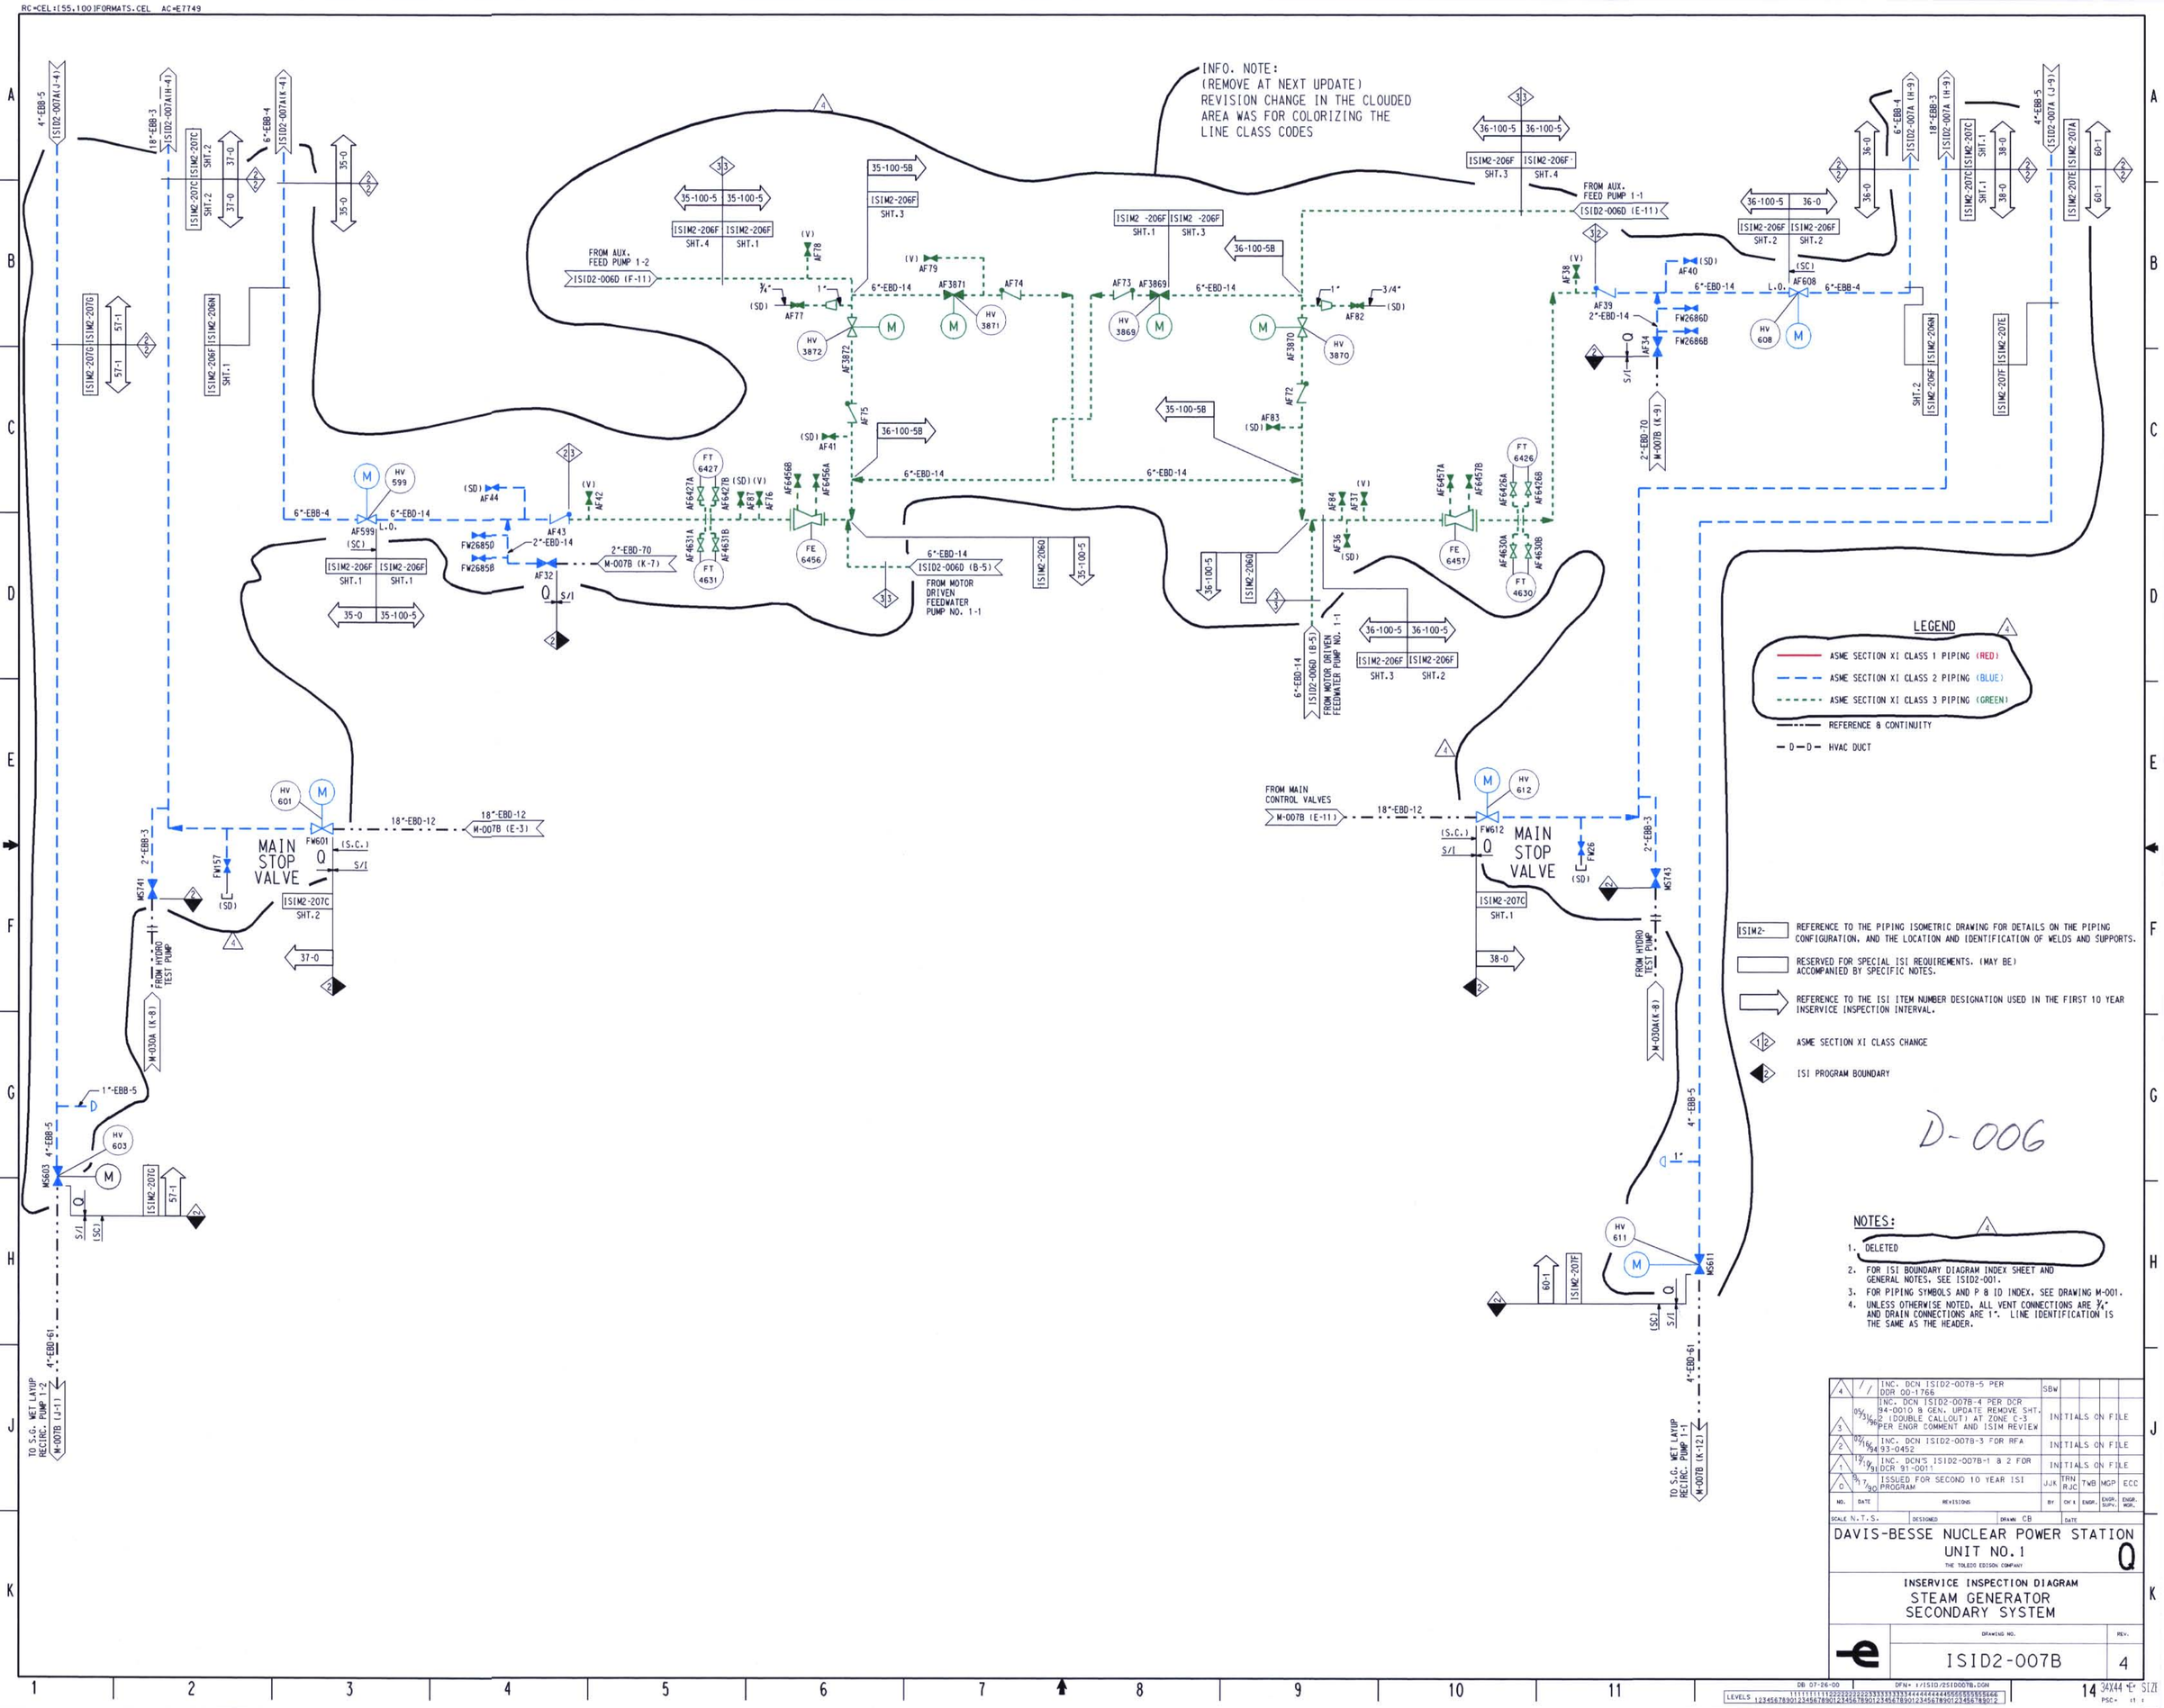

NOTES:

1. DELETED
2. FOR ISI BOUNDARY DIAGRAM INDEX SHEET AND GENERAL NOTES, SEE ISID2-001.
3. FOR PIPING SYMBOLS AND P & ID INDEX, SEE DRAWING M-001.
4. UNLESS OTHERWISE NOTED, ALL VENT CONNECTIONS ARE ¾" AND DRAIN CONNECTIONS ARE 1". LINE IDENTIFICATION IS THE SAME AS THE HEADER.

NO.	DATE	REVISIONS	BY	CH'K	ENGR.	ENGR. SUPV.	ENGR. MGR.
4	/ /	INC. DCN ISID2-007B-5 PER DDR 00-1766	SBW				
3	05/31/96	INC. DCN ISID2-007B-4 PER DCR 94-0010 & GEN. UPDATE REMOVE SHT. 2 (DOUBLE CALLOUT) AT ZONE C-3 PER ENGR COMMENT AND ISIM REVIEW	INITIALS ON FILE				
2	02/16/94	INC. DCN ISID2-007B-3 FOR RFA 93-0452	INITIALS ON FILE				
1	12/10/91	INC. DCN'S ISID2-007B-1 & 2 FOR DCR 91-0011	INITIALS ON FILE				
0	9/17/90	ISSUED FOR SECOND 10 YEAR ISI PROGRAM	JJK	TRN RJC	TWB	MGP	ECC

SCALE N.T.S. DESIGNED DRAWN CB DATE

DAVIS-BESSE NUCLEAR POWER STATION
UNIT NO. 1
THE TOLEDO EDISON COMPANY

Q

INSERVICE INSPECTION DIAGRAM
STEAM GENERATOR
SECONDARY SYSTEM

DRAWING NO. ISID2-007B REV. 4

DB 07-26-00 DFN= I:/ISID/2SID007B.DGN
LEVELS 1234567890123456789012345678901234567890123456789012345678901234567890123456789012
14 34X44 E SIZE
PSC= 1:1