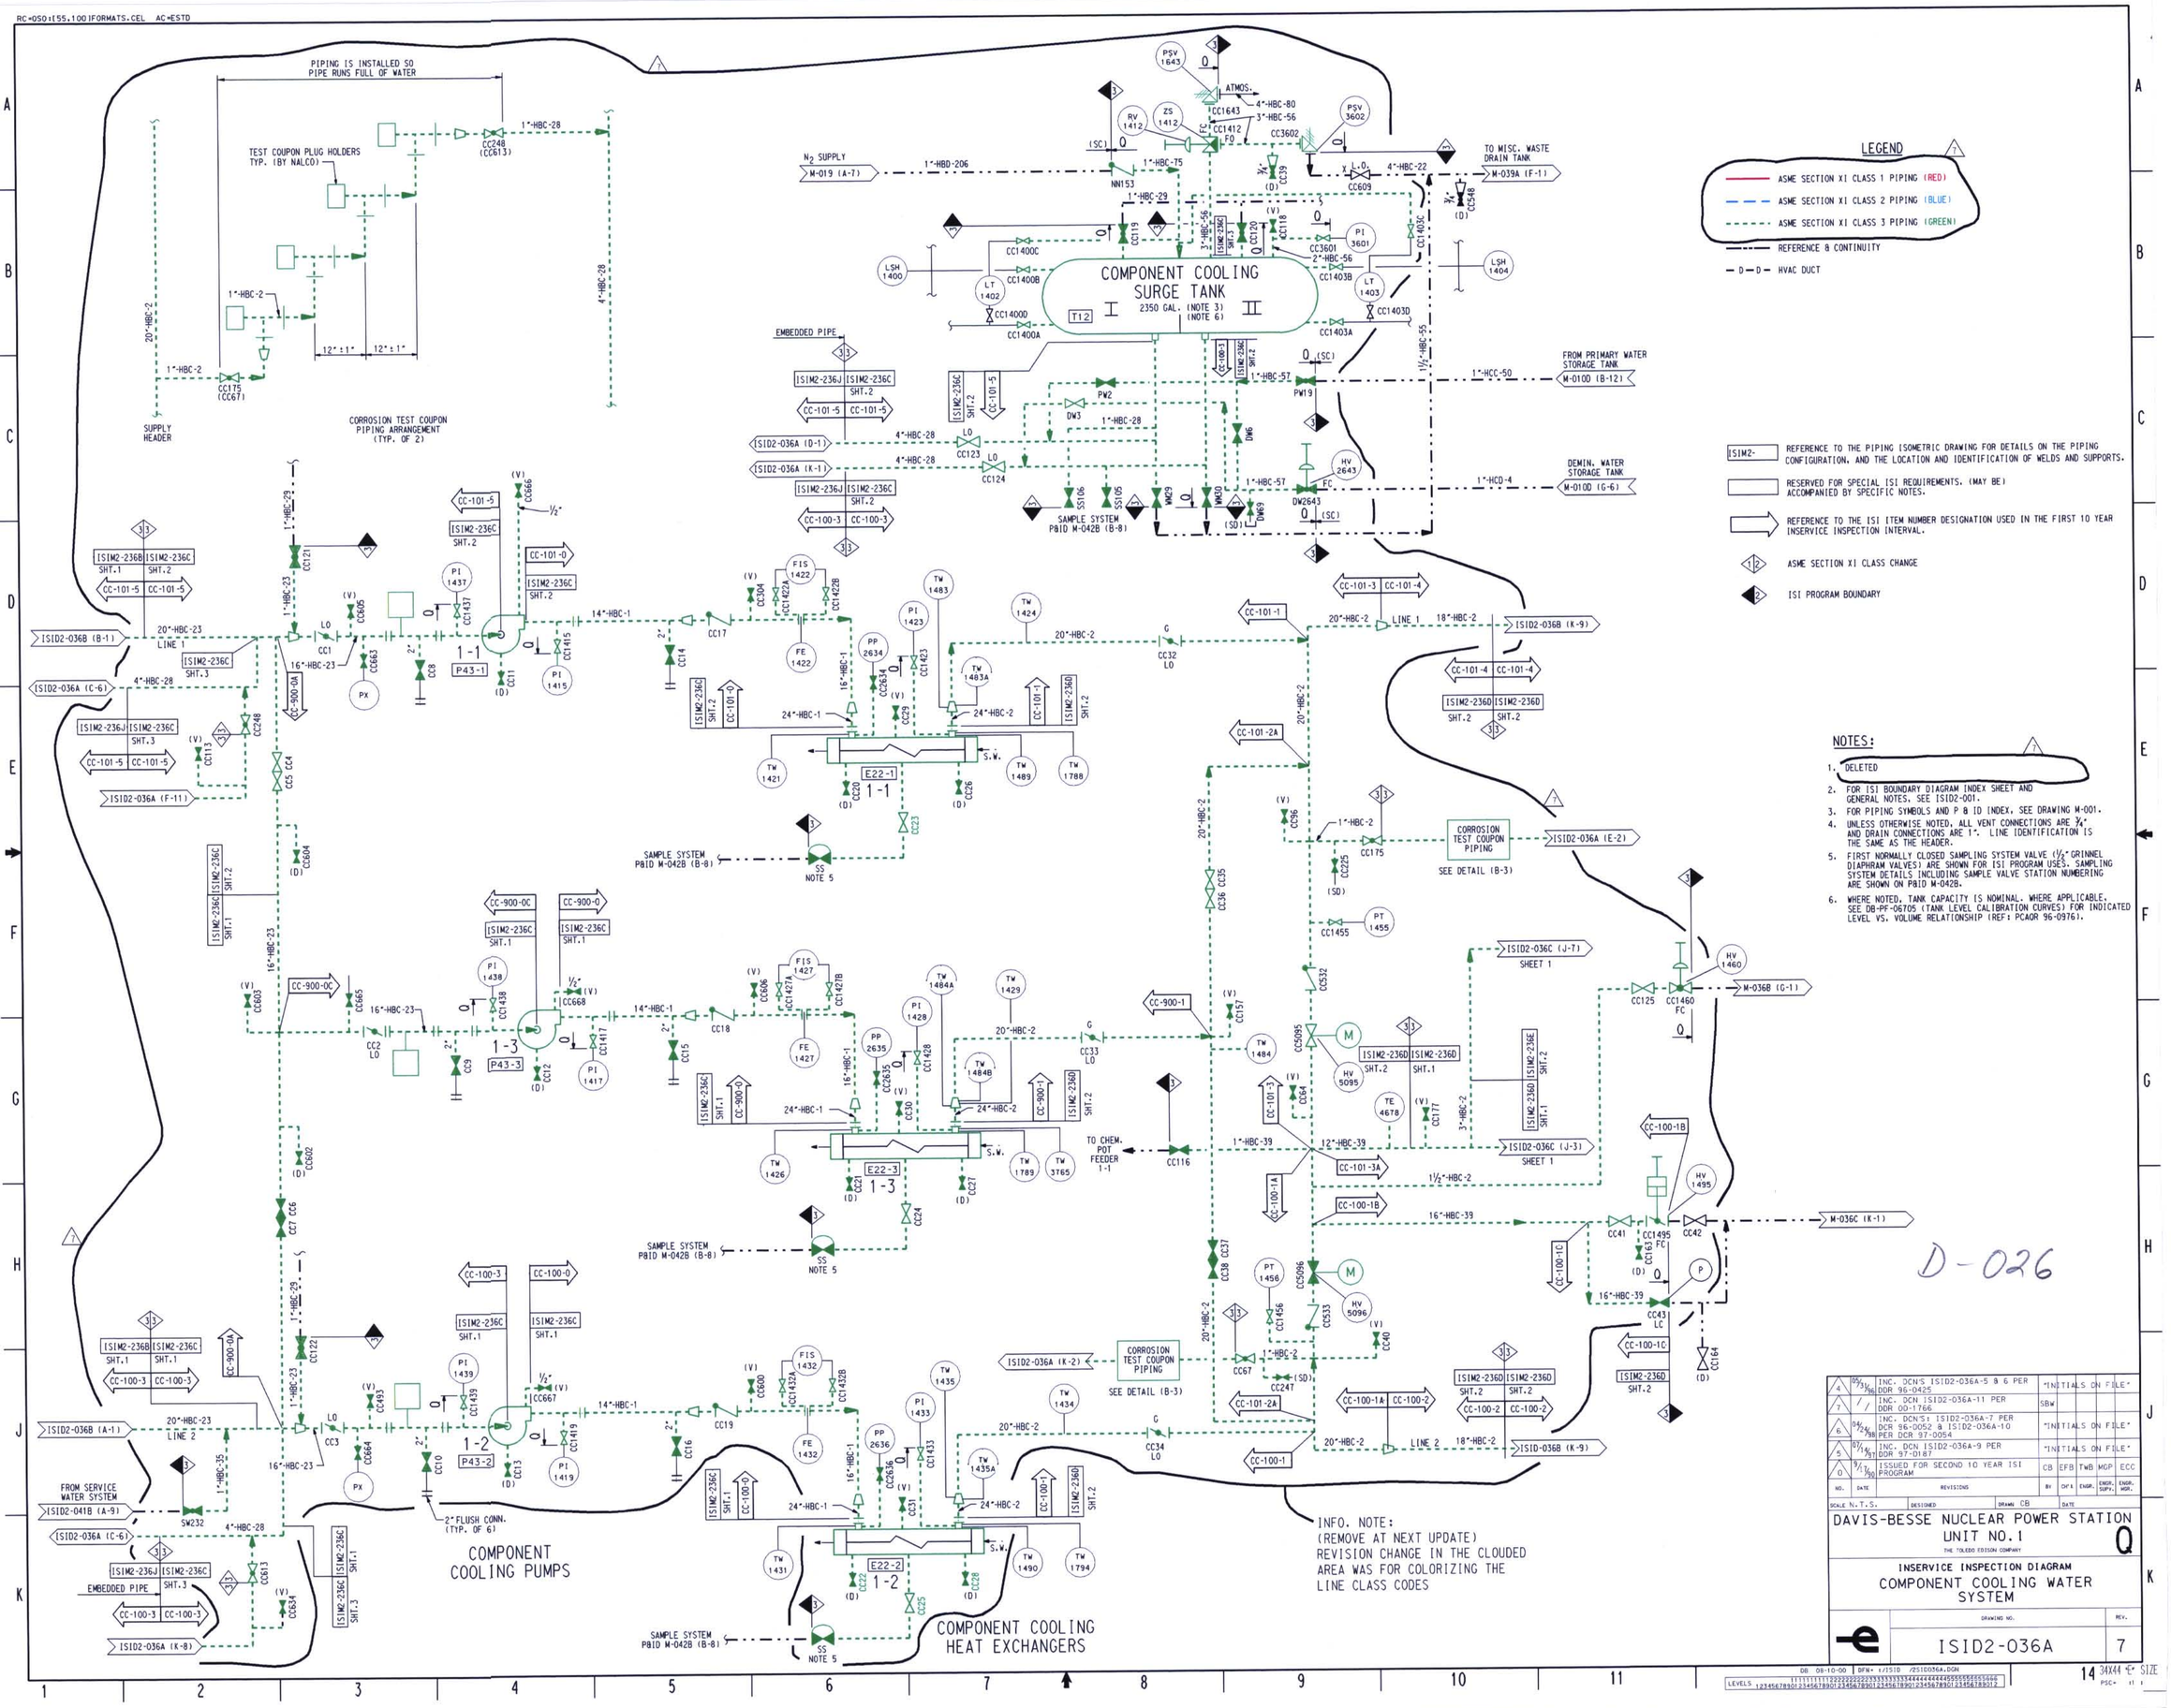

LEGEND

- ASME SECTION XI CLASS 1 PIPING (RED)
- ASME SECTION XI CLASS 2 PIPING (BLUE)
- ASME SECTION XI CLASS 3 PIPING (GREEN)
- REFERENCE & CONTINUITY
- D — D — HVAC DUCT

ISIM2- REFERENCE TO THE PIPING ISOMETRIC DRAWING FOR DETAILS ON THE PIPING CONFIGURATION, AND THE LOCATION AND IDENTIFICATION OF WELDS AND SUPPORTS.

RESERVED FOR SPECIAL ISI REQUIREMENTS. (MAY BE) ACCOMPANIED BY SPECIFIC NOTES.

REFERENCE TO THE ISI ITEM NUMBER DESIGNATION USED IN THE FIRST 10 YEAR INSERVICE INSPECTION INTERVAL.

ASME SECTION XI CLASS CHANGE

ISI PROGRAM BOUNDARY

NOTES:

1. DELETED
2. FOR ISI BOUNDARY DIAGRAM INDEX SHEET AND GENERAL NOTES, SEE ISID2-001.
3. FOR PIPING SYMBOLS AND P & ID INDEX, SEE DRAWING M-001.
4. UNLESS OTHERWISE NOTED, ALL VENT CONNECTIONS ARE ¾" AND DRAIN CONNECTIONS ARE 1". LINE IDENTIFICATION IS THE SAME AS THE HEADER.
5. FIRST NORMALLY CLOSED SAMPLING SYSTEM VALVE (½" GRINNEL DIAPHRAM VALVES) ARE SHOWN FOR ISI PROGRAM USES. SAMPLING SYSTEM DETAILS INCLUDING SAMPLE VALVE STATION NUMBERING ARE SHOWN ON P&ID M-042B.
6. WHERE NOTED, TANK CAPACITY IS NOMINAL. WHERE APPLICABLE, SEE DB-PF-06705 (TANK LEVEL CALIBRATION CURVES) FOR INDICATED LEVEL VS. VOLUME RELATIONSHIP (REF: PCAQR 96-0976).

D-026

NO.	DATE	REVISIONS	BY	CH'K	ENGR.	ENGR. SUPV.	ENGR. MGR.
4	05/31/96	INC. DCN'S ISID2-036A-5 & 6 PER DDR 96-0425	"INITIALS ON FILE"				
7	/ /	INC. DCN ISID2-036A-11 PER DDR 00-1766	SBW				
6	04/24/98	INC. DCN'S: ISID2-036A-7 PER DCR 96-0052 & ISID2-036A-10 PER DCR 97-0054	"INITIALS ON FILE"				
5	07/14/97	INC. DCN ISID2-036A-9 PER DDR 97-0187	"INITIALS ON FILE"				
0	9/17/90	ISSUED FOR SECOND 10 YEAR ISI PROGRAM	CB	EFB	TWB	MGP	ECC

SCALE N.T.S. DESIGNED DRAWN CB DATE

DAVIS-BESSE NUCLEAR POWER STATION
UNIT NO. 1
THE TOLEDO EDISON COMPANY

Q

INSERVICE INSPECTION DIAGRAM
COMPONENT COOLING WATER SYSTEM

DRAWING NO. ISID2-036A REV. 7

DB 08-10-00 DFN= :/ISID /2SID036A.DGN

14 34X44 SIZE PSC= :1 :