RC=CEL;155,100 FORMATS:CEL AC=ESTD

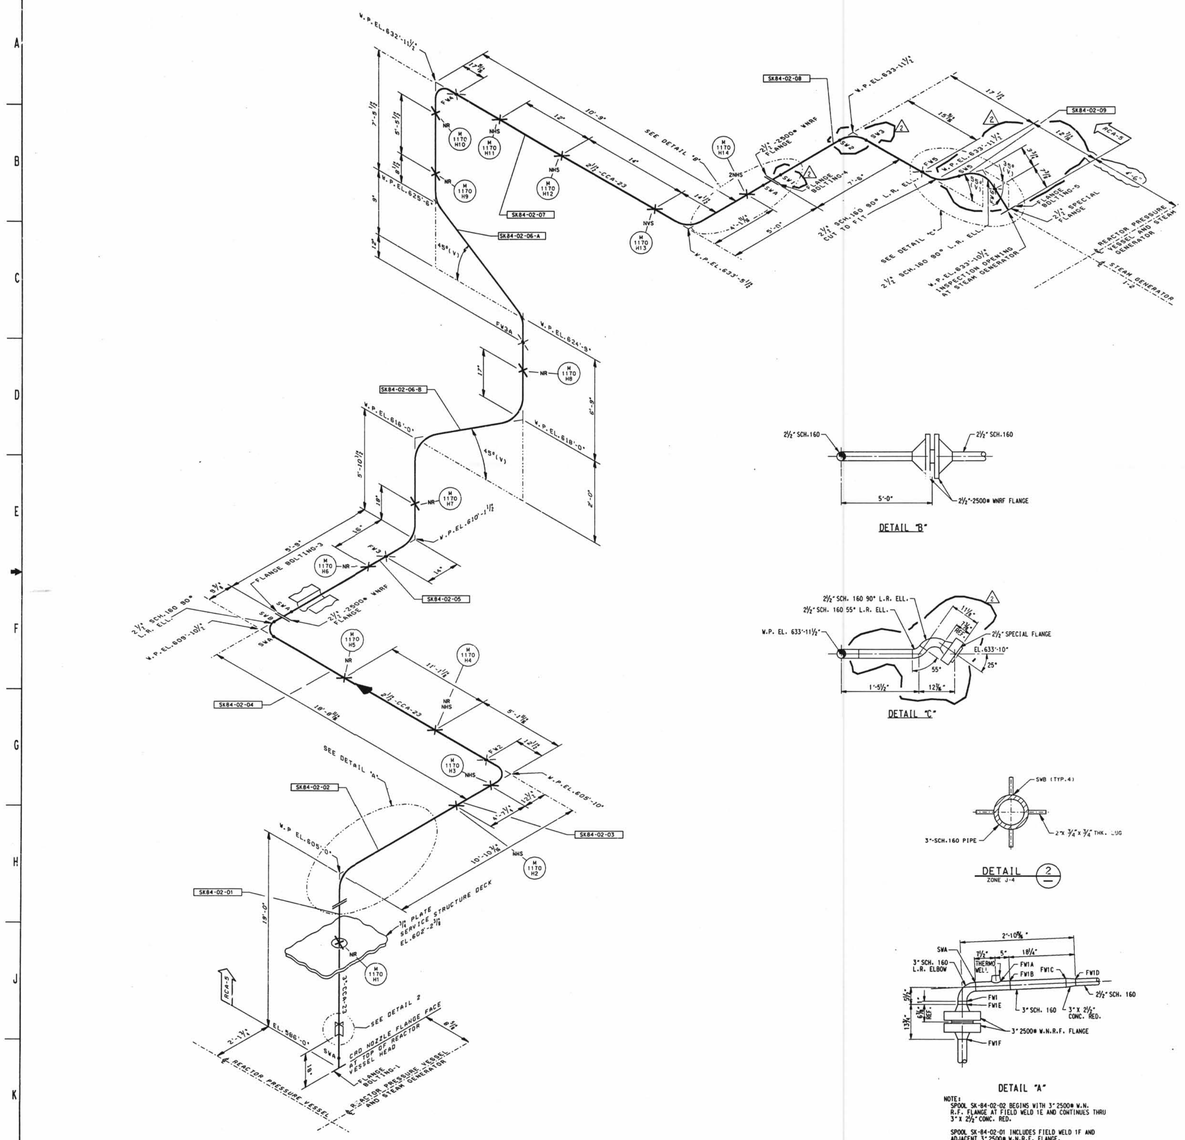

LEGEND

- ASME SECTION XI CLASS 1 PIPING
- ASME SECTION XI CLASS 2 PIPING
- ASME SECTION XI CLASS 3 PIPING
- NON-ISI NUCLEAR CLASS AND HSC CLASS
- PRESSURE BOUNDARY EXTENSION
- REFERENCE & CONTINUITY
- D — D — HVAC DUCT

A	ANCHOR
CS	CONSTANT SPRING HANGER
VS	VARIABLE SPRING HANGER
HS	HYDRAULIC SNUBBER
MS	MECHANICAL SNUBBER
N	NON-WELDED SUPPORT ATTACHMENT
W	WELDED INTEGRAL SUPPORT ATTACHMENT
R	RIGID SUPPORT
T	SWAY STRUT
SW	SHOP WELD
FW	FIELD WELD
LW	LONGITUDINAL WELD
WOL	WELDOLET

⇦ ISI ITEM NUMBER DESIGNATION USED IN THE FIRST 10 YEAR INSERVICE INSPECTION INTERVAL.

NOTES:

1. MULTIPLE SWAY STRUTS, SPRING SUPPORTS OR SNUBBERS IN A SINGLE PIPING SUPPORT ARE SHOWN BY A NUMBER BEFORE THE SUPPORT TYPE. (EXAMPLE: 2HMS - TWO HYDRAULIC TYPE SNUBBERS THAT ARE NOT WELDED INTEGRAL TO THE PIPE).
2. SPOOL NUMBERS SK84-02-06A AND SK84-02-06B ARE FORMED FROM PIPE (NO SHOP WELDS).
3. DIMENSIONS SHOWN ON THIS DRAWING ARE TO BE USED FOR APPROXIMATE LOCATION ONLY. USE DESIGN DRAWINGS FOR DIMENSIONAL VERIFICATION.

REFERENCE DRAWINGS:

ISI02-030A, REACTOR COOLANT SYSTEM

D-068

NO.	DATE	REVISIONS	BY	CH'K	ENGR	SUPR ENGR	SUPV ENGR
1	5/20/94	WC DCN ISIM2-230D-3 FOR MOD 92-0004 SUPP-1	HBW	JE	JE	--	--
2	12/08/94	WC DCN ISIM2-230D-4 FOR EC 94-0002 SUPP-3 INC DCN ISIM2-230D-5 FOR DCR 91-0061	INITIALS			SAN	FILE
3	6-17-96	ISSUED FOR SECOND 10 YEAR ISI PROGRAM	DJR				

SCALE N.T.S. DESIGNED DRAWN CB DATE

DAVIS-BESSE NUCLEAR POWER STATION
UNIT NO. 1
THE TOLEDO EDISON COMPANY

Q

INSERVICE INSPECTION ISOMETRIC
R.V. HEAD TO HOT LEG VENT LINE
CONTAINMENT BUILDING

DRAWING NO. ISIM2-230D REV. 2

14 34X44 SIZE

DB 05-03-93 DFN=:/GDR3/ISIM/ ZIM230.DGN

LEVELS 1234567890123456789012345678901234567890123456789012345678901234567890

I hereby certify that this drawing is an exact copy of the original drawing which was made in the normal and regular course of business on 8/13/93, or on the date stated below and that it is an accurate reproduction of the original drawing.

6-17-93 30X