RC=CEL:[55,100]FORMATS.CEL AC=E7749

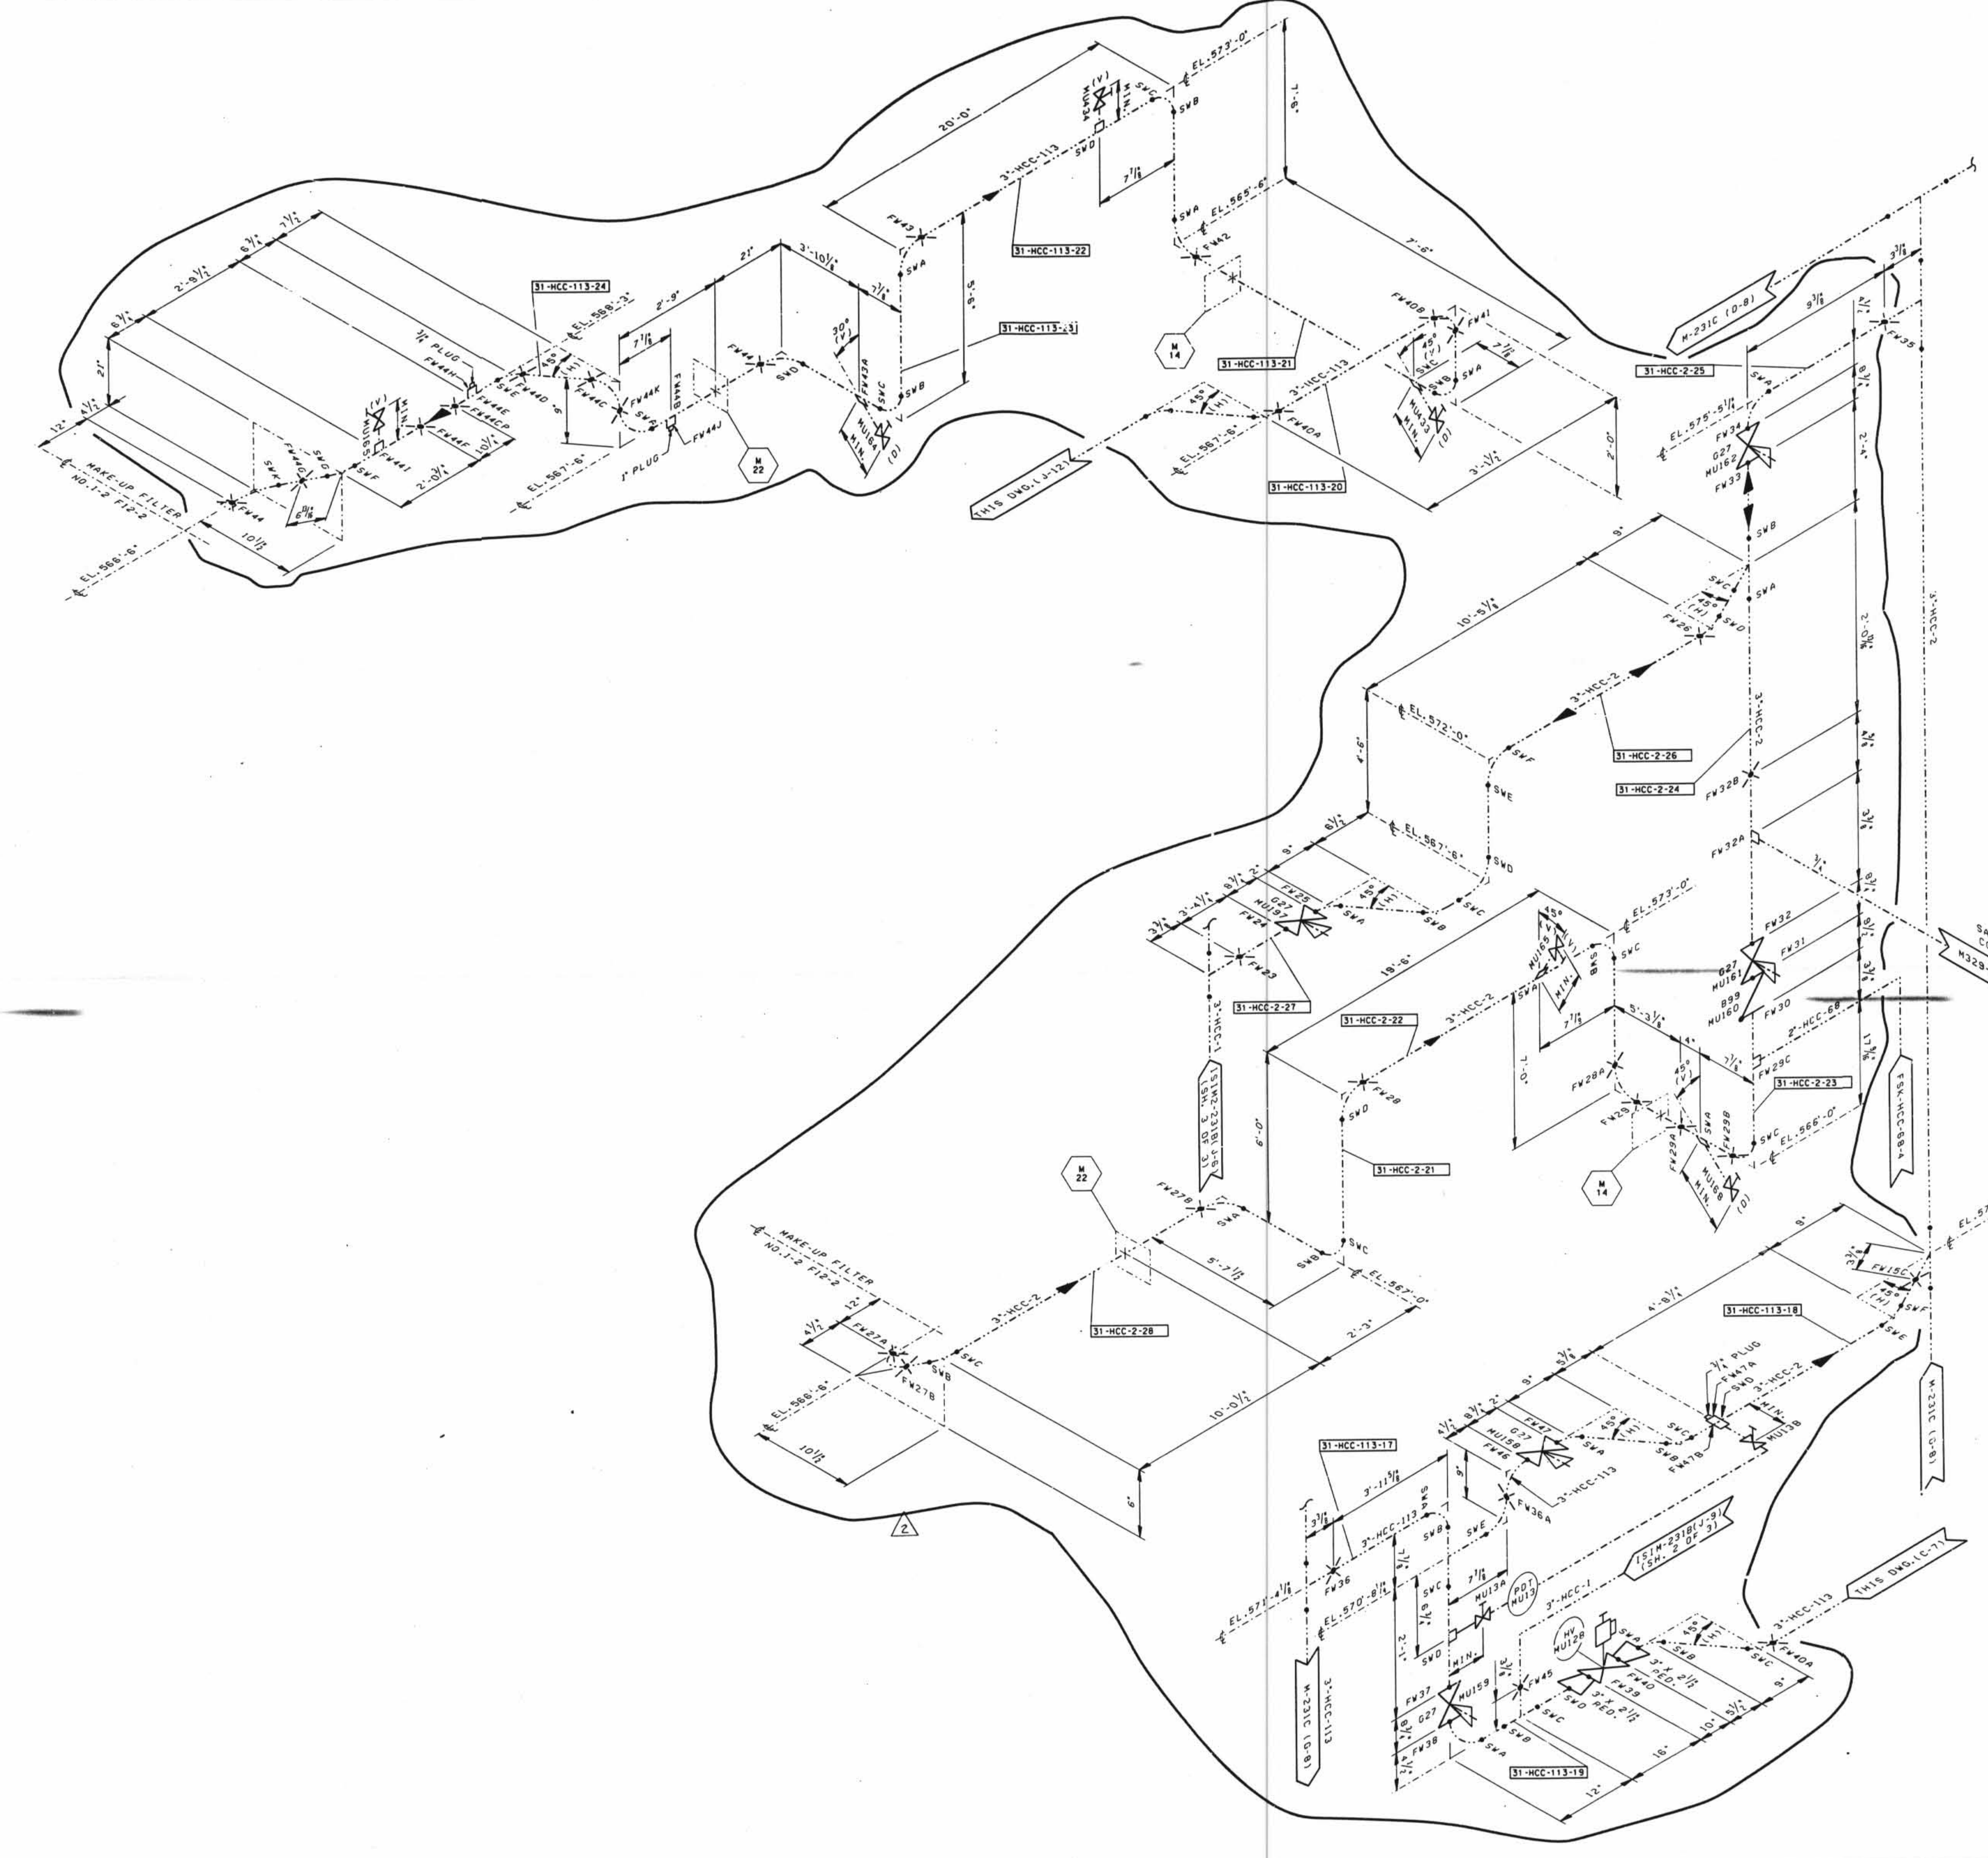

LEGEND

[solid line]	ASME SECTION XI CLASS 1 PIPING
[dashed line]	ASME SECTION XI CLASS 2 PIPING
[dotted line]	ASME SECTION XI CLASS 3 PIPING
[thin line]	NON-ISI NUCLEAR CLASS AND HSC CLASS
[heavy dash line]	PRESSURE BOUNDARY EXTENSION
[dash-dot line]	REFERENCE & CONTINUITY
— D — D —	HVAC DUCT
A	ANCHOR
CS	CONSTANT SPRING HANGER
VS	VARIABLE SPRING HANGER
HS	HYDRAULIC SNUBBER
MS	MECHANICAL SNUBBER
N	NON-WELDED SUPPORT ATTACHMENT
W	WELDED INTEGRAL SUPPORT ATTACHMENT
R	RIGID SUPPORT
T	SWAY STRUT
SW	SHOP WELD
FW	FIELD WELD
LW	LONGITUDINAL WELD
WOL	WELDOLET
⇦	ISI ITEM NUMBER DESIGNATION USED IN THE FIRST 10 YEAR INSERVICE INSPECTION INTERVAL.

NOTES:

1. THE PIPING SYSTEMS ON THIS DRAWING ARE OUTSIDE OF THE ISI BOUNDARY. THEY ARE SHOWN FOR REFERENCE AND CONTINUITY PURPOSES ONLY. THE CONFIGURATION SHOWN MAY NOT REPRESENT THE ACTUAL AS-BUILT CONDITION.

GENERAL NOTES:

DIMENSIONS SHOWN ON THIS DRAWING ARE TO BE USED FOR APPROXIMATE LOCATION ONLY. USE DESIGN DRAWINGS FOR DIMENSIONAL VERIFICATION.

REFERENCE DRAWINGS:

M-231D MAKEUP AND PURIFICATION SYSTEM AUXILIARY BUILDING - SHEET 3

D-076

NO.	DATE	REVISIONS	BY	CH'K	ENGR.	ENGR. SUPV.	ENG. MGR.
2		INC DCN 1SIM2-231D-4 PER RFA 92-0232	JOR				
1	4-22-92	INC DCN 1SIM2-231D-3 PER DCR 91-0011	"INITIALS ON FILE"				
0	9-17-90	ISSUED FOR SECOND 10 YEAR ISI PROGRAM	CB	GFB	LLC	CB	CB

SCALE N.T.S. DESIGNED DRAWN CB DATE

DAVIS-BESSE NUCLEAR POWER STATION
UNIT NO. 1
THE TOLEDO EDISON COMPANY

Q

INSERVICE INSPECTION ISOMETRIC
MAKE-UP AND PURIFICATION SYSTEM
AUXILIARY BUILDING - SHEET 7

DRAWING NO. 1SIM2-231D (SHEET 3) REV. 2

DB 08-25-92 DFN=F:\1SIM\21M23103.DGN

34X44 "E" SIZE

I CERTIFY THAT THE IMAGE CONTAINED ON THIS FRAME WAS MADE IN THE NORMAL AND REGULAR COURSE OF BUSINESS, ON THE DATE STATED BELOW AND THAT IT IS AN ACCURATE REPRODUCTION OF THE RECORD(S) SUBMITTED TO NUCLEAR RECORDS MANAGEMENT.