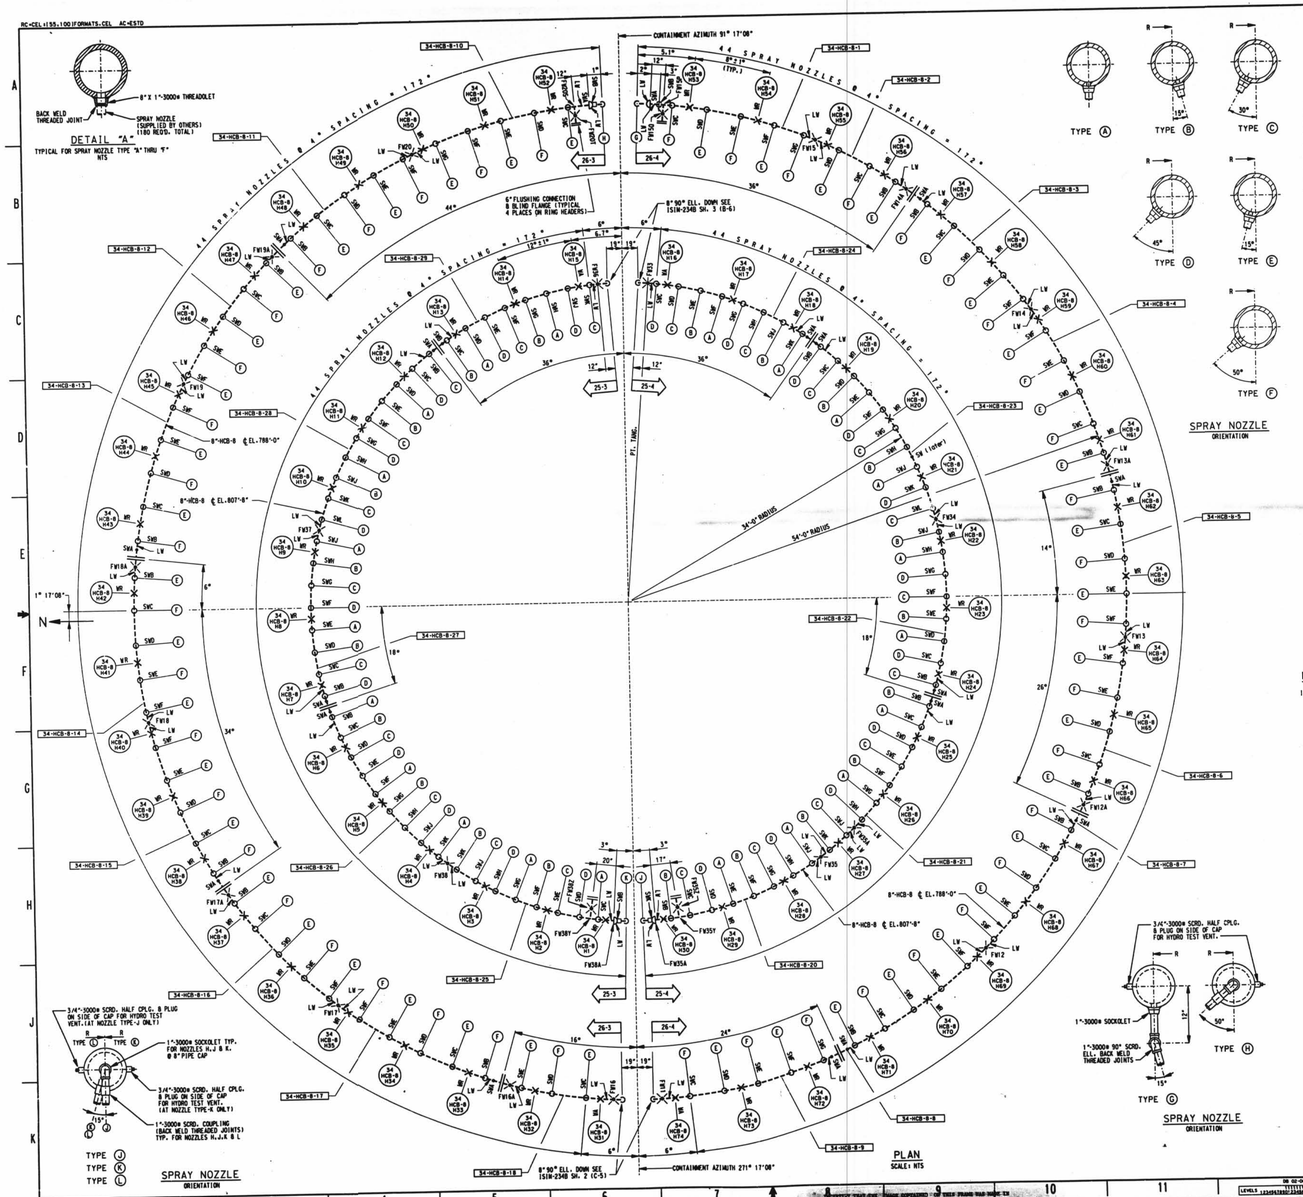

LEGEND

- ASME SECTION XI CLASS 1 PIPING
- ASME SECTION XI CLASS 2 PIPING
- ASME SECTION XI CLASS 3 PIPING
- NON-ISI NUCLEAR CLASS AND NSC CLASS
- PRESSURE BOUNDARY EXTENSION
- REFERENCE & CONTINUITY
- — D — D — HVAC DUCT

A	ANCHOR
CS	CONSTANT SPRING HANGER
VS	VARIABLE SPRING HANGER
HS	HYDRAULIC SNUBBER
MS	MECHANICAL SNUBBER
N	NON-WELDED SUPPORT ATTACHMENT
W	WELDED INTEGRAL SUPPORT ATTACHMENT
R	RIGID SUPPORT
T	SWAY STRUT
SW	SHOP WELD
FW	FIELD WELD
LW	LONGITUDINAL WELD
⇦	ISI ITEM NUMBER DESIGNATION USED IN THE FIRST 10 YEAR INSERVICE INSPECTION INTERVAL.

NOTES:

1. MULTIPLE SWAY STRUTS, SPRING SUPPORTS OR SNUBBERS IN A SINGLE PIPING SUPPORT ARE SHOWN BY A NUMBER BEFORE THE SUPPORT TYPE. (EXAMPLE: 2HMS - TWO HYDRAULIC TYPE SNUBBERS THAT ARE NOT WELDED INTEGRAL TO THE PIPE).
2. THE CONTAINMENT SPRAY LINE 8"-HCB-8 WELDS AND SUPPORTS ARE EXEMPT FROM INSERVICE EXAMINATION REQUIREMENTS PER IWC 1220. THE WELDS AND SUPPORTS SHOWN MAY NOT REPRESENT THE ACTUAL AS-BUILT CONDITION.

GENERAL NOTE

DIMENSIONS SHOWN ON THIS DRAWING ARE TO BE USED FOR APPROXIMATE LOCATION ONLY. USE DESIGN DRAWINGS FOR DIMENSIONAL VERIFICATION.

1

REFERENCE DRAWINGS:

ISI02-034 EMERGENCY CORE COOLING SYSTEM CONTAINMENT SPRAY AND CORE FLOODING SYSTEMS

D-095

NO.	DATE	REVISIONS	BY	CK'D	ENGR.	ENGR. SUPV.	ENG. MGR.
1	2/4/90	INC. DCN ISIM2-234B-1 FOR DCR 91-001I	JFS				
0	5/4/90	ISSUED FOR SECOND 10 YEAR ISI PROGRAM	CB	EFB	LLC	MGP	ECC

SCALE N.T.S. DESIGNED DRAWN CB DATE

DAVIS-BESSE NUCLEAR POWER STATION
UNIT NO.1 Q

THE TOLEDO EDISON COMPANY

INSERVICE INSPECTION ISOMETRIC
CONTAINMENT SPRAY SYSTEM
CONTAINMENT BUILDING

DRAWING NO. ISIM2-234B (SHEET 1 OF 3) REV. 1

14 34X44 E SIZE

DATE 5-22-92 OPERATOR