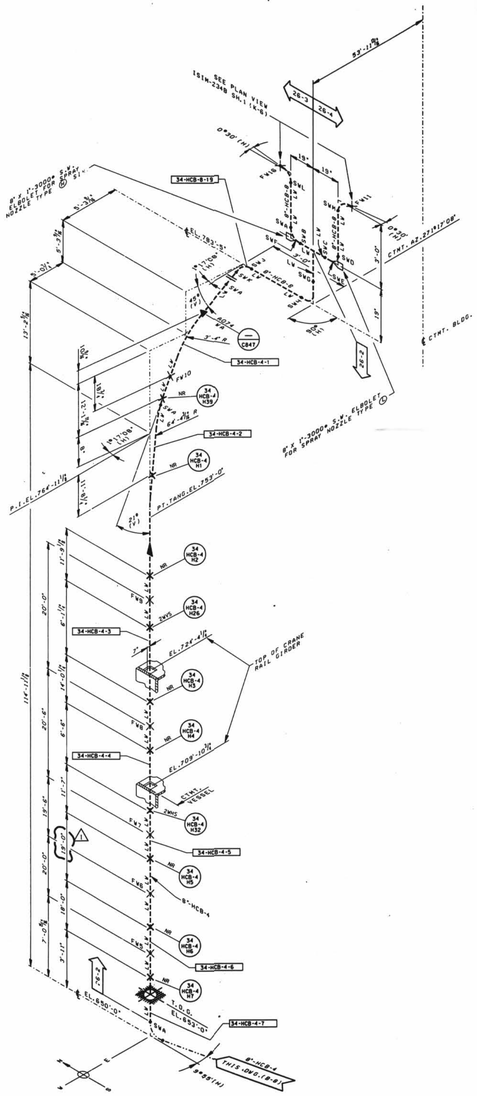

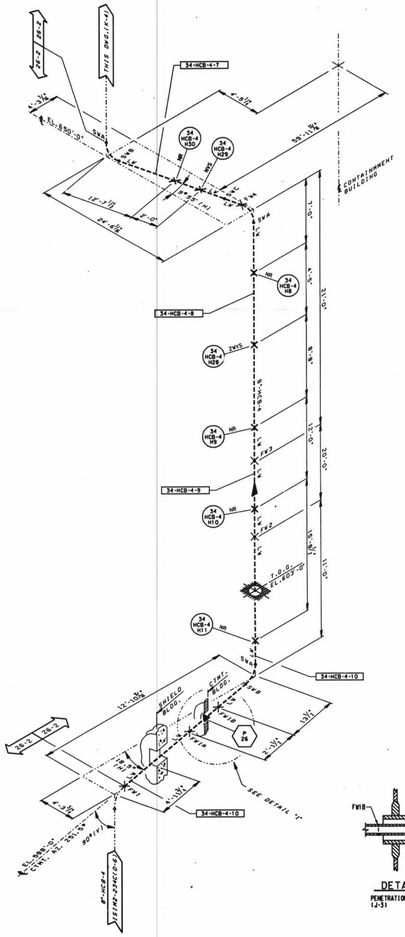



DETAIL 1
PENETRATION NO.P-26
12-31

LEGEND

- ASME SECTION XI CLASS 1 PIPING
- ASME SECTION XI CLASS 2 PIPING
- ASME SECTION XI CLASS 3 PIPING
- NON-ISI NUCLEAR CLASS AND HSC CLASS
- PRESSURE BOUNDARY EXTENSION
- REFERENCE & CONTINUITY
- HVAC DUCT

A	ANCHOR
CS	CONSTANT SPRING HANGER
VS	VARIABLE SPRING HANGER
HS	HYDRAULIC SNUBBER
MS	MECHANICAL SNUBBER
N	NON-WELDED SUPPORT ATTACHMENT
W	WELDED INTEGRAL SUPPORT ATTACHMENT
R	RIGID SUPPORT
T	SWAY STRUT
SW	SHOP WELD
FW	FIELD WELD
LW	LONGITUDINAL WELD

ISI ITEM NUMBER DESIGNATION USED IN THE FIRST 10 YEAR INSERVICE INSPECTION INTERVAL.

NOTES:

1. MULTIPLE SWAY STRUTS, SPRING SUPPORTS OR SNUBBERS IN A SINGLE PIPING SUPPORT ARE SHOWN BY A NUMBER BEFORE THE SUPPORT TYPE. (EXAMPLE: 2HMS - TWO HYDRAULIC TYPE SNUBBERS THAT ARE NOT WELDED INTEGRAL TO THE PIPE).
2. THE CONTAINMENT SPRAY LINES 8"-HCB-8 AND 8"-HCB-4 WELDS AND SUPPORTS ARE EXEMPT FROM INSERVICE EXAMINATION REQUIREMENTS PER IWC 1220. THE WELDS AND SUPPORTS SHOWN MAY NOT REPRESENT THE ACTUAL AS-BUILT CONDITION.

GENERAL NOTE

DIMENSIONS SHOWN ON THIS DRAWING ARE TO BE USED FOR APPROXIMATE LOCATION ONLY. USE DESIGN DRAWINGS FOR DIMENSIONAL VERIFICATION.

REFERENCE DRAWINGS:

ISI02-034 EMERGENCY CORE COOLING SYSTEM CONTAINMENT SPRAY AND CORE FLOODING SYSTEMS

D-096

NO.	DATE	REVISIONS	BY	CK'D	ENGR.	SUP'T	ISI
1		INC. DCN ISIM2-234B-2 FOR DCR R1-001	JFS				
0		ISSUED FOR SECOND 10 YEAR ISI PROGRAM	LPW	TWB BJC	TWB	MGP	ECC

SCALE N.T.S. DESIGNED: DRAWN: CB DATE

DAVIS-BESSE NUCLEAR POWER STATION
UNIT NO. 1
THE TOLEDO EDISON COMPANY

INSERVICE INSPECTION ISOMETRIC
CONTAINMENT SPRAY SYSTEM
CONTAINMENT BUILDING

DRAWING NO. ISIM2-234B (SHEET 2) REV. 1

DR 02-06-92 DRW: I:\DSW-D\MCH\ISI\ISIM2-234B - DCN
LEVELS: 1234567890123456789012345678901234567890123456789012345678901234567890