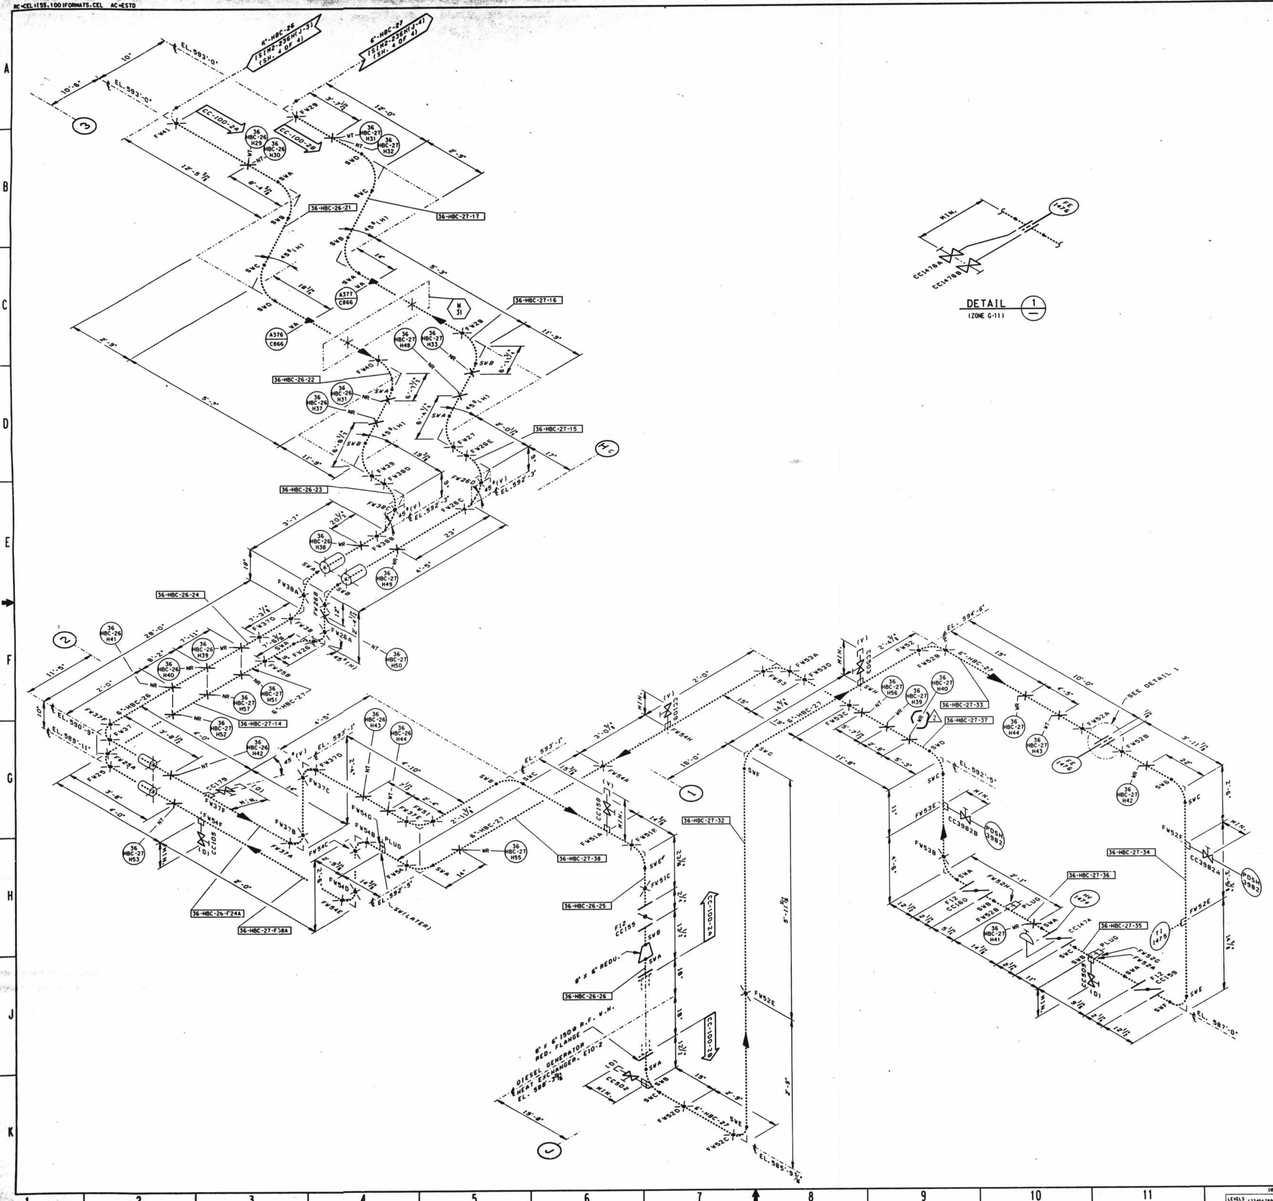



DETAIL 1
(ZONE G-11)

## LEGEND

- ASME SECTION XI CLASS 1 PIPING
- ASME SECTION XI CLASS 2 PIPING
- ASME SECTION XI CLASS 3 PIPING
- NON-ISI NUCLEAR CLASS AND HSC CLASS
- PRESSURE BOUNDARY EXTENSION
- REFERENCE & CONTINUITY
- HVAC DUCT
- A ANCHOR
- CS CONSTANT SPRING HANGER
- VS VARIABLE SPRING HANGER
- HS HYDRAULIC SNUBBER
- MS MECHANICAL SNUBBER
- N NON-WELDED SUPPORT ATTACHMENT
- W WELDED INTEGRAL SUPPORT ATTACHMENT
- R RIGID SUPPORT
- T SWAY STRUT
- SW SHOP WELD
- FW FIELD WELD
- LW LONGITUDINAL WELD
- WOL WELDOLET
- ISI ITEM NUMBER DESIGNATION USED IN THE FIRST 10 YEAR INSERVICE INSPECTION INTERVAL.

## NOTES:

1. MULTIPLE SWAY STRUTS, SPRING SUPPORTS OR SNUBBERS IN A SINGLE PIPING SUPPORT ARE SHOWN BY A NUMBER BEFORE THE SUPPORT TYPE. (EXAMPLE: 2HMS - TWO HYDRAULIC TYPE SNUBBERS THAT ARE NOT WELDED INTEGRAL TO THE PIPE).
2. THE SUPPORTS ON THE COMPONENT COOLING LINE 6"-HBC-26, AND 6"-HBC-27 ARE WITHIN THE ISI EXAMINATION BOUNDARY. THE PIPING WELDS IN THESE LINES ARE SHOWN FOR REFERENCE PURPOSES ONLY. THESE WELDS MAY NOT BE REPRESENTED IN THE ACTUAL AS-BUILT CONDITION.

## GENERAL NOTE:

DIMENSIONS SHOWN ON THIS DRAWING ARE TO BE USED FOR APPROXIMATE LOCATION ONLY. USE DESIGN DRAWINGS FOR DIMENSIONAL VERIFICATION.

## REFERENCE DRAWINGS:

1S102-036B COMPONENT COOLING WATER SYSTEM

D-124

| NO. | DATE | REVISIONS | BY | CH'K | ENGR | SUPV. ENGR. | SUPV. OPER. |
|---|---|---|---|---|---|---|---|
| 1 | 7-1-97 | INC DCN 1S1M2-236H-5 PER DCR 97-1067 | SBW | D/A | — | JFW | — |
| 0 | 5-21-92 | INC DCN 1S1M2-236H-2 FOR DCR 91-0201 | INITIALS ON FILE | | | | |
| A | 9/17/89 | ISSUED FOR SECOND 10 YEAR ISI PROGRAM | CB | LFB | LLC | MGP | ECC |

Was N.T.S. DESIGNED DRAWN CB DATE

DAVIS-BESSE NUCLEAR POWER STATION
UNIT NO. 1

Q

THE TOLEDO EDISON COMPANY

INSERVICE INSPECTION ISOMETRIC
COMPONENT COOLING SYSTEM SUPPLY AND RETURN EMERG. DIESEL GENS.

DRAWING NO. ISIM2-236H SHEET 2 REV. 2

SIZE 14 24X44 PEC- 41

DR 06-24-98

DRAW# 1-1S1M-2236H01 - DGN

LEVELS: 123456789012345678901234567890123456789

I CERTIFY THAT THE IMAGE CONTAINED ON THIS FRAME WAS MADE IN THE NORMAL COURSE OF BUSINESS BY THE TOLEDO EDISON COMPANY NUCLEAR DIVISION DAVIS-BESSE N.P.S.

DATE 7-6-97 OPERATOR

30X