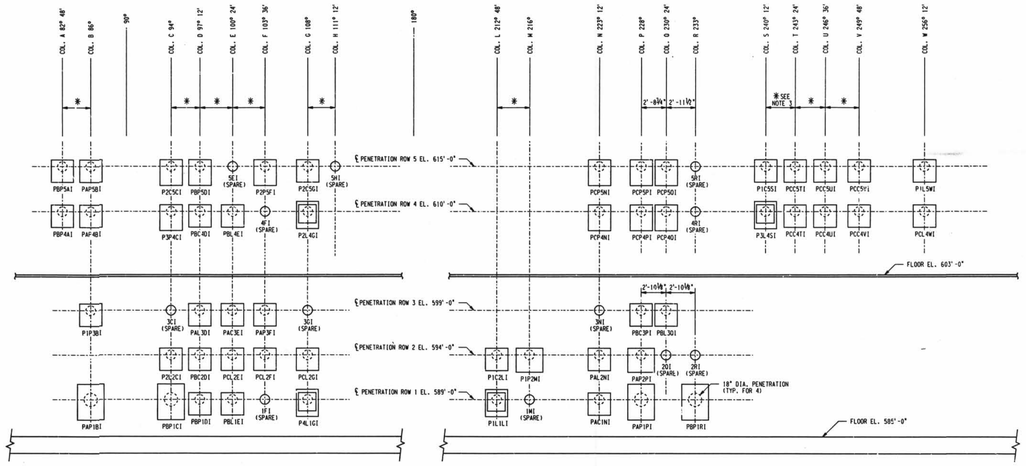

SECTION A-A
SCALE: 1/4" = 1'-0"

NOTES

1. DIMENSIONS NOTED * ARE 3'-7 7/8" UNLESS NOTED OTHERWISE.
2. THE PENETRATIONS SHOWN ON THIS DRAWING ARE SUBJECTED TO THE RULES OF IWE.

REFERENCE DWGS.

E371 ELECTRICAL PENETRATION ARRG'T CONTAINMENT VESSEL

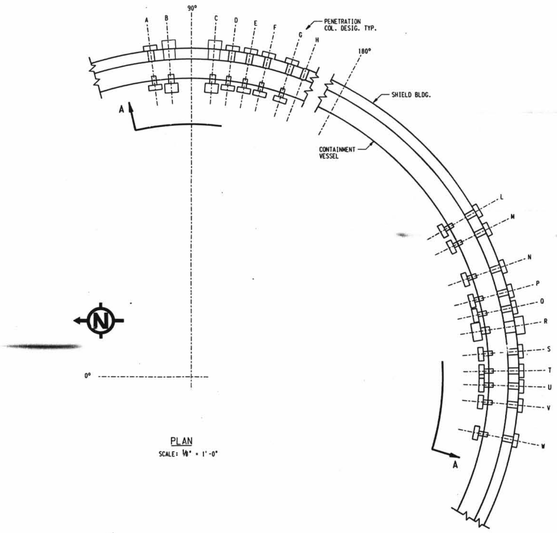

PLAN
SCALE: 1/4" = 1'-0"

D-150

NO.	DATE	REVISIONS	BY	CK'D	ENGR.	ENGR. SUPV.	DSN. SUPV.
0	12/22	ISSUED FOR IMPLEMENTATION FOR SECTION 11 IWE	SBW	[illegible]	[illegible]	[illegible]	–

SCALE AS SHOWN | DESIGNED CD | DRAWN SBW | DATE 12-22-96

DAVIS-BESSE NUCLEAR POWER STATION
UNIT NO. 1
THE TOLEDO EDISON COMPANY

Q

INSERVICE INSPECTION DRAWING
ELECTRICAL PENETRATION ARRG'T
CONTAINMENT VESSEL

DRAWING NO. ISIM2-E371 | REV. 0

DB 12-22-96

DFN:/ISIM /ISIM2-E371 .DGN

I CERTIFY THAT THE INFO. PRESENTED ON THIS FACE WAS PREPARED BY THE DESIGN AND DRAFTING GROUP OF D.E.P.S., ON THE DATE INDICATED BELOW AND THAT IT IS AN ACCURATE REPRESENTATION OF THE APPROVED DESIGN. DESIGN MANAGER [illegible]

30X