


Docket No. 50-259

October 9, 1981

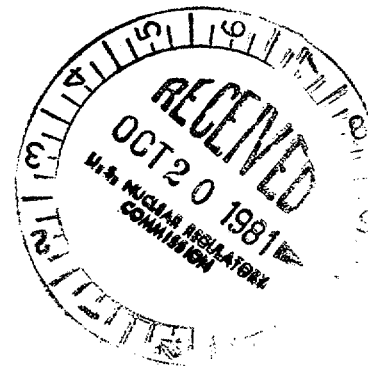

Mr. HughtG. Parris
Manager of Power
Tennessee Valley Authority
500A Chestnut Street, Tower II
Chattanooga, Tennessee 37401

Dear Mr. Parris:

On September 15, 1981, we issued Amendment No. 76 to Facility License No. DPR-33 for the Browns Ferry Nuclear Plant, Unit No. 1. The revision to Table 3.2.F of the Technical Specifications reflected the addition of the new hydrogen monitoring system installed in Unit No. 1 during the refueling outage but did not include the operability requirements on the relief valve monitors that had been added by a recent prior amendment (Amendment No. 71). A corrected page 79 for the Unit No. 1 Technical Specifications is enclosed.

Sincerely,

Richard Clark, Project Manager
Operating Reactors Branch #2
Division of Licensing

Enclosure: p. 79

cc: See next page

DISTRIBUTION
Docket File
NRC PDR
Local PDR
D. Eisenhut
T. Ippolito
S. Norris
D. Clark
ORB #2 Rdg.
J. Heltemes, AEOD
OELD
I&E (3)
NSIC
TERA
ACRS (10)

OFFICE	ORB #2	ORB #2	ORB #2			
SURNAME	S. Norris	D. Clark	T. Ippolito	8111090032	811009	
DATE	10/9/81	10/09/81	10/9/81	PDR	ADOCK 05000259	PDR

Mr. Hugh G. Parris

cc:

H. S. Sanger, Jr., Esquire
General Counsel
Tennessee Valley Authority
400 Commerce Avenue
E 11B 33 C
Knoxville, Tennessee 37902

Mr. Ron Rogers
Tennessee Valley Authority
400 Chestnut Street, Tower II
Chattanooga, Tennessee 37401

Mr. H. N. Culver
249A HBD
400 Commerce Avenue
Tennessee Valley Authority
Knoxville, Tennessee 37902

Robert F. Sullivan
U. S. Nuclear Regulatory Commission
P. O. Box 1863
Decatur, Alabama 35602

Athens Public Library
South and Forrest
Athens, Alabama 35611

Mr. John F. Cox
Tennessee Valley Authority
W9-D 207C
400 Commerce Avenue
Knoxville, Tennessee 37902

Mr. Herbert Abercrombie
Tennessee Valley Authority
P. O. Box 2000
Decatur, Alabama 35602

B11090035 B11009
PDR ADDCK 05000259
PDR

TABLE 3.2.F
Surveillance Instrumentation

<u>Minimum # of Operable Instrument Channels</u>	<u>Instrument #</u>	<u>Instrument</u>	<u>Type Indication and Range</u>	<u>Notes</u>
2	H ₂ M - 76 - 94	Drywell and Torus Hydrogen Concentration	0.1 - 20%	(1)
	H ₂ M - 76 - 104			
2	PdI-64-137 PdI-64-138	Drywell to Suppression Chamber Differential pressure	Indicator 0 to 2 psid	(1) (2) (5)
1/Valve		Relief Valve Tailpipe Thermocouple Temperature or Acoustic Monitor on Relief Valve Tailpipe		(5)

79