



Entergy Nuclear Northeast
Entergy Nuclear Operations, Inc.
440 Hamilton Avenue
P. O. Box 5029
White Plains, NY 10601-5029
Tel 914 272 3500

December 3, 2001
JPN-01-020

U.S. Nuclear Regulatory Commission
ATTN: Document Control Desk
Mail Stop O-P1-17
Washington, DC 20555-0001

Subject: James A. FitzPatrick Nuclear Power Plant
Docket No. 50-333
License No. DPR-59
Relief Request RR-28 for
Third 10-Year Inservice Inspection Interval Program Plan


Reference: 1. USNRC Letter, R. Emch to H. Sumner, dated May 31, 2000, regarding
"Edwin I. Hatch Nuclear Plant, Units 1 and 2 – Third Ten-Year Interval
Inservice Inspection Program, Relief Request Nos. RR-25 and RR-26
(TAC Nos. MA6123 and MA6124)"

Dear Sir:

This letter submits a request for relief to use ASME Section XI Code Case N-562-1 for weld overlay on carbon steel service water piping under the Third Ten Year Inservice Inspection Interval Program Plan for the James A. FitzPatrick Nuclear Power Plant. A similar request for relief was approved for the Hatch Plant, Units 1 and 2 (Reference 1). Approval for this relief request is needed by May 30, 2002 to support planning and resource scheduling of the upcoming Refueling Outage R015.

There are no new commitments made by this letter. If you have any questions, please contact Ms. Charlene Faison at 914-272-3378.

Very truly yours,

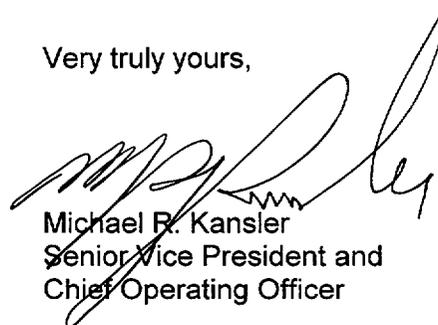

Michael R. Kansler
Senior Vice President and
Chief Operating Officer

cc: next page

A047

cc: Regional Administrator, Region I
U.S. Nuclear Regulatory Commission
475 Allendale Road
King of Prussia, PA 19406

Resident Inspector's Office
James A. FitzPatrick
U.S. Nuclear Regulatory Commission
P.O. Box 136
Lycoming, NY 13093

Mr. Guy S. Vissing, Project Manager
Project Directorate I-1
Division of Reactor Projects I/II
U.S. Nuclear Regulatory Commission
Mail Stop 14 B2
Washington, DC 20555

**JAMES A. FITZPATRICK
THIRD INSPECTION INTERVAL
RELIEF REQUEST NO. 28, Rev. 0, 12/03/01**

A: ARTICLE IDENTIFICATION/COMPONENT IDENTIFICATION:

IWA-4000/All ISI Class 3 moderate energy service water piping.

B: REPAIR REQUIREMENTS

ASME Code, Section XI, IWA-4310 requires that the defect be removed or reduced in size in accordance with Article IWA.

C: RELIEF REQUESTED:

Relief is requested from removing defects and repairing in accordance with the design specification or the original construction code for internal wall thinning or pitting resulting from conditions such as, but not limited to, microbiological corrosion; cavitations induced pitting; erosion/corrosion and/or localized pitting corrosion.

The ASME Section XI Code Committee recognized that an alternative repair approach existed for internal wall thinning of Class 3 piping systems which have experienced degradation mechanisms such as flow-assisted corrosion and/or microbiological corrosion that would provide an acceptable repair configuration. This alternative repair technique as described in Code Case N-562-1 involves the application of additional weld metal on the exterior of the piping system, which restores the wall thickness requirement. Code Case N-562-1 was approved by the ASME Section XI Code Committee on December 31, 1996. However, it has not been incorporated into NRC Regulatory Guide 1.147 and thus is not available for application at nuclear power plants.

Pursuant to 10 CFR 50.55a(a)(3)(i), relief is requested on the basis that the proposed alternative will provide an acceptable level of quality and safety. This relief request applies to all ASME Class 3 moderate energy (i.e., less than or equal to 200°F and/or less than or equal to 275 psig maximum operating conditions) carbon steel plant service water piping systems.

Entergy Nuclear Operations, Inc. (ENO) also proposes to use the following welding processes for the weld overlay: Shielded Metal Arc Welding (SMAW); Gas Tungsten Arc Welding (GTAW) -manual and/or automated); Gas Metal Arc Welding (GMAW) and Flux Cored Arc Welding (FCAW). The overlays may be installed on water backed piping or piping that is empty.

D: BASIS FOR RELIEF

Code Case N-562-1 provides alternative requirements to those of IWA-4000 and for the repair of internal piping system defects or degradation. The ASME XI Code Committee determined that the weld overlay would ensure that an adequate level of quality and safety was being maintained. Therefore, the proposed alternative is justified per 10CFR50.55a(a)(3)(i) as the proposed repair will provide an acceptable level of quality and

**JAMES A. FITZPATRICK
THIRD INSPECTION INTERVAL
RELIEF REQUEST NO. 28, Rev. 0, 12/03/01**

safety. The primary purpose for implementing this repair method is to allow adequate time for additional examination of adjacent piping so that pipe replacement can be planned to reduce impact on system availability including Maintenance Rule applicability, availability of replacement materials and cost. In addition, use of Code Case N-562-1 may reduce outage schedules, as installation of a weld overlay would avoid the need for a pipe replacement and corresponding system line-ups and drain-downs during scheduled refueling outages.

A similar relief request was approved at Southern Nuclear Operation Company's Hatch Plant, Units 1 and 2 (Reference SER dated May 31, 2000, TAC Nos. MA 6123 and MA 6124).

E: ALTERNATIVE REPAIR TECHNIQUE:

ENO will implement the requirements of Code Case N-562-1 in its entirety with the additional restrictions and exceptions as described below, for Class 3 moderate energy (i.e., $\leq 200^{\circ}\text{F}$ and/or ≤ 275 psig maximum operating pressure) piping system repairs resulting from phenomenon such as flow-assisted corrosion and/or microbiological corrosion. These types of defect are typically identified by small leaks in the piping system or by pre-emptive non-code and code-required examinations performed by the licensee to monitor the degradation mechanisms. The repair technique described in Code Case N-562-1 will be utilized whenever engineering evaluation determines that such a repair is suitable for the particular defect or degradation being resolved.

Provisions for use of this Code Case will be addressed in the repair and replacement program procedure. These provisions will require that adjacent areas be examined to verify that the repair will encompass the entire flawed area and that there are no other unacceptable degraded locations within a representative area dependent on the degradation mechanism present. An evaluation of the degradation mechanism will be performed to determine the re-examination schedule to be performed over the life of the repair. The repair will be considered to have a maximum service life of two operating cycles at which time an ASME Section XI code repair (typically a pipe replacement) will replace the weld overlay unless specific approval is requested and received from the NRC to make it permanent.

The NRC had previously approved James A. FitzPatrick relief request No. 6 (Reference SER dated November 25, 1998, TAC NO. MA0711) to utilize ASME Section XI Code Case N-532. Code Case N-532 provides alternatives for the documentation requirements for repair and replacement activities. Code Case N-532 allows use of Form NIS-2A in lieu of Form NIS-2 as required by Code Case N-562-1, paragraph 7.0. Therefore, Entergy will document the use of Code Case N-562-1 on Form NIS-2A in lieu of Form NIS-2.

F: IMPLEMENTATION SCHEDULE

The relief request is applicable for the Third 10-Year Interval and will be utilized upon receipt of NRC approval.

G: ATTACHMENTS TO THE RELIEF REQUEST:

Code Case N-562-1.

CASES OF ASME BOILER AND PRESSURE VESSEL CODE

Approval Date: July 30, 1998

See Numeric Index for expiration
and any reaffirmation dates.

Case N-562-1
Alternative Requirements for Wall Thickness
Restoration of Class 3 Moderate Energy Carbon
Steel Piping
Section XI, Division 1

Inquiry: As an alternative to replacement or internal weld repair, what requirements may be applied for wall thickness restoration of Class 3 moderate-energy carbon steel piping systems that have experienced internal wall thinning or pitting from conditions such as, but not limited to, flow-assisted corrosion and microbiological corrosion?

Reply: It is the opinion of the Committee that areas of Class 3 moderate energy (i.e., less than or equal to 200°F or and less than or equal to 275 psig maximum operating conditions) carbon steel piping experiencing internal thinning or pitting may have the wall thickness restored externally by means of a weld-deposited carbon or low-alloy steel reinforcement on the outside surface of the piping in accordance with the following requirements. Excluded from these provisions are conditions involving corrosion-assisted cracking or any other form of cracking.

1.0 GENERAL REQUIREMENTS

(a) The wall thickness restoration shall be performed in accordance with a Repair/Replacement Plan satisfying the requirements of IWA-4150.¹

(b) The wall thickness restoration shall meet the requirements of IWA-4000,² except as stated in this Case.

(c) If the minimum required thickness of deposited weld metal necessary to satisfy the requirements of para. 3.0 is greater than the nominal thickness for the size and schedule of the piping, the provisions of this

Case shall not apply. In addition, the total thickness of filler metal applied over multiple repairs shall not exceed the original nominal thickness of the piping.

2.0 INITIAL EVALUATION

The material beneath the surface to which the weld overlay is to be applied shall be evaluated to establish the existing average wall thickness and the extent and configuration of degradation to be reinforced by the weld overlay. Consideration shall be given to the cause of degradation. The extent of degradation in the piping, and the effect of the repair on the piping, shall be evaluated in accordance with IWA-4160.³

3.0 DESIGN

3.1 General Design Requirements

(a) Unless otherwise established by theoretical or experimental analysis, or by proof testing as provided for in para. 3.3 or para. 3.4, the full thickness of the weld overlay shall extend a distance of at least s in each direction beyond the area predicted, over the design life of the restoration to infringe upon the required thickness.⁴

where

$$s = \geq \frac{3}{4} \sqrt{Rt_{\text{nom}}}$$

R = outer radius of the component

t_{nom} = nominal wall thickness of the component

Edges of the weld overlay shall be tapered to the existing piping surface at a maximum angle ("α" in Fig. 1) of 45 deg. Final configuration of the reinforcement shall permit the examinations and evaluations required herein, including any required preservice or inservice examinations of encompassed or adjacent welds.

¹IWA-4140 in the 1989 Edition with the 1991 Addenda through 1995 Edition. IWA-4130 (Repair Program) in the 1989 Edition with the 1990 Addenda and earlier Editions and Addenda.

²IWA-4000/7000 and IWC/TWD-4000/7000, as applicable, in the 1989 Edition with the 1990 Addenda and earlier Editions and Addenda.

³IWA-4150 in the 1989 Edition with the 1991 Addenda through 1995 Edition. IWA-4130 (Repair Program) in the 1989 Edition with the 1990 Addenda and earlier Editions and Addenda.

⁴Design thickness as prescribed by the Construction Code.

N-562-1

CASES OF ASME BOILER AND PRESSURE VESSEL CODE

(b) The thickness shall be sufficient to maintain required thickness for the predicted life of the repair, and, except for the tapered edges, the overlay shall have a uniform thickness.

(c) The tensile strength of the weld filler metal for the reinforcement shall be at least that specified for the base metal to which it is applied.

(d) The predicted maximum degradation of the overlaid piping and the overlay over the design life of the restoration shall be considered in the design. The predicted degradation of the piping shall be based upon in-situ inspection and established data for similar base metals. If the weld overlay is predicted to become exposed to the corroding medium, the predicted degradation of the overlay shall be based upon established data for base metals or weld metals with similar chemical composition to that of the filler metal used for the weld overlay.

(e) The effect of weld overlay application on interior coating shall be addressed in the Repair/Replacement Plan [Repair Program].

3.2 Design

The design of weld overlays not prequalified by paras. 3.3, 3.4, or 3.5 shall be in accordance with the applicable requirements of the Construction Code or ND-3100 and ND-3600 (including Appendix II), and shall consider the weld overlay as an integral portion of the piping or component upon which it is applied (not as a weld). The allowable stress values of the base metal shall apply to the design of the deposited weld metal. The following factors shall be considered, as applicable, in the design and application of the reinforcement:

(a) The shrinkage effects, if any, on the piping.

(b) Stress concentrations caused by application of the overlay or resulting from existing and predicted piping internal surface configuration.

3.3 Proof Test Qualification as a Piping Product

As an alternative to design, the configuration of weld overlays may be qualified by performance of proof testing of a mockup in accordance with the following requirements:

(a) A satisfactory mockup burst test shall qualify the design or configuration for application in the same orientation on the same type of item, and the same location on fittings, when the following conditions are satisfied (see Fig. 1):

(1) the base metal is of the same P-No. and Group Number when impact properties are applicable, as the base metal tested;

(2) the specified minimum tensile strength of the item does not exceed that specified for the base metal tested;

(3) the average thickness of the overlay areas is at least the thickness of the mockup plug, u ;

(4) the overlap on the full thickness of base metal, s , is at least that of the mockup;

(5) the transition angle at the outer edges of the overlay, α , is not greater than that of the mockup;

(6) the overlay surface finish is similar to or smoother than that tested;

(7) the maximum proportionate axial dimension, L/D , is not more than that tested;

(8) the maximum proportionate circumferential dimension, C/D , is not more than that tested;

(9) the nominal diameter is not less than one-half nor more than two times the diameter tested;

(10) the nominal thickness/diameter ratio, t/D , is not less than one-half nor more than three times the t/D , ratio tested.

(b) The mockup base shall consist of new base material of similar configuration, or type of item, as the item to be overlaid. A rounded-corner segment of the base material shall be removed to represent the maximum proportionate size (axial dimension of L and circumferential dimension of C) and location of thinning or pitting to be compensated for by the weld overlay. A plug of the same base metal and of uniform thickness u , which shall not exceed the smallest average thickness on which the overlays will be permanently applied, shall be full-penetration welded around the opening and flush with the outside surface of the piping. Alternatively, an equivalent volume of base metal may be removed from the inside surface of the mockup by machining or grinding, without need for welding in a closure plug.

(c) The mockup weld overlay shall be applied in accordance with the design or specified configuration using the specified weld filler metal. Maximum section thickness at the overlaid opening (weld metal plus base metal plug, $u + w$) shall not exceed 87½% of the nominal thickness of the piping.

(d) Straight pipe equivalent to a minimum of one pipe diameter, or one-half diameter for piping over NPS 14, shall be provided (butt-welded to the mockup, if necessary) beyond both ends of the overlay. The piping shall be capped and the completed mockup assembly shall be thoroughly vented and hydrostatically

CASES OF ASME BOILER AND PRESSURE VESSEL CODE

pressure tested to bursting. To qualify the design for general application within the limits of para. 3.3(a), burst pressure shall not be less than:

$$P = \frac{2tS_{act}}{D_o}$$

where

P = minimum acceptable burst pressure, psi

t = minimum specified thickness (excluding manufacturing tolerance) of the base metal being tested, in.

S_{act} = reported actual tensile strength of the base metal being tested, psi

D_o = outside diameter of the pipe, in.

(e) If flexibility analysis was required by the original Construction Code, the effect of the weld overlay shall be reconciled with the original analysis. In this case, for rectangular-shaped overlays on piping designed to ND-3650 and aligned parallel or perpendicular to the axis of the piping, unless a lower stress intensification factor (SIF or i) is established, an SIF (i) of 2.1 shall be applied for overlays on straight pipe and adjacent welds; a stress multiplier of 1.7 shall be applied to the SIF (i) for standard elbows; and an SIF (i) of 2.1 shall be applied for tees and branch connections when the toe of the overlay is not less than $2\frac{1}{2}\sqrt{Rt_{nom}}$ from any branch reinforcement in Fig. 1.

3.4 Proof Test Qualification for Specific Applications

As an alternative to design by analysis or proof test qualification as a piping product, the design or configuration of weld overlays may be qualified for limited service conditions using the provisions of ND-6900. "Proof Tests to Establish Design Pressure," except that component hydrostatic testing is not required (other than as required by IWA-4000²). The mockups shall be fabricated and tested in accordance with the provisions of para. 3.3(b), (c), and (d), and shall be applied in accordance with the provisions and conditions of para. 3.3(a). The provisions of para. 3.3(e) shall be met.

3.5 Prequalified Design

Application of weld overlays on straight pipe, portions of tees not less than $2\frac{1}{2}\sqrt{Rt_{nom}}$ from any branch reinforcement in Fig. 1 standard elbows, and associated welds to correct limited degradation shall be exempt from the requirements of para. 3.2 through para. 3.4,

provided all of the following conditions are satisfied in Fig. 1:

(a) All of the requirements of para. 3.1 apply.

(b) The provisions of para. 3.3(e) shall be met.

(c) The full thickness of weld overlay shall not exceed a maximum axial length of the greater of six in. or the outside diameter of the piping.

(d) The finished overlay shall be circular, oval, full-circumferential, or rectangular in shape.

(1) For each repair, the maximum dimension compensated by a circular overlay shall not exceed $\frac{2}{3}$ the nominal outside diameter of the piping.

(2) Rectangular overlays shall be aligned parallel with or perpendicular to the axis of the piping, and corners shall be rounded with radii not less than the overlay thickness.

(3) For oval overlays, the end radii shall not be less than $\frac{3}{4}\sqrt{Rt_{nom}}$, and the axis of the overlay shall be aligned parallel with or perpendicular to the axis of the piping.

(e) The distance between toes of adjacent overlays shall not be less than t_{nom} .

4.0 Water-backed Applications

(a) Manual application of overlays on water-backed piping shall be restricted to P-No. 1 base materials. Welding of such overlays shall use the SMAW process and low-hydrogen electrodes. In addition, the surface examination required in para. 6.0 shall be performed no sooner than 48 hours after completion of welding. For such overlays consideration should be given to using a temper bead technique similar to that described in IWA-4650.⁵

(b) Piping with wall thickness less than the diameter of the electrode shall be depressurized before welding.

5.0 INSTALLATION

(a) The entire surface area to which the weld overlay is to be applied shall be examined using the liquid penetrant or magnetic particle method, with acceptance criteria in accordance with ND-2500/5300 for the product form (base metal or weld) involved.

(b) If through-wall repairs are required to satisfy the acceptance criteria, or result from application of the

⁵IWA-4540 in the 1989 Edition with the 1991 Addenda through the 1995 Edition. IWE-4200 in the 1986 Edition with the 1988 Addenda through the 1989 Edition with the 1990 Addenda. IWE-4320 in the 1986 Edition with the 1987 Addenda and earlier Editions and Addenda.

N-562-1

CASES OF ASME BOILER AND PRESSURE VESSEL CODE

weld overlay, they shall be accomplished by sealing with weld metal using a qualified weld procedure suitable for open-root welding. This weld shall be examined in accordance with para. 5.0(a). In addition, the first layer of overlay over the repaired area shall be examined in accordance with para. 5.0(a).

(c) Overlay weld metal shall be deposited using a groove-welding procedure qualified in accordance with Section IX and the Construction Code, Section X and Section III, or IWA-4610 and either IWA-4620 or IWA-4650.⁶ The qualified minimum thickness specified in the weld procedure does not apply to the weld overlay or associated base metal repairs.⁷

(d) The surface of the weld overlay shall be prepared by machining or grinding, as necessary, to permit performance of surface and volumetric examinations required by para. 6.0. For ultrasonic examination, a surface finish of 250 RMS or better is required.

6.0 EXAMINATION

(a) The completed weld overlay shall be examined using the liquid penetrant or magnetic particle method and shall satisfy the surface examination acceptance criteria for welds of the Construction Code or ND-5300.

(b) The weld overlay, including the existing piping upon which it is applied, shall be examined to verify acceptable wall thickness.

⁶IWA-4500 and either IWA-4510 or IWA-4540 in the 1989 Edition with the 1991 Addenda through 1995 Edition. IWA-4510 or IWE-4200 in the 1986 Edition with the 1988 Addenda through 1989 Edition with the 1990 Addenda. IWB-4320 or IWE-4320 in the 1986 Edition with the 1987 Addenda or earlier Editions and Addenda.

⁷Exception to IWA-4000.

(c) Weld overlays shall be volumetrically examined as base metal repairs when required by the Construction Code, except as follows:

(1) Weld overlays not exceeding 10 in.² surface area are exempt from volumetric examination.

(2) Other weld overlays shall be exempt from volumetric examination when the finished applied thickness (w in Fig. 1) does not exceed.

(a) $\frac{1}{3}t$ for $t \leq \frac{3}{4}$ in.

(b) $\frac{1}{4}$ in. for $\frac{3}{4}$ in. $< t \leq 2\frac{1}{2}$ in.

(c) The lesser of $\frac{3}{8}$ in. or 10% of t for $t > 2\frac{1}{2}$ in.

where

t = finished full-section thickness of compensated area (e.g., $w + u$, in Fig. 1)

When volumetric examination is required, the full volume of the finished overlay, excluding the tapered edges, but including the volume of base metal required for the design life of the overlay, shall be examined using either the ultrasonic or radiographic method, and shall, to the depth at the surface of the existing piping, satisfy the acceptance criteria for weldments of the Construction Code or ND-5300. The volume of the existing piping, beneath the weld overlay, taken credit for in the design, shall satisfy the volumetric acceptance criteria of ND-2500/5300 for the product form, or IWA-3000.⁸



(d) Follow-up inspection shall be scheduled as necessary to confirm any design assumptions relative to rate or extent of future degradation.

7.0 DOCUMENTATION

Use of this Case shall be documented on an NIS-2 Form.

⁸IWA-3000 and IWB-3514 in the 1989 Edition with the 1990 Addenda and earlier Editions and Addenda.

CASES OF ASME BOILER AND PRESSURE VESSEL CODE

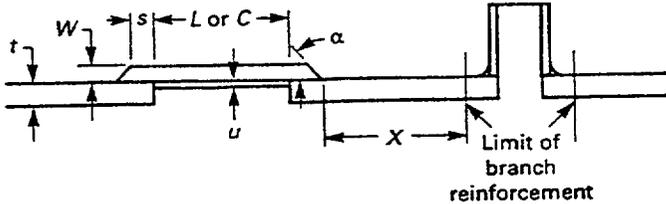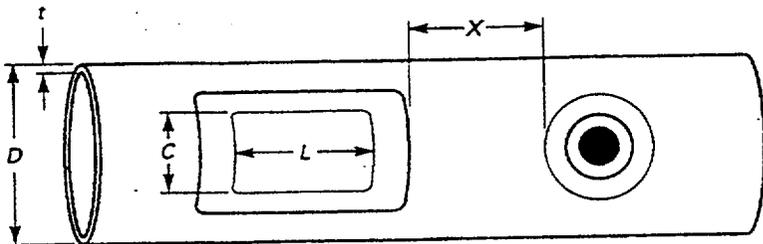

$$X \geq 2\frac{1}{2} \sqrt{Rt_{nom}}$$

FIG. 1