

VIRGINIA ELECTRIC AND POWER COMPANY
RICHMOND, VIRGINIA 23261

December 10, 2001

U.S. Nuclear Regulatory Commission
Attention: Document Control Desk
Washington, D.C. 20555

Serial No. 01-737
NAPS/MPW
Docket Nos. 50-338
50-339
License Nos. NPF-4
NPF-7


Gentlemen:

VIRGINIA ELECTRIC AND POWER COMPANY
NORTH ANNA POWER STATION UNITS 1 AND 2
REVISION TO EMERGENCY PLAN IMPLEMENTING PROCEDURE

Our letter dated October 2, 2001 (Serial No. 01-562) included Revision 34 of Emergency Plan Implementing Procedure (EPIP) 1.01. The revision to EPIP-1.01 did not include marks showing where changes were made on selected pages. EPIP-1.01 was re-issued on December 3, 2001 to correct this administrative error. The content of the procedure was not changed. The revisions do not implement actions that decrease the effectiveness of our Emergency Plan. The Emergency Plan and Implementing Procedures continue to meet the standards of 10 CFR 50.47(b).

Please update your manual by performing the actions described in Attachment 1, Tabulation of Changes.

Very truly yours,



D. A. Heacock
Site Vice President

Commitments Stated or Implied: None.

Enclosures

cc: U.S. Nuclear Regulatory Commission (2 copies)
Region II
Atlanta Federal Center
61 Forsyth St., SW, Suite 23T85
Atlanta, GA 30303

Mr. M. J. Morgan
NRC Senior Resident Inspector
North Anna Power Station

A045

**ATTACHMENT 1
TABULATION OF CHANGES**

**VIRGINIA ELECTRIC AND POWER COMPANY
REVISION TO NORTH ANNA POWER STATION
EMERGENCY PLAN IMPLEMENTING PROCEDURE**

Enclosed is a re-issued revision to a North Anna Power Station Emergency Plan Implementing Procedure (EPIP). Please take the following actions in order to keep your manual updated.

REMOVE AND DESTROY	DATED	INSERT	EFFECTIVE DATE
EPIP-1.01, Rev. 34	09/13/01	EPIP-1.01, Rev. 34	09/13/01 (Re-issued 12/3/01)

Emergency Plan Privacy and Proprietary Material has been removed. Reference Generic Letter No. 81-27.

VIRGINIA POWER
NORTH ANNA POWER STATION
EMERGENCY PLAN IMPLEMENTING PROCEDURE

NUMBER EPIP-1.01	PROCEDURE TITLE EMERGENCY MANAGER CONTROLLING PROCEDURE (With 4 Attachments)	REVISION 34
		PAGE 1 of 7

PURPOSE

To assess potential emergency conditions and initiate corrective actions.

LEVEL 2 DISTRIBUTION
This Document Should Be Verified
And Annotated To A Controlled Source
As Required to Perform Work

ENTRY CONDITIONS

Any of the following:

1. Another station procedure directs initiation of this procedure.
2. A potential emergency condition is reported to the Shift Supervisor.

Approvals on File

Effective Date 09-13-01

NUMBER EPIP-1.01	PROCEDURE TITLE EMERGENCY MANAGER CONTROLLING PROCEDURE	REVISION 34
		PAGE 2 of 7

STEP	ACTION/EXPECTED RESPONSE	RESPONSE NOT OBTAINED
------	--------------------------	-----------------------

CAUTION: Declaration of the highest emergency class for which an Emergency Action Level is exceeded shall be made.

NOTE: The ERFCS is potentially unreliable in the event of an earthquake. Therefore, ERFCS parameters should be evaluated for accuracy should this situation occur.

___ 1 EVALUATE EMERGENCY ACTION LEVELS:

- a) Determine event category using Attachment 1, EMERGENCY ACTION LEVEL TABLE INDEX
- b) Review EAL Tab associated with event category
- c) Use Control Room monitors, ERFCS, and outside reports to get indications of emergency conditions listed in the EAL Table
- d) Verify EAL - CURRENTLY EXCEEDED
- d) IF basis for EAL no longer exists when discovered AND no other reasons exist for an emergency declaration, THEN do the following:
 - RETURN TO procedure in effect.
 - GO TO VPAP-2802, NOTIFICATIONS AND REPORTS, to make one-hour, non-emergency reports for classification without declaration.

IF EAL was NOT exceeded, THEN RETURN TO procedure in effect.

(STEP 1 CONTINUED ON NEXT PAGE)

NUMBER EPIP-1.01	PROCEDURE TITLE EMERGENCY MANAGER CONTROLLING PROCEDURE	REVISION 34
		PAGE 3 of 7

STEP	ACTION/EXPECTED RESPONSE	RESPONSE NOT OBTAINED
------	--------------------------	-----------------------

1 EVALUATE EMERGENCY ACTION LEVELS: (Continued)

e) Record procedure initiation:

- By: _____
- Date: _____
- Time: _____

f) Initiate a chronological log of events

g) Declare position of Station Emergency Manager

NOTE: Assembly, accountability and/or initiation of facility staffing may not be desired during certain situations (e.g., security event, severe weather, anticipated grid disturbance) or may have already been completed. These activities should be implemented as quickly as achievable given the specific situation.

_____ 2 CHECK - CONDITIONS ALLOW FOR NORMAL IMPLEMENTATION OF EMERGENCY RESPONSE ACTIONS

IF deviation from normal emergency response actions warranted, THEN do the following:

- a) Refer to Attachment 4, Considerations for Operations Response Under Abnormal Conditions.
- b) Consider applicability of 50.54(x).
- c) IF classification/assembly announcement deferred, THEN GO TO Step 4.

NUMBER EPIP-1.01	PROCEDURE TITLE EMERGENCY MANAGER CONTROLLING PROCEDURE	REVISION 34
		PAGE 4 of 7

STEP	ACTION/EXPECTED RESPONSE	RESPONSE NOT OBTAINED
<p>3</p>	<p>NOTIFY PLANT STAFF OF ALERT OR HIGHER CLASSIFICATION:</p> <p>a) Check classification - ALERT OR HIGHER</p> <p>b) Check if emergency assembly and accountability - PREVIOUSLY CONDUCTED</p> <p>c) Have Control Room sound EMERGENCY alarm and make announcement on station Gai-Tronics system as follows:</p> <p>"(Emergency classification) has been declared as the result of _____" (event)</p> <p>d) Repeat Step 3.c</p>	<p>a) GO TO Step 4.</p> <p>b) Do the following:</p> <p>1) Have Control Room sound EMERGENCY alarm and make announcement on station Gai-Tronics system as follows:</p> <p>"(Emergency classification) has been declared as the result of _____" (event)</p> <p>"All Emergency Response personnel report to your assigned stations"</p> <p>"All contractor personnel not responding to the emergency and all visitors report to the Security Building"</p> <p>"All other personnel report to your Emergency Assembly Areas"</p> <p>2) Repeat RNO Step 3.b.1.</p> <p>3) GO TO Step 4.</p>

NUMBER EPIP-1.01	PROCEDURE TITLE EMERGENCY MANAGER CONTROLLING PROCEDURE	REVISION 34
		PAGE 5 of 7

STEP	ACTION/EXPECTED RESPONSE	RESPONSE NOT OBTAINED
------	--------------------------	-----------------------

CAUTION: Continue through this and all further instructions unless otherwise directed to hold.

4 INITIATE SUPPORTING PROCEDURES:

- a) Direct Emergency Communicators to initiate the following procedures:
 - 1) EPIP-2.01, NOTIFICATION OF STATE AND LOCAL GOVERNMENTS
 - 2) EPIP-2.02, NOTIFICATION OF NRC
- b) Direct HP to initiate EPIP-4.01, RADIOLOGICAL ASSESSMENT DIRECTOR CONTROLLING PROCEDURE
- c) Establish communications with Security Team Leader:
 - 1) Provide Security with current emergency classification
 - 2) Notify Security which Operations Shift is designated for coverage
 - 3) Direct Security to initiate EPIP-5.09, SECURITY TEAM LEADER CONTROLLING PROCEDURE

NUMBER EPIP-1.01	PROCEDURE TITLE EMERGENCY MANAGER CONTROLLING PROCEDURE	REVISION 34
		PAGE 6 of 7

STEP	ACTION/EXPECTED RESPONSE	RESPONSE NOT OBTAINED
_____ 5	CHECK TSC - ACTIVATED	<p><u>IF</u> TSC <u>NOT</u> activated, <u>THEN</u> do the following:</p> <ul style="list-style-type: none"> a) Have STA report to the Control Room. b) Notify Superintendent Operations or Operations Manager On Call. c) Consider having Radiological Assessment Director report to the Control Room. d) <u>WHEN</u> relief SEM arrives, <u>THEN</u> perform turnover using EPIP-1.01, Attachment 3, Turnover Checklist.
_____ 6	<p>IMPLEMENT EPIP FOR EMERGENCY CLASSIFICATION IN EFFECT:</p> <ul style="list-style-type: none"> • Notification of Unusual Event - GO TO EPIP-1.02, RESPONSE TO NOTIFICATION OF UNUSUAL EVENT • Alert - GO TO EPIP-1.03, RESPONSE TO ALERT • Site Area Emergency - GO TO EPIP-1.04, RESPONSE TO SITE AREA EMERGENCY • General Emergency - GO TO EPIP-1.05, RESPONSE TO GENERAL EMERGENCY 	

NUMBER EPIP-1.01	PROCEDURE TITLE EMERGENCY MANAGER CONTROLLING PROCEDURE	REVISION 34 <hr/> PAGE 7 of 7
----------------------------	---	--

STEP

ACTION/EXPECTED RESPONSE

RESPONSE NOT OBTAINED

- _____ 7 NOTIFY OFFSITE AUTHORITIES OF EMERGENCY TERMINATION:
- a) State and local governments (made by LEOF or CEOF when activated)
 - b) NRC
- _____ 8 NOTIFY STATION PERSONNEL ABOUT THE FOLLOWING:
- Emergency termination
 - Facility de-activation
 - Selective release of personnel
 - Completion and collection of procedures
 - Recovery
- _____ 9 TERMINATE EPIP-1.01:
- Give completed EIPs, forms and other applicable records to Nuclear Emergency Preparedness (TSC Emergency Procedures Coordinator if TSC activated)
 - Completed By: _____
 - Date: _____
 - Time: _____

-END-

NUMBER	ATTACHMENT TITLE	REVISION
EPIP-1.01	EMERGENCY ACTION LEVEL TABLE	34
ATTACHMENT	INDEX	PAGE
1		1 of 43

- CAUTION:
- Declaration of the highest emergency class for which an EAL is exceeded shall be made.
 - Emergency Action Levels shall be conservatively classified based on actual or anticipated plant conditions.

NOTE: Design Change Package 99-006, Replacement of Ventilation Radiation Monitors (NAPS Units 1 & 2), replaces KAMAN process and vent stack particulate, iodine and gaseous radiation monitors with a radiation monitor system manufactured by MGP Instruments (MGPI). Affected EALs are: B-4, B-7, C-7, C-9, E-3, E-5, G-1 and G-2. Both KAMAN and MGPI indications are provided for classification depending upon which system is in service. During the interim period when neither system is in service, indications are provided for classification based on HP monitoring and assessments.

EVENT CATEGORY: TAB

- | | | |
|-----|---|---|
| 1. | Safety, Shutdown, or Assessment System Event..... | A |
| 2. | Reactor Coolant System Event..... | B |
| 3. | Fuel Failure or Fuel Handling Accident..... | C |
| 4. | Containment Event..... | D |
| 5. | Radioactivity Event..... | E |
| 6. | DELETED | |
| 7. | Loss of Secondary Coolant..... | G |
| 8. | Electrical Failure..... | H |
| 9. | Fire..... | I |
| 10. | Security Event..... | J |
| 11. | Hazard to Station Operation..... | K |
| 12. | Natural Events..... | L |
| 13. | Miscellaneous Abnormal Events..... | M |

NUMBER	ATTACHMENT TITLE	REVISION
EPIP-1.01	EMERGENCY ACTION LEVEL TABLE (TAB A)	34
ATTACHMENT	SAFETY, SHUTDOWN, OR ASSESSMENT SYSTEM EVENT	PAGE
1		2 of 43

<u>CONDITION/APPLICABILITY</u>	<u>INDICATION</u>	<u>CLASSIFICATION</u>
<p>CAUTION: EAL C.2 is duplicated below for cross-reference/comparison to EAL A.1:</p>		
<p>C.2. Probable large radioactivity release initiated by loss of heat sink leading to core degradation</p> <p>MODES 1, 2, 3 & 4</p>	<p>Loss of Main Feedwater System, Condensate System and Auxiliary Feedwater System</p>	<p>GENERAL EMERGENCY</p>
<p>1. Loss of function needed for unit HSD condition</p> <p>MODES 1, 2, 3 & 4</p>	<ul style="list-style-type: none"> • Total loss of the Charging/SI System <li style="text-align: center;"><u>OR</u> • Total loss of the Main Feedwater and Auxiliary Feedwater systems 	<p>SITE AREA EMERGENCY</p>
<p>2. Failure of the Reactor Protection System to initiate and complete a required trip while at power</p> <p>MODES 1 & 2</p>	<ul style="list-style-type: none"> • Reactor trip setpoint and coincidences - EXCEEDED <li style="text-align: center;"><u>AND</u> • Automatic trip from RPS - FAILED <li style="text-align: center;"><u>AND</u> • Manual trip from Control Room - FAILED 	<p>SITE AREA EMERGENCY</p>

NUMBER	ATTACHMENT TITLE	REVISION
EPIP-1.01	EMERGENCY ACTION LEVEL TABLE (TAB A)	34
ATTACHMENT	SAFETY, SHUTDOWN, OR ASSESSMENT SYSTEM EVENT	PAGE
1		3 of 43

<u>CONDITION/APPLICABILITY</u>	<u>INDICATION</u>	<u>CLASSIFICATION</u>
<p>3. Inability to monitor a significant transient in progress</p> <p>MODES 1, 2, 3 & 4</p>	<ul style="list-style-type: none"> • Most (>75%) or all annunciator alarms on panels "A" to "K" - NOT AVAILABLE <p style="text-align: center;"><u>AND</u></p> <ul style="list-style-type: none"> • All computer monitoring capability (e.g., plant computer, ERFCs) - NOT AVAILABLE <p style="text-align: center;"><u>AND</u></p> <ul style="list-style-type: none"> • Significant transient - IN PROGRESS (e.g., reactor trip, SI actuation, turbine runback >25% thermal reactor power, thermal power oscillations >10%) <p style="text-align: center;"><u>AND</u></p> <ul style="list-style-type: none"> • Inability to directly monitor any one of the following using Control Room indications: <ul style="list-style-type: none"> • Subcriticality • Core Cooling • Heat Sink • Vessel Integrity • Containment Integrity 	<p>SITE AREA EMERGENCY</p>
<p>4. Evacuation of Main Control Room with control not established within 15 minutes</p> <p>ALL MODES</p>	<p>Evacuation of the Control Room with local shutdown control not established within 15 minutes</p>	<p>SITE AREA EMERGENCY</p>

NUMBER	ATTACHMENT TITLE EMERGENCY ACTION LEVEL TABLE (TAB A) SAFETY, SHUTDOWN, OR ASSESSMENT SYSTEM EVENT	REVISION
EPIP-1.01		34
ATTACHMENT		PAGE
1		4 of 43

<u>CONDITION/APPLICABILITY</u>	<u>INDICATION</u>	<u>CLASSIFICATION</u>
5. Total loss of function needed for unit CSD condition MODES 5 & 6	<ul style="list-style-type: none"> • Secondary system cooling capability - UNAVAILABLE <p style="text-align: center;"><u>AND</u></p> <ul style="list-style-type: none"> • Loss of any of the following systems: <ul style="list-style-type: none"> • Service Water • Component Cooling • RHR <p style="text-align: center;"><u>AND</u></p> <ul style="list-style-type: none"> • RCS temperature GREATER THAN 140 °F 	ALERT
6. Failure of the Reactor Protection System to complete a trip which takes the Reactor Subcritical MODES 1 & 2	<ul style="list-style-type: none"> • Reactor trip setpoint and coincidences - EXCEEDED <p style="text-align: center;"><u>AND</u></p> <ul style="list-style-type: none"> • Automatic trip from RPS - FAILED <p style="text-align: center;"><u>AND</u></p> <ul style="list-style-type: none"> • Manual trip - REQUIRED <p style="text-align: center;"><u>AND</u></p> <ul style="list-style-type: none"> • Manual trip from Control Room - SUCCESSFUL 	ALERT

NUMBER	ATTACHMENT TITLE	REVISION
EPIP-1.01	EMERGENCY ACTION LEVEL TABLE (TAB A)	34
ATTACHMENT	SAFETY, SHUTDOWN, OR ASSESSMENT SYSTEM EVENT	PAGE
1		5 of 43

<u>CONDITION/APPLICABILITY</u>	<u>INDICATION</u>	<u>CLASSIFICATION</u>
<p>7. Unplanned loss of safety system annunciators with compensatory indicators unavailable or a transient in progress</p> <p>MODES 1, 2, 3 & 4</p>	<ul style="list-style-type: none"> • Unplanned loss of most (>75%) or all annunciator alarms on panels "A" to "K" for GREATER THAN 15 minutes <p style="text-align: center;"><u>AND</u></p> <ul style="list-style-type: none"> • All computer monitoring capability (e.g., plant computer, ERFCs) - NOT AVAILABLE <p style="text-align: center;"><u>OR</u></p> <p>Significant transient - INITIATED OR IN PROGRESS (e.g., reactor trip, SI, turbine runback > 25% thermal reactor power, thermal power oscillations > 10%)</p>	<p>ALERT</p>
<p>8. Evacuation of Main Control Room required</p> <p>ALL MODES</p>	<p>Evacuation of the Control Room with shutdown control established within 15 minutes</p>	<p>ALERT</p>
<p>9. Inability to reach required mode within technical specification limits</p> <p>MODES 1, 2, 3 & 4</p>	<ul style="list-style-type: none"> • Intentional reduction in power, load or temperature IAW T.S. Action Statement - HAS COMMENCED <p style="text-align: center;"><u>AND</u></p> <ul style="list-style-type: none"> • T.S. Action Statement time limit for mode change - CANNOT BE MET 	<p>NOTIFICATION OF UNUSUAL EVENT</p>

NUMBER	ATTACHMENT TITLE	REVISION
EPIP-1.01	EMERGENCY ACTION LEVEL TABLE (TAB A)	34
ATTACHMENT	SAFETY, SHUTDOWN, OR ASSESSMENT SYSTEM EVENT	PAGE
1		6 of 43

<u>CONDITION/APPLICABILITY</u>	<u>INDICATION</u>	<u>CLASSIFICATION</u>
<p>10. Failure of a safety or relief valve to close after pressure reduction, which may affect the health and safety of the public</p> <p>MODES 1, 2, 3, 4 & 5</p>	<ul style="list-style-type: none"> • <u>RCS</u> • RCS pressure - LESS THAN 2000 psig <li style="text-align: center;">OR • NDT Protection System - IN SERVICE <li style="text-align: center;">AND • Any indication after lift or actuation that Pressurizer Safety or PORV - REMAINS OPEN <li style="text-align: center;">AND • Flow - UNISOLABLE • <u>Main Steam</u> • Excessive Steam Generator Safety, PORV or Decay Heat Release flow as indicated by rapid RCS cooldown rate <li style="text-align: center;">AND • Main Steam pressure greater than 100 psi below setpoint of affected valve 	<p>NOTIFICATION OF UNUSUAL EVENT</p>
<p>11. Unplanned loss of most or all safety system annunciators for greater than 15 minutes</p> <p>MODES 1, 2, 3 & 4</p>	<ul style="list-style-type: none"> • Unplanned loss of most (>75%) or all annunciators on panels "A" to "K" for GREATER THAN 15 minutes 	<p>NOTIFICATION OF UNUSUAL EVENT</p>

NUMBER	ATTACHMENT TITLE	REVISION
EPIP-1.01	EMERGENCY ACTION LEVEL TABLE (TAB A)	34
ATTACHMENT	SAFETY, SHUTDOWN, OR ASSESSMENT SYSTEM EVENT	PAGE
1		7 of 43

<u>CONDITION/APPLICABILITY</u>	<u>INDICATION</u>	<u>CLASSIFICATION</u>
12. Loss of communications capability ALL MODES	<ul style="list-style-type: none"> • Station PBX phone system - FAILED <li style="text-align: center;"><u>AND</u> • Station Gai-tronics system - FAILED <li style="text-align: center;"><u>AND</u> • Station UHF radio system - FAILED 	NOTIFICATION OF UNUSUAL EVENT

NUMBER	ATTACHMENT TITLE	REVISION
EPIP-1.01	EMERGENCY ACTION LEVEL TABLE (TAB B)	34
ATTACHMENT	REACTOR COOLANT SYSTEM EVENT	PAGE
1		8 of 43

<u>CONDITION/APPLICABILITY</u>	<u>INDICATION</u>	<u>CLASSIFICATION</u>
<p>1. Loss of 2 of 3 fission product barriers with potential loss of 3rd barrier</p> <p>ALL MODES</p>	<p>Any two of a), b) or c) exist and the third is imminent:</p> <p>a) Fuel clad integrity failure as indicated by any of the following:</p> <ul style="list-style-type: none"> • RCS specific activity greater than or equal to 300.0 $\mu\text{Ci}/\text{gram}$ dose equivalent I-131 <p style="text-align: center;"><u>OR</u></p> <p>5 or more core exit thermocouples greater than 1200 °F</p> <p style="text-align: center;"><u>OR</u></p> <p>Containment High Range Radiation Monitor</p> <div style="border: 1px solid black; padding: 5px; width: fit-content; margin: 0 auto;"> <p>RM-RMS-165, -166 or RM-RMS-265, -266 GREATER THAN 1.88x10² R/hr</p> </div> <p>b) Loss of RCS integrity as indicated by any of the following:</p> <ul style="list-style-type: none"> • RCS pressure greater than 2735 psig <p style="text-align: center;"><u>OR</u></p> <p>Loss of Reactor Coolant in progress</p> <p>c) Loss of containment integrity as indicated by any of the following:</p> <ul style="list-style-type: none"> • Containment pressure greater than 60 psia and not decreasing <p style="text-align: center;"><u>OR</u></p> <p>Release path to environment -EXISTS</p>	<p>GENERAL EMERGENCY</p>

NUMBER	ATTACHMENT TITLE	REVISION
EPIP-1.01	EMERGENCY ACTION LEVEL TABLE (TAB B)	34
ATTACHMENT 1	REACTOR COOLANT SYSTEM EVENT	PAGE 9 of 43

<u>CONDITION/APPLICABILITY</u>	<u>INDICATION</u>	<u>CLASSIFICATION</u>
2. Fuel failure with steam generator tube rupture ALL MODES	Any two of a), b) or c) exist and the third is imminent: a) Fuel clad integrity failure as indicated by any of the following: <ul style="list-style-type: none"> • RCS specific activity greater than 300 $\mu\text{Ci}/\text{gram}$ dose equivalent I-131 <p style="text-align: center;"><u>OR</u></p> 5 or more core exit thermocouples GREATER THAN 1200 °F <p style="text-align: center;"><u>OR</u></p> High Range Letdown radiation monitor <div style="border: 1px solid black; padding: 2px; width: fit-content; margin: 0 auto;"> 1-CH-RI-128 or 2-CH-RI-228 GREATER THAN 5.9×10^4 mR/hr </div> b) Steam Generator tube rupture as indicated by both of the following: <ul style="list-style-type: none"> • SI coincidence - SATISFIED <p style="text-align: center;"><u>AND</u></p> <ul style="list-style-type: none"> • Steam Generator tube rupture - IN PROGRESS c) Loss of secondary integrity associated with ruptured steam generator pathway as indicated by any of the following: <ul style="list-style-type: none"> • Steam Generator PORV - OPEN <p style="text-align: center;"><u>OR</u></p> Main Steam Code Safety Valve - OPEN <p style="text-align: center;"><u>OR</u></p> Loss of secondary coolant outside containment - IN PROGRESS	GENERAL EMERGENCY

NUMBER	ATTACHMENT TITLE	REVISION
EPIP-1.01	EMERGENCY ACTION LEVEL TABLE	34
ATTACHMENT	(TAB B)	PAGE
1	REACTOR COOLANT SYSTEM EVENT	10 of 43

<u>CONDITION/APPLICABILITY</u>	<u>INDICATION</u>	<u>CLASSIFICATION</u>
3. RCS leak rate limit - EXCEEDED MODES 1, 2, 3, & 4	<ul style="list-style-type: none"> • Loss of Reactor Coolant in progress and inventory balance indicates leakage GREATER THAN 300 gpm <p style="text-align: center;"><u>AND</u></p> <ul style="list-style-type: none"> • Pressurizer level cannot be maintained with two (2) or more Charging/SI pumps in operation 	SITE AREA EMERGENCY

NUMBER	ATTACHMENT TITLE	REVISION
EPIP-1.01	EMERGENCY ACTION LEVEL TABLE (TAB B)	34
ATTACHMENT	REACTOR COOLANT SYSTEM EVENT	PAGE
1		11 of 43

<u>CONDITION/APPLICABILITY</u>	<u>INDICATION</u>	<u>CLASSIFICATION</u>
<p>4. Gross primary to secondary leakage with loss of offsite power</p> <p>MODES 1, 2, 3, & 4</p>	<ul style="list-style-type: none"> • Steam Generator Tube Rupture - IN PROGRESS <p style="text-align: center;"><u>AND</u></p> <ul style="list-style-type: none"> • Safety Injection - REQUIRED <p style="text-align: center;"><u>AND</u></p> <ul style="list-style-type: none"> • Vent Vent A Kaman Monitor <div style="border: 1px solid black; padding: 2px; margin: 5px 0;"> <p>RM-VG-179 GREATER THAN 1.3 x 10⁸ μCi/sec</p> </div> <p style="text-align: center;"><u>OR</u></p> <p>HP determines Site Boundary DDE GREATER THAN 50 mrem/hr</p> <p style="text-align: center;"><u>OR</u></p> <p>Vent Vent A MGPI Monitor</p> <div style="border: 1px solid black; padding: 2px; margin: 5px 0;"> <p>RM-VG-179 GREATER THAN 1.25 x 10⁸ μCi/sec</p> </div> <p style="text-align: center;"><u>OR</u></p> <p>Steam Generator Blowdown monitor on affected pathway</p> <div style="border: 1px solid black; padding: 2px; margin: 5px 0;"> <p>RM-SS-122, -222 RM-SS-123, -223 RM-SS-124, -224 GREATER THAN 1x10⁶ cpm</p> </div> <p style="text-align: center;"><u>AND</u></p> <ul style="list-style-type: none"> • A subsequent loss of offsite power indicated by zero volts on voltmeters for 4160V buses D, E, & F 	<p>SITE AREA EMERGENCY</p>

NUMBER	ATTACHMENT TITLE EMERGENCY ACTION LEVEL TABLE (TAB B) REACTOR COOLANT SYSTEM EVENT	REVISION
EPIP-1.01		34
ATTACHMENT		PAGE
1		12 of 43

<u>CONDITION/APPLICABILITY</u>	<u>INDICATION</u>	<u>CLASSIFICATION</u>
5. RCS leak rate limit - EXCEEDED MODES 1, 2, 3, & 4	<ul style="list-style-type: none"> Pressurizer level cannot be maintained greater than 20% with one (1) Charging/SI pump in operation <p style="text-align: center;"><u>AND</u></p> <ul style="list-style-type: none"> RCS inventory balance indicates leakage - greater than 50 gpm 	ALERT
6. Gross primary to secondary leakage MODES 1, 2, 3, & 4	<p>Steam Generator Tube Rupture - IN PROGRESS</p> <p style="text-align: center;"><u>AND</u></p> <p>Safety Injection - REQUIRED</p>	ALERT

NUMBER	ATTACHMENT TITLE	REVISION
EPIP-1.01	EMERGENCY ACTION LEVEL TABLE (TAB B)	34
ATTACHMENT	REACTOR COOLANT SYSTEM EVENT	PAGE
1		13 of 43

<u>CONDITION/APPLICABILITY</u>	<u>INDICATION</u>	<u>CLASSIFICATION</u>
<p>7. Excessive primary to secondary leakage with loss of offsite power</p> <p>MODES 1, 2, 3, & 4</p>	<ul style="list-style-type: none"> • Intentional reduction in power, load or temperature because the unit has entered an Action Statement or will exceed an LCO <p style="text-align: center;"><u>AND</u></p> <ul style="list-style-type: none"> • Vent Vent A Kaman Monitor <div style="border: 1px solid black; padding: 2px; margin: 5px 0;"> <p style="text-align: center;">RM-VG-179 GREATER THAN 1.83 x 10⁶ μCi/sec</p> </div> <p style="text-align: center;"><u>OR</u></p> <p>HP assessment of sample results indicates GREATER THAN 10 times ODCM allowable limit (Alert per EAL E-3)</p> <p style="text-align: center;"><u>OR</u></p> <p>Vent Vent A MGPI Monitor</p> <div style="border: 1px solid black; padding: 2px; margin: 5px 0;"> <p style="text-align: center;">RM-VG-179 GREATER THAN 1.73 x 10⁶ μCi/sec</p> </div> <p style="text-align: center;"><u>OR</u></p> <p>Steam Generator Blowdown monitor on affected pathway</p> <div style="border: 1px solid black; padding: 2px; margin: 5px 0;"> <p style="text-align: center;">RM-SS-122, -222 RM-SS-123, -223 RM-SS-124, -224 GREATER THAN 1x10⁵ cpm</p> </div> <p style="text-align: center;"><u>AND</u></p> <ul style="list-style-type: none"> • A subsequent loss of offsite power indicated by zero volts on voltmeters for 4160V buses D, E, & F 	<p>ALERT</p>

NUMBER	ATTACHMENT TITLE	REVISION
EPIP-1.01	EMERGENCY ACTION LEVEL TABLE (TAB B) REACTOR COOLANT SYSTEM EVENT	34
ATTACHMENT 1		PAGE 14 of 43

<u>CONDITION/APPLICABILITY</u>	<u>INDICATION</u>	<u>CLASSIFICATION</u>
8. RCS leak rate requiring plant shutdown IAW T.S. 3.4.6.2 or 3.4.6.3 MODES 1, 2, 3, & 4	<ul style="list-style-type: none"> • Intentional reduction in power, load or temperature because the unit has entered an action statement or will exceed an LCO <p style="text-align: center;"><u>AND</u></p> <ul style="list-style-type: none"> • Unidentified RCS leakage - greater than 1 gpm <p style="text-align: center;"><u>OR</u></p> <p>Identified leakage - greater than 10 gpm</p> <p style="text-align: center;"><u>OR</u></p> <p>Controlled leakage to RCP Seals - greater than 30 gpm total</p> <p style="text-align: center;"><u>OR</u></p> <p>Any pressure boundary leakage - EXISTS</p>	NOTIFICATION OF UNUSUAL EVENT
9. Primary to Secondary leakage - greater than 1 gpm MODES 1, 2, 3, & 4	<ul style="list-style-type: none"> • Intentional reduction in power, load or temperature because the unit has entered an action statement or will exceed an LCO <p style="text-align: center;"><u>AND</u></p> <ul style="list-style-type: none"> • Primary to Secondary leakage greater than 1 gpm <p style="text-align: center;"><u>OR</u></p> <p>N-16 monitor indicates primary to secondary leakage greater than T. S. allowable limits</p>	NOTIFICATION OF UNUSUAL EVENT

NUMBER	ATTACHMENT TITLE	REVISION
EPIP-1.01	EMERGENCY ACTION LEVEL TABLE (TAB C)	34
ATTACHMENT 1	FUEL FAILURE OR FUEL HANDLING ACCIDENT	PAGE 15 of 43

CONDITION/APPLICABILITY	INDICATION	CLASSIFICATION			
1. Probable large radioactivity release initiated by LOCA with ECCS failure leading to core degradation ALL MODES	<ul style="list-style-type: none"> Loss of reactor coolant in progress <u>AND</u> RCS specific activity - greater than 300 $\mu\text{Ci}/\text{gram}$ dose equivalent I-131 <u>OR</u> Containment High Range Radiation Monitor <div style="border: 1px solid black; padding: 5px; width: fit-content; margin: 0 auto;"> RM-RMS-165, -166 or RM-RMS-265, -266 GREATER THAN 1.88×10^2 R/hr </div> <u>AND</u> High or low head ECCS flow not being delivered to the core (if expected by plant conditions) 	GENERAL EMERGENCY			
<p>CAUTION: EAL A.1 is duplicated below for cross-reference/comparison to EAL C.2:</p> <table style="width: 100%; border-collapse: collapse;"> <tr> <td style="width: 35%; vertical-align: top;"> A.1. Loss of function needed for unit HSD condition MODES 1, 2, 3 & 4 </td> <td style="width: 45%; vertical-align: top;"> <ul style="list-style-type: none"> Total loss of the Charging/SI System <u>OR</u> Total loss of the Main Feedwater and Auxiliary Feedwater systems </td> <td style="width: 20%; vertical-align: top; text-align: center;"> SITE AREA EMERGENCY </td> </tr> </table>			A.1. Loss of function needed for unit HSD condition MODES 1, 2, 3 & 4	<ul style="list-style-type: none"> Total loss of the Charging/SI System <u>OR</u> Total loss of the Main Feedwater and Auxiliary Feedwater systems 	SITE AREA EMERGENCY
A.1. Loss of function needed for unit HSD condition MODES 1, 2, 3 & 4	<ul style="list-style-type: none"> Total loss of the Charging/SI System <u>OR</u> Total loss of the Main Feedwater and Auxiliary Feedwater systems 	SITE AREA EMERGENCY			
2. Probable large radioactivity release initiated by loss of heat sink leading to core degradation MODES 1, 2, 3 & 4	Loss of Main Feedwater System, Condensate System and Auxiliary Feedwater System	GENERAL EMERGENCY			

NUMBER	ATTACHMENT TITLE	REVISION
EPIP-1.01	EMERGENCY ACTION LEVEL TABLE (TAB C)	34
ATTACHMENT 1	FUEL FAILURE OR FUEL HANDLING ACCIDENT	PAGE 16 of 43

<u>CONDITION/APPLICABILITY</u>	<u>INDICATION</u>	<u>CLASSIFICATION</u>
3. Probable large radioactivity release initiated by failure of protection system to bring Rx subcritical and causing core degradation ALL MODES	<ul style="list-style-type: none"> • Rx nuclear power after a trip - greater than 5% <p style="text-align: center;"><u>AND</u></p> <ul style="list-style-type: none"> • RCS pressure greater than or equal to 2485 psig <p style="text-align: center;"><u>OR</u></p> Containment pressure and temperature rapidly increasing	GENERAL EMERGENCY
4. Probable large radioactivity release initiated by loss of AC power and all feedwater ALL MODES	<ul style="list-style-type: none"> • Loss of all onsite and offsite AC power <p style="text-align: center;"><u>AND</u></p> <ul style="list-style-type: none"> • Turbine Driven Auxiliary Feedwater Pump not operable <p style="text-align: center;"><u>AND</u></p> <ul style="list-style-type: none"> • Restoration of either of the above not likely within 2 hours 	GENERAL EMERGENCY

NUMBER	ATTACHMENT TITLE	REVISION
EPIP-1.01	EMERGENCY ACTION LEVEL TABLE	34
ATTACHMENT	(TAB C)	PAGE
1	FUEL FAILURE OR FUEL HANDLING ACCIDENT	17 of 43

<u>CONDITION/APPLICABILITY</u>	<u>INDICATION</u>	<u>CLASSIFICATION</u>
5. Probable large radioactivity release initiated by LOCA with loss of ECCS and containment cooling ALL MODES	<ul style="list-style-type: none"> • Loss of reactor coolant in progress <p style="text-align: center;"><u>AND</u></p> <ul style="list-style-type: none"> • High or low head ECCS flow not being delivered to the core (if expected by plant conditions) <p style="text-align: center;"><u>AND</u></p> <ul style="list-style-type: none"> • Containment RS sump temperature greater than 190°F and NOT decreasing <p style="text-align: center;"><u>OR</u></p> All Quench Spray and Recirculation Spray systems - NOT OPERABLE	GENERAL EMERGENCY

NUMBER	ATTACHMENT TITLE EMERGENCY ACTION LEVEL TABLE (TAB C) FUEL FAILURE OR FUEL HANDLING ACCIDENT	REVISION
EPIP-1.01		34
ATTACHMENT		PAGE
1		18 of 43

<u>CONDITION/APPLICABILITY</u>	<u>INDICATION</u>	<u>CLASSIFICATION</u>
<p>6. Core damage with possible loss of coolable geometry</p> <p>MODES 1, 2, 3, & 4</p>	<p>a) Fuel clad failure as indicated by any of the following:</p> <ul style="list-style-type: none"> RCS Specific activity greater than 60 $\mu\text{Ci}/\text{gram}$ dose equivalent I-131 <p style="text-align: center;"><u>OR</u></p> <p>High Range Letdown radiation monitor</p> <div style="border: 1px solid black; padding: 5px; width: fit-content; margin: 0 auto;"> <p>1-CH-RI-128 or 2-CH-RI-228 GREATER THAN 1.2×10^4 mR/hr</p> </div> <p style="text-align: center;"><u>AND</u></p> <p>b) Loss of cooling as indicated by any of the following:</p> <ul style="list-style-type: none"> 5 confirmed core exit thermocouples greater than 1200 °F <p style="text-align: center;"><u>OR</u></p> <p>Core delta T - zero</p> <p style="text-align: center;"><u>OR</u></p> <p>Core delta T - rapidly diverging</p>	<p>SITE AREA EMERGENCY</p>

NUMBER	ATTACHMENT TITLE	REVISION
EPIP-1.01	EMERGENCY ACTION LEVEL TABLE (TAB C)	34
ATTACHMENT	FUEL FAILURE OR FUEL HANDLING ACCIDENT	PAGE
1		19 of 43

<u>CONDITION/APPLICABILITY</u>	<u>INDICATION</u>	<u>CLASSIFICATION</u>
<p>7. Major fuel damage accident with radioactivity release to containment or fuel buildings</p> <p>ALL MODES</p>	<ul style="list-style-type: none"> • Water level in Rx vessel during refueling below the top of core <p style="text-align: center;"><u>OR</u></p> <p>Water level in spent fuel pool below top of spent fuel</p> <p style="text-align: center;"><u>AND</u></p> <ul style="list-style-type: none"> • Verified damage to irradiated fuel resulting in readings on Vent Vent "B" Kaman monitor <div style="border: 1px solid black; padding: 2px; width: fit-content; margin: 5px auto;"> RM-VG-180 GREATER THAN $2.74 \times 10^8 \mu\text{Ci/sec}$ </div> <p style="text-align: center;"><u>OR</u></p> <p>HP determines Site Boundary DDE GREATER THAN 50 mrem/hr</p> <p style="text-align: center;"><u>OR</u></p> <p>Verified damage to irradiated fuel resulting in readings on Vent Vent "B" MGPI monitor</p> <div style="border: 1px solid black; padding: 2px; width: fit-content; margin: 5px auto;"> RM-VG-180 GREATER THAN $2.69 \times 10^8 \mu\text{Ci/sec}$ </div>	<p>SITE AREA EMERGENCY</p>
<p>8. Severe Fuel Clad Damage</p> <p>MODES 1, 2, 3, & 4</p>	<ul style="list-style-type: none"> • High Range Letdown radiation monitor <div style="border: 1px solid black; padding: 2px; width: fit-content; margin: 5px auto;"> 1-CH-RI-128 or 2-CH-RI-228 Increases to GREATER THAN Hi Hi Alarm setpoint within 30 minutes and remains for at least 15 minutes </div>	<p>ALERT</p>

NUMBER	ATTACHMENT TITLE	REVISION
EPIP-1.01	EMERGENCY ACTION LEVEL TABLE (TAB C) FUEL FAILURE OR FUEL HANDLING ACCIDENT	34
ATTACHMENT 1		PAGE 20 of 43

<u>CONDITION/APPLICABILITY</u>	<u>INDICATION</u>	<u>CLASSIFICATION</u>
9. Fuel damage accident with release of radioactivity to containment or fuel buildings ALL MODES	<ul style="list-style-type: none"> • Verified accident involving damage to irradiated fuel <p style="text-align: center;"><u>AND</u></p> <ul style="list-style-type: none"> • Health Physics confirms fission product release from fuel <p style="text-align: center;"><u>OR</u></p> Vent Vent "B" Kaman monitor <div style="border: 1px solid black; padding: 2px; width: fit-content; margin: 0 auto;"> RM-VG-180 GREATER THAN $1.83 \times 10^6 \mu\text{Ci/sec}$ </div> <p style="text-align: center;"><u>OR</u></p> HP assessment of sample results indicates GREATER THAN 10 times ODCM allowable limit (Alert per EAL E-3) <p style="text-align: center;"><u>OR</u></p> Vent Vent "B" MGPI monitor <div style="border: 1px solid black; padding: 2px; width: fit-content; margin: 0 auto;"> RM-VG-180 GREATER THAN $1.99 \times 10^6 \mu\text{Ci/sec}$ </div>	ALERT
10. Potential for fuel damage to occur during refueling MODE 6	Continuing uncontrolled decrease of water level in Reactor Refueling Cavity or Spent Fuel Pool	ALERT

NUMBER EPIP-1.01	ATTACHMENT TITLE EMERGENCY ACTION LEVEL TABLE (TAB C)	REVISION 34
ATTACHMENT 1	FUEL FAILURE OR FUEL HANDLING ACCIDENT	PAGE 21 of 43

<u>CONDITION/APPLICABILITY</u>	<u>INDICATION</u>	<u>CLASSIFICATION</u>
11. Fuel clad damage indication MODES 1, 2, 3, & 4	<ul style="list-style-type: none"> Intentional reduction in power, load or temperature IAW reactor coolant activity T.S. Action Statement - HAS COMMENCED <p style="text-align: center;"><u>OR</u></p> High Range Letdown radiation monitor <div style="border: 1px solid black; padding: 5px; margin: 10px auto; width: fit-content;"> 1-CH-RI-128 or 2-CH-RI-228 Increases to GREATER THAN Hi Alarm setpoint within 30 minutes and remains for at least 15 minutes </div>	NOTIFICATION OF UNUSUAL EVENT
12. Independent Spent Fuel Storage Installation (ISFSI) event ALL MODES	<ul style="list-style-type: none"> Verified Sealed Surface Storage Cask (SSSC) seal leakage <p style="text-align: center;"><u>OR</u></p> Sealed Surface Storage Cask (SSSC) dropped or mishandled	NOTIFICATION OF UNUSUAL EVENT

NUMBER	ATTACHMENT TITLE	REVISION
EPIP-1.01	EMERGENCY ACTION LEVEL TABLE (TAB D)	34
ATTACHMENT 1	CONTAINMENT EVENT	PAGE 22 of 43

<u>CONDITION/APPLICABILITY</u>	<u>INDICATION</u>	<u>CLASSIFICATION</u>
1. Extremely high containment radiation, pressure and temperature MODES 1, 2, 3, & 4	<ul style="list-style-type: none"> Containment High Range radiation monitor <div data-bbox="769 485 1101 621" style="border: 1px solid black; padding: 2px; margin: 5px 0;"> RM-RMS-165, -166 or RM-RMS-265, -266 GREATER THAN 3.76×10^2 R/hr </div> <p style="text-align: center;"><u>AND</u></p> <ul style="list-style-type: none"> Containment pressure greater than 45 psia and not decreasing <p style="text-align: center;"><u>OR</u></p> Containment temperature greater than 280°F	GENERAL EMERGENCY
2. High-high containment radiation, pressure, and temperature MODES 1, 2, 3, & 4	<ul style="list-style-type: none"> Containment High Range radiation monitor <div data-bbox="769 1041 1101 1178" style="border: 1px solid black; padding: 2px; margin: 5px 0;"> RM-RMS-165, -166 or RM-RMS-265, -266 GREATER THAN 1.88×10^2 R/hr </div> <p style="text-align: center;"><u>AND</u></p> <ul style="list-style-type: none"> Containment pressure - greater than 27.75 psia and not decreasing <p style="text-align: center;"><u>OR</u></p> Containment temperature - greater than 200 °F	SITE AREA EMERGENCY

NUMBER	ATTACHMENT TITLE	REVISION
EPIP-1.01	EMERGENCY ACTION LEVEL TABLE	34
ATTACHMENT	(TAB D)	PAGE
1	CONTAINMENT EVENT	23 of 43

<u>CONDITION/APPLICABILITY</u>	<u>INDICATION</u>	<u>CLASSIFICATION</u>
3. High Containment radiation, pressure and temperature MODES 1, 2, 3, & 4	<ul style="list-style-type: none"> <li data-bbox="703 411 1230 617"> • Containment High Range radiation monitor <div style="border: 1px solid black; padding: 2px; display: inline-block;"> RM-RMS-165, -166 or RM-RMS-265, -266 GREATER THAN 81.5 R/hr </div> <li data-bbox="824 653 878 684" style="text-align: center;"><u>AND</u> <li data-bbox="703 705 1230 768"> • Containment pressure - greater than 17 psia <li data-bbox="824 789 862 821" style="text-align: center;"><u>OR</u> <li data-bbox="760 842 1230 898"> Containment temperature - greater than 150°F 	ALERT

NUMBER	ATTACHMENT TITLE	REVISION
EPIP-1.01	EMERGENCY ACTION LEVEL TABLE	34
ATTACHMENT	(TAB E)	PAGE
1	RADIOACTIVITY EVENT	24 of 43

<u>CONDITION/APPLICABILITY</u>	<u>INDICATION</u>	<u>CLASSIFICATION</u>
1. Release imminent or in progress and site boundary doses projected to exceed 1.0 Rem TEDE or 5.0 Rem Thyroid CDE ALL MODES	<ul style="list-style-type: none"> HP assessment indicates actual or projected doses at or beyond site boundary greater than 1.0 Rem TEDE or 5.0 Rem Thyroid CDE 	GENERAL EMERGENCY
2. Release imminent or in progress and site boundary doses projected to exceed 0.1 Rem TEDE or 0.5 Rem Thyroid CDE ALL MODES	<ul style="list-style-type: none"> HP assessment indicates actual or projected dose at or beyond Site Boundary exceeds 0.1 Rem TEDE or 0.5 Rem Thyroid CDE 	SITE AREA EMERGENCY

NUMBER	ATTACHMENT TITLE	REVISION
EPIP-1.01	EMERGENCY ACTION LEVEL TABLE (TAB E)	34
ATTACHMENT	RADIOACTIVITY EVENT	PAGE
1		25 of 43

<u>CONDITION/APPLICABILITY</u>	<u>INDICATION</u>	<u>CLASSIFICATION</u>
3. Effluent release greater than 10 times ODCM allowable limit ALL MODES	a) Any of the following monitors indicate valid readings above the specified values for greater than 15 minutes <ul style="list-style-type: none"> • Clarifier Effluent <div style="border: 1px solid black; padding: 2px; margin-left: 20px;">RM-LW-111 GREATER THAN 4.8×10^5 cpm</div> • Discharge Canal <div style="border: 1px solid black; padding: 2px; margin-left: 20px;">RM-SW-130 or -230 GREATER THAN 5×10^4 cpm</div> • Vent Vent A Kaman <div style="border: 1px solid black; padding: 2px; margin-left: 20px;">RM-VG-179 GREATER THAN 1.83×10^6 μCi/sec</div> • Vent Vent A MGPI <div style="border: 1px solid black; padding: 2px; margin-left: 20px;">RM-VG-179 GREATER THAN 1.73×10^6 μCi/sec</div> • Vent Vent B Kaman <div style="border: 1px solid black; padding: 2px; margin-left: 20px;">RM-VG-180 GREATER THAN 1.83×10^6 μCi/sec</div> • Vent Vent B MGPI <div style="border: 1px solid black; padding: 2px; margin-left: 20px;">RM-VG-180 GREATER THAN 1.99×10^6 μCi/sec</div> • Process Vent Kaman <div style="border: 1px solid black; padding: 2px; margin-left: 20px;">RM-GW-178 GREATER THAN 2.0×10^7 μCi/sec</div> • Process Vent MGPI <div style="border: 1px solid black; padding: 2px; margin-left: 20px;">RM-GW-178 GREATER THAN 1.35×10^7 μCi/sec</div> <p style="text-align: center;"><u>OR</u></p> b) HP assessment (sample results or dose projections) indicate greater than 10 times ODCM allowable limit	ALERT

NUMBER EPIP-1.01	ATTACHMENT TITLE EMERGENCY ACTION LEVEL TABLE (TAB E)	REVISION 34
ATTACHMENT 1	RADIOACTIVITY EVENT	PAGE 26 of 43

<u>CONDITION/APPLICABILITY</u>	<u>INDICATION</u>	<u>CLASSIFICATION</u>
4. High radiation or airborne contamination levels indicate a severe degradation in control of radioactive material ALL MODES	Valid readings on any of the following monitors have increased by a factor of 1000 and remain for at least 15 minutes: <ul style="list-style-type: none"> • Ventilation Vent Multi-sample gaseous or particulate monitor <div style="border: 1px solid black; padding: 2px; width: fit-content; margin-left: 20px;">RM-VG-106 or -105</div> • Control Room Area <div style="border: 1px solid black; padding: 2px; width: fit-content; margin-left: 20px;">RMS-157</div> • Aux. Bldg. Control Area <div style="border: 1px solid black; padding: 2px; width: fit-content; margin-left: 20px;">RMS-154</div> • Decon. Bldg. Area <div style="border: 1px solid black; padding: 2px; width: fit-content; margin-left: 20px;">RMS-151</div> • Fuel Pool Bridge Area <div style="border: 1px solid black; padding: 2px; width: fit-content; margin-left: 20px;">RMS-153</div> • New fuel storage Area <div style="border: 1px solid black; padding: 2px; width: fit-content; margin-left: 20px;">RMS-152</div> • Laboratory Area <div style="border: 1px solid black; padding: 2px; width: fit-content; margin-left: 20px;">RMS-158</div> • Sample Room Area <div style="border: 1px solid black; padding: 2px; width: fit-content; margin-left: 20px;">RMS-156</div> 	ALERT

NUMBER	ATTACHMENT TITLE	REVISION
EPIP-1.01	EMERGENCY ACTION LEVEL TABLE (TAB E)	34
ATTACHMENT	RADIOACTIVITY EVENT	PAGE
1		27 of 43

<u>CONDITION/APPLICABILITY</u>	<u>INDICATION</u>	<u>CLASSIFICATION</u>
5. Effluent release greater than ODCM allowable limit ALL MODES	a) Any of the following monitors indicate valid readings above the specified value for more than 1 hour: <ul style="list-style-type: none"> • Clarifier Effluent <div style="border: 1px solid black; padding: 2px; margin-left: 20px;">RM-LW-111 GREATER THAN 4.8×10^4 cpm</div> • Discharge Canal <div style="border: 1px solid black; padding: 2px; margin-left: 20px;">RM-SW-130 or -230 GREATER THAN 5×10^3 cpm</div> • Vent Vent A Kaman <div style="border: 1px solid black; padding: 2px; margin-left: 20px;">RM-VG-179 GREATER THAN 1.83×10^5 μCi/sec</div> • Vent Vent A MGPI <div style="border: 1px solid black; padding: 2px; margin-left: 20px;">RM-VG-179 GREATER THAN 1.73×10^5 μCi/sec</div> • Vent Vent B Kaman <div style="border: 1px solid black; padding: 2px; margin-left: 20px;">RM-VG-180 GREATER THAN 1.83×10^5 μCi/sec</div> • Vent Vent B MGPI <div style="border: 1px solid black; padding: 2px; margin-left: 20px;">RM-VG-180 GREATER THAN 1.99×10^5 μCi/sec</div> • Process Vent Kaman <div style="border: 1px solid black; padding: 2px; margin-left: 20px;">RM-GW-178 GREATER THAN 2.0×10^6 μCi/sec</div> • Process Vent MGPI <div style="border: 1px solid black; padding: 2px; margin-left: 20px;">RM-GW-178 GREATER THAN 1.35×10^6 μCi/sec</div> <p style="text-align: center;">OR</p> b) HP assessment (sample results or dose projections) indicates greater than ODCM allowable limit	NOTIFICATION OF UNUSUAL EVENT

NUMBER	ATTACHMENT TITLE	REVISION
EPIP-1.01	EMERGENCY ACTION LEVEL TABLE (TAB G)	34
ATTACHMENT 1	LOSS OF SECONDARY COOLANT	PAGE 28 of 43

<u>CONDITION/APPLICABILITY</u>	<u>INDICATION</u>	<u>CLASSIFICATION</u>
1. Major secondary line break with significant primary to secondary leakage and fuel damage indicated MODES 1, 2, 3, & 4	<p>Conditions a) and b) exist with c):</p> <p>a) Uncontrolled loss of secondary coolant - IN PROGRESS</p> <p><u>AND</u></p> <p>b) RCS specific activity exceeds limits of T.S. Figure 3.4-1 (See Attachment 2)</p> <p><u>OR</u></p> <p>High Range Letdown radiation monitor</p> <div style="border: 1px solid black; padding: 2px; width: fit-content; margin: 5px auto;">1-CH-RI-128 or 2-CH-RI-228 GREATER THAN Hi Alarm setpoint</div> <p><u>AND</u></p> <p>c) Vent Vent A Kaman Monitor</p> <div style="border: 1px solid black; padding: 2px; width: fit-content; margin: 5px auto;">RM-VG-179 GREATER THAN 6.45×10^7 $\mu\text{Ci}/\text{sec}$</div> <p><u>OR</u></p> <p>HP determines Site Boundary DDE GREATER THAN 50 mrem/hr</p> <p><u>OR</u></p> <p>Vent Vent A MGPI Monitor</p> <div style="border: 1px solid black; padding: 2px; width: fit-content; margin: 5px auto;">RM-VG-179 GREATER THAN 6.21×10^7 $\mu\text{Ci}/\text{sec}$</div> <p><u>OR</u></p> <p>Affected pathway Steam Generator Blowdown monitor</p> <div style="border: 1px solid black; padding: 2px; width: fit-content; margin: 5px auto;">RM-SS-122, -123, -124, -222, -223, -224 GREATER THAN 1×10^6 cpm</div> <p><u>OR</u></p> <p>Affected pathway Main Steam Line High Range monitor</p> <div style="border: 1px solid black; padding: 2px; width: fit-content; margin: 5px auto;">RM-MS-170, -171, -172, -270, -271, -272 GREATER THAN 12.2 mR/hr</div>	SITE AREA EMERGENCY

NUMBER	ATTACHMENT TITLE	REVISION
EPIP-1.01	EMERGENCY ACTION LEVEL TABLE (TAB G)	34
ATTACHMENT	LOSS OF SECONDARY COOLANT	PAGE
1		29 of 43

<u>CONDITION/APPLICABILITY</u>	<u>INDICATION</u>	<u>CLASSIFICATION</u>
<p>2. Major secondary line break with significant primary to secondary leakage</p> <p>MODES 1, 2, 3, & 4</p>	<ul style="list-style-type: none"> • Uncontrolled loss of secondary coolant - IN PROGRESS <p style="text-align: center;"><u>AND</u></p> <ul style="list-style-type: none"> • Vent Vent A Kaman Monitor <div style="border: 1px solid black; padding: 2px; margin: 5px 0;"> RM-VG-179 GREATER THAN $1.83 \times 10^6 \mu\text{Ci}/\text{sec}$ </div> <p style="text-align: center;"><u>OR</u></p> <p>HP assessment of sample results indicates GREATER THAN 10 times ODCM allowable limit (Alert per EAL E-3)</p> <p style="text-align: center;"><u>OR</u></p> <p>Vent Vent A MGPI Monitor</p> <div style="border: 1px solid black; padding: 2px; margin: 5px 0;"> RM-VG-179 GREATER THAN $1.76 \times 10^6 \mu\text{Ci}/\text{sec}$ </div> <p style="text-align: center;"><u>OR</u></p> <p>Steam Generator Blowdown monitor on affected pathway</p> <div style="border: 1px solid black; padding: 2px; margin: 5px 0;"> RM-SS-122, -123, -124 RM-SS-222, -223, -224 GREATER THAN 1×10^5 cpm </div> <p style="text-align: center;"><u>OR</u></p> <p>Main Steam Line High Range monitor on affected pathway</p> <div style="border: 1px solid black; padding: 2px; margin: 5px 0;"> RM-MS-170, -171, -172 RM-MS-270, -271, -272 GREATER THAN 0.14 mR/hr </div>	<p>ALERT</p>
<p>3. Major secondary line break</p> <p>MODES 1, 2, 3, & 4</p>	<p>Uncontrolled loss of secondary coolant - IN PROGRESS</p>	<p>NOTIFICATION OF UNUSUAL EVENT</p>

NUMBER	ATTACHMENT TITLE	REVISION
EPIP-1.01	EMERGENCY ACTION LEVEL TABLE (TAB H)	34
ATTACHMENT	ELECTRICAL FAILURE	PAGE
1		30 of 43

<u>CONDITION/APPLICABILITY</u>	<u>INDICATION</u>	<u>CLASSIFICATION</u>
1. Loss of offsite and onsite AC power for more than 15 minutes ALL MODES	The following conditions exist for greater than 15 minutes: <ul style="list-style-type: none"> • Ammeters for 4160V Reserve Station Service Buses D, E, & F all indicate - zero (0) amps <p style="text-align: center;"><u>AND</u></p> <ul style="list-style-type: none"> • Ammeters for 4160V Station Service Buses A, B, & C all indicate - zero (0) amps <p style="text-align: center;"><u>AND</u></p> <ul style="list-style-type: none"> • Ammeters for 4160V Emergency Buses H & J both indicate - zero (0) amps 	SITE AREA EMERGENCY
2. Loss of all onsite DC power for greater than 15 minutes ALL MODES	The following conditions exist for greater than 15 minutes: <ul style="list-style-type: none"> • All station battery voltmeters indicate zero (0) volts <p style="text-align: center;"><u>AND</u></p> <ul style="list-style-type: none"> • No light indication available to Reserve Station Service breakers 15D1, 15E1 and 15F1 	SITE AREA EMERGENCY

NUMBER	ATTACHMENT TITLE	REVISION
EPIP-1.01	EMERGENCY ACTION LEVEL TABLE (TAB H) ELECTRICAL FAILURE	34
ATTACHMENT 1		PAGE 31 of 43

<u>CONDITION/APPLICABILITY</u>	<u>INDICATION</u>	<u>CLASSIFICATION</u>
<p>CAUTION: EAL A.1 is duplicated below for cross-reference/comparison to EAL H.3:</p>		
<p>A.1. Loss of function needed for unit HSD condition</p> <p>MODES 1, 2, 3 & 4</p>	<ul style="list-style-type: none"> Total loss of the Charging/SI System <p style="text-align: center;"><u>OR</u></p> <ul style="list-style-type: none"> Total loss of the Main Feedwater and Auxiliary Feedwater Systems 	<p>SITE AREA EMERGENCY</p>
<p>3. Loss of all offsite and onsite AC power</p> <p>ALL MODES</p>	<ul style="list-style-type: none"> Ammeters for 4160V Reserve Station Service Buses D, E, & F all indicate - zero (0) amps <p style="text-align: center;"><u>AND</u></p> <ul style="list-style-type: none"> Ammeters for 4160V Station Service Buses A, B, & C all indicate - zero (0) amps <p style="text-align: center;"><u>AND</u></p> <ul style="list-style-type: none"> Ammeters for 4160V Emergency Buses H and J both indicate - zero (0) amps 	<p>ALERT</p>
<p>4. Loss of all onsite DC power</p> <p>ALL MODES</p>	<ul style="list-style-type: none"> All station battery voltmeters indicate - zero (0) volts <p style="text-align: center;"><u>AND</u></p> <ul style="list-style-type: none"> No light indication available to Reserve Station Service Breakers 15D1, 15E1 and 15F1 	<p>ALERT</p>

NUMBER	ATTACHMENT TITLE	REVISION
EPIP-1.01	EMERGENCY ACTION LEVEL TABLE	34
ATTACHMENT	(TAB H)	PAGE
1	ELECTRICAL FAILURE	32 of 43

<u>CONDITION/APPLICABILITY</u>	<u>INDICATION</u>	<u>CLASSIFICATION</u>
5. Loss of offsite power or onsite AC power capability ALL MODES	<ul style="list-style-type: none"> • Unit main generator and both emergency diesel generators out of service <p style="text-align: center;"><u>OR</u></p> Loss of all 34.5 KV reserve station service buses	NOTIFICATION OF UNUSUAL EVENT

NUMBER EPIP-1.01	ATTACHMENT TITLE EMERGENCY ACTION LEVEL TABLE (TAB I) FIRE	REVISION 34
ATTACHMENT 1		PAGE 33 of 43

<u>CONDITION/APPLICABILITY</u>	<u>INDICATION</u>	<u>CLASSIFICATION</u>
1. Fire resulting in degradation of safety systems MODES 1, 2, 3, & 4	<ul style="list-style-type: none"> • Fire which causes major degradation of a safety system function required for protection of the public <p style="text-align: center;"><u>AND</u></p> <ul style="list-style-type: none"> • Affected systems are caused to be <u>NOT</u> operable as defined by Tech. Specs. 	SITE AREA EMERGENCY
2. Fire potentially affecting station safety systems MODES 1, 2, 3, & 4	Fire which has potential for causing a safety system not to be operable as defined by Tech. Specs.	ALERT
3. Fire lasting greater than 10 minutes in Protected Area or Service Water Pump/Valve House ALL MODES	Fire within the Protected Area or Service Water Pump/Valve House which is not under control within 10 minutes after Fire Brigade - DISPATCHED	NOTIFICATION OF UNUSUAL EVENT

NUMBER	ATTACHMENT TITLE EMERGENCY ACTION LEVEL TABLE (TAB J) SECURITY EVENT	REVISION
EPIP-1.01		34
ATTACHMENT		PAGE
1		34 of 43

<u>CONDITION/APPLICABILITY</u>	<u>INDICATION</u>	<u>CLASSIFICATION</u>
1. Loss of physical Station control ALL MODES	<ul style="list-style-type: none"> Shift Supervisor has been informed that the security force has been neutralized by attack, resulting in loss of physical control of station <p style="text-align: center;"><u>OR</u></p> Shift Supervisor has been informed of intrusion into one or more Vital Areas which are occupied or controlled by an aggressor	GENERAL EMERGENCY
2. Imminent loss of physical Station control ALL MODES	Security Shift Supervisor has notified the Operations Shift Supervisor of imminent intrusion into a Vital Area	SITE AREA EMERGENCY
3. Ongoing Security compromise ALL MODES	Security Shift Supervisor has notified the Operations Shift Supervisor of a confirmed unneutralized intrusion into the Protected Area	ALERT
4. Security threat, unauthorized attempted entry, or attempted sabotage ALL MODES	Security Shift Supervisor has recommended that the Operations Shift Supervisor declare a Notification of Unusual Event IAW applicable Security Contingency Plan Implementing Procedures	NOTIFICATION OF UNUSUAL EVENT

NUMBER	ATTACHMENT TITLE	REVISION
EPIP-1.01	EMERGENCY ACTION LEVEL TABLE (TAB K) HAZARD TO STATION OPERATION	34
ATTACHMENT		PAGE
1		35 of 43

<u>CONDITION/APPLICABILITY</u>	<u>INDICATION</u>	<u>CLASSIFICATION</u>
1. Aircraft damage to vital plant systems MODES 1, 2, 3, & 4	Aircraft crash which affects vital structures by impact or fire	SITE AREA EMERGENCY
2. Severe explosive damage MODES 1, 2, 3, & 4	Explosion which results in severe degradation of any of the following systems required for safe shutdown: <ul style="list-style-type: none"> • CVCS System <li style="text-align: center;"><u>OR</u> ECCS System <li style="text-align: center;"><u>OR</u> Main/Auxiliary Feedwater System 	SITE AREA EMERGENCY
3. Entry of toxic or flammable gases into plant vital areas other than the Control Room MODES 1, 2, 3, & 4	<ul style="list-style-type: none"> • Uncontrolled release of toxic or flammable agents greater than life threatening or explosive limits in Vital Areas <li style="text-align: center;"><u>AND</u> • Evacuation of Vital Area other than Control Room - REQUIRED <li style="text-align: center;"><u>OR</u> Significant degradation of plant safety systems resulting in loss of a safety system function required for protection of the public 	SITE AREA EMERGENCY

NUMBER	ATTACHMENT TITLE	REVISION
EPIP-1.01	EMERGENCY ACTION LEVEL TABLE (TAB K)	34
ATTACHMENT	HAZARD TO STATION OPERATION	PAGE
1		36 of 43

<u>CONDITION/APPLICABILITY</u>	<u>INDICATION</u>	<u>CLASSIFICATION</u>
4. Severe missile damage to safety systems MODES 1, 2, 3, & 4	Missile impact causing severe degradation of safety systems required for unit shutdown	SITE AREA EMERGENCY
5. Aircraft crash on the facility ALL MODES	Aircraft crash within the Protected Area or Switchyard	ALERT
6. Explosion damage to facility ALL MODES	Unplanned explosion resulting in damage to plant structure or equipment that affects plant operations	ALERT
7. Entry of toxic or flammable gases or liquids into plant facility ALL MODES	Notification of uncontrolled release of toxic or flammable agent which causes: <ul style="list-style-type: none"> • Evacuation of personnel from plant areas <p style="text-align: center;"><u>AND</u></p> <ul style="list-style-type: none"> • Safety related equipment is rendered inoperable 	ALERT
8. Turbine failure or missile impact MODES 1 & 2	Failure of turbine/generator rotating equipment resulting in casing penetration	ALERT

NUMBER	ATTACHMENT TITLE	REVISION
EPIP-1.01	EMERGENCY ACTION LEVEL TABLE (TAB K) HAZARD TO STATION OPERATION	34
ATTACHMENT 1		PAGE 37 of 43

<u>CONDITION/APPLICABILITY</u>	<u>INDICATION</u>	<u>CLASSIFICATION</u>
9. Missile damage to safety related equipment or structures MODES 1, 2, 3, & 4	Notification of missile impact causing damage to safety related equipment or structures	ALERT
10. Aircraft crash or unusual aircraft activity ALL MODES	<ul style="list-style-type: none"> • Confirmed notification of aircraft crash within the site boundary <p style="text-align: center;"><u>OR</u></p> Unusual aircraft activity in the vicinity of the site as determined by the Operations Shift Supervisor or the Security Shift Supervisor	NOTIFICATION OF UNUSUAL EVENT
11. Train derailment within Protected Area ALL MODES	Confirmed report of train derailment within Protected Area	NOTIFICATION OF UNUSUAL EVENT
12. Explosion within Protected Area ALL MODES	Confirmed report of unplanned explosion within Protected Area	NOTIFICATION OF UNUSUAL EVENT
13. Onsite or nearsite release of toxic or flammable liquids or gases ALL MODES	Notification of unplanned release of toxic or flammable agents which may affect safety of station personnel or equipment	NOTIFICATION OF UNUSUAL EVENT

NUMBER EPIP-1.01	ATTACHMENT TITLE EMERGENCY ACTION LEVEL TABLE (TAB K) HAZARD TO STATION OPERATION	REVISION 34
ATTACHMENT 1		PAGE 38 of 43

<u>CONDITION/APPLICABILITY</u>	<u>INDICATION</u>	<u>CLASSIFICATION</u>
14. Turbine rotating component failure with no casing penetration MODES 1 & 2	Failure of turbine/generator rotating equipment resulting in immediate unit shutdown	NOTIFICATION OF UNUSUAL EVENT

NUMBER	ATTACHMENT TITLE	REVISION
EPIP-1.01	EMERGENCY ACTION LEVEL TABLE	34
ATTACHMENT	(TAB L)	PAGE
1	NATURAL EVENTS	39 of 43

<u>CONDITION/APPLICABILITY</u>	<u>INDICATION</u>	<u>CLASSIFICATION</u>
1. Earthquake greater than or equal to DBE levels ALL MODES	<ul style="list-style-type: none"> • Confirmed earthquake which activates the Event Alarm on the Strong Motion Accelerograph <p style="text-align: center;"><u>AND</u></p> <ul style="list-style-type: none"> • Alarms on the Peak Shock Annunciator indicate a horizontal motion of greater than or equal to 0.12 g or a vertical motion of greater than or equal to 0.08g 	SITE AREA EMERGENCY
2. Sustained winds in excess of design levels experienced or projected MODES 1, 2, 3, & 4	Sustained winds 150 mph OR GREATER experienced or projected	SITE AREA EMERGENCY
3. Flood or low water level above design levels MODES 1, 2, 3, & 4	Either condition a) or b) exists a) Flood in the Lake Anna Reservoir with indicated level - greater than 264 feet MSL <p style="text-align: center;"><u>OR</u></p> b) Low water level in the Lake Anna Reservoir with indicated level - less than 244 feet MSL <p style="text-align: center;"><u>AND</u></p> Inability to satisfy action requirements of T.S. 3.7.5.1 for Ultimate Heat Sink	SITE AREA EMERGENCY

NUMBER	ATTACHMENT TITLE	REVISION
EPIP-1.01	EMERGENCY ACTION LEVEL TABLE (TAB L)	34
ATTACHMENT	NATURAL EVENTS	PAGE
1		40 of 43

<u>CONDITION/APPLICABILITY</u>	<u>INDICATION</u>	<u>CLASSIFICATION</u>
4. Earthquake greater than or equal to OBE levels ALL MODES	<ul style="list-style-type: none"> • Confirmed earthquake which activates Event Alarm on the Strong Motion Accelerograph <p style="text-align: center;"><u>AND</u></p> <ul style="list-style-type: none"> • Alarms on the Peak Shock Annunciator indicate a horizontal motion of greater than or equal to 0.06 g or a vertical motion of greater than or equal to 0.04g 	ALERT
5. Tornado striking facility ALL MODES	Tornado visually detected striking structures within the Protected Area or Switchyard	ALERT
6. Hurricane winds near design basis level experienced or projected ALL MODES	Hurricane winds 120 mph OR GREATER experienced or projected	ALERT
7. Flood or low water level near design levels ALL MODES	<ul style="list-style-type: none"> • Flood in the Lake Anna Reservoir with indicated level - greater than 263 feet MSL <p style="text-align: center;"><u>OR</u></p> Low water level in the Lake Anna Reservoir with indicated level - less than 244 feet MSL	ALERT

NUMBER	ATTACHMENT TITLE	REVISION
EPIP-1.01	EMERGENCY ACTION LEVEL TABLE (TAB L) NATURAL EVENTS	34
ATTACHMENT 1		PAGE 41 of 43

<u>CONDITION/APPLICABILITY</u>	<u>INDICATION</u>	<u>CLASSIFICATION</u>
8. Earthquake detected ALL MODES	Confirmed earthquake which activates the Event Alarm on the Strong Motion Accelerograph	NOTIFICATION OF UNUSUAL EVENT
9. Tornado within Protected Area or Switchyard ALL MODES	Tornado visually detected within Protected Area or Switchyard	NOTIFICATION OF UNUSUAL EVENT
10. Hurricane force winds projected onsite within 12 hours ALL MODES	• Confirmation by Virginia Power Weather Center that hurricane force winds (greater than 73 mph) projected onsite within 12 hours	NOTIFICATION OF UNUSUAL EVENT
11. 50 year flood or low water level ALL MODES	• Flood in the Lake Anna Reservoir with indicated level - greater than 254 feet MSL <u>OR</u> Low water level in the Lake Anna Reservoir with indicated level less than 246 feet MSL	NOTIFICATION OF UNUSUAL EVENT


NUMBER	ATTACHMENT TITLE EMERGENCY ACTION LEVEL TABLE (TAB M) MISCELLANEOUS ABNORMAL EVENTS	REVISION
EPIP-1.01		34
ATTACHMENT		PAGE
1		42 of 43

<u>CONDITION/APPLICABILITY</u>	<u>INDICATION</u>	<u>CLASSIFICATION</u>
1. Any major internal or external events which singly or in combination cause massive damage to station facilities or may warrant evacuation of the public ALL MODES	Shift Supervisor/Station Emergency Manager judgement	GENERAL EMERGENCY
2. Station conditions which may warrant notification of the public near the site ALL MODES	Shift Supervisor/Station Emergency Manager judgement	SITE AREA EMERGENCY
3. Station conditions which have the potential to degrade or are actually degrading the level of safety of the station ALL MODES	Shift Supervisor/Station Emergency Manager judgement	ALERT

NUMBER	ATTACHMENT TITLE	REVISION
EPIP-1.01	EMERGENCY ACTION LEVEL TABLE (TAB M)	34
ATTACHMENT 1	MISCELLANEOUS ABNORMAL EVENTS	PAGE 43 of 43

<u>CONDITION/APPLICABILITY</u>	<u>INDICATION</u>	<u>CLASSIFICATION</u>
<p>4. Station conditions which warrant increased awareness of state and/or local authorities</p> <p>ALL MODES</p>	<p>Shift Supervisor judgement that any of the following exist:</p> <ul style="list-style-type: none"> • Unit shutdown is other than a controlled shutdown <p style="text-align: center;"><u>OR</u></p> <p>Unit is in an uncontrolled condition during operation</p> <p style="text-align: center;"><u>OR</u></p> <p>A condition exists which has the potential for escalation and therefore warrants notification</p>	<p>NOTIFICATION OF UNUSUAL EVENT</p>

NUMBER EPIP-1.01	ATTACHMENT TITLE TECH SPEC FIGURE 3.4-1	REVISION 34
ATTACHMENT 2	PAGE 1 of 1	

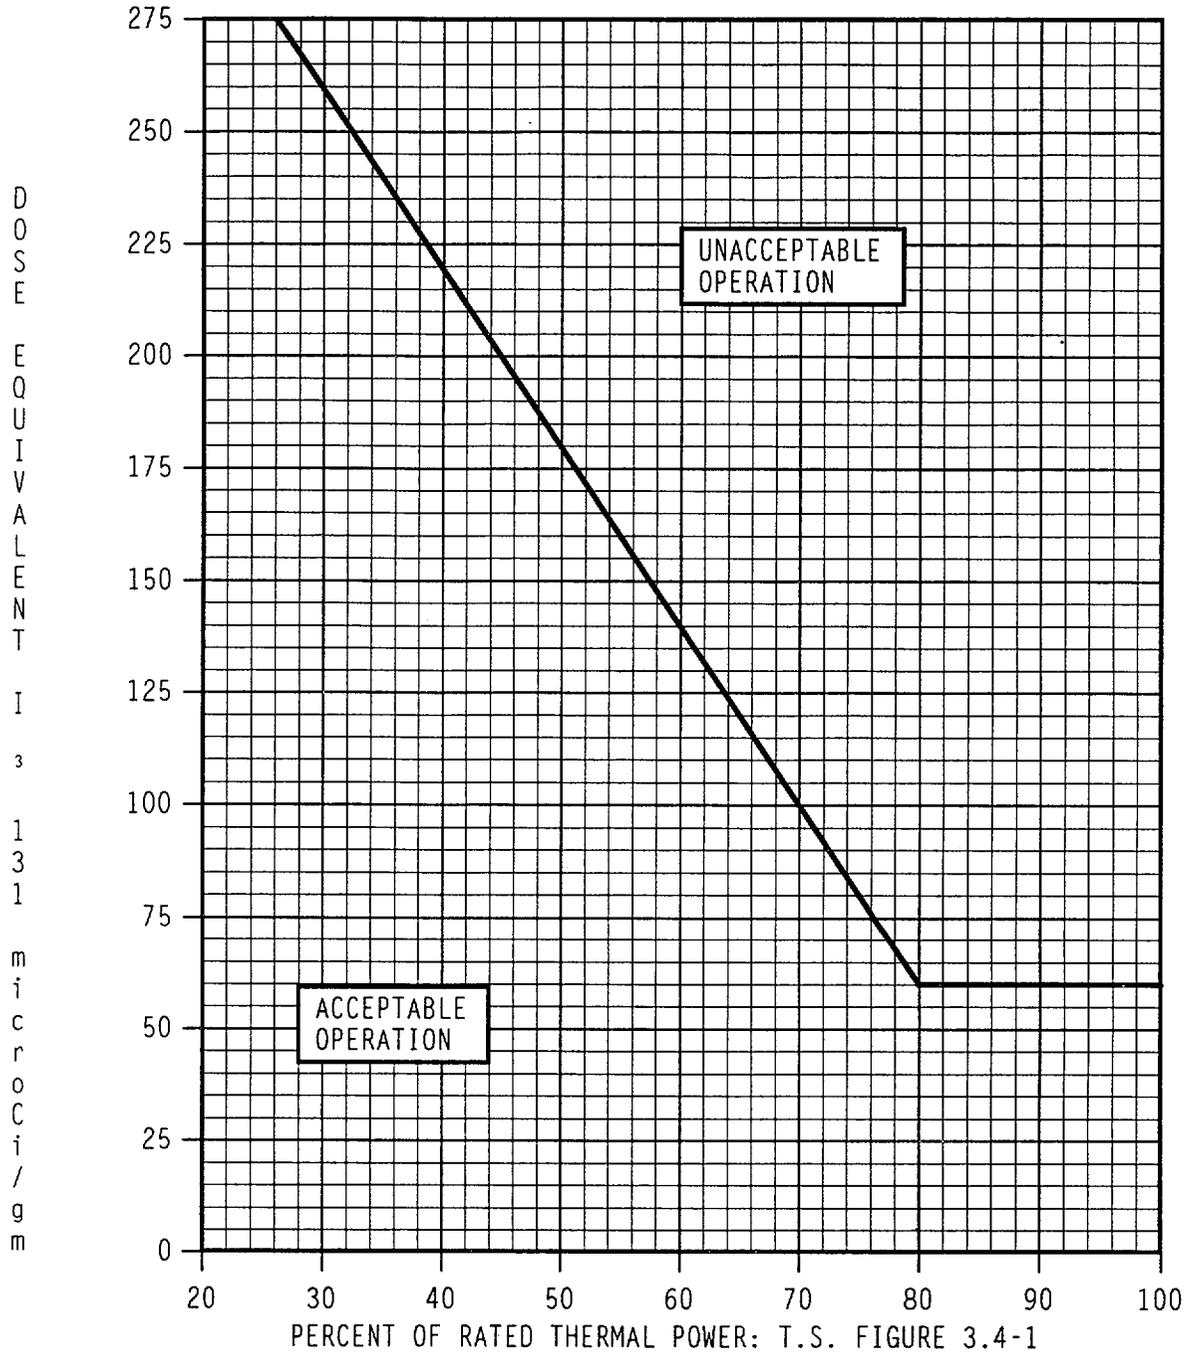

DOSE EQUIVALENT I-131 PRIMARY COOLANT SPECIFIC ACTIVITY LIMIT Versus Percent of RATED THERMAL POWER with the Primary Coolant Specific Activity > 1.0 $\mu\text{Ci/gm}$ Dose Equivalent I-131

NUMBER	ATTACHMENT TITLE	REVISION
EPIP-1.01	TURNOVER CHECKLIST	34
ATTACHMENT 3		PAGE 1 of 1

Conduct a turnover between the onshift and relief SEM in accordance with the following checklist. Use placekeeping aid at left of item, "___", to track completion.

- ___ 1. Determine the status of primary responder notification.
- ___ 2. Determine the status of "Report of Emergency to State and Local Governments," EPIP-2.01, Attachment 2. Get completed copies if available.
- ___ 3. Determine status of the "Report of Radiological Conditions to the State," EPIP-2.01, Attachment 3. Get completed copy if available.
- ___ 4. Determine status of Emergency Notification System (ENS) communications and completion status of NRC Event Notification Worksheet (EPIP-2.02 Attachment 1).
- ___ 5. Review classification and initial PAR status.
- ___ 6. Review present plant conditions and status. Get copy of Critical Safety Functions form.
- ___ 7. Review status of station firewatches and re-establish if conditions allow.
- ___ 8. Determine readiness of TSC for activation.
- ___ 9. After all information is obtained, transfer location to TSC. (Consider direct transfer of State & local notifications to LEOF/CEOF.)
- ___ 10. Call the Control Room and assess any changes that may have occurred during transition to the TSC.
- ___ 11. When sufficient personnel are available, the relief SEM is to assume the following responsibilities from the onshift Station Emergency Manager:
 - a. Reclassification.
 - b. Protective Action Recommendations until LEOF activated.
 - c. Notifications (i.e., state, local, & NRC). Upon LEOF activation, transfer notification responsibilities except for the NRC ENS.
 - d. Site evacuation authorization.
 - e. Emergency exposure authorization.
 - f. Command/control of onsite response.
- ___ 12. Formally relieve the Interim SEM and assume control in the TSC. Announce name and facility activation status to facility.

NUMBER	ATTACHMENT TITLE	REVISION
EPIP-1.01	CONSIDERATIONS FOR OPERATIONS RESPONSE UNDER ABNORMAL CONDITIONS	34
ATTACHMENT 4		PAGE 1 of 1

This attachment provides procedural guidance for controlling selected emergency response actions when their implementation would have adverse results.

Station Emergency Manager (SEM) approval is required before any required action is postponed, suspended or modified. The guidance below is not all-inclusive.

SECURITY EVENT RESPONSE:

IF implementation of emergency response facility activation or assembly of personnel for accountability could compromise Security Plan response strategies or create a personnel safety hazard due to movement of personnel, THEN consider postponing or suspending emergency response actions until threat has been resolved.

UNANTICIPATED HAZARDOUS CONDITIONS EXIST (e.g., tornado or toxic release):

IF assembling personnel for accountability or activating emergency response facilities could endanger plant personnel, THEN consider postponing emergency assembly. (Consider implementing alternative notification methods on an ad hoc basis, e.g., selectively notify personnel in unaffected areas or defer notifications until hazardous conditions are resolved.)

IF notifying augmentation could create a safety hazard for personnel coming to the station, THEN consider postponing augmentation notification. (Consider implementing alternative notification methods on an ad hoc basis, e.g., selectively notify personnel reporting to unaffected areas or defer notifications until the hazardous condition is resolved.)

ANTICIPATED SITUATION (e.g., forecasted severe weather or grid disturbance):

IF all or part of the ERO has been staged in anticipation of a predicted event, THEN notify Security to omit performance of augmentation notification (as described in EPIP-3.05, AUGMENTATION OF EMERGENCY RESPONSE ORGANIZATION).

IF adequate controls have been established to continually account for personnel staged in anticipation of a predicted event, THEN notify Security to omit performance of initial accountability (as described in EPIP-5.03, PERSONNEL ACCOUNTABILITY).

IF a decision has been made to staff the Central EOF in lieu of the LEOF, THEN notify Security that performance of EPIP-3.04, ACTIVATION OF LOCAL EMERGENCY OPERATIONS FACILITY, is not required.

IF environmental conditions are hazardous, THEN consult with Security Team Leader about suspending procedural requirements for staging road blocks (IAW EPIP-5.04, ACCESS CONTROL).