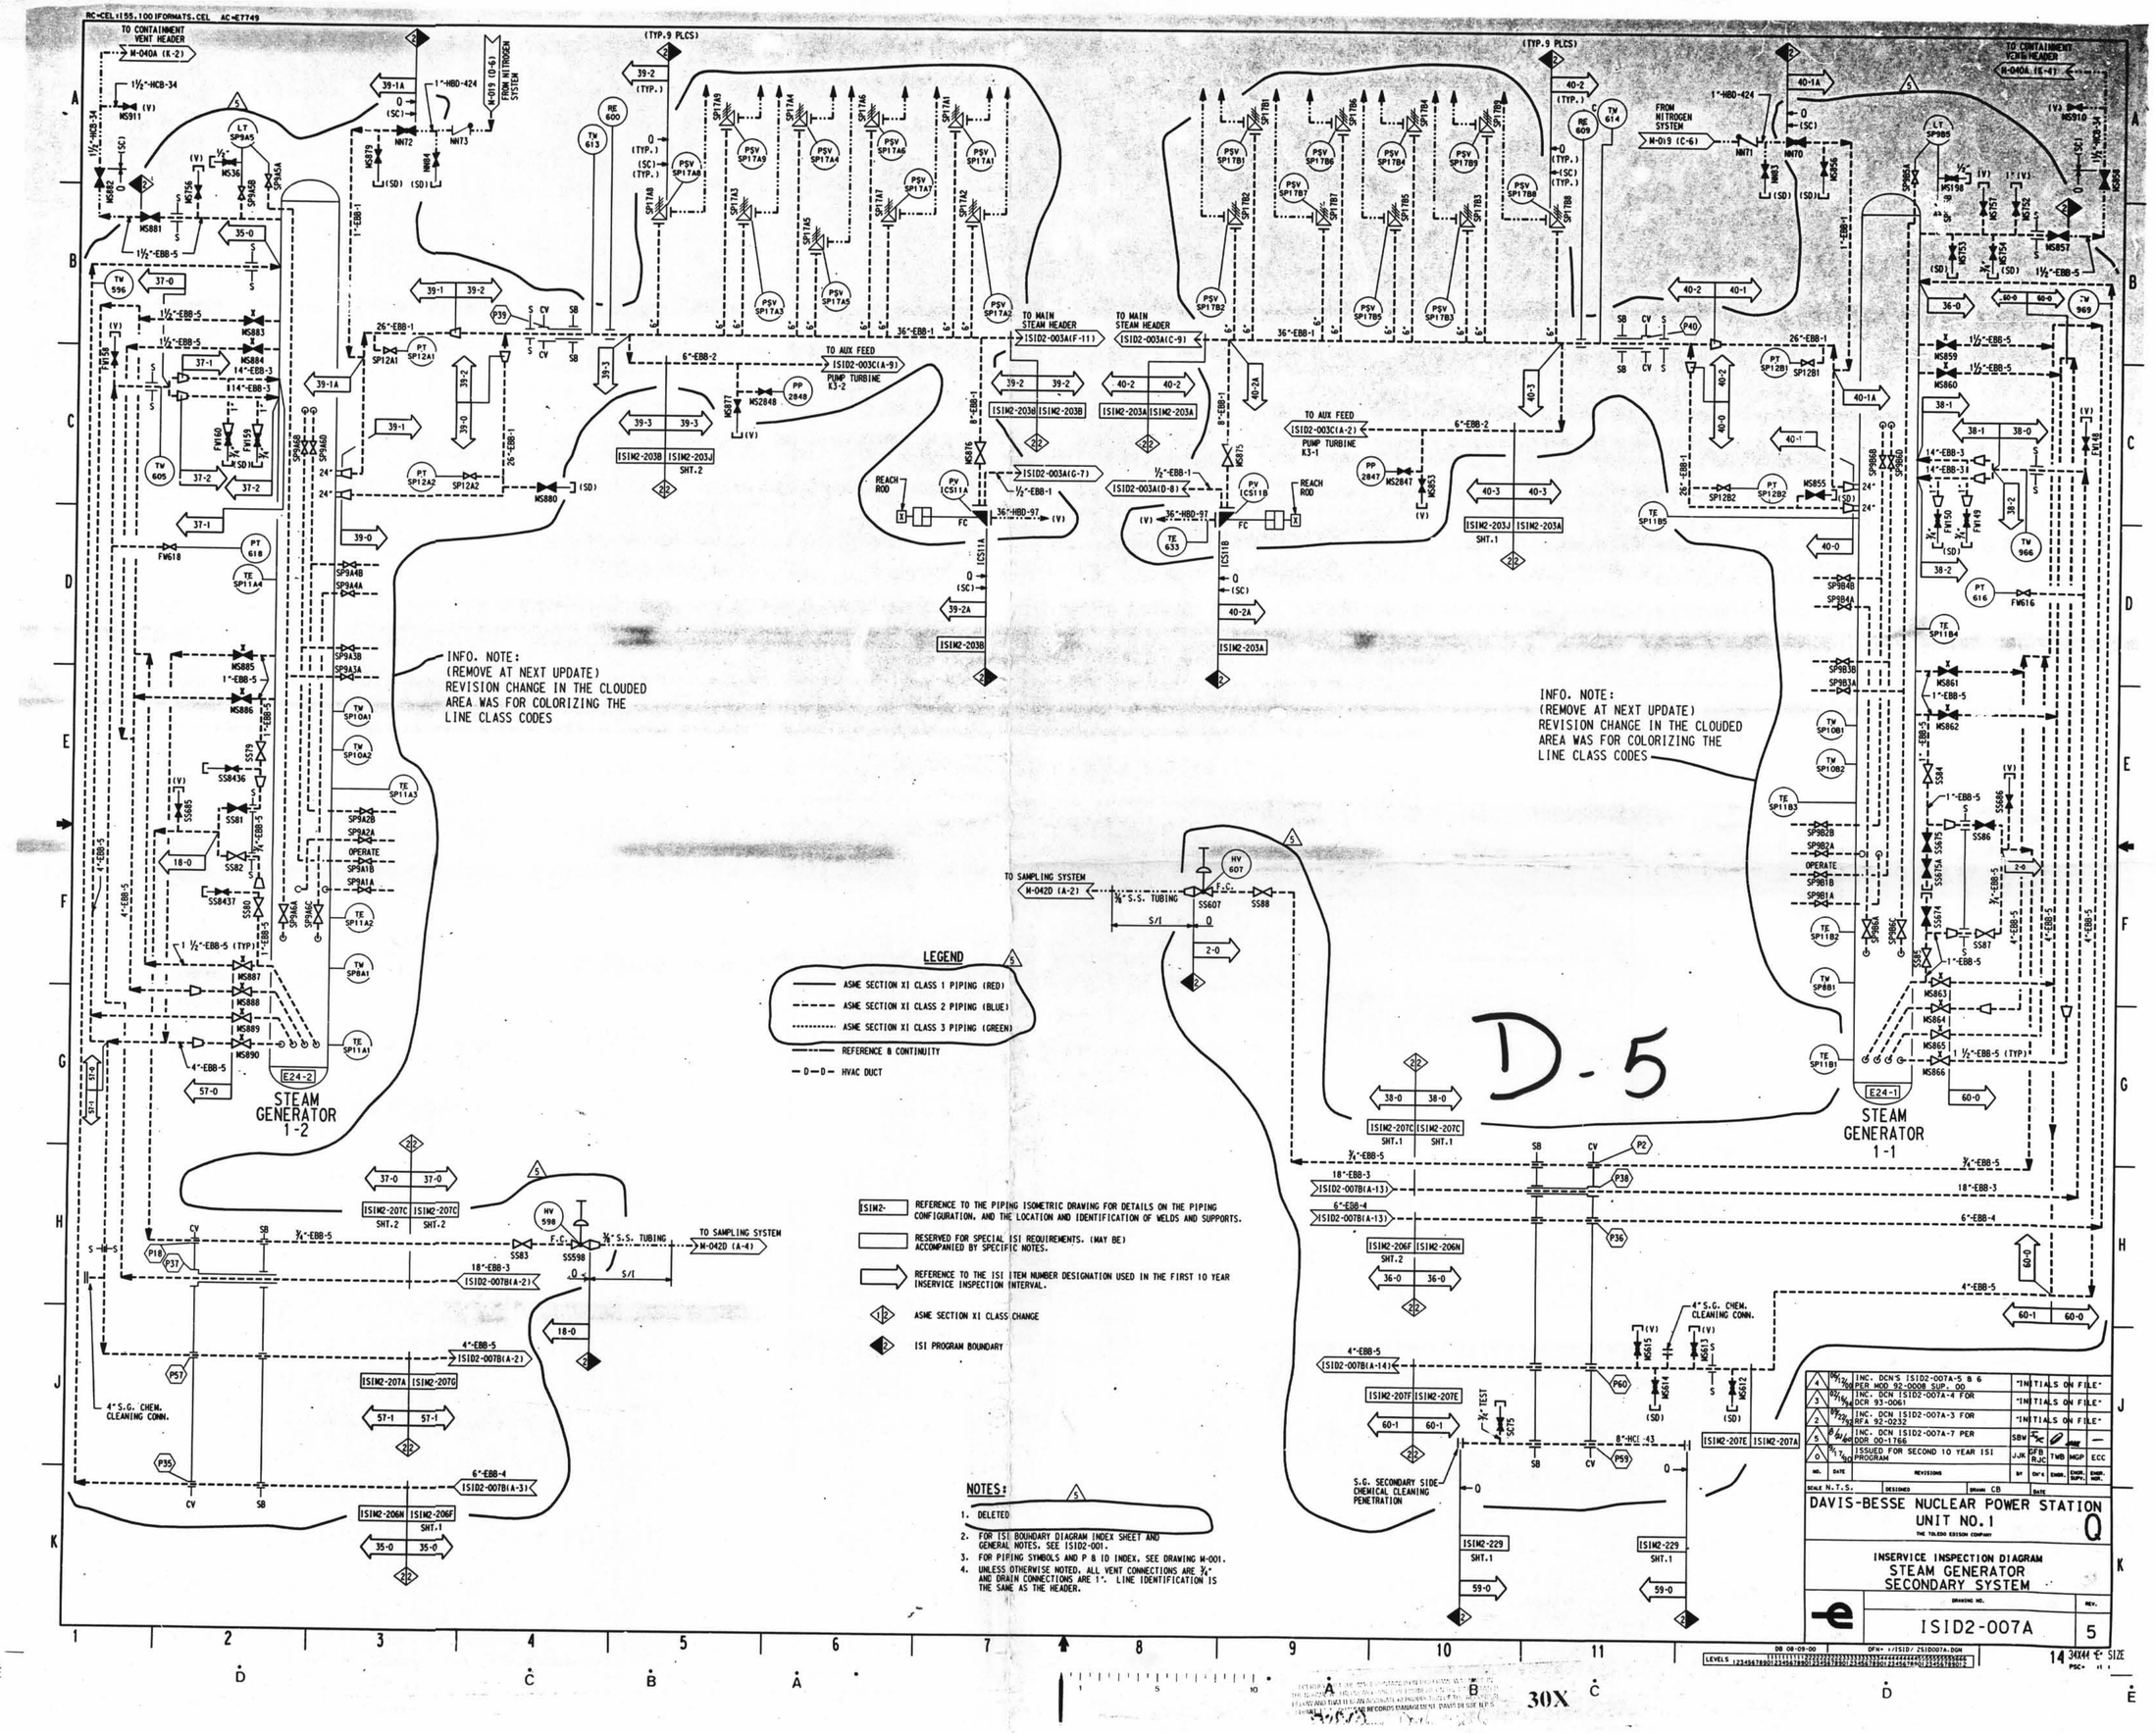
STEAM GENERATOR 1-2
STEAM GENERATOR 1-1
TO MAIN STEAM HEADER
TO AUX FEED
PUMP TURBINE K3-1
PUMP TURBINE K3-2
TO SAMPLING SYSTEM
FROM NITROGEN SYSTEM
TO CONTAINMENT VENT HEADER
INFO. NOTE:
(REMOVE AT NEXT UPDATE)
REVISION CHANGE IN THE CLOUDED AREA WAS FOR COLORIZING THE LINE CLASS CODES
LEGEND
ASME SECTION XI CLASS 1 PIPING (RED)
ASME SECTION XI CLASS 2 PIPING (BLUE)
ASME SECTION XI CLASS 3 PIPING (GREEN)
REFERENCE & CONTINUITY
HVAC DUCT
REFERENCE TO THE PIPING ISOMETRIC DRAWING FOR DETAILS ON THE PIPING CONFIGURATION, AND THE LOCATION AND IDENTIFICATION OF WELDS AND SUPPORTS.
RESERVED FOR SPECIAL ISI REQUIREMENTS. (MAY BE) ACCOMPANIED BY SPECIFIC NOTES.
REFERENCE TO THE ISI ITEM NUMBER DESIGNATION USED IN THE FIRST 10 YEAR INSERVICE INSPECTION INTERVAL.
ASME SECTION XI CLASS CHANGE
ISI PROGRAM BOUNDARY
NOTES:
1. DELETED
2. FOR ISI BOUNDARY DIAGRAM INDEX SHEET AND GENERAL NOTES, SEE ISID2-001.
3. FOR PIPING SYMBOLS AND P & ID INDEX, SEE DRAWING M-001.
4. UNLESS OTHERWISE NOTED, ALL VENT CONNECTIONS ARE ¾" AND DRAIN CONNECTIONS ARE 1". LINE IDENTIFICATION IS THE SAME AS THE HEADER.
D-5
DAVIS-BESSE NUCLEAR POWER STATION
UNIT NO. 1
THE TOLEDO EDISON COMPANY
INSERVICE INSPECTION DIAGRAM
STEAM GENERATOR
SECONDARY SYSTEM
ISID2-007A
5
INC. DCN'S ISID2-007A-5 & 6 PER MOD 92-0008 SUP. 00
INC. DCN ISID2-007A-4 FOR DCR 93-0061
INC. DCN ISID2-007A-3 FOR BFA 92-0232
INC. DCN ISID2-007A-7 PER DDR 00-1766
ISSUED FOR SECOND 10 YEAR ISI PROGRAM
"INITIALS ON FILE"
"INITIALS ON FILE"
"INITIALS ON FILE"
SCALE N.T.S.
DESIGNED
DRAWN CB
DATE
DFN= r:\ISID/_2SID007A.DGN
14 34X44 E SIZE

30X