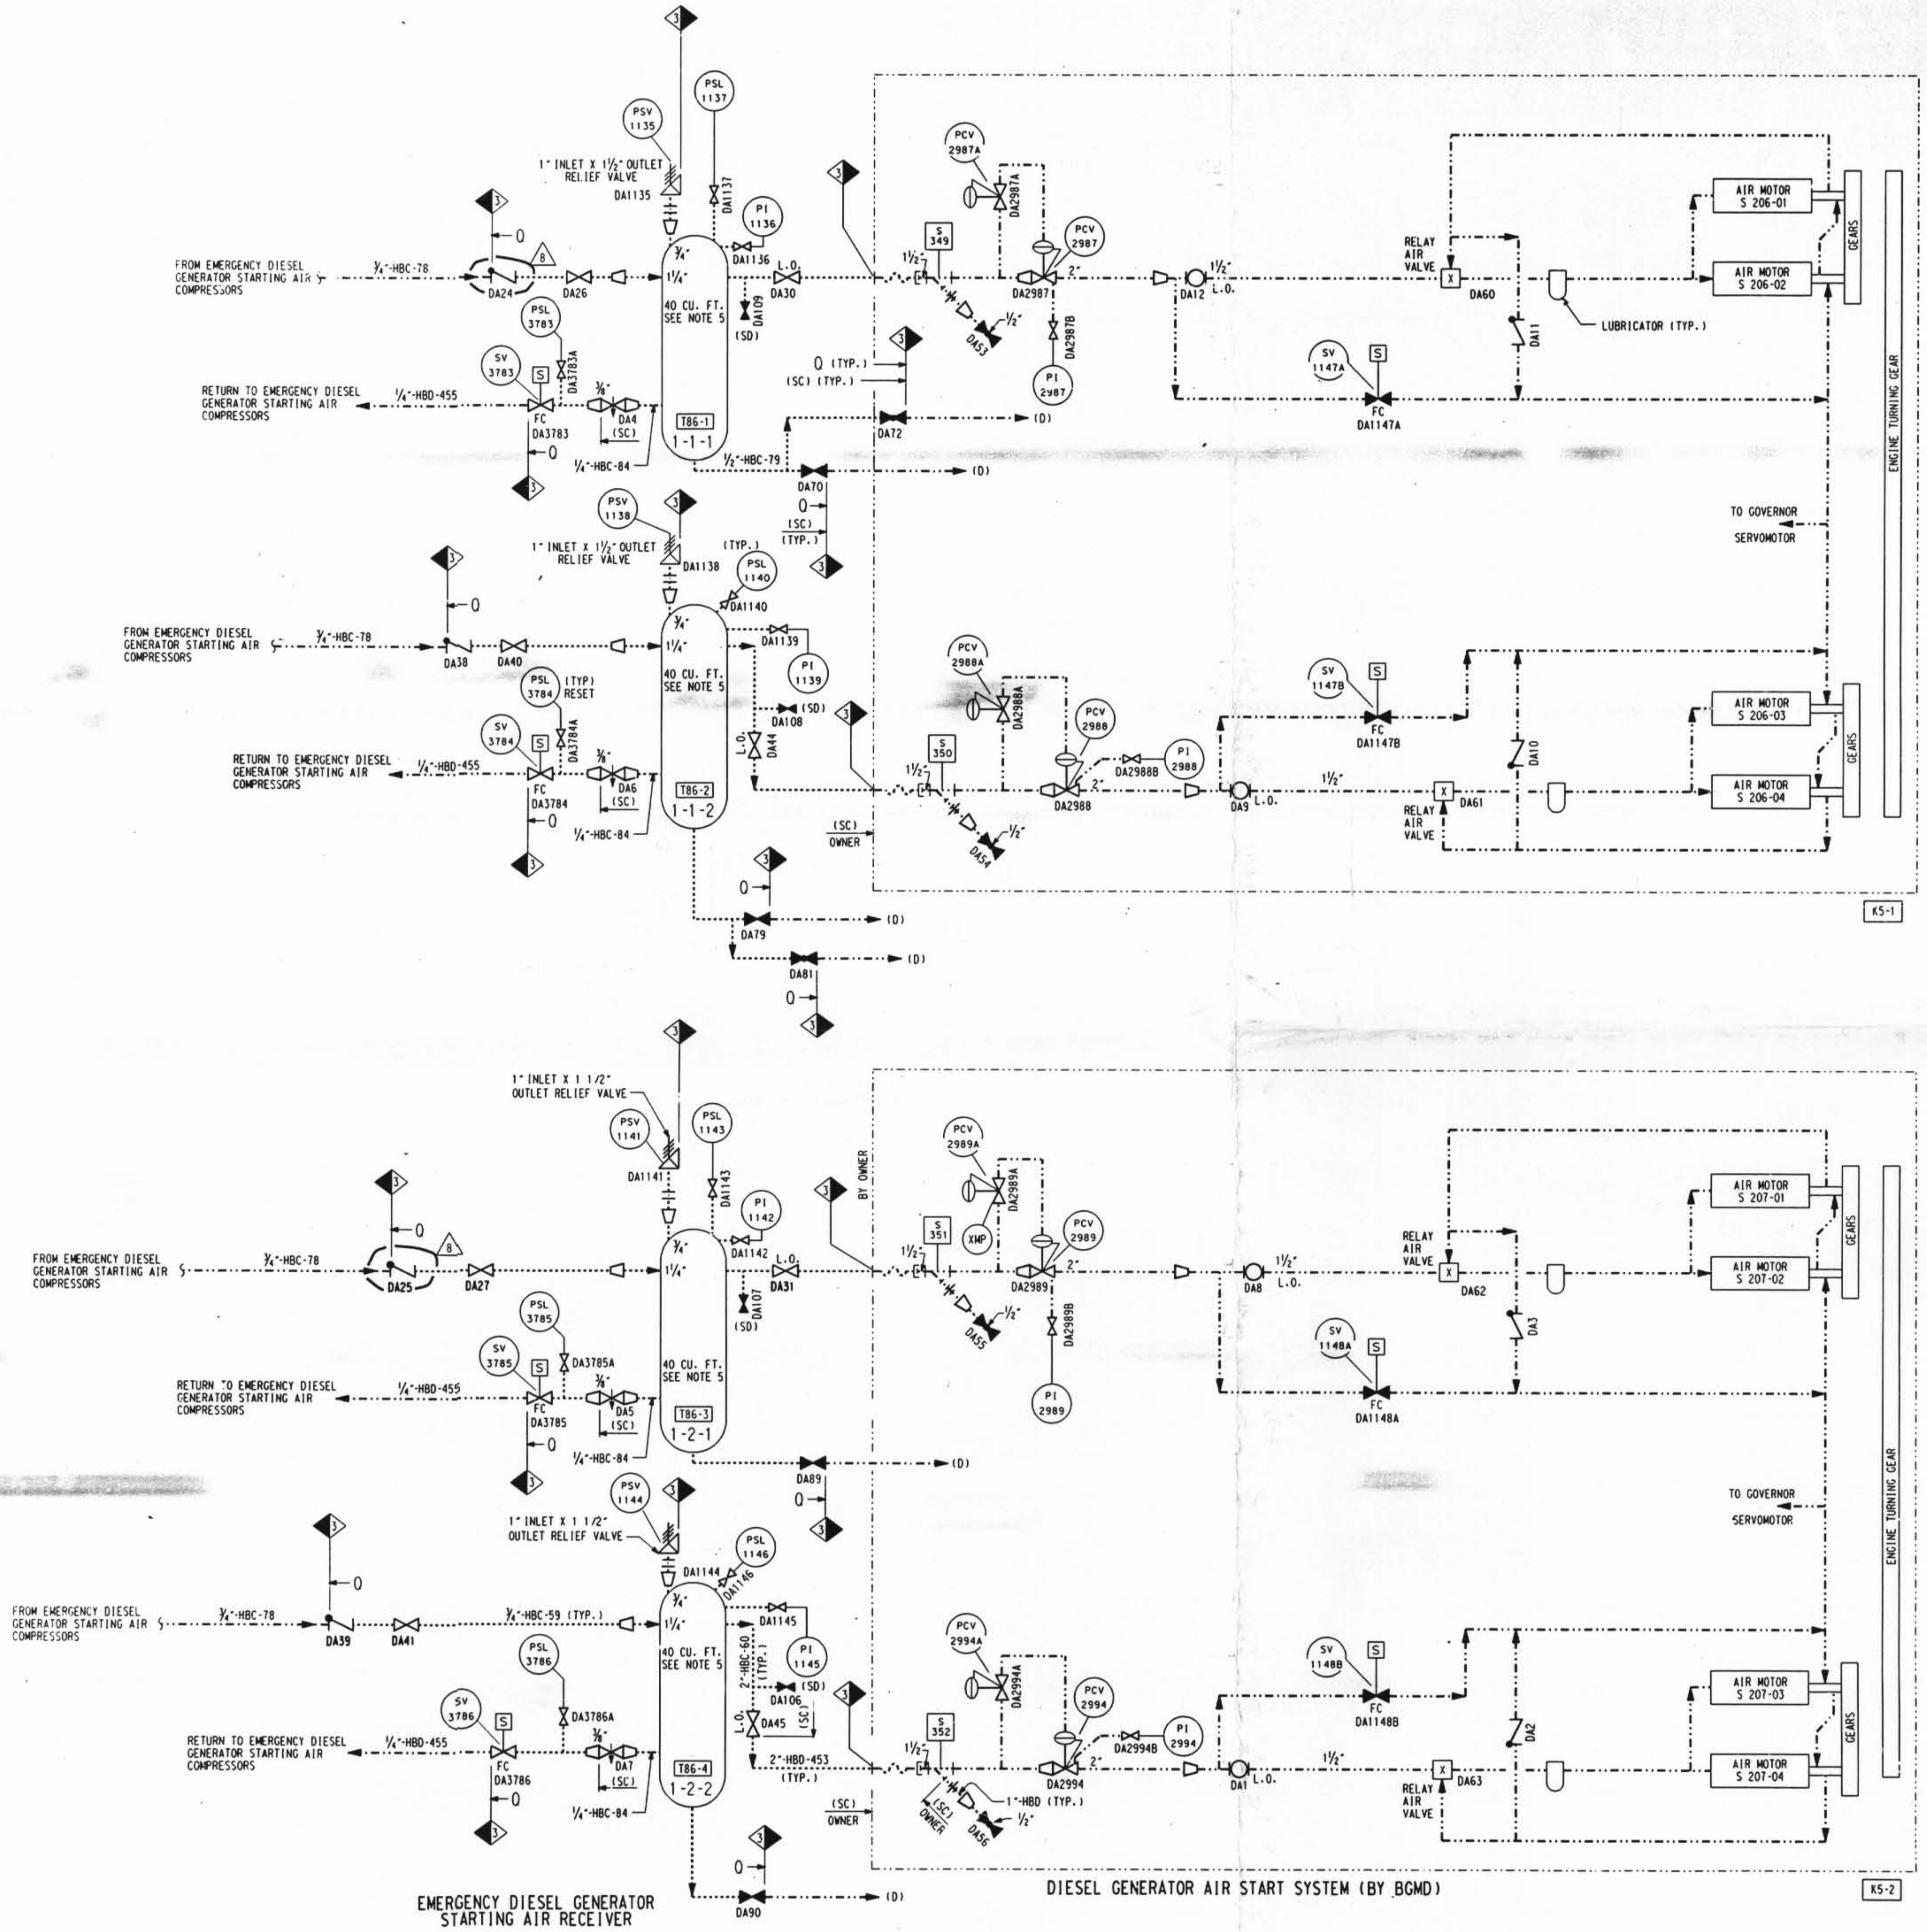

EMERGENCY DIESEL GENERATOR STARTING AIR RECEIVER

DIESEL GENERATOR AIR START SYSTEM (BY BGMD)

LEGEND

- ASME SECTION XI CLASS 1 PIPING (RED)
- ASME SECTION XI CLASS 2 PIPING (BLUE)
- ASME SECTION XI CLASS 3 PIPING (GREEN)
- REFERENCE & CONTINUITY
- D—D— HVAC DUCT

- ISIM2- : REFERENCE TO THE PIPING ISOMETRIC DRAWING FOR DETAILS ON THE PIPING CONFIGURATION, AND THE LOCATION AND IDENTIFICATION OF WELDS AND SUPPORTS.
- RESERVED FOR SPECIAL ISI REQUIREMENTS. (MAY BE) ACCOMPANIED BY SPECIFIC NOTES.
- REFERENCE TO THE ISI ITEM NUMBER DESIGNATION USED IN THE FIRST 10 YEAR INSERVICE INSPECTION INTERVAL.
- 1|2 ASME SECTION XI CLASS CHANGE
- 2 ISI PROGRAM BOUNDARY

NOTES:

1. DELETED
2. FOR ISI BOUNDARY DIAGRAM INDEX SHEET AND GENERAL NOTES, SEE ISID2-001.
3. FOR PIPING SYMBOLS AND P & ID INDEX, SEE DRAWING M-001.
4. UNLESS OTHERWISE NOTED, ALL VENT CONNECTIONS ARE ¾" AND DRAIN CONNECTIONS ARE 1". LINE IDENTIFICATION IS THE SAME AS THE HEADER.
5. WHERE NOTED THE TANK CAPACITY IS NOMINAL. WHERE APPLICABLE, SEE DB-PF-06705 (TANK LEVEL CALIBRATION CURVES) FOR INDICATED LEVEL VS. VOLUME RELATIONSHIP. (REF. PCAOR 96-0976).

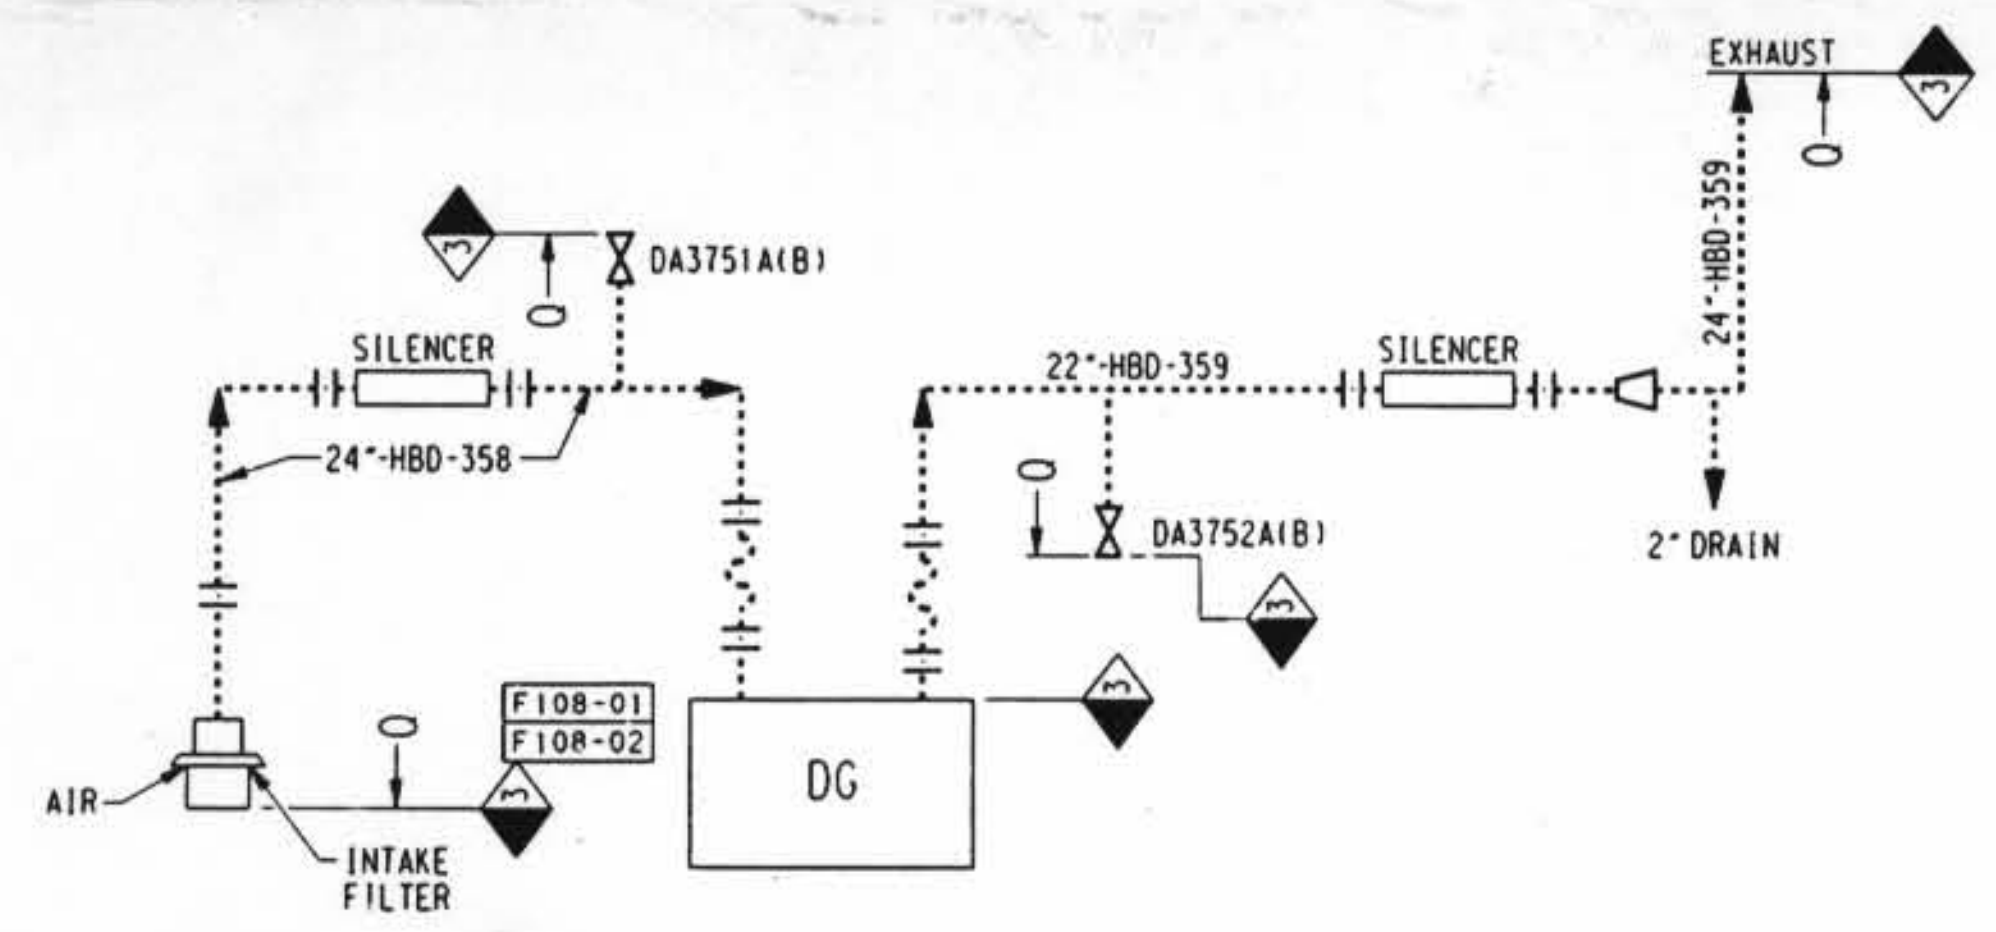

UNIT 1

UNIT 2

DIESEL GENERATOR AIR INTAKE & EXHAUST
(TYPICAL OF TWO)

EQUIPMENT NUMBERS FOR K5-2 IN PARENTHESIS

NO.	DATE	REVISIONS	BY	CH'K	ENGR.	ENGR. SUPV.	ENGR. MGR.
7	08/21/00	INC. DCN ISID2-017B-17 PER DCR 99-0001, ISID2-017B-20 PER ERR 60-0003-046; DCN ISID2-017B-21 PER ERR 60-0003-047 AND DCN ISID2-017B-22 PER DDR 00-1766	"INITIALS ON FILE"				
6	01/30/95	INC. DCN ISID2-017B-12 & 15 PER FPR 93-1228-901 & ISID2-017B-16 PER RFA 94-0108	"INITIALS ON FILE"				
5	6/27/94	INC. DCN ISID2-017B-13 & 14 FOR FPR 93-1228-901	"INITIALS ON FILE"				
4	02/16/94	INC. DCN'S: ISID2-017B-10 FOR RFA 93-0472 AND ISID2-017B-11 FOR RFA 93-0452	"INITIALS ON FILE"				
3	01/15/93	INC. DCN'S ISID2-017B-3 THRU 6 FOR MOD 92-0013 SUPP. 0	"INITIALS ON FILE"				
2	10/9/92	INC. DCN ISID2-017B-2 FOR DCR 90-0008	"INITIALS ON FILE"				
8	3/2/01	INC. DCN ISID2-017B-23 PER ERR 60-0003-116 & DCN ISID2-017B-24 PER ERR 60-0003-115	SBW	JOR			—
0	9/17/90	ISSUED FOR SECOND 10 YEAR ISI PROGRAM	DJR	TRN RJC	TWB	MGP	ECC

SCALE N.T.S. DESIGNED DRAWN CB DATE

DAVIS-BESSE NUCLEAR POWER STATION
UNIT NO. 1
THE TOLEDO EDISON COMPANY

Q

INSERVICE INSPECTION DIAGRAM
DIESEL GENERATORS AIR START

DRAWING NO. ISID2-017B REV. 8

D-11

DB 02-08-01 DFN=I:/ISID /2SID017B.DGN

LEVELS 1234567890123456789012345678901234567890123456789012345678901 2

14 34X44 "E" SIZE PSC=

I CERTIFY THAT THE IMAGE CONTAINED ON THIS FRAME WAS MADE IN THE NORMAL AND REGULAR COURSE OF BUSINESS ON THE DATE STATED BELOW AND THAT IT IS AN ACCURATE REPRODUCTION OF THE RECORD(S) SUBMITTED TO NUCLEAR RECORDS MANAGEMENT- DAVIS-BESSE N.P.S.
DATE 3.8.01 OPERATOR: Doth, Wilk

30X