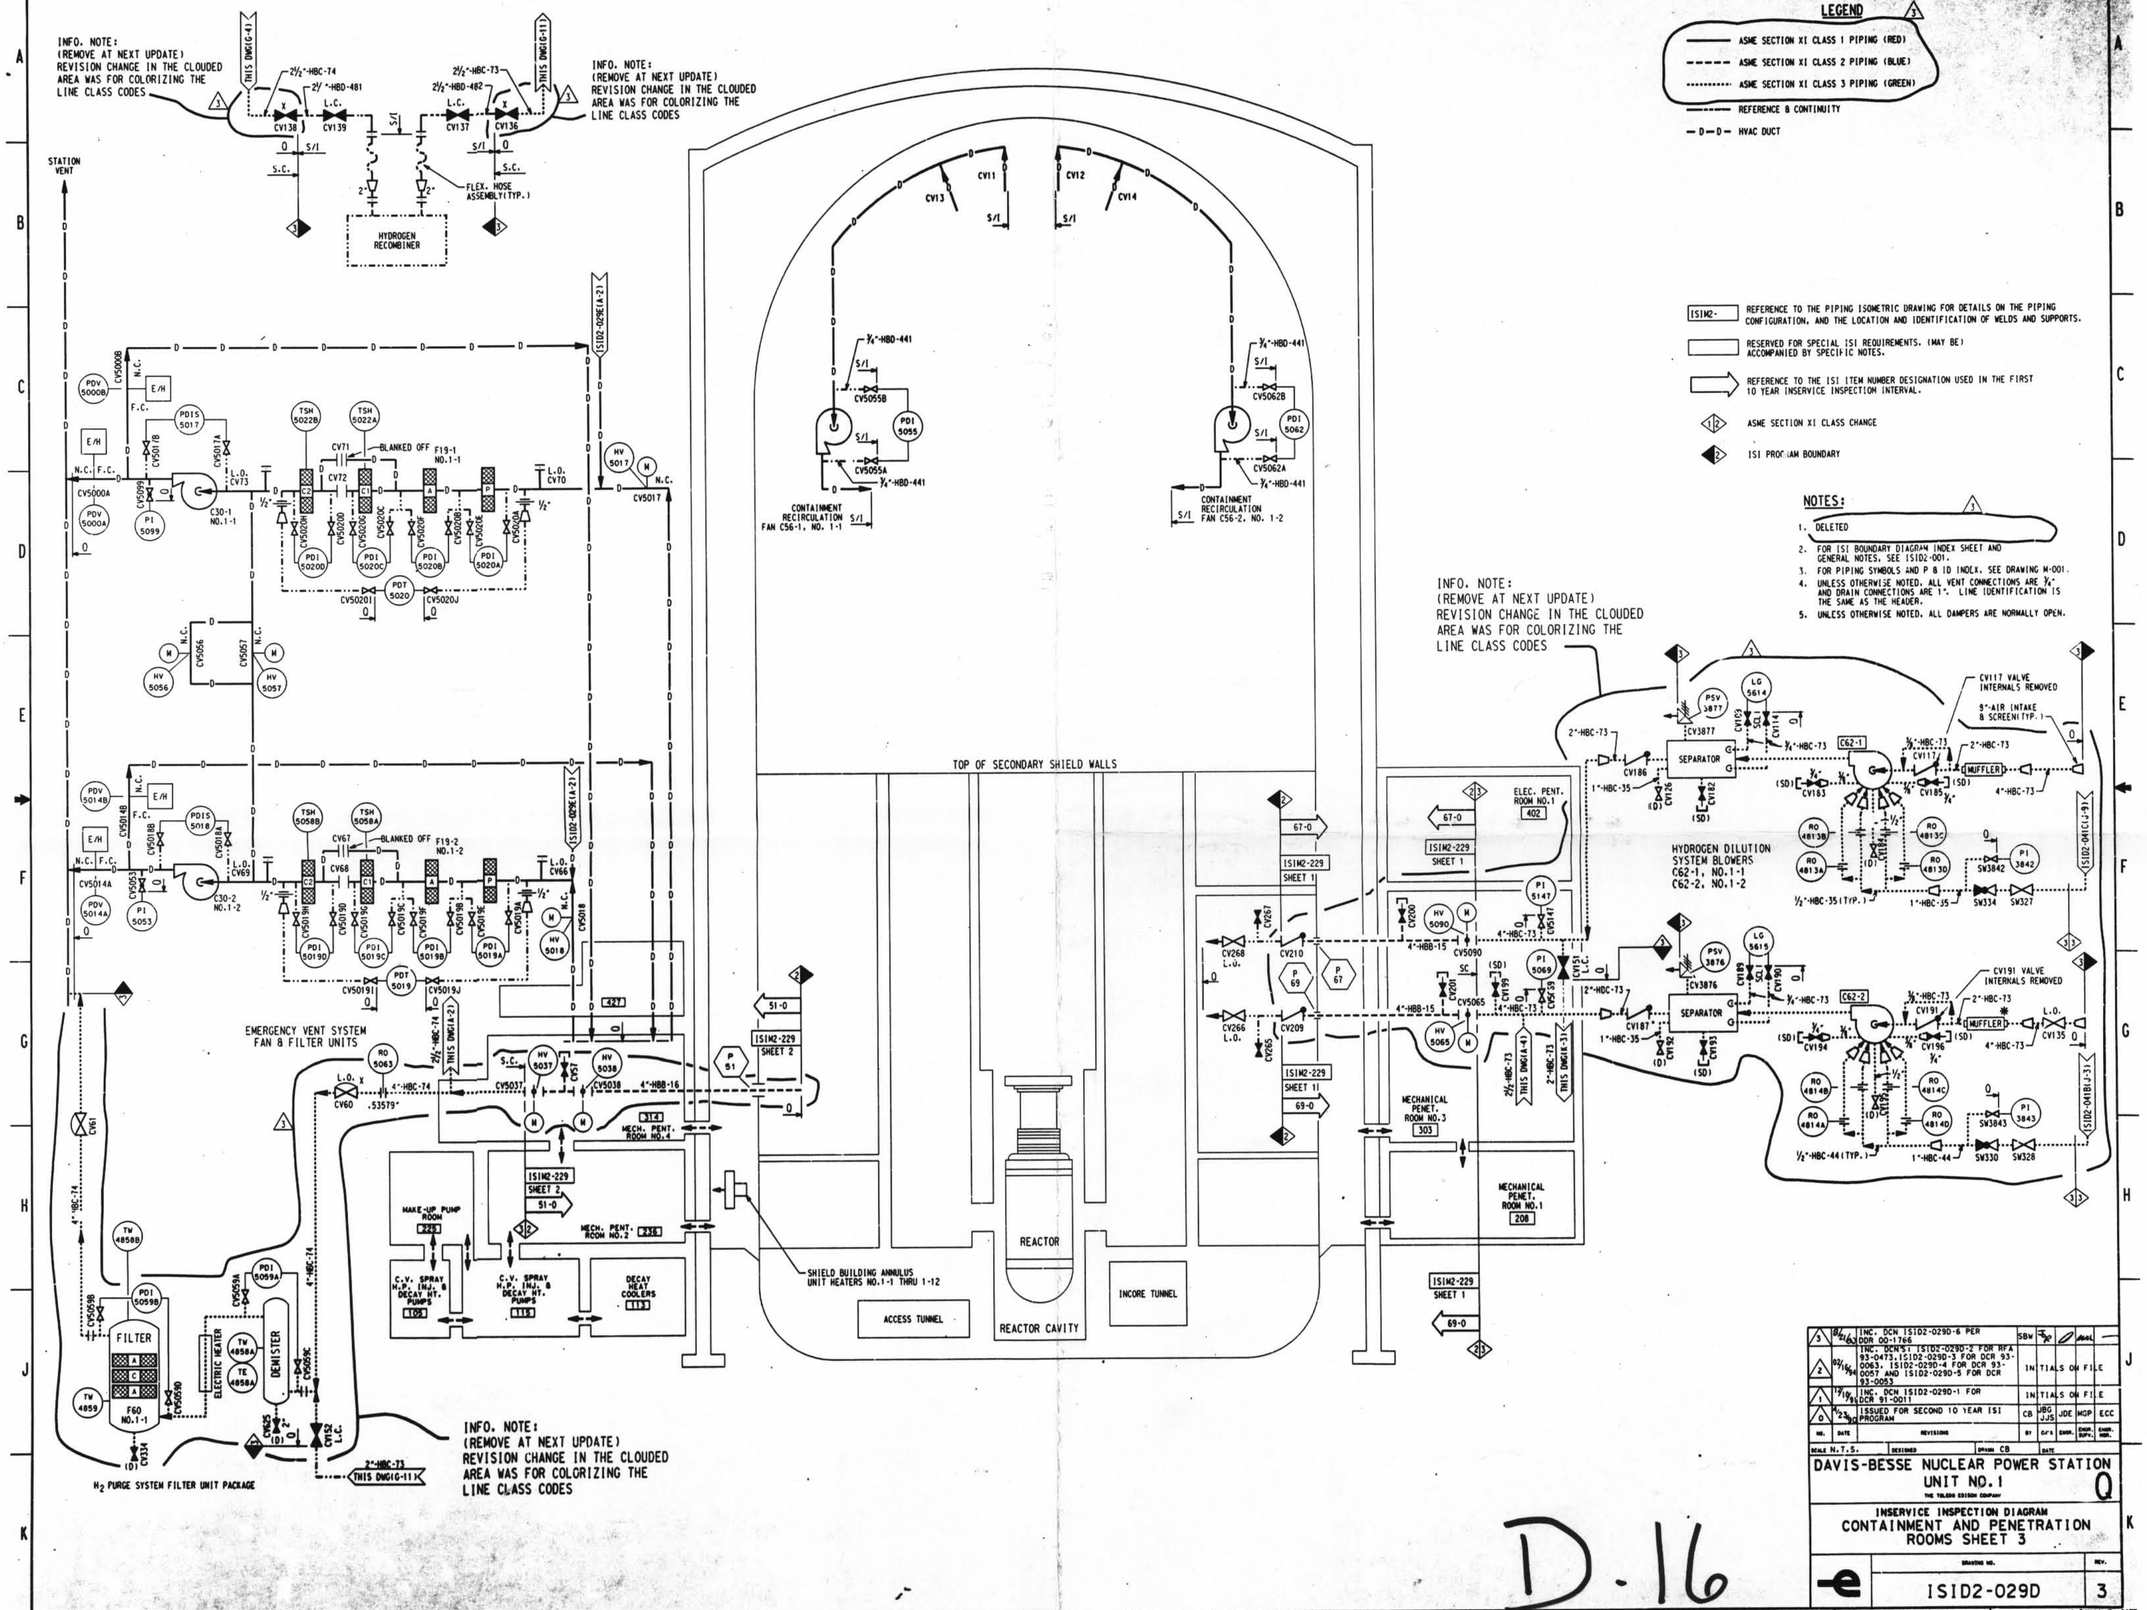


| NO. | DATE | REVISIONS | BY | CK'D | ENGR. | ENGR. SUPV. | ENGR. MGR. |
|---|---|---|---|---|---|---|---|
| 3 | 8/21/93 | INC. DCN ISID2-029D-6 PER DDR 00-1766 | SBW | | | | |
| 2 | 02/16/94 | INC. DCN'S: ISID2-029D-2 FOR RFA 93-0473, ISID2-029D-3 FOR DCR 93-0063, ISID2-029D-4 FOR DCR 93-0057 AND ISID2-029D-5 FOR DCR 93-0053 | IN | TIALS | ON | FILE | |
| 1 | 10/19/95 | INC. DCN ISID2-029D-1 FOR DCR 91-0011 | IN | TIALS | ON | FILE | |
| 0 | 4/23/90 | ISSUED FOR SECOND 10 YEAR ISI PROGRAM | CB | JBG JJS | JDE | MGP | ECC |

SCALE N.T.S. DESIGNED DRAWN CB DATE

DAVIS-BESSE NUCLEAR POWER STATION
UNIT NO.1
THE TOLEDO EDISON COMPANY

Q

INSERVICE INSPECTION DIAGRAM
CONTAINMENT AND PENETRATION ROOMS SHEET 3

DRAWING NO. ISID2-029D REV. 3

D-16

I CERTIFY THAT THE IMAGE CONTAINED ON THIS FRAME WAS MADE IN THE NORMAL AND ORDINARY COURSE OF BUSINESS ON THE DATE SHOWN BELOW AND THAT IT IS AN ACCURATE REPRODUCTION OF THE RECORD SAVE RECORDS MANAGEMENT DAVIS-BESSE NPS

DATE OPERATOR

30X