RC-050115S.10C FORMATS.CEL AC-ESTD

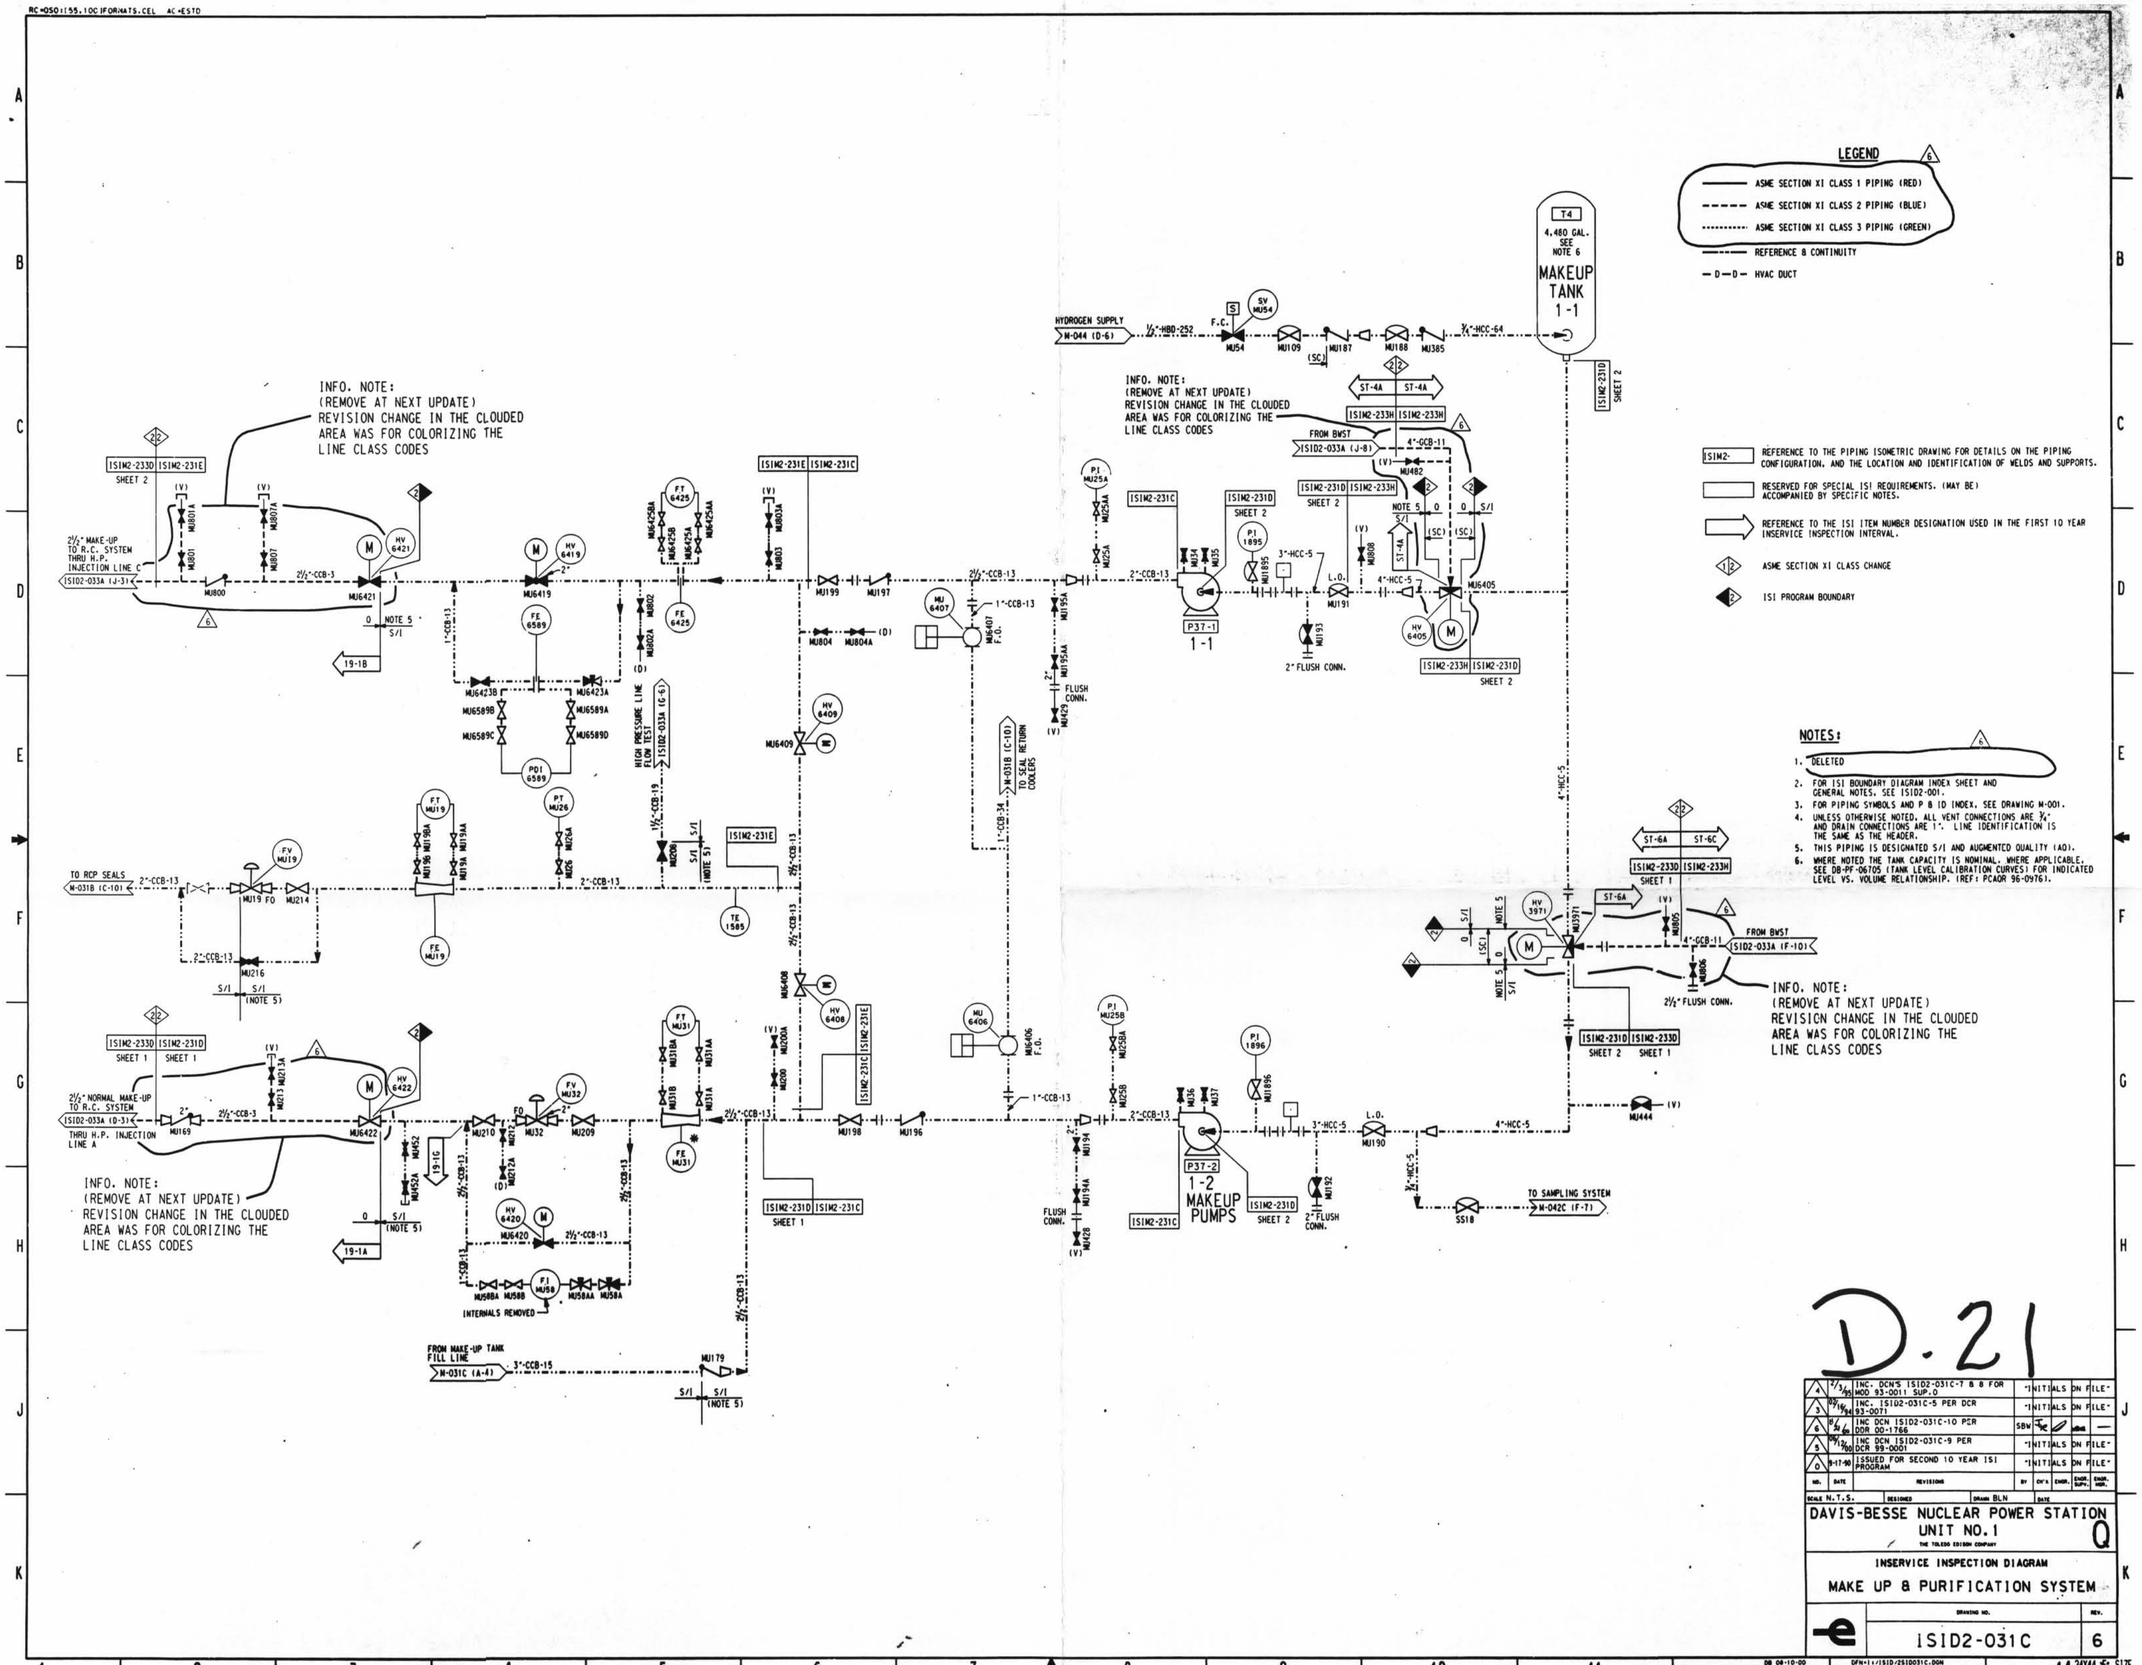

NOTES:

1. DELETED
2. FOR ISI BOUNDARY DIAGRAM INDEX SHEET AND GENERAL NOTES. SEE ISID2-001.
3. FOR PIPING SYMBOLS AND P & ID INDEX. SEE DRAWING M-001.
4. UNLESS OTHERWISE NOTED. ALL VENT CONNECTIONS ARE ¾" AND DRAIN CONNECTIONS ARE 1". LINE IDENTIFICATION IS THE SAME AS THE HEADER.
5. THIS PIPING IS DESIGNATED S/I AND AUGMENTED QUALITY (AQ).
6. WHERE NOTED THE TANK CAPACITY IS NOMINAL. WHERE APPLICABLE, SEE DB-PF-06705 (TANK LEVEL CALIBRATION CURVES) FOR INDICATED LEVEL VS. VOLUME RELATIONSHIP. (REF: PCAQR 96-0976).

D.21

NO.	DATE	REVISIONS	BY	CK'S	ENGR.	ENGR. SUP'V.	ENGR. MGR.
4	7/5/95	INC. DCN'S ISID2-031C-7 & 8 FOR MOD 93-0011 SUP.0	*INITIALS ON FILE*				
3	10/19/94	INC. ISID2-031C-5 PER DCR 93-0071	*INITIALS ON FILE*				
6	8/24/00	INC DCN ISID2-031C-10 PER DCR 00-1766	SBW				
5	09/7/99	INC DCN ISID2-031C-9 PER DCR 99-0001	*INITIALS ON FILE*				
0	9-17-90	ISSUED FOR SECOND 10 YEAR ISI PROGRAM	*INITIALS ON FILE*				

SCALE N.T.S. | DESIGNED | DRAWN BLN | DATE

DAVIS-BESSE NUCLEAR POWER STATION
UNIT NO. 1
THE TOLEDO EDISON COMPANY

INSERVICE INSPECTION DIAGRAM
MAKE UP & PURIFICATION SYSTEM

DRAWING NO. ISID2-031C REV. 6

DB 08-10-00 | DFN=1+/ISID/2SID031C.DGN | LEVELS 1234567890 | 14 | 34X44 E SIZE | PSC- 011

I CERTIFY THAT THE IMAGE CONTAINED ON THIS FRAME WAS MADE IN THE NORMAL OPERATION OF BUSINESS BY THE TOLEDO EDISON COMPANY AND THAT THE IMAGE IS A REPRODUCTION OF THE RECORD OF THE ORIGINAL DOCUMENT. DAVIS-BESSE NPS RECORDS MANAGEMENT
DATE 3/3/98 OPERATOR

30X