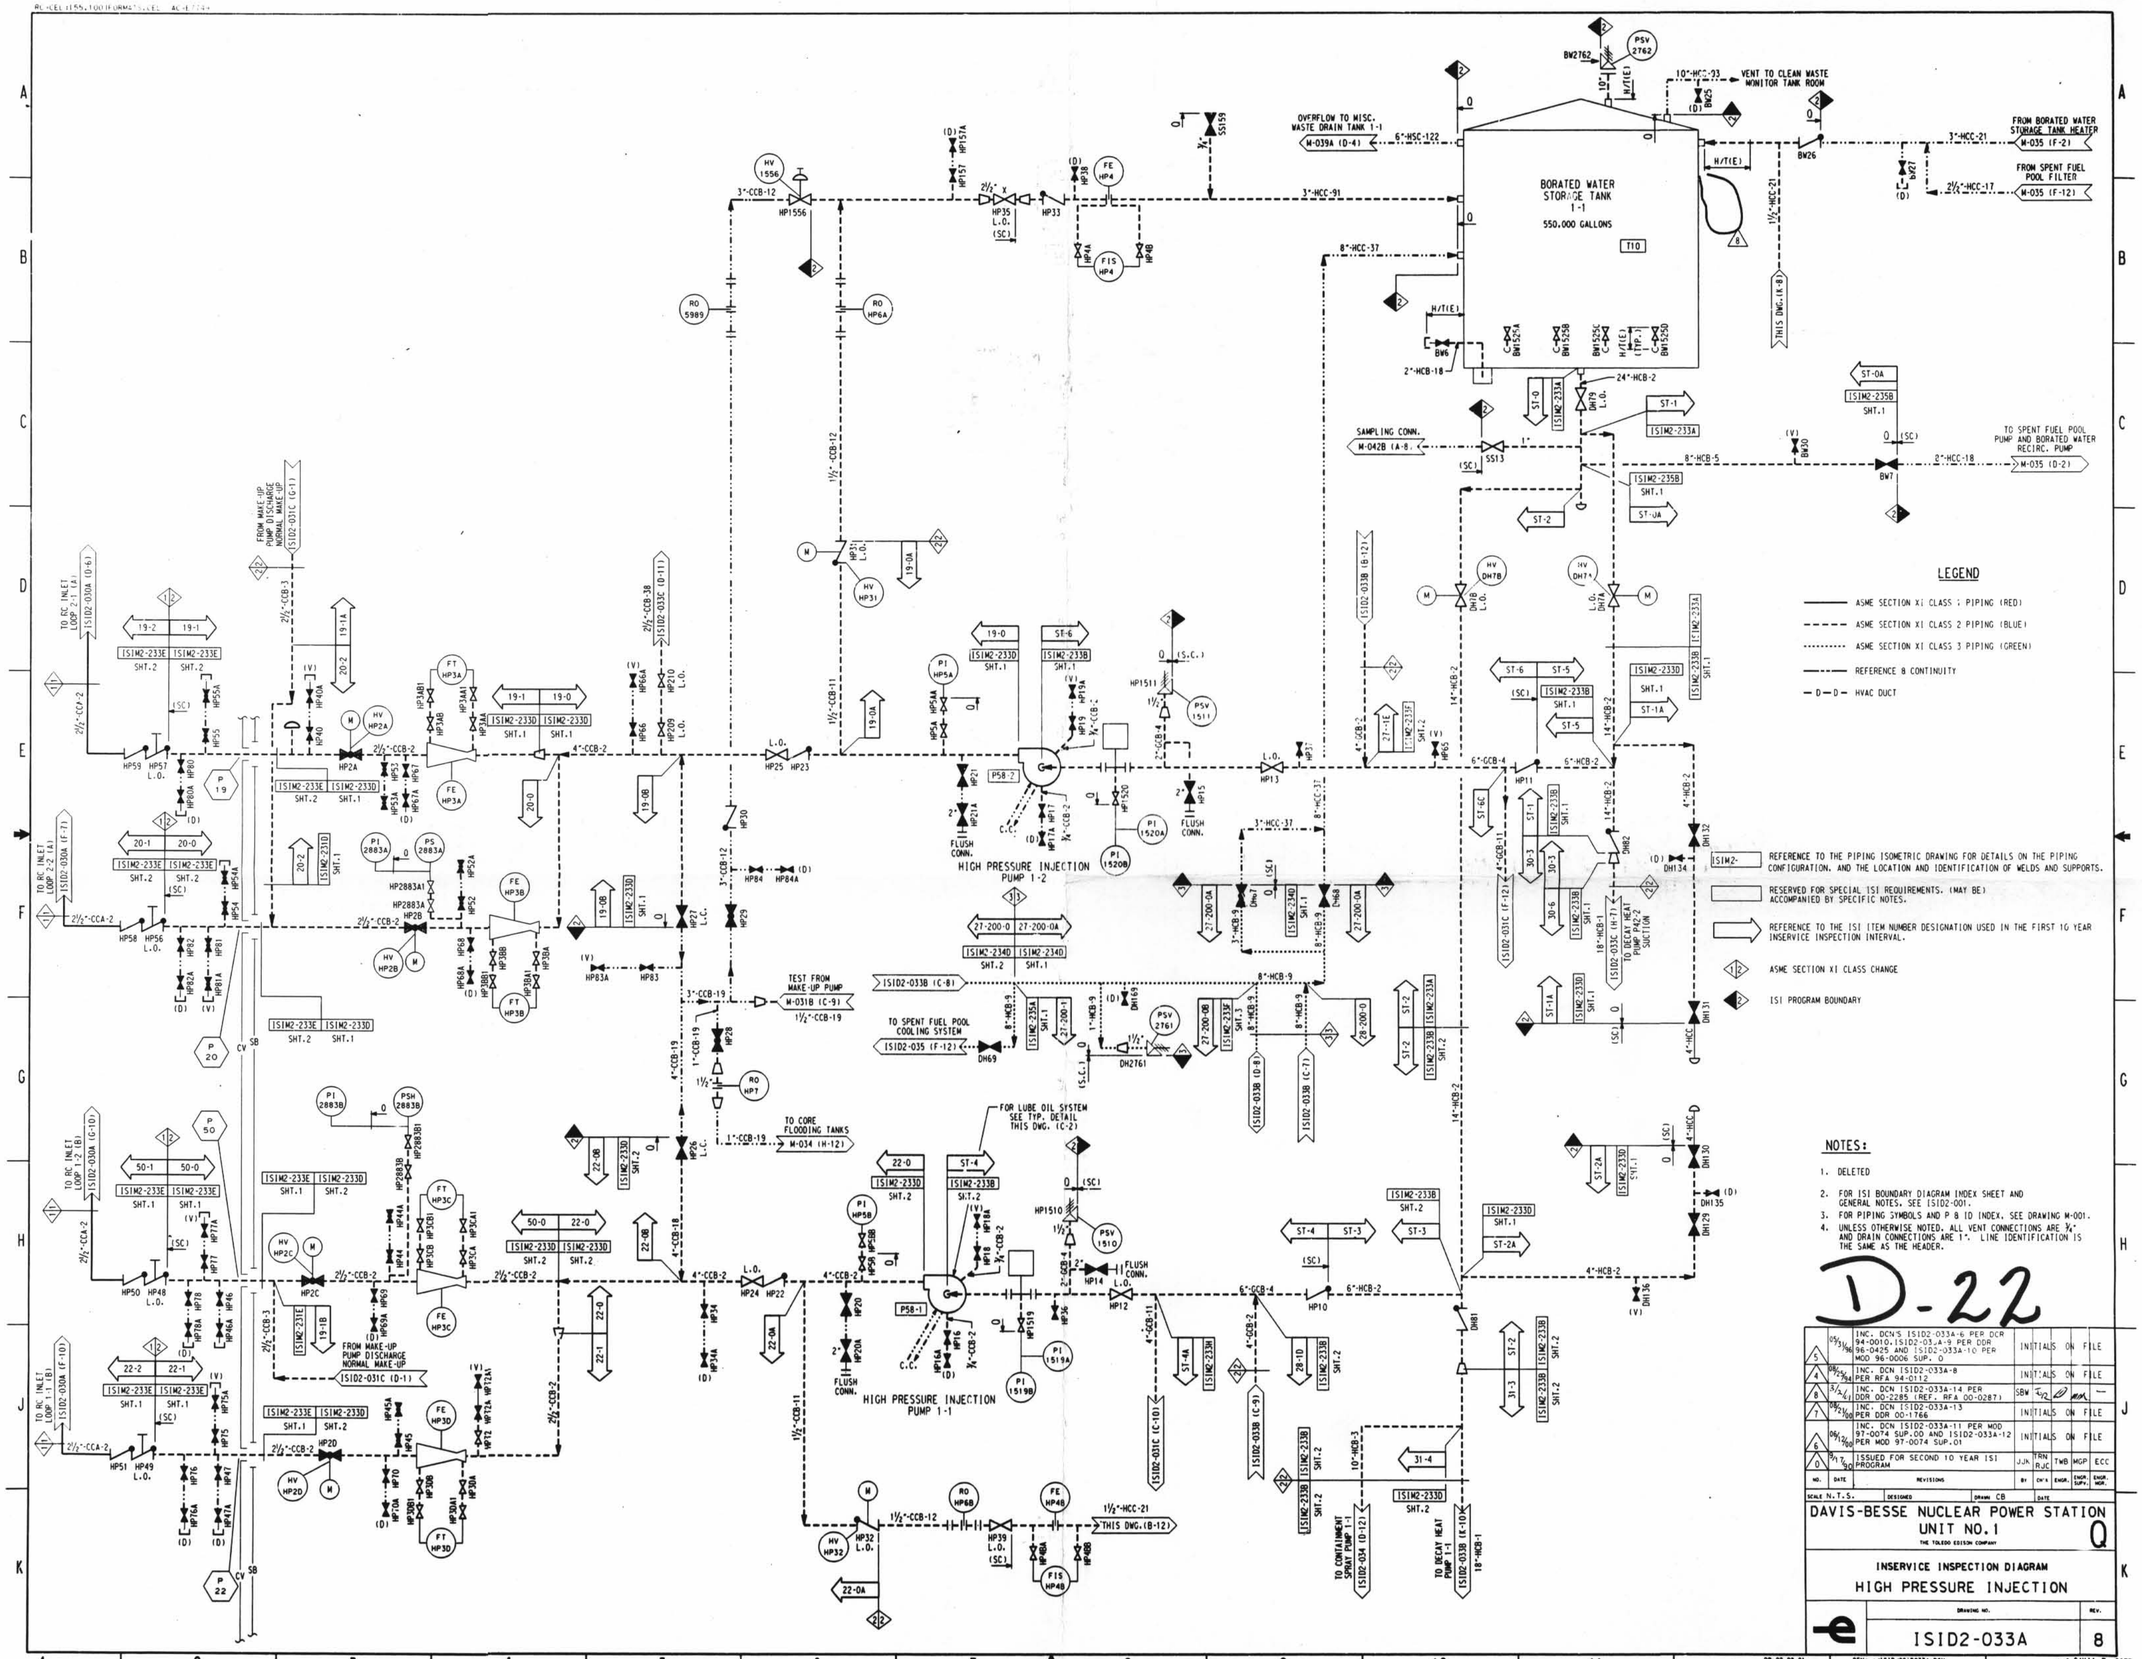

NOTES:

1. DELETED
2. FOR ISI BOUNDARY DIAGRAM INDEX SHEET AND GENERAL NOTES, SEE ISID2-001.
3. FOR PIPING SYMBOLS AND P & ID INDEX, SEE DRAWING M-001.
4. UNLESS OTHERWISE NOTED, ALL VENT CONNECTIONS ARE ¾" AND DRAIN CONNECTIONS ARE 1". LINE IDENTIFICATION IS THE SAME AS THE HEADER.

D-22

NO.	DATE	REVISIONS	BY	CK'D	ENGR.	ENGR. SUPV.	ENGR. MGR.
5	05/31/96	INC. DCN'S ISID2-033A-6 PER DCR 94-0010, ISID2-033A-9 PER DDR 96-0425 AND ISID2-033A-10 PER MOD 96-0006 SUP. 0	INITIALS ON FILE				
4	08/25/94	INC. DCN ISID2-033A-8 PER RFA 94-0112	INITIALS ON FILE				
8	3/2/61	INC. DCN ISID2-033A-14 PER DDR 00-2285 (REF. RFA 00-0287)	SBW				
7	08/21/90	INC. DCN ISID2-033A-13 PER DDR 00-1766	INITIALS ON FILE				
6	06/12/90	INC. DCN ISID2-033A-11 PER MOD 97-0074 SUP.00 AND ISID2-033A-12 PER MOD 97-0074 SUP.01	INITIALS ON FILE				
0	9/17/90	ISSUED FOR SECOND 10 YEAR ISI PROGRAM	JJK	TRN RJC	TWB	MGP	ECC

SCALE N.T.S. DESIGNED DRAWN CB DATE

DAVIS-BESSE NUCLEAR POWER STATION
UNIT NO. 1
THE TOLEDO EDISON COMPANY

Q

INSERVICE INSPECTION DIAGRAM
HIGH PRESSURE INJECTION

DRAWING NO. ISID2-033A REV. 8

DB 02-08-01 DFN= I/ISID/2SID033A.DGN

LEVELS 1234567890123456789012345678901234567890123456789012345678901234567890123456789012

14 34X44 E SIZE

PSC= 11

I CERTIFY THAT THE IMAGE CONTAINED ON THIS FRAME WAS MADE IN THE NORMAL AND REGULAR COURSE OF BUSINESS, ON THE DATE STATED BELOW AND THAT IT IS AN ACCURATE REPRODUCTION OF THE RECORD(S) SUBMITTED TO THE CORPORATE RECORDS MANAGEMENT, DAVIS-BESSE N.P.S.

DATE 3-8-01 OPERATOR: Darth, Wells

30X