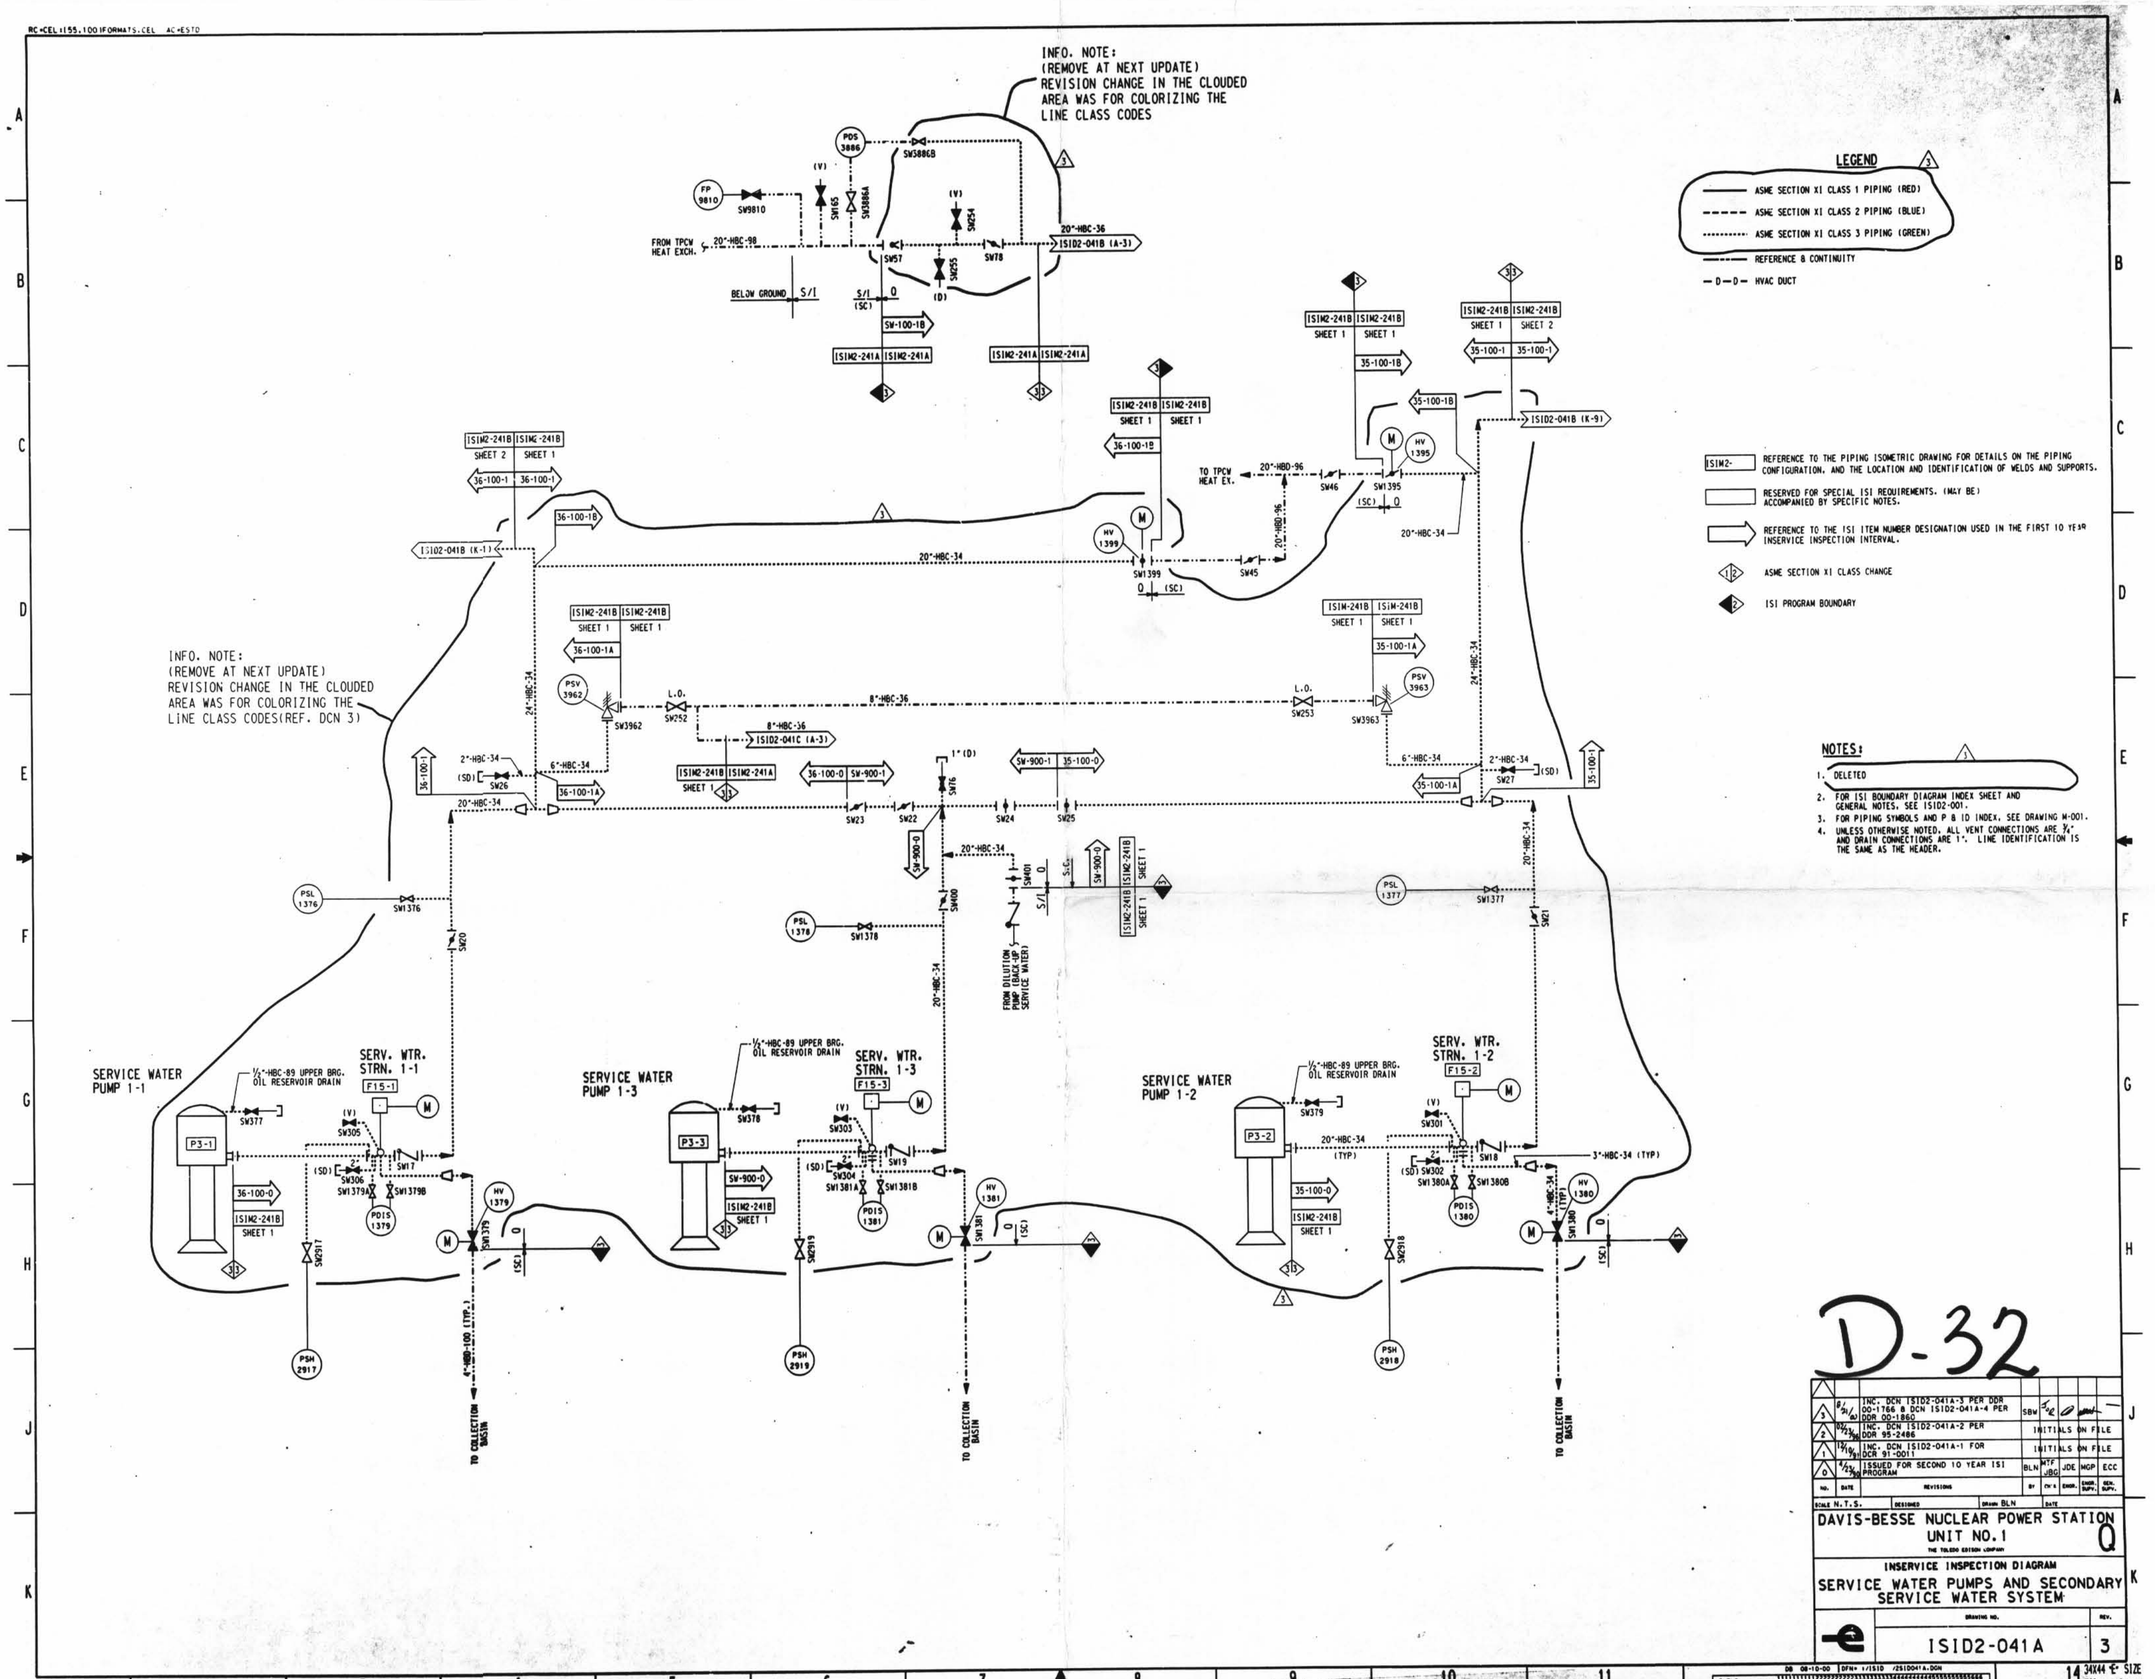

LEGEND

- ASME SECTION XI CLASS 1 PIPING (RED)
- ASME SECTION XI CLASS 2 PIPING (BLUE)
- ASME SECTION XI CLASS 3 PIPING (GREEN)
- REFERENCE & CONTINUITY
- —D—D— HVAC DUCT

ISIM2- REFERENCE TO THE PIPING ISOMETRIC DRAWING FOR DETAILS ON THE PIPING CONFIGURATION, AND THE LOCATION AND IDENTIFICATION OF WELDS AND SUPPORTS.

RESERVED FOR SPECIAL ISI REQUIREMENTS. (MAY BE) ACCOMPANIED BY SPECIFIC NOTES.

REFERENCE TO THE ISI ITEM NUMBER DESIGNATION USED IN THE FIRST 10 YEAR INSERVICE INSPECTION INTERVAL.

ASME SECTION XI CLASS CHANGE

ISI PROGRAM BOUNDARY

NOTES:

1. DELETED
2. FOR ISI BOUNDARY DIAGRAM INDEX SHEET AND GENERAL NOTES, SEE ISID2-001.
3. FOR PIPING SYMBOLS AND P & ID INDEX, SEE DRAWING M-001.
4. UNLESS OTHERWISE NOTED, ALL VENT CONNECTIONS ARE 3/4" AND DRAIN CONNECTIONS ARE 1". LINE IDENTIFICATION IS THE SAME AS THE HEADER.

D-32

NO.	DATE	REVISIONS	BY	CK'D	ENGR.	ENGR. SUPV.	GEN. SUPV.
3	8/31/90	INC. DCN ISID2-041A-3 PER DDR 00-1766 & DCN ISID2-041A-4 PER DDR 00-1860	SBW				
2	02/23/90	INC. DCN ISID2-041A-2 PER DDR 95-2486	INITIALS ON FILE				
1	12/19/91	INC. DCN ISID2-041A-1 FOR DCR 91-0011	INITIALS ON FILE				
0	4/23/90	ISSUED FOR SECOND 10 YEAR ISI PROGRAM	BLN	MTF JBG	JDE	MGP	ECC

SCALE N.T.S. DESIGNED DRAWN BLN DATE

DAVIS-BESSE NUCLEAR POWER STATION
UNIT NO. 1
THE TOLEDO EDISON COMPANY

INSERVICE INSPECTION DIAGRAM
SERVICE WATER PUMPS AND SECONDARY SERVICE WATER SYSTEM

DRAWING NO. ISID2-041A REV. 3

DB 08-10-00 DFN= 1/ISID /2SID041A.DGN

14 34X44 E SIZE

I CERTIFY THAT THE IMAGE CONTAINED ON THIS FRAME WAS MADE IN THE NORMAL AND REGULAR COURSE OF BUSINESS, ON THE DATE STATED BELOW AND THAT THE IMAGE IS AN ACCURATE REPRODUCTION OF THE RECORDS PLANNED AND PROVIDED BY THE DAVIS-BESSE NUCLEAR RECORDS MANAGEMENT. DAVIS-BESSE NUCLEAR

30X