RC-CEL:1155.100|FORMATS.CEL AC-E37D

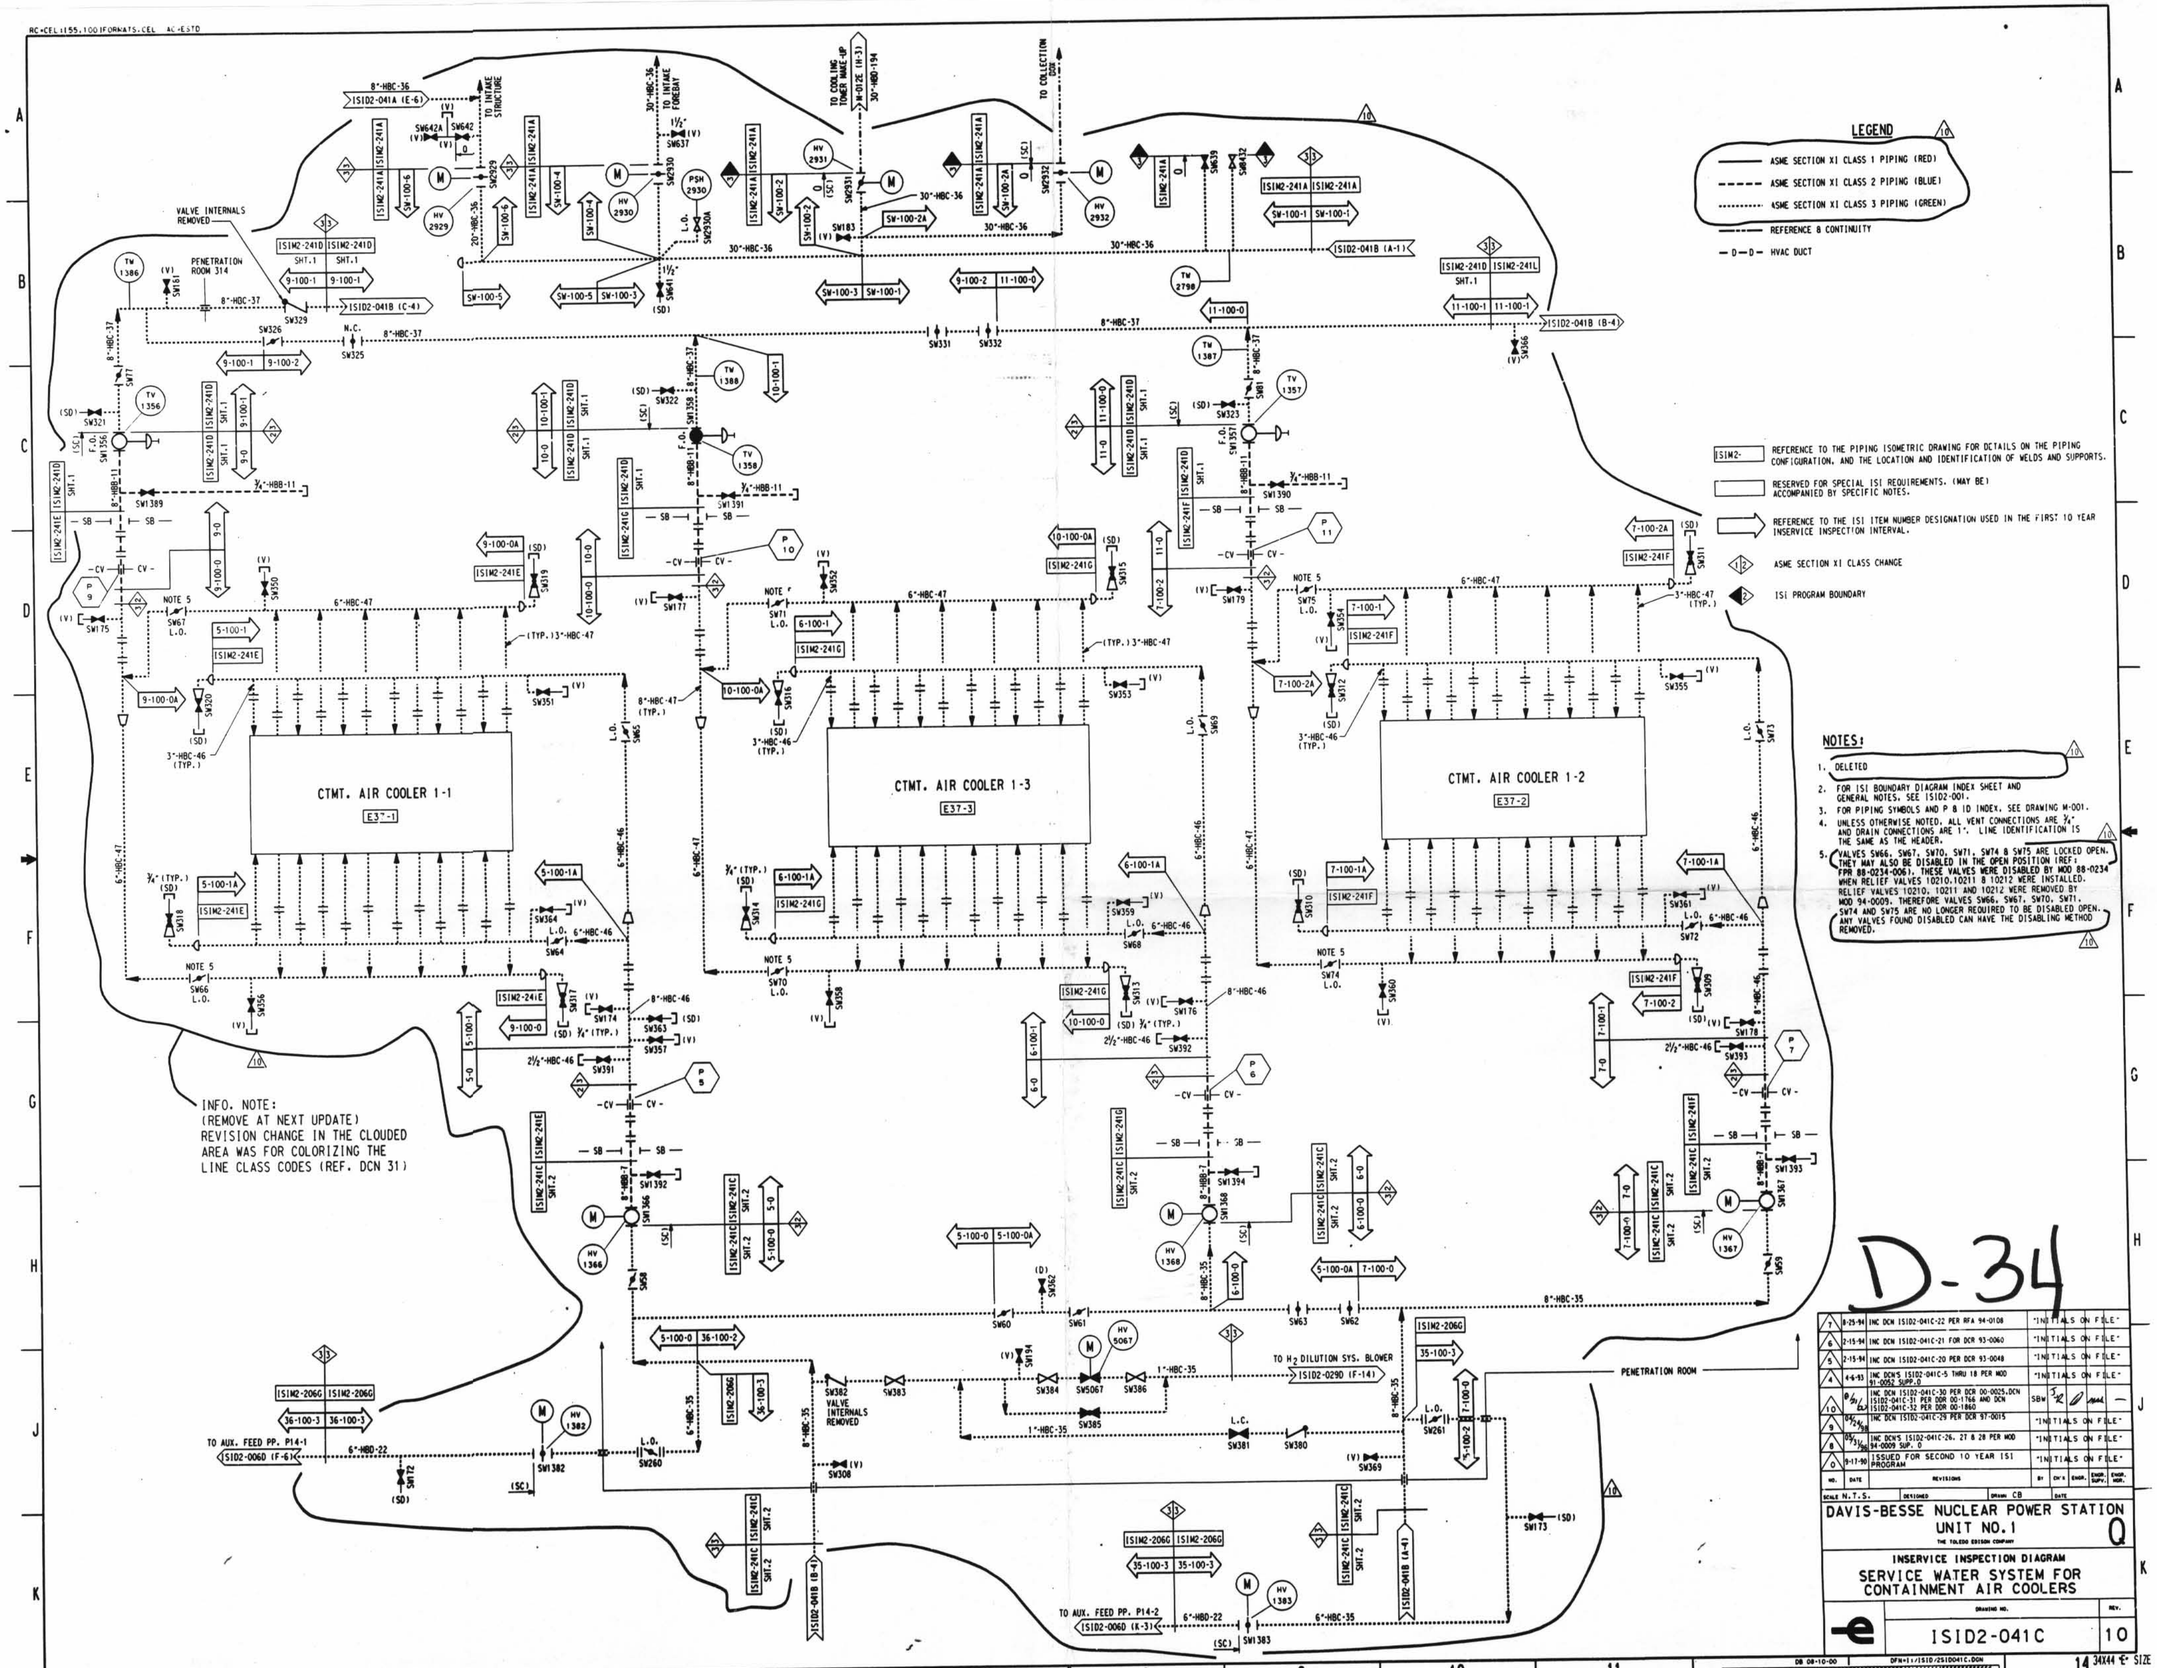


## LEGEND

- ASME SECTION XI CLASS 1 PIPING (RED)
- ASME SECTION XI CLASS 2 PIPING (BLUE)
- ASME SECTION XI CLASS 3 PIPING (GREEN)
- REFERENCE B CONTINUITY
- D — HVAC DUCT

ISIM2- REFERENCE TO THE PIPING ISOMETRIC DRAWING FOR DETAILS ON THE PIPING CONFIGURATION, AND THE LOCATION AND IDENTIFICATION OF WELDS AND SUPPORTS.

RESERVED FOR SPECIAL ISI REQUIREMENTS. (MAY BE) ACCOMPANIED BY SPECIFIC NOTES.

REFERENCE TO THE ISI ITEM NUMBER DESIGNATION USED IN THE FIRST 10 YEAR INSERVICE INSPECTION INTERVAL.

ASME SECTION XI CLASS CHANGE

ISI PROGRAM BOUNDARY

## NOTES:

1. DELETED
2. FOR ISI BOUNDARY DIAGRAM INDEX SHEET AND GENERAL NOTES, SEE ISID2-001.
3. FOR PIPING SYMBOLS AND P & ID INDEX, SEE DRAWING M-001.
4. UNLESS OTHERWISE NOTED, ALL VENT CONNECTIONS ARE ¾", AND DRAIN CONNECTIONS ARE 1". LINE IDENTIFICATION IS THE SAME AS THE HEADER.
5. VALVES SW66, SW67, SW70, SW71, SW74 & SW75 ARE LOCKED OPEN. THEY MAY ALSO BE DISABLED IN THE OPEN POSITION (REF: FPR 88-0234-006). THESE VALVES WERE DISABLED BY MOD 88-0234 WHEN RELIEF VALVES 10210, 10211 & 10212 WERE INSTALLED. RELIEF VALVES 10210, 10211 AND 10212 WERE REMOVED BY MOD 94-0009. THEREFORE VALVES SW66, SW67, SW70, SW71, SW74 AND SW75 ARE NO LONGER REQUIRED TO BE DISABLED OPEN. ANY VALVES FOUND DISABLED CAN HAVE THE DISABLING METHOD REMOVED.

D-34

| NO. | DATE | REVISIONS | BY | CH'K | ENGR. SUPV. | ENGR. MGR. |
|---|---|---|---|---|---|---|
| 7 | 8-25-94 | INC DCN ISID2-041C-22 PER RFA 94-0108 | "INITIALS ON FILE" | | | |
| 6 | 2-15-94 | INC DCN ISID2-041C-21 FOR DCR 93-0060 | "INITIALS ON FILE" | | | |
| 5 | 2-15-94 | INC DCN ISID2-041C-20 PER DCR 93-0048 | "INITIALS ON FILE" | | | |
| 4 | 4-6-93 | INC DCN'S ISID2-041C-5 THRU 18 PER MOD 91-0052 SUPP.0 | "INITIALS ON FILE" | | | |
| 10 | 6/21 | INC DCN ISID2-041C-30 PER DCR 00-0025,DCN ISID2-041C-31 PER DDR 00-1766 AND DCN ISID2-041C-32 PER DDR 00-1860 | SBW | | | |
| 9 | 05/25/98 | INC DCN ISID2-041C-29 PER DCR 97-0015 | "INITIALS ON FILE" | | | |
| 8 | 03/31/94 | INC DCN'S ISID2-041C-26, 27 & 28 PER MOD 94-0009 SUP. 0 | "INITIALS ON FILE" | | | |
| 0 | 9-17-90 | ISSUED FOR SECOND 10 YEAR ISI PROGRAM | "INITIALS ON FILE" | | | |

SCALE N.T.S. | DESIGNED | DRAWN CB | DATE

DAVIS-BESSE NUCLEAR POWER STATION
UNIT NO. 1
THE TOLEDO EDISON COMPANY

Q

INSERVICE INSPECTION DIAGRAM
SERVICE WATER SYSTEM FOR CONTAINMENT AIR COOLERS

DRAWING NO. ISID2-041C | REV. 10

DB 08-10-00 | DFN=1:/ISID/2SID041C.DGN | LEVELS 1234567891011121314151617181920212223242526272829303132333435363738394041424344454647484950 | 14 34X44 E SIZE

I CERTIFY THAT THE IMAGE CONTAINED ON THIS FILM IS A TRUE AND ACCURATE REPRODUCTION OF THE ORIGINAL RECORD. DATE: ____ SIGNATURE: ____

30X