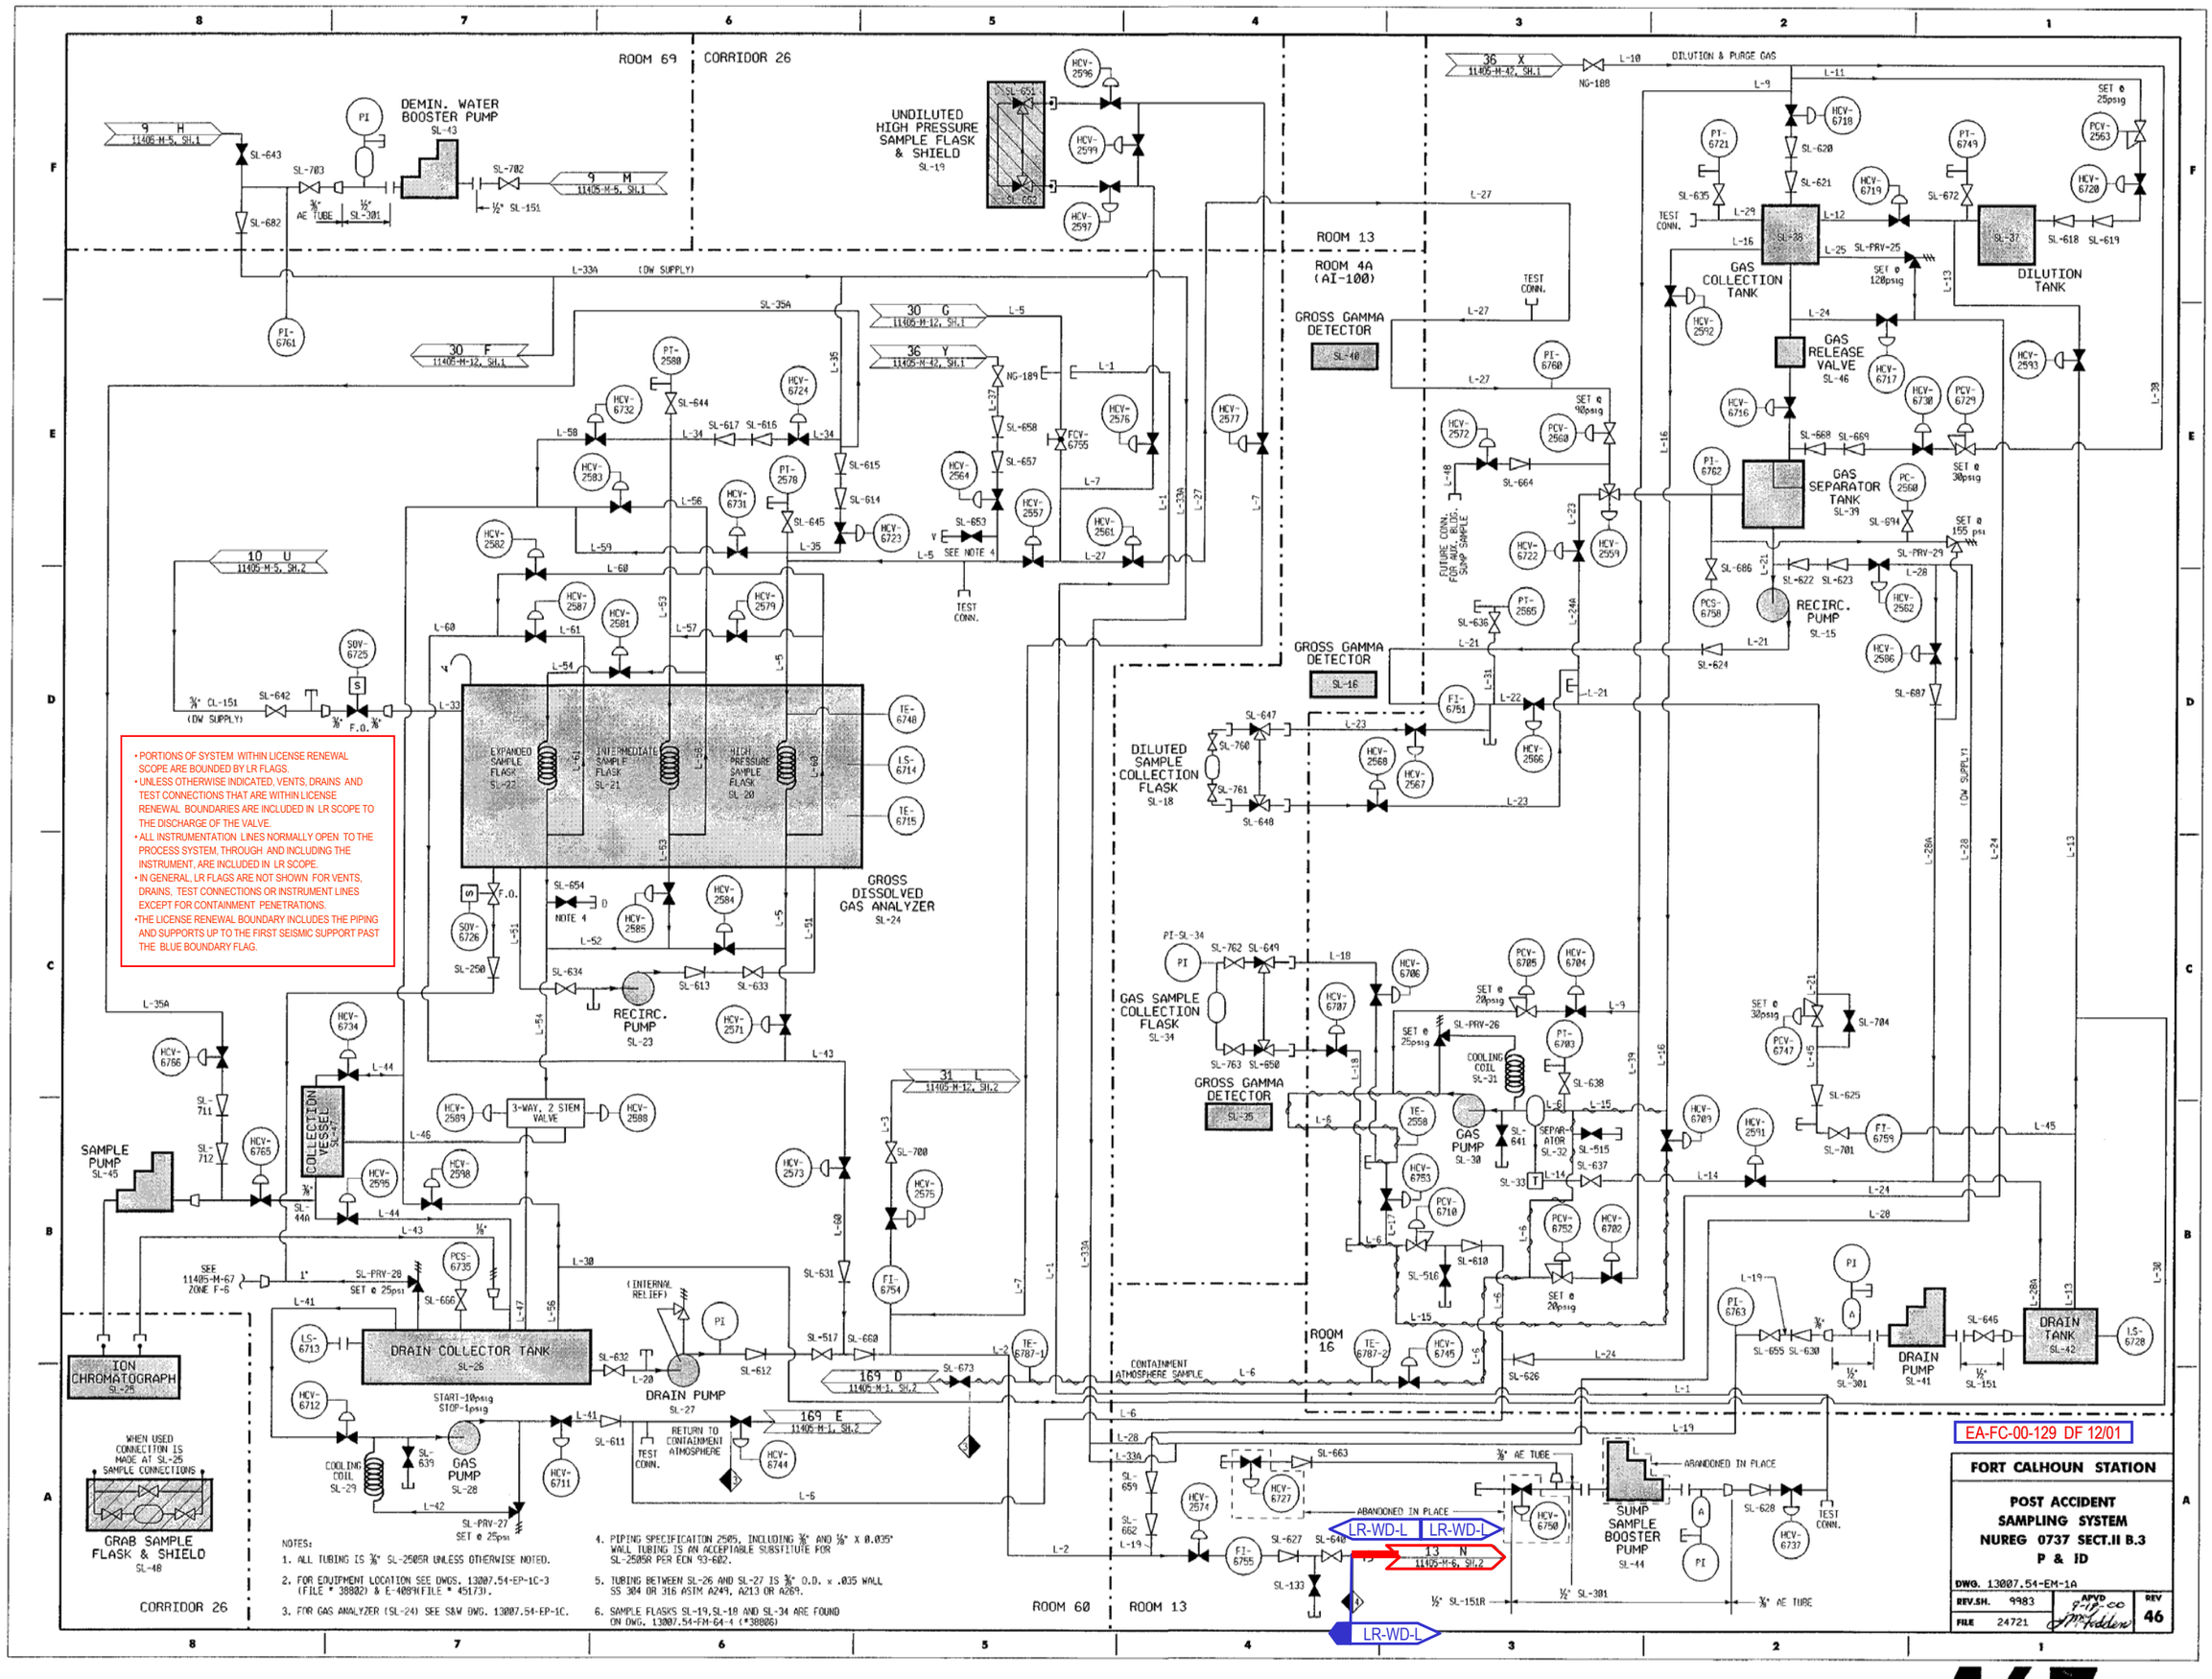

- PORTIONS OF SYSTEM WITHIN LICENSE RENEWAL SCOPE ARE BOUNDED BY LR FLAGS
- UNLESS OTHERWISE INDICATED, VENTS, DRAINS AND TEST CONNECTIONS THAT ARE WITHIN LICENSE RENEWAL BOUNDARIES ARE INCLUDED IN LR SCOPE TO THE DISCHARGE OF THE VALVE.
- ALL INSTRUMENTATION LINES NORMALLY OPEN TO THE PROCESS SYSTEM, THROUGH AND INCLUDING THE INSTRUMENT, ARE INCLUDED IN LR SCOPE.
- IN GENERAL, LR FLAGS ARE NOT SHOWN FOR VENTS, DRAINS, TEST CONNECTIONS OR INSTRUMENT LINES EXCEPT FOR CONTAINMENT PENETRATIONS.
- THE LICENSE RENEWAL BOUNDARY INCLUDES THE PIPING AND SUPPORTS UP TO THE FIRST SEISMIC SUPPORT PAST THE BLUE BOUNDARY FLAG.

NOTES:

1. ALL TUBING IS ⅜" SL-2505R UNLESS OTHERWISE NOTED.
2. FOR EQUIPMENT LOCATION SEE DWGS. 13007.54-EP-1C-3 (FILE # 38802) & E-4089(FILE # 45173).
3. FOR GAS ANALYZER (SL-24) SEE S&W DWG. 13007.54-EP-1C.
4. PIPING SPECIFICATION 2505, INCLUDING ⅜" AND ½" X 0.035" WALL TUBING IS AN ACCEPTABLE SUBSTITUTE FOR SL-2505R PER ECN 93-602.
5. TUBING BETWEEN SL-26 AND SL-27 IS ⅜" O.D. x .035 WALL SS 304 OR 316 ASTM A249, A213 OR A269.
6. SAMPLE FLASKS SL-19, SL-18 AND SL-34 ARE FOUND ON DWG. 13007.54-EM-64-4 (#38806)

FOR INFORMATION ONLY

NOTE: THIS PRINT IS TO BE USED FOR THE FCS LICENSE RENEWAL PROJECT ONLY. IT MAY NOT REFLECT THE MOST CURRENT REVISION OF THIS DRAWING.