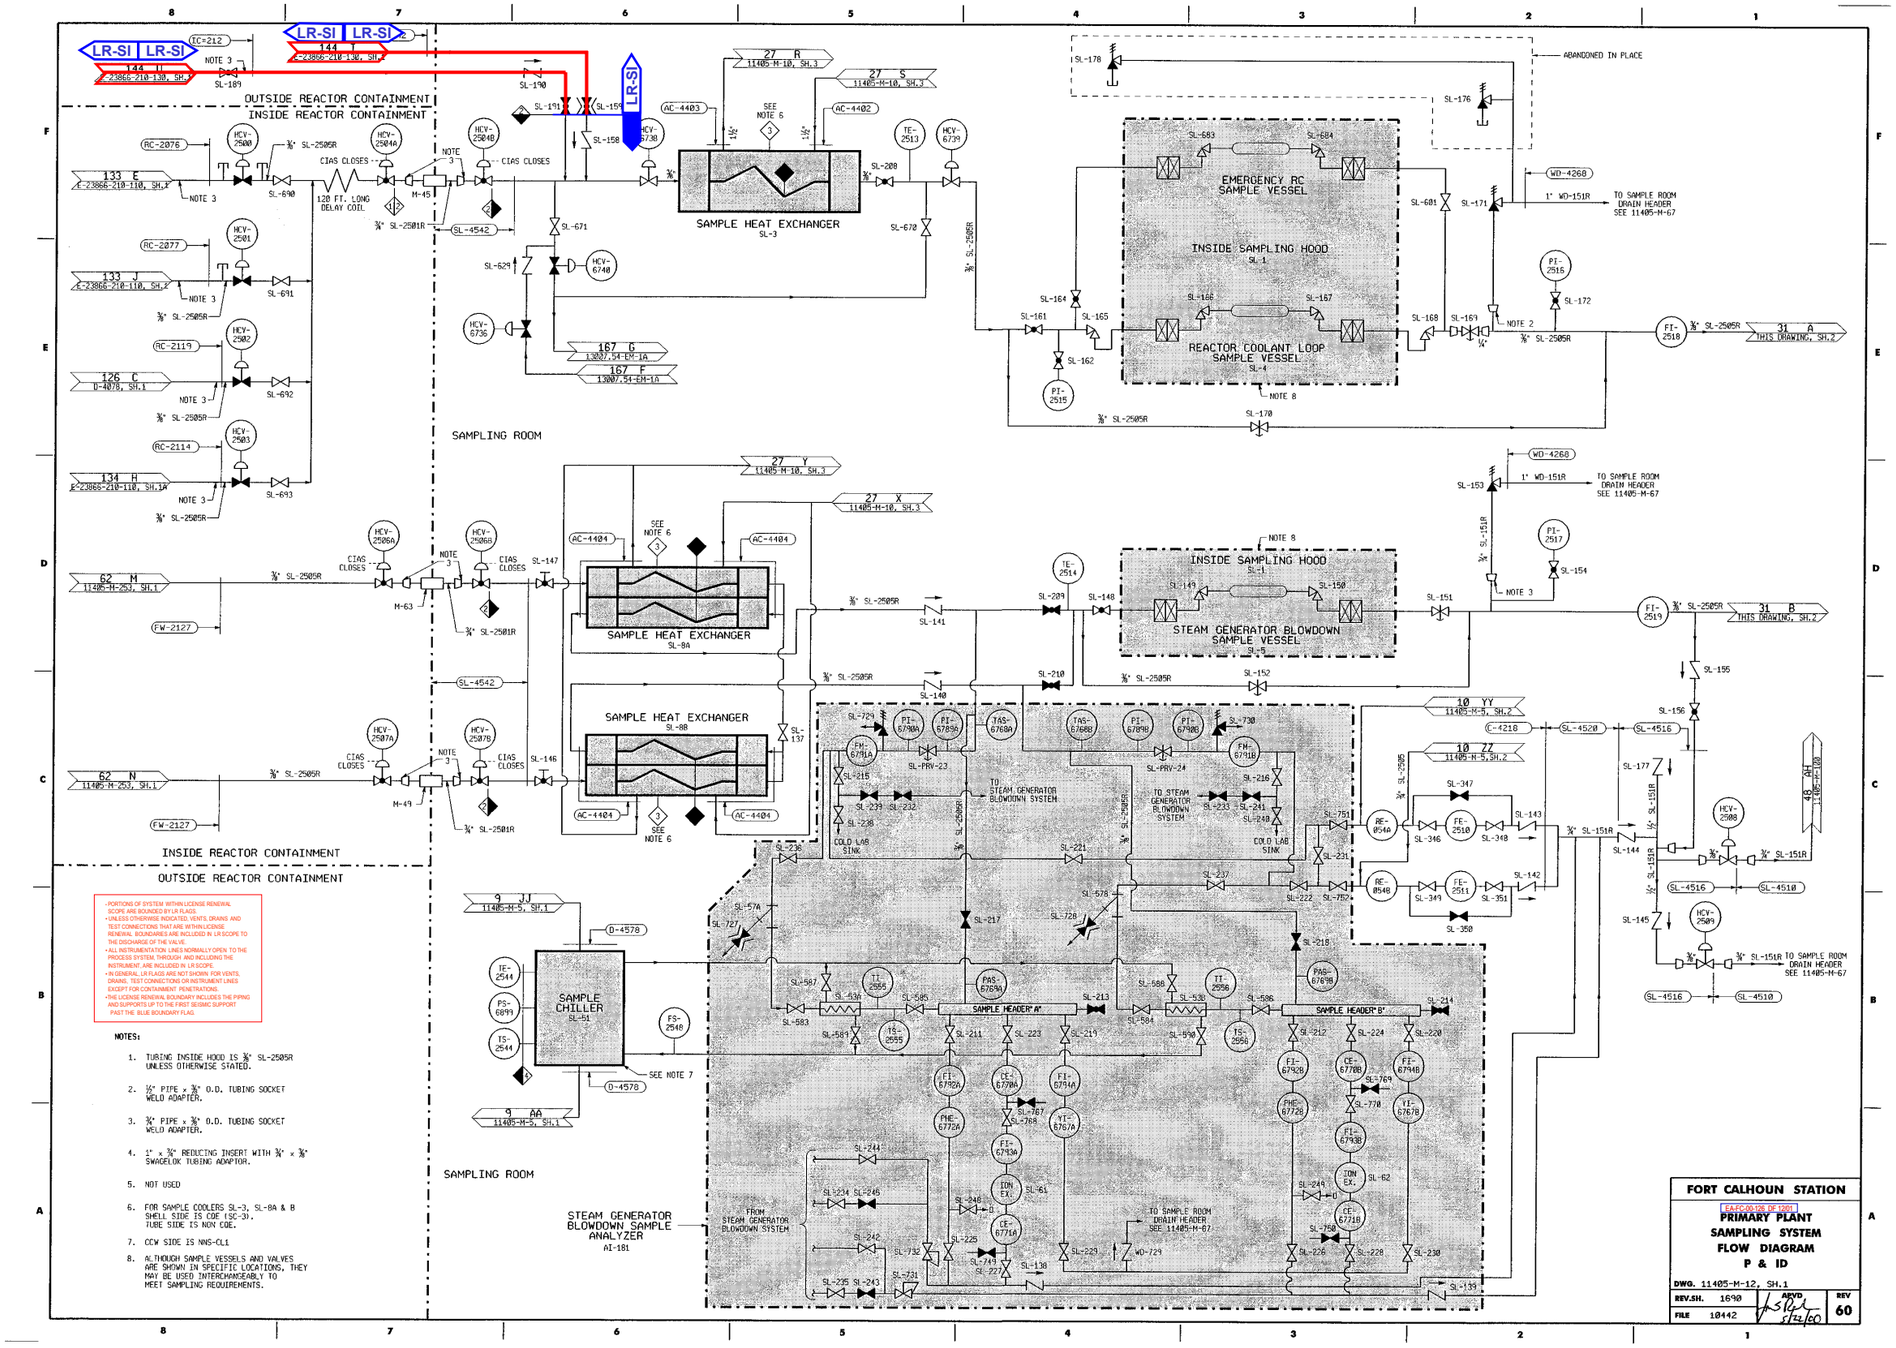

- PORTIONS OF SYSTEM WITHIN LICENSE RENEWAL SCOPE ARE BOUNDED BY LR FLAGS.
- UNLESS OTHERWISE INDICATED, VENTS, DRAINS AND TEST CONNECTIONS THAT ARE WITHIN LICENSE RENEWAL BOUNDARIES ARE INCLUDED IN LR SCOPE TO THE DISCHARGE OF THE VALVE.
- ALL INSTRUMENTATION LINES NORMALLY OPEN TO THE PROCESS SYSTEM, THROUGH AND INCLUDING THE INSTRUMENT, ARE INCLUDED IN LR SCOPE.
- IN GENERAL, LR FLAGS ARE NOT SHOWN FOR VENTS, DRAINS, TEST CONNECTIONS OR INSTRUMENT LINES EXCEPT FOR CONTAINMENT PENETRATIONS.
- THE LICENSE RENEWAL BOUNDARY INCLUDES THE PIPING AND SUPPORTS UP TO THE FIRST SEISMIC SUPPORT PAST THE BLUE BOUNDARY FLAG.

NOTES:

1. TUBING INSIDE HOOD IS ⅜" SL-2505R UNLESS OTHERWISE STATED.
2. ½" PIPE x ⅜" O.D. TUBING SOCKET WELD ADAPTER.
3. ¾" PIPE x ⅜" O.D. TUBING SOCKET WELD ADAPTER.
4. 1" x ¾" REDUCING INSERT WITH ¾" x ⅜" SWAGELOK TUBING ADAPTOR.
5. NOT USED
6. FOR SAMPLE COOLERS SL-3, SL-8A & B SHELL SIDE IS COE (SC-3). TUBE SIDE IS NON COE.
7. CCW SIDE IS NNS-CL1
8. ALTHOUGH SAMPLE VESSELS AND VALVES ARE SHOWN IN SPECIFIC LOCATIONS, THEY MAY BE USED INTERCHANGEABLY TO MEET SAMPLING REQUIREMENTS.

FORT CALHOUN STATION

EA-FC-00-126 DF 1201

PRIMARY PLANT SAMPLING SYSTEM FLOW DIAGRAM P & ID

DWG. 11405-M-12, SH.1

REV.SH. 1690 | ARVD 5/22/00 | REV 60

FILE 10442

FOR INFORMATION ONLY

30

NOTE: THIS PRINT IS TO BE USED FOR THE FCS LICENSE RENEWAL PROJECT ONLY. IT MAY NOT REFLECT THE MOST CURRENT REVISION OF THIS DRAWING.