Table NDE-Partial-2-2North Anna Unit 1Examination Scan Coverage Estimates (Boron Injection Tank)Weld 1

Beam Angle (degrees)	Exam Area	Scan Direction	Scan %		
0	Base and Weld	0	82		
45 and 60	Base 2		96		
45 and 60	Base	5	97		
45	Weld	2	58		
45	Weld	5	76		
45	Weld	7 & 8	77		
60	Weld	2	61		
60	Weld	5	76		
60	Weld	7&8	77		
	+		Avg. 78		

Table NDE-Partial-2-3 North Anna Unit 1 Examination Scan Coverage Estimates (1-CH-279) Weld 11

Scan Direction	Scan %	
2	75	
5 ,	75	
7	100	
8	100	
	Avg. 87	

1

UT Scan Direction Definitions

- 2 Axial scan, 180 degrees from isometric flow direction.
- 5 Axial scan, the same direction as the isometric flow direction.
- 7 Circumferential scan, clockwise rotation when viewing in the direction of isometric flow.
- 8 Circumferential scan, counterclockwise rotation when viewing in the direction of isometric flow.

Table NDE-Partial-2-4 North Anna Unit 1 Examination Scan Coverage Estimates (1-RH-1) Weld 64

Scan Direction	Scan % 45.5	
2		
5	40.5	
7	100	
8	100	
Average	71.5	

UT Scan Direction Definitions

2 - Axial scan, 180 degrees from isometric flow direction.


5 - Axial scan, the same direction as the isometric flow direction.

7 - Circumferential scan, clockwise rotation when viewing in the direction of isometric flow.

8 - Circumferential scan, counterclockwise rotation when viewing in the direction of isometric flow.


Sketch NDE-Partial-2-1 North Anna Unit 1 1-SI-TK-2 Weld 1 .


.

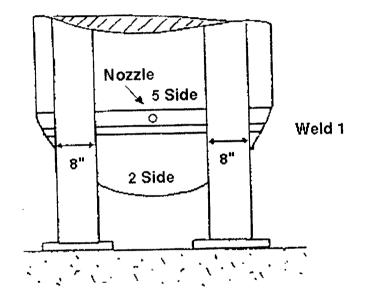


Sketch NDE-Partial-2-2 North Anna Unit 1 14''-RH-2-602-Q2 Weld 72H


•

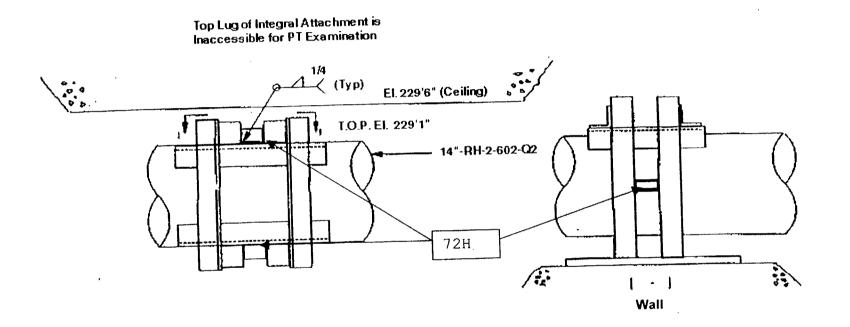





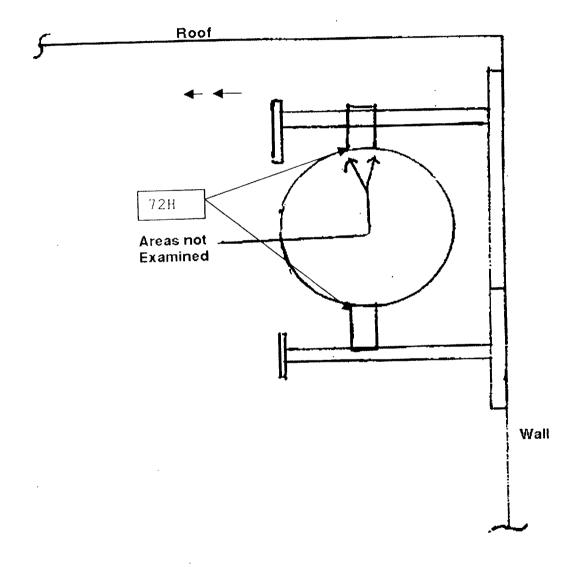


Sketch NDE-Partial-2-4 North Anna Unit 1 1-CH-P-1A WS-03 and WS-04

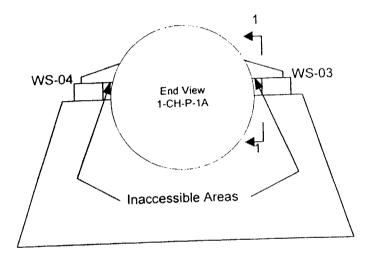



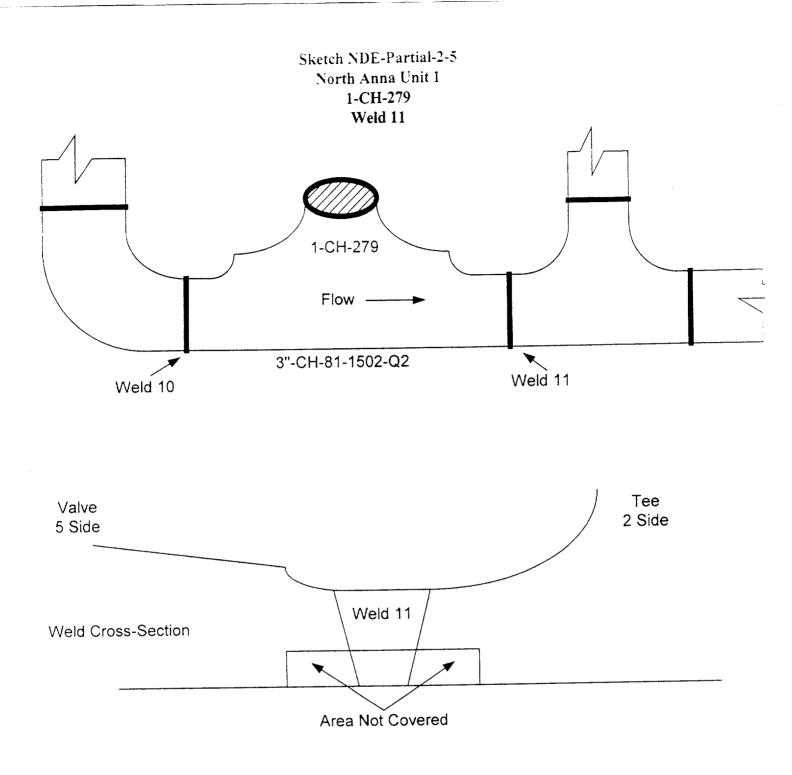

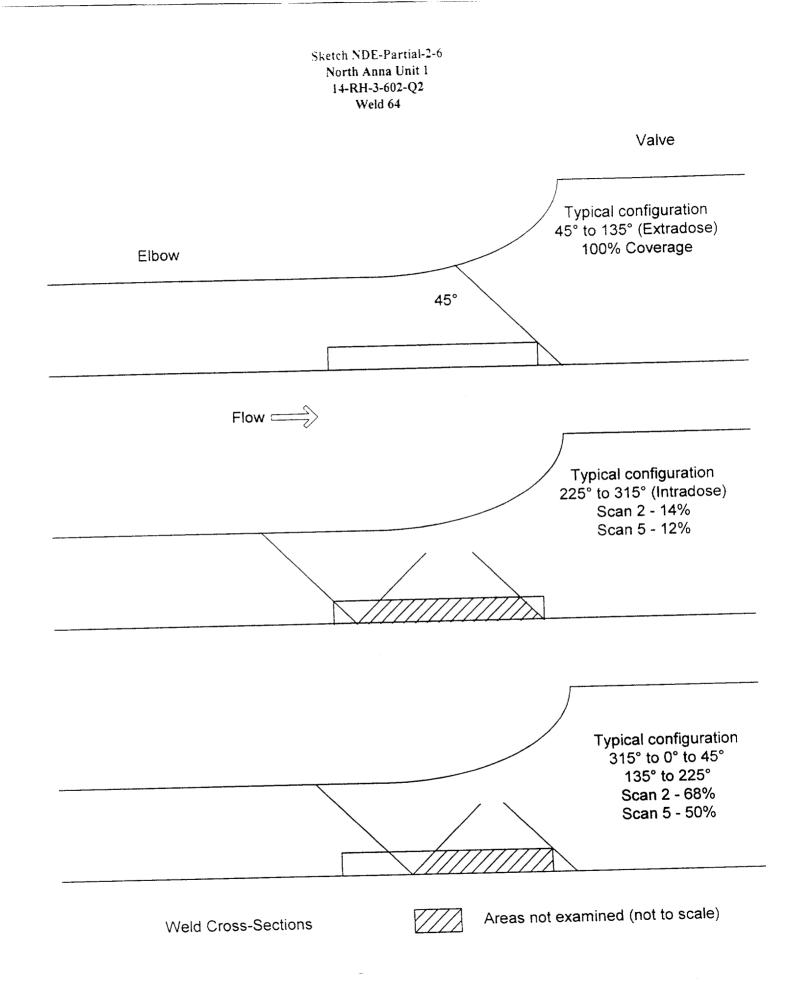

Mr. David A. Christian Senior Vice President and Chief Nuclear Officer Virginia Electric and Power Company Innsbrook Technical Center 5000 Dominion Blvd. Glen Allen, Virginia 23060-6711

NORTH ANNA POWER STATION. UNIT 1 - ASME SECTION XI INSERVICE SUBJECT: INSPECTION (ISI) PROGRAM RELIEF REQUEST NDE-PARTIAL-2 (TAC NO. MB1129)

Dear Mr. Christian:

The purpose of this letter is to grant you the relief you requested by NDE-Partial-2 for North Anna Power Station. Unit 1.

By letter dated January 29, 2001, as supplemented by a letter dated November 26, 2001, the Virginia Electric and Power Company requested relief from the requirements of the American Society of Mechanical Engineers (ASME) Boiler and Pressure Vessel Code, Section XI.

Our evaluation and conclusion are contained in the enclosed Safety Evaluation. The staff has concluded that the requirements of Section XI of the ASME Code are impractical to perform, and the examinations that have been performed provide reasonable assurance of structural integrity of the subject welds. The relief you requested is authorized pursuant to Title 10 of the Code of Federal Regulations Section 50.55a(g)(6)(i) for the third 10-year ISI interval.

The staff has completed its evaluation of this matter; therefore, we are closing TAC No. MB1129.

Sincerely,

Richard J. Laufer, Acting Chief, Section 1 Project Directorate II **Division of Licensing Project Management** Office of Nuclear Reactor Regulation

Docket No. 50-338

Enclosure: As stated

cc w/encl: See next page

Distribution:

TMcLellan RidsNrrPMSMonarque (paper copy) RidsNrrLAEDunnington (paper copy) RidsNrrDlpmLpdii **RidsAcrsAcnwMailCenter** RidsOgcRp RidsRgn2MailCenter TMarsh

PDII-1 R/F GHill (2) PUBLIC

Document Name: G:\PDII-1\NOANNA\north anna 1 nde partial 2.wpd *No major changes made to the SE ADAMS ACCESSION NUMBER ML

OFFICE	PM:PDII/S1	LA:PDJI/S2	DE:EMCB*	OGC NLO	SC/PDII/S1
NAME	SMoŋarque	EDunnington	TChan	AFarnauclez	RLaufer
DATE	01/23/02	01/23/02	01/16/02	2/6/02	/ /02

OFFICIAL RECORD COPI