

Lew W. Myers
Senior Vice President

724-682-5234
Fax: 724-643-8069

March 1, 2002
L-02-020

U. S. Nuclear Regulatory Commission
Attention: Document Control Desk
Washington, DC 20555-0001

**Subject: Beaver Valley Power Station, Unit No. 2
Docket No. 50-412, License No. NPF-73
Cycle 10 Reload and Core Operating Limits Report**

Beaver Valley Power Station, Unit No. 2 completed the ninth cycle of operation on February 4, 2002, with a burnup of 16,352.72 MWD/MTU. This letter describes the Cycle 10 reload design, provides a copy of the Core Operating Limits Report (COLR) in accordance with Technical Specification 6.9.5.d, and documents our review in accordance with 10 CFR 50.59 including our determination that no Technical Specification or license amendment was required for the Cycle 10 reload design.

The Beaver Valley Power Station Unit No. 2 reactor core features a low leakage pattern. During the 2R09 refueling, 1 Region 8B, 32 Region 9B and 32 Region 10 fuel assemblies were discharged and replaced with 1 reinserted Region 8B, 16 fresh Region 12A fuel assemblies enriched to 4.20 nominal weight percent and 48 fresh Region 12B fuel assemblies enriched to 4.80 nominal weight percent. Cycle 10 is the first cycle with Robust Fuel Assemblies (RFA) in the core (Regions 12A & 12B). The NRC-approved Fuel Criteria Evaluation Process (WCAP-12488-A, October 1994) was used to address the design modifications for the 17 x 17 RFA (NSD-NRC-97-5189, June 30, 1997).

FirstEnergy Nuclear Operating Company has performed a review of this reload core design to determine those parameters affecting the design basis limits and the safety analyses for postulated accidents described in the Updated Final Safety Analysis Report (UFSAR). The analytical methods used to determine the core operating limits meet the criteria specified in Technical Specification 6.9.5.a, b and c. The Cycle 10 reactor core reload evaluation concluded that the implementation of the 17 x 17 RFA core will not adversely affect the safety of the plant. The reload evaluation also concluded that the core design will not require any Technical Specification changes, and will not require a license amendment due to new safety analyses changes, fission product barrier design basis limits, or methods of evaluation as described in the UFSAR, pursuant to 10 CFR 50.59. The Beaver Valley Onsite Safety Committee has concurred with the conclusions of the reload evaluation.

Beaver Valley Power Station, Unit No. 2
Cycle 10 Reload and Core Operating Limits Report
L-02-020
Page 2

The Core Operating Limits Report (COLR) is enclosed in accordance with Technical Specification 6.9.5.d. The COLR has been updated for this cycle by revising the F_{xy} and maximum $F_Q^T * P_{REL}$ criteria.

If there are any questions concerning this matter, please contact Mr. Larry R. Freeland, Manager, Regulatory Affairs/Corrective Action at 724-682-5284.

Sincerely,

A handwritten signature in black ink, appearing to read "Lew W. Myers". The signature is fluid and cursive, with a prominent underline.

Lew W. Myers

c: Mr. D. S. Collins, Project Manager
Mr. D. M. Kern, Sr. Resident Inspector
Mr. H. J. Miller, NRC Region I Administrator
Mr. L. E. Ryan (BRP/DEP)

LICENSING REQUIREMENTS MANUAL

4.1 CORE OPERATING LIMITS REPORT

This Core Operating Limits Report provides the cycle specific parameter limits developed in accordance with the NRC approved methodologies specified in Technical Specification Administrative Control 6.9.5.

Specification 3.1.3.5 Shutdown Rod Insertion Limits

The Shutdown rods shall be withdrawn to at least 225 steps.

Specification 3.1.3.6 Control Rod Insertion Limits

Control Banks A and B shall be withdrawn to at least 225 steps.

Control Banks C and D shall be limited in physical insertion as shown in Figure 4.1-1.

Specification 3.2.1 Axial Flux Difference

NOTE: The target band is $\pm 7\%$ about the target flux from 0% to 100% RATED THERMAL POWER.

The indicated Axial Flux Difference:

- a. Above 90% RATED THERMAL POWER shall be maintained within the $\pm 7\%$ target band about the target flux difference.
- b. Between 50% and 90% RATED THERMAL POWER is within the limits shown on Figure 4.1-2.
- c. Below 50% RATED THERMAL POWER may deviate outside the target band.

Specification 3.2.2 $F_Q(Z)$ and F_{xy} Limits

$$F_Q(Z) \leq \frac{CF_Q}{P} * K(Z) \quad \text{for } P > 0.5$$

$$F_Q(Z) \leq \frac{CF_Q}{0.5} * K(Z) \quad \text{for } P \leq 0.5$$

Where: $CF_Q = 2.3$

$$P = \frac{\text{THERMAL POWER}}{\text{RATED THERMAL POWER}}$$

$K(Z)$ = the function obtained from Figure 4.1-3.

LICENSING REQUIREMENTS MANUAL

The F_{xy} limits [$F_{xy}(L)$] for RATED THERMAL POWER within specific core planes shall be:

$$F_{xy}(L) = F_{xy}(RTP) (1 + PF_{XY} * (1-P))$$

Where: For all core planes containing D-Bank:

$$F_{xy}(RTP) \leq 1.71$$

For unrodded core planes:

$$F_{xy}(RTP) \leq 1.74 \text{ from 1.8 ft. elevation to 2.4 ft. elevation}$$

$$F_{xy}(RTP) \leq 1.80 \text{ from 2.4 ft. elevation to 4.0 ft. elevation}$$

$$F_{xy}(RTP) \leq 1.81 \text{ from 4.0 ft. elevation to 6.0 ft. elevation}$$

$$F_{xy}(RTP) \leq 1.84 \text{ from 6.0 ft. elevation to 7.7 ft. elevation}$$

$$F_{xy}(RTP) \leq 1.82 \text{ from 7.7 ft. elevation to 8.9 ft. elevation}$$

$$F_{xy}(RTP) \leq 1.75 \text{ from 8.9 ft. elevation to 10.2 ft. elevation}$$

$$PF_{xy} = 0.2$$

$$P = \frac{\text{THERMAL POWER}}{\text{RATED THERMAL POWER}}$$

Figure 4.1-4 provides the maximum total peaking factor times relative power ($F_Q^T * P_{rel}$) as a function of axial core height during normal core operation.

Specification 3.2.3 $F_{\Delta H}^N$

$$F_{\Delta H}^N \leq CF_{\Delta H} * (1 + PF_{\Delta H} (1 - P))$$

Where: $CF_{\Delta H} = 1.62$

$$PF_{\Delta H} = 0.3$$

$$P = \frac{\text{THERMAL POWER}}{\text{RATED THERMAL POWER}}$$

LICENSING REQUIREMENTS MANUAL

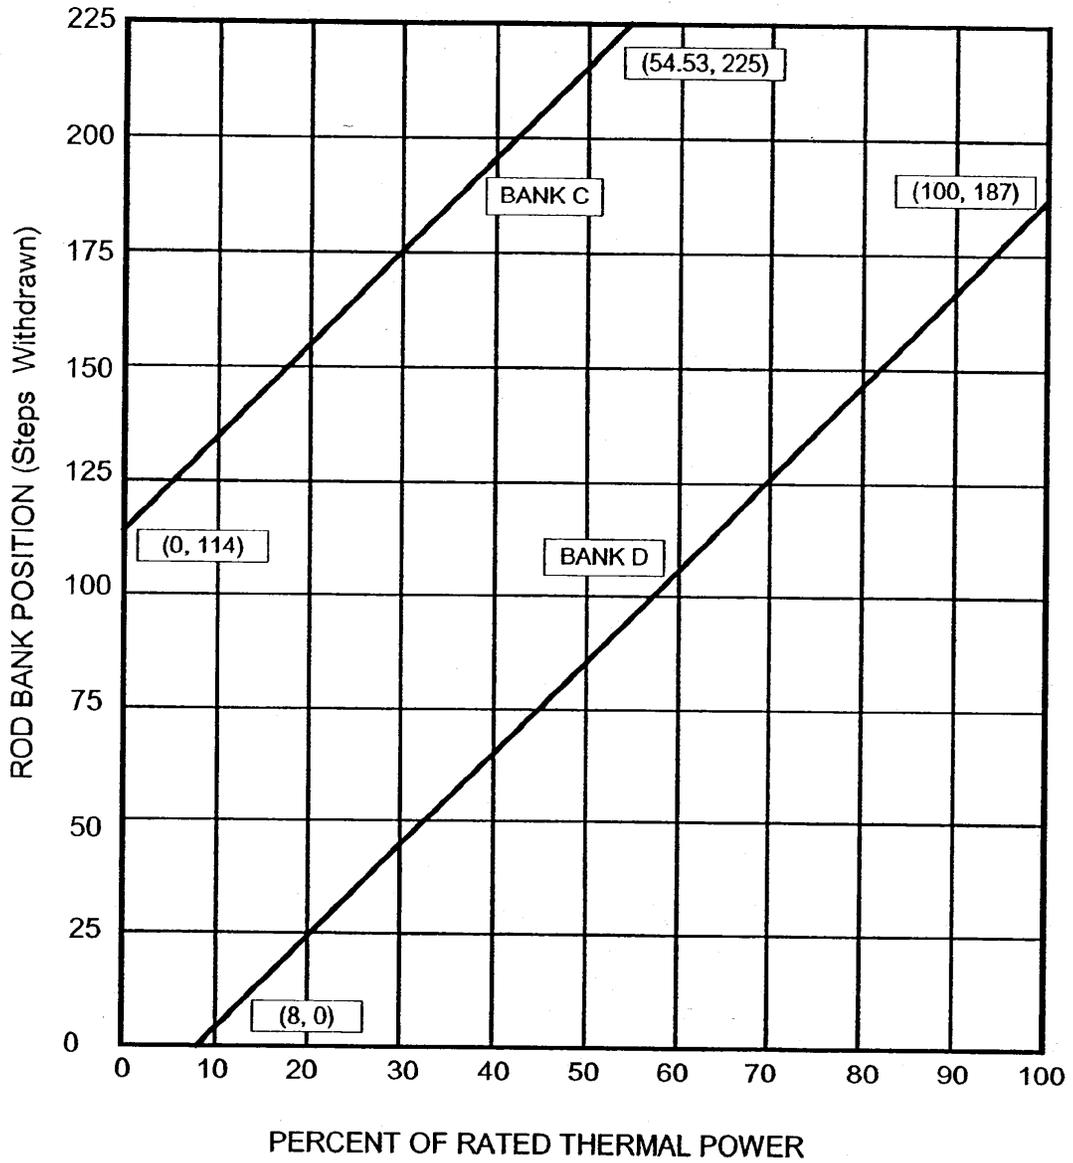


FIGURE 4.1-1

CONTROL ROD INSERTION LIMITS AS A
FUNCTION OF RATED POWER LEVEL

LICENSING REQUIREMENTS MANUAL

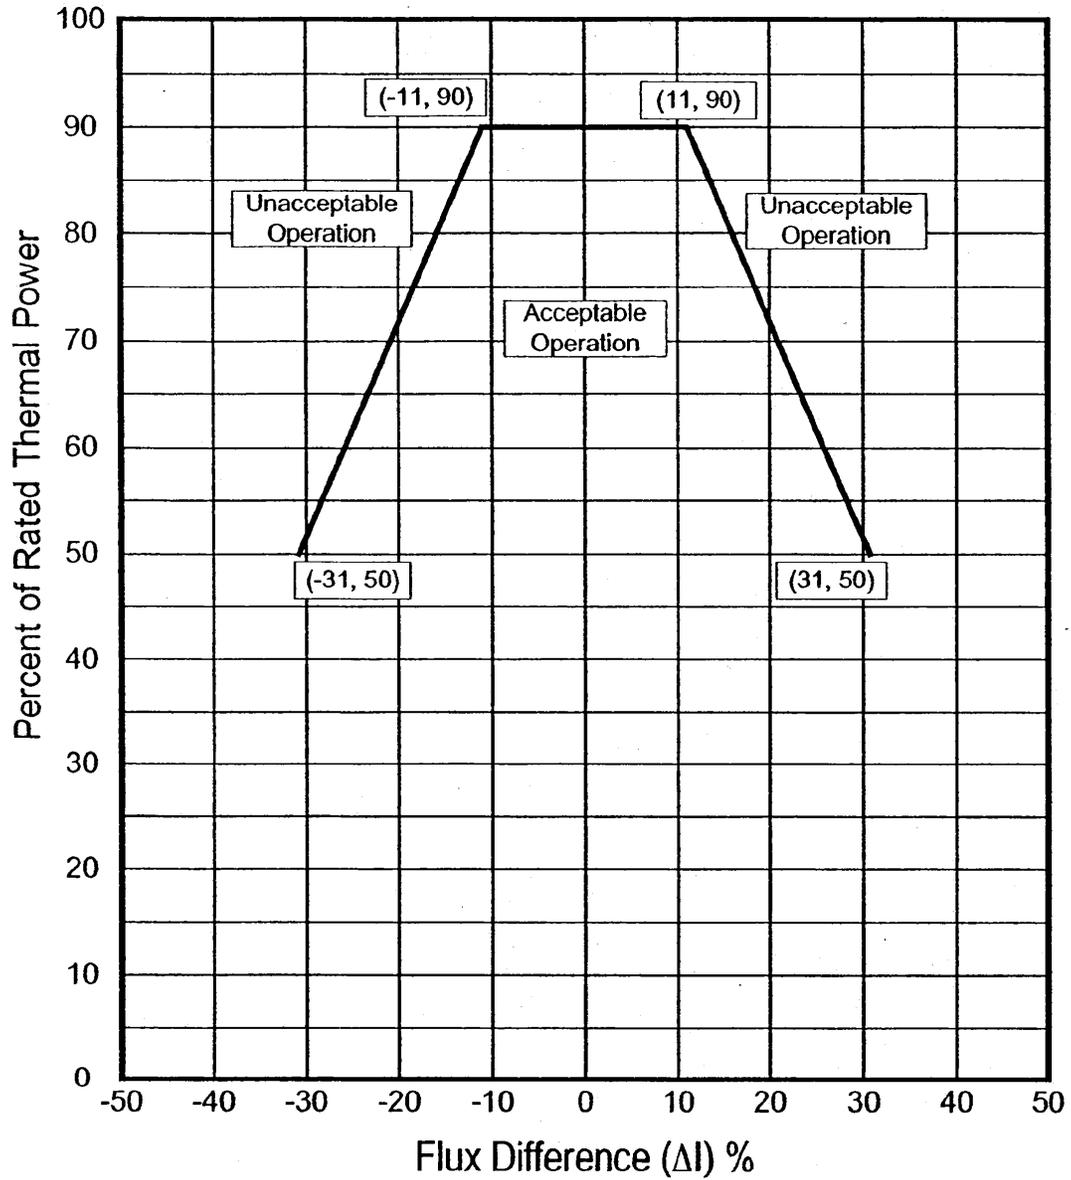


FIGURE 4.1-2

AXIAL FLUX DIFFERENCE LIMITS AS A FUNCTION OF
RATED THERMAL POWER

LICENSING REQUIREMENTS MANUAL

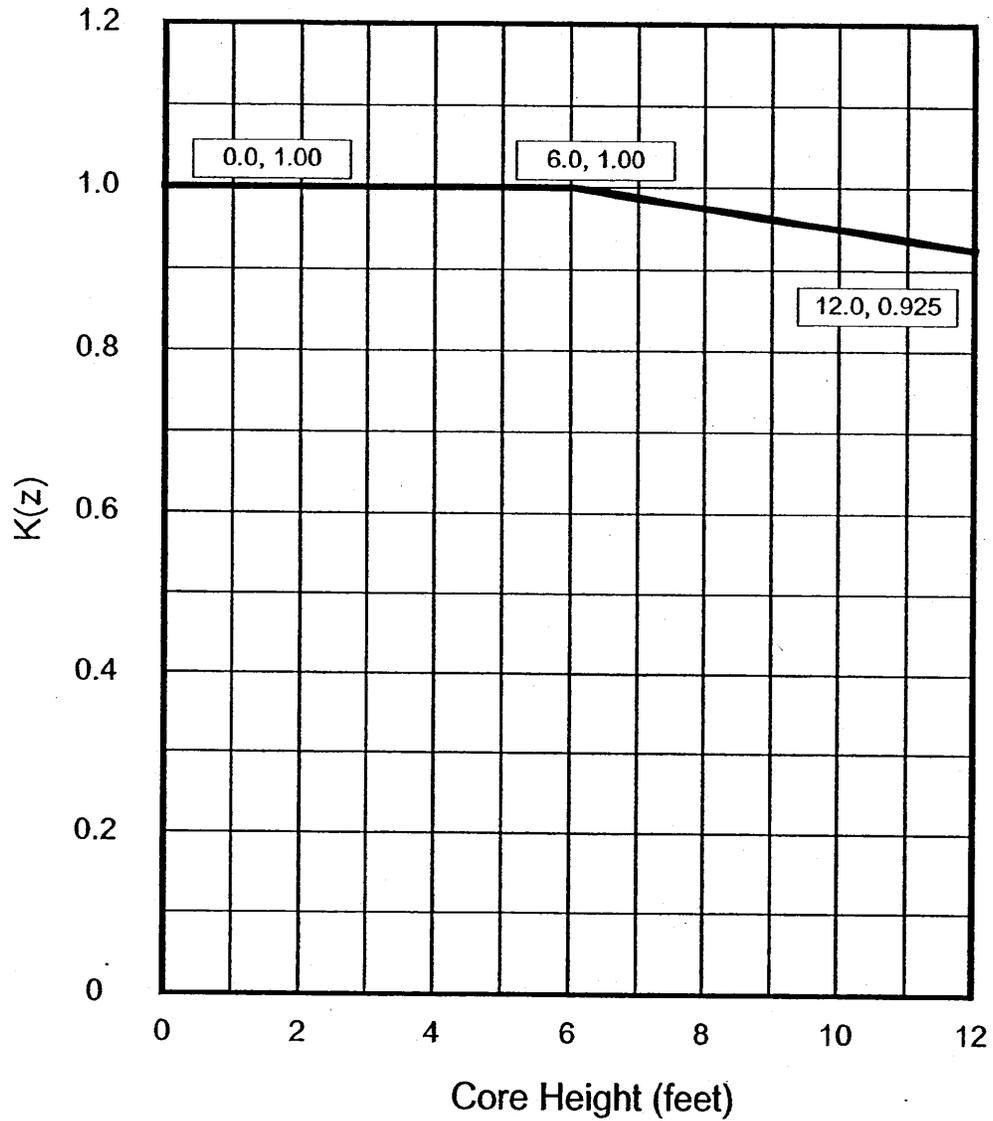


FIGURE 4.1-3

F_QT NORMALIZED OPERATING ENVELOPE, K(Z)

LICENSING REQUIREMENTS MANUAL

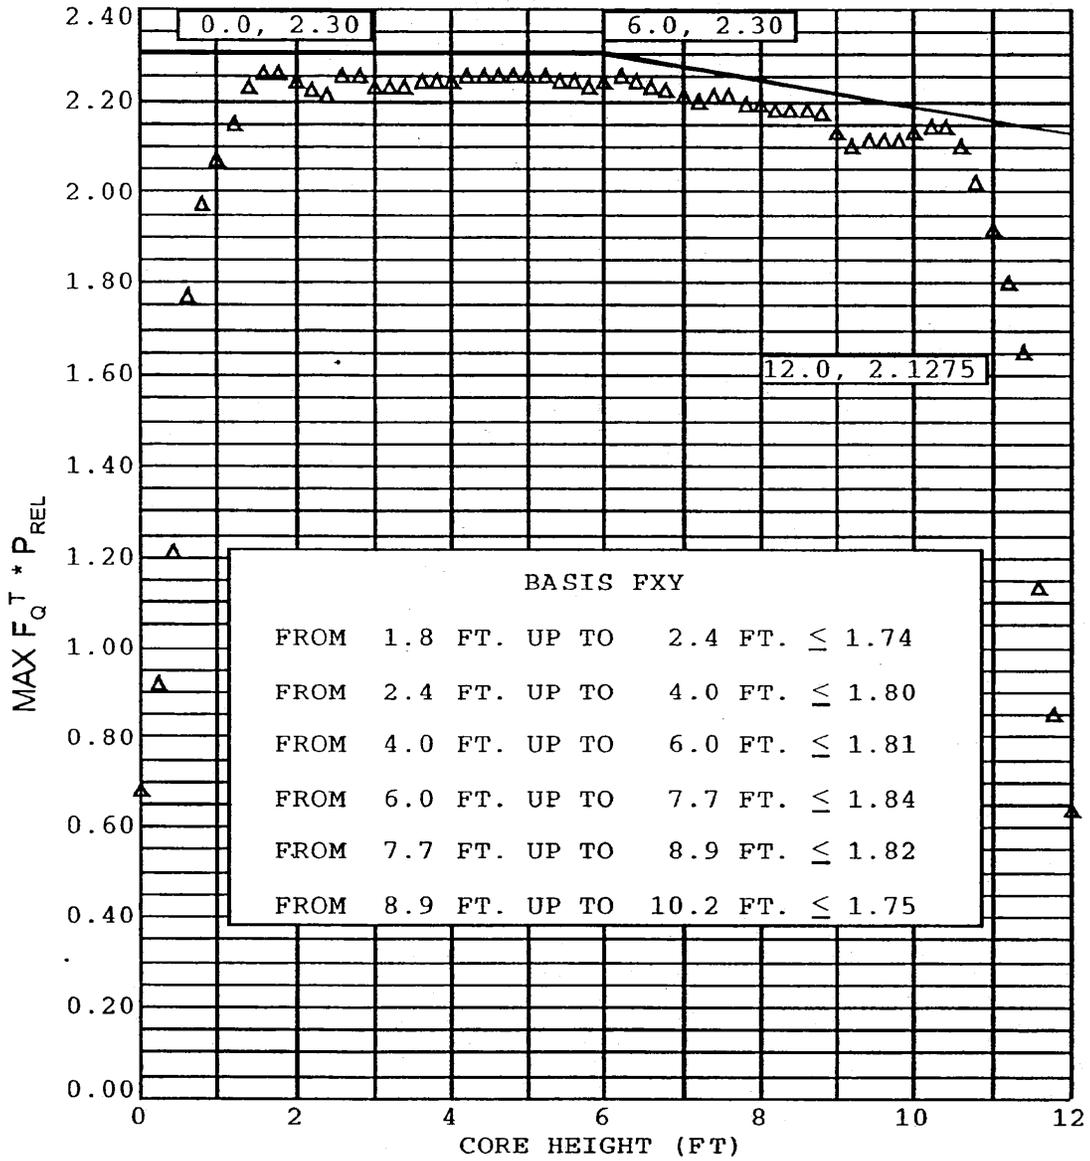


FIGURE 4.1-4

MAXIMUM ($F_Q^T * P_{REL}$) VS. AXIAL CORE HEIGHT
DURING NORMAL OPERATION

BVPS-2
LICENSING REQUIREMENTS MANUAL

Specification 3.3.1.1 Reactor Trip System Instrumentation Setpoints, Table 3.3-1 Table Notations A and B

Overtemperature ΔT Setpoint Parameter Values:

<u>Parameter</u>	<u>Value</u>
Overtemperature ΔT reactor trip setpoint	$K1 \leq 1.311$
Overtemperature ΔT reactor trip setpoint T_{avg} coefficient	$K2 \geq 0.0183/^\circ F$
Overtemperature ΔT reactor trip setpoint pressure coefficient	$K3 \geq 0.00082/psia$
T_{avg} at RATED THERMAL POWER	$T' \leq 576.2^\circ F$
Nominal pressurizer pressure	$P' \geq 2250 psia$
Measured reactor vessel ΔT lead/lag time constants	$\tau_1 \geq 8 sec$ $\tau_2 \leq 3 sec$
Measured reactor vessel ΔT lag time constant	$\tau_3 \leq 0 sec$
Measured reactor vessel average temperature lead/lag time constants	$\tau_4 \geq 30 sec$ $\tau_5 \leq 4 sec$
Measured reactor vessel average temperature lag time constant	$\tau_6 \leq 0 sec$

$f(\Delta I)$ is a function of the indicated difference between top and bottom detectors of the power-range nuclear ion chambers; with gains to be selected based on measured instrument response during plant startup tests such that:

- (i) For $q_t - q_b$ between -32% and +11%, $f_1(\Delta I) = 0$, where q_t and q_b are percent RATED THERMAL POWER in the top and bottom halves of the core respectively, and $q_t + q_b$ is total THERMAL POWER in percent of RATED THERMAL POWER;
- (ii) For each percent that the magnitude of $q_t - q_b$ exceeds -32%, the ΔT Trip Setpoint shall be automatically reduced by 1.46% of its value at RATED THERMAL POWER; and
- (iii) For each percent that the magnitude of $q_t - q_b$ exceeds +11%, the ΔT Trip Setpoint shall be automatically reduced by 1.56% of its value at RATED THERMAL POWER.

Overpower ΔT Setpoint Parameter Values:

<u>Parameter</u>	<u>Value</u>
Overpower ΔT reactor trip setpoint	$K4 \leq 1.094$

BVPS-2
LICENSING REQUIREMENTS MANUAL

Overpower ΔT Setpoint Parameter Values (continued):

<u>Parameter</u>	<u>Value</u>
Overpower ΔT reactor trip setpoint T_{avg} rate/lag coefficient	$K5 \geq 0.02/^{\circ}F$ for increasing average temperature $K5 = 0/^{\circ}F$ for decreasing average temperature
Overpower ΔT reactor trip setpoint T_{avg} heatup coefficient	$K6 \geq 0.0012/^{\circ}F$ for $T > T''$ $K6 = 0/^{\circ}F$ for $T \leq T''$
T_{avg} at RATED THERMAL POWER	$T'' \leq 576.2^{\circ}F$
Measured reactor vessel ΔT lead/lag time constants	$\tau_1 \geq 8$ sec $\tau_2 \leq 3$ sec
Measured reactor vessel ΔT lag time constant	$\tau_3 \leq 0$ sec
Measured reactor vessel average temperature lag time constant	$\tau_6 \leq 0$ sec
Measured reactor vessel average temperature rate/lag time constant	$\tau_7 \geq 10$ sec

Specification 3.2.5 DNB Parameters

<u>Parameter</u>	<u>Indicated Value</u>
Reactor Coolant System T_{avg}	$T_{avg} \leq 579.9^{\circ}F^{(1)}$
Pressurizer Pressure	Pressure ≥ 2214 psia ⁽²⁾
Reactor Coolant System Total Flow Rate	Flow $\geq 267,200$ gpm ⁽³⁾

- (1) The Reactor Coolant System (RCS) T_{avg} value includes allowances for rod control operation and verification via control board indication.
- (2) The pressurizer pressure value includes allowances for pressurizer pressure control operation and verification via control board indication.
- (3) The RCS total flow rate includes allowances for normalization of the cold leg elbow taps with a beginning of cycle precision RCS flow calorimetric measurement and verification on a periodic basis via plant process computer. If periodic verification of flow rate is performed via control board indication, the required flow value is $\geq 267,400$ gpm.

BVPS-2
LICENSING REQUIREMENTS MANUAL

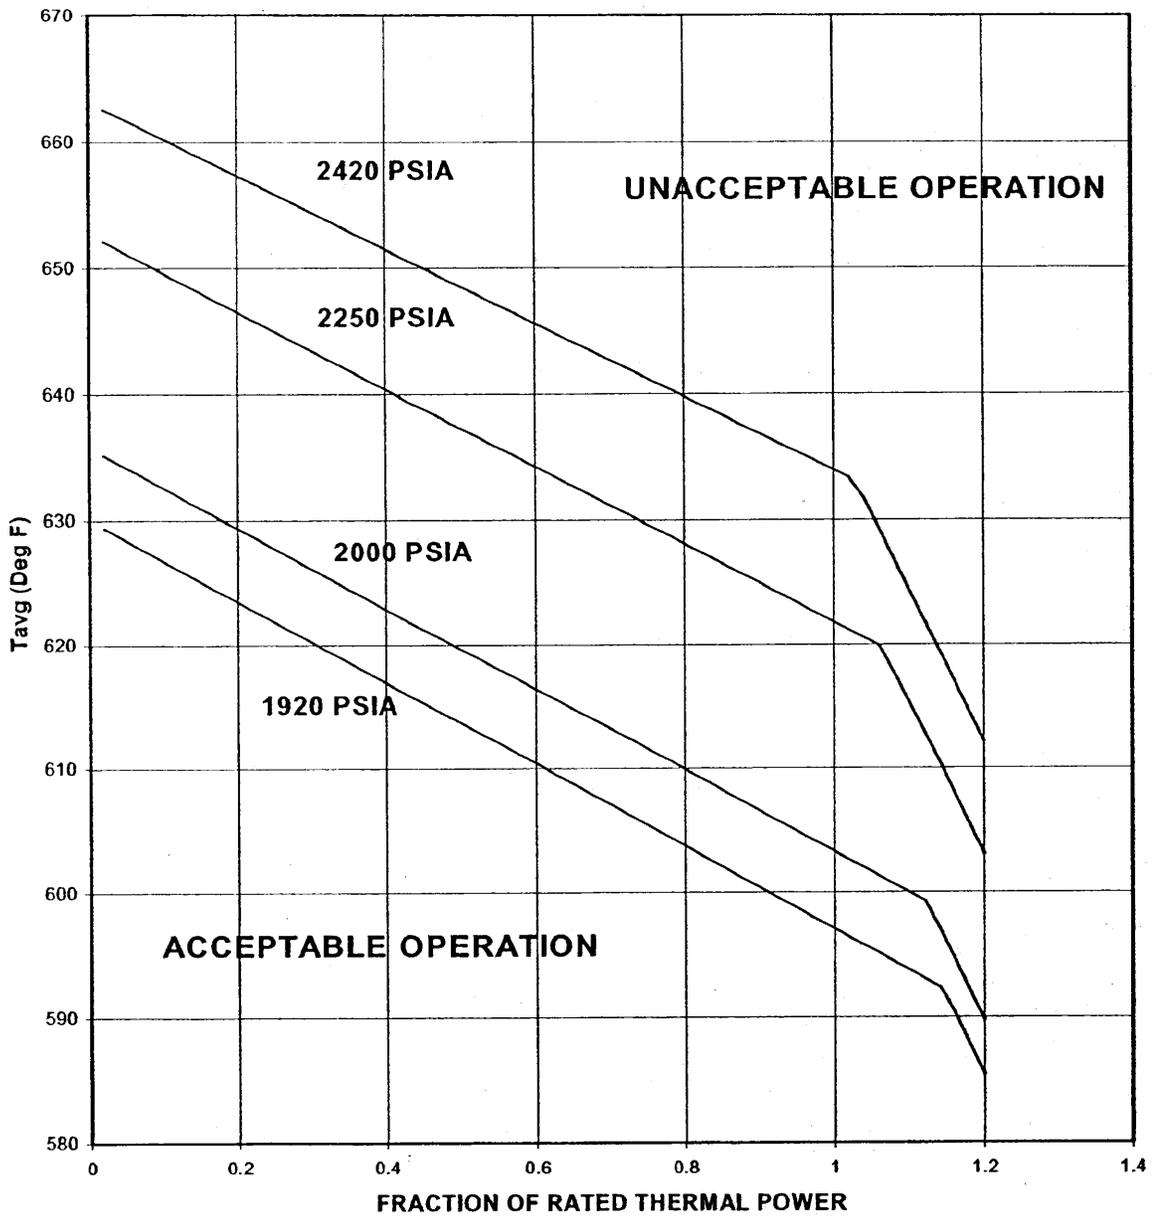


Figure 4.1-5
REACTOR CORE SAFETY LIMIT
THREE LOOP OPERATION
(Technical Specification Safety Limit 2.1.1)