

DEC 08 1976

Docket No. 50-305

Wisconsin Public Service Corporation
ATTN: Mr. E. W. James
Senior Vice President
Post Office Box 1200
Green Bay, Wisconsin 54305

Gentlemen:

RE: KEWAUNEE PLANT

We are enclosing a corrected Specification 4.7.11.2 that has been sent to you as part of the Standard Technical Specifications (STS) for Fire Protection by letter dated December 1, 1976.

Sincerely,

A. Schwencer, Chief
Operating Reactors Branch #1
Division of Operating Reactors

Enclosure:
Specification 4.7.11.2

cc w/encl:
See next page

DISTRIBUTION
Docket
NRC PDR
LOCAL PDR
ORB#1 Readong
KGoller/TCarter
ASchwencer
TVWambach
SMSheppard
DNeighbors
OELD
OI&E (3)
ACRS (16)
DEisenhut
VStello
TBAbernathy
JRBuchanan

OFFICE >	DOR:ORB#1	DOR DOR:ORB31	DOR DOR:ORB#1			
SURNAME >	DNeighbors:lb	TVWambach	Aschwencer			
DATE >	12/08/76	12/22/76	12/21/76			



UNITED STATES
NUCLEAR REGULATORY COMMISSION
WASHINGTON, D. C. 20555

DEC 08 1976

Docket No. 50-305

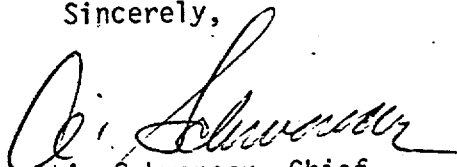
Wisconsin Public Service Corporation
ATTN: Mr. E. W. James
Senior Vice President
Post Office Box 1200
Green Bay, Wisconsin 54305

Gentlemen:

RE: KEWAUNEE PLANT

We are enclosing a corrected Specification 4.7.11.2 that has been sent to you as part of the Standard Technical Specifications (STS) for Fire Protection by letter dated December 1, 1976.

Sincerely,


A. Schwencer, Chief
Operating Reactors Branch #1
Division of Operating Reactors

Enclosure:
Specification 4.7.11.2

cc w/encl:
See next page

Wisconsin Public Service Corporation

- 2 -

DEC 08 1976

cc: Steven E. Keane, Esquire
Foley, Sammond & Lardner
735 North Water Street
Milwaukee, Wisconsin 53202

Bruce W. Churchill, Esquire
Shaw, Pittman, Potts & Trowbridge
910 - 17th Street, N. W.
Washington, D. C. 20006

Kewaunee Public Library
314 Milwaukee Street
Kewaunee, Wisconsin 54216

NOV 03 1976

PLANT SYSTEMS

SPRAY AND/OR SPRINKLER SYSTEMS

LIMITING CONDITION FOR OPERATION

3.7.11.2 The spray and/or sprinkler systems located in the following areas shall be OPERABLE:

- a.
- b. (Plant dependent)
- c.

APPLICABILITY: All modes

ACTIONS:

With a spray and/or sprinkler system inoperable establish a continuous fire watch with backup fire suppression equipment in the unprotected area(s), and

- 1. In MODES 1, 2, 3 or 4 restore the system to OPERABLE status within 7 days or be in at least HOT STANDBY within 6 hours and in COLD SHUTDOWN within the following 30 hours.
- 2. In MODES 5 or 6 restore the system to OPERABLE status within 7 days or prepare and submit a Special Report to the Commission pursuant to Specification 6.9.2 within the next 10 days outlining the cause of inoperability and the plans for restoring the system to OPERABLE status.

SURVEILLANCE REQUIREMENTS

4.7.11.2 The spray and/or sprinkler systems shall be demonstrated to be OPERABLE:

- a. At least once per 92 days by cycling each testable valve through one complete cycle.
- b. At least once per 12 months:
 - 1. By performing a system functional test which includes simulated automatic actuation of the system and verifying that the automatic valves in the flow path actuate to their correct positions.
 - 2. By inspection of spray headers to verify their integrity
 - 3. By inspection of each nozzle to verify no blockage.
- c. At least once per 5 years by an air flow test of the open head spray and/or sprinkler system.