



UNITED STATES
NUCLEAR REGULATORY COMMISSION
WASHINGTON, D. C. 20555

Docket File

October 4, 1989

Docket Nos. 50-454, 50-455
and 50-456, 50-457

Mr. Thomas J. Kovach
Nuclear Licensing Manager
Commonwealth Edison Company
Post Office Box 767
Chicago, Illinois 60690

Dear Mr. Kovach:

The Commission has issued the enclosed Amendment No. 34 to Facility Operating License No. NPF-37 and Amendment No. 34 to Facility Operating License No. NPF-66 for the Byron Station, Unit Nos. 1 and 2, respectively and Amendment No. 22 to Facility Operating License No. NPF-72, and Amendment No. 22 to Facility Operating License No. NPF-77 for Braidwood Station, Units Nos. 1 and 2, respectively. The amendments consist of changes to the Technical Specifications in response to your application transmitted by letter dated December 4, 1987.

These amendments approve changes to Technical Specification Figure 3.2-2 which depicts the normalized heat flux hot channel factor as a function of core height.

A copy of the related Safety Evaluation is enclosed. A Notice of Issuance will be filed with the Office of the Federal Register for publication.

Sincerely,

Stephen P. Sands

Stephen P. Sands, Project Manager
Project Directorate III-2
Division of Reactor Projects - III,
IV, V, and Special Projects
Office of Nuclear Reactor Regulation

Leonard N. Olshan

Leonard N. Olshan, Project Manager
Project Directorate III-2
Division of Reactor Projects - III,
IV, V, and Special Projects
Office of Nuclear Reactor Regulation

Enclosures:

1. Amendment No. 34 to NPF-37
2. Amendment No. 34 to NPF-66
3. Amendment No. 22 to NPF-72
4. Amendment No. 22 to NPF-77
5. Safety Evaluation

cc w/enclosures:
See next page

*QFOI
11*

Mr. Thomas J. Kovach
Commonwealth Edison Company

Byron/Braidwood Power Station
Units 1 and 2

cc:

Mr. Jack Tain
Atomic Power Distribution
Westinghouse Electric Corporation
Post Office Box 355
Pittsburgh, Pennsylvania 15230

Dr. Bruce von Zellen
Department of Biological Sciences
Northern Illinois University
DeKalb, Illinois 61107

Joseph Gallo, Esq.
Hopkins and Sutter
1050 Connecticut Ave., N.W.
Suite 1250
Washington, D.C. 20036

U. S. Nuclear Regulatory Commission
Byron/Resident Inspectors Office
4448 North German Church Road
Byron, Illinois 61010

Regional Administrator
U. S. NRC, Region III
799 Roosevelt Road, Bldg. #4
Glen Ellyn, Illinois 60137

Ms. Lorraine Creek
Rt. 1, Box 182
Manteno, Illinois 60950

Ms. Bridget Little Rorem
Appleseed Coordinator
117 North Linden Street
Essex, Illinois 60935

Mrs. Phillip B. Johnson
1907 Stratford Lane
Rockford, Illinois 61107

Mr. Edward R. Crass
Nuclear Safeguards and Licensing
Division
Sargent & Lundy Engineers
55 East Monroe Street
Chicago, Illinois 60603

Douglass Cassel, Esq.
109 N. Dearborn Street
Suite 1300
Chicago, Illinois 60602

Ms. Pat Morrison
913 N Main Street #707
Rockford, Illinois 61103-7058

U. S. Nuclear Regulatory Commission
Resident Inspectors Office
RR#1, Box 79
Braceville, Illinois 60407

David C. Thomas, Esq.
77 S. Wacker Drive
Chicago, Illinois 60601

Mr. Thomas W. Ortziger, Director
Illinois Emergency Services
and Disaster Agency
110 East Adams Street
Springfield, Illinois 62706

Mr. Thomas J. Kovach
Commonwealth Edison Company

- 2 -

Byron/Braidwood

cc:

Illinois Department of
Nuclear Safety
Office of Nuclear Facility Safety
1035 Outer Park Drive
Springfield, Illinois 62704

Michael Miller, Esq.
Sidley and Austin
One First National Plaza
Chicago, Illinois 60603

George L. Edgar
Newman & Holtzinger, P.C.
1615 L Street, N.W.
Washington, D.C. 20036

Commonwealth Edison Company
Byron Station Manager
4450 North German Church Road
Byron, Illinois 61010



UNITED STATES
NUCLEAR REGULATORY COMMISSION
WASHINGTON, D. C. 20555

COMMONWEALTH EDISON COMPANY

DOCKET NO. 50-454

BYRON STATION, UNIT 1

AMENDMENT TO FACILITY OPERATING LICENSE

Amendment No. 34
License No. NPF-37

1. The Nuclear Regulatory Commission (the Commission) has found that:
 - A. The application for amendment by Commonwealth Edison Company (the licensee) dated December 4, 1987, complies with the standards and requirements of the Atomic Energy Act of 1954, as amended (the Act) and the Commission's rules and regulations set forth in 10 CFR Chapter I;
 - B. The facility will operate in conformity with the application, the provisions of the Act, and the rules and regulations of the Commission;
 - C. There is reasonable assurance (i) that the activities authorized by this amendment can be conducted without endangering the health and safety of the public, and (ii) that such activities will be conducted in compliance with the Commission's regulations;
 - D. The issuance of this amendment will not be inimical to the common defense and security or to the health and safety of the public; and
 - E. The issuance of this amendment is in accordance with 10 CFR Part 51 of the Commission's regulations and all applicable requirements have been satisfied.
2. Accordingly, the license is amended by changes to the Technical Specifications as indicated in the attachment to this license amendment, and paragraph 2.C.(2) of Facility Operating License No. NPF-37 is hereby amended to read as follows:

(2) Technical Specification

The Technical Specifications contained in Appendix A as revised through Amendment No. 34 and the Environmental Protection Plan contained in Appendix B, both of which are attached hereto, are

hereby incorporated into this license. The licensee shall operate the facility in accordance with the Technical Specifications and the Environmental Protection Plan.

3. This license amendment is effective as of the date of its issuance.

FOR THE NUCLEAR REGULATORY COMMISSION



Paul C. Shemanski, Acting Director
Project Directorate III-2
Division of Reactor Projects - III,
IV, V, and Special Projects
Office of Nuclear Reactor Regulation

Attachment:
Changes to the Technical
Specifications

Date of Issuance: October 4, 1989



UNITED STATES
NUCLEAR REGULATORY COMMISSION
WASHINGTON, D. C. 20555

COMMONWEALTH EDISON COMPANY

DOCKET NO. 50-455

BYRON STATION, UNIT 2

AMENDMENT TO FACILITY OPERATING LICENSE

Amendment No. 34
License No. NPF-66

1. The Nuclear Regulatory Commission (the Commission) has found that:
 - A. The application for amendment by Commonwealth Edison Company (the licensee) dated December 4, 1987, complies with the standards and requirements of the Atomic Energy Act of 1954, as amended (the Act) and the Commission's rules and regulations set forth in 10 CFR Chapter I;
 - B. The facility will operate in conformity with the application, the provisions of the Act, and the rules and regulations of the Commission;
 - C. There is reasonable assurance (i) that the activities authorized by this amendment can be conducted without endangering the health and safety of the public, and (ii) that such activities will be conducted in compliance with the Commission's regulations;
 - D. The issuance of this amendment will not be inimical to the common defense and security or to the health and safety of the public; and
 - E. The issuance of this amendment is in accordance with 10 CFR Part 51 of the Commission's regulations and all applicable requirements have been satisfied.
2. Accordingly, the license is amended by changes to the Technical Specifications as indicated in the attachment to this license amendment, and paragraph 2.C.(2) of Facility Operating License No. NPF-66 is hereby amended to read as follows:


(2) Technical Specification

The Technical Specifications contained in Appendix A (NUREG-1113), as revised through Amendment No. 34 and revised by Attachment 2 to NPF-60, and the Environmental Protection Plan contained in Appendix B, both of which are attached to License No. NPF-37, dated February 14, 1985, are hereby incorporated into this license. Attachment 2

contains a revision to Appendix A which is hereby incorporated into this license. The licensee shall operate the facility in accordance with the Technical Specifications and the Environmental Protection Plan.

3. This license amendment is effective as of the date of its issuance.

FOR THE NUCLEAR REGULATORY COMMISSION



Paul C. Shemanski, Acting Director
Project Directorate III-2
Division of Reactor Projects - III,
IV, V, and Special Projects
Office of Nuclear Reactor Regulation

Attachment:
Changes to the Technical
Specifications

Date of Issuance: October 4, 1989

ATTACHMENT TO LICENSE AMENDMENT NOS. 34 AND 34
FACILITY OPERATING LICENSE NOS. NPF-37 AND NPF-66
DOCKET NOS. 50-454 AND 50-455

Revise Appendix A as follows:

REMOVE

3/4 2-5

INSERT

3/4 2-5

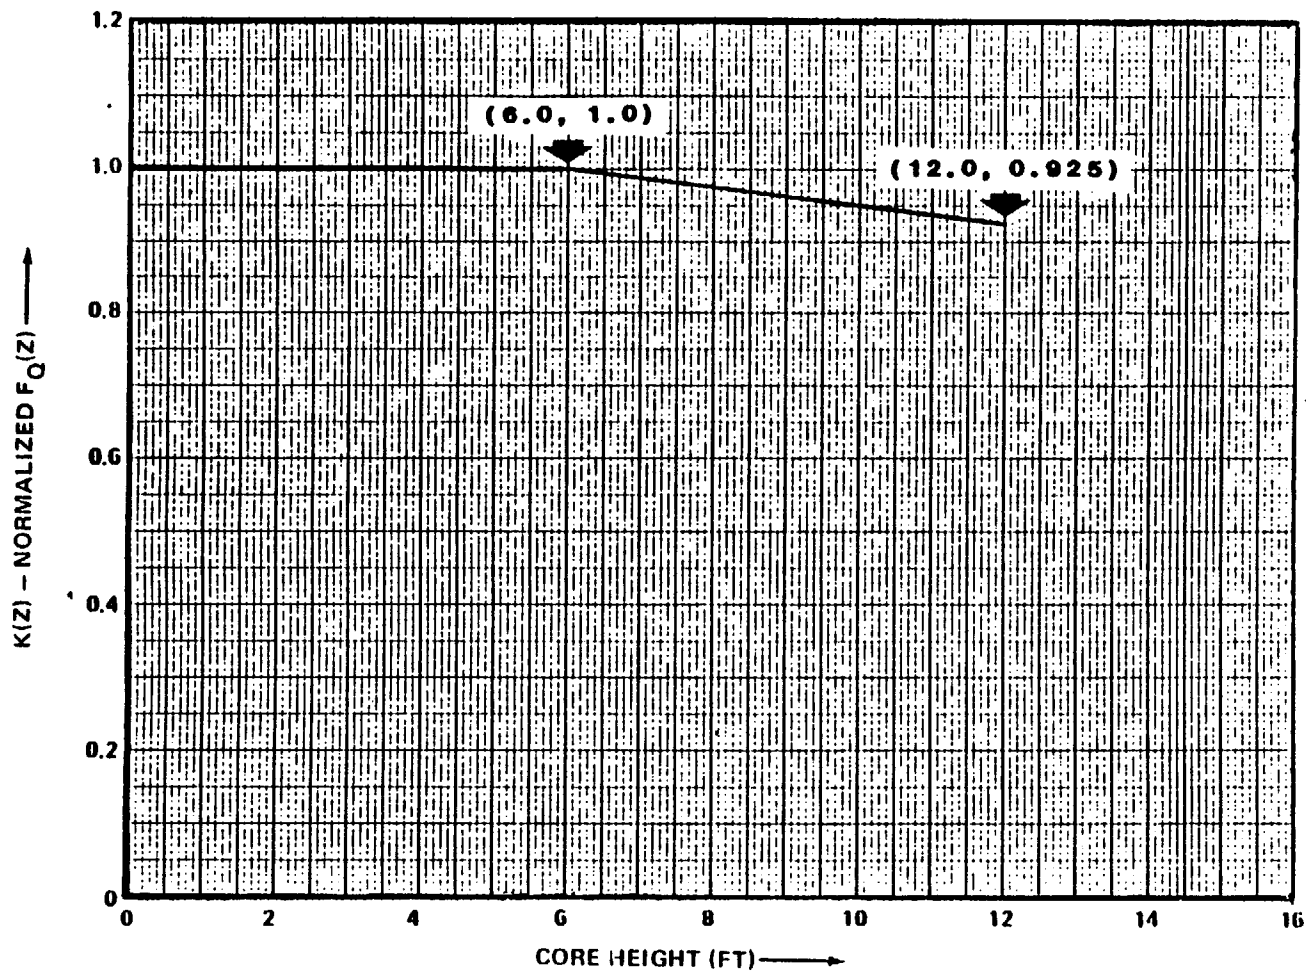


FIGURE 3.2-2

$K(Z)$ - NORMALIZED $F_Q(Z)$ AS A FUNCTION
OF CORE HEIGHT



UNITED STATES
NUCLEAR REGULATORY COMMISSION
WASHINGTON, D. C. 20555

COMMONWEALTH EDISON COMPANY

DOCKET NO. 50-456

BRAIDWOOD STATION, UNIT 1

AMENDMENT TO FACILITY OPERATING LICENSE

Amendment No. 22
License No. NPF-72

1. The Nuclear Regulatory Commission (the Commission) has found that:
 - A. The application for amendment by Commonwealth Edison Company (the licensee) dated December 4, 1987, complies with the standards and requirements of the Atomic Energy Act of 1954, as amended (the Act) and the Commission's rules and regulations set forth in 10 CFR Chapter I;
 - B. The facility will operate in conformity with the application, the provisions of the Act, and the rules and regulations of the Commission;
 - C. There is reasonable assurance (i) that the activities authorized by this amendment can be conducted without endangering the health and safety of the public, and (ii) that such activities will be conducted in compliance with the Commission's regulations;
 - D. The issuance of this amendment will not be inimical to the common defense and security or to the health and safety of the public; and
 - E. The issuance of this amendment is in accordance with 10 CFR Part 51 of the Commission's regulations and all applicable requirements have been satisfied.
2. Accordingly, the license is amended by changes to the Technical Specifications as indicated in the attachment to this license amendment, and paragraph 2.C.(2) of Facility Operating License No. NPF-72 is hereby amended to read as follows:


(2) Technical Specification

The Technical Specifications contained in Appendix A as revised through Amendment No. 22 and the Environmental Protection Plan contained in Appendix B, both of which are attached hereto, are

hereby incorporated into this license. The licensee shall operate the facility in accordance with the Technical Specifications and the Environmental Protection Plan.

3. This license amendment is effective as of the date of its issuance.

FOR THE NUCLEAR REGULATORY COMMISSION



Paul C. Shemanski, Acting Director
Project Directorate III-2
Division of Reactor Projects - III,
IV, V, and Special Projects
Office of Nuclear Reactor Regulation

Attachment:
Changes to the Technical
Specifications

Date of Issuance: October 4, 1989



UNITED STATES
NUCLEAR REGULATORY COMMISSION
WASHINGTON, D. C. 20555

COMMONWEALTH EDISON COMPANY

DOCKET NO. 50-457

BRAIDWOOD STATION, UNIT 2

AMENDMENT TO FACILITY OPERATING LICENSE

Amendment No. 22
License No. NPF-77

1. The Nuclear Regulatory Commission (the Commission) has found that:
 - A. The application for amendment by Commonwealth Edison Company (the licensee) dated December 4, 1987, complies with the standards and requirements of the Atomic Energy Act of 1954, as amended (the Act) and the Commission's rules and regulations set forth in 10 CFR Chapter I;
 - B. The facility will operate in conformity with the application, the provisions of the Act, and the rules and regulations of the Commission;
 - C. There is reasonable assurance (i) that the activities authorized by this amendment can be conducted without endangering the health and safety of the public, and (ii) that such activities will be conducted in compliance with the Commission's regulations;
 - D. The issuance of this amendment will not be inimical to the common defense and security or to the health and safety of the public; and
 - E. The issuance of this amendment is in accordance with 10 CFR Part 51 of the Commission's regulations and all applicable requirements have been satisfied.
2. Accordingly, the license is amended by changes to the Technical Specifications as indicated in the attachment to this license amendment, and paragraph 2.C.(2) of Facility Operating License No. NPF-77 is hereby amended to read as follows:


(2) Technical Specification

The Technical Specifications contained in Appendix A as revised through Amendment No. 22 and the Environmental Protection Plan contained in Appendix B, both of which were attached to

License No. NPF-72, dated July 2, 1987, are hereby incorporated into this license. The licensee shall operate the facility in accordance with the Technical Specifications and the Environmental Protection Plan.

3. This license amendment is effective as of the date of its issuance.

FOR THE NUCLEAR REGULATORY COMMISSION



Paul C. Shemanski, Acting Director
Project Directorate III-2
Division of Reactor Projects - III,
IV, V, and Special Projects
Office of Nuclear Reactor Regulation

Attachment:
Changes to the Technical
Specifications

Date of Issuance: October 4, 1989

ATTACHMENT TO LICENSE AMENDMENT NOS. 22 AND 22
AND FACILITY OPERATING LICENSE NOS. NPF-72 AND NPF-77
DOCKET NOS. 50-456 AND 50-457

Revise Appendix A as follows:

REMOVE

3/4 2-5

INSERT

3/4 2-5

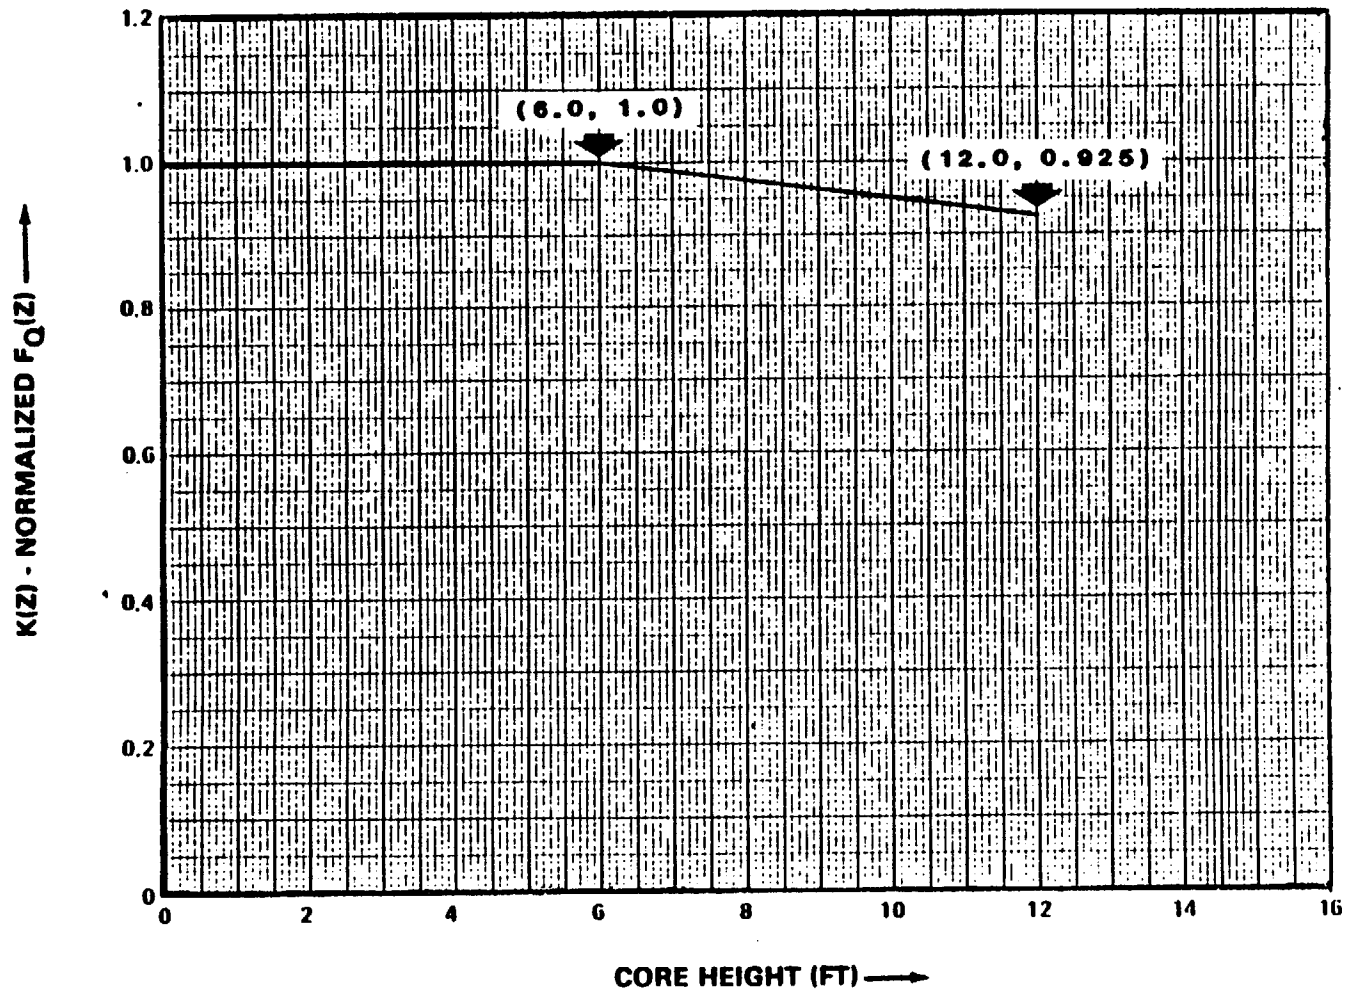


FIGURE 3.2-2
 $K(Z) - \text{NORMALIZED } F_Q(Z)$ AS A FUNCTION
OF CORE HEIGHT



UNITED STATES
NUCLEAR REGULATORY COMMISSION
WASHINGTON, D. C. 20555

SAFETY EVALYATION BY THE OFFICE OF NUCLEAR REACTOR REGULATION
RELATED TO AMENDMENT NO. 34 TO FACILITY OPERATING LICENSE NO. NPF-37,
AMENDMENT NO. 34 TO FACILITY OPERATING LICENSE NO. NPF-66,
AMENDMENT NO. 22 TO FACILITY OPERATING LICENSE NO. NPF-72,
AND AMENDMENT NO. 22 TO FACILITY OPERATING LICENSE NO. NPF-77
COMMONWEALTH EDISON COMPANY
BYRON STATION, UNITS 1 AND 2
BRAIDWOOD STATION, UNITS 1 AND 2
DOCKET NOS. 50-454, 50-455, 50-456, AND 50-457

1.0 INTRODUCTION

By letter dated December 4, 1987 (Ref. 1), the Commonwealth Edison Company (CECo), the licensee, requested a modification to Figure 3.2-2 in the Technical Specifications for the Byron/Braidwood power stations. Additional information was submitted on October 26, 1988 (Ref. 2). Figure 3.2-2 (known as the $K(z)$ curve) represents the normalized heat flux hot channel factor as a function of core height. The modification was proposed after a reanalysis of the small break loss of coolant accident, which was performed as part of the licensee's T_{hot} reduction program.

The T_{hot} reduction program was being performed under the provisions of 10 CFR 50.59 and is a program to reduce the primary system vessel outlet temperature (T_{hot}) from 618.4°F to 600°F, a reduction of 18.4°F from the original design. The purpose of this reduction is to reduce the potential for initiation and propagation of primary water stress corrosion cracking in the steam generators for the Byron/Braidwood Stations, Units 1 and 2.

The $K(z)$ curve has three distinct segments which define the limits for $K(z)$ at various core axial positions. The third segment is that portion at the higher core locations defined by the points (10.8, 0.94) and (12.0, 0.65). This portion represents the limiting $K(z)$ values assumed in the small break loss of coolant accident (SBLOCA).

During a postulated SBLOCA, only the higher elevations can potentially become uncovered. The appropriate value of $K(z)$ is used to calculate local hot rod power at a particular core elevation. This in turn determines the location of peak cladding temperature (PCT) during the postulated SBLOCA event. CECO performed a new analysis at the limiting condition. This made it possible to eliminate the third line segment. Greater heat flux values could then be obtained at higher axial positions and the limits on the core design for hot channel factors could be relaxed.

The CECO amendment request proposed to eliminate the third line segment and, in place, extend the segment defined by the points (6.0, 1.0) and (10.8, 0.94) to the 12 foot core elevation, which defined a new point (12.0, 0.925) as shown on the attached Figure 3.2-2. CECO provided a description of the analyses supporting their amendment for change of Figure 3.2-2.

In Reference 1, Attachment B, revised marked-up pages of Chapter 15.6.5 of the Byron/Braidwood FSAR were provided as background information (proprietary report, WCAP-11386, Revision 2 (Ref. 3)). The staff reviewed brief sections in WCAP-11386 pertaining to the change requested for Figure 3.2-2 in the Technical Specifications.

2.0 EVALUATION

In the large break loss of coolant accident (LBLOCA) and SBLOCA reanalysis the approved NOTRUMP (Ref. 4) and BASH (Ref. 5) computer codes were used respectively. The following parameters were revised as indicated below in the new analysis:

	<u>Original</u>	<u>Revised</u>
Total Peaking Factor (F_Q)	2.32	2.40
Enthalpy Rise Peaking Factor (F_H)	1.55	1.62
Steam Generator Tube Plugging (uniform)	0%	10%
Safety Injection Flow	-	5% reduction
$K(z)$ curve	-	eliminate third line segment

The increase in F_Q and F_H were only addressed in the LOCA analysis.

In response to a request for additional information relating to Figure 3.2-2, the $K(z)$ curve, CECO submitted a letter dated October 26, 1988 (Ref. 2) describing the methodology of the hot rod power shape for the large and small break LOCA to satisfy the requirements of 10 CFR 50.46, Appendix A. The licensee stated that the representative small break shape in the NRC approved WCAP-9500-A was used as well as additional criteria regarding power distribution mechanisms which govern peak clad temperature for the small break. CECO also provided a revised figure to show the correct hot rod power shape for the SBLOCA. For the LBLOCA, the licensee stated that Westinghouse had demonstrated that the most limiting power shape was being used in the 1981 evaluation model using the BASH large break LOCA analyses. Studies, as presented in Revision 1 of Addendum 1 to WCAP-10266-P-A, Revision 2, for F_Q peaking factors equal to

2.32 and 2.50 showed the chopped cosine power shape to be the most limiting. CECO stated that the chopped cosine power shape was used in the analysis for Byron/Braidwood and that the peaking factor used was 2.40, which is bounded by the above studies reported in WCAP-10266-P-A. Since the peaking factor is bounded by the previous studies, it is acceptable. However, the Technical Specifications will retain the current overall LOCA peaking factor (F_0) of 2.32 until all of the pertinent FSAR non-LOCA analyses have been repeated at the higher F_0 value of 2.40.

The staff had requested that the licensee provide a new figure similar to their revised Figure 3.2-2 with the results of the analysis imposed for the power shape. This was to include curves of linear heat generation rate (KW/ft) versus elevation (ft) including core average and hot rod values and the $K(z)$ limit for the SBLOCA. CECO submitted such a figure (Ref. 3) which provided a means to observe if the submitted Figure 3.2-2 $K(z)$ was supported by the results of the analysis. The staff found the modified Figure 3.2-2 $K(z)$ curve to be in agreement with the results of the analysis.

The results of the large and small break LOCA as shown in Tables 15.6-3 and 15.6-4 Reference 2 indicated that the maximum peak fuel element clad temperatures were 1754°F and 1630°F, respectively. This is well within the 2200°F limit specified in 10 CFR 50.46. Also, the total Zr/H₂O reactor was less than 0.3 percent for both the large and small break LOCA which is less than the 1 percent limit specified in 10 CFR 50.46.

3.0 CONCLUSIONS FOR MODIFICATION OF FIGURE 3.2-2

The staff has found the modification made to the Figure 3.2-2 $K(z)$ curve to be acceptable since the analyses on which it is based used acceptable codes, and the results of these analyses meet the criteria of 10 CFR 50.46:

(1) The calculated peak fuel element clad temperature is below 2200°F; (2) the amount of fuel element cladding that reacts chemically with water or steam does not exceed 1 percent of the total amount of zircaloy in the reactor; (3) the total oxidation of the cladding does not exceed 17 percent of the total cladding thickness before oxidation; (4) the core remains amenable to cooling during and after the break; (5) the core temperature is reduced and decay heat is removed for the extended period of time required by the long-lived radioactivity remaining in the core.

4.0 TECHNICAL SPECIFICATIONS

The Technical Specifications were changed as follows:

Figure 3.2-2, $K(z)$ -normalized $F_0(Z)$ is a function of core height, was modified for both the Byron and Braidwood plants. The third line segment was eliminated. In place of the third line segment, the segment defined by the points (6.0, 1.0) and (10.8, 0.94) was extended to the 12 foot elevation, defined by the new point (12.0, 0.925) as shown on the attached figure. The modification was found to be acceptable as explained in Sections 2.0 and 3.0.

5.0 ENVIRONMENTAL CONSIDERATION

Pursuant to 10 CFR 51.32, an environmental assessment and finding of no significant impact have been prepared and published (54 FR 40547) in the Federal Register on October 2, 1989. Accordingly, based upon the environmental assessment, the Commission has determined that the issuance of this amendment will not have a significant effect on the quality of the human environment.

6.0 CONCLUSION

The staff has concluded, based on the considerations discussed above, that: (1) there is reasonable assurance that the health and safety of the public will not be endangered by operation in the proposed manner, and (2) such activities will be conducted in compliance with the Commission's regulations and the issuance of these amendments will not be inimical to the common defense and security or to the health and safety of the public.

7.0 REFERENCES

1. Letter from K. A. Ainger, Commonwealth Edison Company (CECo) to NRC, dated December 4, 1987.
2. Letter from R. A. Chrzanowski, CECo to T. E. Murley, NRC, dated October 26, 1988.
3. WCAP-11386, Revision 2, "Byron/Braidwood T_{hot} Reduction Final Licensing Report," dated November 1987.
4. Meyer, P. E., NOTRUMP, A Nodal Transient Small Break General Network Code, WCAP-10079-P-A, August 1985 (Proprietary).
5. Kabadi, J. N., et al., "The 1981 Version of the Westinghouse ECCS Evaluation Model Using the BASH Code," WCAP-10266, Revision 2, with addenda (Proprietary), August 1986.

Principal Contributor: H. Balukjian

Dated: October 4, 1989

October 4, 1989

Docket Nos. 50-454, 50-455
and 50-456, 50-457

Mr. Thomas J. Kovach
Nuclear Licensing Manager
Commonwealth Edison Company
Post Office Box 767
Chicago, Illinois 60690

Dear Mr. Kovach:

DISTRIBUTION:
Docket Files
NRC/Local PDRs
PD32 Reading
PShemanski(A)
MJVirgilio
LLuther
LOlshan
SSands
OGC (WF)

DHagan
PD32 Plant File
ARM/LFMB
TMeek (16)
WJones
JCalvo
EJordan
HBalukjian
ACRS (10)
GPA/PA

The Commission has issued the enclosed Amendment No. 34 to Facility Operating License No. NPF-37 and Amendment No. 34 to Facility Operating License No. NPF-66 for the Byron Station, Unit Nos. 1 and 2, respectively and Amendment No. 22 to Facility Operating License No. NPF-72, and Amendment No. 22 to Facility Operating License No. NPF-77 for Braidwood Station, Units Nos. 1 and 2, respectively. The amendments consist of changes to the Technical Specifications in response to your application transmitted by letter dated December 4, 1987.

These amendments approve changes to Technical Specification Figure 3.2-2 which depicts the normalized heat flux hot channel factor as a function of core height.

A copy of the related Safety Evaluation is enclosed. A Notice of Issuance will be filed with the Office of the Federal Register for publication.

Sincerely,

Stephen P. Sands, Project Manager
Project Directorate III-2
Division of Reactor Projects - III,
IV, V, and Special Projects
Office of Nuclear Reactor Regulation

Leonard N. Olshan, Project Manager
Project Directorate III-2
Division of Reactor Projects - III,
IV, V, and Special Projects
Office of Nuclear Reactor Regulation

Enclosures:

1. Amendment No. 34 to NPF-37
2. Amendment No. 34 to NPF-66
3. Amendment No. 22 to NPF-72
4. Amendment No. 22 to NPF-77
5. Safety Evaluation

cc w/enclosures:
See next page

[BYRON/BRAIDWOOD AMEND]
LA:PD32 PM:PD32
LLuther LOlshan:sam
9/8/1/89 8/30/89
OFFICIAL RECORD COPY

SPS
PM:PD32
SSands
9/11/89

OGC/Myung
9/9/89
P.S.
(A)D:PD32
PCShemanski
9/5/89