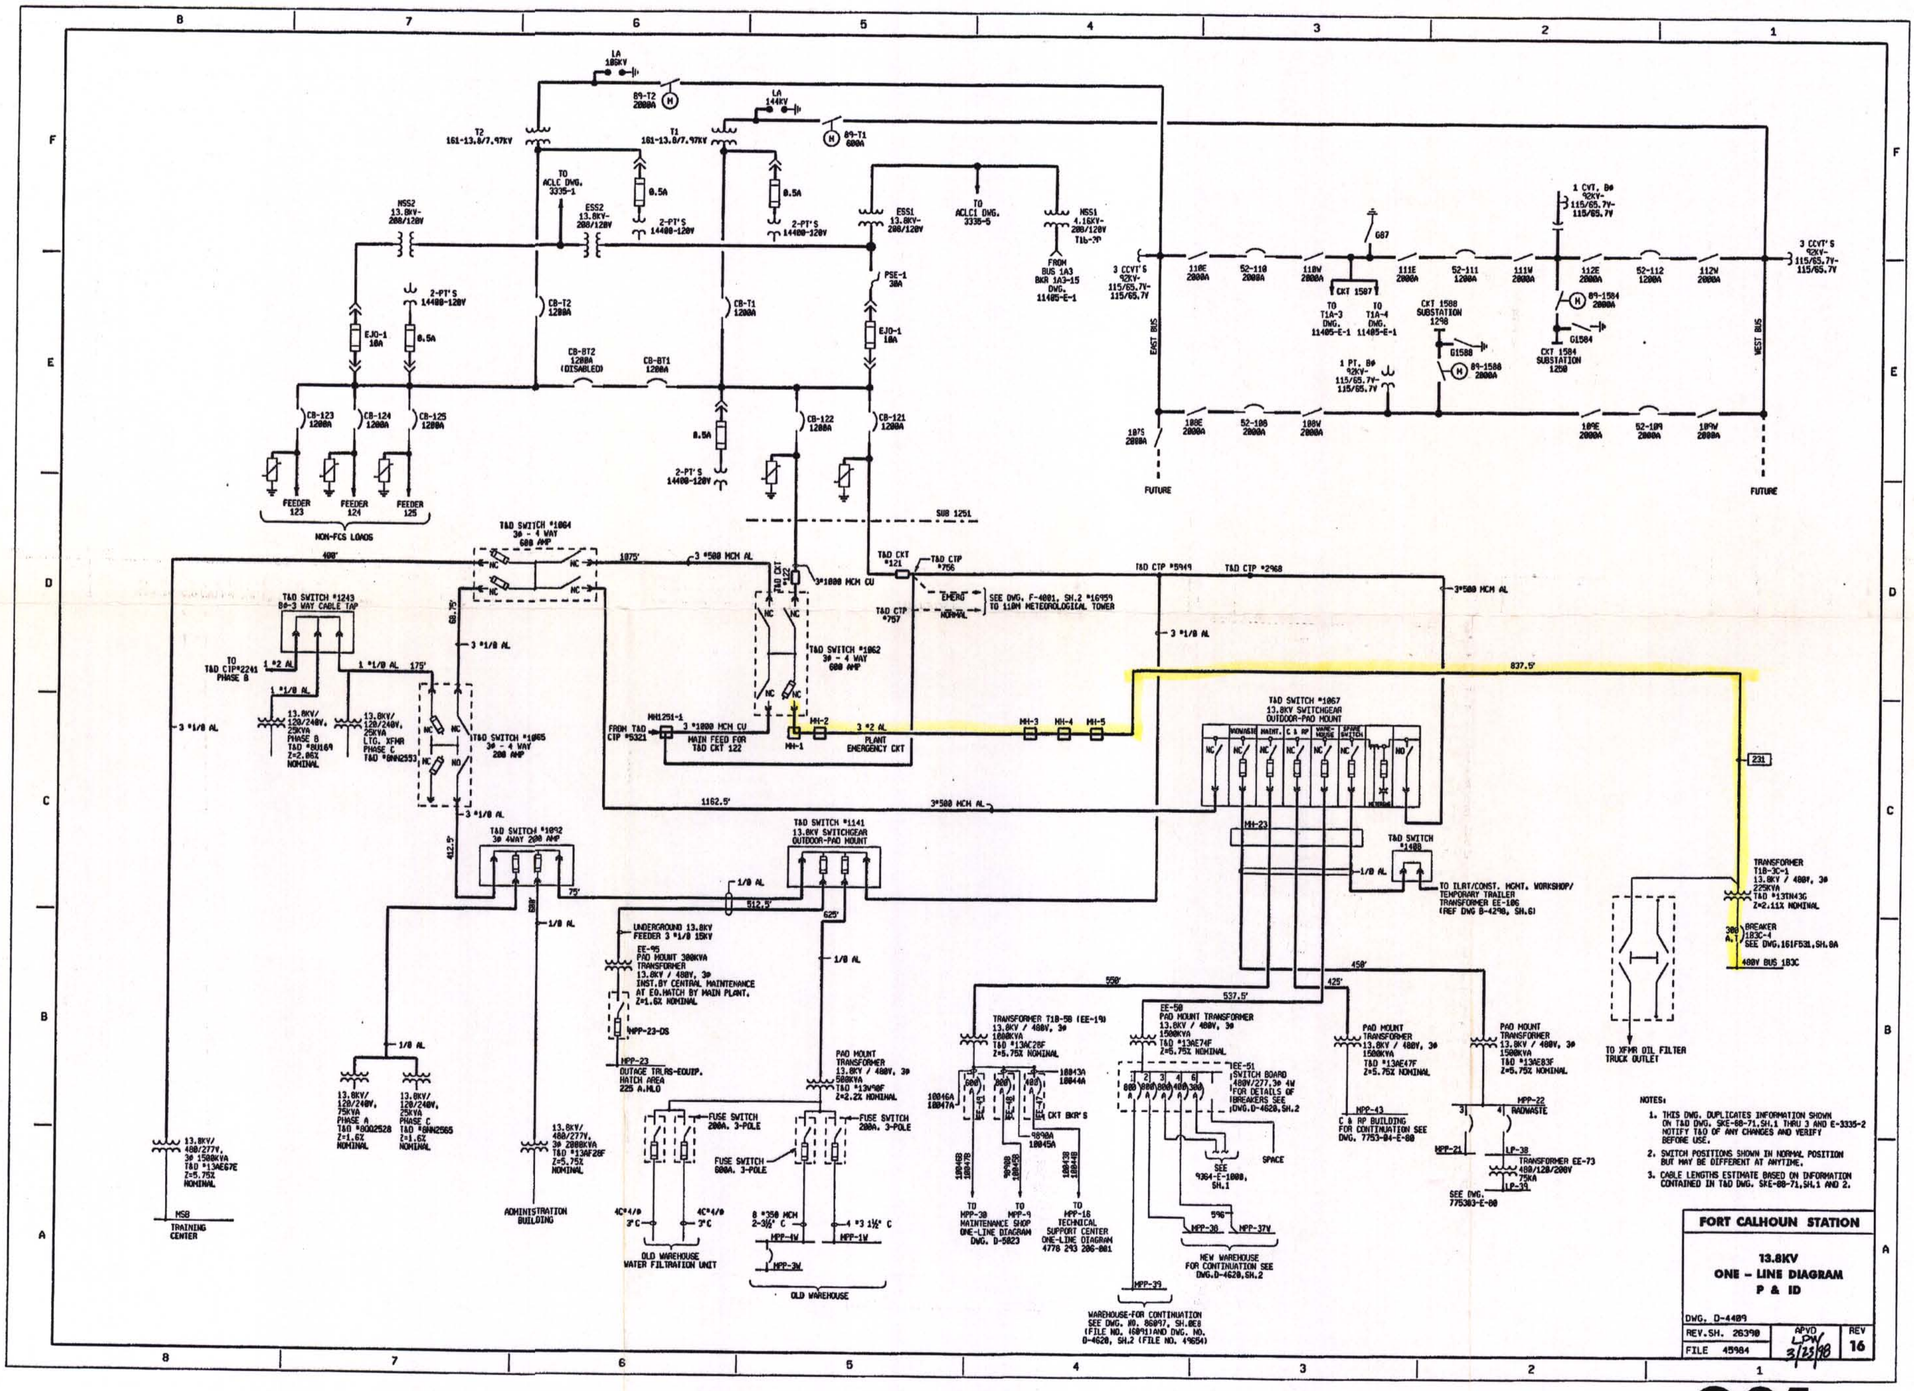
FORT CALHOUN STATION
13.8KV
ONE - LINE DIAGRAM
P & ID
DWG. D-4409
REV.SH. 26398
FILE 45984
APVD LPW 3/23/90
REV 16
NOTES:
1. THIS DWG. DUPLICATES INFORMATION SHOWN ON T&D DWG. SKE-88-71,SH.1 THRU 3 AND E-3335-2 NOTIFY T&D OF ANY CHANGES AND VERIFY BEFORE USE.
2. SWITCH POSITIONS SHOWN IN NORMAL POSITION BUT MAY BE DIFFERENT AT ANYTIME.
3. CABLE LENGTHS ESTIMATE BASED ON INFORMATION CONTAINED IN T&D DWG. SKE-88-71,SH.1 AND 2.
EAST BUS
WEST BUS
FUTURE
NON-FCS LOADS
FEEDER 123
FEEDER 124
FEEDER 125
SUB 125L
MAIN FEED FOR T&D CKT 122
PLANT EMERGENCY CKT
TRAINING CENTER
ADMINISTRATION BUILDING
OLD WAREHOUSE WATER FILTRATION UNIT
OLD WAREHOUSE
NEW WAREHOUSE FOR CONTINUATION SEE DWG.D-4620,SH.2
TO ILRT/CONST. MGMT. WORKSHOP/ TEMPORARY TRAILER TRANSFORMER EE-18G (REF DWG D-4290, SH.6)
TO XFMR OIL FILTER TRUCK OUTLET
400V BUS 183C

201

D-1