

Decht


DISTRIBUTION: TERA-4
Docket File-4 NSIC
NRC PDR ORB#2 Rdg
L PDR DEisenhut

SNorris
RBevan
PO'Connor
OELD
IE-5
GDeegan-16
BScharf-10
JWetmore
ACRS=10
CMiles
RDiggs
Chairman, ASLAB
DCrutchfield
Gray File +4
HSmith

Dockets Nos. 50-237, 50-249,
50-254 and 50-265

MAR 27 1981

Mr. J. S. Abel
Director of Nuclear Licensing
Commonwealth Edison Company
P. O. Box 767
Chicago, Illinois 60690

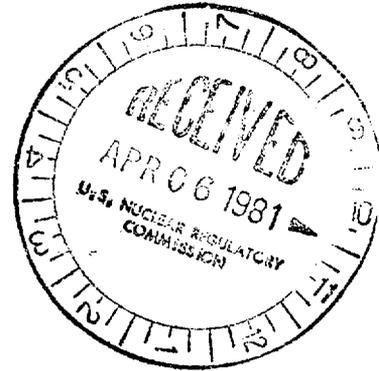

Dear Mr. Abel:

The Commission has issued Amendment No. 57 to Provisional Operating License DPR-19 and Amendments Nos. 50, 65, and 59 to Facility Operating Licenses Nos. DPR-25, DPR-29 and DPR-30 for Dresden Station Units 2 and 3 and Quad Cities Station Units 1 and 2, respectively. The amendments are in response to your request of May 22, 1978.

The amendments revise the Technical Specifications to increase the sump flow monitoring surveillance frequency from once per day to once per eight hour shift.

Copies of the Safety Evaluation and Notice of Issuance are also enclosed.

Sincerely,

Original Signed by
T. A. Ippolito

Thomas A. Ippolito, Chief
Operating Reactors Branch #2
Division of Licensing

Enclosures:

1. Amendment No. 57 to DPR-19
2. Amendment No. 50 to DPR-25
3. Amendment No. 65 to DRR-29
4. Amendment No. 59 to DPR-30
5. Safety Evaluation
6. Notice

cc w/enclosures:
See next page

P

8104130458

PwD

OFFICE:	ORB#2:DL	ORB#2:DL	AD-OR:DL	OELD	C-ORB#2:DL	ORB#5	BCORRES
SURNAME:	S. J. P. S.	RBevan:cb	TNovak	<i>Koslov</i>	Tippolito	P. O'Connor	D Crutchfield
DATE:	3/18/81	3/18/81	3/19/81	3/25/81	3/19/81	3/19/81	3/19/81



UNITED STATES
NUCLEAR REGULATORY COMMISSION
WASHINGTON, D. C. 20555

March 27, 1981

Dockets Nos. 50-237, 50-249,
50-254 and 50-265

Mr. J. S. Abel
Director of Nuclear Licensing
Commonwealth Edison Company
P. O. Box 767
Chicago, Illinois 60690


Dear Mr. Abel:

The Commission has issued Amendment No. 57 to Provisional Operating License DPR-19 and Amendments Nos. 50, 65, and 59 to Facility Operating Licenses Nos. DPR-25, DPR-29 and DPR-30 for Dresden Station Units 2 and 3 and Quad Cities Station Units 1 and 2, respectively. The amendments are in response to your request of May 22, 1978.

The amendments revise the Technical Specifications to increase the sump flow monitoring surveillance frequency from once per day to once per eight hour shift.

Copies of the Safety Evaluation and Notice of Issuance are also enclosed.

Sincerely,


Thomas A. Ippolito, Chief
Operating Reactors Branch #2
Division of Licensing

Enclosures:

1. Amendment No. 57 to DPR-19
2. Amendment No. 50 to DPR-25
3. Amendment No. 65 to DPR-29
4. Amendment No. 59 to DPR-30
5. Safety Evaluation
6. Notice

cc w/enclosures:
See next page

8104130458

MAR 3 1981

Mr. J. S. Abel
Commonwealth Edison Company

cc:

Mr. D. R. Stichnoth
President
Iowa-Illinois Gas and
Electric Company
206 East Second Avenue
Davenport, Iowa 52801

Mr. John W. Rowe
Isam, Lincoln & Beale
Counselors at Law
One First National Plaza, 42nd Floor
Chicago, Illinois 60603

Mr. Nick Kalivianakas
Plant Superintendent
Quad Cities Nuclear Power Station
22710 - 206th Avenue - North
Cordova, Illinois 61242

Moline Public Library
304 - 17th Street
Moline, Illinois 61265

Susan K. Sekuler
Assistant Attorney General
Environmental Control Division
788 W. Randolph Street
Suite 2315
Chicago, Illinois 60601

Resident Inspector
U. S. Nuclear Regulatory Commission
22712 206th Avenue N.
Cordova, Illinois 61242

John F. Wolf, Esq.
3409 Shepherd Street
Crevy Chase, Maryland 20015

Dr. Linda W. Little
510 Hermitage Drive
Raleigh, North Carolina 27612

Dr. Forrest J. Remick
315 East Hamilton Avenue
State College, Pennsylvania 16801

Mr. William Waters
Chairman, Board of Supervisors
of Grundy County
Grundy County Courthouse
Morris, Illinois 60450

Mr. B. B. Stephenson
Plant Superintendent
Dresden Nuclear Power Station
Rural Route #1
Morris, Illinois 60450

Morris Public Library
604 Liberty Street
Morris, Illinois 60451

U. S. Nuclear Regulatory Commission
Resident Inspector's Office
Dresden Station
RR #1
Morris, Illinois 60450

Director, Standards and Criteria Division
Office of Radiation Program (ANR-460)
U.S. Environmental Protection Agency
Washington, D. C. 20460

U.S. Environmental Protection Agency
Federal Activities Branch
Region V Office
EIS Coordinator
230 South Dearborn Street
Chicago, Illinois 60604

Illinois Department of Nuclear Safety
1035 Outer Park Drive
5th Floor
Springfield, Illinois 62704

Mr. Marcel DeJaegher, Chairman
Rock Island County Board
of Supervisors
Rock Island County Court House
Rock Island, Illinois 61201



UNITED STATES
NUCLEAR REGULATORY COMMISSION
WASHINGTON, D. C. 20555

COMMONWEALTH EDISON COMPANY

DOCKET NO. 50-237

DRESDEN STATION UNIT NO. 2

AMENDMENT TO PROVISIONAL OPERATING LICENSE

Amendment No. 57
License No. DPR-19

1. The Nuclear Regulatory Commission (the Commission) has found that:
 - A. The application for amendment by Commonwealth Edison Company (the licensee) dated May 22, 1978, complies with the standards and requirements of the Atomic Energy Act of 1954, as amended (the Act), and the Commission's rules and regulations set forth in 10 CFR Chapter I;
 - B. The facility will operate in conformity with the application, the provisions of the Act, and the rules and regulations of the Commission;
 - C. There is reasonable assurance (i) that the activities authorized by this amendment can be conducted without endangering the health and safety of the public, and (ii) that such activities will be conducted in compliance with the Commission's regulations;
 - D. The issuance of this amendment will not be inimical to the common defense and security or to the health and safety of the public; and
 - E. The issuance of this amendment is in accordance with 10 CFR Part 51 of the Commission's regulations and all applicable requirements have been satisfied.

8104130 465

2. Accordingly, the license is amended by changes to the Technical Specifications as indicated in the attachment to this license amendment and Paragraph 3.B of Provisional Operating License No. DPR-19 is hereby amended to read as follows:

B. Technical Specifications

The Technical Specifications contained in Appendix A, as revised through Amendment No. 57, are hereby incorporated in the license. The licensee shall operate the facility in accordance with the Technical Specifications.

3. This license amendment is effective as of the date of its issuance.

FOR THE NUCLEAR REGULATORY COMMISSION


Dennis M. Crutchfield, Chief
Operating Reactors Branch #5
Division of Licensing

Attachment:
Changes to the Technical
Specifications

Date of Issuance: March 27, 1981

ATTACHMENT TO LICENSE AMENDMENT NO. 57
PROVISIONAL OPERATING LICENSE NO. DPR-19
DOCKET NO. 50-237

Revise the Appendix "A" Technical Specifications by removing Page 89 and replacing it with the attached revised Page 89.

3.6 LIMITING CONDITION FOR OPERATION

2. The reactor coolant water shall not exceed the following limits with steaming rates less than 100,000 pounds per hour except as specified in 3.6.C.3:

Conductivity	2 μ mho/cm
Chloride ion	0.1 ppm

3. For reactor startups the maximum value for conductivity shall not exceed 10 μ mho/cm and the maximum value for chloride ion concentration shall not exceed 0.1 ppm, for the first 24 hours after placing the reactor in the power operating condition.

4. Except as specified in 3.6.C.3 above, the reactor coolant water shall not exceed the following limits with steaming rates greater than or equal to 100,000 pounds per hour.

Conductivity	5 μ mho/cm
Chloride ion	0.5 ppm

5. If Specification 3.6.C.1, 3.6.C.2, 3.6.C.3 or 3.6.C.4 is not met, an orderly shutdown shall be initiated.

D. Coolant Leakage

Any time irradiated fuel is in the reactor vessel and reactor coolant temperature is above 212°F, reactor coolant leakage into the primary containment from unidentified sources shall not exceed 5 gpm. In addition, the total reactor coolant system leakage into the primary containment shall not exceed 20 gpm. If these conditions cannot be met,

4.6 SURVEILLANCE REQUIREMENT

2. During startups and at steaming rates below 100,000 pounds per hour, a sample of reactor coolant shall be taken every four hours and analyzed for conductivity and chloride content.

3. a. With steaming rates greater than or equal to 100,000 pounds per hour, a reactor coolant sample shall be taken at least every 96 hours and when the continuous conductivity monitors indicate abnormal conductivity (other than short-term spikes), and analyzed for conductivity and chloride ion content.

- b. When the continuous conductivity monitor is inoperable, a reactor coolant sample should be taken at least daily and analyzed for conductivity and chloride ion content.

D. Coolant Leakage

Reactor coolant system leakage shall be checked by the sump and air sampling system. Sump flow monitoring and recording shall be performed once per shift. Air sampling shall be performed once per day.



UNITED STATES
NUCLEAR REGULATORY COMMISSION
WASHINGTON, D. C. 20555

COMMONWEALTH EDISON COMPANY

DOCKET NO. 50-249

DRESDEN STATION UNIT NO. 3

AMENDMENT TO FACILITY OPERATING LICENSE

Amendment No. 50
License No. DPR-25

1. The Nuclear Regulatory Commission (the Commission) has found that:
 - A. The application for amendment by Commonwealth Edison Company (the licensee) dated May 22, 1978, complies with the standards and requirements of the Atomic Energy Act of 1954, as amended (the Act), and the Commission's rules and regulations set forth in 10 CFR Chapter I;
 - B. The facility will operate in conformity with the application, the provisions of the Act, and the rules and regulations of the Commission;
 - C. There is reasonable assurance (i) that the activities authorized by this amendment can be conducted without endangering the health and safety of the public, and (ii) that such activities will be conducted in compliance with the Commission's regulations;
 - D. The issuance of this amendment will not be inimical to the common defense and security or to the health and safety of the public; and
 - E. The issuance of this amendment is in accordance with 10 CFR Part 51 of the Commission's regulations and all applicable requirements have been satisfied.

2. Accordingly, the license is amended by changes to the Technical Specifications as indicated in the attachment to this license amendment and Paragraph 3.B of Facility Operating License No. DPR-25 is hereby amended to read as follows:

B. Technical Specifications

The Technical Specifications contained in Appendix A, as revised through Amendment No. 50, are hereby incorporated in the license. The licensee shall operate the facility in accordance with the Technical Specifications.

3. This license amendment is effective as of the date of its issuance.

FOR THE NUCLEAR REGULATORY COMMISSION



Thomas A. Ippolito, Chief
Operating Reactors Branch #2
Division of Licensing

Attachment:
Changes to the Technical
Specifications

Date of Issuance: March 27, 1981

ATTACHMENT TO LICENSE AMENDMENT NO. 50

FACILITY OPERATING LICENSE NO. DPR-25

DOCKET NO. 50-249

Revise the Appendix "A" Technical Specifications by removing Page 89 and replacing it with the attached revised Page 89.

3.6 LIMITING CONDITION FOR OPERATION

2. The reactor coolant water shall not exceed the following limits with steaming rates less than 100,000 pounds per hour except as specified in 3.6.C.3:

Conductivity	2 μ mho/cm
Chloride ion	0.1 ppm

3. For reactor startups the maximum value for conductivity shall not exceed 10 μ mho/cm and the maximum value for chloride ion concentration shall not exceed 0.1 ppm, for the first 24 hours after placing the reactor in the power operating condition.

4. Except as specified in 3.6.C.3 above, the reactor coolant water shall not exceed the following limits with steaming rates greater than or equal to 100,000 pounds per hour.

Conductivity	5 μ mho/cm
Chloride ion	0.5 ppm

5. If Specification 3.6.C.1, 3.6.C.2, 3.6.C.3 or 3.6.C.4 is not met, an orderly shutdown shall be initiated.

D. Coolant Leakage

Any time irradiated fuel is in the reactor vessel and reactor coolant temperature is above 212°F, reactor coolant leakage into the primary containment from unidentified sources shall not exceed 5 gpm. In addition, the total reactor coolant system leakage into the primary containment shall not exceed 20 gpm. If these conditions cannot be met,

4.6 SURVEILLANCE REQUIREMENT

2. During startups and at steaming rates below 100,000 pounds per hour, a sample of reactor coolant shall be taken every four hours and analyzed for conductivity and chloride content.

3. a. With steaming rates greater than or equal to 100,000 pounds per hour, a reactor coolant sample shall be taken at least every 96 hours and when the continuous conductivity monitors indicate abnormal conductivity (other than short-term spikes) and analyzed for conductivity and chloride ion content.

- b. When the continuous conductivity monitor is inoperable, a reactor coolant sample should be taken at least daily and analyzed for conductivity and chloride ion content.

D. Coolant Leakage

Reactor coolant system leakage shall be checked by the sump and air sampling system. Sump flow monitoring and recording shall be performed once per shift. Air sampling shall be performed once per day.



UNITED STATES
NUCLEAR REGULATORY COMMISSION
WASHINGTON, D. C. 20555

COMMONWEALTH EDISON COMPANY
AND
IOWA ILLINOIS GAS AND ELECTRIC COMPANY

DOCKET NO. 50-265

QUAD CITIES STATION UNIT NO. 1

AMENDMENT TO FACILITY OPERATING LICENSE

Amendment No. 65
License No. DPR-29

1. The Nuclear Regulatory Commission (the Commission) has found that:
 - A. The application for amendment by Commonwealth Edison Company (the licensee) dated May 22, 1978, complies with the standards and requirements of the Atomic Energy Act of 1954, as amended (the Act) and the Commission's rules and regulations set forth in 10 CFR Chapter I;
 - B. The facility will operate in conformity with the application, the provisions of the Act, and the rules and regulations of the Commission;
 - C. There is reasonable assurance (i) that the activities authorized by this amendment can be conducted without endangering the health and safety of the public, and (ii) that such activities will be conducted in compliance with the Commission's regulations;
 - D. The issuance of this amendment will not be inimical to the common defense and security or to the health and safety of the public; and
 - E. The issuance of this amendment is in accordance with 10 CFR Part 51 of the Commission's regulations and all applicable requirements have been satisfied.
2. Accordingly, the license is amended by changes to the Technical Specifications as indicated in the attachment to this license amendment and paragraph 3.B of Facility License No. DPR-29 is hereby amended to read as follows:

B. Technical Specifications

The Technical Specifications contained in Appendices A and B, as revised through Amendment No.65, are hereby incorporated in the license. The licensee shall operate the facility in accordance with the Technical Specifications.

3. This license amendment is effective as of the date of its issuance.

FOR THE NUCLEAR REGULATORY COMMISSION



Thomas A. Ippolito, Chief
Operating Reactors Branch #2
Division of Licensing

Attachment:
Changes to the Technical
Specifications

Date of Issuance: March 27, 1981

ATTACHMENT TO LICENSE AMENDMENT NO. 65

FACILITY OPERATING LICENSE NO. DPR-29

DOCKET NO. 50-254

Revise Appendix A Technical Specifications by removing page 3.6/4.6-3 and replacing with the enclosed page.

QUAD-CITIES
DPR-29

2. The reactor coolant water shall not exceed the following limits with steaming rates less than 100,000 lb/hr except as specified in Specification 3.6.C.3:

conductivity 2 μ mho/cm

chloride ion 0.1 ppm

3. For reactor startups, the maximum value for conductivity shall not exceed 10 μ mho/cm, and the maximum value for chloride ion concentration shall not exceed 0.1 ppm for the first 24 hours after placing the reactor in the power operating condition.
4. Except as specified in Specification 3.6.C.3 above, the reactor coolant water shall not exceed the following limits with steaming rates greater than or equal to 100,000 lb/hr:
conductivity 10 μ mho/cm
chloride ion 1.0 ppm
5. If Specification 3.6.C.1, 3.6.C.2, 3.6.C.3, or 3.6.C.4 is not met, an orderly shutdown shall be initiated.

D. Coolant Leakage

1. Any time irradiated fuel is in the reactor vessel and reactor coolant temperature is above 212° F, reactor coolant leakage into the primary containment from unidentified sources shall not exceed 5 gpm. In addition, the total reactor coolant system leakage into the primary containment shall not exceed 25 gpm.

through I-135.

- d. Whenever the steady-state radioiodine concentration of prior operation is greater than 10% of Specification 3.6.C.1, a sample of reactor coolant shall be taken prior to any reactor startup and analyzed for radioactive iodines of I-131 through I-135 as well as the coolant sample and analyses required by Specification 4.6.C.1.c above.
2. During startups and at steaming rates below 100,000 lb/hr, a sample of reactor coolant shall be taken every 4 hours and analyzed for conductivity and chloride content.
3. a. With steaming rates greater than or equal to 100,000 lb/hr, a reactor coolant sample shall be taken at least every 96 hours and when the continuous conductivity monitors indicate abnormal conductivity (other than short-term spikes) and analyzed for conductivity and chloride ion content.
b. When the continuous conductivity monitor is inoperable, a reactor coolant sample should be taken at least daily and analyzed for conductivity and chloride ion content.

D. Coolant Leakage

Reactor coolant system leakage shall be checked by the sump and air sampling system. Sump flow monitoring and recording shall be performed once per shift. Air sampling shall be performed once per day.



UNITED STATES
NUCLEAR REGULATORY COMMISSION
WASHINGTON, D. C. 20555

COMMONWEALTH EDISON COMPANY
AND
IOWA ILLINOIS GAS AND ELECTRIC COMPANY

DOCKET NO. 50-265

QUAD CITIES STATION UNIT NO.2

AMENDMENT TO FACILITY OPERATING LICENSE

Amendment No. 59
License No. DPR-30

1. The Nuclear Regulatory Commission (the Commission) has found that:
 - A. The application for amendment by Commonwealth Edison Company (the licensee) dated May 22, 1978, complies with the standards and requirements of the Atomic Energy Act of 1954, as amended (the Act) and the Commission's rules and regulations set forth in 10 CFR Chapter I;
 - B. The facility will operate in conformity with the application, the provisions of the Act, and the rules and regulations of the Commission;
 - C. There is reasonable assurance (i) that the activities authorized by this amendment can be conducted without endangering the health and safety of the public, and (ii) that such activities will be conducted in compliance with the Commission's regulations;
 - D. The issuance of this amendment will not be inimical to the common defense and security or to the health and safety of the public; and
 - E. The issuance of this amendment is in accordance with 10 CFR Part 51 of the Commission's regulations and all applicable requirements have been satisfied.
2. Accordingly, the license is amended by changes to the Technical Specifications as indicated in the attachment to this license amendment and paragraph 3.B of Facility License No. DPR-30 is hereby amended to read as follows:

B. Technical Specifications

The Technical Specifications contained in Appendices A and B, as revised through Amendment No. 59, are hereby incorporated in the license. The licensee shall operate the facility in accordance with the Technical Specifications.

3. This license amendment is effective as of the date of its issuance.

FOR THE NUCLEAR REGULATORY COMMISSION



Thomas A. Ippolito, Chief
Operating Reactors Branch #2
Division of Licensing

Attachment:
Changes to the Technical
Specifications

Date of Issuance: March 27, 1981

ATTACHMENT TO LICENSE AMENDMENT NO. 59

FACILITY OPERATING LICENSE NO. DPR-30

DOCKET NO. 50-265

Revise Appendix A Technical Specifications by removing page 3.6/4.6-3 and replacing with the enclosed page.

QUAD-CITIES
DPR-30

- through I-135.
2. The reactor coolant water shall not exceed the following limits with steaming rates less than 100,000 lb/hr except as specified in Specification 3.6.C.3:
conductivity 2 μ mho/cm
chloride ion 0.1 ppm
 3. For reactor startups, the maximum value for conductivity shall not exceed 10 μ mho/cm, and the maximum value for chloride ion concentration shall not exceed 0.1 ppm for the first 24 hours after placing the reactor in the power operating condition.
 4. Except as specified in Specification 3.6.C.3 above, the reactor coolant water shall not exceed the following limits with steaming rates greater than or equal to 100,000 lb/hr:
conductivity 10 μ mho/cm
chloride ion 1.0 ppm
 5. If Specification 3.6.C.1, 3.6.C.2, 3.6.C.3, or 3.6.C.4 is not met, an orderly shutdown shall be initiated.
- d. Whenever the steady-state radioiodine concentration of prior operation is greater than 10% of Specification 3.6.C.1, a sample of reactor coolant shall be taken prior to any reactor startup and analyzed for radioactive iodines of I-131 through I-135 as well as the coolant sample and analyses required by Specification 4.6.C.1.c above.
2. During startups and at steaming rates below 100,000 lb/hr, a sample of reactor coolant shall be taken every 4 hours and analyzed for conductivity and chloride content.
 3. a. With steaming rates greater than or equal to 100,000 lb/hr, a reactor coolant sample shall be taken at least every 96 hours and when the continuous conductivity monitors indicate abnormal conductivity (other than short-term spikes) and analyzed for conductivity and chloride ion content.
b. When the continuous conductivity monitor is inoperable, a reactor coolant sample should be taken at least daily and analyzed for conductivity and chloride ion content.

D. Coolant Leakage

1. Any time irradiated fuel is in the reactor vessel and reactor coolant temperature is above 212° F, reactor coolant leakage into the primary containment from unidentified sources shall not exceed 5 gpm. In addition, the total reactor coolant system leakage into the primary containment shall not exceed 25 gpm.

D. Coolant Leakage

Reactor coolant system leakage shall be checked by the sump and air sampling system. Sump flow monitoring and recording shall be performed once per shift. Air sampling shall be performed once per day.



UNITED STATES
NUCLEAR REGULATORY COMMISSION
WASHINGTON, D. C. 20555

SAFETY EVALUATION BY THE OFFICE OF NUCLEAR REACTOR REGULATION

SUPPORTING AMENDMENT NO. 57 TO PROVISIONAL OPERATING LICENSE NO. DPR-19

AMENDMENT NO. 50 TO FACILITY OPERATING LICENSE NO. DPR-25

AMENDMENT NO. 65 TO FACILITY OPERATING LICENSE NO. DPR-29

AMENDMENT NO. 59 TO FACILITY OPERATING LICENSE NO. DPR-30

COMMONWEALTH EDISON COMPANY

AND

IOWA-ILLINOIS GAS AND ELECTRIC COMPANY

DOCKETS NOS. 50-237, 50-249, 50-254 AND 50-265

Introduction

By letter dated September 15, 1977 we transmitted to Commonwealth Edison Company (CECo) NUREG-0313, "Technical Report on Material Selection and Processing Guidelines for the BWR Coolant Pressure Boundary Piping". We requested that CECo review Dresden Station Unit Nos. 2 and 3 and the Quad Cities Station, Unit Nos. 1 and 2 to determine conformance, and that CECo propose appropriate Technical Specification changes. By letter of February 3, 1978 CECo committed to increasing sump flow monitoring frequency from once per day to once per eight hour shift. By letter of May 22, 1978, CECo proposed Technical Specification changes to require the increased monitoring and recording frequency.

Evaluation

The proposal to increase the surveillance frequency for drywell sump flow monitoring and recording to once per eight hour shift will significantly reduce the period of time during which a leak having a leak rate in excess of a limiting condition for operation might go undetected. The proposed change increases a surveillance requirement, is conservative with respect to the present requirement, and is acceptable.

Environmental Considerations

We have determined that these amendments do not authorize a change in effluent types or total amounts nor an increase in power level and will not result in any significant environmental impact. Having made this determination, we have further concluded that these amendments involve an action which is insignificant from the standpoint of environmental impact and pursuant to 10 CFR §51.5(d)(4) that an environmental impact statement, or negative declaration and environmental impact appraisal need not be prepared in connection with the issuance of these amendments.

8104130 471

Conclusion

We have concluded based on the considerations discussed above, that:
(1) because the amendments do not involve a significant increase in the probability or consequences of accidents previously considered and do not involve a significant decrease in a safety margin, the amendments do not involve a significant hazards considerations (2) there is reasonable assurance that the health and safety of the public will not be endangered by operation in the proposed manner, and (3) such activities will be conducted in compliance with the Commission's regulations and the issuance of these amendments will not be inimical to the common defense and security or to the health and safety of the public.

Dated: March 27, 1981

UNITED STATES NUCLEAR REGULATORY COMMISSIONDOCKET NOS. 50-237, 50-249, 50-254, 50-265COMMONWEALTH EDISON COMPANYANDIOWA-ILLINOIS GAS AND ELECTRIC COMPANYNOTICE OF ISSUANCE OF AMENDMENTS TO
OPERATING LICENSES

The U. S. Nuclear Regulatory Commission (the Commission) has issued Amendment No. 57 to Provisional Operating License No. DPR-19 and Amendment No. 50 to Facility Operating License No. DPR-25, issued to Commonwealth Edison Company, which revised the Technical Specifications for operation of the Dresden Nuclear Power Station, Unit Nos. 2 and 3, respectively, located in Grundy County, Illinois. The Commission has also issued Amendment No. 65 to Operating License DPR-29 and Amendment No. 59 to Facility Operating License No. DPR-30 issued to Commonwealth Edison Company and Iowa-Illinois Gas and Electric Company, which revised the Technical Specifications for operation of the Quad Cities Nuclear Power Station, Unit Nos. 1 and 2, located in Rock Island County, Illinois.

The amendments revise the Technical Specifications to increase the sump flow monitoring surveillance frequency from once per day to once per eight hour shift.

8104130 476

The application for amendments complies with the standards and requirements of the Atomic Energy Act of 1954, as amended (the Act), and the Commission's rules and regulations. The Commission has made appropriate findings as required by the Act and the Commission's rules and regulations in 10 CFR Chapter I, which are set forth in the license amendments. Prior public notice of these amendments was not required since the amendments do not involve a significant hazards consideration.

The Commission has determined that the issuance of these amendments will not result in any significant environmental impact and that pursuant to 10 CFR Section 51.5 (d)(4) an environmental impact statement or negative declaration and environmental impact appraisal need not be prepared in connection with issuance of these amendments.

For further details with respect to this action, see (1) the application for amendments dated May 22, 1978, (2) Amendment No. 57 to Provisional Operating License No. DPR-19, Amendment No. 50 to Facility Operating License No. DPR-30, Amendment No. 65 to Facility Operating License No. DPR-29 and Amendment No. 59 to Facility Operating License No. DPR-25, and (3) the Commission's related Safety Evaluation. All of these items are available for public inspection at the Commission's Public Document Room, 1717 H Street, N. W., Washington, D. C. and at the Morris Public Library, 604 Liberty Street, Morris, Illinois for Dresden 2 and 3, and at the Moline Public Library, 504-17th Street, Moline, Illinois for Quad Cities 1 and 2. A copy of items (2) and (3)

may be obtained upon request addressed to the U. S. Nuclear Regulatory Commission, Washington, D. C. 20555, Attention: Director, Division of Licensing.

Dated at Bethesda, Maryland, this 27th day of March, 1981.

FOR THE NUCLEAR REGULATORY COMMISSION


Thomas A. Ippolito, Chief
Operating Reactors Branch #2
Division of Licensing