

UNITED STATES
NUCLEAR REGULATORY COMMISSION

WASHINGTON, D.C. 20555-0001

TRANSMITTAL OF MEETING HANDOUT MATERIALS FOR
IMMEDIATE PLACEMENT IN THE PUBLIC DOMAIN

This form is to be filled out (typed or hand-printed) by the person who announced the meeting (i.e., the person who issued the meeting notice). The completed form, and the attached copy of meeting handout materials, will be sent to the Document Control Desk on the same day of the meeting; under no circumstances will this be done later than the working day after the meeting.

Do not include proprietary materials.

DATE OF MEETING

03/20/2002

The attached document(s), which was/were handed out in this meeting, is/are to be placed in the public domain as soon as possible. The minutes of the meeting will be issued in the near future. Following are administrative details regarding this meeting:

Docket Number(s)

05000346

Plant/Facility Name

Davis-Besse Nuclear Power Station

TAC Number(s) (if available)

NA

Reference Meeting Notice

March 14, 2002

Purpose of Meeting
(copy from meeting notice)

To discuss current knowledge relating to the recently

identified degradation of the reactor vessel head at the

Davis-Besse Nuclear Power Station

NAME OF PERSON WHO ISSUED MEETING NOTICE

Stephen Sands

TITLE

Project Manager, NRR/DLPM/LPD3

OFFICE

NRR

DIVISION

Division of Licensing Project Management

BRANCH

Project Directorate III

Distribution of this form and attachments:

Docket File/Central File

PUBLIC

DF03



March 20, 2002 Public Meeting

on

Reactor Pressure Vessel Head Degradation

MARCH 20, 2002 PUBLIC MEETING
on
REACTOR PRESSURE VESSEL HEAD DEGRADATION

PURPOSE: To exchange information with stakeholders and respond to questions regarding degradation of the reactor pressure vessel head found at the Davis Besse Nuclear Power plant and NRC's actions to address the issue.

SUCCESS: Participants leave the meeting with clear understanding of the issue, stakeholder perspectives and concerns, and NRC's actions to address the issue and protect public health and safety.

AGENDA

I. INTRODUCTIONS

**Tony Mendiola, Section Chief
DLPM, NRR
U.S. NRC**

II. OVERVIEW OF ISSUE (25 minutes)

**Jack Strosnider, Director
Division of Engineering, NRR
U.S. NRC**

III. QUESTION AND DISCUSSION PERIOD

IV. ADJOURNMENT

OVERVIEW OF ISSUE

- I. Basic Plant and Reactor Pressure Vessel Overview**
- II. Description of Degradation found at Davis Besse**
- III. Safety Implications**
- IV. Industry / licensee actions**
- V. NRC Actions**

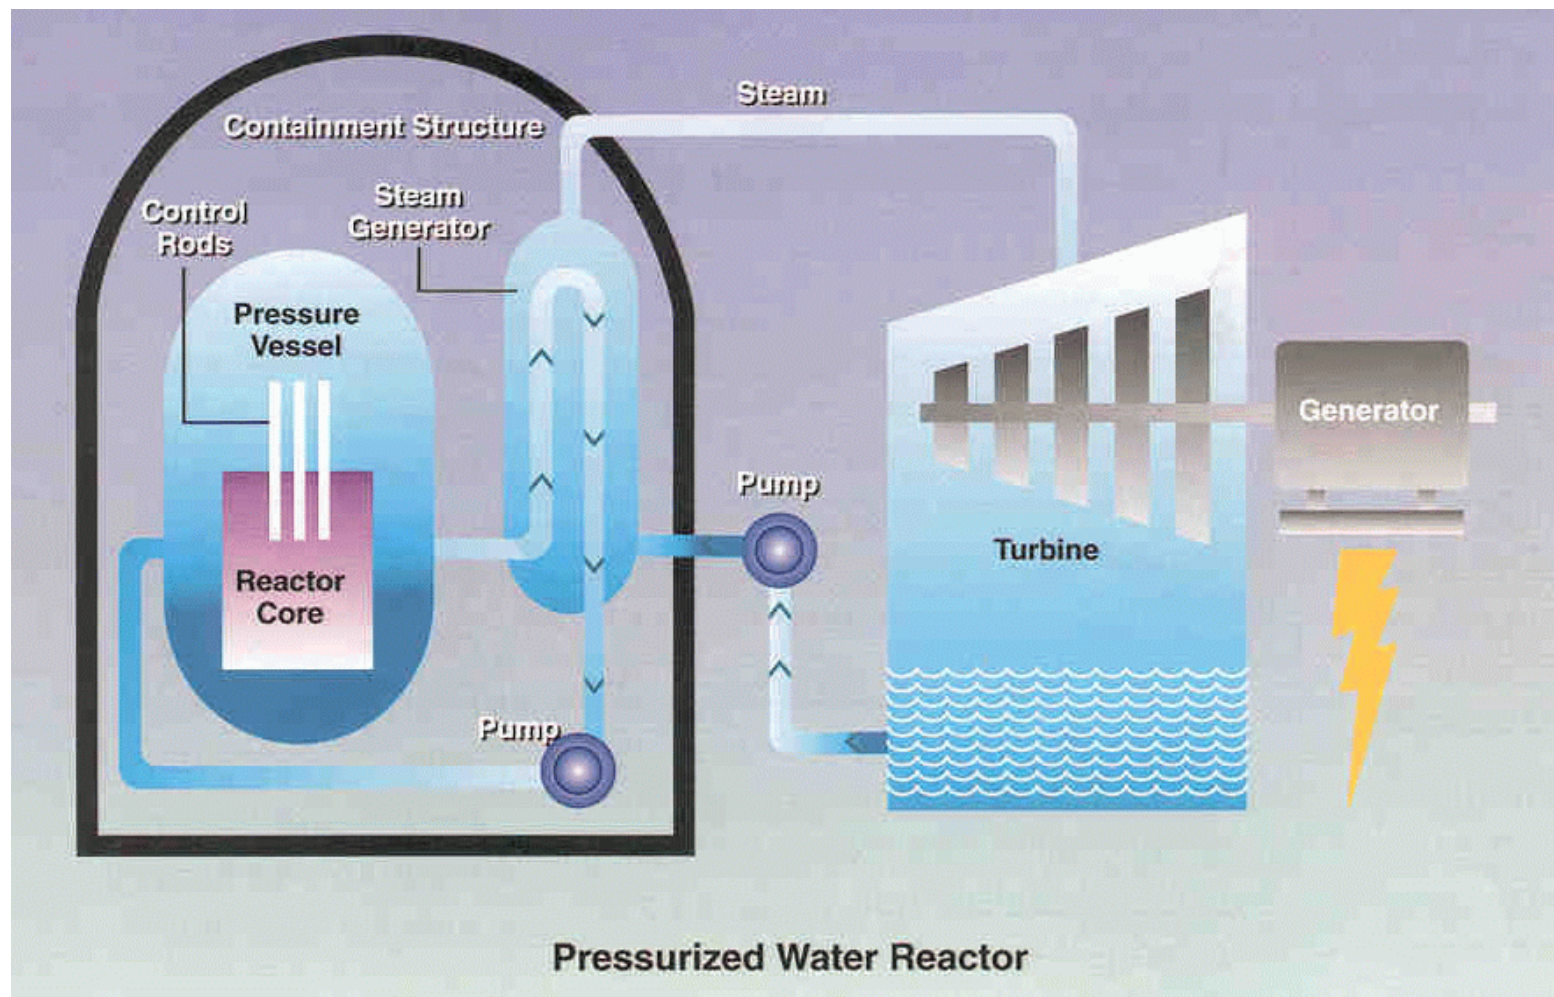


FIG 1: BASIC PLANT SYSTEMS

Reactor Pressure Vessel Head Degradation Location

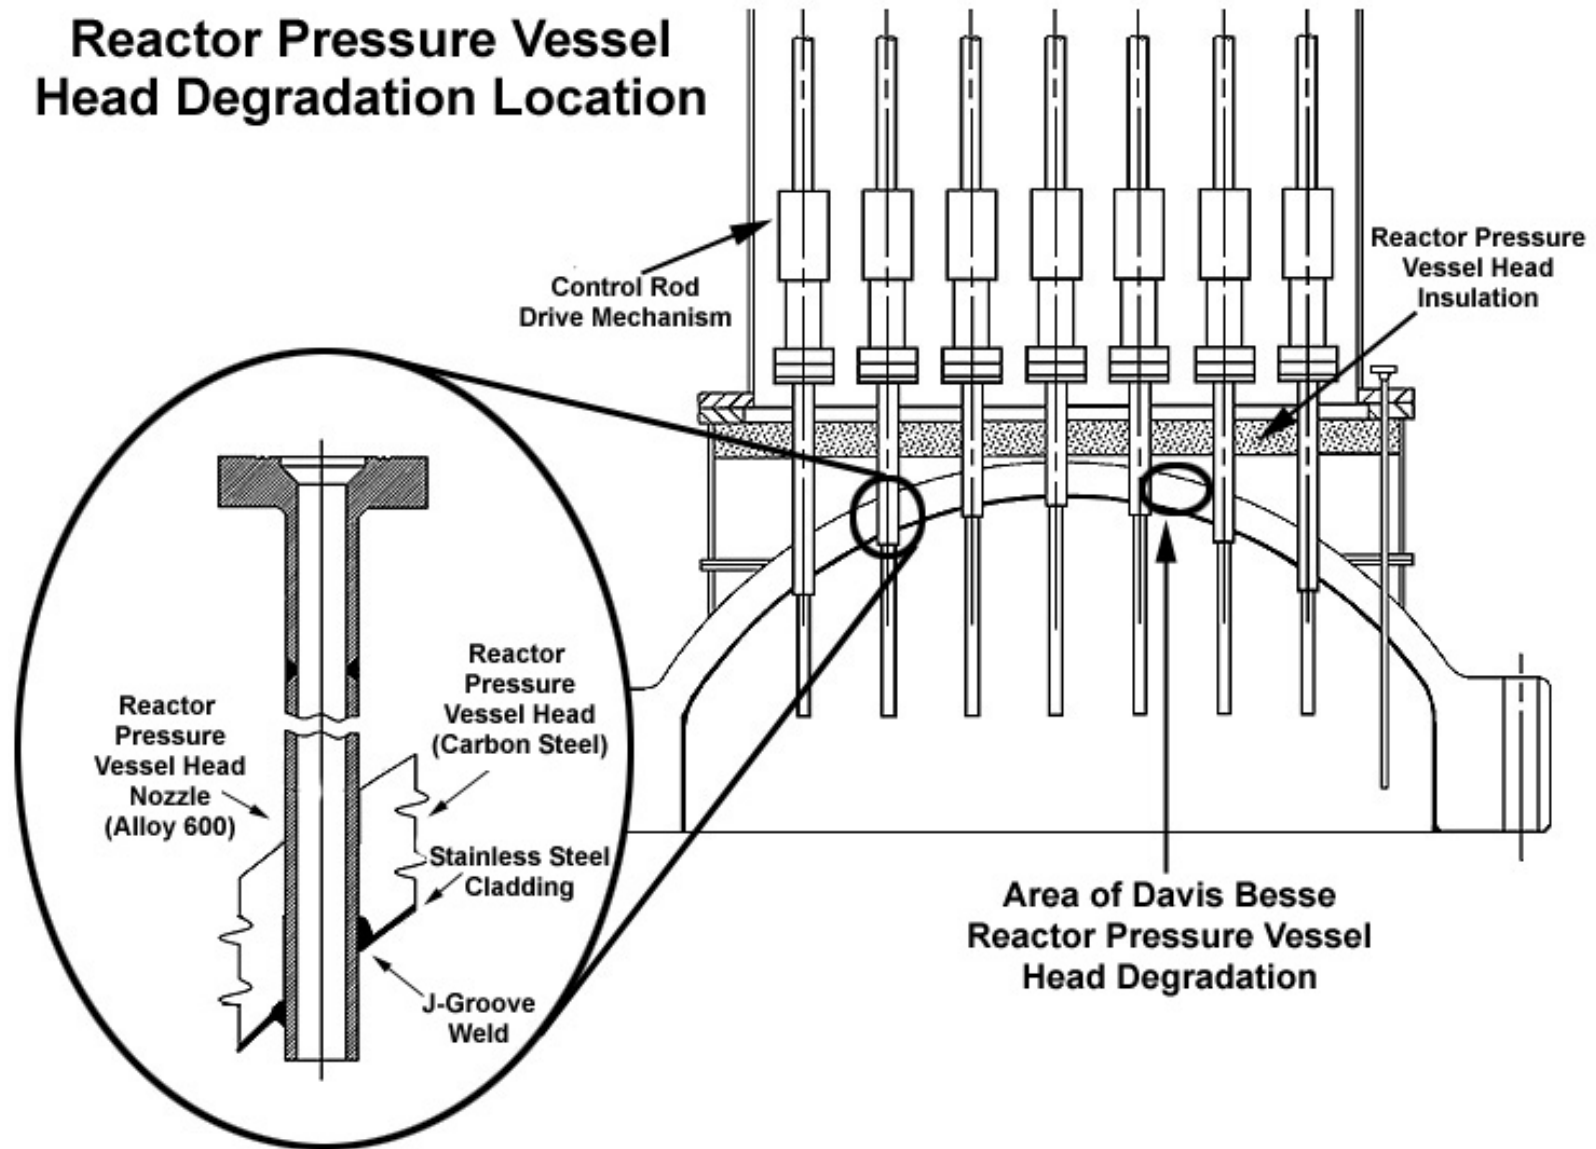


FIG 2: REACTOR PRESSURE VESSEL HEAD

DESCRIPTION OF DEGRADATION FOUND AT DAVIS BESSE

- **INSPECTIONS WERE BEING PERFORMED IN RESPONSE TO NRC BULLETIN 2001-01 REGARDING CRACKING OF CRDM NOZZLE PENETRATION TUBE**
- **NOZZLES INSPECTED WITH ULTRASONIC TESTING**
 - **nozzles 1, 2, and 3 had through-wall cracks that leaked**
 - **nozzles 5 and 47 had cracks that were not through-wall**
- **PROBLEMS ENCOUNTERED DURING REPAIR OF NOZZLE 3**
- **NOZZLE 3 REMOVED FROM REACTOR VESSEL HEAD AND BORIC ACID DEPOSITS REMOVED**
- **IDENTIFIED DEGRADED AREAS ADJACENT TO NOZZLES 1, 2, AND 3**


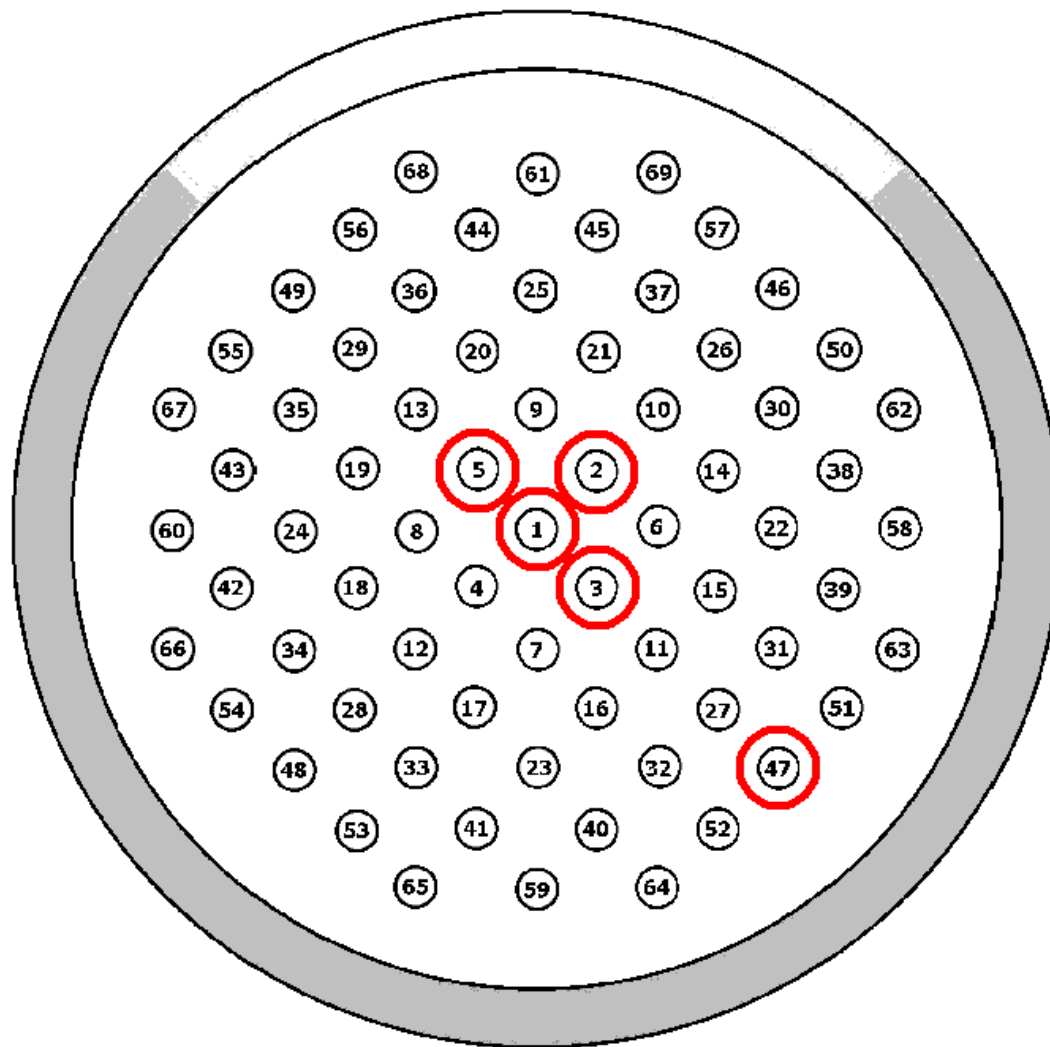


FIG 3: TOP VIEW OF REACTOR VESSEL HEAD

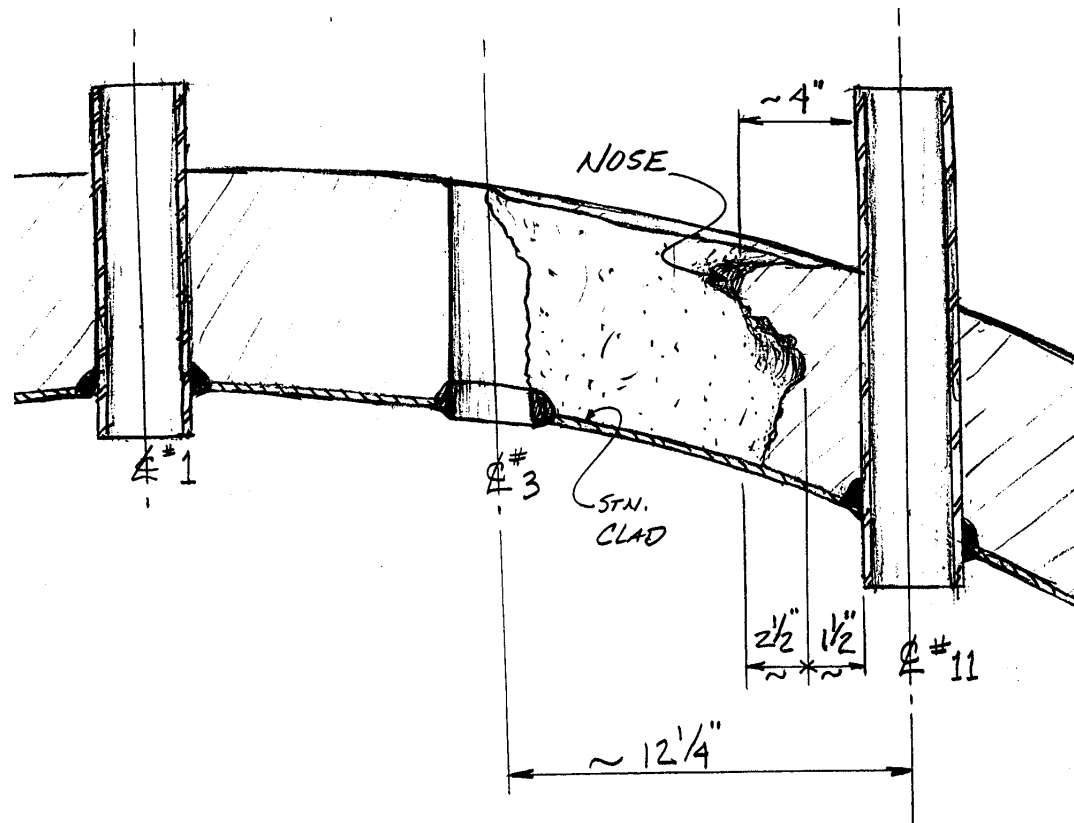

SECTION A-A

FIG 4: CROSS-SECTIONAL SKETCH OF DEGRADED AREA ADJACENT TO NOZZLE 3

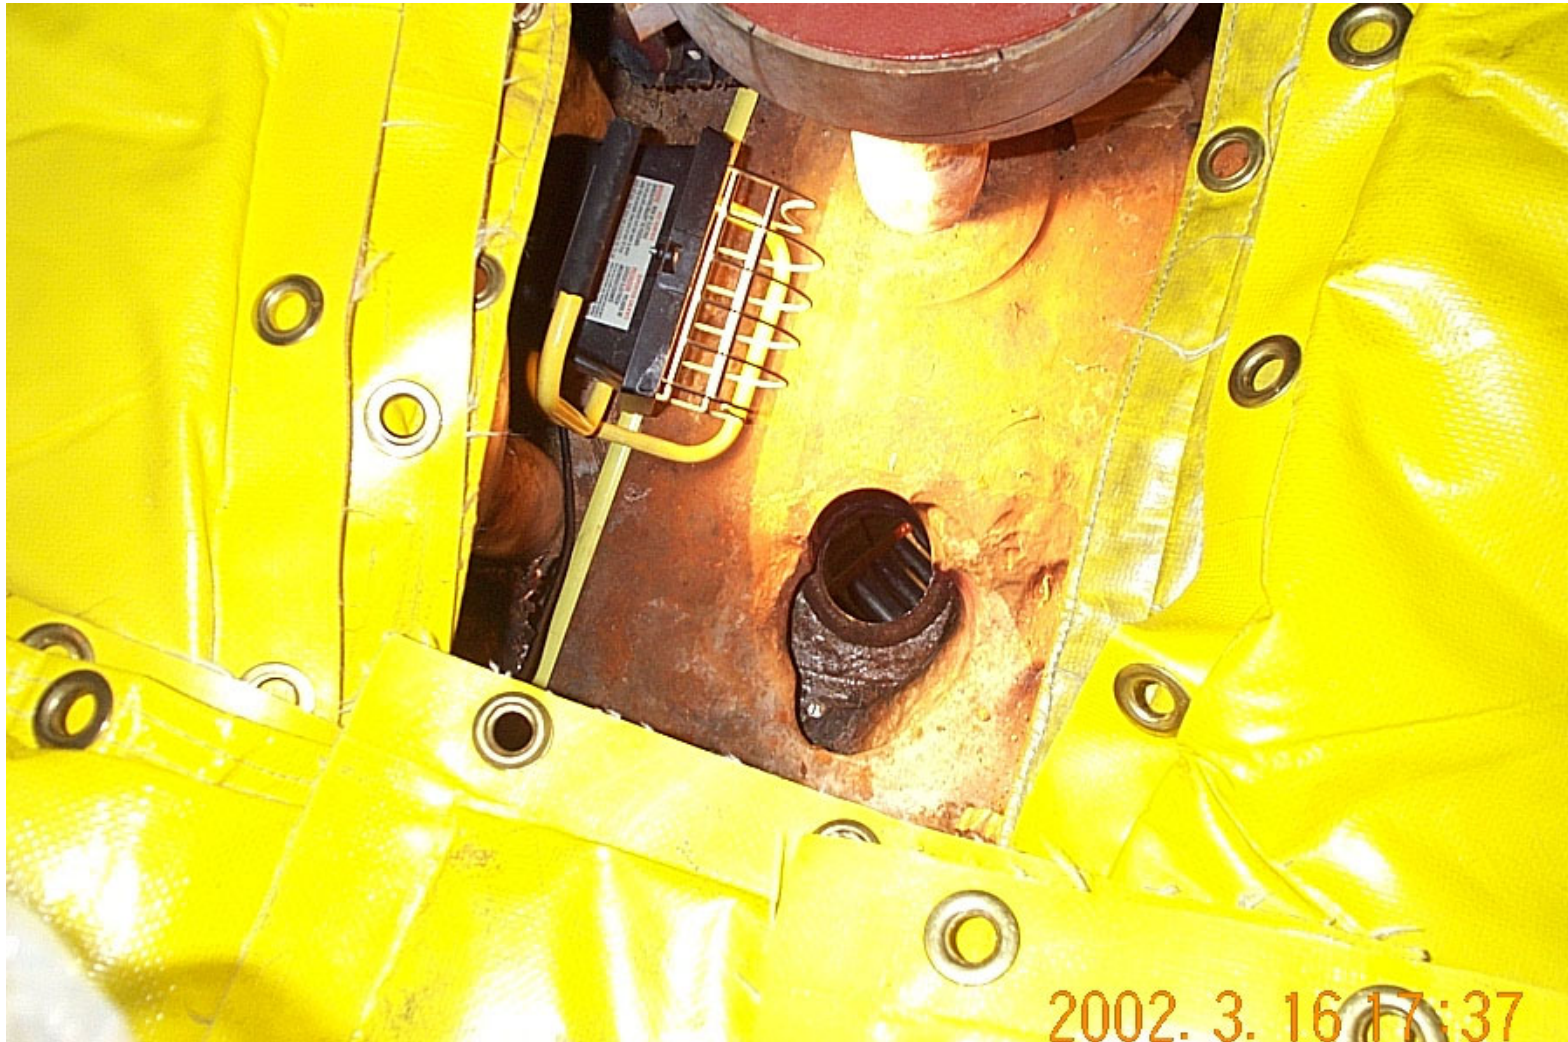


FIG 5: PHOTO OF DEGRADED AREA ADJACENT TO NOZZLE 3

SAFETY IMPLICATIONS

- **VERY SERIOUS DEGRADATION**
 - **Structural Margins Were Significantly Degraded**
 - **Potential for Loss of Reactor Coolant Accident**
- **PLANT IS DESIGNED TO DEAL WITH A LOSS OF COOLANT ACCIDENT**
 - **Emergency Core Cooling Systems, Control of Nuclear Reaction, Containment**
 - **Unwanted Challenge to Systems and Operators**
- **PROMPT ACTION REQUIRED TO CONFIRM THAT SIMILAR PROBLEMS DON'T EXIST AT OTHER PLANTS**

LICENSEE / INDUSTRY ACTIONS

- **LICENSEE ACTIONS**
 - **Plant is in safe, shutdown condition**
 - **Licensee investigating extent and cause of degradation**
 - **Licensee evaluating repair or replacement options**
- **INDUSTRY ACTION**
 - **Industry survey to collect information on status of all pressurized water reactor plants**
 - **Information presented at March 19 public meeting**

NRC Actions

- **INFORMATION NOTICE 2002-11 ISSUED MARCH 12, 2002**
- **NRC AUGMENTED INSPECTION TEAM (AIT) SENT TO SITE**
- **CONFIRMATORY ACTION LETTER ISSUED TO LICENSEE**
- **BULLETIN 2002-01 ISSUED ON MARCH 18, 2002**

BULLETIN REQUIRED INFORMATION

WITHIN 15 DAYS:

- **SUMMARY OF RPV HEAD INSPECTION & MAINTENANCE PROGRAMS**
- **EVALUATION OF ABILITY OF INSPECTION AND MAINTENANCE PROGRAMS TO IDENTIFY DEGRADATION**
- **DESCRIPTION OF CONDITIONS THAT COULD LEAD TO DEGRADATION AND CORRECTIVE ACTIONS TAKEN TO ADDRESS SUCH CONDITIONS**
- **PLANS, BASIS AND SCHEDULE FOR FUTURE INSPECTIONS OF THE REACTOR VESSEL HEAD AND VESSEL HEAD PENETRATION NOZZLES**
- **BASIS FOR CONTINUED OPERATION UNTIL THE INSPECTIONS ARE PERFORMED**

WITHIN 30 DAYS:

- **RESULTS OF INSPECTIONS**

WITHIN 60 DAYS:

- **BASIS FOR CONCLUDING BORIC ACID INSPECTION PROGRAM IS EFFECTIVELY MAINTAINING REACTOR COOLANT PRESSURE BOUNDARY INTEGRITY**