



UNITED STATES
NUCLEAR REGULATORY COMMISSION
WASHINGTON, D. C. 20555

September 14, 1984

Docket No. 50-249
LS05-84-09-014

Mr. Dennis L. Farrar
Director of Nuclear Licensing
Commonwealth Edison Company
Post Office Box 767
Chicago, Illinois 60690

Dear Mr. Farrar:

SUBJECT: TECHNICAL SPECIFICATION CHANGES RELATING TO THE EXTENSION OF
CERTAIN MAPLHGR CURVES

Re: Dresden Nuclear Power Station, Unit No. 3

The Commission has issued the enclosed Amendment No. 76 to Facility Operating License No. DPR-25 for the Dresden Nuclear Power Station, Unit No. 3. The amendment consists of changes to the Technical Specifications (TS) in response to your application dated March 19, 1984 as supplemented by letters dated April 9, 1984 and August 2, 1984. The latter submittal transmitted a copy of the proposed TS page in the recently approved reformatted TS style with no change in the technical content from the earlier submittals.

The amendment authorizes an extension of the MAPLHGR limits for residual fuel types 8DRB265L and P8DRB265L in the Dresden 3 core to 40 000 Mwd/STU from 30 000 Mwd/STU. It also approves slightly higher MAPLHGR limits for P8DRB265L in the range 1250-25 000 Mwd/STU.

A notice of Consideration of Issuance of Amendment to License and Proposed No Significant Hazards Consideration Determination and Opportunity for Hearing relating to the actions in the March 19, 1984 and April 9, 1984 letters was published in the Federal Register on May 23, 1984 (49 FR 21827). No requests for hearing or comments were received.

Add: T. BARNHART (4)
R. Diggs
W. Jones
C. Miles
D. BRINKMAN

8409170389 840914
PDR ADDOCK 05000249
P PDR

SE01
11
(EXT-16)

A copy of the staff's related Safety Evaluation is also enclosed. This action will appear in the Commission's monthly notice publication in the Federal Register.

Sincerely,

Walter A. Paulson, Acting Chief
Operating Reactors Branch #5
Division of Licensing

Enclosures:

- 1. Amendment No. 76 to License No. DPR-25
- 2. Safety Evaluation

cc w/enclosures:
See next page

DISTRIBUTION

Docket File
 NRC PDR
 Local PDR
 NSIC
 ORB #5 Reading
 WPaulson
 CJamerson
 RGilbert
 OELD
 ELJordan
 JNGrace
 ACRS (10)
 TBarnhart (4)
 CMiles
 WJones
 DBrinkman

DL: ORB #5
 CJamerson:cc
 8/21/84

DL: ORB #5
 RGilbert
 8/29/84

OELD
 8/31/84

DL: ORB #5
 WPaulson
 9/11/84

DL: ORB #5
 DCrutchfield
 9/12/84

cc

Isham, Lincoln & Beale
Counselors at Law
Three First National Plaza,
Suite 5200
Chicago, Illinois 60602

Mr. Doug Scott
Plant Superintendent
Dresden Nuclear Power Station
Rural Route #1
Morris, Illinois 60450

U. S. Nuclear Regulatory Commission
Resident Inspectors Office
Dresden Station
Rural Route #1
Morris, Illinois 60450

Chairman
Board of Supervisors of
Grundy County
Grundy County Courthouse
Morris, Illinois 60450

U. S. Environmental Protection Agency
Federal Activities Branch
Region V Office
ATTN: Regional Radiation Representative
230 South Dearborn Street
Chicago, Illinois 60604

James G. Keppler, Regional Administrator
Nuclear Regulatory Commission, Region III
799 Roosevelt Street
Glen Ellyn, Illinois 60137

Mr. Gary N. Wright, Manager
Nuclear Facility Safety
Illinois Department of Nuclear Safety
1035 Outer Park Drive, 5th Floor
Springfield, Illinois 62704



UNITED STATES
NUCLEAR REGULATORY COMMISSION
WASHINGTON, D. C. 20555

COMMONWEALTH EDISON COMPANY

DOCKET NO. 50-249

DRESDEN NUCLEAR POWER STATION, UNIT NO.3

AMENDMENT TO FACILITY OPERATING LICENSE

Amendment No. 76
License No. DPR-25

1. The Nuclear Regulatory Commission (the Commission) has found that:
 - A. The application for amendment by the Commonwealth Edison Company (the licensee) dated March 19, 1984, as supplemented by letters dated April 9, 1984 and August 2, 1984 complies with the standards and requirements of the Atomic Energy Act of 1954, as amended (the Act), and the Commission's rules and regulations set forth in 10 CFR Chapter I;
 - B. The facility will operate in conformity with the application, the provisions of the Act, and the rules and regulations of the Commission;
 - C. There is reasonable assurance (i) that the activities authorized by this amendment can be conducted without endangering the health and safety of the public, and (ii) that such activities will be conducted in compliance with the Commission's regulations;
 - D. The issuance of this amendment will not be inimical to the common defense and security or to the health and safety of the public; and
 - E. The issuance of this amendment is in accordance with 10 CFR Part 51 of the Commission's regulations and all applicable requirements have been satisfied.

2. Accordingly, the license is amended by changes to the Technical Specifications as indicated in the attachment to this license amendment and paragraph 3.B of Facility Operating License No. DPR-25 is hereby amended to read as follows:

B. Technical Specifications

The Technical Specifications contained in Appendix A, as revised through Amendment No. 76, are hereby incorporated in the license. The licensee shall operate the facility in accordance with the Technical Specifications.

3. This license amendment is effective as of the date of its issuance.

FOR THE NUCLEAR REGULATORY COMMISSION

Walter A. Paulson

Walter A. Paulson, Acting Chief
Operating Reactors Branch #5
Division of Licensing

Attachment:
Change to the Technical
Specifications

Date of Issuance: September 14, 1984

ATTACHMENT TO LICENSE AMENDMENT NO. 76

FACILITY OPERATING LICENSE NO. DPR-25

DOCKET NO. 50-249

Revise the Technical Specifications by replacing page 3/4.5-18 with a revised page 3/4.5-18.

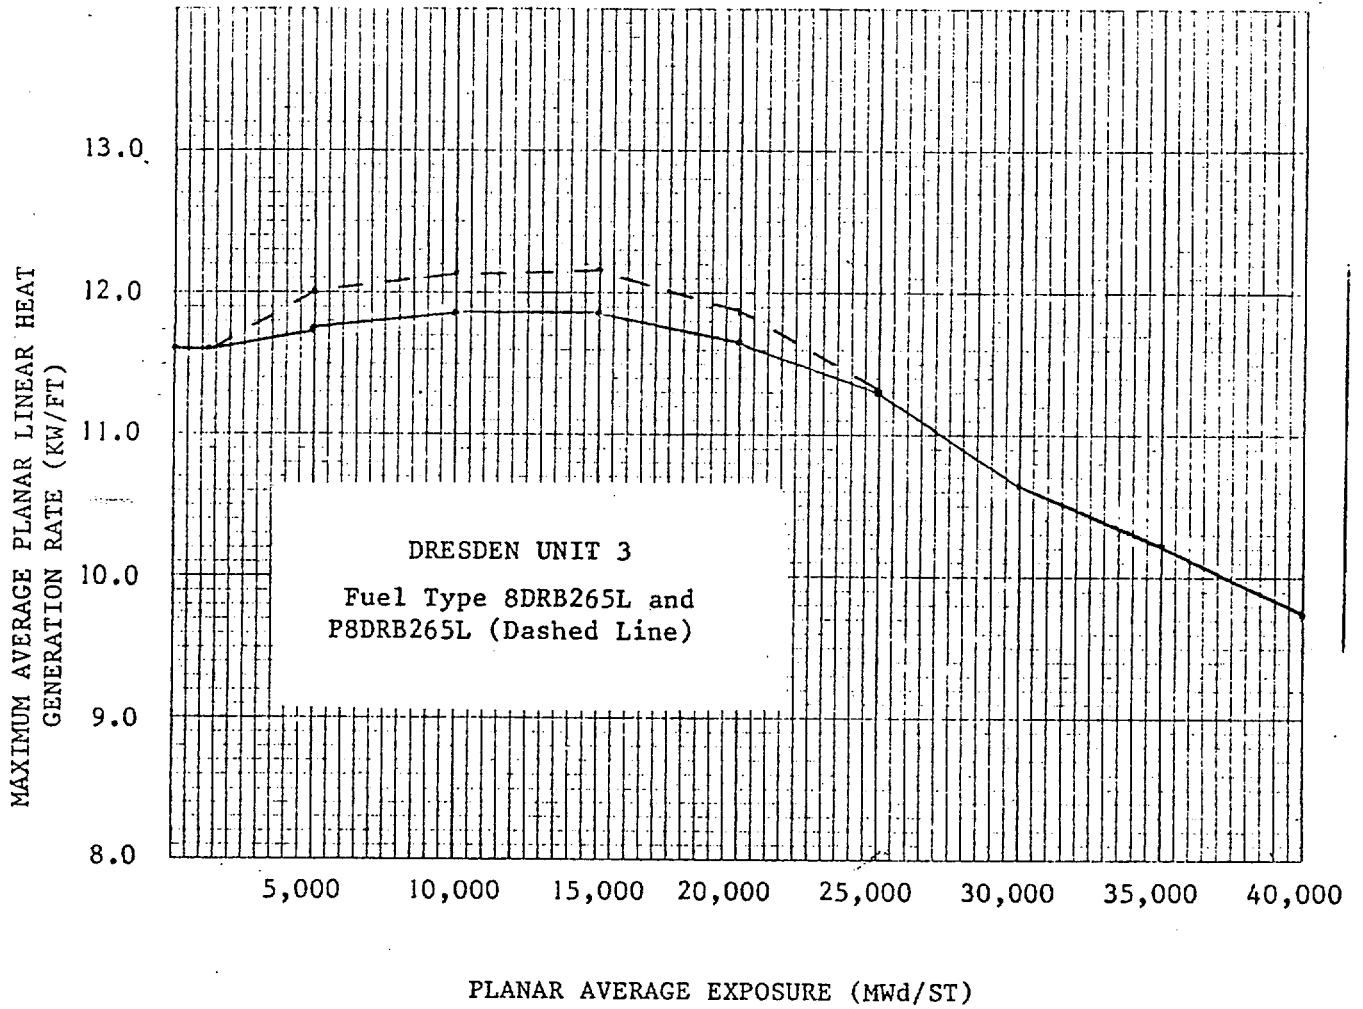


Figure 3.5-1
(Sheet 2 of 5)

Maximum Average Planar
Linear Heat Generation Rate (MAPLHGR)
Vs. Planar Average Exposure



UNITED STATES
NUCLEAR REGULATORY COMMISSION
WASHINGTON, D. C. 20555

SAFETY EVALUATION BY THE OFFICE OF NUCLEAR REACTOR REGULATION
SUPPORTING AMENDMENT NO. 76 TO FACILITY OPERATING LICENSE NO. DPR-25

COMMONWEALTH EDISON COMPANY

DRESDEN NUCLEAR POWER STATION, UNIT NO. 3

DOCKET NO. 50-249

1.0 INTRODUCTION

By letters dated March 19, 1984 (Ref. 1) and April 9, 1984 (Ref. 2), Commonwealth Edison Company (the licensee) proposed modifications to the Technical Specifications (TS) for Dresden Unit 3. In addition, an August 2, 1984 letter transmitted a copy of the proposed TS page in the recently approved reformatted TS style with no change in the technical content from the earlier submittals. The changes specify the Maximum Average Planar Linear Heat Generation Rate (MAPLHGR) operating limits for both unpressurized and pressurized 8X8R fuel types beyond planar average exposures of 30 000 MWd/STU.

A Notice of Consideration of Issuance of Amendment to License and Proposed No Significant Hazards Consideration Determination and Opportunity for Hearing related to the requested actions in the March 19, and April 9, 1984 letters was published in the Federal Register on May 23, 1984 (49 FR 21827). No requests for hearings or comments were received.

2.0 EVALUATION

The licensee's submittals provided MAPLHGR limits for resident fuel types 8DRB265L and P8DRB265L in the Dresden Unit 3 core. The submittals proposed extension of the limits to 40 000 MWd/STU from the presently approved limit of 30 000 MWd/STU. Although the methodology (Ref. 3) used is generically applicable for the determination of MAPLHGR limits, the staff previously concluded (Ref. 4) that the effects of enhanced fission gas release at high burnups (i.e., greater than 20 000 MWd/STU) were not adequately considered in the analysis. In response to this concern, the fuel vendor (General Electric) requested (Refs. 5-6) that credit for approved, but unapplied, ECCS evaluation model changes and calculated peak cladding temperature margin be used to avoid MAPLHGR penalties at higher burnups. This proposal was found acceptable provided that certain plant-specific analytical considerations were met. These were that (1) no additional credit is taken in the analysis for the ECCS evaluation model changes and (2) the peak cladding temperature for each fuel type and burnup does not exceed that assumed in Table 2 of the Reference 6 letter. The General Electric Standard Application for Reactor Fuel (GESTAR II - Ref. 7) has been modified (Section S.2.5.2.5) to incorporate these considerations.

In addition to the MAPLHGR limit extension, the licensee's submittals requested slightly higher MAPLHGR limits for P8DRB265L fuel in the range 1250-25 000 MWd/STU. Reference 3 provides a licensing basis for this change, which the staff finds acceptable. The change has also been approved previously for Dresden Unit 2 (Ref. 8).

3.0 FINDINGS

The licensee has proposed an extension to the MAPLHGR limits for two of the fuel types in the Dresden Unit 3 core. Based on a previous approval of the generic methods used to determine these limits, the staff finds the proposed MAPLHGR limits acceptable.

4.0 ENVIRONMENTAL QUALIFICATION

This amendment involves a change in the installation or use of a facility component located within the restricted area. The staff has determined that the amendment involves no significant increase in the amounts, and no significant change in the types, of any effluents that may be released offsite and that there is no significant increase in individual or cumulative occupation radiation exposure. The Commission has previously issued a proposed finding that this amendment involves no significant hazards consideration and there has been no public comment on such finding. Accordingly, this amendment meets the eligibility criteria for categorical exclusion set forth in 10 CFR Section 51.22(c)(9). Pursuant to 10 CFR 51.22(b) no environmental impact statement or environmental assessment need be prepared in connection with the issuance of this amendment.

5.0 CONCLUSION

The staff has concluded, based on the considerations discussed above, that: (1) there is reasonable assurance that the health and safety of the public will not be endangered by operation in the proposed manner, and (2) such activities will be conducted in compliance with the Commission's regulations and the issuance of this amendment will not be inimical to the common defense and security or to the health and safety of the public.

6.0 ACKNOWLEDGEMENT

The following staff members have contributed to this evaluation:

M. Dunenfeld
R. Gilbert

Dated: September 14, 1984

REFERENCES

1. Letter from B. Rybak (CECo) to Harold R. Denton (NRC), Subject: Proposed Amendment to Technical Specification for Facility Operating License DPR-25, dated March 19, 1984.
2. Letter from B. Rybak (CECo) to Harold R. Denton (NRC), Subject: Supplementary Information to Proposed Amendment to Technical Specification - Extension of MAPLHGR Curve, dated April 9, 1984.
3. General Electric Company, NEDO-24146A, Revision 1, "Loss-of-Coolant Accident Analysis Report for Dresden Units 2, 3 and Quad Cities Units 1, 2, Nuclear Power Station", dated April 1979 as subsequently modified by Errata and Addenda 1 through 12.
4. Letter from D. F. Ross, Jr. (NRC) to G. Sherwood (GE) dated January 18, 1978.
5. Letter from R. E. Engel (GE) to T. A. Ippolito (NRC) dated May 6, 1981.
6. Letter from R. E. Engel (GE) to T. A. Ippolito (NRC) dated May 28, 1981.
7. General Electric Company, NEDE-24011-P-A-6, "General Electric Standard Application for Reactor Fuel," April 1983 (Proprietary).
8. Letter from D. M. Crutchfield (NRC) to D. L. Farrar (CECo) dated April 7, 1983.