

NOTE

The requirements of TSR 3.0.b apply to Chapter 12.

12.0 RADIOLOGICAL EFFLUENT TECHNICAL STANDARDS

Chapter 12 of the LaSalle Station ODCM is a compilation of the various regulatory requirements, surveillances and bases, commitments and/or components of the radiological effluent and environmental monitoring programs for LaSalle Station. To assist in the understanding of the relationship between effluent regulations, ODCM equations, RETS (Chapter 12 section) and related Technical Specification requirements, Table 12.0-1 is a matrix which relates these various components. The Radiological Environmental Monitoring Program fundamental requirements are contained within this chapter, with LaSalle specific information in Chapter 11 and a supplemental matrix in Table 12.0-2.

**TABLE 12.0-1
EFFLUENT COMPLIANCE MATRIX**

Regulation	Dose to be compared to limit	ODCM Equation	RETS	Technical Specification
10CFR50 Appendix I	1. gamma air dose and beta air dose due to airborne radioactivity in effluent plume.	A-1 A-2	12.4.2	5.5.4.h
	1.a whole body and skin dose due to airborne radioactivity in effluent plume are reported only if certain gamma and beta air dose criteria are exceeded.	A-6 A-7	N/A	N/A
	2. CDE for all organs and all four age groups due to iodines and particulates in effluent plume. All pathways are considered.	A-13	12.4.3	5.5.4.i
	3. CDE for all organs and all four age groups due to radioactivity in liquid effluents.	A-29	12.3.2	5.5.4.d
10CFR20	1. TEDE, totaling all deep dose equivalent components (direct, ground and plume shine) and committed effective dose equivalents (all pathways, both airborne and liquid-borne). CDE evaluation is made for adult only using FGR 11 database.	A-38	12.4.9	5.5.4.c
40CFR190 (now by reference, also part of 10CFR20)	1. Whole body dose (DDE) due to direct dose, ground and plume shine from all sources at a station.	A-35	12.4.7	5.5.4.j
	2. Organ doses (CDE) to an adult due to all pathways.	A-13		
Technical Specifications	1. "Instantaneous" whole body (DDE), thyroid (CDE) and skin (SDE), dose rates to an adult due to radioactivity in airborne effluents. For the thyroid dose, only inhalation is considered.	A-8 A-9 A-28	12.4.1	5.5.4.g 5.5.4.b
	2. "Instantaneous" concentration limits for liquid effluents.	A-32	12.3.1	
Technical Specifications	1. Radioactive Effluent Release Report	NA	12.6.2	5.6.3

Table 12.0-2

REMP Compliance Matrix

Regulation	Component	RETS	Technical Specification
10CFR50 Appendix I Section IV.B.2	Implement environmental monitoring program.	12.5.1	N/A
10CFR50 Appendix I Section IV.B.3	Land Use Census	12.5.2	N/A
10CFR50 Appendix I Section IV.B.2	Interlaboratory Comparison Program	12.5.3	N/A
10CFR50 Appendix I Section IV B.2 and Technical Specifications	Annual Radiological Environmental Operating Report	12.6.1	5.6.2

- 12.1 DEFINITIONS
- 12.1.1 ACTION - ACTION shall be that part of a requirement which prescribes remedial measures required under designated conditions.
- 12.1.2 CHANNEL CALIBRATION - A CHANNEL CALIBRATION shall be the adjustment, as necessary, of the channel output such that it responds with the necessary range and accuracy to known values of the parameter which the channel monitors. The CHANNEL CALIBRATION shall encompass the entire channel, including the required sensor, alarm, display, and trip functions, and shall include the CHANNEL FUNCTIONAL TEST. Calibration of instrument channels with resistance temperature detector (RTD) or thermocouple sensors may consist of an in-place qualitative assessment of sensor behavior and normal calibration of the remaining adjustable devices in the channel. The CHANNEL CALIBRATION may be performed by any series of sequential, overlapping or total channel steps so that the entire channel is calibrated.
- 12.1.3 CHANNEL CHECK - A CHANNEL CHECK shall be the qualitative assessment, by observation, of channel behavior during operation. This determination shall include, where possible, comparison of the channel indication and status to other indications or status derived from independent instrument channels measuring the same parameter.
- 12.1.4 CHANNEL FUNCTIONAL TEST - A CHANNEL FUNCTIONAL TEST shall be the injection of a simulated signal into the channel as close to the sensor as practical to verify OPERABILITY including required alarm, interlock, display, and trip functions, and channel failure trips. The CHANNEL FUNCTIONAL TEST may be performed by any series of sequential, overlapping, or total channel steps so that the entire channel is tested.
- 12.1.5 DOSE EQUIVALENT I-131 - DOSE EQUIVALENT I-131 shall be that concentration of I-131, (microcuries/gram), that alone would produce the same thyroid dose as the quantity and isotopic mixture of I-131, I-132, I-133, I-134, and I-135 actually present. The thyroid dose conversion factors used for this calculation shall be those listed in Table III of TID-14844, AEC 1962, "Calculation of Distance Factors for Power and Test Reactor Sites;" Table E.7 of Regulatory Guide 1.109, Rev. 1, NRC, 1977; or ICRP 30, Supplement to Part 1, pages 192-212, Table titled, "Committed Dose Equivalent in Target Organs or Tissues per Intake of Unit Activity."
- 12.1.6 FREQUENCY - Table 12.1-1 provides the definitions of various frequencies for which surveillances, sampling, etc. are performed unless defined otherwise. The provisions of Technical Specifications SR 3.0.2 and SR 3.0.3 are applicable to the frequencies except that they do not apply to the frequencies associated with the Radiological Environmental Monitoring Program (Section 12.5).
- 12.1.7 GASEOUS RADWASTE TREATMENT SYSTEM - A GASEOUS RADWASTE TREATMENT SYSTEM shall be any system designed and installed to reduce radioactive gaseous effluents by collecting primary coolant system offgases from the primary system and providing for delay or holdup for the purpose of reducing total radioactivity prior to release to the environment.
- 12.1.8 MEMBER(S) OF THE PUBLIC - means an individual except when that individual is receiving an occupational dose.
- 12.1.9 MODE - A MODE shall correspond to any one of the inclusive combination of mode switch position, average reactor coolant temperature, and reactor pressure vessel head closure bolt tensioning specified in Table 12.1-2 with fuel in the reactor vessel.

- 12.1.10 OCCUPATIONAL DOSE - means the dose received by an individual in the course of employment in which the individual's assigned duties involve exposure to radiation and/or to radioactive material from licensed and unlicensed sources of radiation, whether in the possession of the licensee or other person. Occupational dose does not include dose from background radiation as a patient from medical practices, from voluntary participation in medical research programs, or as a member of the public.
- 12.1.11 OPERABLE - OPERABILITY - A system, subsystem, division, component, or device shall be OPERABLE or have OPERABILITY when it is capable of performing its specified function(s), and when all necessary attendant instrumentation, controls, normal or emergency electrical power, cooling and seal water, lubrication, and other auxiliary equipment that are required for the system, subsystem, division, component or device to perform its function(s) are also capable of performing their related support function(s).
- 12.1.12 PROCESS CONTROL PROGRAM - The PROCESS CONTROL PROGRAM (PCP) shall contain the current formulas, sampling, analyses, test, and determinations to be made to ensure that processing and packaging of solid radioactive wastes based on demonstrated processing of actual or simulated wet solid wastes shall be accomplished in such a way as to assure compliance with 10 CFR Parts 20, 61, and 71, State regulations, burial ground requirements, and other requirements governing the disposal of solid radioactive waste.
- 12.1.13 PURGE - PURGING - PURGE or PURGING shall be the controlled process of discharging air or gas from a confinement to maintain temperature, pressure, humidity, concentration or other operating condition, in such a manner that replacement air or gas is required to purify the confinement.
- 12.1.14 RATED THERMAL POWER (RTP) - RTP shall be a total reactor core heat transfer rate to the reactor coolant of 3489 Mwt.
- 12.1.15 SITE BOUNDARY - The SITE BOUNDARY shall be that line beyond which the land is neither owned, nor leased, nor otherwise controlled by the licensee.
- 12.1.16 SOLIDIFICATION - SOLIDIFICATION shall be the conversion of radioactive wastes from liquid systems to a homogeneous (uniformly distributed), monolithic, immobilized solid with definite volume and shape, bounded by a stable surface of distinct outline on all sides (free-standing).
- 12.1.17 SOURCE CHECK - A SOURCE CHECK shall be the qualitative assessment of channel response when the channel sensor is exposed to a radioactive source.
- 12.1.18 THERMAL POWER - THERMAL POWER shall be the total reactor core heat transfer rate to the reactor coolant.
- 12.1.19 UNRESTRICTED AREA BOUNDARY - means an area, access to which is neither limited nor controlled by the licensee.
- 12.1.20 VENTILATION EXHAUST TREATMENT SYSTEM - A VENTILATION EXHAUST TREATMENT SYSTEM shall be any system designed and installed to reduce gaseous radioiodine or radioactive material in particulate form in effluents by passing ventilation or vent exhaust gases through charcoal adsorbers and/or HEPA filters for the purpose of removing iodines or particulates from the gaseous exhaust system prior to the release to the environment (such a system is not considered to have any effect on noble gas effluents). Engineered Safety Feature (ESF) atmospheric cleanup systems are not considered to be VENTILATION EXHAUST TREATMENT SYSTEM components.

- 12.1.21 VENTING - VENTING shall be the controlled process of discharging air or gas from a confinement to maintain temperature, pressure, humidity, concentration or other operating condition, in such a manner that replacement air or gas is not provided or required during VENTING. Vent, used in system names, does not imply a VENTING process.
- 12.1.22 Definitions Peculiar to Estimating Dose to Members of the Public Using the ODCM Computer Program.
- a. ACTUAL - ACTUAL refers to using known release data to project the dose to members of the public for the previous time period. This data is stored in the database and used to demonstrate compliance with the reporting requirements of Chapter 12.6.
 - b. PROJECTED - PROJECTED refers to using known release data from the previous time period or estimated release data to forecast a future dose to members of the public. This data is not incorporated into the database.

TABLE 12.1-1
FREQUENCY NOTATION

<u>NOTATION</u>	<u>FREQUENCY</u>
S - Shiftly	At least once per 12 hours.
D - Daily	At least once per 24 hours.
W - Weekly	At least once per 7 days.
M - Monthly	At least once per 31 days.
Q - Quarterly	At least once per 92 days.
SA - Semiannually	At least once per 184 days.
A - Annually	At least once per 366 days.
E - Sesquiannually	At least once per 18 months.
B - Refueling cycle	At least once per 24 months.
S/U - Startup	Prior to each reactor startup.
P - Prior	Prior to each radioactive release.
N.A.	Not applicable.

Table 12.1-2 (Page 1 of 1)

MODES

MODE	TITLE	REACTOR MODE SWITCH POSITION	AVERAGE REACTOR COOLANT TEMPERATURE (°F)
1	Power Operation	RUN	N/A
2	Startup	Refuel ^(a) or Startup/Hot Standby	N/A
3	Hot Shutdown ^(a)	Shutdown	> 200
4	Cold Shutdown ^(a)	Shutdown	≤ 200
5	Refueling ^(b)	Shutdown or Refuel	NA

(a) All reactor vessel head closure bolts fully tensioned.

(b) One or more reactor vessel head closure bolts less than fully tensioned.

12.2 INSTRUMENTATION**12.2.1 Radioactive Liquid Effluent Monitoring Instrumentation****Operability Requirements**

12.2.1.A The radioactive liquid effluent monitoring instrumentation channels shown in Table 12.2.1-1 shall be OPERABLE with their alarm/trip setpoints set to ensure that the limits of Section 12.3.1.A are not exceeded. The alarm trip setpoints of these channels shall be determined in accordance with the ODCM Chapter 10.

Applicability: At all times, when flow is present in the system.

Action:

- a. With a radioactive liquid effluent monitoring instrumentation channel alarm/trip setpoint less conservative than required, immediately suspend the release of radioactive liquid effluents monitored by the affected channel or declare the channel inoperable.
- b. With less than the minimum number of radioactive liquid effluent monitoring instrumentation channels OPERABLE, take the ACTION shown in Table 12.2.1-1. Restore the inoperable instrumentation to OPERABLE status within the time specified in the ACTION or, explain in the next Radioactive Effluent Release Report why this inoperability was not corrected within the time specified.

Surveillance Requirements

12.2.1.B Each radioactive liquid effluent monitoring instrumentation channel shall be demonstrated OPERABLE by performance of the CHANNEL CHECK, SOURCE CHECK, CHANNEL FUNCTIONAL TEST and CHANNEL CALIBRATION operations at the frequencies shown in Table 12.2.1-2.

Bases

12.2.1.C The radioactive liquid effluent monitoring instrumentation is provided to monitor and control, as applicable, the releases of radioactive materials in liquid effluents during actual or potential releases of liquid effluents. The alarm/trip setpoints for these instruments shall be calculated in accordance with the procedures in the ODCM to ensure that the alarm/trip will occur prior to exceeding the limits of RETS. The OPERABILITY and use of this instrumentation is consistent with the requirements of General Design Criteria 60, 63, and 64 of Appendix A to 10 CFR Part 50.

TABLE 12.2.1-1

RADIOACTIVE LIQUID EFFLUENT MONITORING INSTRUMENTATION

<u>INSTRUMENT</u>	<u>MINIMUM CHANNELS OPERABLE</u>	<u>ACTION</u>
1. GAMMA SCINTILLATION MONITOR PROVIDING ALARM AND AUTOMATIC TERMINATION OF RELEASE		
a. Liquid Radwaste Effluent Line	1	100
2. GAMMA SCINTILLATION MONITORS PROVIDING ALARM BUT NOT PROVIDING AUTOMATIC TERMINATION OF RELEASE		
a. Service Water System Effluent Line (Unit 1)	1	101
b. Service Water System Effluent Line (Unit 2)	1	101
c. RHR Service Water (Line A) Effluent Line (Unit 1)	1	101
d. RHR Service Water (Line A) Effluent Line (Unit 2)	1	101
e. RHR Service Water (Line B) Effluent Line (Unit 1)	1	101
f. RHR Service Water (Line B) Effluent Line (Unit 2)	1	101
3. FLOW RATE MEASUREMENT DEVICES		
a. Liquid Radwaste Effluent Line	1	102
b. Cooling Pond Blowdown Pipe*	1	102

* Same as River Discharge Blowdown Pipe.

RADIOACTIVE LIQUID EFFLUENT MONITORING INSTRUMENTATIONTABLE 12.2.1-1 (Continued)TABLE NOTATION

- ACTION 100 - With the number of OPERABLE channels less than required by the Minimum Channels OPERABLE requirement, effluent releases may continue for up to 14 days provided that prior to initiating a release:
- a. At least two independent samples are analyzed in accordance with Section 12.3.1.B.1, and
 - b. At least two technically qualified members of the Facility Staff independently verify the release rate calculations and discharge line valving;
- Otherwise, suspend release of radioactive effluents via this pathway.
- ACTION 101 - With the number of channels OPERABLE less than required by the Minimum Channels OPERABLE requirement, effluent releases via this pathway may continue for up to 30 days provided that, at least once per 8 hours, grab samples are collected and analyzed for principal gamma emitters and I-131 at a lower limit of detection as specified in Table 12.3.1-2. If effluent releases continue via this pathway beyond 30 days, continue to collect and analyze samples, then explain in the next Radioactive Effluent Release Report why this inoperability was not corrected within the time specified.
- ACTION 102 - With the number of channels OPERABLE less than required by the Minimum Channels OPERABLE requirement, actual radioactive releases in progress via this pathway may continue provided the flow rate is estimated at least once per 4 hours. Pump curves for Instrument 3a, or for known valve positions for Instrument 3b, may be used to estimate flow. Actual releases of radioactive effluent will not be initiated without an OPERABLE channel.

TABLE 12.2.1-2

RADIOACTIVE LIQUID EFFLUENT MONITORING INSTRUMENTATION SURVEILLANCE REQUIREMENTS

<u>INSTRUMENT</u>	<u>CHANNEL CHECK</u>	<u>SOURCE CHECK</u>	<u>CHANNEL FUNCTIONAL TEST</u>	<u>CHANNEL CALIBRATION</u>
1. GAMMA SCINTILLATION MONITOR PROVIDING ALARM AND AUTOMATIC TERMINATION OF RELEASE				
a. Liquid Radwaste Effluents Line	D	P	Q(1)	B(3)
2. GAMMA SCINTILLATION MONITORS PROVIDING ALARM BUT NOT PROVIDING AUTOMATIC TERMINATION OF RELEASE				
a. Service Water System Effluent Line (Unit 1)	D	M	Q(2)	B(3)
b. Service Water System Effluent Line (Unit 2)	D	M	Q(2)	B(3)
c. RHR Service Water (Line A) Effluent Line (Unit 1)	D	M	Q(2)	B(3)
d. RHR Service Water (Line A) Effluent Line (Unit 2)	D	M	Q(2)	B(3)
e. RHR Service Water (Line B) Effluent Line (Unit 1)	D	M	Q(2)	B(3)
f. RHR Service Water (Line B) Effluent Line (Unit 2)	D	M	Q(2)	B(3)
3. FLOW RATE MEASUREMENT DEVICES				
a. Liquid Radwaste Effluent Line	D(4)	N.A.	P	B
b. Cooling Pond Blowdown Pipe	D(4)	N.A.	Q	E

RADIOACTIVE LIQUID EFFLUENT MONITORING INSTRUMENTATIONTABLE 12.2.1-2 (Continued)TABLE NOTATION

- (1) The CHANNEL FUNCTIONAL TEST shall also demonstrate that automatic isolation of this pathway and control alarm annunciation occurs if any of the following conditions exist:
 1. Instrument indicates measured levels above the alarm/trip setpoint.
 2. Loss of power.
 3. Instrument alarms on downscale failure.
 4. Instrument controls not set in Operate or High Voltage mode.
- (2) The CHANNEL FUNCTIONAL TEST shall also demonstrate that control room alarm annunciation occurs if any of the following conditions exist:
 1. Instrument indicates measured levels above the alarm setpoint.
 2. Loss of power.
 3. Instrument alarms on downscale failure.
 4. Instrument controls not set in Operate or High Voltage mode.
- (3) The initial CHANNEL CALIBRATION shall be performed using one or more of the reference radioactive standards certified by the National Institute of Standards and Technology (NIST) or using standards that have been obtained from suppliers that participate in measurement assurance activities with NIST. These standards shall permit calibrating the system over its intended range of energy and measurement range. For subsequent CHANNEL CALIBRATION, the initial reference radioactive standards or radioactive sources that have been related to the initial calibration shall be used.
- (4) CHANNEL CHECK shall consist of verifying indication of flow during periods of release. CHANNEL CHECK shall be made at least once per 24 hours on days in which continuous, periodic, or batch releases are made.

12.2 INSTRUMENTATION

12.2.2 Radioactive Gaseous Effluent Monitoring Instrumentation

Operability Requirements

12.2.2.A The radioactive gaseous effluent monitoring instrumentation channels shown in Table 12.2.2-1 shall be OPERABLE with their alarm/trip setpoints set to ensure that the limits of Section 12.4.1.A are not exceeded. The alarm/trip setpoints of these channels shall be determined in accordance with the ODCM.

Applicability: As shown in Table 12.2.2-1.

Action:

- a. With a radioactive gaseous effluent monitoring instrumentation channel alarm/trip setpoint less conservative than required, immediately suspend the release of radioactive gaseous effluents monitored by the affected channel or declare the channel inoperable.
- b. With less than the minimum number of radioactive gaseous effluent monitoring instrumentation channels OPERABLE, take the ACTION shown in Table 12.2.2-1.

Surveillance Requirements

12.2.2.B Each radioactive gaseous effluent monitoring instrumentation channel shall be demonstrated OPERABLE by performance of the CHANNEL CHECK, SOURCE CHECK, CHANNEL FUNCTIONAL TEST and CHANNEL CALIBRATION operations at the frequencies shown in Table 12.2.2-2.

Bases

12.2.2.C The radioactive gaseous effluent monitoring instrumentation is provided to monitor and control, as applicable, the releases of radioactive materials in gaseous effluents during actual or potential releases of gaseous effluents. The alarm/trip setpoints for these instruments shall be calculated in accordance with the procedures in the ODCM to ensure that the alarm/trip will occur prior to exceeding the limits of RETS.

TABLE 12.2.2-1
RADIOACTIVE GASEOUS EFFLUENT MONITORING INSTRUMENTATION

<u>INSTRUMENT</u> ¹	<u>MINIMUM CHANNELS OPERABLE</u>	<u>APPLICABILITY</u>	<u>ACTION</u>
1. MAIN CONDENSER OFFGAS TREATMENT SYSTEM EFFLUENT MONITORING SYSTEM			
a. Noble Gas Activity Monitor - Providing Alarm and Automatic Termination of Release (1(2) D18-N903A, K901A, K601A, R601) and/or (1(2) D18-N903B, K901B, K601B, R601)	2	**	110
2. MAIN STACK MONITORING SYSTEM			
a. Noble Gas Activity Monitor (0D18-N514, R517, R518 Low Range WRGM) or (0D18-N515, R517, R518 Mid Range WRGM)	1	*	110
b. Iodine Sampler (Grab Sampler)	1	*	111
c. Particulate Sampler (Grab Sampler)	1	*	111
d. Effluent System Flow Rate Monitor (0FT-VR019, 0FY-VR019 and 19A, 0FR-VR019, 0D18-K510, 0D18-R518)	1	*	112
e. Sampler Flow Rate Monitor (Low: 0D18-N527, 0D18-N528, 0D18-R518; Mid/Hi: 0D18-N530, 0D18-N531, 0D18-R518)	1	*	112
3. CONDENSER AIR EJECTOR RADIOACTIVITY MONITOR (Prior to Input to Holdup System)			
a. Noble Gas Activity Monitor (1(2) D18-N002, K613, R604) (1(2) D18-N012, K600, R605)	1	#	113
4. SBGTS MONITORING SYSTEM			
a. Noble Gas Activity Monitor (0D18-N511, R515, R516 Low Range WRGM) or (0D18-N512, R515, R516 Mid Range WRGM)	1	##	110
b. Iodine Sampler (Grab Sampler)	1	##	111
c. Particulate Sampler (Grab Sampler)	1	##	111
d. Effluent System Flow Rate Monitor (1(2)FT-VG009, 1(2)FY-VG009, 1(2)FR-VG009)	1	##	112
e. Sampler Flow Rate Monitor (Low: 0D18-N521, 0D18-N522, 0D18-R516; Mid/Hi: 0D18-N524, 0D18-N525, 0D18-R516)	1	##	112

¹Equipment Part Number (EPN) numbers or monitor types are provided in parentheses "()".

RADIOACTIVE GASEOUS EFFLUENT MONITORING INSTRUMENTATIONTABLE 12.2.2-1 (Continued)TABLE NOTATION

- * At all times.
- ** During effluent releases via this pathway.
- # During operation of the main condenser air ejector.
- ## During operation of the SBGTS.

ACTION 110 - a. For the Main Condenser Offgas Treatment System Effluent Monitoring System:

With only one channel OPERABLE, place the inoperable channel in a tripped condition within 1 hour.

With no channel OPERABLE, effluent releases via this pathway may continue for up to 30 days provided grab samples are taken at least once per 8 hours and these samples are analyzed for noble gas gamma emitters within 24 hours. (See NOTE below.)

b. For the Low/Mid Range of the Main Stack Monitoring System or SBGTS Monitoring System:

With the number of channels OPERABLE less than required by the Minimum Channels OPERABLE requirement, effluent releases via this pathway may continue for up to 30 days provided grab samples are taken at least once per 8 hours and these samples are analyzed for noble gas gamma emitters within 24 hours at a lower limit of detection as specified in Table 12.4.1-1. (See NOTE below.)

ACTION 111 - With the number of channels OPERABLE less than required by the Minimum Channels OPERABLE requirement, effluent releases via this pathway may continue for up to 30 days provided that within 4 hours after the channel has been declared inoperable, samples are continuously collected with auxiliary sampling equipment as required in Table 12.4.1-1. (See NOTE below.)

ACTION 112 - With the number of channels OPERABLE less than required by the Minimum Channels OPERABLE requirement, effluent releases via this pathway may continue for up to 30 days provided the flow rate is estimated at least once per 4 hours. (See NOTE below.)

ACTION 113 - With the number of channels OPERABLE less than required by the Minimum Channels OPERABLE requirement, the output from the charcoal adsorber vessels may be released to the environment for up to 72 hours provided:

- a. The offgas treatment system is not bypassed, and
- b. The offgas treatment delay system noble gas activity effluent downstream monitor is OPERABLE;

Otherwise, be in at least Mode 2 with the main steam isolation valves closed within 12 hours.

NOTE: For Actions 110 through 112 above, effluent releases may continue beyond the 30 days as long as the applicable sampling requirements are met. Explain in the next Radioactive Effluent Release Report why the inoperability was not corrected within the time specified.

TABLE 12.2.2-2

RADIOACTIVE GASEOUS EFFLUENT MONITORING INSTRUMENTATION SURVEILLANCE REQUIREMENTS

<u>INSTRUMENT</u>	<u>CHANNEL CHECK</u>	<u>SOURCE CHECK</u>	<u>CHANNEL FUNCTIONAL TEST</u>	<u>CHANNEL CALIBRATION</u>	<u>OPERATIONAL CONDITIONS FOR WHICH SURVEILLANCE REQUIRED</u>
1. MAIN CONDENSER OFFGAS TREATMENT SYSTEM EFFLUENT MONITORING SYSTEM					
a. Noble Gas Activity Monitor - Providing Alarm and Automatic Termination of Release	D	D	Q(1)	B(3)	**
2. MAIN STACK MONITORING SYSTEM					
a. Noble Gas Activity Monitor	D	M	Q(4)	B(3)	*
b. Iodine Sampler	W	N.A.	N.A.	N.A.	*
c. Particulate Sampler	W	N.A.	N.A.	N.A.	*
d. Effluent System Flow Rate Monitor	D	N.A.	Q	B	*
e. Sampler Flow Rate Monitor	D	N.A.	Q	B	*
3. CONDENSER AIR EJECTOR RADIOACTIVITY MONITOR					
a. Noble Gas Activity Monitor	D	M	Q(2)	B(3)	#
4. SBGTS MONITORING SYSTEM					
a. Noble Gas Activity Monitor	D	M	Q(4)	B(3)	##
b. Iodine Sampler	W	N.A.	N.A.	N.A.	##
c. Particulate Sampler	W	N.A.	N.A.	N.A.	##
d. Effluent System Flow Rate Monitor	D	N.A.	Q	B	##
e. Sampler Flow Rate Monitor	D	N.A.	Q	B	##

RADIOACTIVE GASEOUS EFFLUENT MONITORING INSTRUMENTATION SURVEILLANCE
REQUIREMENTS

TABLE 12.2.2-2 (Continued)

TABLE NOTATION

- * At all times.
 - ** During effluent releases via this pathway.
 - # During operation of the main condenser air ejector.
 - ## During operation of the SBGTS.
-
- (1) The CHANNEL FUNCTIONAL TEST shall also demonstrate the automatic isolation capability of this pathway for the following conditions:
 - 1. Upscale.
 - 2. Inoperative.
 - 3. Downscale.

 - (2) The CHANNEL FUNCTIONAL TEST for the log scale monitor shall also demonstrate that control room alarm annunciation occurs for the following conditions:
 - 1. Upscale.
 - 2. Inoperative.
 - 3. Downscale.

 - (3) The initial CHANNEL CALIBRATION shall be performed using one or more of the reference radioactive standards certified by the National Institute of Standards and Technology (NIST) or using standards that have been obtained from suppliers that participate in measurement assurance activities with NIST. These standards shall permit calibrating the system over its intended range of energy and measurement range. For subsequent CHANNEL CALIBRATION, the initial reference radioactive standards or radioactive sources that have been related to the initial calibration shall be used.

RADIOACTIVE GASEOUS EFFLUENT MONITORING INSTRUMENTATION SURVEILLANCE
REQUIREMENTS

TABLE 12.2.2-2 (Continued)

TABLE NOTATION

- (4) The CHANNEL FUNCTIONAL TEST shall also demonstrate that control room alarm annunciation occurs if any of the following conditions exists:
1. Instrument indicates measured levels above the alarm setpoint.
 2. Loss of Counts

12.3 LIQUID EFFLUENTS

12.3.1 Concentration

Operability Requirements

12.3.1.A The concentration of radioactive material released from the site shall be limited to ten (10) times the concentration value in Appendix B, Table 2, Column 2 to 10CFR20.1001-20.2402 for radionuclides other than dissolved or entrained noble gases. For dissolved or entrained noble gases, the concentration shall be limited to the concentrations specified in Table 12.3.1-1.

Applicability: At all times.

Action:

With the concentration of radioactive material released from the site exceeding the above limits, immediately restore the concentration to within the above limits.

Surveillance Requirements

12.3.1.B.1 The radioactivity content of each batch of radioactive liquid waste shall be determined prior to release by sampling and analysis in accordance with Table 12.3.1-2. The results of pre-release analyses shall be used with the calculational methods in the ODCM to assure that the concentration at the point of release is maintained within the limits of Section 12.3.1.A.

12.3.1.B.2 Post-release analyses of samples composited from batch releases shall be performed in accordance with Table 12.3.1-2. The results of the previous post-release analyses shall be used with the calculational methods in the ODCM to assure that the concentrations at the point of release were maintained within the limits of Section 12.3.1.A.

12.3.1.B.3 The radioactivity concentration of liquids discharged from continuous release points shall be determined by collection and analysis of samples in accordance with Table 12.3.1-2. The results of the analyses shall be used with the calculational methods in the ODCM to assure that the concentrations at the point of release are maintained within the limits of Section 12.3.1.A.

12.3.1.B.4 Identify outside temporary liquid holdup tanks within the site and restrict the quantity of radioactive material contained in specified tanks to provide assurance that in the event of an uncontrolled release of the tanks contents, the resulting concentrations would be less than the limits of Section 12.3.1.A. Refer to LaSalle Technical Specification 5.5.9.b.

Bases

12.3.1.C This requirement is provided to ensure that the concentration of radioactive materials released in liquid waste effluents from the site will be less than ten (10) times the concentration levels specified in Appendix B, Table 2, Column 2 to 10CFR20.1001-2402. This limitation provides additional assurance that the levels of radioactive materials in bodies of water outside the site will result in exposure within (1) the Section II.A design objectives of Appendix I, 10 CFR 50, to an individual, and (2) the limits of 10 CFR 20.1301 to the population. In addition, this limit is associated with 40 CFR 141 which states concentration limits at the nearest downstream potable water supply.

TABLE 12.3.1-1

ALLOWABLE CONCENTRATION (AC) OF
DISSOLVED OR ENTRAINED NOBLE GASES
RELEASED FROM THE SITE TO UNRESTRICTED AREAS
IN LIQUID WASTE

<u>NUCLIDE</u>	<u>AC(μCi/ml)*</u>
Kr 85 m	2E-4
85	5E-4
87	4E-5
88	9E-5
Ar 41	7E-5
Xe 131 m	7E-4
133 m	5E-4
133	6E-4
135 m	2E-4
135	2E-4

* Computed from Equation 20 of ICRP Publication 2 (1959), adjusted for infinite cloud submersion in water, and $R = 0.01$ rem/week, $p_w = 1.0$ gm/cm³, and $P_w/P_t = 1.0$.

TABLE 12.3.1-2

RADIOACTIVE LIQUID WASTE SAMPLING AND ANALYSIS PROGRAM

LIQUID RELEASE TYPE	SAMPLING FREQUENCY	MINIMUM ANALYSIS FREQUENCY	TYPE OF ACTIVITY ANALYSIS	LOWER LIMIT OF DETECTION (LLD) ($\mu\text{Ci/ml}$) ^a
A. Batch Waste Release Tanks ^d	P Each Batch	P Each Batch	Principal Gamma Emitters ^f	5×10^{-7}
			I-131	1×10^{-6}
	P One Batch/M	M	Dissolved and Entrained Gases (Gamma Emitters)	1×10^{-5}
	P Each Batch	M Composite ^b	H-3	1×10^{-5}
			Gross Alpha	1×10^{-7}
	P Each Batch	Q Composite ^b	Sr-89, Sr-90	5×10^{-8}
			Fe-55	1×10^{-6}
B. Continuous Releases ^e Cooling Pond Blowdown	Continuous ^c	W Composite ^c	Principal Gamma Emitters ^f	5×10^{-7}
			I-131	1×10^{-6}
	M Grab Sample	M	Dissolved and Entrained Gases (Gamma Emitters)	1×10^{-5}
	Continuous ^c	M Composite ^c	H-3	1×10^{-5}
			Gross Alpha	1×10^{-7}
	Continuous ^c	Q Composite ^c	Sr-89, Sr-90	5×10^{-8}
			Fe-55	1×10^{-6}

RADIOACTIVE LIQUID WASTE SAMPLING AND ANALYSIS PROGRAM

TABLE 12.3.1-2 (Continued)

TABLE NOTATION

- a. The LLD is the smallest concentration of radioactive material in a sample that will be detected with 95% probability with 5% probability of falsely concluding that a blank observation represents a "real" signal.

For a particular measurement system (which may include radiochemical separation):

$$LLD = \frac{4.66 s_b}{E \cdot V \cdot 2.22 \times 10^6 \cdot Y \cdot \exp(-\lambda \Delta t)}$$

Where:

- LLD is the "a priori" lower limit of detection as defined above (as microcurie per unit mass or volume),
- s_b is the standard deviation of the background counting rate or of the counting rate of a blank sample as appropriate (as counts per minute),
- E is the counting efficiency (as counts per transformation),
- V is the sample size (in units of mass or volume),
- 2.22×10^6 is the number of transformations per minute per microcurie,
- Y is the fractional radiochemical yield (when applicable),
- λ is the radioactive decay constant for the particular radionuclide and for composite samples, and
- Δt is the elapsed time between midpoint of sample collection and time of counting (for plant effluents, not environmental samples). For batch samples taken and analyzed prior to release, Δt is taken to be zero.

The value of s_b used in the calculation of the LLD for a detection system shall be based on the actual observed variance of the background counting rate or of the counting rate of the blank samples (as appropriate) rather than on an unverified theoretically predicted variance. Typical values of E, V, Y, and Δt shall be used in the calculation.

Alternate LLD Methodology

An alternate methodology for LLD determination follows and is similar to the above LLD equation:

$$LLD = \frac{(2.71 + 4.65\sqrt{B}) \cdot \text{Decay}}{E \cdot V \cdot Y \cdot t \cdot (2.22 \times 10^6)}$$

TABLE 12.3.1-2 (Continued)
RADIOACTIVE LIQUID WASTE SAMPLING AND ANALYSIS PROGRAM
TABLE NOTATIONS

Where:

B = background sum (counts)

E = counting efficiency

q = sample quantity (mass or volume)

b = abundance (if applicable)

Y = fractional radiochemical yield or collection efficiency (if applicable)

t = count time (minutes)

2.22×10^6 = number of disintegrations per minute per microCurie

$2.71 + 4.65\sqrt{B} = k^2 + (2k \sqrt{2} \sqrt{B})$, and $k = 1.645$

(k = value of the t statistic from the single-tailed t distribution at a significance level of 0.95 and infinite degrees of freedom. This means that the LLD result represents a 95% detection probability with a 5% probability of falsely concluding that the nuclide is present when it is not or that the nuclide is not present when it is.)

Decay = $e^{\lambda \Delta t} [\lambda RT / (1 - e^{-\lambda RT})] [\lambda T_d / (1 - e^{-\lambda T_d})]$ if applicable

λ = radioactive decay constant (units consistent with Δt , RT and T_d)

Δt = "delta t", or the elapsed time between sample collection or the midpoint of sample collection and the time the count is started, depending on the type of sample (units consistent with λ)

RT = elapsed real time, or the duration of the sample count (units consistent with λ)

T_d = sample deposition time, or the duration of analyte collection onto the sample media (units consistent with λ)

The LLD may alternately be determined using installed radioanalytical software, if available. In addition to determining the correct number of channels over which to total the background sum, utilizing the software's ability to perform decay corrections (i.e. during sample collection, from sample collection to start of analysis, and during counting), this alternate method will result in a more accurate determination of the LLD.

It should be recognized that the LLD is defined as a before the fact limit representing the capability of a measurement system and not as an after the fact limit for a particular measurement.

RADIOACTIVE LIQUID WASTE SAMPLING AND ANALYSIS PROGRAMTABLE 12.3.1-2 (Continued)TABLE NOTATION

- b. A composite sample is one in which the quantity of liquid sampled is proportional to the quantity of liquid waste discharged and in which the method of sample employed results in a specimen which is representative of the liquids released.
- c. To be representative of the quantities and concentrations of radioactive materials in liquid effluents, samples shall be collected in proportion to the rate of flow of the effluent stream. Prior to analyses, all samples taken for the composite shall be thoroughly mixed in order for the composite sample to be representative of the effluent release.
- d. A batch release is the discharge of liquid waste of a discrete volume. Prior to sampling for analyses, each batch shall be isolated, and then thoroughly mixed to assure representative sampling.
- e. A continuous release is the discharge of liquid wastes of a nondiscrete volume; e.g., from a volume of system that has an input flow during the continuous release.
- f. The principal gamma emitters for which the LLD specification applies exclusively are the following radionuclides: Mn-54, Fe-59, Co-58, Co-60, Zn-65, Mo-99, Cs-134, Cs-137, Ce-141, and Ce-144. This list does not mean that only these nuclides are to be detected and reported. Other peaks which are measurable and identifiable, at the 95% confidence level, together with the above nuclides, shall also be identified and reported.

12.3 LIQUID EFFLUENTS

12.3.2 Dose

Operability Requirements

12.3.2.A The dose or dose commitment to an individual from radioactive materials in liquid effluents released, from each reactor unit, from the site shall be limited:

- a. During any calendar quarter to less than or equal to 1.5 mrem to the total body and to less than or equal to 5 mrem to any organ, and
- b. During any calendar year to less than or equal to 3 mrem to the total body and to less than or equal to 10 mrem to any organ.

APPLICABILITY: At all times.

ACTION:

- a. With the calculated dose from the release of radioactive materials in liquid effluents exceeding any of the above limits, prepare and submit to the Commission, pursuant to 10CFR50, Appendix I, Section IV.A, a report which identifies the cause(s) for exceeding the limit(s) and defines the corrective actions to be taken to reduce the releases of radioactive materials in liquid effluents during the remainder of the current calendar quarter and during the subsequent three calendar quarters, so that the cumulative dose or dose commitment to an individual from these releases is within 3 mrem to the total body and 10 mrem to any organ. The Report shall also include the radiological impact on finished drinking water supplies at the nearest downstream drinking water source. The Report is due to the NRC within 30 days from the end of the quarter in which the release occurred.

Surveillance Requirements

12.3.2.B Dose Calculations- Cumulative dose contributions from liquid effluents shall be determined in accordance with the ODCM at least once per 31 days, when liquid discharges are performed.

Bases

12.3.2.C This requirement is provided to implement the requirements of Sections II.A, III.A and IV.A of Appendix I, 10 CFR Part 50. The Limiting Condition for Operation implements to guides set forth in Section II.A of Appendix I. The ACTION statements provide the required operating flexibility and at the same time implement the guides set forth in Section IV.A of Appendix I to assure that the releases of radioactive material in liquid effluents will be kept "as low as is reasonably achievable." Also, for fresh water sites with drinking water supplies which can be potentially affected by plant operations, there is reasonable assurance that the operation of the facility will not result in radionuclide concentrations in the finished drinking water that are in excess of the requirements of 40 CFR 141. The dose calculations in the ODCM implement the requirements in Section III.A of Appendix I that conformance with the guides of Appendix I be shown by calculational procedures based on models and data, such that the actual exposure of an individual through appropriate pathways is unlikely to be substantially underestimated. The equations specified in the ODCM for calculating the doses due to the actual release rates of radioactive materials in liquid effluents are consistent with the methodology provided in Regulatory Guide 1.109,

LASALLE

Revision 3
May 2001

"Calculation of Annual Doses to Man from Routine Releases of Reactor Effluents for the Purpose of Evaluating Compliance with 10 CFR Part 50, Appendix I," Revision 1, October 1977 and Regulatory Guide 1.113, "Estimating Aquatic Dispersion of Effluents from Accidental and Routine Reactor Releases for the Purpose of Implementing Appendix I," April 1977.

This requirement applies to the release of radioactive materials in liquid effluents from each reactor at the site. For units with shared radwaste treatment systems, the liquid effluents from the shared are proportioned among the units sharing that system.

12.3 LIQUID EFFLUENTS

12.3.3 Liquid Waste Treatment System

Operability Requirements

12.3.3.A The liquid radwaste treatment system shall be OPERABLE. The appropriate portions of the system shall be used to reduce the radioactive materials in liquid wastes prior to their discharge when the projected doses due to the liquid effluent from each reactor unit, from the site, when averaged over 31 days, would exceed 0.06 mrem to the total body or 0.2 mrem to any organ.

Applicability: At all times.

Action:

- a. With the liquid radwaste treatment system inoperable for more than 31 days or with radioactive liquid waste being discharged without treatment and in excess of the above limits, prepare and submit to the Commission within 30 days a Special Report which includes the following information:
 1. Identification of the inoperable equipment or subsystems and the reason for inoperability,
 2. Action(s) taken to restore the inoperable equipment to OPERABLE status, and
 3. Summary description of action(s) taken to prevent a recurrence.

Surveillance Requirements

12.3.3.B.1 Doses due to liquid releases shall be projected at least once per 31 days when releases are to be performed, in accordance with the methods in the ODCM.

12.3.3.B.2 The liquid radwaste treatment system shall be demonstrated OPERABLE by operating the liquid radwaste treatment system equipment for at least 30 minutes at least once per 92 days unless the liquid radwaste system has been utilized to process radioactive liquid effluents during the previous 92 days.

Bases

12.3.3.C

The OPERABILITY of the liquid radwaste treatment system ensures that this system will be available for use whenever liquid effluents require treatment prior to release to the environment. The requirement that the appropriate portions of this system be used when specified provides assurance that the releases of radioactive materials in liquid effluents will be kept "as low as is reasonably achievable." A system bypass allows connection to portable waste treatment equipment. This enables the efficient processing of liquid radwaste through the use of state-of-the-art radwaste processing technology. The portable radwaste treatment system may be used in lieu of various portions of the liquid radwaste treatment system including the evaporator. During extended shutdown or low power operation, i.e., > 92 days, when steam is not available to the concentrators and when a portable waste treatment is not used, Surveillance Requirement 12.3.3.B.2 may be extended to 180 days. This specification implements the requirements of 10 CFR Part 50.36a, General Design Criterion 50 of Appendix A to 10 CFR Part 50 and the design objective given in Section II.0 of Appendix I to 10 CFR Part 50. The specified limits governing the use of appropriate portions of the liquid radwaste treatment system were specified as a suitable fraction of the dose design objectives set forth in Section II.A of Appendix I, 10 CFR Part 50, for liquid effluents.

12.4 GASEOUS EFFLUENTS

12.4.1 Dose Rate

Operability Requirements

12.4.1.A The dose rate due to radioactive materials released in gaseous effluents from the site to areas at and beyond the SITE BOUNDARY, shall be limited to the following:

- a. For noble gases: Less than or equal to a dose rate of 500 mrem/yr to the total body and less than or equal to a dose rate of 3000 mrem/yr to the skin, and
- b. For iodine-131, for iodine-133, for tritium, and for all radionuclides in particulate form with half lives greater than 8 days: Less than or equal to a dose rate of 1500 mrems/yr to any organ via the inhalation pathway.

Applicability: At all times.

Action:

With the dose rate(s) exceeding the above limits, immediately decrease the release rate to within the above limit(s).

Surveillance Requirements

12.4.1.B.1 The dose rate due to noble gases in gaseous effluents shall be determined to be within the above limits in accordance with the methodology and parameters of the ODCM by obtaining representative samples and performing analyses in accordance with the sampling and analysis program specified in Table 12.4.1-1.

12.4.1.B.2 The dose rate due to iodine-131, iodine-133, tritium, and all radionuclides in particulate form with half lives greater than eight days, in accordance with the methodology and parameters of the ODCM by obtaining representative samples and performing analyses in accordance with the sampling and analysis program specified in Table 12.4.1-1.

Bases

12.4.1.C This specification is provided to ensure that the dose at any time at the site boundary from gaseous effluents from all units on the site will be within the annual dose limits of RETS for unrestricted areas. These limits provide reasonable assurance that radioactive material discharged in gaseous effluents will not result in the exposure of an individual in an unrestricted area, either within or outside the site boundary exceeding the limits specified in 10CFR20.1301. For individuals who may at times be within the site boundary, the occupancy of the individual will be sufficiently low to compensate for any increase in the atmospheric diffusion factor above that for the site boundary. The specified release rate limits restrict, at all times, the corresponding gamma and beta dose rates above background to an individual at or beyond the site boundary to less than or equal to a dose rate of 500 mrem/year to the total body or to less than or equal to a dose rate of 3000 mrem/year to the skin. These release rate limits also restrict, at all times, the corresponding thyroid dose rate above background via the inhalation pathway to less than or equal to a dose rate of 1500 mrem/year.

This specification applies to the release of radioactive effluents in gaseous effluents from all reactors at the site. For units within shared radwaste treatment systems, the gaseous effluents from the shared system are proportioned among the units sharing that system.

TABLE 12.4.1-1
RADIOACTIVE GASEOUS WASTE SAMPLING AND ANALYSIS PROGRAM

GASEOUS RELEASE TYPE	SAMPLING FREQUENCY	MINIMUM ANALYSIS FREQUENCY	TYPE OF ACTIVITY ANALYSIS	LOWER LIMIT OF DETECTION (LLD) ($\mu\text{Ci/ml}$) ^a
A. Containment Vent and Purge System ^h	P Each Purge ^b Grab Sample	P Each Purge ^b	Principal Gamma Emitters ^g	1×10^{-4}
			H-3	1×10^{-6}
B. Main Vent Stack	M ^b Grab Sample	M ^b	Principal Gamma Emitters ^g	1×10^{-4}
	W ^{b,e} Grab Sample	W ^{b,e}	H-3	1×10^{-6}
C. Standby Gas Treatment System	D ^c Grab Sample	D ^c	Principal Gamma Emitters ^g	1×10^{-4}
D. Main Vent Stack And Standby Gas Treatment System ^c	Continuous ^f	W ^d Charcoal Sample	I-131	1×10^{-12}
			I-133	1×10^{-10}
	Continuous ^f	W ^d Particulate Sample	Principal Gamma Emitters ^g (I-131, Others)	1×10^{-11}
	Continuous ^f	M Composite Particulate Sample	Gross Alpha	1×10^{-11}
	Continuous ^f	Q Composite Particulate Sample	Sr-89, Sr-90	1×10^{-11}
	Continuous ^f	Noble Gas Monitor	Noble Gases Gross Beta or Gamma	1×10^{-6}

LASALLE

Revision 3
May 2001

TABLE 12.4.1-1 (Continued)

GASEOUS RELEASE TYPE	SAMPLING FREQUENCY	MINIMUM ANALYSIS FREQUENCY	TYPE OF ACTIVITY ANALYSIS	LOWER LIMIT OF DETECTION (LLD) ($\mu\text{Ci/ml}$) ^a
E. Oil Burner	P Each Batch Grab Sample	P Each Batch	Principle Gamma Emitters	5×10^{-7}
			Dissolved and Entrained Gases (Gamma Emitters)	1×10^{-5}
			I-131	1×10^{-6}
	P Each Batch Grab Sample	M Composite	H-3	1×10^{-5}
			Gross Alpha	1×10^{-7}
		Q Composite	Sr-89, Sr-90	5×10^{-8}
			Fe-55	1×10^{-6}

TABLE 12.4.1-1 (Continued)

RADIOACTIVE GASEOUS WASTE SAMPLING AND ANALYSIS PROGRAM

TABLE NOTATION

- a. The LLD is the smallest concentration of radioactive material in a sample that will be detected with 95% probability with 5% probability of falsely concluding that a blank observation represents a "real" signal.

For a particular measurement system (which may include radiochemical separation):

$$4.66 s_b$$

$$LLD = \frac{4.66 s_b}{E \cdot V \cdot 2.22 \times 10^6 \cdot Y \cdot \exp(-\lambda \Delta t)}$$

Where:

LLD is the "a priori" lower limit of detection as defined above (as microcurie per unit mass or volume),

s_b is the standard deviation of the background counting rate or of the counting rate of a blank sample as appropriate (as counts per minute),

E is the counting efficiency (as counts per transformation),

V is the sample size (in units of mass or volume),

2.22×10^6 is the number of transformations per minute per microcurie,

Y is the fractional radiochemical yield (when applicable),

λ is the radioactive decay constant for the particular radionuclide, and

Δt is the elapsed time between midpoint of sample collection and time of counting (for plant effluents, not environmental samples).

The value of s_b used in the calculation of the LLD for a detection system shall be based on the actual observed variance of the background counting rate or of the counting rate of the blank samples (as appropriate) rather than on an unverified theoretically predicted variance. Typical values of E, V, Y, and Δt shall be used in the calculation.

Alternate LLD Methodology

An alternate methodology for LLD determination follows and is similar to the above LLD equation:

$$LLD = \frac{(2.71 + 4.65\sqrt{B}) \cdot \text{Decay}}{E \cdot V \cdot Y \cdot t \cdot (2.22 \times 10^6)}$$

TABLE 12.4.1-1 (Continued)
RADIOACTIVE GASEOUS WASTE SAMPLING AND ANALYSIS PROGRAM
TABLE NOTATION

Where:

B = background sum (counts)

E = counting efficiency

q = sample quantity (mass or volume)

b = abundance (if applicable)

Y = fractional radiochemical yield or collection efficiency (if applicable)

t = count time (minutes)

2.22×10^6 = number of disintegrations per minute per microCurie

$2.71 + 4.65\sqrt{B} = k^2 + (2k\sqrt{2}\sqrt{B})$, and $k = 1.645$

(k=value of the t statistic from the single-tailed t distribution at a significance level of 0.95 and infinite degrees of freedom. This means that the LLD result represents a 95% detection probability with a 5% probability of falsely concluding that the nuclide is present when it is not or that the nuclide is not present when it is.)

Decay = $e^{\lambda\Delta t} [\lambda RT / (1 - e^{-\lambda RT})] [\lambda T_d / (1 - e^{-\lambda T_d})]$ if applicable

λ = radioactive decay constant (units consistent with Δt , RT and T_d)

Δt = "delta t", or the elapsed time between sample collection or the midpoint of sample collection and the time the count is started, depending on the type of sample (units consistent with λ)

RT = elapsed real time, or the duration of the sample count (units consistent with λ)

T_d = sample deposition time, or the duration of analyte collection onto the sample media (units consistent with λ)

The LLD may alternately be determined using installed radioanalytical software, if available. In addition to determining the correct number of channels over which to total the background sum, utilizing the software's ability to perform decay corrections (i.e. during sample collection, from sample collection to start of analysis, and during counting), this alternate method will result in a more accurate determination of the LLD.

It should be recognized that the LLD is defined as a before the fact limit representing the capability of a measurement system and not as an after the fact limit for a particular measurement.

- b. Sampling and analyses shall also be performed following shutdown, startup, or a thermal power change exceeding 20 percent of rated thermal power in 1 hour unless (1) analysis shows that the dose equivalent I-131 concentration in the primary coolant has not increased more than a factor of 5, and (2) the noble gas activity monitor shows that effluent activity has not increased by more than a factor of 3.

TABLE 12.4.1-1 (Continued)
RADIOACTIVE GASEOUS WASTE SAMPLING AND ANALYSIS PROGRAM
TABLE NOTATION

- c. Whenever there is flow through the SBGTS. (If SBT is run more than 10 minutes in a 24 hour period then it must be run a minimum of 5 hours. The 5 hour run is required to meet the sample requirements for iodine and particulates.) When SBT equipment is started and shutdown, ensure noble gas iodine and particulate samples are taken.
- d. Samples shall be changed at least once per 7 days and the analyses completed within 48 hours after removal from the sampler. Sampling shall also be performed within 24 hours following each shutdown, startup, or thermal power level change exceeding 20% of rated thermal power in one hour. This requirement does not apply if 1) analysis shows that the dose equivalent I-131 concentration in the primary coolant has not increased by more than a factor of 5, and 2) the noble gas activity monitor shows that effluent activity has not increased by more than a factor of 3. When samples collected for 24 hours are analyzed, the corresponding LLDs may be increased by a factor of 10.
- e. Tritium grab samples shall be taken at least once per 7 days from the plant vent to determine tritium releases in the ventilation exhaust from the spent fuel pool area whenever spent fuel is in the spent fuel pool. If there is no spent fuel in the fuel pool, sampling and analysis of tritium grab samples shall be performed at least monthly.
- f. The ratio of the sample flow rate to the sampled stream flow rate shall be known for the time period covered by each dose or dose rate calculation made in accordance with Sections 12.4.1.A, 12.4.2.A and 12.4.3.A.
- g. The principal gamma emitters for which the LLD specification applies include the following radionuclides: Kr-87, Kr-88, Xe-133, Xe-133m, Xe-135, and Xe-138 for gaseous emissions and Mn-54, Fe-59, Co-58, Co-60, Zn-65, Mo-99, Cs-134, Cs-137, Ce-141 and Ce-144 for particulate emissions. This list does not mean that only these nuclides are to be detected and reported. Other peaks which are measurable and identifiable, at the 95% confidence level, together with the above nuclides, shall also be identified and reported.
- h. The drywell tritium and noble gas sample results are valid for 30 hours from sample time if 1) the drywell radioactivity monitors have not indicated an increase in airborne or gaseous radioactivity, and 2) the drywell equipment and floor drain sump pumps run times have not indicated an increase in leakage in the drywell since the sample was taken, and 3) conditions are such that activity can be calculated for the radionuclide concentration at the time of the release.

If there is any reason to suspect that gaseous radioactivity levels have changed in the drywell that would compromise the calculated, or estimated, radionuclide concentrations at the time of the release, since the last sample (30 hours), a new sample and analyses should be requested prior to starting a drywell purge to meet the intent of providing current analyses to reflect actual activity released to the environment. If a known steady state leakage condition exists in the drywell it is possible to calculate a safe and accurate release package. Final release quantification will be based on calculated radionuclide concentrations at the time of the actual release.

If the drywell is purged in accordance with the ODCM definition, both noble gas and tritium analyses must be completed before the purge begins. If the drywell is simply vented in accordance with the ODCM definition, no sample is required before venting.

12.4 GASEOUS EFFLUENTS

12.4.2 Dose - Noble Gases

Operability Requirements

- 12.4.2.A The air dose due to noble gases released in gaseous effluents, from each reactor unit, from the site shall be limited to the following:
- a. During any calendar quarter: Less than or equal to 5 mrad for gamma radiation and less than or equal to 10 mrad for beta radiation, and
 - b. During any calendar year: Less than or equal to 10 mrad for gamma radiation and less than or equal to 20 mrad for beta radiation.

Applicability: At all times.

Action:

- a. With the calculated air dose from radioactive noble gases in gaseous effluents exceeding any of the above limits, prepare and submit to the Commission, pursuant to 10CFR50, Appendix I, Section IV.A, a report which identifies the cause(s) for exceeding the limit(s) and defines the corrective actions to be taken to reduce the releases and the proposed corrective actions to be taken to assure that subsequent releases will be in compliance with the above limits. This report is due to the NRC within 30 days from the end of the quarter in which the release occurred.

Surveillance Requirements

- 12.4.2.B Dose Calculations - Cumulative dose contributions for the current calendar quarter and current calendar year shall be determined in accordance with the ODCM at least once per 31 days.

Bases

- 12.4.2.C This specification is provided to implement the requirements of Sections II.B, III.A and IV.A of Appendix I, 10 CFR Part 50. The Operability Requirements are the guides set forth in Section II.B of Appendix I. The ACTION statements provide the required operating flexibility and at the same time implement the guides set forth in Section IV.A of Appendix I to assure that the releases of radioactive material in gaseous effluents will be kept "as low as is reasonably achievable." The Surveillance Requirements implement the requirements in Section III.A of Appendix I that conformance with the guides of Appendix I be shown by calculational procedures based on models and data such that the actual exposure of an individual through appropriate pathways is unlikely to be substantially underestimated. The dose calculations established in the ODCM for calculating the doses due to the actual release rates of radioactive noble gases in gaseous effluents are consistent with the methodology provided in Regulatory Guide 1.109, "Calculation of Annual Doses to Man from Routine Releases of Reactor Effluents for the Purpose of Evaluating Compliance with 10 CFR Part 50, Appendix I, "Revision 1, October 1977 and Regulatory Guide 1.111, "Methods for Estimating Atmospheric Transport and Dispersion of Gaseous Effluents in Routine Releases from Light-Water Cooled Reactors," Revision I, July 1977. The ODCM equations provided for determining the air doses at the site boundary are based upon the historical average atmospheric conditions.

12.4 GASEOUS EFFLUENTS

12.4.3 Dose - Iodine-131, Iodine-133, Tritium, and Radionuclides in Particulate Form

Operability Requirements

12.4.3.A The dose to a MEMBER OF THE PUBLIC from iodine-131, iodine-133, tritium, and all radionuclides in particulate form with half-lives greater than 8 days in gaseous effluents released, from each reactor unit, to areas at and beyond the SITE BOUNDARY shall be limited to the following:

- a. During any calendar quarter: Less than or equal to 7.5 mrems to any organ and,
- b. During any calendar year: Less than or equal to 15 mrems to any organ.

Applicability: At all times.

Action:

- a. With the calculated dose from the release of iodine-131, iodine-133, tritium, and radionuclides in particulate form with half lives greater than 8 days, in gaseous effluents exceeding any of the above limits, prepare and submit to the Commission, pursuant to 10CFR50, Appendix I, Section IV.A, a report that identifies the cause(s) for exceeding the limit and defines the corrective actions that have been taken to reduce the releases and the proposed correction actions to be taken to assure that subsequent releases will be in compliance with the above limits. This report is due to the NRC within 30 days from the end of the quarter in which the release occurred.

Surveillance Requirements

12.4.3.B Cumulative dose contributions for the current calendar quarter and current calendar year for iodine-131, iodine-133, tritium, and radionuclides in particulate form with half lives greater than 8 days shall be determined in accordance with the methodology and parameters in the ODCM at least once per 31 days.

Bases

12.4.3.C

The specification is provided to implement the requirements of Sections II.C, III.A and IV.A of Appendix I, 10 CFR Part 50. The Operability Requirements are the guides set forth in Section II.C of Appendix I. The ACTION statements provide the required operating flexibility and at the same time implement the guides set forth in Section IV.A of Appendix I to assure that the releases of radioactive materials in gaseous effluents will be kept "as low as is reasonably achievable." The ODCM calculational methods specified in the Surveillance Requirements implement the requirements in Section III.A of Appendix I that conformance with the guides of Appendix I be shown by calculational procedures based on models and data, such that the actual exposure of an individual through appropriate pathways is unlikely to be substantially underestimated. The ODCM calculational methods for calculating the doses due to the actual release rates of the subject materials are consistent with the methodology provided in Regulatory Guide 1.109, "Calculation of Annual Doses to Man from Routine Releases of Reactor Effluents for the Purpose of Evaluating Compliance with 10 CFR Part 50, Appendix I, "Revision 1, October 1977 and Regulatory Guide 1.111, "Methods for Estimating Atmospheric Transport and Dispersion of Gaseous Effluents in Routine Releases from Light-Water-Cooled Reactors," Revision 1, July 1977. These equations also provide for determining the actual doses based upon the historical average atmospheric conditions. The release rate specifications for radioiodines, radioactive materials in particulate form and radionuclides other than noble gases are dependent on the existing radionuclide pathways to man, in the unrestricted area. The pathways which were examined in the development of these calculations were: 1) individual inhalation of airborne radionuclides, 2) deposition of radionuclides onto green leafy vegetation with subsequent consumption by man, 3) deposition onto grassy areas where milk animals and meat producing animals graze with consumption of the milk and meat by man, and 4) deposition on the ground with subsequent exposure of man.

12.4 GASEOUS EFFLUENTS

12.4.4 Gaseous Radwaste Treatment System

Operability Requirements

12.4.4.A The GASEOUS RADWASTE (OFF-GAS) TREATMENT SYSTEM shall be in operation.

Applicability: Whenever the main condenser air ejector system is in operation.

Action:

a. With the GASEOUS RADWASTE (OFF-GAS) TREATMENT SYSTEM inoperable for more than 7 days, prepare and submit to the Commission within 30 days, a Special Report which includes the following information:

1. Identification of the inoperable equipment or subsystems and the reason for inoperability.
2. Action(s) taken to restore the inoperable equipment to OPERABLE status, and
3. Summary description of action(s) taken to prevent a recurrence.

Surveillance Requirements

12.4.4.B The GASEOUS RADWASTE TREATMENT SYSTEM shall be verified to be in operation at least once per 7 days.

Bases

12.4.4.C The OPERABILITY of the GASEOUS RADWASTE TREATMENT SYSTEM and the VENTILATION EXHAUST TREATMENT SYSTEM ensures that the system will be available for use whenever gaseous effluents require treatment prior to release to the environment. The requirement that the appropriate portions of these systems be used, when specified, provides reasonable assurance that the releases of radioactive materials in gaseous effluents will be kept "as low as is reasonably achievable". This specification implements the requirements of 10 CFR Part 50.36a, General Design Criterion 60 of Appendix A to 10 CFR Part 50, and the design objectives given in Section II,0 of Appendix I to 10 CFR Part 50. The specified limits governing the use of appropriate portions of the systems were specified as a suitable fraction of the dose design objectives set forth in Sections II.B and II.C of Appendix I, 10 CFR Part 50, for gaseous effluents.

12.4 GASEOUS EFFLUENTS

12.4.5 Ventilation Exhaust Treatment System

Operability Requirements

12.4.5.A The appropriate portions of the VENTILATION EXHAUST TREATMENT SYSTEM shall be OPERABLE and be used to reduce radioactive materials in gaseous waste prior to their discharge when the projected doses due to gaseous effluent releases from each reactor unit, from the site, when averaged over 31 days, would exceed 0.3 mrem to any organ.

Applicability: At all times.

Action:

With the VENTILATION EXHAUST TREATMENT SYSTEM inoperable for more than 31 days, and with gaseous waste being discharged without treatment and in excess of the above limits, prepare and submit to the Commission within 30 days, a Special Report which includes the following information:

1. Identification of the inoperable equipment or subsystems and the reason for inoperability,
2. Action(s) taken to restore the inoperable equipment to OPERABLE status, and
3. Summary description of action(s) taken to prevent a recurrence.

Surveillance Requirements

12.4.5.B.1 Doses due to gaseous releases from the site shall be projected at least once per 31 days in accordance with the ODCM.

12.4.5.B.2 The VENTILATION EXHAUST TREATMENT SYSTEM shall be demonstrated OPERABLE by operating the VENTILATION EXHAUST TREATMENT SYSTEM equipment for at least 30 minutes, at least once per 92 days unless the appropriate system has been utilized to process radioactive gaseous effluents during the previous 92 days.

Bases

12.4.5.C The OPERABILITY of the GASEOUS RADWASTE TREATMENT SYSTEM and the VENTILATION EXHAUST TREATMENT SYSTEM ensures that the system will be available for use whenever gaseous effluents require treatment prior to release to the environment. The requirement that the appropriate portions of these systems be used, when specified, provides reasonable assurance that the releases of radioactive materials in gaseous effluents will be kept "as low as is reasonably achievable". This specification implements the requirements of 10 CFR Part 50.36a, General Design Criterion 60 of Appendix A to 10 CFR Part 50, and the design objectives given in Section II.0 of Appendix I to 10 CFR Part 50. The specified limits governing the use of appropriate portions of the systems were specified as a suitable fraction of the dose design objectives set forth in Sections II.B and II.C of Appendix I, 10 CFR Part 50, for gaseous effluents.

12.4 GASEOUS EFFLUENTS

12.4.6 Venting or Purging

Operability Requirements

12.4.6.A VENTING or PURGING of the containment drywell shall be through the Primary Containment Vent and Purge System or the Standby Gas Treatment System.

Applicability: Whenever the drywell is vented or purged.

Action:

- a. With the requirements of the above specification not satisfied, suspend all VENTING and PURGING of the drywell.

Surveillance Requirements

12.4.6.B.1 The containment drywell shall be determined to be aligned for VENTING or PURGING through the Primary Containment Vent and Purge System or the Standby Gas Treatment System within 4 hours prior to start of and at least once per 12 hours during VENTING or PURGING of the drywell.

12.4.6.B.2 Prior to use of the Purge System through the Standby Gas Treatment System in MODE 1, 2 or 3 assure that:

- a. Both Standby Gas Treatment System trains are OPERABLE, and
- b. Only one of the Standby Gas Treatment System trains is used for PURGING.

Bases

12.4.6.C This specification provides reasonable assurance that releases from drywell purging operations will not exceed the annual dose limits of 10CFR20 for unrestricted areas.

12.4 GASEOUS EFFLUENTS

12.4.7 Total Dose

Operability Requirements

12.4.7.A The dose or dose commitment to any member of the public, due to releases of radioactivity and radiation, from uranium fuel cycle sources shall be limited to less than or equal to 25 mrem to the total body or any organ (except the thyroid, which shall be limited to less or equal to 75 mrem) over 12 consecutive months.

Applicability: At all times.

Action:

With the calculated doses from the release of radioactive materials in liquid or gaseous effluents exceeding twice the limits of Sections 12.3.2.A.a, 12.3.2.A.b, 12.4.2.A.a, 12.4.2.A.b, 12.4.3.A.a or 12.4.3.A.b, prepare and submit a Special Report to the Director, Nuclear Reactor Regulation, U.S. Nuclear Regulatory Commission, Washington, D.C. 20555, within 30 days, which defines the corrective action to be taken to reduce subsequent releases to prevent recurrence of exceeding the limits of Section 12.4.7.A. This Special Report shall include an analysis which estimates the radiation exposure (dose) to a member of the public from uranium fuel cycle sources (including all effluents pathways and direct radiation) for a 12 consecutive month period that includes the release(s) covered by this report. If the estimated dose(s) exceeds the limits of Section 12.4.7.A, and if the release condition resulting in violation of 40 CFR 190 has not already been corrected, the Special Report shall include a request for a variance in accordance with the provisions of 40 CFR 190 and including the specified information of 40 CFR 190.11. Submittal of the report is considered a timely request, and a variance is granted until staff action on the request is complete. The variance only relates to the limits of 40 CFR 190, and does not apply in any way to the requirements for dose limitation of 10 CFR Part 20, as addressed in other sections of this technical specification.

Surveillance Requirements

12.4.7.B Dose Calculations - Cumulative dose contributions from direct radiation and liquid and gaseous effluents shall be determined in accordance with Sections 12.3.2.B, 12.4.2.B and 12.4.3.B, and in accordance with the ODCM.

Bases

12.4.7.C This specification is provided to meet the dose limitations of 40 CFR 190. The specification requires the preparation and submittal of a Special Report whenever the calculated doses from plant radioactive effluents exceed twice the design objective doses of Appendix I. For sites containing up to 4 reactors, it is highly unlikely that the resultant dose to a member of the public will exceed the dose limits of 40 CFR 190 if the individual reactors remain within the reporting requirement level. The Special Report will describe a course of action which should result in the limitation of dose to a member of the public for 12 consecutive months to within the 40 CFR 190 limits. For the purpose of the Special Report, it may be assumed that the dose commitment to the member of the public from other uranium fuel cycle sources is negligible, with the exception that dose contributions from other nuclear fuel cycle facilities at the same site or within a radius of 5 miles must be considered. If the dose to any member of the public is estimated to exceed the requirements of 40 CFR 190, the Special Report with a request for a variance (provided the release conditions resulting in violation of 40 CFR 190 have not already been corrected), in accordance with the provisions of 40 CFR 190.11, is considered to be a timely request and fulfills the requirements of 40 CFR 190 until NRC staff action is completed. An individual is not considered a member of the public during any period in which he/she is engaged in carrying out any operation which is part of the nuclear fuel cycle.

12.4 GASEOUS EFFLUENTS

12.4.8 Main Condenser

Operability Requirements

12.4.8.A The release rate of the sum of the activities from the noble gases measured prior to the holdup line shall be limited to less than or equal to 3.4×10^5 microcuries/second after decay of 30 minutes.

Applicability: MODE 1. MODES 2 and 3 with any main steam line not isolated and steam jet air ejectors (SJAE) not in operation.

Action:

With the release rate of the sum of the activities from the noble gases prior to the holdup line exceeding 3.4×10^5 microcuries/second after decay of 30 minutes, restore the release rate to within its limit within 72 hours or either isolate all main steam lines or isolate the SJAEs in the next 12 hours, or be in MODE 3 in the next 12 hours and MODE 4 in the next 24 hours.

Surveillance Requirements

12.4.8.B.1 The radioactivity rate of noble gases prior to the holdup line shall be continuously monitored in accordance with the ODCM and Table 12.2.2-2.

12.4.8.B.2 *The release rate of the sum of the activities from noble gases prior to the holdup line shall be determined to be within the limits of specification 12.4.8.A at the following frequencies by performing an isotopic analysis of a representative sample of gases taken prior to the holdup line.

- a. At least once per 31 days.
- b. Within 4 hours following an increase, as indicated by the off gas pre-treatment Noble Gas Activity Monitor, of greater than 50%, after factoring out increases due to changes in THERMAL POWER level, in the nominal steady state fission gas release from the primary coolant.

* Not required to be performed until 31 days after any main steam line not isolated and SJAE not in operation.

Bases

12.4.8.C In accordance with surveillance requirements contained within ODCM Chapter 12 item number 12.4.8.B.1 and 2, this specification provides reasonable assurance that the releases from the main condenser will not exceed the requirements of the LaSalle Technical Specifications 3.7.6. In addition, a sample is required within 4 hours if the increase is not due to thermal power changes. If the cause is known and not fuel related and less than 1 hour in duration, then no sample is required. [This is based on interpretation letter from W. R. Huntington to Operating Engineers, Shift Engineers and F.R. Lawless, dated May 24, 1984.]

12.4.9 Dose Limits for Members of the PublicOperability Requirements

12.4.9.A The licensee shall conduct operations such that the TEDE to individual MEMBERS OF THE PUBLIC does not exceed 100 mrem in a year. In addition, the dose in any unrestricted area from external sources does not exceed 2 mrem in any one hour. The Effluents Program shall implement monitoring, sampling, and analysis of radioactive liquid and gaseous effluents in accordance with 10CFR20.1302 and with the methodology and parameters in the ODCM.

Applicability: At all times.

Action:

1. If the calculated dose from the release or exposure of radiation meets or exceeds the 100 mrem/year limit for the MEMBER OF THE PUBLIC, prepare and submit a report to the Commission in accordance with 10CFR20.2203.
2. If the dose in any unrestricted area from external sources of radiation meets or exceeds the 2 mrem in any one hour limit for the MEMBER OF THE PUBLIC, prepare and submit a report to the Commission in accordance with 10CFR20.2203.

Surveillance Requirements

12.4.9.B Calculate the TEDE to individual MEMBERS OF THE PUBLIC annually to determine compliance with the 100 mrem/year limit in accordance with the ODCM. In addition, evaluate and/or determine if direct radiation exposures exceed 2 mrem in any hour in unrestricted areas.

Bases

12.4.9.C This section applies to direct exposure of radioactive materials as well as radioactive materials released in gaseous and liquid effluents. 10CFR20.1301 sets forth the 100 mrem/year dose limit to members of the public; 2 mrem in any one hour limit in the unrestricted area; and reiterates that the licensee is also required to meet the 40CFR190 standards. 10CFR20.1302 provides options to determine compliance to 10CFR20.1301. Compliance to the above operability requirement is based on 10CFR20, 40CFR190 and LaSalle Station Technical Specification 5.5.4.g.

12.5 RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM12.5.1 Monitoring ProgramOperability Requirements

- 12.5.1.A The Radiological Environmental Monitoring Program shall be conducted as specified in Table 12.5-1.

Applicability: At all times.

Action:

1. With the Radiological Environmental Monitoring Program not being conducted as specified in Table 12.5-1, prepare and submit to the Commission, in the Annual Radiological Environmental Operating Report required by Technical Specification 5.6.2, a description of the reasons for not conducting the program as required and the plans for preventing a recurrence.

Deviations are permitted from the required sampling schedule if specimens are unobtainable due to hazardous conditions, seasonal unavailability, malfunction of sampling equipment, if a person/business who participates in this program goes out of business or no longer can provide sample, or contractor omission which is corrected as soon as discovered. If the equipment malfunctions, corrective actions shall be completed as soon as practical. If a person/business supplying samples goes out of business, a replacement supplier shall be found as soon as possible. All deviations from the sampling schedule shall be described in the Annual Radiological Environmental Operating Report.

2. With the level of radioactivity as the result of plant effluents in an environmental sampling medium at a specified location exceeding the reporting levels of Table 12.5-2 when averaged over any calendar quarter, prepare and submit to the Commission within 30 days, a Special Report that identifies the cause(s) for exceeding the limit(s) and defines the corrective actions to be taken to reduce radioactive effluents so that the potential annual dose* to a MEMBER OF THE PUBLIC is less than the calendar year limits of Section 12.3.2, 12.4.2, or 12.4.3. When more than one of the radionuclides in Table 12.5.2 are detected in the sampling medium, this report shall be submitted if:

$$\frac{\text{concentration (1)}}{\text{reporting level (1)}} + \frac{\text{concentration (2)}}{\text{reporting level (2)}} \geq 1.0$$

When radionuclides other than those in Table 12.5-2 are detected and are the result of plant effluents, this report shall be submitted if the potential annual dose* to A MEMBER OF THE PUBLIC from all radionuclides is equal to or greater than the calendar year limits of Section 12.3.2, 12.4.2, or 12.4.3. This report is not required if the measured level of radioactivity was not the result of plant effluents; however, in such an event, the condition shall be reported and described in the Annual Radiological Environmental Operating Report required by Section 12.6.1.

*The methodology and parameters used to estimate the potential annual dose to a MEMBER OF THE PUBLIC shall be indicated in this report.

12.5 RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM (Continued)

3. If the sample type or sampling location(s) as required by Table 12.5-1 become(s) permanently unavailable, identify suitable alternative sampling media for the pathway of interest and/or specific sampling locations for obtaining replacement samples and add them to the Radiological Environmental Monitoring Program as soon as practicable. The specific locations from which samples were unavailable may then be deleted from the monitoring program.

Prepare and submit controlled version of the ODCM within 180 days including a revised figure(s) and table reflecting the new location(s) with supporting information identifying the cause of the unavailability of samples and justifying the selection of new location(s) for obtaining samples.

Surveillance Requirements

- 12.5.1.B The radiological environmental monitoring program samples shall be collected pursuant to Table 12.5-1 from the specific locations given in the table and figure(s) in the ODCM, and shall be analyzed pursuant to the requirements of Table 12.5-1 and the detection capabilities required by Table 12.5-3.

Bases

- 12.5.1.C The Radiological Environmental Monitoring Program required by this section provides representative measurements of radiation and of radioactive materials in those exposure pathways and for those radionuclides that lead to the highest potential radiation exposures of MEMBERS OF THE PUBLIC resulting from the station operation. This monitoring program implements Section IV.B.2 of Appendix I to 10 CFR Part 50 and thereby supplements the radiological effluent monitoring program by verifying that the measurable concentrations of radioactive materials and levels of radiation are not higher than expected on the basis of the effluent measurements and the modeling of the environmental exposure pathways. Guidance for this monitoring program is provided by the Radiological Assessment Branch Technical Position on Environmental Monitoring. The initially specified monitoring program will be effective for at least the first 3 years of commercial operation. Following this period, program changes may be initiated based on operational experience.

The required detection capabilities for environmental sample analyses are tabulated in terms of the lower limits of detection (LLDs). The LLDs required by Table 12.5-3 are considered optimum for routine environmental measurements in industrial laboratories. It should be recognized that the LLD is defined as a before the fact limit representing the capability of a measurement system and not as an after the fact limit for a particular measurement.

Detailed discussion of the LLD, and other detection limits, can be found in HASL Procedures Manual, HASL-300 (revised annually), Currie, LA., "Limits for Qualitative Detection and Quantitative Determination - Application to Radiochemistry," Anal. Chem. **40**, 586-93 (1968), and Hartwell, J.K., "Detection Limits for Radioanalytical Counting Techniques," Atlantic Richfield Hanford Company Report ARH-SA-215 (June 1975).

12.5 RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM (Continued)

Interpretations

12.5.1.D Table 12.5-1 requires "one sample of each community drinking water supply downstream of the plant within 10 kilometers." Drinking water supply is defined as water taken from rivers, lakes, or reservoirs (not well water) which is used for drinking.

LASALLE

Revision 3
May 2001

TABLE 12.5-1
RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM

EXPOSURE PATHWAY AND/ OR SAMPLE	NUMBER OF REPRESENTATIVE SAMPLES AND SAMPLE LOCATIONS ⁽¹⁾	SAMPLING AND COLLECTION FREQUENCY	TYPE AND FREQUENCY OF ANALYSIS
<p>1. Airborne Radioiodine and Particulates</p>	<p>Samples from a total of eight locations:</p> <p>a. Indicator- Near Field</p> <p>Four samples from locations within 4 km (2.5 mi) in different sectors.</p> <p>b. Indicator- Far Field</p> <p>Three additional locations within 4 to 10 km (2.5 to 6.2 mi) in different sectors.</p> <p>c. Control</p> <p>One sample from a control location within 10 to 30 km (6.2 to 18.6 mi).</p>	<p>Continuous sampler operation with particulate sample collection weekly (or more frequently if required due to dust loading) and radioiodine canister collection biweekly.</p>	<p>Radioiodine Canister: I-131 analysis biweekly on near field and control samples.⁽²⁾</p> <p>Particulate Sampler: Gross beta analysis following weekly filter change⁽³⁾ and gamma isotopic analysis⁽⁴⁾ quarterly on composite filters by location on near field and control⁽²⁾ samples.</p>

LASALLE

Revision 3
May 2001

TABLE 12.5-1 (Continued)
RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM

EXPOSURE PATHWAY AND/ OR SAMPLE	NUMBER OF REPRESENTATIVE SAMPLES AND SAMPLE LOCATIONS ⁽¹⁾	SAMPLING AND COLLECTION FREQUENCY	TYPE AND FREQUENCY OF ANALYSIS
<p>2. Direct Radiation⁽⁵⁾</p>	<p>Forty routine monitoring stations either with a thermoluminescent dosimeter (TLD) or with one instrument for measuring dose rate continuously, placed as follows:</p> <p>a. Indicator- Inner Ring (100 Series TLD)</p> <p>One in each meteorological sector, in the general area of the SITE BOUNDARY (within 0.1 to 2.0 mi; 0.2 to 3.2 km)</p> <p>b. Indicator- Outer Ring (200 Series TLD)</p> <p>One in each meteorological sector, within 4.8 to 10 km (3 to 6.2 mi); and</p> <p>c. Other</p> <p>One at each Airborne location given in part 1.a. and 1.b.</p> <p>The balance of the TLDs to be placed at special interest locations beyond the Restricted Area where either a MEMBER OF THE PUBLIC or Commonwealth Edison employees have routine access. (300 Series TLD)</p>	<p>Quarterly</p>	<p>Gamma dose on each TLD quarterly.</p>

LASALLE

Revision 3
May 2001

TABLE 12.5-1 (Continued)
RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM

EXPOSURE PATHWAY AND/ OR SAMPLE	NUMBER OF REPRESENTATIVE SAMPLES AND SAMPLE LOCATIONS ⁽¹⁾	SAMPLING AND COLLECTION FREQUENCY	TYPE AND FREQUENCY OF ANALYSIS
2. Direct Radiation ⁽⁵⁾ (Cont'd)	d. Control One at each Airborne control location given in part 1.c	Quarterly	Gamma dose on each TLD quarterly.
3. Waterborne a. Ground/ Well	a. Indicator Samples from two sources only if likely to be affected. ⁽⁶⁾	Quarterly	Gamma isotopic ⁽⁴⁾ and tritium analysis quarterly.
b. Drinking ⁽⁷⁾	a. Indicator One Sample from each community drinking water supply that could be affected by the station discharge within 10 km (6.2 mi) downstream of discharge.	Weekly grab samples.	Gross beta and gamma isotopic analyses ⁽⁴⁾ on monthly composite; tritium analysis on quarterly composite.
c. Surface Water ⁽⁷⁾	If no community water supply (Drinking Water) exists within 10 km downstream of discharge then surface water sampling shall be performed.	Weekly grab samples.	Gross beta and gamma isotopic analyses ⁽⁴⁾ on monthly composite; tritium analysis on quarterly composite.
	a. Indicator One sample downstream		

TABLE 12.5-1 (Continued)
RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM

EXPOSURE PATHWAY AND/ OR SAMPLE	NUMBER OF REPRESENTATIVE SAMPLES AND SAMPLE LOCATIONS ⁽¹⁾	SAMPLING AND COLLECTION FREQUENCY	TYPE AND FREQUENCY OF ANALYSIS
d. Control Sample ⁽⁷⁾	a. Control One surface sample upstream discharge.	Weekly grab samples.	Gross beta and gamma isotopic analyses ⁽⁴⁾ on monthly composite; tritium analysis on quarterly composite.
e. Sediment	a. Indicator At least one sample from downstream ⁽⁷⁾ area within 10 km (6.2 mi).	Semiannually.	Gamma isotopic analysis ⁽⁴⁾ semiannually.
4. Ingestion a. Milk ⁽⁸⁾	a. Indicator Samples from milking animals from a maximum of three locations within 10 km (6.2 mi) distance. b. Control One sample from milking animals at a control location within 10 to 30 km (6.2 to 18.6 mi).	Biweekly ⁽⁹⁾ when animals are on pasture (May through October), monthly at other times (November through April).	Gamma isotopic ⁽⁴⁾ and I-131 ⁽¹⁰⁾ analysis on each sample.

LASALLE

Revision 3
May 2001

TABLE 12.5-1 (Continued)
RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM

EXPOSURE PATHWAY AND/ OR SAMPLE	NUMBER OF REPRESENTATIVE SAMPLES AND SAMPLE LOCATIONS ⁽¹⁾	SAMPLING AND COLLECTION FREQUENCY	TYPE AND FREQUENCY OF ANALYSIS
b. Fish	<p>a. Indicator</p> <p>Representative samples of commercially and recreationally important species in discharge area.</p> <p>b. Control</p> <p>Representative samples of commercially and recreationally important species in control locations upstream of discharge.</p>	Two times annually.	Gamma isotopic analysis ⁽⁴⁾ on edible portions
c. Food Products	<p>a. Indicator</p> <p>Two representative samples from the principal food pathways grown in each of four major quadrants within 10 km (6.2 mi), if available:</p> <p>At least one root vegetable sample⁽¹¹⁾</p> <p>At least one broad leaf vegetable (or vegetation)⁽¹¹⁾</p> <p>b. Control</p> <p>Two representative samples similar to Indicator samples grown within 15 to 30 km (9.3 to 18.6 mi), if available.</p>	Annually	Gamma isotopic ⁽⁴⁾ analysis on each sample.

TABLE 12.5-1 (Continued)
RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM
TABLE NOTATIONS

- (1) Specific parameters of distance and direction from the centerline of the midpoint of the two units and additional description where pertinent shall be provided for each and every sample location in Table 12.5-1, except for vegetation. For vegetation, due to location variability year to year, the parameters of distance and direction shall be provided in the Annual Environmental Operating Report.
- (2) Far field samples are analyzed when the respective near field sample results are inconsistent with previous measurements and radioactivity is confirmed as having its origin in airborne effluents from the station, or at the discretion of the Radiation Support Director.
- (3) Airborne particulate sample filters shall be analyzed for gross beta radioactivity 24 hours or more after sampling to allow for radon and thoron daughter decay. If gross beta activity in air particulate samples is greater than 10 times the yearly mean of control samples, gamma isotopic analysis shall be performed on the individual samples.
- (4) Gamma isotopic analysis means the identification and quantification of gamma emitting radionuclides that may be attributable to the effluents from the station.
- (5) One or more instruments, such as a pressurized ion chamber, for measuring and recording dose rate continuously may be used in place of, or in addition to, integrating dosimeters. Film badges shall not be used as dosimeters for measuring direct radiation. The 40 locations is not an absolute number. The number of direct radiation monitoring stations may be reduced according to geographical limitations; e.g., If a station is adjacent to a lake, some sectors may be over water thereby reducing the number of dosimeters which could be placed at the indicated distances. The frequency of analysis or readout for TLD systems will depend upon the characteristics of the specific system used and should be selected to obtain optimum dose information with minimal fading.
- (6) Groundwater samples shall be taken when this source is tapped for drinking or irrigation purposes in areas where the hydraulic gradient or recharge properties are suitable for contamination.
- (7) The "downstream" sample shall be taken in an area beyond but near the mixing zone. The "upstream sample" shall be taken at a distance beyond significant influence of the discharge. Upstream samples in an estuary must be taken far enough upstream to be beyond the station influence.
- (8) If milking animals are not found in the designated indicator locations, or if the owners decline to participate in the REMP, all milk sampling may be discontinued.
- (9) Biweekly refers to every two weeks.
- (10) I-131 analysis means the analytical separation and counting procedure are specific for this radionuclide.
- (11) One sample shall consist of a volume/weight of sample large enough to fill contractor specified container.

LaSalle

Revision 3
May 2001

TABLE 12.5-2

REPORTING LEVELS FOR RADIOACTIVITY CONCENTRATIONS IN ENVIRONMENTAL SAMPLES
REPORTING LEVELS

ANALYSIS	WATER (pCi/l)	AIRBORNE PARTICULATE OR GASES (pCi/m3)	FISH (pCi/kg, wet)	MILK (pCi/l)	FOOD PRODUCTS (pCi/kg, wet)
H-3	20,000 ⁽¹⁾				
Mn-54	1,000		30,000		
Fe-59	400		10,000		
Co-58	1,000		30,000		
Co-60	300		10,000		
Zn-65	300		20,000		
Zr-Nb-95	400				
I-131	2 ⁽²⁾	0.9		3	100
Cs-134	30	10	1,000	60	1,000
Cs-137	50	20	2,000	70	2,000
Ba-La-140	200			300	

(1) For drinking water samples. This is 40 CFR Part 141 value. If no drinking water pathway exists, a value of 30,000 pCi/l may be used.

(2) If no drinking water pathway exists, a value of 20 pCi/l may be used.

TABLE 12.5-3

DETECTION CAPABILITIES FOR ENVIRONMENTAL SAMPLE ANALYSIS

LOWER LIMIT OF DETECTION (LLD)⁽²⁾⁽³⁾

ANALYSIS	WATER (pCi/l)	AIRBORNE PARTICULATE OR GASES (pCi/m ³)	FISH (pCi/kg, wet)	MILK (pCi/l)	FOOD PRODUCTS (pCi/kg, wet)	SEDIMENT (pCi/kg, dry)
Gross Beta	4	0.01	1000			
H-3	2,000 ⁽⁷⁾					
Mn-54	15		130			
Fe-59	30		260			
Co-58,60	15		130			
Zn-65	30		260			
Zr-Nb-95	15					
I-131 ⁽⁶⁾	1/15 ⁽⁴⁾	0.07	100	0.5/5 ⁽⁵⁾	60	
Cs-134	15	0.01	100	15	60	150
Cs-137	18	0.01	100	18	80	180
Ba-La-140	15			15		

TABLE 12.5-3 (Continued)
DETECTION CAPABILITIES FOR ENVIRONMENTAL SAMPLE ANALYSIS
TABLE NOTATIONS

- (1) The nuclides on this list are not the only nuclides intended to be considered. Other peaks that are identifiable, together with those of the above nuclides, shall also be analyzed and reported in the Annual Radiological Environmental Operating Report.
- (2) Required detection capabilities for thermoluminescent dosimeters used for environmental measurements shall be in accordance with the recommendations of Regulatory Guide 4.13.
- (3) The Lower Limit of Detection (LLD) is defined, for purposes of these specifications, as the smallest concentration of radioactive material in a sample that will yield a net count, above system background, that will be detected with 95% probability with only 5% probability of falsely concluding that a blank observation represents a "real" signal.

For a particular measurement system, which may include radiochemical separation, the LLD is defined as follows:

$$LLD = \frac{4.66 Sb + 3/tb}{(E) (V) (2.22) (Y) (\exp(-\lambda\Delta t))}$$

$$LLD \sim \frac{4.66 Sb}{(E) (V) (2.22) (Y) (\exp(-\lambda\Delta t))}$$

Where: $4.66 Sb \gg 3/tb$

LLD = the "a priori" Minimum Detectable Concentration (picoCuries per unit mass or volume),

sb = the standard deviation of the background counting rate or of the counting rate of a blank sample, as appropriate (counts per minute),

$$= \frac{\sqrt{\text{total counts}}}{tb}$$

E = the counting efficiency(counts per disintegration),

V = the sample size (units of mass or volume),

2.22 = the number of disintegrations per minute per picoCurie,

Y = the fractional radiochemical yield, when applicable,

λ = the radioactive decay constant for the particular radionuclide (sec⁻¹),

TABLE 12.5-3 (Continued)
DETECTION CAPABILITIES FOR ENVIRONMENTAL SAMPLE ANALYSIS
TABLE NOTATIONS

t_b = counting time of the background or blank (minutes), and

Δt = the elapsed time between sample collection, or end of the sample collection period, and the time of counting (sec).

Typical values of E , V , Y , and Δt should be used in the calculation.

It should be recognized that the LLD is defined as a before the fact limit representing the capability of a measurement system and not as an after the fact limit for a particular measurement.

Analyses shall be performed in such a manner that the stated LLDs will be achieved under routine conditions. Occasionally, background fluctuations, unavoidable small sample sizes, the presence of interfering nuclides, or other uncontrollable circumstances may render these LLDs unachievable. In such cases, the contributing factors shall be identified and described in the Annual Radiological Environmental Operating Report.

- (4) If no drinking water pathway exists, the value of 15 pCi/l may be used.
- (5) A value of 0.5 pCi/l shall be used when the animals are on pasture (May through October) and a value of 5 pCi/l shall be used at all other times (November through April).
- (6) This LLD applies only when the analytical separation and counting procedure are specific for this radionuclide.
- (7) This LLD is the minimum allowable, however, vendors performing environmental sample analyses off-site will be required to meet an LLD of 200 pCi/l.

12.5.2 Land Use CensusOperability Requirements

12.5.2.A. A Land Use Census shall be conducted and shall identify within a distance of 10 km (6.2 miles) the location in each of the 16 meteorological sectors* of the nearest milk animal, the nearest residence**, and an enumeration of livestock. For dose calculation, a garden will be assumed at the nearest residence.

Applicability: At all times.

Action:

1. With a Land Use Census identifying a location(s) that yields a calculated dose or dose commitment, via the same exposure pathway 20% greater than at a location from which samples are currently being obtained in accordance with Section 12.5.1, add the new location(s) within 30 days to the Radiological Environmental Monitoring Program given in Chapter 11. The sampling location(s), excluding the control location, having the lowest calculated dose or dose commitment(s), via the same exposure pathway, may be deleted from this monitoring program after October 31 of the year in which this Land Use Census was conducted. Submit in the next Annual Radiological Environmental Operating Report documentation for a change in the ODCM including a revised figure(s) and table(s) for the ODCM reflecting the new location(s) with information supporting the change in sampling locations.

*This requirement may be reduced according to geographical limitations; e.g. at a lake site where some sector's will be over water.

**The nearest industrial facility shall also be documented if closer than the nearest residence.

Surveillance Requirements

12.5.2.B The Land Use Census shall be conducted during the growing season, between June 1 and October 1, at least once per 12 months using that information that will provide the best results, such as by a door-to-door survey, aerial survey, or by consulting local agriculture authorities. The results of the Land Use Census shall be included in the Annual Radiological Environmental Operating Report.

Bases

12.5.2.C This specification is provided to ensure that changes in the use of areas at and beyond the SITE BOUNDARY are identified and that modifications to the Radiological Environmental Monitoring Program given in the ODCM are made if required by the results of this census. This census satisfies the requirements of Section IV.B.3 of Appendix I to 10 CFR Part 50. An annual garden census will not be required since the licensee will assume that there is a garden at the nearest residence in each sector for dose calculations.

12.5.3 Interlaboratory Comparison Program

Operability Requirements

12.5.3.A Analyses shall be performed on radioactive materials supplied as part of an Interlaboratory Comparison Program that correspond to samples required by Table 12.5-1.

Applicability: At all times.

Action:

1. With analyses not being performed as required above, report the corrective actions taken to prevent a recurrence to the Commission in the Annual Radiological Environmental Operating Report.

Surveillance Requirements

12.5.3.B A summary of the results obtained as part of the above required Interlaboratory Comparison Program shall be included in the Annual Radiological Environmental Operating Report.

Bases

12.5.3.C The requirement for participation in an Interlaboratory Comparison Program is provided to ensure that independent checks on the precision and accuracy of the measurements of radioactive material in environmental samples matrices are performed as part of the quality assurance program for environmental monitoring in order to demonstrate that the results are valid for the purposes of Section IV.B.2 of Appendix I to 10 CFR Part 50.

12.6 REPORTING REQUIREMENTS12.6.1 Annual Radiological Environmental Operating Report*

Routine Annual Radiological Environmental Operating Report covering the operation of the Units during the previous calendar year shall be submitted by May 15 of each year. The report shall include summaries, interpretations, and an analysis of trends of the results of the radiological environmental monitoring program for the report period. The material provided shall be consistent with the objectives outlined in the Offsite Dose Calculation Manual, and in 10CFR50, Appendix I, Sections IV.B.2, IV.B.3, and IV.c. It should include, as found appropriate, a comparison of preoperational studies with operational controls or with previous environmental surveillance reports, and an assessment of the observed impacts of the plant operation on the environment.

The Annual Radiological Environmental Operating Report shall include the results of all radiological environmental samples and of all environmental radiation measurements taken during the period pursuant to the locations specified in the tables and figures in Chapter 11 of the ODCM, as well as summarized and tabulated results of these analyses and measurements in the format of the table in the Radiological Assessment Branch Technical Position, Revision 1, November 1979. In the event that some individual results are not available for inclusion with the report, the report shall be submitted noting and explaining the reasons for the missing results. The missing data shall be submitted as soon as possible in a supplementary report.

The reports shall also include the following: a summary description of the Radiological Environmental Monitoring Program; legible maps covering all sampling locations keyed to a table giving distances and directions from the midpoint between the two units; reasons for not conducting the Radiological Environmental Monitoring Program as required by Section 12.5.1, and discussion of all deviations from the sampling schedule of Table 12.5-1; a Table of Missed Samples and a Table of Sample Anomalies for all deviations from the sampling schedule of Table 11.1-1; discussion of environmental sample measurements that exceed the reporting levels of Table 12.5-2 but are not the result of plant effluents; discussion of all analyses in which the LLD required by Table 12.5-3 was not achievable; results of the Land Use Census required by Section 12.5.2; and the results of licensee participation in an Interlaboratory Comparison Program and the corrective actions being taken if the specified program is not being performed as required by Section 12.5.3.

The Annual Radiological Environmental Operating Report shall also include an annual summary of hourly meteorological data collected over the previous year. This annual summary may be either in the form of an hour-by-hour listing on magnetic tape of wind speed, wind direction, atmospheric stability, and precipitation (if measured), or in the form of joint frequency distributions of wind speed, wind direction, and atmospheric stability. In lieu of submission with the Annual Radiological Environmental Operating Report, the licensee has the option of retaining the summary of required meteorological data on site in a file that shall be provided to the NRC upon request.

*A single submittal may be made for a multiple unit station. The submittal should combine sections common to all units at the station.

12.6.1 Annual Radiological Environmental Operating Report (Continued)

The Annual Radiological Environmental Operating Report shall also include an assessment of the radiation doses due to the radioactive liquid and gaseous effluents released from the unit or station during the previous calendar year. This report shall also include an assessment of radiation doses to the most likely exposed MEMBER OF THE PUBLIC from reactor releases and other nearby uranium fuel cycle sources, including doses from primary effluent pathways and direct radiation, for the previous calendar year. The assessment of radiation doses shall be performed in accordance with the methodology and parameters in the ODCM and in compliance with 10CFR20 and 40 CFR 190, "Environmental Radiation Protection Standards for Nuclear Power Operation."

12.6.2 Radioactive Effluent Release Report⁴

- a. The radioactive effluent release reports covering the operation of the unit during the previous calendar year of operation shall be submitted in accordance with 10CFR50.36a prior to May 1 of each year. The report shall include a summary of the quantities of radioactive liquid and gaseous effluent and solid waste released from the unit. The material provided shall be consistent with the objectives outlined in the ODCM and the PROCESS CONTROL PROGRAM and in conformance with 10CFR50.36a and 10CFR50, Appendix I, Section IV.B.1.
- b. The radioactive effluent release reports shall include a summary of the quantities of radioactive liquid and gaseous effluents and solid waste released from the unit as outlined in Regulatory Guide 1.21, "Measuring, Evaluating and Reporting Radioactivity in Solid Wastes and Releases of Radioactive Materials in Liquid and Gaseous Effluents from Light-Water-Cooled Nuclear Power Plants," Revision 1, June 1974, with data summarized on a quarterly basis following the format of Appendix B thereof.
- c. The radioactive effluent release report shall include the following information for each type of solid waste shipped offsite during the report period:
 1. Container volume,
 2. Total curie quantity (specify whether determined by measurement or estimate),
 3. Principal radionuclides (specify whether determined by measurement or estimate),
 4. Type of waste (e.g., spent resin, compacted dry waste, evaporator bottoms),
 5. Type of container (e.g., LSA, Type A, Type B, Large Quantity), and
 6. Solidification agent (e.g., cement, urea formaldehyde).

The radioactive effluent release reports shall include unplanned releases from the site to unrestricted areas of radioactive materials in gaseous and liquid effluents on a quarterly basis.

The radioactive effluent release reports shall include any changes to the PROCESS CONTROL PROGRAM (PCP) made during the reporting period.

The radioactive effluent release reports shall include a description of licensee initiated major changes to the radioactive waste treatment systems (liquid, gaseous and solid), as described in Section 12.6.3.)

⁴A single submittal may be made for a multiple unit station. The submittal should combine those sections that are common to all units at the station; however, for units with separate radwaste systems, the submittal shall specify the releases of radioactive material from each unit.

12.6 REPORTING REQUIREMENTS**12.6.3 Offsite Dose Calculation Manual (ODCM)***

- 12.6.3.1 The ODCM shall contain the methodology and parameters used in the calculation of offsite doses resulting from radioactive gaseous and liquid effluents, in the calculation of gaseous and liquid effluent monitoring alarm and trip setpoints, and in the conduct of the radiological environmental monitoring program; and
- 12.6.3.2 The ODCM shall also contain the radioactive effluent controls and radiological environmental monitoring activities, and descriptions of the information that should be included in the Annual Radiological Environmental Operating, and Radioactive Effluent Release Reports required by Technical Specifications 5.6.2 and 5.6.3.
- 12.6.3.3 Licensee-initiated changes to the ODCM:
- a. Shall be documented and records of reviews performed shall be retained as required by the Quality Assurance (QA) Manual. This documentation shall contain:
 1. Sufficient information to support the change(s) together with the appropriate analyses or evaluations justifying the change(s); and
 2. A determination that the change(s) maintain the level of radioactive effluent control required by 10 CFR 20.1302, 40 CFR Part 190, 10 CFR 50.36a, and 10 CFR Part 50, Appendix I, and not adversely impact the accuracy or reliability of effluent, dose, or setpoint calculations.
 - a. Shall become effective after approval of the Plant Manager.
 - b. Shall be submitted to the NRC in the form of a complete, legible copy of the entire ODCM as a part of or concurrent with the Radioactive Effluent Release Report for the period of the report in which any change to the ODCM was made. Each change shall be identified by markings in the margin of the affected pages, clearly indicating the area of the page that was changed, and shall indicate the date (i.e., month and year) the change was implemented.

*The OFFSITE DOSE CALCULATION MANUAL (ODCM) is common to LaSalle Unit 1 and LaSalle Unit 2.

12.6 REPORTING REQUIREMENTS

12.6.4 Major Changes to Radioactive Waste Treatment Systems

12.6.4.1 License initiated major changes to the radioactive waste treatment systems (liquid and gaseous):

- a. Shall be reported to the Commission in the Radioactive Effluent Release Report for the period in which the evaluation was reviewed by the Onsite Review and Investigative Function. The discussion of each change shall contain:
 1. A summary of the evaluation that led to the determination that the change could be made in accordance with 10 CFR 50.59;
 2. Sufficient detailed information to totally support the reason for the change without benefit or additional or supplemental information;
 3. A detailed description of the equipment, components and processes involved and the interfaces with other plant systems;
 4. An evaluation of the change which shows the predicted releases of radioactive materials in liquid and gaseous effluents waste that differ from those previously predicted in the license application and amendments thereto;
 5. An evaluation of the change which shows the expected maximum exposures to individual in the unrestricted area and to the general population that differ from those previously estimated in the license application and amendments thereto;
 6. A comparison of the predicted releases of radioactive materials, in liquid and gaseous effluents, to the actual releases for the period to when the changes are to be made;
 7. An estimate of the exposure to plant operating personnel as a result of the change; and
 8. Documentation of the fact that the change was reviewed and found acceptable by the Onsite Review and Investigative Function.
- b. Shall become effective upon review and acceptance by the Onsite Review and Investigative Function.

APPENDIX F
STATION-SPECIFIC DATA FOR LASALLE
UNITS 1 AND 2

Table of Contents

	<u>PAGE</u>
F.1 INTRODUCTION	F-1
F.2 REFERENCES	F-1

APPENDIX F
LIST OF TABLES

<u>NUMBER</u>	<u>TITLE</u>	<u>PAGE</u>
F-1	Aquatic Environment Dose Parameters	F-2
F-2	Station Characteristics	F-3
F-3	Critical Ranges	F-4
F-4	Average Wind Speeds	F-5
F-5	X/Q and D/Q Maxima At or Beyond the Unrestricted Area Boundary	F-6
F-5a	X/Q and D/Q Maxima At or Beyond the Restricted Area Boundary	F-7
F-6	D/Q at the Nearest Milk Cow and Meat Animal Locations Within 5 Miles	F-8
F-7	Maximum Offsite Finite Plume Gamma Dose Factors Based on 1 cm Depth at the Unrestricted Area Boundary for Selected Nuclides	F-9
F-7a	Maximum Offsite Finite Plume Gamma Dose Factors Based on 1 cm Depth at the Restricted Area Boundary for Selected Nuclides	F-24
F-8	Parameters for Calculation of N-16 Skyshine Radiation from LaSalle	F-39
Supplemental Tables		
A	Elevated Level Joint Frequency Distribution Table Summary - 375 Foot Elevation Data	F-40
	-Summary Table of Percent by Direction and Class -Summary Table of Percent by Direction and Speed -Summary Table of Percent by Speed and Class	
B	Mid Elevation Joint Frequency Distribution Table Summary - 200 Foot Elevation Data	F-42
	-Summary Table of Percent by Direction and Class -Summary Table of Percent by Direction and Speed -Summary Table of Percent by Speed and Class	
C	Ground Level Joint Frequency Distribution Table Summary - 33 Foot Elevation Data	F-44
	-Summary Table of Percent by Direction and Class -Summary Table of Percent by Direction and Speed -Summary Table of Percent by Speed and Class	

APPENDIX F
LIST OF FIGURES

<u>NUMBER</u>	<u>TITLE</u>	<u>PAGE</u>
F-1	Unrestricted Area Boundary	F-46
F-2	Restricted Area Boundary	F-47

APPENDIX F
STATION-SPECIFIC DATA FOR LASALLE
UNITS 1 AND 2

F.1 INTRODUCTION

This appendix contains data relevant to the LaSalle site. Included is a figure showing the unrestricted area boundary, restricted area boundary, and values of parameters used in offsite dose assessment.

F.2 REFERENCES

1. Sargent & Lundy, Analysis and Technology Division, LaSalle Calculation No. ATD-0164, Revisions 0, 1, 2 and 3.
2. Sargent & Lundy, Nuclear Safeguards and Licensing Division, LaSalle Calculation No. ATD-0139, "N-16 Skyshine Ground Level Doses from LaSalle Turbine System & Piping, Revision 0.
3. Verification of Environmental Parameter used for Commonwealth Edison Company's Offsite Dose Calculations, "NUS Corporation, 1988.

Table F-1
Aquatic Environment Dose Parameters

General Information*

The station liquid discharge flows into the Illinois River then into the Mississippi River.

Recreation includes one or more of the following: boating, waterskiing, swimming, and sport fishing.

Two downstream dams are on the Illinois River, Marseilles and Starved Rock. This information is based on Section 2.4.1.1 and Figures 2.4-2 and 2.4-6 of the LaSalle Environmental Report.

Water and Fish Ingestion Parameters

Parameter ^b	Value
V/M^c , V/M^f	1.0
F^m , cfs	1.85E4
F^f , cfs	1.31E4
t^f , hr ^d	24.0
t^m , hr ^d	97.0

Limits on Radioactivity in Unprotected Outdoor Tanks*

Outside Temporary Tank $\leq 10 \text{ Ci}^f$

* This is based on information in LaSalle Environmental Report, Figure 3.3-1 and Section 2.1.4.2.1.

^b The parameters are defined in Sections A.2.1 of Appendix A.

^c t^f (hr) = 24 hr (all stations) for the fish ingestion pathway

^d t^m (hr) = 97 hr (distance to nearest public potable water intake, Peoria, is 97 miles; flow rate of 1 mph is assumed.)

^e See Section A.2.4 of Appendix A.

^f Tritium and dissolved or entrained noble gases are excluded from this limit.

Table F-3
Critical Ranges

<u>Direction</u>	<u>Unrestricted Area Boundary^a (m)</u>	<u>Restricted Area Boundary (m)</u>	<u>Nearest Resident^b (m)</u>	<u>Nearest Dairy Farm Within 5 Miles^c (m)</u>
N	1036	1036	8300	None
NNE	1378	1378	2800	None
NE	2408	1609	3400	None
ENE	4450	1079	5300	None
E	1996	833	5200	None
ESE	1465	845	2300	None
SE	969	969	2700	None
SSE	838	698	2900	None
S	829	820	2400	None
SSW	835	835	1100	None
SW	628	628	1600	None
WSW	533	533	2400	None
W	524	524	1300	None
WNW	643	643	1400	None
NW	762	762	2900	None
NNW	890	890	2700	7400

- ^a Used in calculating the meteorological dose factors in Tables F-5 and F-7. See Sections B.3 through B.6 of Appendix B.
- ^b 1994 annual survey by Teledyne Isotopes Midwest Laboratories. The distances are rounded to the nearest conservative 100 meters.
- ^c 1994 annual milk animal census, by Teledyne Isotopes Midwest Laboratories. Used in Calculating the D/Q values in table F.6. The distances are rounded to the nearest conservative 100 meters. A default value of 8000 meters is used when there are no dairies within 5 miles.

Table F-4
Average Wind Speeds

Downwind Direction	Average Wind Speed (m/sec) ^a		
	Elevated	Vent ^b	Ground Level
N	9.7	7.7	4.9
NNE	10.1	8.0	5.1
NE	9.2	7.4	4.9
ENE	9.0	7.2	4.8
E	9.5	7.8	5.2
ESE	9.7	8.4	5.9
SE	8.1	7.4	5.9
SSE	7.4	6.7	5.0
S	6.7	5.9	4.3
SSW	5.8	3.7	2.9
SW	5.5	4.1	3.1
WSW	6.9	5.4	3.9
W	7.6	6.5	4.5
WNW	7.5	6.3	4.3
NW	7.5	6.2	3.9
NNW	8.3	6.7	4.3

^aBased on LaSalle site meteorological data, January 1978 through December 1987. Calculated Reference 1 of Section F.2, using formulas in Section B.1.3 of Appendix B.

LaSalle

Revision 3
May 2001

Table F-5

X/Q and D/Q Maxima at or Beyond the Unrestricted Area Boundary

Downwind Direction	Elevated(stack) Release			Mixed Mode(Vent) Release			Ground Level Release			
	Radius (meters)	X/Q (sec/m ³)	Radius (meters)	D/Q (1/m ²)	Radius (meters)	X/Q (sec/m ³)	D/Q (1/m ²)	Radius (meters)	X/Q (sec/m ³)	D/Q (1/m ²)
N	5633.	6.123E-09	1036.	7.203E-10	6000.	6.289E-09	8.311E-10	1036.	1.524E-06	1.019E-08
NNE	1378.	7.045E-09	1378.	9.831E-10	5633.	7.102E-09	9.659E-10	1378.	9.737E-07	7.095E-09
NE	4400.	5.535E-09	2408.	4.245E-10	2408.	5.600E-09	4.836E-10	2408.	3.907E-07	2.377E-09
ENE	5200.	5.086E-09	4450.	2.021E-10	4450.	4.909E-09	2.824E-10	4450.	1.496E-07	6.764E-10
E	5200.	5.865E-09	1996.	5.415E-10	1996.	6.198E-09	6.396E-10	1996.	4.870E-07	2.980E-09
ESE	5200.	8.000E-09	1500.	8.896E-10	1465.	8.290E-09	1.229E-09	1465.	7.223E-07	5.880E-09
SE	5633.	7.116E-09	1500.	7.505E-10	969.	1.087E-08	1.709E-09	969.	1.137E-06	1.123E-08
SSE	5200.	6.717E-09	1500.	7.176E-10	838.	1.313E-08	2.124E-09	838.	1.124E-06	1.064E-08
S	5633.	5.910E-09	1500.	6.136E-10	829.	8.402E-09	1.303E-09	829.	1.112E-06	1.039E-08
SSW	6000.	5.269E-09	835.	5.793E-10	835.	7.322E-09	9.999E-10	835.	7.940E-07	5.359E-09
SW	6000.	6.767E-09	628.	8.545E-10	628.	2.224E-08	2.154E-09	628.	1.864E-06	1.407E-08
WSW	6000.	6.065E-09	533.	6.527E-10	540.	2.105E-08	2.079E-09	533.	2.101E-06	1.970E-08
W	6437.	5.354E-09	1500.	4.811E-10	540.	1.344E-08	1.629E-09	524.	2.830E-06	2.453E-08
WNW	7242.	3.916E-09	1500.	3.175E-10	643.	5.963E-09	9.071E-10	643.	2.429E-06	1.508E-08
NW	7242.	3.766E-09	1500.	3.118E-10	5633.	4.127E-09	6.660E-10	762.	1.984E-06	1.055E-08
NNW	6437.	4.240E-09	1500.	3.806E-10	6437.	4.095E-09	5.574E-10	890.	1.605E-06	8.840E-09

LASALLE SITE METEOROLOGICAL DATA 1/78 - 12/87

Note: Based on Reference 2 of Section F.2 and the formulas in Sections B.3 and B.4 of Appendix B.

Used for beta air, beta skin, and inhalation dose pathways. See sections A.1.2, A.1.3 and A.1.4.2 of Appendix A.

Used for produce and leafy vegetable pathways. See A.1.4 of Appendix A.

LaSalle

Revision 3
May 2001

Table F-5a

X/Q and D/Q Maxima at or Beyond the Restricted Area Boundary

Downwind Direction	Elevated(Stack) Release				Mixed Mode(Vent) Release			Ground Level Release		
	Radius (meters)	X/Q (sec/m**3)	Radius (meters)	D/Q (1/m**2)	Radius (meters)	X/Q (sec/m**3)	D/Q (1/m**2)	Radius (meters)	X/Q (sec/m**3)	D/Q (1/m**2)
N	5633.	6.123E-09	1036.	7.203E-10	6000.	6.289E-09	8.311E-10	1036.	1.524E-06	1.019E-08
NNE	1378.	7.045E-09	1378.	9.831E-10	5633.	7.102E-09	9.659E-10	1378.	9.737E-07	7.095E-09
NE	4400.	5.535E-09	1609.	6.556E-10	1609.	6.052E-09	7.953E-10	1609.	7.003E-07	4.747E-09
ENE	5200.	5.086E-09	1079.	6.376E-10	1079.	6.579E-09	9.861E-10	1079.	1.128E-06	7.788E-09
E	5200.	5.865E-09	1500.	6.659E-10	1055.	7.712E-09	1.160E-09	1055.	1.278E-06	8.779E-09
ESE	5200.	8.000E-09	1500.	8.896E-10	1055.	9.981E-09	1.546E-09	1055.	1.192E-06	1.021E-08
SE	5633.	7.116E-09	1500.	7.505E-10	969.	1.087E-08	1.709E-09	969.	1.137E-06	1.123E-08
SSE	5200.	6.717E-09	698.	7.210E-10	698.	1.444E-08	2.403E-09	698.	1.492E-06	1.428E-08
S	5633.	5.910E-09	1500.	6.136E-10	820.	8.455E-09	1.312E-09	820.	1.130E-06	1.058E-08
SSW	6000.	5.269E-09	835.	5.793E-10	835.	7.322E-09	9.999E-10	835.	7.940E-07	5.359E-09
SW	6000.	6.767E-09	628.	8.545E-10	628.	2.224E-08	2.154E-09	628.	1.864E-06	1.407E-08
WSW	6000.	6.065E-09	533.	6.527E-10	540.	2.105E-08	2.079E-09	533.	2.101E-06	1.970E-08
W	6437.	5.354E-09	1500.	4.811E-10	540.	1.344E-08	1.629E-09	524.	2.830E-06	2.453E-08
WNW	7242.	3.916E-09	1500.	3.175E-10	643.	5.963E-09	9.071E-10	643.	2.429E-06	1.508E-08
NW	7242.	3.766E-09	1500.	3.118E-10	5633.	4.127E-09	6.660E-10	762.	1.984E-06	1.055E-08
NNW	6437.	4.240E-09	1500.	3.806E-10	6437.	4.095E-09	5.574E-10	890.	1.605E-06	8.840E-09

LASALLE SITE METEOROLOGICAL DATA 1/78 - 12/87

Table F-6

Revision 3
May 2001

D/Q at the Nearest Milk Cow and Meat Animal Locations within 5 miles

Downwind Direction	Nearest Milk Cow D/Q(1/m**2)			Nearest Meat Animal D/Q(1/m**2)				
	Radius (meters)	Elevated Release	Mixed Release	Ground Release	Radius (meters)	Elevated Release	Mixed Release	Ground Release
N	8000.	9.711E-11	1.006E-10	2.915E-10	6400.	1.387E-10	1.436E-10	4.352E-10
NNE	8000.	1.151E-10	1.178E-10	3.273E-10	3100.	4.257E-10	4.320E-10	1.760E-09
NE	8000.	8.839E-11	9.468E-11	2.851E-10	5600.	1.538E-10	1.649E-10	5.403E-10
ENE	8000.	8.559E-11	8.420E-11	2.381E-10	5000.	1.739E-10	1.725E-10	5.519E-10
E	8000.	1.056E-10	9.772E-11	2.587E-10	8000.	1.056E-10	9.772E-11	2.587E-10
ESE	8000.	1.450E-10	1.356E-10	3.010E-10	8000.	1.450E-10	1.356E-10	3.010E-10
SE	8000.	1.242E-10	1.322E-10	2.881E-10	7600.	1.354E-10	1.437E-10	3.160E-10
SSE	8000.	1.174E-10	1.278E-10	2.152E-10	7600.	1.279E-10	1.389E-10	2.360E-10
S	8000.	9.947E-11	9.895E-11	2.065E-10	8000.	9.947E-11	9.895E-11	2.065E-10
SSW	8000.	8.647E-11	9.097E-11	1.077E-10	8000.	8.647E-11	9.097E-11	1.077E-10
SW	8000.	1.096E-10	1.210E-10	1.793E-10	8000.	1.096E-10	1.210E-10	1.793E-10
WSW	8000.	1.017E-10	1.083E-10	1.940E-10	8000.	1.017E-10	1.083E-10	1.940E-10
W	8000.	8.494E-11	1.094E-10	2.354E-10	4800.	1.808E-10	2.362E-10	5.866E-10
WNW	8000.	5.824E-11	6.886E-11	1.994E-10	5200.	1.117E-10	1.331E-10	4.312E-10
NW	8000.	5.436E-11	6.319E-11	1.828E-10	6400.	7.773E-11	9.022E-11	2.730E-10
NNW	7400.	7.317E-11	7.264E-11	2.269E-10	7600.	7.002E-11	6.954E-11	2.163E-10

LaSalle Site Meteorological Data 1/78 - 12/87

Note: Based on Reference 2 of Section F.2 and the formulas in Section B.4 of Appendix B.

Table F-7

Maximum Offsite Finite Plume Gamma Dose Factors Based on 1 cm Depth at the Unrestricted Area Boundary for Kr-83m

Direction	Downwind Unrestricted Area Bound		Elevated(Stack) Release		Mixed Mode(Vent) Release			Ground Level Release		
	Radius (meters)	Radius (meters)	S (mrad/yr)/(uCi/sec)	SBAR (mrad/yr)/(uCi/sec)	Radius (meters)	V (mrad/yr)/(uCi/sec)	VBAR (mrad/yr)/(uCi/sec)	Radius (meters)	G (mrad/yr)/(uCi/sec)	-GBAR (mrad/yr)/(uCi/sec)
N	1036.	1036.	4.787E-07	3.609E-07	1036.	5.281E-07	3.982E-07	1036.	1.785E-04	1.346E-04
NNE	1378.	1378.	8.751E-07	6.599E-07	1378.	6.905E-07	5.206E-07	1378.	1.139E-04	8.586E-05
NE	2408.	2408.	6.471E-07	4.879E-07	2408.	6.697E-07	5.049E-07	2408.	4.355E-05	3.284E-05
ENE	4450.	4450.	5.700E-07	4.298E-07	4450.	5.653E-07	4.262E-07	4450.	1.466E-05	1.105E-05
E	1996.	1996.	4.687E-07	3.534E-07	1996.	7.559E-07	5.700E-07	1996.	5.491E-05	4.140E-05
ESE	1465.	1465.	5.252E-07	3.960E-07	1465.	1.002E-06	7.559E-07	1465.	8.270E-05	6.236E-05
SE	969.	969.	3.545E-07	2.673E-07	969.	1.267E-06	9.554E-07	969.	1.333E-04	1.005E-04
SSE	838.	838.	3.051E-07	2.301E-07	838.	1.512E-06	1.140E-06	838.	1.323E-04	9.978E-05
S	829.	829.	2.840E-07	2.141E-07	829.	1.040E-06	7.842E-07	829.	1.330E-04	1.003E-04
SSW	835.	835.	3.185E-07	2.401E-07	835.	1.071E-06	8.076E-07	835.	9.326E-05	7.032E-05
SW	628.	628.	3.177E-07	2.395E-07	628.	2.826E-06	2.131E-06	628.	2.305E-04	1.738E-04
WSW	533.	533.	2.617E-07	1.973E-07	533.	2.674E-06	2.017E-06	533.	2.568E-04	1.936E-04
W	524.	524.	2.327E-07	1.754E-07	524.	1.658E-06	1.250E-06	524.	3.352E-04	2.527E-04
WNW	643.	643.	1.714E-07	1.292E-07	643.	7.235E-07	5.455E-07	643.	2.728E-04	2.057E-04
NW	762.	762.	1.744E-07	1.315E-07	762.	4.391E-07	3.311E-07	762.	2.219E-04	1.673E-04
NHW	890.	890.	2.397E-07	1.807E-07	890.	3.334E-07	2.514E-07	890.	1.823E-04	1.374E-04

LASALLE SITE METEOROLOGICAL DATA 1/78 - 12/87

Note: Based on Reference 1 of Section F.2 and the formulas in Sections B.5 and B.6 of Appendix B.

Table F-7 (Continued)

Maximum Offsite Finite Plume Gamma Dose Factors Based on 1 cm Depth at the Unrestricted Area Boundary for Kr-85m

Downwind Unrestricted Direction Area Bound	Elevated(Stack) Release Radius (meters)	Release		Mixed Mode(Vent) Release Radius (meters)	Release		Ground Level Release Radius (meters)	Release		
		S (mrad/yr)/(uCi/sec)	SBAR (uCi/sec)		V (mrad/yr)/(uCi/sec)	VBAR (uCi/sec)		G (mrad/yr)/(uCi/sec)	GBAR (uCi/sec)	
N	1036.	1036.	5.747E-05	5.560E-05	1036.	6.602E-05	6.388E-05	1036.	9.660E-04	9.252E-04
NNE	1378.	1378.	5.063E-05	4.896E-05	1378.	5.514E-05	5.334E-05	1378.	6.776E-04	6.496E-04
NE	2408.	2408.	2.592E-05	2.506E-05	2408.	2.727E-05	2.636E-05	2408.	2.969E-04	2.849E-04
ENE	4450.	4450.	1.351E-05	1.304E-05	4450.	1.332E-05	1.286E-05	4450.	1.156E-04	1.111E-04
E	1996.	1996.	2.705E-05	2.616E-05	1996.	2.863E-05	2.767E-05	1996.	3.557E-04	3.412E-04
ESE	1465.	1465.	4.351E-05	4.209E-05	1465.	4.624E-05	4.470E-05	1465.	5.201E-04	4.989E-04
SE	969.	969.	5.594E-05	5.415E-05	969.	6.610E-05	6.391E-05	969.	7.793E-04	7.470E-04
SSE	838.	838.	5.518E-05	5.339E-05	838.	6.630E-05	6.410E-05	838.	7.683E-04	7.364E-04
S	829.	829.	4.712E-05	4.560E-05	829.	5.330E-05	5.154E-05	829.	7.986E-04	7.657E-04
SSW	835.	835.	4.422E-05	4.279E-05	835.	5.351E-05	5.174E-05	835.	5.684E-04	5.450E-04
SW	628.	628.	7.281E-05	7.046E-05	628.	9.952E-05	9.618E-05	628.	1.285E-03	1.231E-03
WSW	533.	533.	7.757E-05	7.507E-05	533.	9.714E-05	9.388E-05	533.	1.389E-03	1.331E-03
W	524.	524.	7.601E-05	7.356E-05	524.	9.705E-05	9.385E-05	524.	1.687E-03	1.614E-03
WNW	643.	643.	5.286E-05	5.116E-05	643.	6.615E-05	6.399E-05	643.	1.327E-03	1.270E-03
NW	762.	762.	4.668E-05	4.518E-05	762.	5.688E-05	5.503E-05	762.	1.094E-03	1.047E-03
NNW	890.	890.	4.683E-05	4.532E-05	890.	5.142E-05	4.976E-05	890.	9.282E-04	8.885E-04

LASALLE SITE METEOROLOGICAL DATA 1/78 - 12/87

Table F-7 (Continued)

Maximum Offsite Finite Plume Gamma Dose Factors Based on 1 cm Depth at the Unrestricted Area Boundary for Kr-85

Direction	Downwind Unrestricted Area Bound (meters)	Elevated(Stack) Release		Mixed Mode(Vent) Release		Ground Level Release				
		Radius (meters)	S (mrad/yr)/(uCi/sec)	SBAR (uCi/sec)	Radius (meters)	V (mrad/yr)/(uCi/sec)	VBAR (uCi/sec)	Radius (meters)	G (mrad/yr)/(uCi/sec)	GBAR (uCi/sec)
N	1036.	1036.	8.547E-07	8.265E-07	1036.	9.889E-07	9.563E-07	1036.	1.056E-05	1.021E-05
NNE	1378.	1378.	7.309E-07	7.068E-07	1378.	8.077E-07	7.811E-07	1378.	7.474E-06	7.227E-06
NE	2408.	2408.	3.651E-07	3.530E-07	2408.	3.909E-07	3.780E-07	2408.	3.363E-06	3.252E-06
ENE	4450.	4450.	1.885E-07	1.823E-07	4450.	1.856E-07	1.795E-07	4450.	1.377E-06	1.332E-06
E	1996.	1996.	3.912E-07	3.782E-07	1996.	4.096E-07	3.961E-07	1996.	4.008E-06	3.876E-06
ESE	1465.	1465.	6.359E-07	6.149E-07	1465.	6.632E-07	6.413E-07	1465.	5.783E-06	5.593E-06
SE	969.	969.	8.386E-07	8.110E-07	969.	9.583E-07	9.267E-07	969.	8.555E-06	8.273E-06
SSE	838.	838.	8.350E-07	8.075E-07	838.	9.612E-07	9.294E-07	838.	8.432E-06	8.154E-06
S	829.	829.	7.262E-07	7.023E-07	829.	8.067E-07	7.801E-07	829.	8.741E-06	8.453E-06
SSW	835.	835.	6.857E-07	6.630E-07	835.	8.402E-07	8.124E-07	835.	6.270E-06	6.063E-06
SW	628.	628.	1.142E-06	1.104E-06	628.	1.494E-06	1.444E-06	628.	1.401E-05	1.355E-05
WSW	533.	533.	1.211E-06	1.171E-06	533.	1.433E-06	1.386E-06	533.	1.510E-05	1.460E-05
W	524.	524.	1.172E-06	1.134E-06	524.	1.443E-06	1.395E-06	524.	1.824E-05	1.763E-05
WNW	643.	643.	8.185E-07	7.915E-07	643.	1.000E-06	9.670E-07	643.	1.436E-05	1.389E-05
NW	762.	762.	7.192E-07	6.954E-07	762.	8.694E-07	8.407E-07	762.	1.188E-05	1.148E-05
NNW	890.	890.	7.128E-07	6.893E-07	890.	7.849E-07	7.590E-07	890.	1.011E-05	9.778E-06

LASALLE SITE METEOROLOGICAL DATA 1/78 - 12/87

Table F-7 (Continued)

Maximum Offsite Finite Plume Gamma Dose Factors Based on 1 cm Depth at the Unrestricted Area Boundary for Kr-87

Direction	Downwind Unrestricted		Elevated(Stack) Release		Mixed Mode(Vent) Release		Ground Level Release			
	Area Bound (meters)	Radius (meters)	S (mrad/yr)/(uCi/sec)	SBAR	Radius (meters)	V (mrad/yr)/(uCi/sec)	VBAR	Radius (meters)	G (mrad/yr)/(uCi/sec)	GBAR
N	1036.	1036.	3.226E-04	3.135E-04	1036.	3.758E-04	3.652E-04	1036.	2.879E-03	2.795E-03
NNE	1378.	1378.	2.672E-04	2.597E-04	1378.	3.005E-04	2.920E-04	1378.	2.019E-03	1.960E-03
NE	2408.	2408.	1.283E-04	1.246E-04	2408.	1.359E-04	1.320E-04	2408.	8.605E-04	8.355E-04
ENE	4450.	4450.	5.904E-05	5.737E-05	4450.	5.859E-05	5.692E-05	4450.	3.133E-04	3.042E-04
E	1996.	1996.	1.412E-04	1.372E-04	1996.	1.458E-04	1.417E-04	1996.	1.030E-03	9.998E-04
ESE	1465.	1465.	2.351E-04	2.284E-04	1465.	2.426E-04	2.357E-04	1465.	1.545E-03	1.500E-03
SE	969.	969.	3.211E-04	3.120E-04	969.	3.612E-04	3.510E-04	969.	2.355E-03	2.287E-03
SSE	838.	838.	3.254E-04	3.162E-04	838.	3.655E-04	3.552E-04	838.	2.329E-03	2.262E-03
S	829.	829.	2.850E-04	2.770E-04	829.	3.081E-04	2.994E-04	829.	2.431E-03	2.361E-03
SSW	835.	835.	2.742E-04	2.665E-04	835.	3.400E-04	3.305E-04	835.	1.706E-03	1.657E-03
SW	628.	628.	4.614E-04	4.484E-04	628.	5.936E-04	5.769E-04	628.	3.903E-03	3.790E-03
WSW	533.	533.	4.880E-04	4.743E-04	533.	5.683E-04	5.523E-04	533.	4.251E-03	4.128E-03
W	524.	524.	4.675E-04	4.543E-04	524.	5.708E-04	5.547E-04	524.	5.136E-03	4.986E-03
WNW	643.	643.	3.224E-04	3.133E-04	643.	3.914E-04	3.804E-04	643.	4.001E-03	3.884E-03
NW	762.	762.	2.823E-04	2.743E-04	762.	3.397E-04	3.301E-04	762.	3.276E-03	3.180E-03
NNW	890.	890.	2.747E-04	2.669E-04	890.	3.031E-04	2.945E-04	890.	2.763E-03	2.683E-03

LASALLE SITE METEOROLOGICAL DATA 1/78 - 12/87

Table F-7 (Continued)

Maximum Offsite Finite Plume Gamma Dose Factors Based on 1 cm Depth at the Unrestricted Area Boundary for Kr-88

Downwind Unrestricted Direction Area Bound	Radius (meters)	Elevated(Stack) Release		Mixed Mode(Vent) Release			Ground Level Release			
		Radius (meters)	S (mrad/yr)/(uCi/sec)	SBAR	Radius (meters)	V (mrad/yr)/(uCi/sec)	VBAR	Radius (meters)	G (mrad/yr)/(uCi/sec)	GBAR
N	1036.	1036.	8.602E-04	8.374E-04	1036.	1.003E-03	9.769E-04	1036.	6.988E-03	6.787E-03
NNE	1378.	1378.	7.111E-04	6.922E-04	1378.	7.989E-04	7.777E-04	1378.	4.940E-03	4.798E-03
NE	2408.	2408.	3.435E-04	3.344E-04	2408.	3.694E-04	3.596E-04	2408.	2.182E-03	2.120E-03
ENE	4450.	4450.	1.648E-04	1.604E-04	4450.	1.646E-04	1.602E-04	4450.	8.502E-04	8.263E-04
E	1996.	1996.	3.781E-04	3.680E-04	1996.	3.928E-04	3.824E-04	1996.	2.599E-03	2.525E-03
ESE	1465.	1465.	6.235E-04	6.070E-04	1465.	6.445E-04	6.273E-04	1465.	3.816E-03	3.707E-03
SE	969.	969.	8.537E-04	8.311E-04	969.	9.571E-04	9.317E-04	969.	5.712E-03	5.549E-03
SSE	838.	838.	8.671E-04	8.442E-04	838.	9.702E-04	9.445E-04	838.	5.645E-03	5.483E-03
S	829.	829.	7.696E-04	7.492E-04	829.	8.417E-04	8.194E-04	829.	5.862E-03	5.695E-03
SSW	835.	835.	7.427E-04	7.231E-04	835.	9.375E-04	9.127E-04	835.	4.167E-03	4.048E-03
SW	628.	628.	1.246E-03	1.213E-03	628.	1.601E-03	1.559E-03	628.	9.396E-03	9.126E-03
WSW	533.	533.	1.314E-03	1.279E-03	533.	1.525E-03	1.485E-03	533.	1.017E-02	9.882E-03
W	524.	524.	1.249E-03	1.216E-03	524.	1.520E-03	1.480E-03	524.	1.225E-02	1.190E-02
WNW	643.	643.	8.669E-04	8.440E-04	643.	1.045E-03	1.017E-03	643.	9.595E-03	9.317E-03
NW	762.	762.	7.580E-04	7.379E-04	762.	9.125E-04	8.884E-04	762.	7.895E-03	7.666E-03
NNW	890.	890.	7.369E-04	7.174E-04	890.	8.161E-04	7.945E-04	890.	6.693E-03	6.500E-03

LASALLE SITE METEOROLOGICAL DATA 1/78 - 12/87

Table F-7 (Continued)

Maximum Offsite Finite Plume Gamma Dose Factors Based on 1 cm Depth at the Unrestricted Area Boundary for Kr-89

Downwind Unrestricted Direction Area Bound	Radius (meters)	Elevated(Stack) Release S (mrad/yr)/(uCi/sec)		Mixed Mode(Vent) Release V (mrad/yr)/(uCi/sec)		Ground Level Release G (mrad/yr)/(uCi/sec)				
		SBAR	SBAR	Radius (meters)	VBAR	Radius (meters)	GBAR			
N	1036.	1036.	3.904E-04	3.794E-04	1036.	4.258E-04	4.139E-04	1036.	2.051E-03	1.992E-03
NNE	1378.	1378.	2.820E-04	2.741E-04	1378.	2.988E-04	2.904E-04	1378.	1.151E-03	1.118E-03
NE	2408.	2408.	8.306E-05	8.072E-05	2408.	7.403E-05	7.195E-05	2408.	2.060E-04	2.001E-04
ENE	4450.	4450.	1.570E-05	1.526E-05	4450.	1.153E-05	1.121E-05	4450.	1.701E-05	1.653E-05
E	1996.	1996.	1.052E-04	1.023E-04	1996.	9.299E-05	9.037E-05	1996.	3.031E-04	2.944E-04
ESE	1465.	1465.	2.365E-04	2.299E-04	1465.	2.240E-04	2.177E-04	1465.	7.762E-04	7.540E-04
SE	969.	969.	3.891E-04	3.782E-04	969.	4.188E-04	4.070E-04	969.	1.846E-03	1.793E-03
SSE	838.	838.	4.108E-04	3.993E-04	838.	4.365E-04	4.243E-04	838.	1.831E-03	1.778E-03
S	829.	829.	3.408E-04	3.312E-04	829.	3.253E-04	3.162E-04	829.	2.034E-03	1.976E-03
SSW	835.	835.	2.921E-04	2.839E-04	835.	2.779E-04	2.702E-04	835.	1.021E-03	9.916E-04
SW	628.	628.	5.830E-04	5.667E-04	628.	6.600E-04	6.415E-04	628.	3.274E-03	3.180E-03
WSW	533.	533.	6.913E-04	6.720E-04	533.	7.525E-04	7.314E-04	533.	4.592E-03	4.460E-03
W	524.	524.	6.961E-04	6.766E-04	524.	8.259E-04	8.028E-04	524.	5.967E-03	5.796E-03
WNW	643.	643.	4.295E-04	4.174E-04	643.	5.147E-04	5.003E-04	643.	3.746E-03	3.638E-03
NW	762.	762.	3.500E-04	3.402E-04	762.	4.035E-04	3.922E-04	762.	2.561E-03	2.488E-03
NNW	890.	890.	3.301E-04	3.208E-04	890.	3.415E-04	3.319E-04	890.	1.966E-03	1.909E-03

LASALLE SITE METEOROLOGICAL DATA 1/78 - 12/87

Table F-7 (Continued)

Maximum Offsite Finite Plume Gamma Dose Factors Based on 1 cm Depth at the Unrestricted Area Boundary for Kr-90

Downwind Unrestricted Direction Area Bound	Elevated(Stack) Release Radius	S		SBAR		Mixed Mode(Vent) Release Radius	V		VBAR		Ground Level Release Radius	G		GBAR			
		(meters)	(meters)	(mrad/yr)	((uCi/sec)		(meters)	(mrad/yr)	((uCi/sec)	(meters)		(mrad/yr)	((uCi/sec)	(meters)	(mrad/yr)	((uCi/sec)	(meters)
N	1036.	1036.	6.785E-05	6.586E-05	1036.	5.199E-05	5.047E-05	1036.	8.203E-05	7.954E-05							
NNE	1378.	1378.	3.195E-05	3.102E-05	1378.	2.161E-05	2.098E-05	1378.	2.265E-05	2.196E-05							
NE	2408.	2408.	2.160E-06	2.097E-06	2408.	9.136E-07	8.868E-07	2408.	5.870E-07	5.693E-07							
ENE	4450.	4450.	1.109E-07	1.076E-07	4450.	3.907E-08	3.792E-08	4450.	1.814E-08	1.759E-08							
E	1996.	1996.	4.713E-06	4.575E-06	1996.	2.562E-06	2.486E-06	1996.	2.865E-06	2.779E-06							
ESE	1465.	1465.	2.134E-05	2.072E-05	1465.	1.551E-05	1.506E-05	1465.	2.503E-05	2.427E-05							
SE	969.	969.	5.843E-05	5.673E-05	969.	5.324E-05	5.168E-05	969.	1.365E-04	1.324E-04							
SSE	838.	838.	6.863E-05	6.663E-05	838.	6.174E-05	5.993E-05	838.	1.227E-04	1.190E-04							
S	829.	829.	5.057E-05	4.909E-05	829.	3.745E-05	3.635E-05	829.	1.055E-04	1.023E-04							
SSW	835.	835.	3.062E-05	2.972E-05	835.	1.274E-05	1.237E-05	835.	1.835E-05	1.779E-05							
SW	628.	628.	9.754E-05	9.470E-05	628.	6.538E-05	6.347E-05	628.	1.410E-04	1.368E-04							
WSW	533.	533.	1.892E-04	1.836E-04	533.	1.525E-04	1.480E-04	533.	4.861E-04	4.713E-04							
W	524.	524.	2.165E-04	2.101E-04	524.	2.185E-04	2.121E-04	524.	8.427E-04	8.170E-04							
WNW	643.	643.	1.018E-04	9.883E-05	643.	1.008E-04	9.787E-05	643.	3.141E-04	3.045E-04							
NW	762.	762.	6.634E-05	6.440E-05	762.	5.815E-05	5.645E-05	762.	1.306E-04	1.267E-04							
NNW	890.	890.	5.725E-05	5.558E-05	890.	4.336E-05	4.209E-05	890.	8.819E-05	8.551E-05							

LASALLE SITE METEOROLOGICAL DATA 1/78 - 12/87

Table F-7 (Continued)

Maximum Offsite Finite Plume Gamma Dose Factors Based on 1 cm Depth at the Unrestricted Area Boundary for Xe-131m

Downwind Unrestricted Direction Area Bound	Radius (meters)	Elevated(Stack) Release		Mixed Mode(Vent) Release			Ground Level Release			
		Radius (meters)	S (mrad/yr)/(uCi/sec)	SBAR (uCi/sec)	Radius (meters)	V (mrad/yr)/(uCi/sec)	VBAR (uCi/sec)	Radius (meters)	G (mrad/yr)/(uCi/sec)	GBAR (uCi/sec)
N	1036.	1036.	1.606E-06	1.473E-06	1036.	1.827E-06	1.679E-06	1036.	1.645E-04	1.283E-04
NNE	1378.	1378.	1.778E-06	1.572E-06	1378.	1.726E-06	1.553E-06	1378.	1.072E-04	8.384E-05
NE	2408.	2408.	1.086E-06	9.376E-07	2408.	1.136E-06	9.826E-07	2408.	4.347E-05	3.412E-05
ENE	4450.	4450.	7.931E-07	6.617E-07	4450.	7.858E-07	6.550E-07	4450.	1.623E-05	1.279E-05
E	1996.	1996.	9.572E-07	8.457E-07	1996.	1.230E-06	1.058E-06	1996.	5.428E-05	4.253E-05
ESE	1465.	1465.	1.347E-06	1.215E-06	1465.	1.789E-06	1.560E-06	1465.	7.935E-05	6.215E-05
SE	969.	969.	1.472E-06	1.365E-06	969.	2.406E-06	2.115E-06	969.	1.240E-04	9.696E-05
SSE	838.	838.	1.415E-06	1.318E-06	838.	2.598E-06	2.260E-06	838.	1.228E-04	9.597E-05
S	829.	829.	1.231E-06	1.144E-06	829.	1.966E-06	1.727E-06	829.	1.232E-04	9.639E-05
SSW	835.	835.	1.196E-06	1.103E-06	835.	2.003E-06	1.755E-06	835.	8.798E-05	6.885E-05
SW	628.	628.	1.802E-06	1.691E-06	628.	4.345E-06	3.728E-06	628.	2.109E-04	1.646E-04
WSW	533.	533.	1.859E-06	1.755E-06	533.	4.161E-06	3.577E-06	533.	2.324E-04	1.813E-04
W	524.	524.	1.800E-06	1.703E-06	524.	3.359E-06	2.972E-06	524.	3.000E-04	2.335E-04
WNW	643.	643.	1.263E-06	1.194E-06	643.	1.976E-06	1.791E-06	643.	2.446E-04	1.902E-04
NW	762.	762.	1.135E-06	1.069E-06	762.	1.561E-06	1.437E-06	762.	2.005E-04	1.560E-04
NNW	890.	890.	1.191E-06	1.112E-06	890.	1.363E-06	1.263E-06	890.	1.664E-04	1.295E-04

LASALLE SITE METEOROLOGICAL DATA 1/78 - 12/87

Table F-7 (Continued)

Maximum Offsite Finite Plume Gamma Dose Factors Based on 1 cm Depth at the Unrestricted Area Boundary for Xe-133m

Direction	Downwind Unrestricted Area Bound		Elevated(Stack) Release		Mixed Mode(Vent) Release			Ground Level Release		
	Radius (meters)	Radius (meters)	S (mrad/yr)/(uCi/sec)	SBAR (mrad/yr)/(uCi/sec)	Radius (meters)	V (mrad/yr)/(uCi/sec)	VBAR (mrad/yr)/(uCi/sec)	Radius (meters)	G (mrad/yr)/(uCi/sec)	GBAR (mrad/yr)/(uCi/sec)
N	1036.	1036.	8.557E-06	8.199E-06	1036.	9.814E-06	9.407E-06	1036.	2.822E-04	2.410E-04
NNE	1378.	1378.	7.917E-06	7.509E-06	1378.	8.400E-06	8.009E-06	1378.	1.901E-04	1.633E-04
NE	2408.	2408.	4.246E-06	3.993E-06	2408.	4.482E-06	4.217E-06	2408.	8.032E-05	6.950E-05
ENE	4450.	4450.	2.488E-06	2.298E-06	4450.	2.450E-06	2.262E-06	4450.	3.108E-05	2.706E-05
E	1996.	1996.	4.247E-06	4.028E-06	1996.	4.721E-06	4.433E-06	1996.	9.835E-05	8.482E-05
ESE	1465.	1465.	6.614E-06	6.309E-06	1465.	7.393E-06	6.978E-06	1465.	1.432E-04	1.234E-04
SE	969.	969.	8.229E-06	7.903E-06	969.	1.039E-05	9.834E-06	969.	2.189E-04	1.879E-04
SSE	838.	838.	8.070E-06	7.758E-06	838.	1.060E-05	9.998E-06	838.	2.163E-04	1.856E-04
S	829.	829.	6.932E-06	6.660E-06	829.	8.449E-06	7.995E-06	829.	2.201E-04	1.893E-04
SSW	835.	835.	6.541E-06	6.276E-06	835.	8.500E-06	8.036E-06	835.	1.574E-04	1.354E-04
SW	628.	628.	1.059E-05	1.020E-05	628.	1.637E-05	1.535E-05	628.	3.668E-04	3.140E-04
WSW	533.	533.	1.121E-05	1.081E-05	533.	1.588E-05	1.490E-05	533.	4.005E-04	3.423E-04
W	524.	524.	1.096E-05	1.056E-05	524.	1.504E-05	1.427E-05	524.	5.039E-04	4.287E-04
WNW	643.	643.	7.648E-06	7.374E-06	643.	9.956E-06	9.510E-06	643.	4.055E-04	3.441E-04
NW	762.	762.	6.774E-06	6.526E-06	762.	8.435E-06	8.088E-06	762.	3.334E-04	2.831E-04
NNW	890.	890.	6.855E-06	6.594E-06	890.	7.588E-06	7.286E-06	890.	2.794E-04	2.377E-04

LASALLE SITE METEOROLOGICAL DATA 1/78 - 12/87

Table F-7 (Continued)

Maximum Offsite Finite Plume Gamma Dose Factors Based on 1 cm Depth at the Unrestricted Area Boundary for Xe-133

Downwind Direction	Unrestricted Area Bound Radius (meters)	Elevated(Stack) Release		Mixed Mode(Vent) Release		Ground Level Release				
		Radius (meters)	S (mrad/yr)/(uCi/sec)	SBAR (uCi/sec)	Radius (meters)	V (mrad/yr)/(uCi/sec)	VBAR (uCi/sec)	Radius (meters)	G (mrad/yr)/(uCi/sec)	GBAR (uCi/sec)
N	1036.	1036.	7.010E-06	6.757E-06	1036.	7.933E-06	7.649E-06	1036.	3.136E-04	2.785E-04
NNE	1378.	1378.	6.939E-06	6.629E-06	1378.	7.149E-06	6.860E-06	1378.	2.132E-04	1.903E-04
NE	2408.	2408.	3.969E-06	3.767E-06	2408.	4.106E-06	3.897E-06	2408.	9.094E-05	8.164E-05
ENE	4450.	4450.	2.442E-06	2.286E-06	4450.	2.384E-06	2.229E-06	4450.	3.540E-05	3.193E-05
E	1996.	1996.	3.841E-06	3.671E-06	1996.	4.310E-06	4.083E-06	1996.	1.109E-04	9.929E-05
ESE	1465.	1465.	5.762E-06	5.534E-06	1465.	6.599E-06	6.277E-06	1465.	1.612E-04	1.443E-04
SE	969.	969.	6.641E-06	6.416E-06	969.	8.978E-06	8.558E-06	969.	2.450E-04	2.185E-04
SSE	838.	838.	6.364E-06	6.153E-06	838.	9.231E-06	8.769E-06	838.	2.418E-04	2.156E-04
S	829.	829.	5.333E-06	5.152E-06	829.	6.962E-06	6.627E-06	829.	2.476E-04	2.212E-04
SSW	835.	835.	4.969E-06	4.793E-06	835.	6.598E-06	6.266E-06	835.	1.770E-04	1.582E-04
SW	628.	628.	7.798E-06	7.549E-06	628.	1.362E-05	1.285E-05	628.	4.090E-04	3.640E-04
WSW	533.	533.	8.245E-06	7.992E-06	533.	1.326E-05	1.252E-05	533.	4.447E-04	3.951E-04
W	524.	524.	8.166E-06	7.919E-06	524.	1.220E-05	1.164E-05	524.	5.551E-04	4.911E-04
WNW	643.	643.	5.715E-06	5.541E-06	643.	7.885E-06	7.574E-06	643.	4.444E-04	3.922E-04
NW	762.	762.	5.117E-06	4.958E-06	762.	6.538E-06	6.303E-06	762.	3.661E-04	3.233E-04
NNW	890.	890.	5.340E-06	5.165E-06	890.	5.911E-06	5.708E-06	890.	3.080E-04	2.725E-04

LASALLE SITE METEOROLOGICAL DATA 1/78 - 12/87

Table F-7 (Continued)

Maximum Offsite Finite Plume Gamma Dose Factors Based on 1 cm Depth at the Unrestricted Area Boundary for Xe-135m

Direction	Downwind Unrestricted Area Bound Radius (meters)	Elevated(Stack) Release		Mixed Mode(Vent) Release			Ground Level Release			
		Radius (meters)	S (mrad/yr)/(uCi/sec)	SBAR	Radius (meters)	V (mrad/yr)/(uCi/sec)	VBAR	Radius (meters)	G (mrad/yr)/(uCi/sec)	GBAR
N	1036.	1036.	1.396E-04	1.349E-04	1036.	1.598E-04	1.545E-04	1036.	1.531E-03	1.475E-03
NNE	1378.	1378.	1.151E-04	1.113E-04	1378.	1.274E-04	1.232E-04	1378.	1.019E-03	9.821E-04
NE	2408.	2408.	5.077E-05	4.907E-05	2408.	5.129E-05	4.958E-05	2408.	3.516E-04	3.390E-04
ENE	4450.	4450.	1.919E-05	1.854E-05	4450.	1.778E-05	1.719E-05	4450.	8.758E-05	8.445E-05
E	1996.	1996.	5.672E-05	5.483E-05	1996.	5.675E-05	5.486E-05	1996.	4.329E-04	4.172E-04
ESE	1465.	1465.	1.005E-04	9.716E-05	1465.	1.024E-04	9.902E-05	1465.	7.369E-04	7.103E-04
SE	969.	969.	1.389E-04	1.343E-04	969.	1.575E-04	1.522E-04	969.	1.262E-03	1.216E-03
SSE	838.	838.	1.402E-04	1.356E-04	838.	1.591E-04	1.538E-04	838.	1.254E-03	1.209E-03
S	829.	829.	1.183E-04	1.144E-04	829.	1.235E-04	1.194E-04	829.	1.341E-03	1.292E-03
SSW	835.	835.	1.104E-04	1.068E-04	835.	1.260E-04	1.218E-04	835.	8.762E-04	8.444E-04
SW	628.	628.	1.904E-04	1.841E-04	628.	2.444E-04	2.363E-04	628.	2.173E-03	2.094E-03
WSW	533.	533.	2.063E-04	1.995E-04	533.	2.427E-04	2.345E-04	533.	2.479E-03	2.388E-03
W	524.	524.	2.033E-04	1.966E-04	524.	2.511E-04	2.427E-04	524.	3.050E-03	2.937E-03
WNW	643.	643.	1.363E-04	1.318E-04	643.	1.687E-04	1.631E-04	643.	2.286E-03	2.201E-03
NW	762.	762.	1.187E-04	1.148E-04	762.	1.423E-04	1.376E-04	762.	1.806E-03	1.739E-03
NNW	890.	890.	1.161E-04	1.122E-04	890.	1.259E-04	1.217E-04	890.	1.482E-03	1.427E-03

LASALLE SITE METEOROLOGICAL DATA 1/78 - 12/87

Table F-7 (Continued)

Maximum Offsite Finite Plume Gamma Dose Factors Based on 1 cm Depth at the Unrestricted Area Boundary for Xe-135

Direction	Unrestricted Area Bound Radius (meters)	Elevated(Stack) Release		Mixed Mode(Vent) Release		Ground Level Release				
		Radius (meters)	S (mrad/yr)/(uCi/sec)	SBAR (mrad/yr)/(uCi/sec)	Radius (meters)	V (mrad/yr)/(uCi/sec)	VBAR (mrad/yr)/(uCi/sec)	Radius (meters)	G (mrad/yr)/(uCi/sec)	GBAR (mrad/yr)/(uCi/sec)
N	1036.	1036.	8.165E-05	7.902E-05	1036.	9.387E-05	9.085E-05	1036.	1.302E-03	1.257E-03
NNE	1378.	1378.	7.171E-05	6.940E-05	1378.	7.821E-05	7.569E-05	1378.	9.178E-04	8.866E-04
NE	2408.	2408.	3.669E-05	3.550E-05	2408.	3.876E-05	3.751E-05	2408.	4.075E-04	3.937E-04
ENE	4450.	4450.	1.928E-05	1.866E-05	4450.	1.899E-05	1.837E-05	4450.	1.625E-04	1.570E-04
E	1996.	1996.	3.838E-05	3.714E-05	1996.	4.056E-05	3.925E-05	1996.	4.869E-04	4.704E-04
ESE	1465.	1465.	6.171E-05	5.972E-05	1465.	6.539E-05	6.328E-05	1465.	7.073E-04	6.833E-04
SE	969.	969.	7.953E-05	7.697E-05	969.	9.346E-05	9.044E-05	969.	1.052E-03	1.017E-03
SSE	838.	838.	7.845E-05	7.593E-05	838.	9.367E-05	9.064E-05	838.	1.037E-03	1.002E-03
S	829.	829.	6.719E-05	6.503E-05	829.	7.587E-05	7.342E-05	829.	1.078E-03	1.041E-03
SSW	835.	835.	6.306E-05	6.103E-05	835.	7.636E-05	7.389E-05	835.	7.699E-04	7.438E-04
SW	628.	628.	1.039E-04	1.006E-04	628.	1.409E-04	1.363E-04	628.	1.729E-03	1.670E-03
WSW	533.	533.	1.106E-04	1.071E-04	533.	1.372E-04	1.328E-04	533.	1.864E-03	1.801E-03
W	524.	524.	1.082E-04	1.048E-04	524.	1.374E-04	1.329E-04	524.	2.256E-03	2.179E-03
WNW	643.	643.	7.538E-05	7.296E-05	643.	9.395E-05	9.092E-05	643.	1.775E-03	1.713E-03
NW	762.	762.	6.654E-05	6.440E-05	762.	8.098E-05	7.838E-05	762.	1.466E-03	1.415E-03
NNW	890.	890.	6.671E-05	6.456E-05	890.	7.327E-05	7.092E-05	890.	1.247E-03	1.204E-03

LASALLE SITE METEOROLOGICAL DATA 1/78 - 12/87

Table F-7 (Continued)

Maximum Offsite Finite Plume Gamma Dose Factors Based on 1 cm Depth at the Unrestricted Area Boundary for Xe-137

Direction	Downwind Unrestricted		Elevated(Stack) Release		Mixed Mode(Vent) Release		Ground Level Release			
	Area Bound (meters)	Radius (meters)	S (mrad/yr)/(uCi/sec)	SBAR	Radius (meters)	V (mrad/yr)/(uCi/sec)	VBAR	Radius (meters)	G (mrad/yr)/(uCi/sec)	GBAR
N	1036.	1036.	4.780E-05	4.627E-05	1036.	5.242E-05	5.074E-05	1036.	3.409E-04	3.298E-04
NNE	1378.	1378.	3.585E-05	3.471E-05	1378.	3.814E-05	3.692E-05	1378.	1.975E-04	1.911E-04
NE	2408.	2408.	1.153E-05	1.116E-05	2408.	1.052E-05	1.018E-05	2408.	3.979E-05	3.850E-05
ENE	4450.	4450.	2.512E-06	2.432E-06	4450.	1.933E-06	1.871E-06	4450.	3.949E-06	3.821E-06
E	1996.	1996.	1.420E-05	1.374E-05	1996.	1.285E-05	1.244E-05	1996.	5.599E-05	5.418E-05
ESE	1465.	1465.	3.033E-05	2.936E-05	1465.	2.918E-05	2.825E-05	1465.	1.327E-04	1.284E-04
SE	969.	969.	4.743E-05	4.591E-05	969.	5.188E-05	5.023E-05	969.	2.989E-04	2.892E-04
SSE	838.	838.	4.926E-05	4.769E-05	838.	5.357E-05	5.186E-05	838.	2.970E-04	2.874E-04
S	829.	829.	4.072E-05	3.942E-05	829.	3.975E-05	3.849E-05	829.	3.298E-04	3.191E-04
SSW	835.	835.	3.521E-05	3.408E-05	835.	3.424E-05	3.315E-05	835.	1.748E-04	1.691E-04
SW	628.	628.	6.779E-05	6.563E-05	628.	7.938E-05	7.685E-05	628.	5.333E-04	5.161E-04
WSW	533.	533.	7.919E-05	7.667E-05	533.	8.829E-05	8.548E-05	533.	7.164E-04	6.932E-04
W	524.	524.	7.990E-05	7.736E-05	524.	9.608E-05	9.302E-05	524.	9.223E-04	8.924E-04
WNW	643.	643.	5.023E-05	4.863E-05	643.	6.090E-05	5.896E-05	643.	6.002E-04	5.808E-04
NW	762.	762.	4.160E-05	4.028E-05	762.	4.841E-05	4.687E-05	762.	4.228E-04	4.090E-04
NNW	890.	890.	3.985E-05	3.858E-05	890.	4.152E-05	4.020E-05	890.	3.279E-04	3.172E-04

LASALLE SITE METEOROLOGICAL DATA 1/78 - 12/87

Table F-7 (Continued)

Maximum Offsite Finite Plume Gamma Dose Factors Based on 1 cm Depth at the Unrestricted Area Boundary for Xe-138

Downwind Unrestricted Direction Area Bound	Elevated(Stack) Release Radius (meters)	Release		Mixed Mode(Vent) Release Radius (meters)	Release		Ground Level Release Radius (meters)	Release		
		S	SBAR		V	VBAR		G	-GBAR	
(meters)	(meters)	(mrad/yr)/(uCi/sec)	(mrad/yr)/(uCi/sec)	(meters)	(mrad/yr)/(uCi/sec)	(mrad/yr)/(uCi/sec)	(meters)	(mrad/yr)/(uCi/sec)	(mrad/yr)/(uCi/sec)	
N	1036.	1036.	3.926E-04	3.816E-04	1036.	4.523E-04	4.396E-04	1036.	3.178E-03	3.084E-03
NNE	1378.	1378.	3.160E-04	3.071E-04	1378.	3.536E-04	3.437E-04	1378.	2.117E-03	2.055E-03
NE	2408.	2408.	1.356E-04	1.318E-04	2408.	1.379E-04	1.340E-04	2408.	7.244E-04	7.032E-04
ENE	4450.	4450.	4.939E-05	4.799E-05	4450.	4.572E-05	4.443E-05	4450.	1.769E-04	1.718E-04
E	1996.	1996.	1.540E-04	1.497E-04	1996.	1.535E-04	1.492E-04	1996.	8.921E-04	8.659E-04
ESE	1465.	1465.	2.766E-04	2.689E-04	1465.	2.804E-04	2.725E-04	1465.	1.532E-03	1.487E-03
SE	969.	969.	3.938E-04	3.828E-04	969.	4.408E-04	4.285E-04	969.	2.641E-03	2.564E-03
SSE	838.	838.	4.037E-04	3.924E-04	838.	4.484E-04	4.358E-04	838.	2.628E-03	2.551E-03
S	829.	829.	3.457E-04	3.360E-04	829.	3.560E-04	3.460E-04	829.	2.809E-03	2.727E-03
SSW	835.	835.	3.277E-04	3.186E-04	835.	3.832E-04	3.724E-04	835.	1.828E-03	1.774E-03
SW	628.	628.	5.698E-04	5.538E-04	628.	7.209E-04	7.007E-04	628.	4.546E-03	4.412E-03
WSW	533.	533.	6.144E-04	5.973E-04	533.	7.121E-04	6.921E-04	533.	5.206E-03	5.053E-03
W	524.	524.	5.976E-04	5.809E-04	524.	7.318E-04	7.113E-04	524.	6.383E-03	6.195E-03
WNW	643.	643.	3.986E-04	3.875E-04	643.	4.887E-04	4.750E-04	643.	4.757E-03	4.616E-03
NW	762.	762.	3.457E-04	3.360E-04	762.	4.131E-04	4.016E-04	762.	3.746E-03	3.635E-03
NNW	890.	890.	3.330E-04	3.236E-04	890.	3.626E-04	3.525E-04	890.	3.069E-03	2.978E-03

LASALLE SITE METEOROLOGICAL DATA 1/78 - 12/87

LaSalle

Revision 3
May 2001

Table F-7 (Continued)

Maximum Offsite Finite Plume Gamma Dose Factors Based on 1 cm Depth at the Unrestricted Area Boundary for Ar-41

Downwind Unrestricted Direction Area Bound	Elevated(Stack) Release Radius S	Release		Mixed Mode(Vent) Release Radius V	Release		Ground Level Release			
		(mrad/yr)/(uCi/sec)	SBAR		(mrad/yr)/(uCi/sec)	VBAR	Radius G	(mrad/yr)/(uCi/sec)		
(meters)	(meters)	(mrad/yr)/(uCi/sec)	SBAR	(meters)	(mrad/yr)/(uCi/sec)	VBAR	(meters)	G	GBAR	
N	1036.	1036.	4.746E-04	4.594E-04	1036.	5.528E-04	5.351E-04	1036.	4.557E-03	4.411E-03
NNE	1378.	1378.	3.954E-04	3.828E-04	1378.	4.439E-04	4.297E-04	1378.	3.203E-03	3.101E-03
NE	2408.	2408.	1.925E-04	1.863E-04	2408.	2.045E-04	1.980E-04	2408.	1.387E-03	1.343E-03
ENE	4450.	4450.	9.141E-05	8.848E-05	4450.	9.061E-05	8.772E-05	4450.	5.219E-04	5.052E-04
E	1996.	1996.	2.110E-04	2.043E-04	1996.	2.180E-04	2.110E-04	1996.	1.658E-03	1.605E-03
ESE	1465.	1465.	3.480E-04	3.368E-04	1465.	3.593E-04	3.478E-04	1465.	2.459E-03	2.381E-03
SE	969.	969.	4.711E-04	4.560E-04	969.	5.320E-04	5.149E-04	969.	3.715E-03	3.597E-03
SSE	838.	838.	4.761E-04	4.608E-04	838.	5.378E-04	5.206E-04	838.	3.671E-03	3.554E-03
S	829.	829.	4.168E-04	4.035E-04	829.	4.533E-04	4.388E-04	829.	3.823E-03	3.701E-03
SSW	835.	835.	3.994E-04	3.866E-04	835.	4.930E-04	4.772E-04	835.	2.700E-03	2.614E-03
SW	628.	628.	6.711E-04	6.496E-04	628.	8.591E-04	8.316E-04	628.	6.139E-03	5.943E-03
WSW	533.	533.	7.089E-04	6.862E-04	533.	8.229E-04	7.966E-04	533.	6.667E-03	6.453E-03
W	524.	524.	6.802E-04	6.584E-04	524.	8.291E-04	8.026E-04	524.	8.057E-03	7.799E-03
WNW	643.	643.	4.708E-04	4.558E-04	643.	5.716E-04	5.533E-04	643.	6.300E-03	6.099E-03
NW	762.	762.	4.123E-04	3.991E-04	762.	4.970E-04	4.811E-04	762.	5.173E-03	5.008E-03
NNW	890.	890.	4.025E-04	3.896E-04	890.	4.447E-04	4.305E-04	890.	4.374E-03	4.234E-03

LASALLE SITE METEOROLOGICAL DATA 1/78 - 12/87

LaSalle

Revision 3
May 2001

Table F-7a

Maximum Offsite Finite Plume Gamma Dose Factors Based on 1 cm Depth at the Restricted Area Boundary for Kr-83m

Downwind Direction	Restricted Area Bound (meters)	Elevated(Stack) Release		Mixed Mode(Vent) Release		Ground Level Release				
		Radius (meters)	S (mrad/yr)/(uCi/sec)	SBAR (mrad/yr)/(uCi/sec)	Radius (meters)	V (mrad/yr)/(uCi/sec)	VBAR (mrad/yr)/(uCi/sec)	Radius (meters)	G (mrad/yr)/(uCi/sec)	GBAR (mrad/yr)/(uCi/sec)
N	1036.	1036.	4.787E-07	3.609E-07	1036.	5.281E-07	3.982E-07	1036.	1.785E-04	1.346E-04
NNE	1378.	1378.	8.751E-07	6.599E-07	1378.	6.905E-07	5.206E-07	1378.	1.139E-04	8.586E-05
NE	1609.	1609.	6.873E-07	5.182E-07	1609.	7.291E-07	5.497E-07	1609.	8.106E-05	6.112E-05
ENE	1079.	1079.	4.160E-07	3.137E-07	1079.	8.010E-07	6.039E-07	1079.	1.322E-04	9.967E-05
E	1055.	1055.	3.476E-07	2.621E-07	1055.	9.181E-07	6.923E-07	1055.	1.483E-04	1.118E-04
ESE	1055.	1055.	4.371E-07	3.296E-07	1055.	1.175E-06	8.856E-07	1055.	1.394E-04	1.051E-04
SE	969.	969.	3.545E-07	2.673E-07	969.	1.267E-06	9.554E-07	969.	1.333E-04	1.005E-04
SSE	698.	698.	2.415E-07	1.821E-07	698.	1.646E-06	1.241E-06	698.	1.773E-04	1.337E-04
S	820.	820.	2.803E-07	2.114E-07	820.	1.047E-06	7.895E-07	820.	1.354E-04	1.021E-04
SSW	835.	835.	3.185E-07	2.401E-07	835.	1.071E-06	8.076E-07	835.	9.326E-05	7.032E-05
SW	628.	628.	3.177E-07	2.395E-07	628.	2.826E-06	2.131E-06	628.	2.305E-04	1.738E-04
WSW	533.	533.	2.617E-07	1.973E-07	533.	2.674E-06	2.017E-06	533.	2.568E-04	1.936E-04
W	524.	524.	2.327E-07	1.754E-07	524.	1.658E-06	1.250E-06	524.	3.352E-04	2.527E-04
WNW	643.	643.	1.714E-07	1.292E-07	643.	7.235E-07	5.455E-07	643.	2.728E-04	2.057E-04
NW	762.	762.	1.744E-07	1.315E-07	762.	4.391E-07	3.311E-07	762.	2.219E-04	1.673E-04
NNW	890.	890.	2.397E-07	1.807E-07	890.	3.334E-07	2.514E-07	890.	1.823E-04	1.374E-04

LASALLE SITE METEOROLOGICAL DATA 1/78 - 12/87

The restricted area boundary (RAB) was redefined in sectors E and ESE to 833 and 848 from 1055 and 1055 meters, respectively. As a result of this change of range, the dose factors were re-evaluated using the following equation. Here, F_R is the resulting dose factor at the new range (i.e. 833). F_{R_0} is the value provided in the above ODCM tables (i.e. S, SBAR, V, VBAR, G, GBAR). R_0 is the former RAB distance (i.e. 1055), and R is the RAB distance (i.e. 833).

$$F_R = F_{R_0} \left[\frac{R_0}{R} \right]^{1.5}$$

This analysis indicates that the change in range would increase the dose factor error by approximately 40%. Since this difference is well within the expected error of the current factors, no further adjustment in the above factors is considered necessary.

Note: Based on Reference 1 of Section F.2 and the formulas in Sections B.5 and B.6 of Appendix B.

LaSalle
Table F-7a (Continued)

Revision 3
May 2001

Maximum Offsite Finite Plume Gamma Dose Factors Based on 1 cm Depth at the Restricted Area Boundary for Kr-85m

Downwind Direction	Restricted Area Bound (meters)	Elevated(Stack) Release		Mixed Mode(Vent) Release		Ground Level Release				
		Radius (meters)	S (mrad/yr)/(uCi/sec)	SBAR (mrad/yr)/(uCi/sec)	Radius (meters)	V (mrad/yr)/(uCi/sec)	VBAR (mrad/yr)/(uCi/sec)	Radius (meters)	G (mrad/yr)/(uCi/sec)	GBAR (mrad/yr)/(uCi/sec)
N	1036.	1036.	5.747E-05	5.560E-05	1036.	6.602E-05	6.388E-05	1036.	9.660E-04	9.252E-04
NNE	1378.	1378.	5.063E-05	4.896E-05	1378.	5.514E-05	5.334E-05	1378.	6.776E-04	6.496E-04
NE	1609.	1609.	3.632E-05	3.512E-05	1609.	3.847E-05	3.720E-05	1609.	5.003E-04	4.798E-04
ENE	1079.	1079.	4.315E-05	4.174E-05	1079.	4.569E-05	4.419E-05	1079.	7.345E-04	7.037E-04
E	1055.	1055.	4.572E-05	4.424E-05	1055.	5.053E-05	4.886E-05	1055.	8.134E-04	7.792E-04
ESE	1055.	1055.	5.730E-05	5.544E-05	1055.	6.298E-05	6.090E-05	1055.	8.020E-04	7.687E-04
SE	969.	969.	5.596E-05	5.415E-05	969.	6.610E-05	6.391E-05	969.	7.793E-04	7.470E-04
SSE	698.	698.	6.471E-05	6.263E-05	698.	7.905E-05	7.643E-05	698.	9.815E-04	9.404E-04
S	820.	820.	4.756E-05	4.603E-05	820.	5.386E-05	5.208E-05	820.	8.103E-04	7.769E-04
SSW	835.	835.	4.422E-05	4.279E-05	835.	5.351E-05	5.174E-05	835.	5.684E-04	5.450E-04
SW	628.	628.	7.281E-05	7.046E-05	628.	9.952E-05	9.618E-05	628.	1.285E-03	1.231E-03
WSW	533.	533.	7.757E-05	7.507E-05	533.	9.714E-05	9.388E-05	533.	1.389E-03	1.331E-03
W	524.	524.	7.601E-05	7.356E-05	524.	9.705E-05	9.385E-05	524.	1.687E-03	1.614E-03
WNW	643.	643.	5.286E-05	5.116E-05	643.	6.615E-05	6.399E-05	643.	1.327E-03	1.270E-03
NW	762.	762.	4.668E-05	4.518E-05	762.	5.688E-05	5.503E-05	762.	1.094E-03	1.047E-03
NW	890.	890.	4.683E-05	4.532E-05	890.	5.142E-05	4.976E-05	890.	9.282E-04	8.885E-04

LASALLE SITE METEOROLOGICAL DATA 1/78 - 12/87

The restricted area boundary (RAB) was redefined in sectors E and ESE to 833 and 848 from 1055 and 1055 meters, respectively. As a result of this change of range, the dose factors were re-evaluated using the following equation. Here, F_R is the resulting dose factor at the new range (i.e. 833). F_{R_0} is the value provided in the above ODCM tables (i.e. S, SBAR, V, VBAR, G, GBAR). R_0 is the former RAB distance (i.e. 1055) and R is the RAB distance (i.e. 833).

$$F_R = F_{R_0} \left[\frac{R_0}{R} \right] \exp 1.5$$

This analysis indicates that the change in range would increase the dose factor error by approximately 40%. Since this difference is well within the expected error of the current factors, no further adjustment in the above factors is considered necessary.

LaSalle

Table F-7a (Continued)

Revision 3
May 2001

Maximum Offsite Finite Plume Gamma Dose Factors Based on 1 cm Depth at the Restricted Area Boundary for Kr-85

Downwind Direction	Restricted Area Bound Radius (meters)	Elevated(Stack) Release		Mixed Mode(Vent) Release		Ground Level Release				
		Radius (meters)	S (mrad/yr)/(uCi/sec)	SBAR (mrad/yr)/(uCi/sec)	Radius (meters)	V (mrad/yr)/(uCi/sec)	VBAR (mrad/yr)/(uCi/sec)	Radius (meters)	G (mrad/yr)/(uCi/sec)	GBAR (mrad/yr)/(uCi/sec)
N	1036.	1036.	8.547E-07	8.265E-07	1036.	9.889E-07	9.563E-07	1036.	1.056E-05	1.021E-05
NNE	1378.	1378.	7.309E-07	7.068E-07	1378.	8.077E-07	7.811E-07	1378.	7.474E-06	7.227E-06
NE	1609.	1609.	5.225E-07	5.052E-07	1609.	5.615E-07	5.430E-07	1609.	5.559E-06	5.375E-06
ENE	1079.	1079.	6.463E-07	6.249E-07	1079.	6.707E-07	6.486E-07	1079.	8.057E-06	7.791E-06
E	1055.	1055.	6.819E-07	6.594E-07	1055.	7.385E-07	7.142E-07	1055.	8.923E-06	8.628E-06
ESE	1055.	1055.	8.484E-07	8.204E-07	1055.	9.108E-07	8.808E-07	1055.	8.808E-06	8.517E-06
SE	969.	969.	8.386E-07	8.110E-07	969.	9.583E-07	9.267E-07	969.	8.555E-06	8.273E-06
SSE	698.	698.	9.869E-07	9.543E-07	698.	1.153E-06	1.115E-06	698.	1.072E-05	1.036E-05
S	820.	820.	7.333E-07	7.091E-07	820.	8.154E-07	7.885E-07	820.	8.866E-06	8.574E-06
SSW	835.	835.	6.857E-07	6.630E-07	835.	8.402E-07	8.124E-07	835.	6.270E-06	6.063E-06
SW	628.	628.	1.142E-06	1.104E-06	628.	1.494E-06	1.444E-06	628.	1.401E-05	1.355E-05
WSW	533.	533.	1.211E-06	1.171E-06	533.	1.433E-06	1.386E-06	533.	1.510E-05	1.460E-05
W	524.	524.	1.172E-06	1.134E-06	524.	1.443E-06	1.395E-06	524.	1.824E-05	1.763E-05
WNW	643.	643.	8.185E-07	7.915E-07	643.	1.000E-06	9.670E-07	643.	1.436E-05	1.389E-05
NW	762.	762.	7.192E-07	6.954E-07	762.	8.694E-07	8.407E-07	762.	1.188E-05	1.148E-05
NNW	890.	890.	7.128E-07	6.893E-07	890.	7.849E-07	7.590E-07	890.	1.011E-05	9.778E-06

LASALLE SITE METEOROLOGICAL DATA 1/78 - 12/87

The restricted area boundary (RAB) was redefined in sectors E and ESE to 833 and 848 from 1055 and 1055 meters, respectively. As a result of this change of range, the dose factors were re-evaluated using the following equation. Here, F_R is the resulting dose factor at the new range (i.e. 833). F_{R_0} is the value provided in the above ODCM tables (i.e. S, SBAR, V, VBAR, G, GBAR). R_0 is the former RAB distance (i.e. 1055) and R is the RAB distance (i.e. 833).

$$F_R = F_{R_0} \left[\frac{R_0}{R} \right]^{1.5}$$

This analysis indicates that the change in range would increase the dose factor error by approximately 40%. Since this difference is well within the expected error of the current factors, no further adjustment in the above factors is considered necessary.

LaSalle

Table F-7a (Continued)

Revision 3
May 2001

Maximum Offsite Finite Plume Gamma Dose Factors Based on 1 cm Depth at the Restricted Area Boundary for Kr-87

Downwind Direction	Restricted Area Bound Radius (meters)	Elevated(Stack) Release		Mixed Mode(Vent) Release		Ground Level Release				
		Radius (meters)	S (mrad/yr)/(uCi/sec)	SBAR (mrad/yr)/(uCi/sec)	Radius (meters)	V (mrad/yr)/(uCi/sec)	VBAR (mrad/yr)/(uCi/sec)	Radius (meters)	G (mrad/yr)/(uCi/sec)	GBAR (mrad/yr)/(uCi/sec)
N	1036.	1036.	3.226E-04	3.135E-04	1036.	3.758E-04	3.652E-04	1036.	2.879E-03	2.795E-03
NNE	1378.	1378.	2.672E-04	2.597E-04	1378.	3.005E-04	2.920E-04	1378.	2.019E-03	1.960E-03
NE	1609.	1609.	1.908E-04	1.853E-04	1609.	2.038E-04	1.981E-04	1609.	1.480E-03	1.437E-03
ENE	1079.	1079.	2.430E-04	2.361E-04	1079.	2.534E-04	2.462E-04	1079.	2.192E-03	2.129E-03
E	1055.	1055.	2.601E-04	2.528E-04	1055.	2.785E-04	2.706E-04	1055.	2.423E-03	2.353E-03
ESE	1055.	1055.	3.217E-04	3.125E-04	1055.	3.412E-04	3.315E-04	1055.	2.407E-03	2.337E-03
SE	969.	969.	3.211E-04	3.120E-04	969.	3.612E-04	3.510E-04	969.	2.355E-03	2.287E-03
SSE	698.	698.	3.885E-04	3.776E-04	698.	4.423E-04	4.298E-04	698.	2.985E-03	2.898E-03
S	820.	820.	2.881E-04	2.800E-04	820.	3.117E-04	3.029E-04	820.	2.467E-03	2.396E-03
SSW	835.	835.	2.742E-04	2.665E-04	835.	3.400E-04	3.305E-04	835.	1.706E-03	1.657E-03
SW	628.	628.	4.614E-04	4.484E-04	628.	5.936E-04	5.769E-04	628.	3.903E-03	3.790E-03
WSW	533.	533.	4.880E-04	4.743E-04	533.	5.683E-04	5.523E-04	533.	4.251E-03	4.128E-03
W	524.	524.	4.675E-04	4.543E-04	524.	5.708E-04	5.547E-04	524.	5.136E-03	4.986E-03
WNW	643.	643.	3.224E-04	3.133E-04	643.	3.914E-04	3.804E-04	643.	4.001E-03	3.884E-03
NW	762.	762.	2.823E-04	2.743E-04	762.	3.397E-04	3.301E-04	762.	3.276E-03	3.180E-03
NNW	890.	890.	2.747E-04	2.669E-04	890.	3.031E-04	2.945E-04	890.	2.763E-03	2.683E-03

LASALLE SITE METEOROLOGICAL DATA 1/78 - 12/87

The restricted area boundary (RAB) was redefined in sectors E and ESE to 833 and 848 from 1055 and 1055 meters, respectively. As a result of this change of range, the dose factors were re-evaluated using the following equation. Here, F_R is the resulting dose factor at the new range (i.e. 833). F_{R_0} is the value provided in the above ODCM tables (i.e. S, SBAR, V, VBAR, G, GBAR). R_0 is the former RAB distance (i.e. 1055) and R is the RAB distance (i.e. 833).

$$F_R = F_{R_0} \left[\frac{R_0}{R} \right]^{exp 1.5}$$

This analysis indicates that the change in range would increase the dose factor error by approximately 40%. Since this difference is well within the expected error of the current factors, no further adjustment in the above factors is considered necessary.

LaSalle

Table F-7a (Continued)

Revision 3
May 2001

Maximum Offsite Finite Plume Gamma Dose Factors Based on 1 cm Depth at the Restricted Area Boundary for Kr-88

Downwind Direction	Restricted Area Bound Radius (meters)	Elevated(Stack) Release		Mixed Mode(Vent) Release			Ground Level Release			
		Radius (meters)	S (mrad/yr)/(uCi/sec)	SBAR (mrad/yr)/(uCi/sec)	Radius (meters)	V (mrad/yr)/(uCi/sec)	VBAR (mrad/yr)/(uCi/sec)	Radius (meters)	G (mrad/yr)/(uCi/sec)	GBAR (mrad/yr)/(uCi/sec)
N	1036.	1036.	8.602E-04	8.374E-04	1036.	1.003E-03	9.769E-04	1036.	6.988E-03	6.787E-03
NNE	1378.	1378.	7.111E-04	6.922E-04	1378.	7.989E-04	7.777E-04	1378.	4.940E-03	4.798E-03
NE	1609.	1609.	5.067E-04	4.932E-04	1609.	5.485E-04	5.340E-04	1609.	3.656E-03	3.552E-03
ENE	1079.	1079.	6.528E-04	6.355E-04	1079.	6.769E-04	6.589E-04	1079.	5.337E-03	5.184E-03
E	1055.	1055.	6.915E-04	6.732E-04	1055.	7.419E-04	7.222E-04	1055.	5.907E-03	5.737E-03
ESE	1055.	1055.	8.514E-04	8.288E-04	1055.	9.030E-04	8.790E-04	1055.	5.857E-03	5.689E-03
SE	969.	969.	8.537E-04	8.311E-04	969.	9.571E-04	9.317E-04	969.	5.712E-03	5.549E-03
SSE	698.	698.	1.034E-03	1.007E-03	698.	1.172E-03	1.141E-03	698.	7.193E-03	6.986E-03
S	820.	820.	7.777E-04	7.571E-04	820.	8.513E-04	8.287E-04	820.	5.947E-03	5.777E-03
SSW	835.	835.	7.427E-04	7.231E-04	835.	9.375E-04	9.127E-04	835.	4.167E-03	4.048E-03
SW	628.	628.	1.246E-03	1.213E-03	628.	1.601E-03	1.559E-03	628.	9.396E-03	9.126E-03
WSW	533.	533.	1.314E-03	1.279E-03	533.	1.525E-03	1.485E-03	533.	1.017E-02	9.882E-03
W	524.	524.	1.249E-03	1.216E-03	524.	1.520E-03	1.480E-03	524.	1.225E-02	1.190E-02
WNW	643.	643.	8.669E-04	8.440E-04	643.	1.045E-03	1.017E-03	643.	9.595E-03	9.317E-03
NW	762.	762.	7.580E-04	7.379E-04	762.	9.125E-04	8.884E-04	762.	7.895E-03	7.666E-03
NNW	890.	890.	7.369E-04	7.174E-04	890.	8.161E-04	7.945E-04	890.	6.693E-03	6.500E-03

LASALLE SITE METEOROLOGICAL DATA 1/78 - 12/87

The restricted area boundary (RAB) was redefined in sectors E and ESE to 833 and 848 from 1055 and 1055 meters, respectively. As a result of this change of range, the dose factors were re-evaluated using the following equation. Here, F_R is the resulting dose factor at the new range (i.e. 833). F_{R_0} is the value provided in the above ODCM tables (i.e. S, SBAR, V, VBAR, G, GBAR). R_0 is the former RAB distance (i.e. 1055) and R is the RAB distance (i.e. 833).

$$F_R = F_{R_0} \left[\frac{R_0}{R} \right]^{1.5}$$

This analysis indicates that the change in range would increase the dose factor error by approximately 40%. Since this difference is well within the expected error of the current factors, no further adjustment in the above factors is considered necessary.

LaSalle

Table F-7a (Continued)

Revision 3
May 2001

Maximum Offsite Finite Plume Gamma Dose Factors Based on 1 cm Depth at the Restricted Area Boundary for Kr-89

Downwind Direction	Restricted Area Bound Radius (meters)	Elevated(Stack) Release		Mixed Mode(Vent) Release		Ground Level Release				
		Radius (meters)	S (mrad/yr)/(uCi/sec)	SBAR (mrad/yr)/(uCi/sec)	Radius (meters)	V (mrad/yr)/(uCi/sec)	VBAR (mrad/yr)/(uCi/sec)	Radius (meters)	G (mrad/yr)/(uCi/sec)	GBAR (mrad/yr)/(uCi/sec)
N	1036.	1036.	3.904E-04	3.794E-04	1036.	4.258E-04	4.139E-04	1036.	2.051E-03	1.992E-03
NNE	1378.	1378.	2.820E-04	2.741E-04	1378.	2.988E-04	2.904E-04	1378.	1.151E-03	1.118E-03
NE	1609.	1609.	1.750E-04	1.701E-04	1609.	1.654E-04	1.607E-04	1609.	6.564E-04	6.375E-04
ENE	1079.	1079.	2.703E-04	2.628E-04	1079.	2.619E-04	2.545E-04	1079.	1.450E-03	1.409E-03
E	1055.	1055.	3.041E-04	2.956E-04	1055.	2.972E-04	2.888E-04	1055.	1.569E-03	1.524E-03
ESE	1055.	1055.	3.931E-04	3.821E-04	1055.	3.909E-04	3.800E-04	1055.	1.682E-03	1.633E-03
SE	969.	969.	3.891E-04	3.782E-04	969.	4.188E-04	4.070E-04	969.	1.846E-03	1.793E-03
SSE	698.	698.	5.333E-04	5.184E-04	698.	5.797E-04	5.634E-04	698.	2.722E-03	2.643E-03
S	820.	820.	3.464E-04	3.367E-04	820.	3.312E-04	3.219E-04	820.	2.083E-03	2.023E-03
SSW	835.	835.	2.921E-04	2.839E-04	835.	2.779E-04	2.702E-04	835.	1.021E-03	9.916E-04
SW	628.	628.	5.830E-04	5.667E-04	628.	6.600E-04	6.415E-04	628.	3.274E-03	3.180E-03
WSW	533.	533.	6.913E-04	6.720E-04	533.	7.525E-04	7.314E-04	533.	4.592E-03	4.460E-03
W	524.	524.	6.961E-04	6.766E-04	524.	8.259E-04	8.028E-04	524.	5.967E-03	5.796E-03
WNW	643.	643.	4.295E-04	4.174E-04	643.	5.147E-04	5.003E-04	643.	3.746E-03	3.638E-03
NW	762.	762.	3.500E-04	3.402E-04	762.	4.035E-04	3.922E-04	762.	2.561E-03	2.488E-03
NNW	890.	890.	3.301E-04	3.208E-04	890.	3.415E-04	3.319E-04	890.	1.966E-03	1.909E-03

LASALLE SITE METEOROLOGICAL DATA 1/78 - 12/87

The restricted area boundary (RAB) was redefined in sectors E and ESE to 833 and 848 from 1055 and 1055 meters, respectively. As a result of this change of range, the dose factors were re-evaluated using the following equation. Here, F_R is the resulting dose factor at the new range (i.e. 833). F_{R_0} is the value provided in the above ODCM tables (i.e. S, SBAR, V, VBAR, G, GBAR). R_0 is the former RAB distance (i.e. 1055) and R is the RAB distance (i.e. 833).

$$F_R = F_{R_0} \left[\frac{R_0}{R} \right]^{1.5}$$

This analysis indicates that the change in range would increase the dose factor error by approximately 40%. Since this difference is well within the expected error of the current factors, no further adjustment in the above factors is considered necessary.

LaSalle
Table F-7a (Continued)

Revision 3
May 2001

Maximum Offsite Finite Plume Gamma Dose Factors Based on 1 cm Depth at the Restricted Area Boundary for Kr-90

Downwind Direction	Restricted Area Bound Radius (meters)	Elevated(Stack) Release		Mixed Mode(Vent) Release		Ground Level Release				
		Radius (meters)	S (mrad/yr)/(uCi/sec)	SBAR (mrad/yr)/(uCi/sec)	Radius (meters)	V (mrad/yr)/(uCi/sec)	VBAR (mrad/yr)/(uCi/sec)	Radius (meters)	G (mrad/yr)/(uCi/sec)	GBAR (mrad/yr)/(uCi/sec)
N	1036.	1036.	6.785E-05	6.586E-05	1036.	5.199E-05	5.047E-05	1036.	8.203E-05	7.954E-05
NNE	1378.	1378.	3.195E-05	3.102E-05	1378.	2.161E-05	2.098E-05	1378.	2.265E-05	2.196E-05
NE	1609.	1609.	1.240E-05	1.203E-05	1609.	6.949E-06	6.745E-06	1609.	7.357E-06	7.134E-06
ENE	1079.	1079.	3.718E-05	3.610E-05	1079.	2.538E-05	2.464E-05	1079.	4.577E-05	4.438E-05
E	1055.	1055.	4.582E-05	4.448E-05	1055.	3.257E-05	3.162E-05	1055.	6.817E-05	6.610E-05
ESE	1055.	1055.	6.315E-05	6.130E-05	1055.	5.071E-05	4.922E-05	1055.	1.078E-04	1.046E-04
SE	969.	969.	5.843E-05	5.673E-05	969.	5.324E-05	5.168E-05	969.	1.365E-04	1.324E-04
SSE	698.	698.	1.170E-04	1.136E-04	698.	1.103E-04	1.070E-04	698.	2.578E-04	2.500E-04
S	820.	820.	5.233E-05	5.081E-05	820.	3.888E-05	3.775E-05	820.	1.108E-04	1.075E-04
SSW	835.	835.	3.062E-05	2.972E-05	835.	1.274E-05	1.237E-05	835.	1.835E-05	1.779E-05
SW	628.	628.	9.754E-05	9.470E-05	628.	6.538E-05	6.347E-05	628.	1.410E-04	1.368E-04
WSW	533.	533.	1.892E-04	1.836E-04	533.	1.525E-04	1.480E-04	533.	4.861E-04	4.713E-04
W	524.	524.	2.165E-04	2.101E-04	524.	2.185E-04	2.121E-04	524.	8.427E-04	8.170E-04
WNW	643.	643.	1.018E-04	9.883E-05	643.	1.008E-04	9.787E-05	643.	3.141E-04	3.045E-04
NW	762.	762.	6.634E-05	6.440E-05	762.	5.815E-05	5.645E-05	762.	1.306E-04	1.267E-04
NNW	890.	890.	5.725E-05	5.558E-05	890.	4.336E-05	4.209E-05	890.	8.819E-05	8.551E-05

LASALLE SITE METEOROLOGICAL DATA 1/78 - 12/87

The restricted area boundary (RAB) was redefined in sectors E and ESE to 833 and 848 from 1055 and 1055 meters, respectively. As a result of this change of range, the dose factors were re-evaluated using the following equation. Here, F_R is the resulting dose factor at the new range (i.e. 833). F_{R_0} is the value provided in the above ODCM tables (i.e. S, SBAR, V, VBAR, G, GBAR). R_0 is the former RAB distance (i.e. 1055) and R is the RAB distance (i.e. 833).

$$F_R = F_{R_0} \left[\frac{R_0}{R} \right]^{1.5}$$

This analysis indicates that the change in range would increase the dose factor error by approximately 40%. Since this difference is well within the expected error of the current factors, no further adjustment in the above factors is considered necessary.

LaSalle

Table F-7a (Continued)

Revision 3
May 2001

Maximum Offsite Finite Plume Gamma Dose Factors Based on 1 cm Depth at the Restricted Area Boundary for Xe-131m

Downwind Direction	Restricted Area Bound Radius (meters)	Elevated(Stack) Release		Mixed Mode(Vent) Release		Ground Level Release				
		Radius (meters)	S (mrad/yr)/(uCi/sec)	SBAR (mrad/yr)/(uCi/sec)	Radius (meters)	V (mrad/yr)/(uCi/sec)	VBAR (mrad/yr)/(uCi/sec)	Radius (meters)	G (mrad/yr)/(uCi/sec)	GBAR (mrad/yr)/(uCi/sec)
N	1036.	1036.	1.606E-06	1.473E-06	1036.	1.827E-06	1.679E-06	1036.	1.645E-04	1.283E-04
NNE	1378.	1378.	1.778E-06	1.572E-06	1378.	1.726E-06	1.553E-06	1378.	1.072E-04	8.384E-05
NE	1609.	1609.	1.327E-06	1.167E-06	1609.	1.409E-06	1.239E-06	1609.	7.747E-05	6.064E-05
ENE	1079.	1079.	1.254E-06	1.143E-06	1079.	1.612E-06	1.423E-06	1079.	1.225E-04	9.563E-05
E	1055.	1055.	1.249E-06	1.150E-06	1055.	1.806E-06	1.592E-06	1055.	1.376E-04	1.073E-04
ESE	1055.	1055.	1.566E-06	1.442E-06	1055.	2.270E-06	1.998E-06	1055.	1.298E-04	1.014E-04
SE	969.	969.	1.472E-06	1.365E-06	969.	2.406E-06	2.115E-06	969.	1.240E-04	9.696E-05
SSE	698.	698.	1.566E-06	1.476E-06	698.	2.969E-06	2.597E-06	698.	1.624E-04	1.267E-04
S	820.	820.	1.238E-06	1.151E-06	820.	1.983E-06	1.742E-06	820.	1.253E-04	9.802E-05
SSW	835.	835.	1.196E-06	1.103E-06	835.	2.003E-06	1.755E-06	835.	8.798E-05	6.885E-05
SW	628.	628.	1.802E-06	1.691E-06	628.	4.345E-06	3.728E-06	628.	2.109E-04	1.646E-04
WSW	533.	533.	1.859E-06	1.755E-06	533.	4.161E-06	3.577E-06	533.	2.324E-04	1.813E-04
W	524.	524.	1.800E-06	1.703E-06	524.	3.359E-06	2.972E-06	524.	3.000E-04	2.335E-04
WNW	643.	643.	1.263E-06	1.194E-06	643.	1.976E-06	1.791E-06	643.	2.446E-04	1.902E-04
NW	762.	762.	1.135E-06	1.069E-06	762.	1.561E-06	1.437E-06	762.	2.005E-04	1.560E-04
NHW	890.	890.	1.191E-06	1.112E-06	890.	1.363E-06	1.263E-06	890.	1.664E-04	1.295E-04

LASALLE SITE METEOROLOGICAL DATA 1/78 - 12/87

The restricted area boundary (RAB) was redefined in sectors E and ESE to 833 and 848 from 1055 and 1055 meters, respectively. As a result of this change of range, the dose factors were re-evaluated using the following equation. Here, F_R is the resulting dose factor at the new range (i.e. 833). F_{R_0} is the value provided in the above ODCM tables (i.e. S, SBAR, V, VBAR, G, GBAR). R_0 is the former RAB distance (i.e. 1055) and R is the RAB distance (i.e. 833).

$$F_R = F_{R_0} \left[\frac{R_0}{R} \right]^{1.5}$$

This analysis indicates that the change in range would increase the dose factor error by approximately 40%. Since this difference is well within the expected error of the current factors, no further adjustment in the above factors is considered necessary.

LaSalle
Table F-7a (Continued)

Revision 3
May 2001

Maximum Offsite Finite Plume Gamma Dose Factors Based on 1 cm Depth at the Restricted Area Boundary for Xe-133m

Downwind Direction	Restricted Area Bound Radius (meters)	Elevated(Stack) Release		Mixed Mode(Vent) Release			Ground Level Release			
		Radius (meters)	S (mrad/yr)/(uCi/sec)	SBAR	Radius (meters)	V (mrad/yr)/(uCi/sec)	VBAR	Radius (meters)	G (mrad/yr)/(uCi/sec)	GBAR
N	1036.	1036.	8.557E-06	8.199E-06	1036.	9.814E-06	9.407E-06	1036.	2.822E-04	2.410E-04
NNE	1378.	1378.	7.917E-06	7.509E-06	1378.	8.400E-06	8.009E-06	1378.	1.901E-04	1.633E-04
NE	1609.	1609.	5.729E-06	5.423E-06	1609.	6.093E-06	5.768E-06	1609.	1.389E-04	1.195E-04
ENE	1079.	1079.	6.486E-06	6.205E-06	1079.	7.141E-06	6.771E-06	1079.	2.121E-04	1.815E-04
E	1055.	1055.	6.770E-06	6.492E-06	1055.	7.917E-06	7.501E-06	1055.	2.368E-04	2.024E-04
ESE	1055.	1055.	8.481E-06	8.132E-06	1055.	9.879E-06	9.355E-06	1055.	2.276E-04	1.951E-04
SE	969.	969.	8.229E-06	7.903E-06	969.	1.039E-05	9.834E-06	969.	2.189E-04	1.879E-04
SSE	698.	698.	9.363E-06	9.021E-06	698.	1.250E-05	1.181E-05	698.	2.815E-04	2.409E-04
S	820.	820.	6.991E-06	6.718E-06	820.	8.532E-06	8.075E-06	820.	2.236E-04	1.923E-04
SSW	835.	835.	6.541E-06	6.276E-06	835.	8.500E-06	8.036E-06	835.	1.574E-04	1.354E-04
SW	628.	628.	1.059E-05	1.020E-05	628.	1.637E-05	1.535E-05	628.	3.668E-04	3.140E-04
WSW	533.	533.	1.121E-05	1.081E-05	533.	1.588E-05	1.490E-05	533.	4.005E-04	3.423E-04
W	524.	524.	1.096E-05	1.056E-05	524.	1.504E-05	1.427E-05	524.	5.039E-04	4.287E-04
WNW	643.	643.	7.648E-06	7.374E-06	643.	9.956E-06	9.510E-06	643.	4.055E-04	3.441E-04
NW	762.	762.	6.774E-06	6.526E-06	762.	8.435E-06	8.088E-06	762.	3.334E-04	2.831E-04
NNW	890.	890.	6.855E-06	6.594E-06	890.	7.588E-06	7.286E-06	890.	2.794E-04	2.377E-04

LASALLE SITE METEOROLOGICAL DATA 1/78 - 12/87

The restricted area boundary (RAB) was redefined in sectors E and ESE to 833 and 848 from 1055 and 1055 meters, respectively. As a result of this change of range, the dose factors were re-evaluated using the following equation. Here, F_R is the resulting dose factor at the new range (i.e. 833). F_{R_0} is the value provided in the above ODCM tables (i.e. S, SBAR, V, VBAR, G, GBAR). R_0 is the former RAB distance (i.e. 1055) and R is the RAB distance (i.e. 833).

$$F_R = F_{R_0} \left(\frac{R_0}{R} \right)^{1.5}$$

This analysis indicates that the change in range would increase the dose factor error by approximately 40%. Since this difference is well within the expected error of the current factors, no further adjustment in the above factors is considered necessary.

LaSalle
Table F-7a (Continued)

Revision 3
May 2001

Maximum Offsite Finite Plume Gamma Dose Factors Based on 1 cm Depth at the Restricted Area Boundary for Xe-133

Downwind Direction	Restricted Area Bound Radius (meters)	Elevated(Stack) Release		Mixed Mode(Vent) Release		Ground Level Release				
		Radius (meters)	S (mrad/yr)/(uCi/sec)	SBAR (mrad/yr)/(uCi/sec)	Radius (meters)	V (mrad/yr)/(uCi/sec)	VBAR (mrad/yr)/(uCi/sec)	Radius (meters)	G (mrad/yr)/(uCi/sec)	GBAR (mrad/yr)/(uCi/sec)
N	1036.	1036.	7.010E-06	6.757E-06	1036.	7.933E-06	7.649E-06	1036.	3.136E-04	2.785E-04
NNE	1378.	1378.	6.939E-06	6.629E-06	1378.	7.149E-06	6.860E-06	1378.	2.132E-04	1.903E-04
NE	1609.	1609.	5.088E-06	4.853E-06	1609.	5.323E-06	5.076E-06	1609.	1.562E-04	1.397E-04
ENE	1079.	1079.	5.306E-06	5.106E-06	1079.	6.045E-06	5.769E-06	1079.	2.362E-04	2.101E-04
E	1055.	1055.	5.535E-06	5.340E-06	1055.	6.764E-06	6.452E-06	1055.	2.632E-04	2.338E-04
ESE	1055.	1055.	7.016E-06	6.769E-06	1055.	8.566E-06	8.169E-06	1055.	2.543E-04	2.266E-04
SE	969.	969.	6.641E-06	6.416E-06	969.	8.978E-06	8.558E-06	969.	2.450E-04	2.185E-04
SSE	698.	698.	7.217E-06	6.994E-06	698.	1.073E-05	1.021E-05	698.	3.132E-04	2.785E-04
S	820.	820.	5.369E-06	5.188E-06	820.	7.024E-06	6.687E-06	820.	2.515E-04	2.246E-04
SSW	835.	835.	4.969E-06	4.793E-06	835.	6.598E-06	6.266E-06	835.	1.770E-04	1.582E-04
SW	628.	628.	7.798E-06	7.549E-06	628.	1.362E-05	1.285E-05	628.	4.090E-04	3.640E-04
WSW	533.	533.	8.245E-06	7.992E-06	533.	1.326E-05	1.252E-05	533.	4.447E-04	3.951E-04
W	524.	524.	8.166E-06	7.919E-06	524.	1.220E-05	1.164E-05	524.	5.551E-04	4.911E-04
WNW	643.	643.	5.715E-06	5.541E-06	643.	7.885E-06	7.574E-06	643.	4.444E-04	3.922E-04
NW	762.	762.	5.117E-06	4.958E-06	762.	6.538E-06	6.303E-06	762.	3.661E-04	3.233E-04
NNW	890.	890.	5.340E-06	5.165E-06	890.	5.911E-06	5.708E-06	890.	3.080E-04	2.725E-04

LASALLE SITE METEOROLOGICAL DATA 1/78 - 12/87

The restricted area boundary (RAB) was redefined in sectors E and ESE to 833 and 848 from 1055 and 1055 meters, respectively. As a result of this change of range, the dose factors were re-evaluated using the following equation. Here, F_R is the resulting dose factor at the new range (i.e. 833). F_{R_0} is the value provided in the above ODCM tables (i.e. S, SBAR, V, VBAR, G, GBAR). R_0 is the former RAB distance (i.e. 1055) and R is the RAB distance (i.e. 833).

$$F_R = F_{R_0} \left[\frac{R_0}{R} \right]^{exp 1.5}$$

This analysis indicates that the change in range would increase the dose factor error by approximately 40%. Since this difference is well within the expected error of the current factors, no further adjustment in the above factors is considered necessary.

LaSalle
Table F-7a (Continued)

Revision 3
May 2001

Maximum Offsite Finite Plume Gamma Dose Factors Based on 1 cm Depth at the Restricted Area Boundary for Xe-135m

Downwind Direction	Restricted Area Bound Radius (meters)	Elevated(Stack) Release		Mixed Mode(Vent) Release		Ground Level Release				
		Radius (meters)	S (mrad/yr)/(uCi/sec)	SBAR (mrad/yr)/(uCi/sec)	Radius (meters)	V (mrad/yr)/(uCi/sec)	VBAR (mrad/yr)/(uCi/sec)	Radius (meters)	G (mrad/yr)/(uCi/sec)	GBAR (mrad/yr)/(uCi/sec)
N	1036.	1036.	1.396E-04	1.349E-04	1036.	1.598E-04	1.545E-04	1036.	1.531E-03	1.475E-03
NNE	1378.	1378.	1.151E-04	1.113E-04	1378.	1.274E-04	1.232E-04	1378.	1.019E-03	9.821E-04
NE	1609.	1609.	8.046E-05	7.779E-05	1609.	8.260E-05	7.985E-05	1609.	7.033E-04	6.778E-04
ENE	1079.	1079.	1.024E-04	9.898E-05	1079.	1.064E-04	1.028E-04	1079.	1.147E-03	1.105E-03
E	1055.	1055.	1.121E-04	1.084E-04	1055.	1.183E-04	1.144E-04	1055.	1.253E-03	1.207E-03
ESE	1055.	1055.	1.411E-04	1.365E-04	1055.	1.490E-04	1.441E-04	1055.	1.256E-03	1.211E-03
SE	969.	969.	1.389E-04	1.343E-04	969.	1.575E-04	1.522E-04	969.	1.262E-03	1.216E-03
SSE	698.	698.	1.692E-04	1.636E-04	698.	1.955E-04	1.890E-04	698.	1.667E-03	1.606E-03
S	820.	820.	1.196E-04	1.157E-04	820.	1.251E-04	1.209E-04	820.	1.363E-03	1.314E-03
SSW	835.	835.	1.104E-04	1.068E-04	835.	1.260E-04	1.218E-04	835.	8.762E-04	8.444E-04
SW	628.	628.	1.904E-04	1.841E-04	628.	2.444E-04	2.363E-04	628.	2.173E-03	2.094E-03
WSW	533.	533.	2.063E-04	1.995E-04	533.	2.427E-04	2.345E-04	533.	2.479E-03	2.388E-03
W	524.	524.	2.033E-04	1.966E-04	524.	2.511E-04	2.427E-04	524.	3.050E-03	2.937E-03
WNW	643.	643.	1.363E-04	1.318E-04	643.	1.687E-04	1.631E-04	643.	2.286E-03	2.201E-03
NW	762.	762.	1.187E-04	1.148E-04	762.	1.423E-04	1.376E-04	762.	1.806E-03	1.739E-03
NNW	890.	890.	1.161E-04	1.122E-04	890.	1.259E-04	1.217E-04	890.	1.482E-03	1.427E-03

LASALLE SITE METEOROLOGICAL DATA 1/78 - 12/87

The restricted area boundary (RAB) was redefined in sectors E and ESE to 833 and 848 from 1055 and 1055 meters, respectively. As a result of this change of range, the dose factors were re-evaluated using the following equation. Here, F_R is the resulting dose factor at the new range (i.e. 833). F_{R_0} is the value provided in the above ODCM tables (i.e. S, SBAR, V, VBAR, G, GBAR). R_0 is the former RAB distance (i.e. 1055) and R is the RAB distance (i.e. 833).

$$F_R = F_{R_0} \left[\frac{R_0}{R} \right]^{1.5}$$

This analysis indicates that the change in range would increase the dose factor error by approximately 40%. Since this difference is well within the expected error of the current factors, no further adjustment in the above factors is considered necessary.

LaSalle

Revision 3
May 2001

Table F-7a (Continued)

Maximum Offsite Finite Plume Gamma Dose Factors Based on 1 cm Depth at the Restricted Area Boundary for Xe-135

Downwind Direction	Restricted Area Bound Radius (meters)	Elevated(Stack) Release		Mixed Mode(Vent) Release		Ground Level Release				
		Radius (meters)	S (mrad/yr)/(uCi/sec)	SBAR (mrad/yr)/(uCi/sec)	Radius (meters)	V (mrad/yr)/(uCi/sec)	VBAR (mrad/yr)/(uCi/sec)	Radius (meters)	G (mrad/yr)/(uCi/sec)	GBAR (mrad/yr)/(uCi/sec)
N	1036.	1036.	8.165E-05	7.902E-05	1036.	9.387E-05	9.085E-05	1036.	1.302E-03	1.257E-03
NNE	1378.	1378.	7.171E-05	6.940E-05	1378.	7.821E-05	7.569E-05	1378.	9.178E-04	8.866E-04
NE	1609.	1609.	5.140E-05	4.974E-05	1609.	5.463E-05	5.286E-05	1609.	6.801E-04	6.570E-04
ENE	1079.	1079.	6.139E-05	5.942E-05	1079.	6.476E-05	6.267E-05	1079.	9.912E-04	9.573E-04
E	1055.	1055.	6.493E-05	6.284E-05	1055.	7.155E-05	6.924E-05	1055.	1.097E-03	1.060E-03
ESE	1055.	1055.	8.130E-05	7.869E-05	1055.	8.905E-05	8.617E-05	1055.	1.083E-03	1.046E-03
SE	969.	969.	7.953E-05	7.697E-05	969.	9.346E-05	9.044E-05	969.	1.052E-03	1.017E-03
SSE	698.	698.	9.205E-05	8.910E-05	698.	1.117E-04	1.081E-04	698.	1.321E-03	1.276E-03
S	820.	820.	6.782E-05	6.564E-05	820.	7.666E-05	7.419E-05	820.	1.093E-03	1.056E-03
SSW	835.	835.	6.306E-05	6.103E-05	835.	7.636E-05	7.389E-05	835.	7.699E-04	7.438E-04
SW	628.	628.	1.039E-04	1.006E-04	628.	1.409E-04	1.363E-04	628.	1.729E-03	1.670E-03
WSW	533.	533.	1.106E-04	1.071E-04	533.	1.372E-04	1.328E-04	533.	1.864E-03	1.801E-03
W	524.	524.	1.082E-04	1.048E-04	524.	1.374E-04	1.329E-04	524.	2.256E-03	2.179E-03
WNW	643.	643.	7.538E-05	7.296E-05	643.	9.395E-05	9.092E-05	643.	1.775E-03	1.713E-03
NW	762.	762.	6.654E-05	6.440E-05	762.	8.098E-05	7.838E-05	762.	1.466E-03	1.415E-03
NNW	890.	890.	6.671E-05	6.456E-05	890.	7.327E-05	7.092E-05	890.	1.247E-03	1.204E-03

LASALLE SITE METEOROLOGICAL DATA 1/78 - 12/87

The restricted area boundary (RAB) was redefined in sectors E and ESE to 833 and 848 from 1055 and 1055 meters, respectively. As a result of this change of range, the dose factors were re-evaluated using the following equation. Here, F_R is the resulting dose factor at the new range (i.e. 833). F_{R_0} is the value provided in the above ODCM tables (i.e. S, SBAR, V, VBAR, G, GBAR). R_0 is the former RAB distance (i.e. 1055) and R is the RAB distance (i.e. 833).

$$F_R = F_{R_0} \left[\frac{R_0}{R} \right] \exp 1.5$$

This analysis indicates that the change in range would increase the dose factor error by approximately 40%. Since this difference is well within the expected error of the current factors, no further adjustment in the above factors is considered necessary.

LaSalle

Table F-7a (Continued)

Maximum Offsite Finite Plume Gamma Dose Factors Based on 1 cm Depth at the Restricted Area Boundary for Xe-137

Downwind Direction	Restricted Area Bound (meters)	Elevated(Stack) Release		Mixed Mode(Vent) Release			Ground Level Release			
		Radius (meters)	S (mrad/yr)/(uCi/sec)	SBAR (mrad/yr)/(uCi/sec)	Radius (meters)	V (mrad/yr)/(uCi/sec)	VBAR (mrad/yr)/(uCi/sec)	Radius (meters)	G (mrad/yr)/(uCi/sec)	GBAR (mrad/yr)/(uCi/sec)
N	1036.	1036.	4.780E-05	4.627E-05	1036.	5.242E-05	5.074E-05	1036.	3.409E-04	3.298E-04
NNE	1378.	1378.	3.585E-05	3.471E-05	1378.	3.814E-05	3.692E-05	1378.	1.975E-04	1.911E-04
NE	1609.	1609.	2.282E-05	2.209E-05	1609.	2.185E-05	2.115E-05	1609.	1.166E-04	1.128E-04
ENE	1079.	1079.	3.342E-05	3.236E-05	1079.	3.282E-05	3.177E-05	1079.	2.437E-04	2.358E-04
E	1055.	1055.	3.741E-05	3.622E-05	1055.	3.716E-05	3.597E-05	1055.	2.625E-04	2.540E-04
ESE	1055.	1055.	4.827E-05	4.673E-05	1055.	4.871E-05	4.715E-05	1055.	2.765E-04	2.676E-04
SE	969.	969.	4.743E-05	4.591E-05	969.	5.188E-05	5.023E-05	969.	2.989E-04	2.892E-04
SSE	698.	698.	6.273E-05	6.073E-05	698.	6.983E-05	6.760E-05	698.	4.329E-04	4.189E-04
S	820.	820.	4.133E-05	4.002E-05	820.	4.042E-05	3.913E-05	820.	3.373E-04	3.264E-04
SSW	835.	835.	3.521E-05	3.408E-05	835.	3.424E-05	3.315E-05	835.	1.748E-04	1.691E-04
SW	628.	628.	6.779E-05	6.563E-05	628.	7.938E-05	7.685E-05	628.	5.333E-04	5.161E-04
WSW	533.	533.	7.919E-05	7.667E-05	533.	8.829E-05	8.548E-05	533.	7.164E-04	6.932E-04
W	524.	524.	7.990E-05	7.736E-05	524.	9.608E-05	9.302E-05	524.	9.223E-04	8.924E-04
WNW	643.	643.	5.023E-05	4.863E-05	643.	6.090E-05	5.896E-05	643.	6.002E-04	5.808E-04
NW	762.	762.	4.160E-05	4.028E-05	762.	4.841E-05	4.687E-05	762.	4.228E-04	4.090E-04
NNW	890.	890.	3.985E-05	3.858E-05	890.	4.152E-05	4.020E-05	890.	3.279E-04	3.172E-04

LASALLE SITE METEOROLOGICAL DATA 1/78 - 12/87

The restricted area boundary (RAB) was redefined in sectors E and ESE to 833 and 848 from 1055 and 1055 meters, respectively. As a result of this change of range, the dose factors were re-evaluated using the following equation. Here, F_R is the resulting dose factor at the new range (i.e. 833). F_{R_0} is the value provided in the above ODCM tables (i.e. S, SBAR, V, VBAR, G, GBAR). R_0 is the former RAB distance (i.e. 1055) and R is the RAB distance (i.e. 833).

$$F_R = F_{R_0} \left[\frac{R_0}{R} \right]^{1.5}$$

This analysis indicates that the change in range would increase the dose factor error by approximately 40%. Since this difference is well within the expected error of the current factors, no further adjustment in the above factors is considered necessary.

LaSalle
Table F-7a (Continued)

Revision 3
May 2001

Maximum Offsite Finite Plume Gamma Dose Factors Based on 1 cm Depth at the Restricted Area Boundary for Xe-138

Downwind Direction	Restricted Area Bound (meters)	Elevated(Stack) Release		Mixed Mode(Vent) Release		Ground Level Release				
		Radius (meters)	S (mrad/yr)/(uCi/sec)	SBAR (mrad/yr)/(uCi/sec)	Radius (meters)	V (mrad/yr)/(uCi/sec)	VBAR (mrad/yr)/(uCi/sec)	Radius (meters)	G (mrad/yr)/(uCi/sec)	GBAR (mrad/yr)/(uCi/sec)
N	1036.	1036.	3.926E-04	3.816E-04	1036.	4.523E-04	4.396E-04	1036.	3.178E-03	3.084E-03
NNE	1378.	1378.	3.160E-04	3.071E-04	1378.	3.536E-04	3.437E-04	1378.	2.117E-03	2.055E-03
NE	1609.	1609.	2.198E-04	2.136E-04	1609.	2.272E-04	2.208E-04	1609.	1.457E-03	1.414E-03
ENE	1079.	1079.	2.887E-04	2.806E-04	1079.	2.996E-04	2.912E-04	1079.	2.383E-03	2.313E-03
E	1055.	1055.	3.167E-04	3.079E-04	1055.	3.323E-04	3.230E-04	1055.	2.600E-03	2.524E-03
ESE	1055.	1055.	3.961E-04	3.850E-04	1055.	4.149E-04	4.032E-04	1055.	2.618E-03	2.541E-03
SE	969.	969.	3.938E-04	3.828E-04	969.	4.408E-04	4.285E-04	969.	2.641E-03	2.564E-03
SSE	698.	698.	4.911E-04	4.773E-04	698.	5.540E-04	5.384E-04	698.	3.494E-03	3.391E-03
S	820.	820.	3.498E-04	3.400E-04	820.	3.606E-04	3.505E-04	820.	2.857E-03	2.773E-03
SSW	835.	835.	3.277E-04	3.186E-04	835.	3.832E-04	3.724E-04	835.	1.828E-03	1.774E-03
SW	628.	628.	5.698E-04	5.538E-04	628.	7.209E-04	7.007E-04	628.	4.546E-03	4.412E-03
WSW	533.	533.	6.144E-04	5.973E-04	533.	7.121E-04	6.921E-04	533.	5.206E-03	5.053E-03
W	524.	524.	5.976E-04	5.809E-04	524.	7.318E-04	7.113E-04	524.	6.383E-03	6.195E-03
WNW	643.	643.	3.986E-04	3.875E-04	643.	4.887E-04	4.750E-04	643.	4.757E-03	4.616E-03
NW	762.	762.	3.457E-04	3.360E-04	762.	4.131E-04	4.016E-04	762.	3.746E-03	3.635E-03
NNW	890.	890.	3.330E-04	3.236E-04	890.	3.626E-04	3.525E-04	890.	3.069E-03	2.978E-03

LASALLE SITE METEOROLOGICAL DATA 1/78 - 12/87

The restricted area boundary (RAB) was redefined in sectors E and ESE to 833 and 848 from 1055 and 1055 meters, respectively. As a result of this change of range, the dose factors were re-evaluated using the following equation. Here, F_R is the resulting dose factor at the new range (i.e. 833). F_{R_0} is the value provided in the above ODCM tables (i.e. S, SBAR, V, VBAR, G, GBAR). R_0 is the former RAB distance (i.e. 1055) and R is the RAB distance (i.e. 833).

$$F_R = F_{R_0} \left[\frac{R_0}{R} \right]^{1.5}$$

This analysis indicates that the change in range would increase the dose factor error by approximately 40%. Since this difference is well within the expected error of the current factors, no further adjustment in the above factors is considered necessary.

LaSalle
Table F-7a (Continued)

Revision 3
May 2001

Maximum Offsite Finite Plume Gamma Dose Factors Based on 1 cm Depth at the Restricted Area Boundary for Ar-41

Downwind Direction	Restricted Area Bound (meters)	Elevated(Stack) Release		Mixed Mode(Vent) Release		Ground Level Release				
		Radius (meters)	S (mrad/yr)/(uCi/sec)	SBAR (mrad/yr)/(uCi/sec)	Radius (meters)	V (mrad/yr)/(uCi/sec)	VBAR (mrad/yr)/(uCi/sec)	Radius (meters)	G (mrad/yr)/(uCi/sec)	GBAR (mrad/yr)/(uCi/sec)
N	1036.	1036.	4.746E-04	4.594E-04	1036.	5.528E-04	5.351E-04	1036.	4.557E-03	4.411E-03
NNE	1378.	1378.	3.954E-04	3.828E-04	1378.	4.439E-04	4.297E-04	1378.	3.203E-03	3.101E-03
NE	1609.	1609.	2.825E-04	2.734E-04	1609.	3.029E-04	2.932E-04	1609.	2.358E-03	2.283E-03
ENE	1079.	1079.	3.582E-04	3.468E-04	1079.	3.729E-04	3.610E-04	1079.	3.472E-03	3.361E-03
E	1055.	1055.	3.818E-04	3.696E-04	1055.	4.100E-04	3.969E-04	1055.	3.841E-03	3.718E-03
ESE	1055.	1055.	4.725E-04	4.574E-04	1055.	5.025E-04	4.864E-04	1055.	3.807E-03	3.685E-03
SE	969.	969.	4.711E-04	4.560E-04	969.	5.320E-04	5.149E-04	969.	3.715E-03	3.597E-03
SSE	698.	698.	5.672E-04	5.490E-04	698.	6.491E-04	6.284E-04	698.	4.695E-03	4.545E-03
S	820.	820.	4.212E-04	4.077E-04	820.	4.585E-04	4.438E-04	820.	3.879E-03	3.755E-03
SSW	835.	835.	3.994E-04	3.866E-04	835.	4.930E-04	4.772E-04	835.	2.700E-03	2.614E-03
SW	628.	628.	6.711E-04	6.496E-04	628.	8.591E-04	8.316E-04	628.	6.139E-03	5.943E-03
WSW	533.	533.	7.089E-04	6.862E-04	533.	8.229E-04	7.966E-04	533.	6.667E-03	6.453E-03
W	524.	524.	6.802E-04	6.584E-04	524.	8.291E-04	8.026E-04	524.	8.057E-03	7.799E-03
WNW	643.	643.	4.708E-04	4.558E-04	643.	5.716E-04	5.533E-04	643.	6.300E-03	6.099E-03
NW	762.	762.	4.123E-04	3.991E-04	762.	4.970E-04	4.811E-04	762.	5.173E-03	5.008E-03
NNW	890.	890.	4.025E-04	3.896E-04	890.	4.447E-04	4.305E-04	890.	4.374E-03	4.234E-03

LASALLE SITE METEOROLOGICAL DATA 1/78 - 12/87

The restricted area boundary (RAB) was redefined in sectors E and ESE to 833 and 848 from 1055 and 1055 meters, respectively. As a result of this change of range, the dose factors were re-evaluated using the following equation. Here, F_R is the resulting dose factor at the new range (i.e. 833). F_{R_0} is the value provided in the above ODCM tables (i.e. S, SBAR, V, VBAR, G, GBAR). R_0 is the former RAB distance (i.e. 1055) and R is the RAB distance (i.e. 833).

$$F_R = F_{R_0} \left[\frac{R_0}{R} \right]^{1.5}$$

This analysis indicates that the change in range would increase the dose factor error by approximately 40%. Since this difference is well within the expected error of the current factors, no further adjustment in the above factors is considered necessary.

Table F-8
Parameters for Calculations of N-16 Skyshine Radiation
From LaSalle

Location Number k	Activity	Occupancy Hours OH _k ^a	Occupancy Factor ^c OF _k	Shielding Factor SF _k	Distance R _k (m)
1	Living at home (nearest resident)	8360	0.95	0.7	1100 ^b
2	Fishing	400	0.05	1.0	2100
3	Living at the National Guard Facility	2500		0.7	2400

$$M_n = 5$$

$$K = 2.28E-05 \text{ mrem/(MWe-hr)}$$

These parameters are used to obtain an initial estimate of skyshine dose to the maximally exposed member of the public using Equation A-34 in Appendix A. If desired, more realistic parameters could be used in place of these to refine the estimate. For example, one could determine whether the nearest resident really fishes the specified number of hours at the specified location.

- a The amount of time in a year that a maximally exposed fisherman would spend fishing near the site is estimated as 12 hours per week for 8 months per year. This yields an estimate of:

$$[12 \text{ hours/week}] [(8 \text{ months/yr}) / (12 \text{ months/yr})] \times [52 \text{ weeks/yr}] = 416 \text{ hours/yr}$$

The remaining time is assumed to be spent at the nearest residence.

- b Distance to nearest residence (See Table F-3).
- c The OF_k is the quotient of the number of hours a location is occupied and the number of hours in a year. Thus OH_k/8760 hours = OF_k rounded to the 0.01 digit.

In determining the maximally exposed individual, the following possibilities were considered: the nearest resident, fishermen, and persons at the National Guard facility north of the site. The annual exposure time and location of a maximally exposed fisherman were estimated on the basis of discussion with a member of the station staff. The nearest resident was found to have the greatest exposure to skyshine. For details, see Reference 2 of Section F.2.

Supplemental Table A

Elevated Level Joint Frequency Distribution Table Summary

375 Foot Elevation Data

Summary Table of Percent by Direction and Class

Class	N	NNE	NE	ENE	E	ESE	SE	SSE	S	SSW	SW	WSW	W	WNW	NW	NNW	Total
A	.024	.032	.067	.057	.062	.040	.030	.060	.056	.189	.087	.051	.056	.064	.063	.024	.943
B	.149	.175	.227	.149	.080	.047	.056	.070	.233	.463	.330	.189	.145	.192	.153	.183	2.843
C	.300	.262	.351	.255	.138	.069	.104	.130	.375	.579	.454	.361	.344	.420	.329	.332	4.805
D	3.100	2.634	3.282	3.192	2.780	1.945	1.767	2.053	2.810	2.875	2.270	2.460	3.248	4.533	3.922	3.681	46.551
E	1.018	.913	1.162	1.431	1.823	1.495	1.460	1.752	2.867	2.978	2.124	1.531	1.575	2.085	1.670	1.196	27.061
F	.320	.182	.248	.280	.469	.707	.905	.995	1.459	1.735	1.561	1.041	1.012	1.099	.894	.553	13.438
G	.055	.039	.022	.012	.041	.081	.278	.507	.674	.658	.660	.460	.309	.242	.217	.103	4.358
Total	4.965	4.237	5.359	5.356	5.394	4.385	4.601	5.567	8.474	9.457	7.487	6.093	6.688	8.615	7.248	6.073	100.000

Summary Table of Percent by Direction and Speed

Speed	N	NNE	NE	ENE	E	ESE	SE	SSE	S	SSW	SW	WSW	W	WNW	NW	NNW	Total
.45	.018	.017	.015	.010	.006	.010	.013	.008	.018	.010	.000	.013	.000	.000	.001	.000	.137
1.05	.018	.033	.030	.027	.021	.023	.032	.027	.027	.017	.017	.028	.021	.024	.034	.027	.402
2.05	.162	.260	.276	.215	.147	.149	.159	.171	.165	.168	.155	.135	.147	.115	.136	.160	2.721
3.05	.381	.479	.551	.477	.369	.287	.311	.276	.323	.317	.272	.302	.321	.317	.302	.311	5.599
4.05	.508	.647	.785	.547	.494	.428	.437	.404	.453	.455	.428	.400	.387	.482	.487	.455	7.798
5.05	.489	.598	.792	.515	.451	.403	.420	.505	.477	.489	.492	.472	.493	.540	.542	.533	8.213
6.05	.577	.599	.861	.596	.506	.419	.479	.483	.556	.584	.523	.487	.558	.598	.668	.656	9.150
8.05	1.297	.918	1.353	1.289	1.207	.972	.869	1.062	1.415	1.500	1.371	1.164	1.207	1.822	1.669	1.623	20.637
10.05	.912	.421	.487	.845	.998	.751	.738	.947	1.385	1.552	1.325	1.088	1.240	1.671	1.557	1.270	17.188
13.05	.482	.210	.183	.594	.858	.692	.749	1.187	2.107	2.440	1.822	1.338	1.432	1.962	1.428	.800	18.286
18.00	.120	.055	.026	.231	.326	.240	.283	.459	1.476	1.815	1.043	.581	.746	1.137	.404	.222	9.163
99.00	.002	.000	.000	.011	.011	.011	.013	.035	.072	.109	.038	.088	.137	.147	.019	.015	.708
Total	4.965	4.237	5.359	5.356	5.394	4.385	4.601	5.567	8.474	9.457	7.487	6.093	6.688	8.615	7.248	6.073	100.000

NOTE: Wind directions in tables are presented in "wind from" and not "wind to" direction.

Supplemental Table A -Continued

Elevated Level Joint Frequency Distribution Table Summary

375 Foot Elevation Data

Summary Table of Percent by Speed and Class

Class Speed	A	B	C	D	E	F	G
.45	.000	.000	.000	.052	.058	.023	.004
1.05	.001	.004	.004	.176	.153	.080	.005
2.05	.017	.041	.109	1.540	.656	.307	.050
3.05	.046	.159	.290	3.269	1.193	.547	.096
4.05	.102	.249	.499	4.364	1.629	.788	.166
5.05	.102	.335	.547	4.159	1.945	.916	.210
6.05	.108	.341	.565	4.663	2.320	.986	.268
8.05	.225	.701	1.118	10.191	5.190	2.480	.788
10.05	.141	.429	.785	7.441	4.924	2.891	.878
13.05	.134	.404	.598	6.977	5.670	3.208	1.296
18.00	.068	.163	.256	3.424	3.128	1.511	.815
99.00	.001	.017	.038	.398	.198	.043	.015

Supplemental Table B

Revision 3
May 2001

Mid Elevation Joint Frequency Distribution Table Summaries

Summary Table of Percent by Direction and Class							200 Foot Elevation Data										Total
Class	N	NNE	NE	ENE	E	ESE	SE	SSE	S	SSW	SW	WSW	W	WNW	NW	NNW	Total
A	.381	.248	.801	.790	.631	.256	.142	.119	.231	.357	.441	.370	.453	.653	.579	.678	7.030
B	.313	.249	.377	.343	.290	.175	.110	.104	.207	.288	.327	.292	.350	.496	.530	.612	5.082
C	.531	.420	.566	.434	.390	.299	.321	.282	.370	.498	.478	.470	.506	.573	.710	.785	7.634
D	2.274	2.315	2.517	2.248	2.669	1.715	1.677	1.775	2.781	3.045	2.098	1.839	2.140	3.069	2.841	2.408	37.410
E	.777	.734	1.088	1.105	1.488	1.323	1.243	1.438	2.678	2.910	1.697	1.176	1.228	1.712	1.429	1.015	23.034
F	.233	.155	.177	.205	.433	.809	.802	.801	1.210	1.383	1.183	.862	.854	1.017	.848	.448	11.419
G	.085	.060	.021	.013	.059	.265	.635	.896	1.244	1.239	.997	.689	.740	.716	.562	.150	8.411
Total	4.575	4.182	5.547	5.138	5.857	4.841	4.930	5.413	8.722	9.721	7.219	5.698	6.288	8.297	7.498	6.094	100.000

Summary Table of Percent by Direction and Speed																	Total
Speed	N	NNE	NE	ENE	E	ESE	SE	SSE	S	SSW	SW	WSW	W	WNW	NW	NNW	Total
.45	.043	.003	.000	.020	.015	.003	.005	.008	.005	.000	.008	.000	.000	.000	.000	.000	.113
1.05	.046	.072	.063	.042	.033	.025	.040	.034	.037	.021	.026	.038	.031	.026	.034	.046	.612
2.05	.219	.575	.500	.323	.233	.197	.202	.201	.232	.193	.201	.189	.183	.151	.153	.163	3.915
3.05	.442	1.132	1.140	.891	.497	.350	.399	.363	.366	.344	.339	.353	.413	.374	.366	.374	7.946
4.05	.538	.970	1.375	.729	.617	.528	.548	.532	.599	.583	.557	.466	.481	.553	.630	.618	10.319
5.05	.881	.584	1.041	.800	.639	.553	.635	.558	.621	.610	.579	.560	.590	.688	.737	.720	10.593
6.05	.729	.383	.670	.802	.777	.728	.708	.681	.843	.887	.698	.687	.695	.815	.940	.916	11.959
8.05	1.088	.339	.576	1.004	1.557	1.351	1.333	1.426	2.234	2.473	1.925	1.484	1.604	1.933	1.903	1.559	23.790
10.05	.472	.106	.153	.475	.801	.691	.690	1.015	2.122	2.439	1.707	1.108	1.108	1.586	1.315	.910	16.693
13.05	.202	.016	.029	.214	.509	.348	.298	.476	1.342	1.778	1.012	.626	.790	1.414	1.096	.580	10.728
18.00	.111	.001	.001	.034	.177	.067	.076	.113	.310	.383	.154	.159	.300	.683	.312	.203	3.088
99.00	.007	.000	.000	.004	.001	.000	.000	.005	.010	.009	.014	.030	.074	.074	.013	.004	.247
Total	4.575	4.182	5.547	5.138	5.857	4.841	4.930	5.413	8.722	9.721	7.219	5.698	6.288	8.297	7.498	6.094	100.000

NOTE: Wind directions in tables are presented in "wind from" and not "wind to" direction.

Supplemental Table B - Continued

Revision 3
May 2001

Mid Elevation Joint Frequency Distribution Table Summaries

200 Foot Elevation Data

Summary Table of Percent by Speed and Class

Class Speed	A	B	C	D	E	F	G
.45	.000	.000	.001	.046	.037	.021	.009
1.05	.013	.004	.022	.219	.175	.116	.063
2.05	.172	.130	.291	1.946	.732	.437	.207
3.05	.600	.463	.809	3.633	1.631	.642	.378
4.05	.776	.588	.970	4.134	2.329	.930	.591
5.05	.828	.588	.966	3.918	2.455	1.150	.690
6.05	.835	.533	.921	4.389	2.742	1.461	1.079
8.05	1.542	1.208	1.671	8.019	5.377	3.357	2.616
10.05	1.030	.780	.979	5.271	4.164	2.319	2.160
13.05	.874	.558	.764	4.158	2.654	.935	.697
16.00	.331	.207	1.231	1.621	.830	.048	.020
20.00	.029	.012	1.018	.182	.020	.005	.001

Supplemental Table C

Revision 3
May 2001

Ground Level Joint Frequency Distribution Table Summary

33 Foot Elevation Data

Summary Table of Percent by Direction and Class

Class	N	NNE	NE	ENE	E	ESE	SE	SSE	S	SSW	SW	WSW	W	WNW	NW	NNW	Total
A	.411	.318	.688	.887	.594	.308	.133	.135	.212	.407	.478	.447	.532	.665	.844	.904	7.962
B	.314	.150	.278	.310	.276	.177	.108	.071	.172	.239	.268	.222	.293	.405	.505	.501	4.288
C	.380	.233	.330	.328	.262	.270	.189	.172	.285	.385	.424	.343	.380	.507	.638	.501	5.628
D	3.149	1.449	2.178	2.504	2.687	1.735	1.577	1.540	2.195	2.673	2.178	1.925	2.243	3.240	3.269	2.509	37.051
E	1.131	.661	1.168	1.021	1.758	1.434	1.303	1.561	2.656	2.795	1.968	1.480	1.557	1.945	1.692	.917	24.947
F	.166	.087	.177	.160	.646	.840	.750	.817	1.259	1.280	1.376	1.039	1.048	.867	.609	.378	11.499
G	.019	.008	.017	.025	.127	.615	.873	1.023	1.183	1.050	.998	.966	.925	.490	.214	.093	8.627
Total	5.570	2.906	4.836	5.235	6.349	5.379	4.932	5.319	7.862	8.829	7.690	6.422	6.979	8.118	7.771	5.803	100.000

Summary Table of Percent by Direction and Speed

Speed	N	NNE	NE	ENE	E	ESE	SE	SSE	S	SSW	SW	WSW	W	WNW	NW	NNW	Total
.45	.000	.004	.000	.002	.002	.000	.000	.002	.008	.002	.002	.004	.002	.000	.002	.002	.029
1.05	.052	.048	.073	.048	.058	.056	.052	.073	.081	.075	.079	.067	.102	.093	.068	.068	1.085
2.05	.378	.609	.813	.517	.424	.601	.686	.582	.532	.441	.457	.466	.613	.626	.497	.488	6.731
3.05	1.124	1.183	1.802	1.268	1.191	1.270	1.278	1.222	1.149	1.158	1.112	1.031	1.095	1.079	.931	1.043	18.932
4.05	1.326	.621	1.122	1.230	1.420	1.116	1.058	1.079	1.731	1.719	1.648	1.550	1.274	1.023	1.000	.896	19.813
5.05	1.129	.241	.617	1.106	1.189	.694	.642	.738	1.276	1.509	1.305	1.129	1.029	1.104	1.014	.777	15.505
6.05	.667	.091	.297	.697	.879	.551	.509	.586	1.047	1.434	1.112	.808	.894	.914	.966	.813	12.163
8.05	.628	.102	.106	.422	.817	.767	.480	.642	1.282	1.638	1.291	.827	1.072	1.478	1.644	1.014	14.189
10.05	.145	.002	.008	.042	.303	.227	.172	.289	.561	.588	.532	.358	.480	.942	.933	.457	6.038
13.05	.114	.000	.000	.002	.067	.093	.056	.084	.202	.258	.119	.121	.254	.834	.583	.220	2.797
18.00	.008	.000	.000	.002	.000	.004	.002	.012	.018	.012	.031	.046	.145	.212	.154	.029	.671
99.00	.000	.000	.000	.000	.000	.000	.000	.000	.000	.000	.002	.013	.019	.012	.002	.000	.046
Total	5.570	2.906	4.836	5.235	6.349	5.379	4.932	5.319	7.862	8.829	7.690	6.422	6.979	8.118	7.771	5.803	100.000

NOTE: Wind directions in tables are presented in "wind from" and not "wind to" direction.

Supplemental Table C - Continued

Revision 3
May 2001

Ground Level Joint Frequency Distribution Table Summary

33 Foot Elevation Data

Summary Table of Percent by Speed and Class

Class Speed	A	B	C	D	E	F	G
.45	.000	.000	.004	.002	.008	.010	.008
1.05	.021	.008	.012	.197	.355	.299	.195
2.05	.326	.202	.272	2.282	2.334	1.764	1.552
3.05	.998	.578	.798	5.133	5.350	3.267	2.808
4.05	1.247	.686	.882	6.435	4.793	3.064	2.725
5.05	1.203	.646	.852	6.115	3.880	1.773	1.037
6.05	1.201	.570	.804	5.472	3.049	.817	.251
8.05	1.629	.900	1.208	6.605	3.334	.463	.050
10.05	.775	.422	.518	2.855	1.334	.031	.002
13.05	.428	.212	.245	1.469	.438	.004	.002
18.00	.112	.052	.052	.382	.089	.004	.000
99.00	.023	.012	.000	.008	.004	.004	.000

Illinois River

Liquid
Effluent Discharge
Point

OFFSITE DOSE CALCULATION MANUAL
LASALLE COUNTY STATION
FIGURE F-1
UNRESTRICTED AREA BOUNDARY



Scale in Feet

UNRESTRICTED AREA BOUNDARY
(Property Line)


Waste
Stabilization
Pond

Exclusion
Area

LaSalle Lake

Gaseous Effluent Release Point

Meteorological Tower

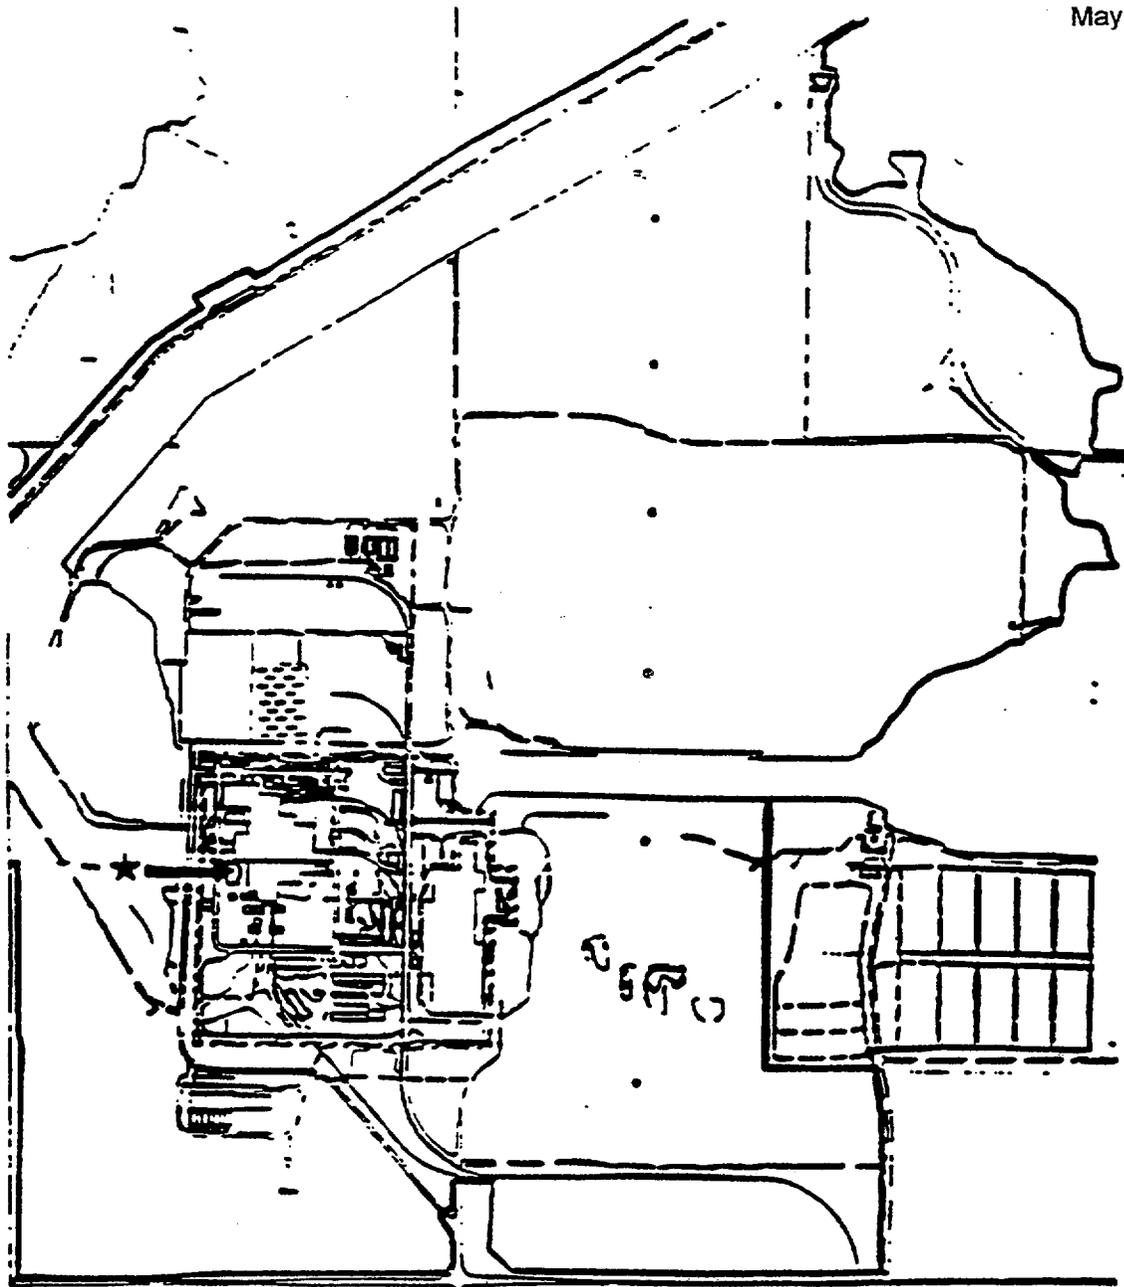


★ Interim Radwaste Storage Facility

— Restricted Area Boundary

▨ Radwaste Storage Area (When Operational, this area may include 48-packs, DAW, and other types of storage)



1000 0 1000 2000 FEET



GRAPHIC SCALE

OFFSITE DOSE CALCULATION MANUAL
LA SALLE COUNTY STATION

FIGURE F-2
RESTRICTED AREA BOUNDARY