

**Constellation
Nuclear**

**Calvert Cliffs
Nuclear Power Plant**

*A Member of the
Constellation Energy Group*

May 10, 2002

U. S. Nuclear Regulatory Commission
Washington, DC 20555

ATTENTION: Document Control Desk

SUBJECT: Calvert Cliffs Nuclear Power Plant, Unit Nos. 1 & 2; Docket Nos. 50-317 & 50-318
Calvert Cliffs Independent Spent Fuel Storage Installation, Docket No. 72-8
Radiological Environmental Monitoring Program Annual Report

REFERENCES: (a) Calvert Cliffs Nuclear Power Plant Technical Specification 5.6.2
(b) Calvert Cliffs Independent Spent Fuel Storage Installation Technical Specification 6.2

In accordance with References (a) and (b), Calvert Cliffs Nuclear Power Plant is submitting the Annual Radiological Environmental Monitoring Report, dated March 2002.

Should you have questions regarding this matter, we will be pleased to discuss them with you.

Very truly yours,

M. E. Tonacci
General Supervisor - Chemistry


MET/MJY/bjd

Attachment: As Stated

cc: R. S. Fleishman, Esquire
J. E. Silberg, Esquire
Director, Project Directorate I-1, NRC
D. M. Skay, NRC

H. J. Miller, NRC
Resident Inspector, NRC
R. I. McLean, DNR
P. Perzynski, MDE

IE25




**Constellation
Energy Group**

**RADIOLOGICAL ENVIRONMENTAL
MONITORING PROGRAM**

Annual Report

MARCH 2002



**Calvert Cliffs Nuclear Power Plant Units 1 and 2
and the Independent Spent Fuel Storage Installation**

January 1 to December 31, 2001

**RADIOLOGICAL ENVIRONMENTAL
MONITORING PROGRAM
FOR THE
CALVERT CLIFFS NUCLEAR POWER PLANT
UNITS 1 AND 2
AND THE
INDEPENDENT SPENT FUEL STORAGE INSTALLATION**

January 1 - December 31, 2001

L. J. BARTAL, Ph.D.
R. CONATSER
A. J. KAUPA

CONSTELLATION ENERGY GROUP

MARCH 2002

(LEFT BLANK)

TABLE OF CONTENTS

LIST OF FIGURES	iii
LIST OF TABLES	v
<u>I. SUMMARY</u>	1
<u>II. CALVERT CLIFFS NUCLEAR POWER PLANT</u>	3
<u>II.A. INTRODUCTION</u>	3
<u>II.B. PROGRAM</u>	4
II.B.1 <u>Objectives</u>	4
II.B.2 <u>Sample Collection</u>	4
II.B.3 <u>Data Interpretation</u>	4
II.B.4 <u>Program Exceptions</u>	4
<u>II.C. RESULTS AND DISCUSSIONS</u>	4
II.C.1 <u>Aquatic Environment</u>	5
II.C.1.a <u>Bay Water</u>	5
II.C.1.b <u>Aquatic Organisms</u>	5
II.C.1.c <u>Shoreline Sediment</u>	6
II.C.2 <u>Atmospheric Environment</u>	9
II.C.2.a <u>Air Particulate Filters</u>	9
II.C.2.b <u>Air Iodine</u>	9
II.C.3 <u>Terrestrial Environment</u>	9
II.C.3.a <u>Vegetation</u>	11
II.C.3.b <u>Soils</u>	11
II.C.3.c <u>Direct Radiation</u>	11
<u>II.D. CONCLUSION</u>	13
<u>III. INDEPENDENT SPENT FUEL STORAGE INSTALLATION RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM</u>	21
<u>III.A. INTRODUCTION</u>	21
<u>III.B. PROGRAM</u>	21
III.B.1 <u>Objectives</u>	21
III.B.2 <u>Sample Collection</u>	22
III.B.3 <u>Data Interpretation</u>	22
III.B.4 <u>Program Exceptions</u>	22
<u>III.C. RESULTS AND DISCUSSIONS</u>	22
III.C.1 <u>Atmospheric Environment</u>	22
III.C.1.a <u>Air Particulate Filters</u>	22
III.C.2 <u>Terrestrial Environment</u>	23
III.C.2.a <u>Vegetation</u>	23
III.C.2.b <u>Soils</u>	23
III.C.2.c <u>Direct Radiation</u>	24
<u>III.D. CONCLUSION</u>	25
<u>IV. REFERENCES</u>	29
<u>APPENDIX A</u>	33
<u>APPENDIX B</u>	47
<u>APPENDIX C</u>	71
<u>APPENDIX D</u>	89
<u>APPENDIX E</u>	91

(LEFT BLANK)

LIST OF FIGURES

Figure	Title	Page
1	Tritium in Chesapeake Bay Water	7
2	Silver-110m and Potassium-40 in Chesapeake Bay Oysters	8
3	Nuclear Fallout in the Calvert Cliffs Area	10
4	Mean TLD Gamma Dose, Calvert Cliffs Nuclear Power Plant	12
5	Atmospheric Dispersion Around CCNPP 2001 Average Relative Air Concentrations	15
6	Atmospheric Dispersion Around CCNPP 2001 Average Relative Ground Deposition	17
7	Mean TLD Gamma Dose, ISFSI	26
A-1	Map of Southern Maryland and Chesapeake Bay Showing Location of Calvert Cliffs Nuclear Power Plant	38
A-2	Calvert Cliffs Nuclear Power Plant Sampling Locations, 0-2 Miles	39
A-3	Calvert Cliffs Nuclear Power Plant Sampling Locations, 0-10 Miles	41
A-4	Independent Spent Fuel Storage Installation Sampling Locations	44
A-5	Enlarged Map of the Independent Spent Fuel Storage Installation Sampling Locations	45

(LEFT BLANK)

LIST OF TABLES

Table	Title	Page
1	Synopsis of 2001 Calvert Cliffs Nuclear Power Plant Radiological Environmental Monitoring Program.....	19
2	Annual Summary of Radioactivity in the Environs of the Calvert Cliffs Nuclear Power Plant Units 1 and 2	20
3	Synopsis of 2001 Calvert Cliffs Nuclear Power Plant Independent Spent Fuel Storage Installation Radiological Environmental Monitoring Program	27
4	Annual Summary of Radioactivity in the Environs of the Calvert Cliffs Nuclear Power Plant Independent Spent Fuel Storage Installation.....	28
A-1	Locations of Environmental Sampling Stations for the Calvert Cliffs Nuclear Power Plant	37
A-2	Locations of Environmental Sampling Stations for the Independent Spent Fuel Storage Installation at Calvert Cliffs	43
B-1	Concentration of Tritium and Gamma Emitters in Bay Water	50
B-2	Concentration of Gamma Emitters in the Flesh of Edible Fish.....	51
B-3	Concentration of Gamma Emitters in Oyster Samples.....	52
B-4	Concentration of Gamma Emitters in Shoreline Sediment.....	53
B-5	Concentration of Iodine-131 in Filtered Air.....	54
B-6	Concentration of Beta Emitters in Air Particulates	56
B-7	Concentration of Gamma Emitters in Air Particulates	60
B-8a	Concentration of Gamma Emitters in Vegetation Samples	61
B-8b	Concentration of Gamma Emitters in Vegetation From Locations Around the IFSFI.....	63
B-9	Concentration of Gamma Emitters in Soil Samples From Locations Around the ISFSI	64
B-10	Typical MDA Ranges for Gamma Spectrometry	65
B-11	Typical LLDs for Gamma Spectrometry.....	66
B-12	Direct Radiation	67
C-1	Results of Participation in Cross Check Programs	75
C-2	Results of Quality Assurance Program for 2001	77
C-3	Teledyne Brown Engineering's Typical MDAs for Gamma Spectrometry	86
C-4	EnRad Laboratories Typical MDAs for Gamma Spectrometry	87
D-1	Land Use Survey	89
E-1	Locations of Non-Tech Spec Environmental Sampling Stations for Calvert Cliffs Nuclear Power Plant	94
E-2	Synopsis of 2001 Calvert Cliffs Nuclear Power Plant Non-Tech Spec Radiological Environmental Monitoring Program	95
E-3	Annual Summary for Calvert Cliffs Nuclear Power Plant Units 1 & 2 Non-Tech Spec Radiological Environmental Monitoring Program	96
E-4	Concentration of Gamma Emitters in Bottom Sediment.....	97
E-5	Concentration of Iodine-131 in Filtered Air.....	98
E-6	Concentration of Beta Emitters in Air Particulates	100
E-7	Concentration of Gamma Emitters in Air Particulates	102
E-8	Concentration of Tritium and Gamma Emitters in Taylors Island Well Water.....	103
E-9	Direct Radiation as Measured in Pressurized Ion Chamber	104
E-10	Direct Radiation	105
E-11	Direct Radiation from Resin Storage Area.....	106

(LEFT BLANK)

I. SUMMARY

During the 2001 operating period for Calvert Cliffs Nuclear Power Plant (CCNPP) Units 1 and 2, radiochemical analyses were performed on environmental samples, and thermoluminescent dosimeters (TLDs) were analyzed for ambient radiation exposure rates. These analyses were performed to satisfy the requirements of the CCNPP Off-Site Dose Calculation Manual (ODCM), Sections 3/4.12 (6), and Technical Specifications 5.6.2.

For the Independent Spent Fuel Storage Installation (ISFSI), radiochemical analyses were performed on environmental samples, some of which were in common with the power plant program. Additional TLDs, some of which are also in common with the power plant program, were analyzed for ambient radiation exposure rates. These analyses were performed to satisfy the requirements of the ODCM.

In addition, radiochemical analyses were performed on quality assurance samples as part of an internal and external quality assurance program associated with Teledyne Brown Engineering, Environmental Services and Enrad Laboratories (Duke Power Company). Performance evaluation samples obtained from Environmental Resource Associates (ERA) and Analytics' Inc. Cross-Check Program were also analyzed.

And lastly, analyses were performed on extra environmental samples, and extra TLDs were analyzed for ambient radiation exposure rates. Also, six pressurized ion chambers continuously monitored the environs around the plant for ambient radiation levels. The additional analyses reflect a commitment to maintain historical continuity for samples and sampling pathways discontinued from the program when the Environmental Technical Specifications were changed in March 1985 and to satisfy our commitment to the community.

Samples collected from the aquatic environment included bay water, fish, oysters, and shoreline sediment samples. Bay water was analyzed for tritium and gamma emitters. Fish, oysters, and shoreline sediments were analyzed for gamma emitting radionuclides.

Monitoring the atmospheric environment involved sampling the air at various locations surrounding CCNPP and the ISFSI. Air particulates and gaseous iodine were collected on glass fiber filters and silver zeolite molecular sieve cartridges, respectively. The particulate filters were analyzed for beta activity and gamma emitting nuclides. The molecular sieve cartridges were analyzed for airborne gaseous radioiodine.

Samples from the terrestrial environment consisted of vegetation and soil samples, collected and analyzed for gamma emitters. Vegetation samples for the CCNPP REMP were also analyzed for I-131.

Measurements of direct radiation, as required by the ODCM, were performed by analyzing TLDs from forty locations surrounding CCNPP and the ISFSI.

Low levels of various man-made fission products were observed in the environment surrounding the plant during 2001. Some of these observations were attributed to fallout from past atmospheric weapons testing. The others cited were related to the operation of the plant (e.g., H-3 in quarterly composited bay water samples, Ag-110m in oyster samples, and Co-60 in a soil sample collected near the ISFSI).

To assess the plant's contribution to the radiation levels of the ambient environment, dose calculations were performed using the plant's effluent release data, on-site meteorological data, and appropriate pathways. The results of these dose calculations indicate:

- a. a maximum thyroid dose of 5.24×10^{-3} mrem via liquid and gaseous pathways, which is < 0.01% of the acceptable limit of 75 mrem/yr as specified in 40 CFR 190;
- b. a maximum whole body dose of 9.82×10^{-3} mrem via liquid and gaseous pathways, which is < 0.1% of the acceptable limit of 25 mrem/yr as specified in 40 CFR 190;
- c. a maximum calculated dose to all other organs via liquid and gaseous pathways was equal to 3.51×10^{-1} mrem to the GI-Tract. This dose was about 1% of the allowable limit of 25 mrem/yr as specified in 40 CFR 190.

Thus, it is concluded based upon the levels of radioactivity observed and the various dose calculations performed, that Calvert Cliffs Nuclear Power Plant Units 1 and 2 and the ISFSI did not cause any significant radiological impact on the surrounding environment during 2001.

II. CALVERT CLIFFS NUCLEAR POWER PLANT
RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM

II.A. INTRODUCTION

Constellation Energy Group (CEG), previously known as Baltimore Gas and Electric Company, has been conducting a radiological environmental monitoring program in the environs of the Calvert Cliffs Nuclear Power Plant since the summer of 1970. The Calvert Cliffs site is an operating nuclear generating station consisting of two pressurized water reactors. Unit 1 achieved criticality on October 7, 1974 and commenced commercial operation in May 1975. Unit 2 achieved criticality on November 30, 1976 and went into commercial operation April 1, 1977.

Originally the Radiological Environmental Monitoring Program (REMP) was conducted under separate Environmental Technical Specifications (1, 2). On July 29, 1977 the monitoring program began operation under a combined set of Technical Specifications (3) for both Units. The program has operated as such until March 1, 1985 when the Environmental Technical Specifications were revised to reflect a new generic format for radiological environmental monitoring adopted by the Nuclear Regulatory Commission (4). Changes in the program (sample locations, sample types, and/or sampling frequencies) were implemented to conform to these revisions. In October 1996, the Nuclear Regulatory Commission approved the relocation of these Technical Specifications to the ODCM in accordance with Generic Letter 89-01 (5). In the early nineteen nineties, the NRC terminated their thermoluminescent dosimeter program, and therefore, there are no longer any independently collocated TLDs sites for comparison purposes.

Results of the monitoring program for the pre-operational and previous operational periods through December 31, 2000 have been reported in a series of documents (16-52).

Results of the monitoring program for the current operational period of January 1, 2001 through December 31, 2001 are included in this report. The report presents the content of the Radiological Environmental Monitoring Program (Table 1), the sampling locations (Appendix A), the summary of the analytical results of 2001 (Table 2), a compilation of the analytical data for 2001 (Appendix B), the results of the Interlaboratory Comparison Program and the Quality Assurance Program (Appendix C), the results of the Land Use Survey (Appendix D), and a compilation of the analytical data for extra samples collected in 2001 (Appendix E). Interpretation of the data and conclusions are presented in the body of the report.

The environmental surveillance data collected during this reporting period were compared with that generated in previous periods whenever possible to evaluate the environmental radiological impact of Calvert Cliffs Nuclear Power Plant Units 1 and 2 during 2001.

II.B. PROGRAM

II.B.1 Objectives

The objectives of the REMP for the Calvert Cliffs Nuclear Power Plant are:

- a. To verify that radioactivity and ambient radiation levels attributable to plant operation are within the limits specified in the ODCM (39) and the Environmental Radiation Protection Standards as stated in 40 CFR Part 190,
- b. To detect any measurable buildup of long-lived radionuclides in the environment,
- c. To monitor and evaluate ambient radiation levels,
- d. To determine whether any statistically significant increase occurs in the concentration of radionuclides in important pathways.

II.B.2 Sample Collection

The locations of the individual sampling stations are listed in Table A-1 and shown in Figures A-2 and A-3. All samples were collected by contractors to, or personnel of CEG according to Calvert Cliffs Nuclear Power Plant Procedures (7).

II.B.3 Data Interpretation

Many results in environmental monitoring occur at or below the minimum detectable activity (MDA). In this report, all results at or below the relevant MDA are reported as being "less than" the MDA value.

II.B.4 Program Exceptions

There were no program exceptions during 2001.

II.C. RESULTS AND DISCUSSIONS

All the environmental samples collected during the year were analyzed using Constellation Power Source Generation (CPSG) laboratory procedures (8). The analytical results for this reporting period are presented in Appendix B and are also summarized in Table 2. For discussion, the analytical results are divided into four categories. The categories are the Aquatic Environment, the Atmospheric Environment, the Terrestrial Environment, and Direct Radiation. These categories are further divided into subcategories according to sample type (e.g., Bay Water, Aquatic Organisms, etc., for the Aquatic Environment).

II.C.1 Aquatic Environment

The aquatic environment surrounding the plant was monitored by analyzing samples of bay water, aquatic organisms, and shoreline sediment. These samples were obtained from various sampling locations on the Chesapeake Bay near the plant.

II.C.1.a Bay Water

Monthly bay water samples were taken from two locations during the year. These locations are the Intake Area (sample code Wa1) and the Discharge Area (sample code Wa2). The samples were obtained from a composite sampling system operating at each location for the entire sampling period. These samples were analyzed for tritium and gamma emitters.

The tritium analyses, performed on quarterly composites of the monthly bay water samples, showed the presence of tritium in the Discharge (Wa2) samples in each of the four quarters, while detectable readings were observed in the Intake (Wa1) in three of the four quarters. It is not unusual to observe occasional tritium in the Intake as a result of bay water recirculation. The concentrations observed ranged from 192 ± 39 to 685 ± 43 pCi/L in the discharge and from <MDA to 107 ± 37 pCi/L in the intake, which are similar to those ranges observed in previous years, (22-52).

Figure 1 compares tritium observed in the plant discharge and intake with annual effluent releases in 2001 as reported in the Radioactive Effluent Release Report.

Monthly analyses of bay water samples from both locations for gamma emitters exhibited no detectable concentrations of any plant-related radionuclides.

II.C.1.b Aquatic Organisms

Samples of aquatic organisms were obtained from four locations during the year. Samples of fish, when in season, are normally collected from the Intake-Discharge Area (sample codes Ia1 and Ia2) and from the Patuxent River (sample codes Ia4 and Ia5). As shown in Table B-2, two species of fish were sampled at both the plant intake and the control point in the Patuxent River. Oyster samples were obtained quarterly from Camp Conoy (sample code Ia3) and Kenwood Beach (sample code Ia6). Edible portion of the fish and oyster samples were analyzed for gamma emitters.

Gamma spectrometric analyses of the fish exhibited no detectable concentrations of any plant-related radionuclides. Oyster samples exhibited low levels of detectable concentrations of the plant-related radionuclide, Ag-110m, in samples obtained from Camp Conoy (Ia3). These concentrations, which ranged from 46 ± 10 to 95 ± 12 pCi/kg, are consistent with that expected due to liquid effluents from the plant in 2001.

II.C.1.c Shoreline Sediment

Semiannual shoreline sediment samples were taken from one location during the year. This location is Shoreline at Barge Road (sample code Wb1). The samples obtained from this location were analyzed for gamma emitters.

Gamma spectrometric analyses of these samples exhibited no detectable concentrations of any plant-related radionuclides.

FIGURE 1
Tritium in Chesapeake Bay Water


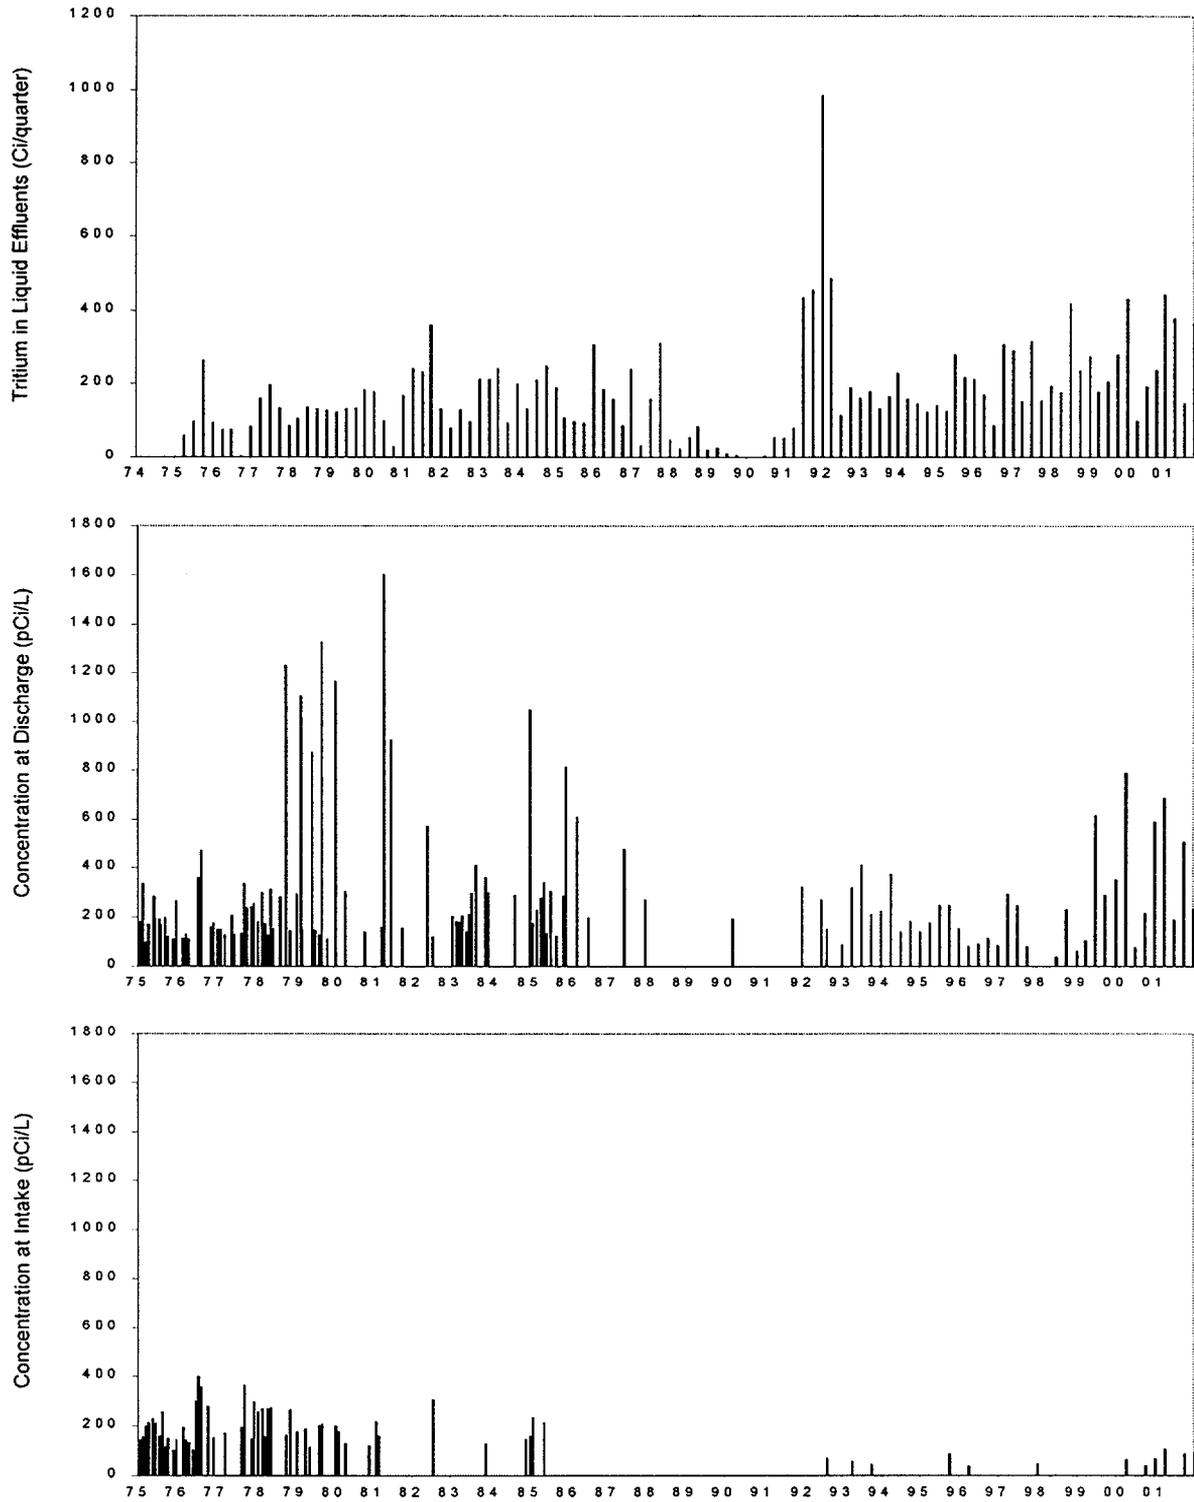


FIGURE 2
Silver-110m and Potassium-40 in Chesapeake Bay Oysters

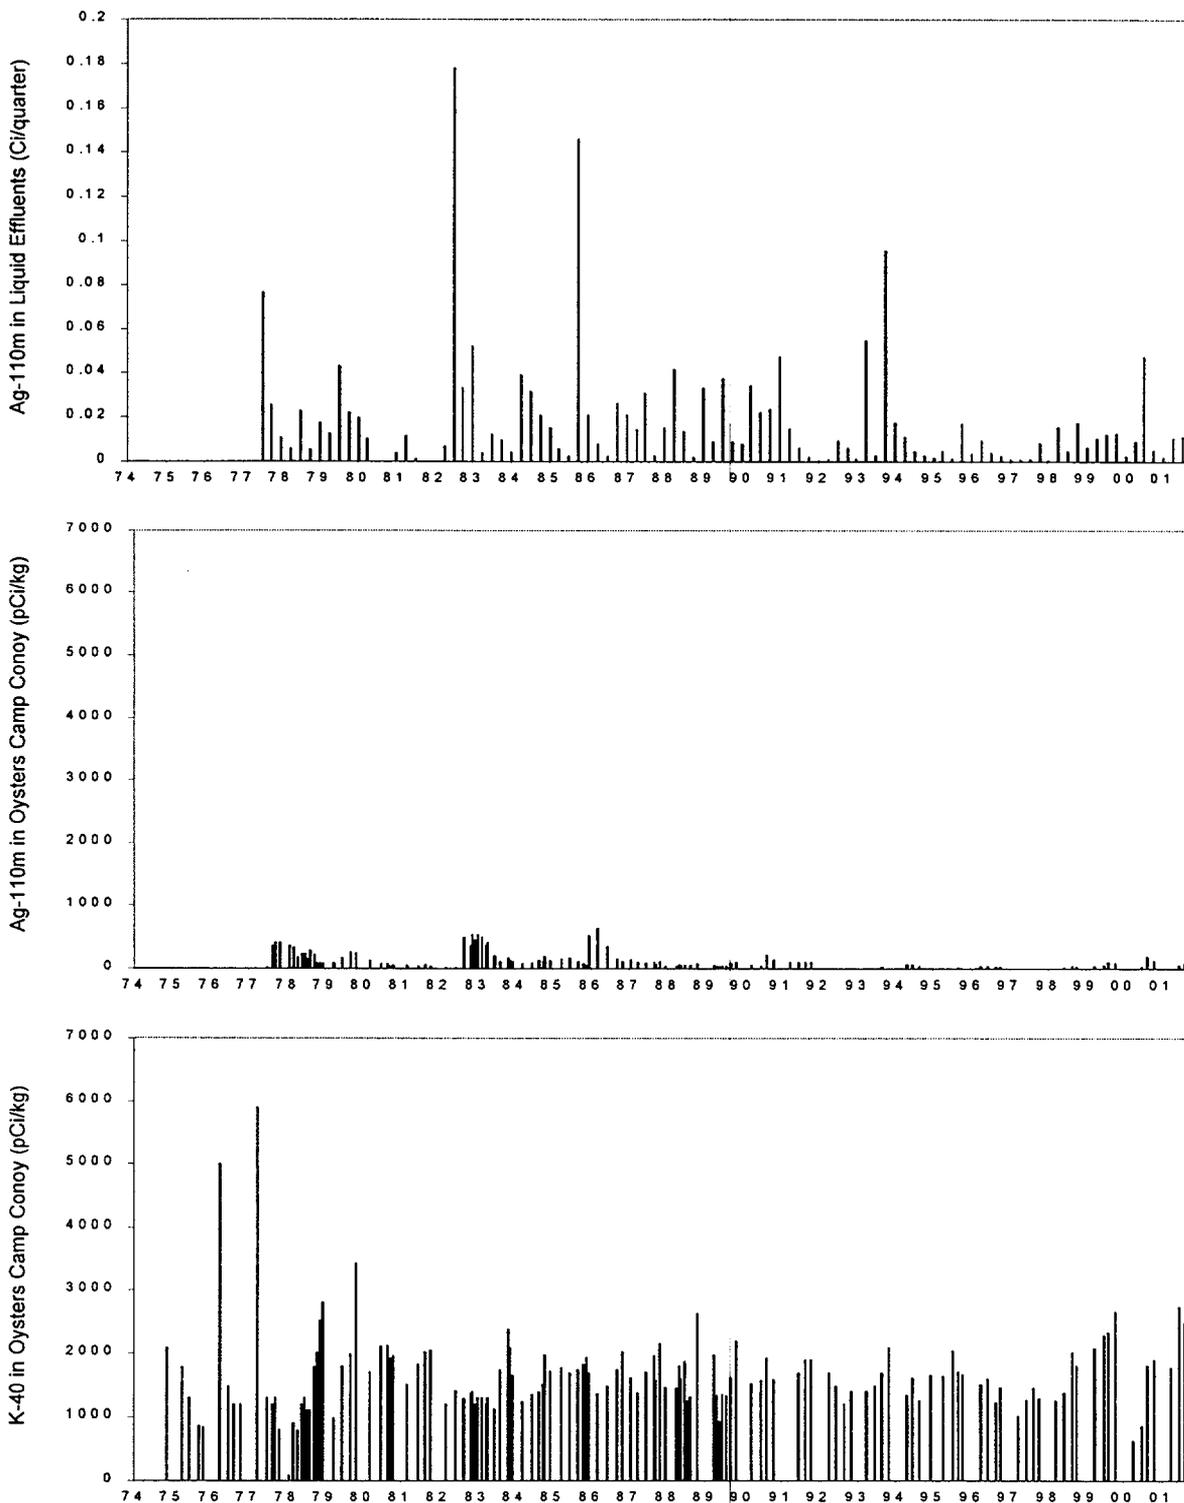

II.C.2 Atmospheric Environment

The atmospheric environment was monitored by analyzing air particulate filters and silver zeolite cartridges (for trapping radioiodine species). These samples were collected from five locations surrounding the plant. These locations are On Site before the Entrance to Camp Conoy (sample code A1), Camp Conoy Road at the Emergency Siren (sample code A2), Bay Breeze Road (sample code A3), Route 765 at Lusby (sample code A4), and at the Emergency Operations Facility (sample code A5).

II.C.2.a Air Particulate Filters

Weekly composite air particulate filter samples were collected from the five locations during the year. These samples were analyzed for beta activity and gamma emitters.

Weekly analyses for beta activity on air particulate filters collected from all five locations showed values characteristic of background levels (22-52). The values ranged from 0.4×10^{-2} to 3.0×10^{-2} pCi/m³ for the indicator locations and 0.9×10^{-2} to 3.0×10^{-2} pCi/m³ at the control location. The location with the highest overall mean of 1.9×10^{-2} pCi/m³ was A5, EOF.

Gamma spectrometric analyses of monthly composited air particulate samples exhibited no detectable concentrations of any plant-related radionuclides in any of these samples.

Figure 3 depicts the historical trends of beta activity.

II.C.2.b Air Iodine

Weekly composited silver zeolite cartridges (for trapping radioiodine species) were collected from the five locations during the year. These samples were analyzed for radioiodine species.

Weekly radioiodine analyses of silver zeolite cartridges collected from all five locations exhibited no detectable concentrations of I-131.



Figure 3 depicts the historical trends of radioiodine.

II.C.3 Terrestrial Environment

The terrestrial environment was monitored by analyzing samples of vegetation collected monthly, when available, from various sampling locations near the plant during the normal growing season.

FIGURE 3 Nuclear Fallout in the Calvert Cliffs Area

SURFACE AIR VAPORS, LUSBY, MD (A4)

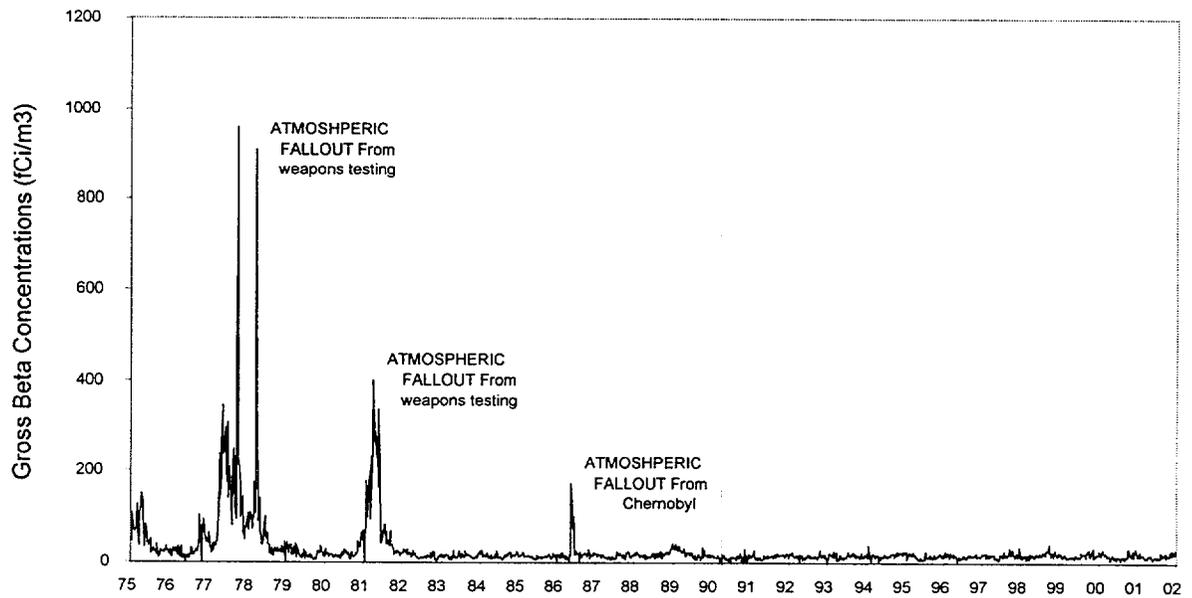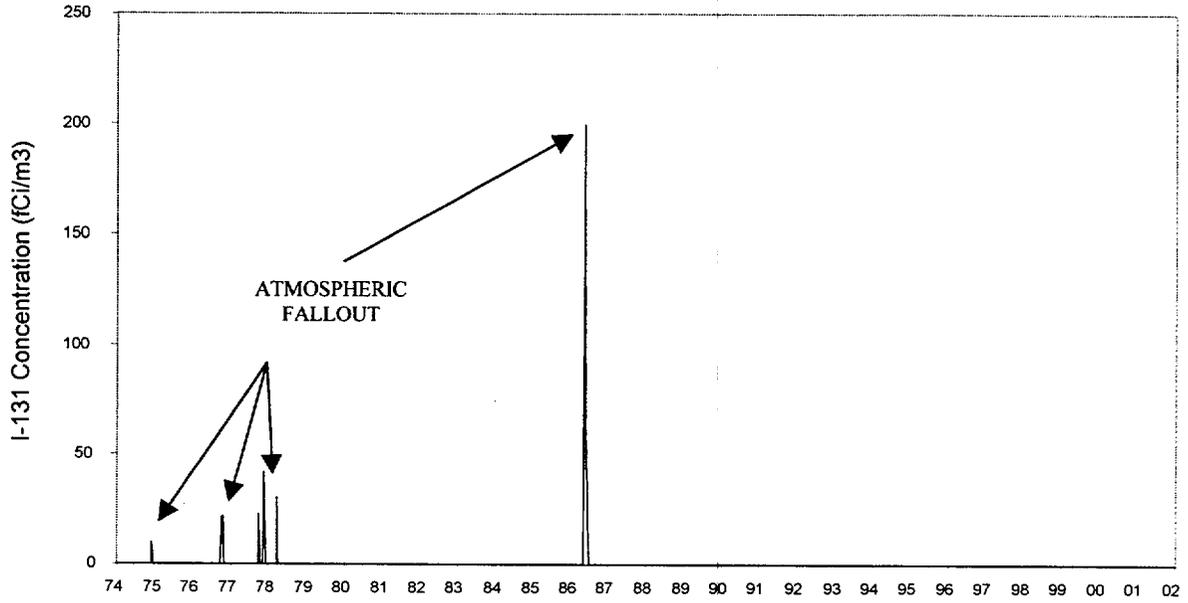

II.C.3.a Vegetation

Vegetation samples were collected from three locations during the year. These locations are Garden Plot off Bay Breeze Road (sample codes Ib1, Ib2, and Ib3), On Site before the Entrance to Camp Conoy (sample codes Ib4, Ib5, and Ib6), and the Emergency Operations Facility (sample codes Ib7, Ib8, and Ib9). These samples were analyzed for gamma emitters, including analyses for I-131.

Gamma spectrometric analyses exhibited no detectable concentrations of plant-related radionuclides in any of these samples.


II.C.4 Direct Radiation

Direct radiation is measured by a network of TLDs in each overland sector surrounding the Plant both at the plant boundary and at 4 miles from the Plant.

Thermoluminescent dosimeters were collected quarterly from twenty-three locations surrounding the plant. The twenty indicator locations are On Site Along the Cliffs (sample code DR1), Route 765 Auto Dump (sample code DR2), Giovanni's Tavern (sample code DR3), Route 765 across from White Sands (sample code DR4), John's Creek (sample code DR5), Lusby (sample code DR6), On Site before the Entrance to Camp Conoy (sample code DR7), On Site at Emergency Siren (sample code DR8), Bay Breeze Road (sample code DR9), Decatur and Calvert Beach Roads (sample code DR10), Dirt Road off Mackall and Parran Roads (sample code DR11), Mackall and Bowen Roads (sample code DR12), Wallville (sample code DR13), Rodney Point (sample code DR14), Mill Bridge and Turner Roads (sample code DR15), Appeal School (sample code DR16), Cove Point and Little Cove Point Roads (sample code DR17), Cove Point (sample code DR18), Long Beach (sample code DR19), and On Site Near Shore (sample code DR20). The three control locations are the Emergency Operations Facility (sample code DR21), Solomons Island (sample code DR22), and Taylors Island, Carpenters Property (sample code DR23).

The mean 90 day ambient radiation measured at the indicator locations was 11.16 mR and ranged from 8.53 to 15.17 mR as reported in Table 2. The control locations showed a 90 day mean of 12.60 mR with ranges from 9.74 to 16.12 mR. The location with the highest overall mean of 15.29 was DR23, Taylors Island, Carpenters Property, which ranged from 13.66 to 16.12 mR. A comparison of the means and ranges of the current TLD data with those of both the historical data and the regional data (22-52) shows no plant-related contribution to the measured direct radiation exposure for 2001. Figure 4 shows the historical comparison of the average monthly radiation levels per calendar year for TLDs on site, at four miles, and at the control locations.

FIGURE 4
Mean TLD Gamma Dose, Calvert Cliffs Nuclear Power Plant

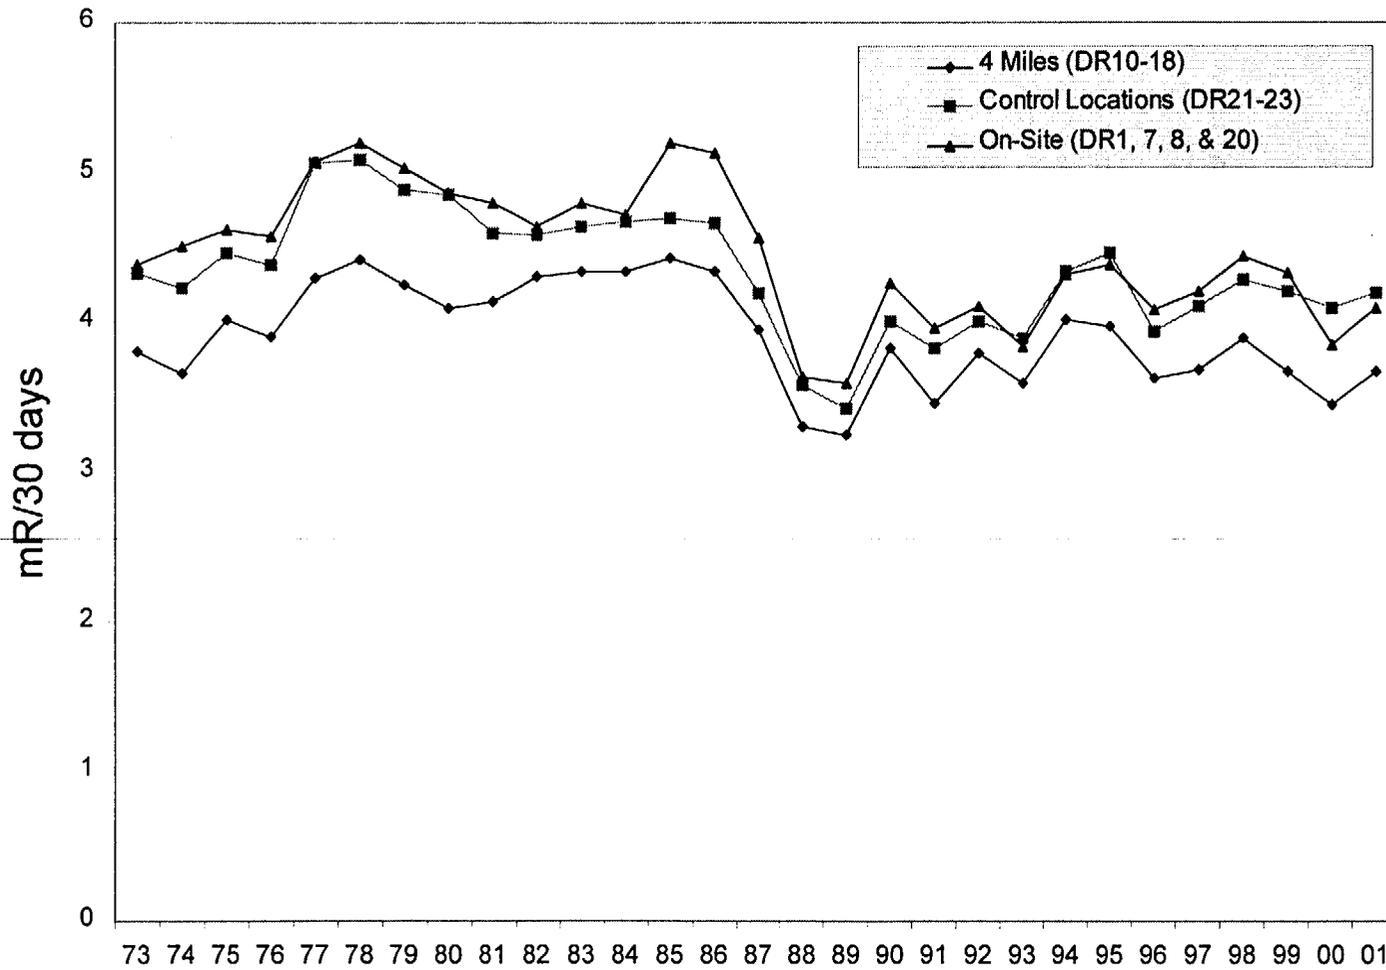

II.D. CONCLUSION

Low levels of various man-made fission by-products were observed in the environment surrounding the plant during 2001. Some of these observations were attributed to fallout from past atmospheric weapons testing. The others cited were related to the operation of the plant (e.g., tritium in quarterly composited bay water samples and Ag-110m in oysters).

Historical trends for tritium in bay water, Ag-110m and K-40 in oyster samples, nuclear fallout in the Calvert Cliffs area, and TLD data are depicted in Figures 1 through 4. As can be seen from these figures, the plant made no adverse radiological contributions to the surrounding environment during 2001.

To assess the plant's contribution to the ambient radiation levels of the surrounding environment, dose calculations were performed using the plant's effluent release data, on site meteorological data (see X/Q and D/Q values presented in Figures 5 and 6), and appropriate pathways. The results of these dose calculations indicate:

Gaseous Pathways

A maximum thyroid dose of 2.14×10^{-3} mrem to a child via the plume, ground, vegetable, meat, and inhalation pathways at 1.9 km WSW of Calvert Cliffs. This is $< 0.01\%$ of the acceptable limit of 75 mrem/year as specified in 40 CFR 190, "Environmental Radiation Protection Standards for Nuclear Power Operations."

A maximum whole body gamma dose of 5.09×10^{-4} mrem to a child at 1.4 km WSW of Calvert Cliffs, which is $< 0.01\%$ of the acceptable dose limit of 25 mrem/year as specified in 40 CFR 190.

A maximum dose to any other organ, in this case the skin, of 1.05×10^{-3} mrem to all age groups at 1.4 km WSW of Calvert Cliffs. This is $< 0.01\%$ of the acceptable dose limit of 25 mrem/year as specified in 40 CFR 190.

Liquid Pathways

A maximum thyroid dose of 3.10×10^{-3} mrem to a teenager for all liquid pathways, which is $< 0.01\%$ of the acceptable dose limit of 75 mrem/year as specified in 40 CFR 190.

A maximum whole body dose of 9.31×10^{-3} mrem to a child via all liquid pathways, which is about 0.04% of the acceptable dose limit of 25 mrem/year as stated in 40 CFR 190.

A maximum dose to any organ, in this case the GI-Tract, of 3.51×10^{-1} mrem to an adult for all pathways, which is about 1% of the acceptable dose limit of 25 mrem/year specified in 40 CFR 190.

Gaseous and Liquid Pathways Combined

A maximum thyroid dose of 4.79×10^{-3} mrem via liquid and gaseous pathways, which is < 0.01% of the acceptable limit of 75 mrem/year specified in 40 CFR 190.


A maximum whole body dose of 9.15×10^{-3} mrem via liquid and gaseous pathways which is < 0.1% of the acceptable limit of 25 mrem/year as specified in 40 CFR 190.

A maximum calculated dose to all other organs via liquid and gaseous pathways was equal to 2.35×10^{-1} mrem to the GI-Tract. This dose is about 1% of the allowable limit of 25 mrem/year as specified in 40 CFR 190.

In all cases, the calculated doses are a small fraction of the applicable limits specified in 40 CFR 190. Therefore, it is concluded that the operation of Calvert Cliffs Units 1 & 2 produced radioactivity and ambient radiation levels significantly below the limits of Off-Site Dose Calculation Manual and 40 CFR Part 190. There was no significant buildup of radionuclides in the environment due to Calvert Cliffs.

FIGURE 5


Atmospheric Dispersion Around CCNPP 2001 Average Relative Air Concentrations

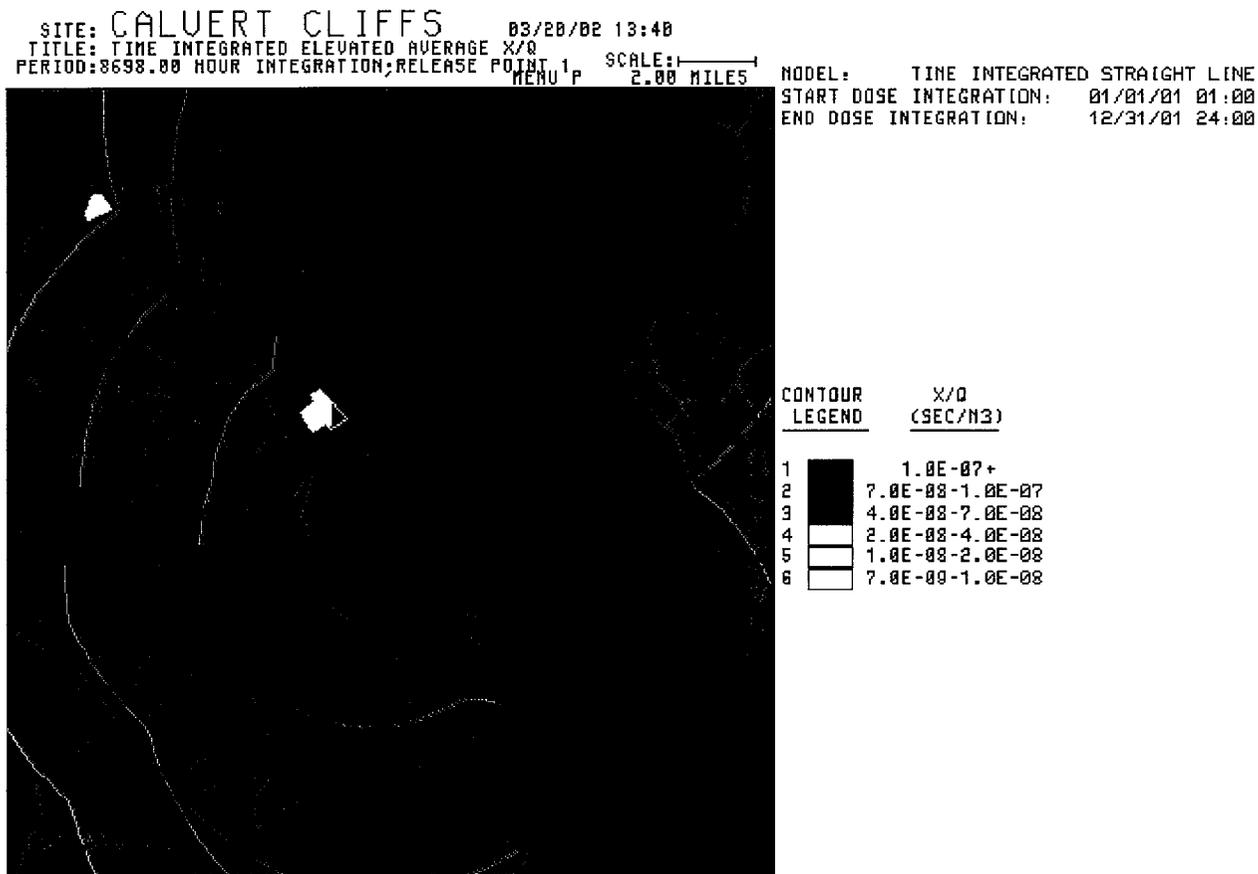

(LEFT BLANK)

FIGURE 6

Atmospheric Dispersion Around CCNPP 2001 Average Relative Ground Deposition

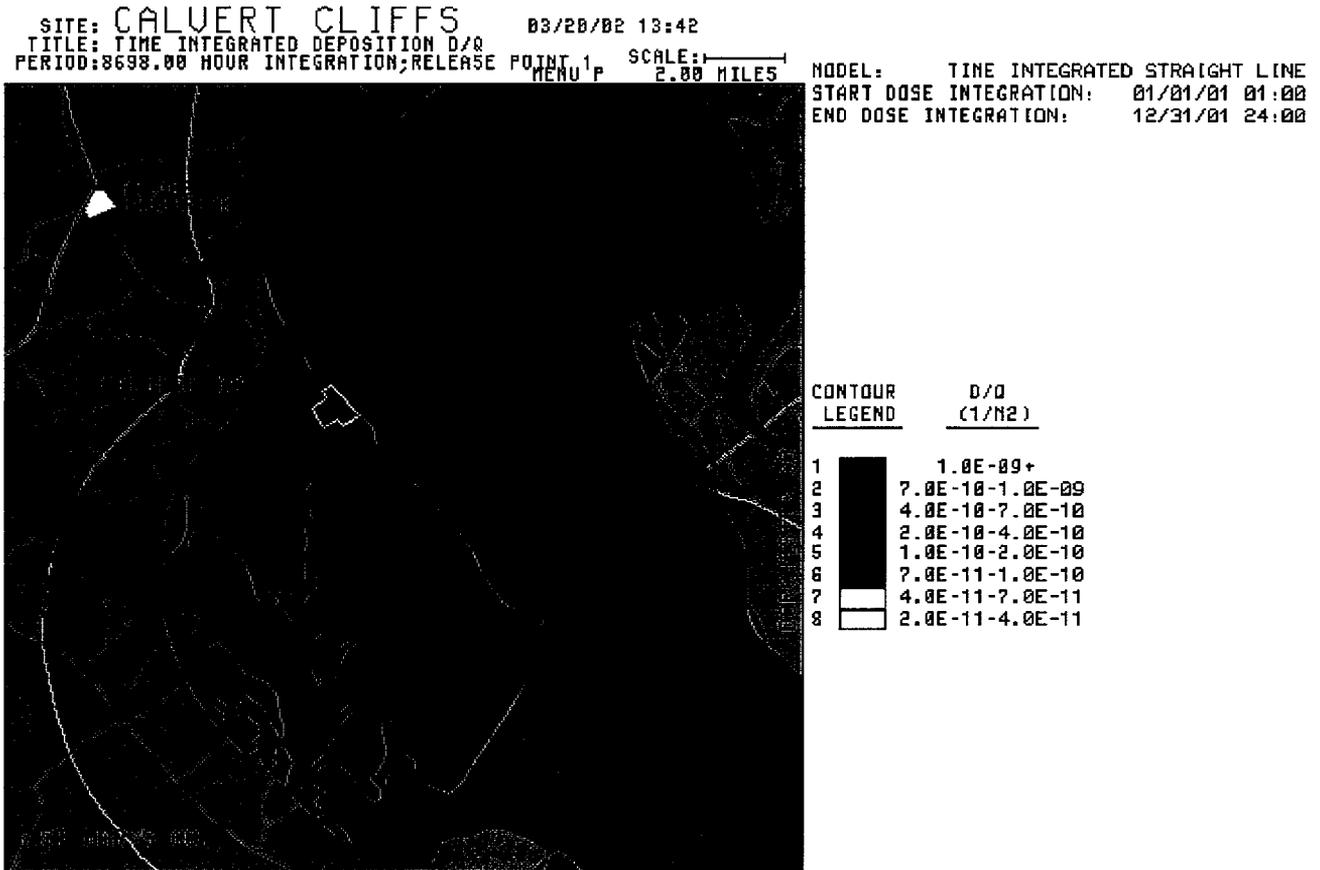

(LEFT BLANK)

Table 1

Synopsis of 2001 Calvert Cliffs Nuclear Power Plant Radiological Environmental Monitoring Program

Sample Type	Sampling Frequency ¹	Number of Locations	Number Collected	Analysis	Analysis Frequency ¹	Number Analyzed
Aquatic Environment						
Bay Water	MC	2	24	Gamma	M	24
				H-3	QC	8
Fish ²	A	2	4	Gamma	A	4
Oysters	Q	2	8	Gamma	Q	8
Shoreline Sediment	SA	1	2	Gamma	SA	2
Atmospheric Environment						
Air Iodine ³	W	5	260	I-131	W	260
Air Particulates ⁴	W	5	260	Gross Beta	W	260
				Gamma	MC	60
Direct Radiation						
Ambient Radiation	Q	23	546	TLD	Q	546
Terrestrial Environment						
Vegetation ⁵	M	3	36	Gamma	M	36

¹ W-weekly, M-monthly, Q-quarterly, SA-semiannual, A-annual, C-composite

² Once in Season, July Through September

³ The collection device contains silver zeolite

⁴ Beta counting is performed after ≥ 72 hour decay. Gamma spectroscopy performed on monthly composites of weekly samples

⁵ Monthly during Growing Season

Table 2

Annual Summary of Radioactivity in the Environs of the
Calvert Cliffs Nuclear Power Plant Units 1 and 2

Medium or Pathway Sampled (Unit of Measurement)	Type and Total Number of Analyses Performed	Lower Limit of Detection (LLD)	Indicator Locations Mean (F)/Range ¹	Location with Highest Annual Mean Name/Distance & Direction ²	Highest Annual Mean (F) / Range ¹	Control Locations Mean (F)/Range ¹
Aquatic Environment						
Bay Water (pCi/L)	H-3 (8)	54	405 (4/4) (192-685)	Discharge Vicinity Wa2 0.3 km N	405 (4/4) (192-685)	96 (3/4) (86-107.00)
Oysters (pCi/kg)	Gamma (8) Ag110m	14	71 (3/4) (46-95)	Camp Conoy Ia3 0.9 km E	71 (3/4) (46-95)	<MDA
Atmospheric Environment						
Air Particulates (10 ⁻² pCi/m ³)	Gross Beta (260)	0.5	1.5 (208/208) (0.4-3.0)	EOF A5 19.3 km WNW	1.9 (52/52) (0.9-3.0)	1.9 (52/52) (0.9-3.0)
Direct Radiation						
Ambient Radiation (mR/90 days)	TLD (546)	-	11.16 (474/474) (8.53-15.17)	Taylor's Island DR23 12.6 km ENE	15.29 (24/24) (13.66-16.12)	12.60 (72/72) (9.74-16.12)

¹ Mean and range based upon detectable measurements only. Fraction (F) of detectable measurements and ranges at specified location is indicated in parentheses.² From the centerpoint between the two containment buildings.

III. INDEPENDENT SPENT FUEL STORAGE INSTALLATION RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM

III.A. INTRODUCTION

In August 1990 BGE initiated a program of additional radiological environmental monitoring around the site for the Independent Spent Fuel Storage Facility (ISFSI). The first dry fuel storage canister was loaded into the ISFSI in November of 1993.

Results of the monitoring program for the ISFSI for the current period of January 1, 2001 through December 31, 2001 are included in this report.

This report presents the content of the ISFSI radiological environmental monitoring program (Table 3), the ISFSI sampling locations (Appendix A), the summary of the analytical results of the period (Table 4), and a compilation of the analytical data for the period (Appendix B). Interpretation of the data and conclusions are presented in the body of the report.

The ISFSI monitoring program is as described in this section of the report with the exception of the Pressurized Ion Chambers (PICs). Pressurized Ion Chambers, because they duplicate direct surveillance by TLDs and because they experience problems with reliability, were excluded from the Technical Specification portion of the ISFSI REMP (9). Pressurized Ion Chambers' results, however, are given in table E-9 and will continue to be a non-ODCM surveillance to satisfy our commitment to the community.

The results for 2001 were compared with that generated during the previous ISFSI pre-operational periods (10) and the current and previous CCNPP REMP periods (22-52). These comparisons demonstrate the consistency of data throughout the CCNPP site, which are very close to the natural background levels for the region. A discussion of these results is given in Section III. C. 3.

III.B. PROGRAM

III.B.1 Objectives

The objectives of the radiological environmental monitoring program for the ISFSI are:

- a. To satisfy the community concern regarding the impact of the ISFSI on the environment,
- b. To verify that radioactivity and ambient radiation levels attributable to operation of the ISFSI are within the limits specified in the Environmental Radiation Protection Standards as stated in 40 CFR Part 190,
- c. To detect any measurable buildup of long-lived radionuclides in the environment due to the ISFSI,

- d. To monitor and evaluate ambient radiation levels around the ISFSI,
- e. To determine whether any statistically significant increase occurs in the concentration of radionuclides near the ISFSI.

III.B.2 Sample Collection

The locations of the individual sampling sites are listed in Table A-2 and shown in Figures A-4 and A-5. All samples were collected by contractors to, or personnel of, CEG personnel according to Calvert Cliffs Nuclear Power Plant Procedures (7).

III.B.3 Data Interpretation

Many results in environmental monitoring occur at or below the minimum detectable activity (MDA). In this report, all results at or below the relevant MDA are reported as being "less than" the MDA value.

III.B.4 Program Exceptions

There were no program exceptions during 2001.

III.C. RESULTS AND DISCUSSIONS

All the environmental samples collected during the year were analyzed using CPSG's laboratory procedures (8). The analytical results for this reporting period are presented in Appendix B and are also summarized for the period in Table 4. For discussion, the analytical results are divided into three categories. The categories are the Atmospheric Environment, the Terrestrial Environment, and Direct Radiation. These categories are further divided into subcategories according to sample type (e.g., Vegetation and Soil for Terrestrial Environment).

III.C.1 Atmospheric Environment

The atmospheric environment was monitored by analyzing air particulate filters. These samples were collected from five locations surrounding the ISFSI.

No source of airborne radioiodine exists for the ISFSI. Airborne radioiodine is, therefore, not considered.

III.C.1.a Air Particulate Filters

Weekly composite air particulate filter samples were collected from five locations during the period. These locations are On Site before the Entrance to Camp Conoy (sample code A1; in common with the CCNPP REMP), Meteorological Station (SFA1), CCNPP Visitor's Center (SFA2), NNW of the ISFSI (SFA3), and South of the ISFSI (SFA4). These samples were analyzed for beta radioactivity and gamma emitting radionuclides.

Weekly analyses for beta activity on air particulate filters collected from all five locations showed values characteristic of levels routinely observed in the REMP (22-52). These values ranged from 0.7×10^{-2} to 4.0×10^{-2} pCi/m³ for the indicator locations and 0.8×10^{-2} to 2.6×10^{-2} pCi/m³ for the control location. The location with the highest overall mean of 1.7×10^{-2} pCi/m³ was SFA3, NNW of ISFSI.

Gamma spectrometric analyses of monthly composited air particulate samples exhibited no detectable concentrations of any plant-related radionuclides in any of these samples.

III.C.2 Terrestrial Environment

The terrestrial environment was monitored by analyzing samples of vegetation and soil collected quarterly from the vicinity of the air sampling locations for the ISFSI.

III.C.2.a Vegetation

Vegetation samples were collected quarterly from five locations during the year. These locations are: Meteorological Station (sample code SFb1), CCNPP Visitor's Center (sample code SFb2), NNW of the ISFSI (sample code SFb3), South of the ISFSI (sample code SFb4), and On Site before the Entrance to Camp Conoy (sample code SFb5). These samples were analyzed for gamma emitters.

Gamma spectrometric analyses of these samples revealed the presence of Cs-137 in one sample. The Cs-137 concentration level was 21 ± 12 pCi/kg. While the presence of Cs-137 in this sample may be plant-related, this result is consistent with that found to be due to the residual fallout from past atmospheric nuclear weapons testing. The activity of this radionuclide is well below the federal limits established in 40 CFR 190, "Environmental Radiation Protection Standards for Nuclear Power Operations" and is comparable to those observed in previous annual reporting periods for the CCNPP REMP (22-52) and in the earlier pre-operational data for the ISFSI (10).

III.C.2.b Soils

Soil samples were collected quarterly from five locations surrounding the ISFSI in the vicinity of the air samplers. These locations are: Meteorological Station (sample code SFS1), CCNPP Visitor's Center (sample code SFS2), NNW of the ISFSI (sample code SFS3), South of the ISFSI (sample code SFS4), and On Site before the Entrance to Camp Conoy (sample code SFS5).

Soil samples were analyzed for gamma emitting radionuclides. Cesium-137 was detected in twelve quarterly samples from both indicator and control locations while Co-60 was detected in one quarterly sample from the MET Station (SFS1). The Cs-137 concentrations ranged from 47 ± 26 to 809 ± 62 pCi/kg and the single Co-60 result was 31 ± 17 pCi/kg. While the presence of Cs-137 in these samples may be plant-related, this range is consistent with that found to be due to the residual fallout from past atmospheric nuclear weapons testing. The presence of Co-60 is plant-related; however, this result is near the minimum detectable activity. The activities of both

these radionuclides are well below the federal limits established in 40 CFR 190, "Environmental Radiation Protection Standards for Nuclear Power Operations" and are comparable to those observed in previous annual reporting periods for the CCNPP REMP (22-52) and in the earlier pre-operational data for the ISFSI (10).

III.C.3 Direct Radiation

Direct radiation is measured by a network of TLDs surrounding the ISFSI. These thermoluminescent dosimeters are collected quarterly from seventeen locations surrounding the ISFSI, plus one control TLD location at the Visitor's Center (sample code SFDR7). The locations include On Site before the Entrance to Camp Conoy (sample code DR7, common to both the CCNPP Program and the ISFSI Program) and the Meteorological Station (sample code DR30, previously a location maintained for historical continuity.) The other sampling locations are: SW of ISFSI, Collocated with Plant TLD #159, (sample code SFDR1); N of ISFSI, Collocated with Plant TLD #160, (sample code SFDR2); NNE of ISFSI, Collocated with Plant TLD #161, (sample code SFDR3); NE of ISFSI, Collocated with Plant TLD #162, (sample code SFDR4); E of ISFSI, Collocated with Plant TLD #163, (sample code SFDR5); ESE of ISFSI, Collocated with Plant TLD #164, (sample code SFDR6); North Northwest of ISFSI, (sample code SFDR8); South of ISFSI, (sample code SFDR9); NNW of ISFSI, (sample code SFDR10); WNW of ISFSI, (sample code SFDR11); West of ISFSI, (sample code SFDR12); SSW of ISFSI, (sample code SFDR13); SSE of ISFSI, (sample code SFDR14); ENE of ISFSI, (sample code SFDR15); and WSW of ISFSI, (sample code SFDR16). Sampling locations are shown on Figures A-4 and A-5.

The mean 90 day ambient radiation measured at the ISFSI indicator locations was 20.62 mR and ranged from 8.72 to 58.97 mR as reported in Table 4. The control location showed a 90 day mean of 12.43 mR and ranged from 11.39 to 13.07 mR. A comparison of the mean and ranges of the current TLD data with those of both the historical data and the regional data (22-52, 10) reveals only one set of elevated TLD readings. That location with the highest overall mean of 42.96 mR with a range of 34.96 to 58.97 mR was SFDR10, North Northwest of ISFSI. These readings are consistent with those expected from the continuing storage of spent fuel in the ISFSI (22-52, 10). A comparison of the average monthly radiation levels per calendar year of the ISFSI TLD data from the indicator locations with the ISFSI control location at the Visitor's Center, SFDR7, can be seen in Figure 7.

III.D. CONCLUSION

Low levels of Cs-137 and Co-60 were observed in the environment surrounding the ISFSI during the period. The Cs-137 observations were attributed to fallout from past atmospheric weapons testing, while the Co-60 observation is attributable to plant operation.

In general, the results in the following tables continue the historical trends previously observed at the official sites of the Calvert Cliffs Nuclear Power Plant Radiological Environmental Monitoring Program (22-52).

FIGURE 7
Mean TLD Gamma Dose, ISFSI

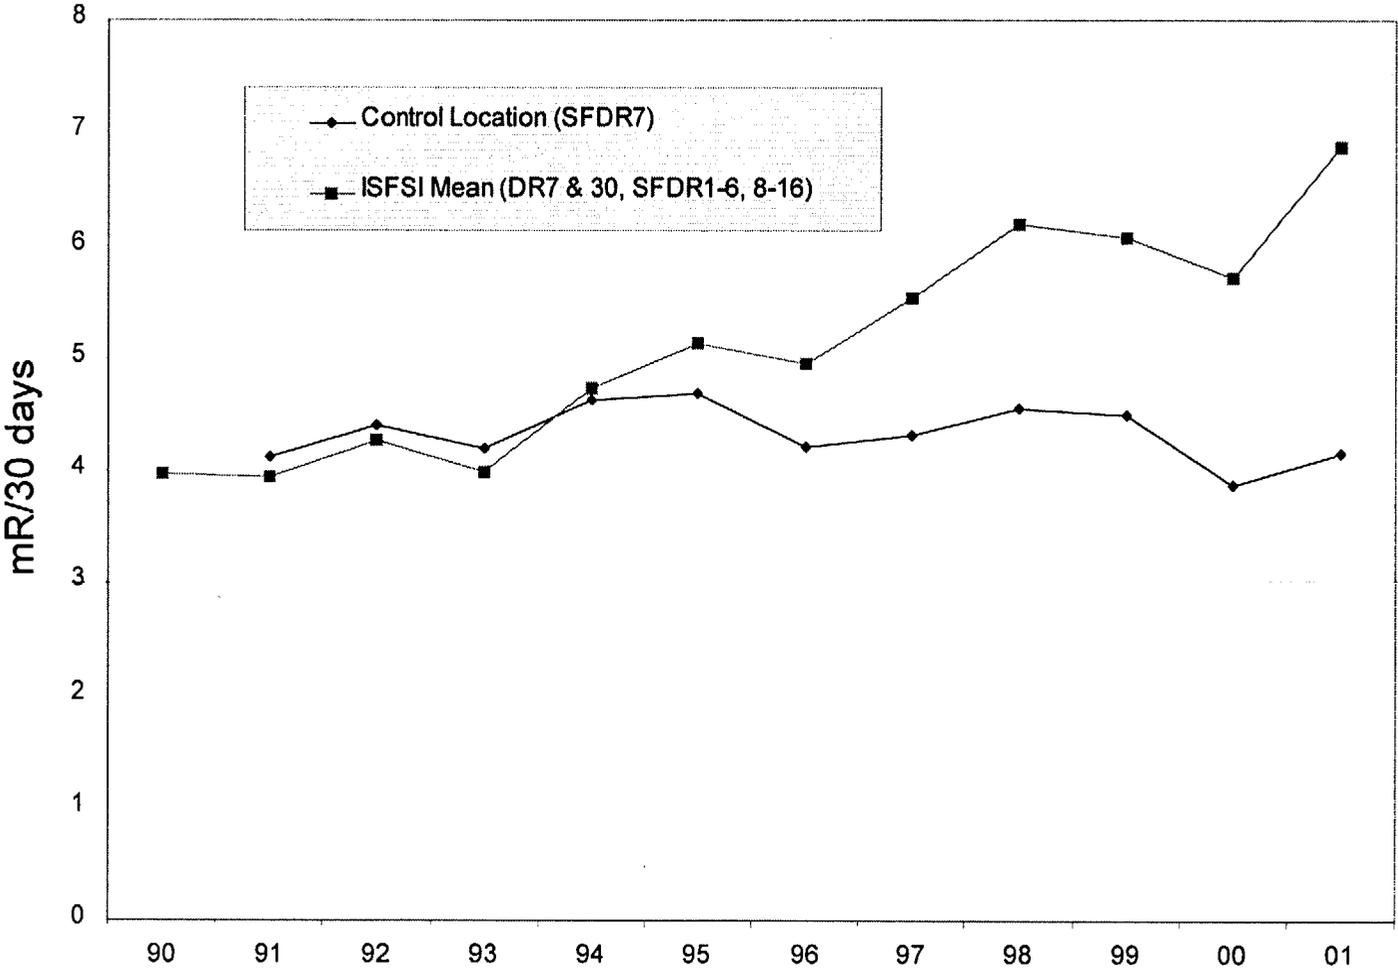


Table 3

**Synopsis of 2001 Calvert Cliffs Nuclear Power Plant
Independent Spent Fuel Storage Installation
Radiological Environmental Monitoring Program**

Sample Type	Sampling Frequency ¹	Number of Locations	Number Collected	Analysis	Analysis Frequency ¹	Number Analyzed
Atmospheric Environment Air Particulates ²	W	5	260	Gross Beta Gamma	W MC	260 60
Direct Radiation Ambient Radiation	Q	18	432	TLD	Q	432
Terrestrial Environment Vegetation	Q	5	20	Gamma	Q	20
Soil	Q	5	20	Gamma	Q	20

¹ W-weekly, M-monthly, Q-quarterly, SA-semiannual, A-annual, C-composite

² Beta counting is performed after ≥ 72 hour decay. Gamma spectroscopy performed on monthly composites of weekly samples

Table 4
**Annual Summary of Radioactivity in the Environs of the
Calvert Cliffs Nuclear Power Plant Independent Spent Fuel Storage Installation**

Medium or Pathway Sampled (Unit of Measurement)	Type and Total Number of Analyses Performed	Lower Limit of Detection (LLD)	Indicator Locations Mean (F)/Range ¹	Location with Highest Annual Mean Name/Distance & Direction ²	Highest Annual Mean (F) / Range ¹	Control Locations Mean (F)/Range ¹
Atmospheric Environment						
Air Particulates (10 ⁻² pCi/m ³)	Gross Beta (260)	0.5	1.7 (208/208) (0.7-4.0)	NNW of ISFSI SFA3 0.1 km NNW	1.7 (52/52) (0.7-2.8)	1.6 (52/52) (0.8-2.6)
Direct Radiation						
Ambient Radiation (mR/90 days)	TLD (432)	--	20.62 (408/408) (8.72-58.97)	NNW of ISFSI SFDR10 0.1 km NNW	42.96 (24/24) (34.96-58.97)	12.43 (24/24) (11.39-13.07)
Terrestrial Environment						
Vegetation (pCi/L)	Gamma (20) Cs-137	27	21 (1/16) --	On Site before Entrance to Camp Conoy SFb5 0.7 km SE	21 (1/4) --	-- --
Soil (pCi/kg)	Gamma (20) Co-60	21	31 (1/16) --	MET station SFS1 0.4 km NW	31 (1/4) --	-- --
	Gamma (20) Cs-137	17	334 (8/16) (47-809)	Entrance to Camp Conoy SFS5 0.7 km SE	400 (4/4) (209-600)	128 (4/4) (103-151)

¹ Mean and range based upon detectable measurements only. Fraction (F) of detectable measurements at specified location is indicated in parentheses.

² From the centerpoint of the ISFSI facility

IV. REFERENCES

- (1) Calvert Cliffs Nuclear Power Plant, Unit Number 1, License No. DPR-53, Appendix A, Technical Specifications; Appendix B, Environmental Technical Specifications.
- (2) Calvert Cliffs Nuclear Power Plant, Unit Number 2, License No. DPR-69, Appendix A, Technical Specifications; Appendix B, Environmental Technical Specifications.
- (3) Calvert Cliffs Nuclear Power Plant, Unit Nos. 1 and 2, License Nos. DPR-53 and DPR-69, Amendment No. 23 for Unit No. 1, Amendment No. 7 for Unit No. 2, Appendix A Technical Specifications; Appendix B, Environmental Technical Specifications.
- (4) Calvert Cliffs Nuclear Power Plant, Unit Nos. 1 and 2, License Nos. DPR-53 and DPR-69, Amendment No. 100 for Unit No. 1, Amendment No. 83 for Unit No. 2, Appendix A Technical Specifications.
- (5) Calvert Cliffs Nuclear Power Plant, Unit Nos. 1 and 2, License Nos. DPR-53 and DPR-69, Amendment No. 217 for Unit No. 1, Amendment No. 194 for Unit No. 2, October 1996.
- (6) Off-Site Dose Calculation Manual Calvert Cliffs Nuclear Power Plant.
- (7) CP-234, Specification and Surveillance for the Radiological Environmental Monitoring Program.
- (8) Constellation Power Source Generation (CPSG) Laboratory Procedures Manual, Fossil Engineering and Maintenance Dept.
- (9) Letter from Mr. R. E. Denton (BGE) to Mr. T. T. Martin (NRC), dated November 24, 1993, Annual Report of Changes, Tests, and Experiments - 10 CFR 72.48.
- (10) Baltimore Gas and Electric Company, Radiological Environmental Monitoring Program Pre-Operational Report for the Calvert Cliffs Independent Spent Fuel Storage Installation, August 1990 - November 1993, February 1994.
- (11) Teledyne Brown Engineering Environmental Services, Laboratory Procedures.
- (12) Constellation Energy Group, "Land Use Survey Around Calvert Cliffs Nuclear Power Plant."
- (13) Calvert Cliffs Nuclear Power Plant, Docket Nos. 50-317/318 Effluent Release Report: January 2001- December 2001.
- (14) U.S. NRC Regulatory Guide 1.109, "Calculation of Annual Doses to Man from Routine Releases of Reactor Effluents for the Purpose of Evaluating Compliance with 10 CFR Part 50, Appendix I", Revision 1, October 1977.
- (15) U.S. NRC Regulatory Guide 1.111, "Methods for Estimating Atmospheric Transport and Dispersion of Gaseous Effluents in Routine Releases from Light-Water-Cooled Reactors", Revision 1, July 1977.

- (16) Cohen, L. K., "Preoperational Environmental Radioactivity Monitoring Program at Calvert Cliffs Units 1 and 2", NUS No. 882 Semiannual Report January-June 1971, December 1971; NUS No. 1025 Annual Report 1971, March 1973.
- (17) Cohen, L. K., "Preoperational Environmental Radioactivity Monitoring Program at Calvert Cliffs Units 1 and 2", NUS No. 1137 Annual Report 1972, December 1973.
- (18) Cohen, L. K. and Malmberg, M. S., "Preoperational Environmental Radioactivity Monitoring Program at Calvert Cliffs Units 1 and 2", NUS No. 1188, Annual Report 1973, October 1974.
- (19) Radiation Management Corporation, Calvert Cliffs Nuclear Power Plant Radiological Environmental Analyses, December 1971 - December 1973 RMC-TR-74-13, August 1974.
- (20) Malmberg, M. S., "Environmental Radioactivity Monitoring Program at Calvert Cliffs Nuclear Power Plant", NUS No. 1331 Annual Report 1974, February 1975.
- (21) Malmberg, M. S., "Preoperational Environmental Radioactivity Monitoring Program at Calvert Cliffs Units 1 and 2", NUS No. 1333, Data Summary Report, September 1970 to September 1974, July 1975.
- (22) Radiation Management Corporation, Calvert Cliffs Nuclear Power Plant - Radiological Environmental Surveillance Program, January 1 to June 30, 1974, December 1974.
- (23) Baltimore Gas and Electric Company, Calvert Cliffs Nuclear Power Plant - Semiannual Operating Report, July - December 1974, March 1975.
- (24) Radiation Management Corporation, Radiological Environmental Monitoring Program - Semiannual Report for Calvert Cliffs Nuclear Power Plant, July 1 through December 31, 1974, RMC-TR-75-06, August 1975.
- (25) Baltimore Gas and Electric Company and Radiation Management Corporation, Calvert Cliffs Nuclear Power Plant Radiological Environmental Monitoring Program Semiannual Report, January 1 - June 30, 1975, RMC-TR-75-11, September 1975.
- (26) Baltimore Gas and Electric Company and Radiation Management Corporation, Calvert Cliffs Nuclear Power Plant Radiological Environmental Monitoring Program Semiannual Report, July 1 - December 31, 1975, RMC-TR-76-02, March 1976.
- (27) Baltimore Gas and Electric Company and Radiation Management Corporation, Calvert Cliffs Nuclear Power Plant Radiological Environmental Monitoring Program Semiannual Report, January 1 - June 30, 1976, RMC-TR-76-06, September 1976.
- (28) Baltimore Gas and Electric Company and Radiation Management Corporation, Calvert Cliffs Nuclear Power Plant Radiological Environmental Monitoring Program Semiannual Report, July 1 - December 31, 1976, RMC-TR-77-07, March 1977.
- (29) Baltimore Gas and Electric Company, Calvert Cliffs Nuclear Power Plant Radiological Environmental Monitoring Program Annual Report, January 1 - December 31, 1977, March 1978.

- (30) Baltimore Gas and Electric Company, Calvert Cliffs Nuclear Power Plant Radiological Environmental Monitoring Program Annual Report, January 1 - December 31, 1978, March 1979.
- (31) Baltimore Gas and Electric Company, Calvert Cliffs Nuclear Power Plant Radiological Environmental Monitoring Program Annual Report, January 1 - December 31, 1979, March 1980.
- (32) Baltimore Gas and Electric Company, Calvert Cliffs Nuclear Power Plant Radiological Environmental Monitoring Program Annual Report, January 1 - December 31, 1980, March 1981.
- (33) Baltimore Gas and Electric Company, Calvert Cliffs Nuclear Power Plant Radiological Environmental Monitoring Program Annual Report, January 1 - December 31, 1981, March 1982.
- (34) Baltimore Gas and Electric Company, Calvert Cliffs Nuclear Power Plant Radiological Environmental Monitoring Program Annual Report, January 1 - December 31, 1982, March 1983.
- (35) Baltimore Gas and Electric Company, Calvert Cliffs Nuclear Power Plant Radiological Environmental Monitoring Program Annual Report, January 1 - December 31, 1983, March 1984.
- (36) Baltimore Gas and Electric Company, Calvert Cliffs Nuclear Power Plant Radiological Environmental Monitoring Program Annual Report, January 1 - December 31, 1984, March 1985.
- (37) Baltimore Gas and Electric Company, Calvert Cliffs Nuclear Power Plant Radiological Environmental Monitoring Program Annual Report, January 1 - December 31, 1985, March 1986.
- (38) Baltimore Gas and Electric Company, Calvert Cliffs Nuclear Power Plant Radiological Environmental Monitoring Program Annual Report, January 1 - December 31, 1986, March 1987.
- (39) Baltimore Gas and Electric Company, Calvert Cliffs Nuclear Power Plant Radiological Environmental Monitoring Program Annual Report, January 1 - December 31, 1987, March 1988.
- (40) Baltimore Gas and Electric Company, Calvert Cliffs Nuclear Power Plant Radiological Environmental Monitoring Program Annual Report, January 1 - December 31, 1988, March 1989.
- (41) Baltimore Gas and Electric Company, Calvert Cliffs Nuclear Power Plant Radiological Environmental Monitoring Program Annual Report, January 1 - December 31, 1989, March 1990.
- (42) Baltimore Gas and Electric Company, Calvert Cliffs Nuclear Power Plant Radiological Environmental Monitoring Program Annual Report, January 1 - December 31, 1990, March 1991.

- (43) Baltimore Gas and Electric Company, Calvert Cliffs Nuclear Power Plant Radiological Environmental Monitoring Program Annual Report, January 1 - December 31, 1991, March 1992.
- (44) Baltimore Gas and Electric Company, Calvert Cliffs Nuclear Power Plant Radiological Environmental Monitoring Program Annual Report, January 1 - December 31, 1992, March 1993.
- (45) Baltimore Gas and Electric Company, Calvert Cliffs Nuclear Power Plant Radiological Environmental Monitoring Program Annual Report, January 1 - December 31, 1993, March 1994.
- (46) Baltimore Gas and Electric Company, Calvert Cliffs Nuclear Power Plant Radiological Environmental Monitoring Program Annual Report, January 1 - December 31, 1994, March 1995.
- (47) Baltimore Gas and Electric Company, Calvert Cliffs Nuclear Power Plant Radiological Environmental Monitoring Program Annual Report, January 1 - December 31, 1995, March 1996.
- (48) Baltimore Gas and Electric Company, Calvert Cliffs Nuclear Power Plant Radiological Environmental Monitoring Program Annual Report, January 1 - December 31, 1996, March 1997.
- (49) Baltimore Gas and Electric Company, Calvert Cliffs Nuclear Power Plant Radiological Environmental Monitoring Program Annual Report, January 1 - December 31, 1997, March 1998.
- (50) Baltimore Gas and Electric Company, Calvert Cliffs Nuclear Power Plant Radiological Environmental Monitoring Program Annual Report, January 1 - December 31, 1998, March 1999.
- (51) Baltimore Gas and Electric Company, Calvert Cliffs Nuclear Power Plant Radiological Environmental Monitoring Program Annual Report, January 1 - December 31, 1999, March 2000.
- (52) Constellation Energy Group, Calvert Cliffs Nuclear Power Plant Radiological Environmental Monitoring Program Annual Report, January 1 - December 31, 2000, March 2001.

APPENDIX A

Appendix A contains information concerning the environmental samples which were collected during the period January 1, 2001 to December 31, 2001.

Sample locations and specific information about individual locations for the CCNPP Radiological Environmental Monitoring Program are given in Table A-1. Figure A-1 shows the location of the Calvert Cliffs Nuclear Power Plant in relation to Southern Maryland and the Chesapeake Bay. Figures A-2 and A-3 show the locations of the power plant sampling sites in relation to the plant site at different degrees of detail.

Sample locations and specific information about individual locations for the ISFSI radiological environmental monitoring program are given in Table A-2. Figures A-4 and A-5 show the locations of the ISFSI sampling sites in relation to the plant site at different degrees of detail.

(LEFT BLANK)

TABLE OF CONTENTS - SAMPLING LOCATIONS

Table	Title	Page
A-1	Locations of Environmental Sampling Stations for the Calvert Cliffs Nuclear Power Plant	37
A-2	Locations of Environmental Sampling Stations for the Independent Spent Fuel Storage Installation at Calvert Cliffs	43

Figure	Title	Page
A-1	Map of Southern Maryland and Chesapeake Bay Showing Location of Calvert Cliffs Nuclear Power Plant	38
A-2	Calvert Cliffs Nuclear Power Plant Sampling Locations, 0-2 Miles	39
A-3	Calvert Cliffs Nuclear Power Plant Sampling Locations, 0-10 Miles	41
A-4	Independent Spent Fuel Storage Installation Sampling Locations	44
A-5	Enlarged Map of the Independent Spent Fuel Storage Installation Sampling Locations	45

(LEFT BLANK)

TABLE A-1
Locations of Environmental Sampling Stations
for the Calvert Cliffs Nuclear Power Plant

Station	Description	Distance ¹		Direction ¹ (Sector)
		(KM)	(Miles)	
A1	On Site before Entrance to Camp Conoy	0.7	0.5	S
A2	Camp Conoy at Emergency Siren	2.5	1.5	SSE
A3	Bay Breeze Road	2.6	1.6	SE
A4	Route 765 Lusby	2.9	1.8	SSW
A5	Emergency Operations Facility (EOF)	19.3	12.1	WNW
DR1	On Site along Cliffs	0.6	0.4	NW
DR2	Route 765, Auto Dump	2.7	1.7	WNW
DR3	Route 765, Giovanni's Tavern (Knotty Pine)	2.3	1.4	W
DR4	Route 765, across from White Sands Drive	2.0	1.2	WSW
DR5	Route 765, John's Creek	2.4	1.5	SW
DR6	Route 765 Lusby	2.9	1.8	SSW
DR7 ²	On Site before Entrance to Camp Conoy	0.7	0.5	S
DR8	Camp Conoy at Emergency Siren	2.5	1.5	SSE
DR9	Bay Breeze Road	2.6	1.6	SE
DR10	Calvert Beach Rd. and Decatur Street	6.4	4.0	NW
DR11	Dirt road off Mackall & Parran Roads	6.6	4.1	WNW
DR12	Mackall and Bowen Roads	6.7	4.2	W
DR13	Mackall Rd. near Wallville	6.1	3.8	WSW
DR14	Rodney Point	6.4	4.0	SW
DR15	Mill Bridge and Turner Roads	6.2	3.9	SSW
DR16	Across from Appeal School	6.5	4.1	S
DR17	Cove Point and Little Cove Point Roads	5.9	3.7	SSE
DR18	Cove Point	7.1	4.5	SE
DR19	Long Beach	4.4	2.8	NW
DR20	On Site near shore	0.4	0.3	NNW
DR21	Emergency Operations Facility (EOF)	19.3	12.1	WNW
DR22	Solomons Island	12.5	7.8	S
DR23	Taylor's Island, Carpenter's Property	12.6	7.9	ENE
Ia1,2	Discharge Area	0.3	0.2	N
Ia3	Camp Conoy	0.9	0.6	E
Ia4,5	Patuxent River	N/A	N/A	N/A
Ia6	Kenwood Beach	10.7	6.7	NNW
Ib1,2,3	Garden Off Bay Breeze Road	2.6	1.6	SSE
Ib4,5,6	On Site before Entrance to Camp Conoy	0.7	0.5	S
Ib7,8,9	Emergency Operations Facility (EOF)	19.3	12.1	WNW
Wa1	Intake Area	0.2	0.1	NNE
Wa2	Discharge Area	0.3	0.2	N
Wb1	Shoreline at Barge Rd.	0.6	0.4	ESE

¹ Distance and direction from the central point between the two containment buildings.

² Common to both the REMP and ISFSI monitoring program

FIGURE A-1
Map of Southern Maryland and Chesapeake Bay Showing Location of Calvert Cliffs Nuclear Power Plant



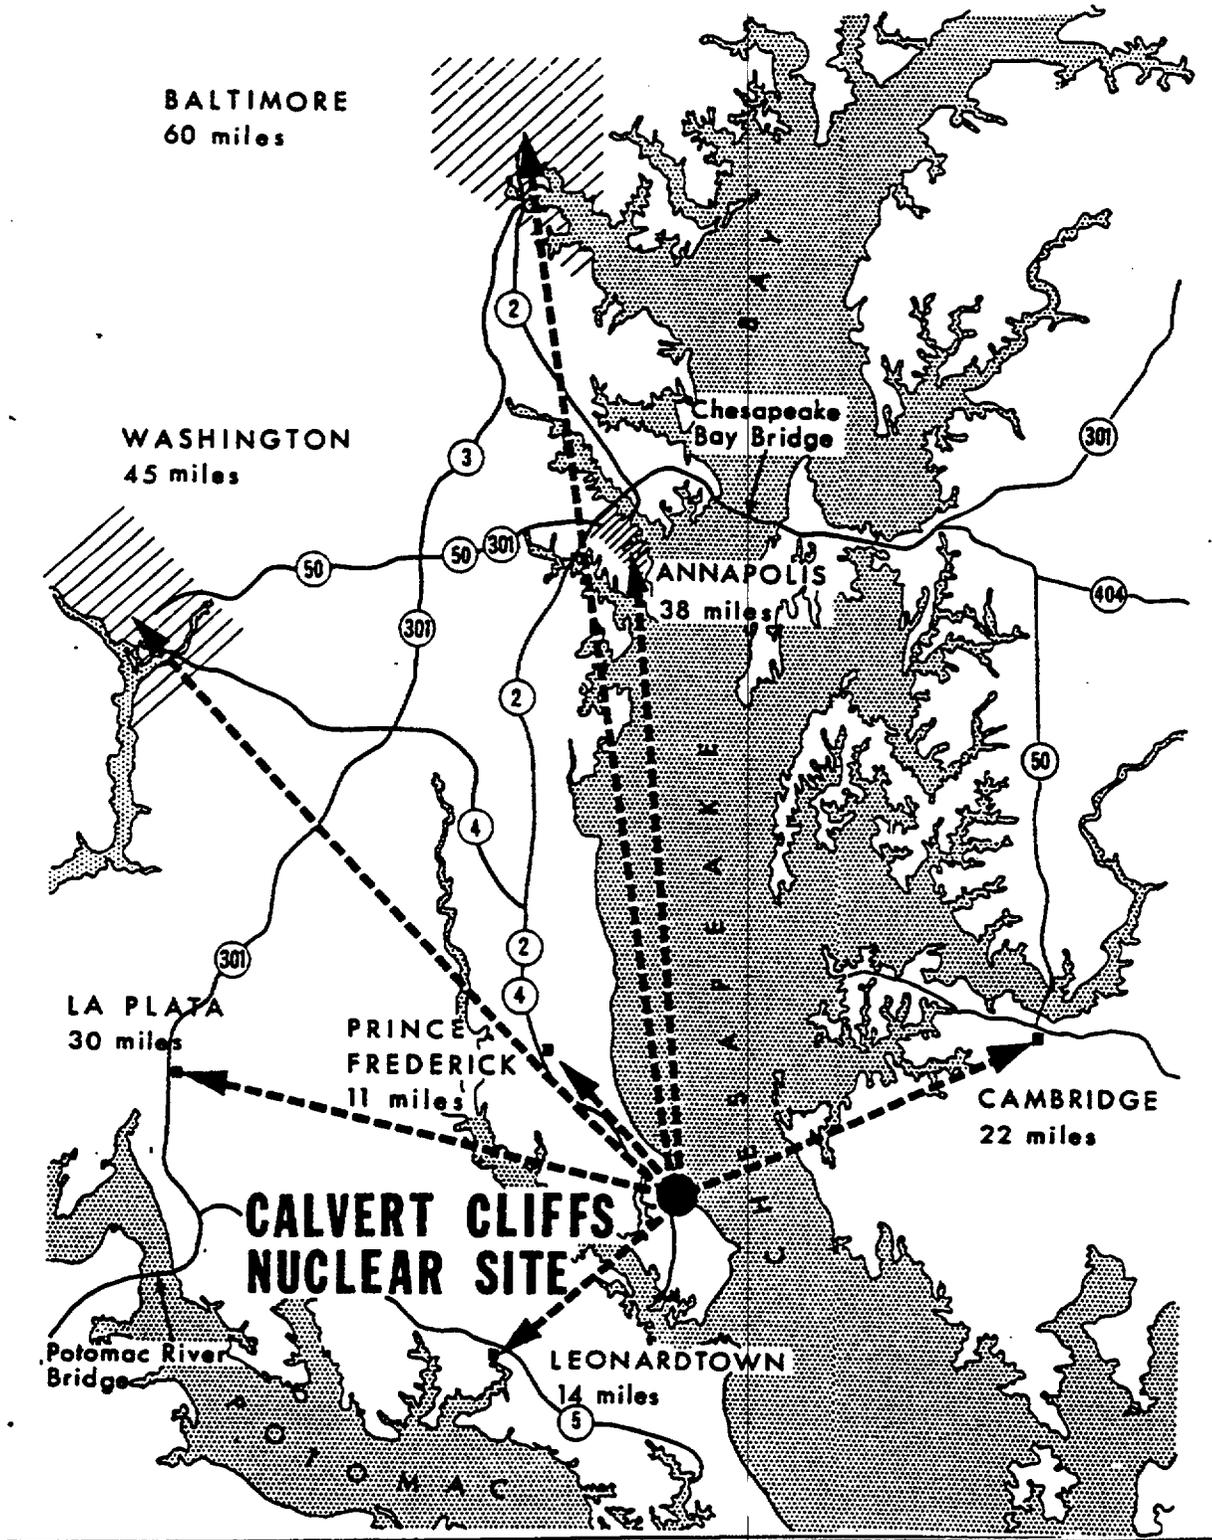


FIGURE A-2
Calvert Cliffs Nuclear Power Plant Sampling Locations
0-2 Miles

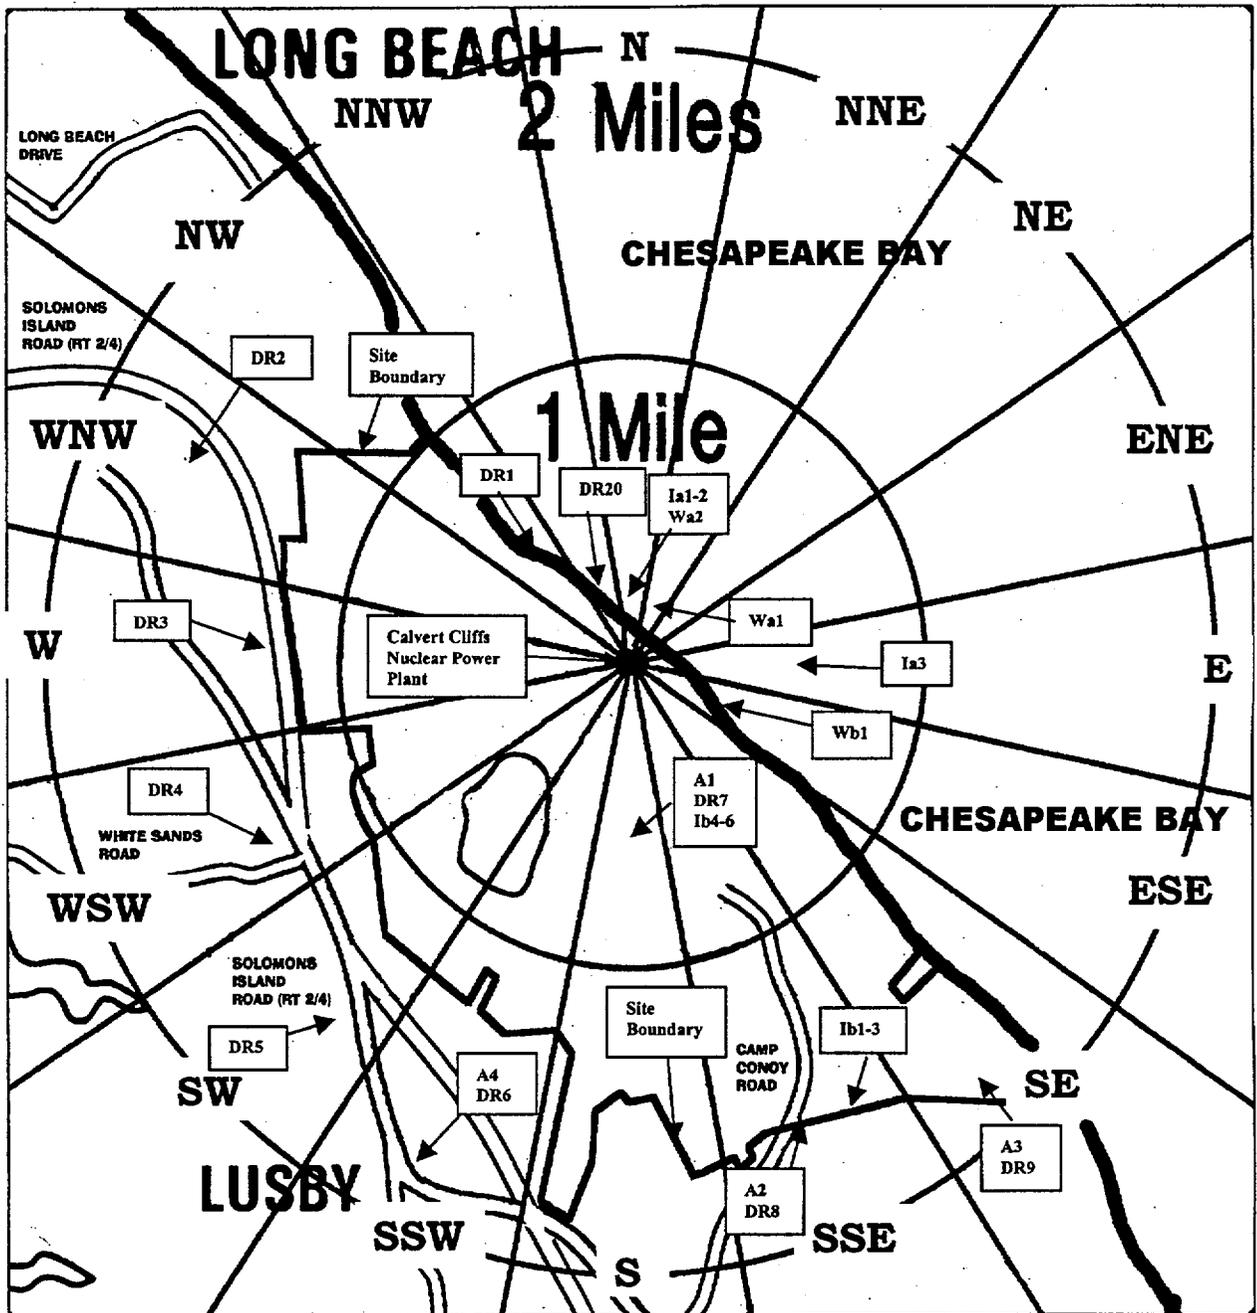

(LEFT BLANK)

FIGURE A-3
Calvert Cliffs Nuclear Power Plant Sampling Locations
 0-10 Miles

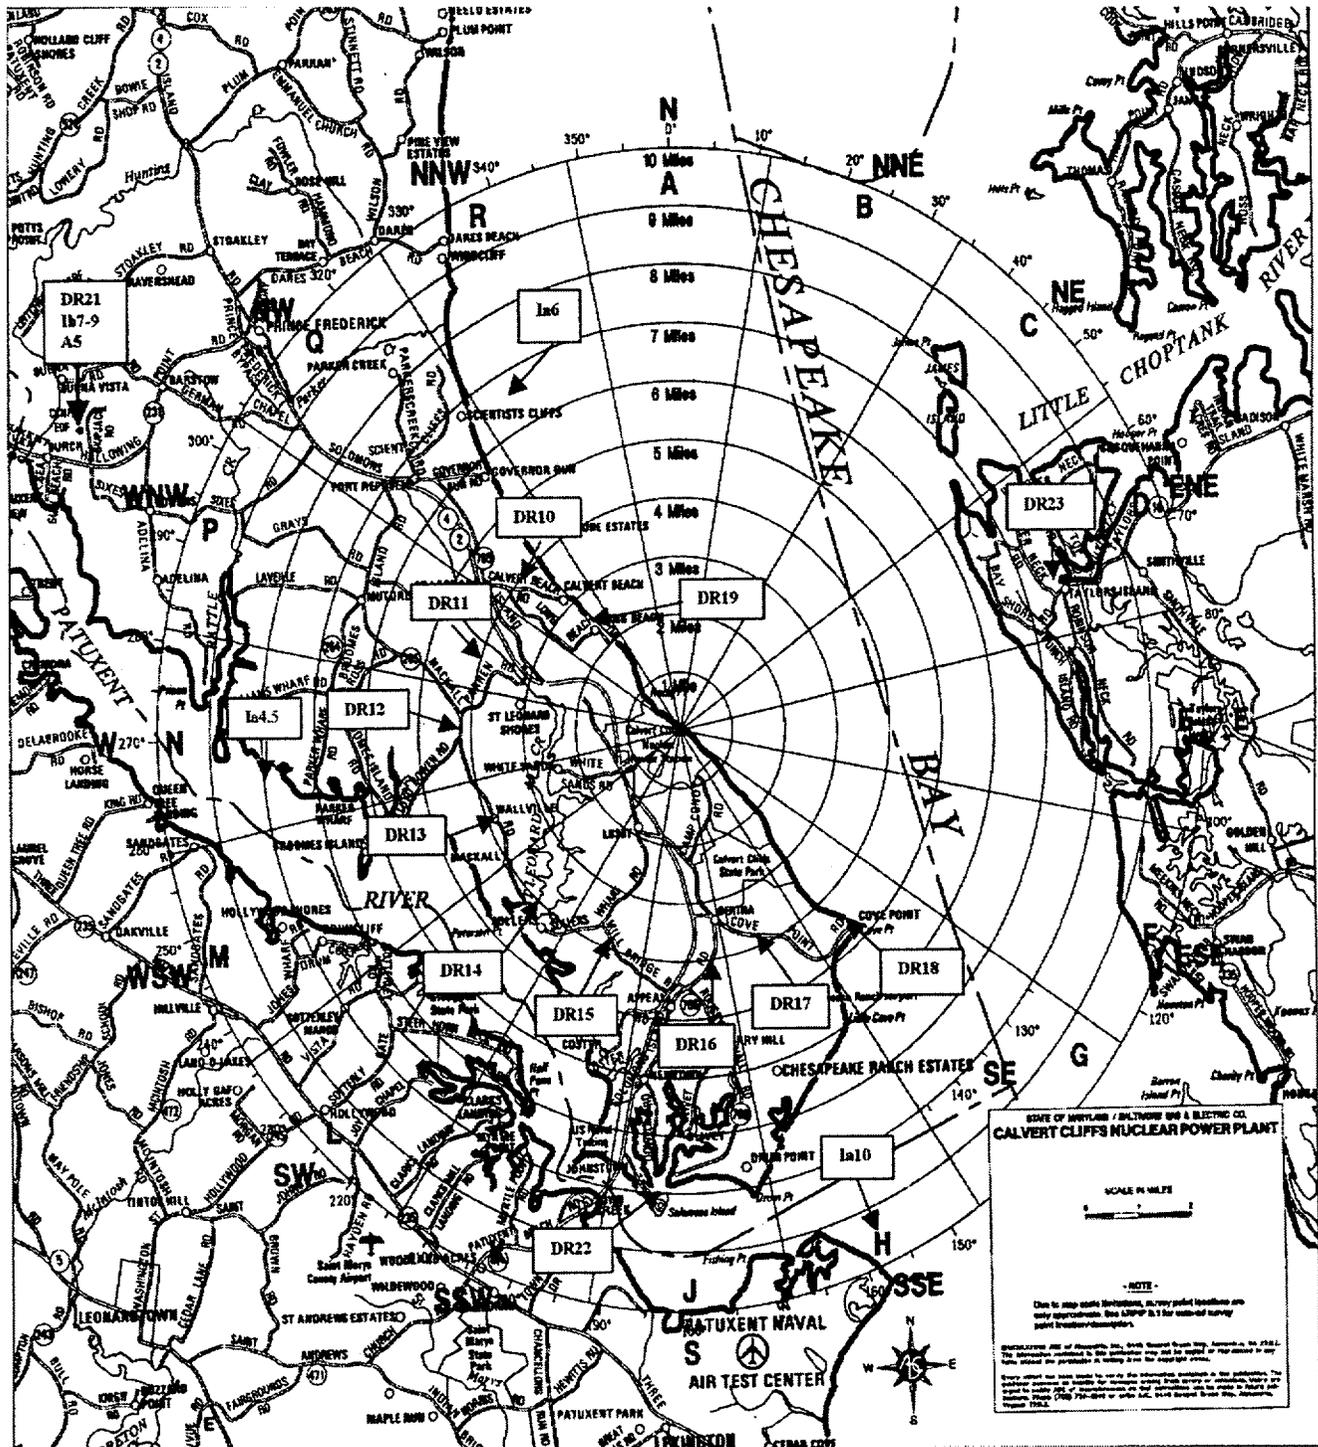

(LEFT BLANK)

TABLE A-2

Locations of Environmental Sampling Stations for the
Independent Spent Fuel Storage Installation at Calvert Cliffs

Station	Description	Distance ¹		Direction ¹
		(KM)	(Miles)	(Sector)
A1 ²	On Site before Entrance to Camp Conoy	0.7	0.5	S
SFA1	Meteorological Station	0.4	0.2	NW
SFA2	CCNPP Visitor's Center	0.7	0.4	NNE
SFA3	NNW of ISFSI	0.1	<0.1	NNW
SFA4	South of ISFSI	0.1	<0.1	S
SFDR1	SW of ISFSI	0.1	<0.1	SW
SFDR2	North of ISFSI	0.1	<0.1	N
SFDR3	NNE of ISFSI	0.1	<0.1	NNE
SFDR4	NE of ISFSI	<0.1	<0.1	NE
SFDR5	East of ISFSI	<0.1	<0.1	E
SFDR6	ESE of ISFSI	0.1	<0.1	ESE
SFDR7	CCNPP Visitor's Center	0.7	0.4	NNE
SFDR8	North Northwest of ISFSI	0.1	<0.1	NNW
SFDR9	South of ISFSI	0.1	<0.1	S
SRDR10	NNW of ISFSI	0.1	<0.1	NNE
SFDR11	WNW of ISFSI	0.1	<0.1	WNW
SFDR12	West of ISFSI	<0.1	<0.1	W
SFDR13	SSW of ISFSI	<0.1	<0.1	SSW
SFDR14	SSE of ISFSI	0.1	<0.1	SSE
SFDR15	ENE of ISFSI	<0.1	<0.1	ENE
SFDR16	WSW of ISFSI	<0.1	<0.1	WSW
DR7 ²	On Site before Entrance to Camp Conoy	0.7	0.4	SE
DR30	Meteorological Station	0.4	0.2	NW
SFb1	Meteorological Station	0.4	0.2	NW
SFb2	CCNPP Visitor's Center	0.7	0.4	NNE
SFb3	NNW of ISFSI	0.1	<0.1	NNW
SFb4	South of ISFSI	0.1	<0.1	S
SFb5	On Site before Entrance to Camp Conoy	0.7	0.4	SE
SFS1	Meteorological Station	0.4	0.2	NW
SFS2	CCNPP Visitor's Center	0.7	0.4	NNE
SFS3	NNW of ISFSI	0.1	<0.1	NNW
SFS4	South of ISFSI	0.1	<0.1	S
SFS5	On Site before Entrance to Camp Conoy	0.7	<0.1	SE

¹ Distance and direction from the central point between the two containment buildings.

² Common to both the REMP and ISFSI monitoring program

FIGURE A-4
Independent Spent Fuel Storage Installation Sampling Locations


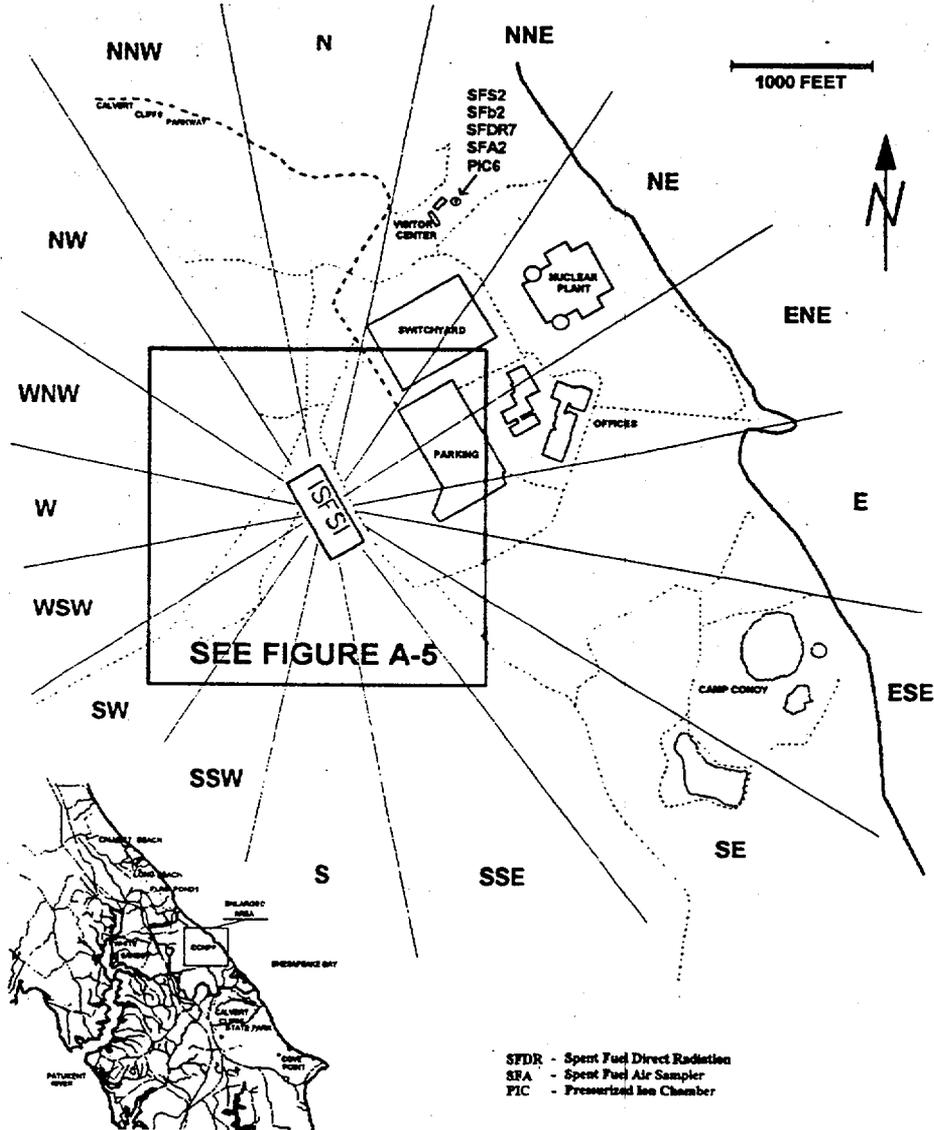


FIGURE A-5
Enlarged Map of the Independent Spent Fuel Storage Installation
Sampling Locations

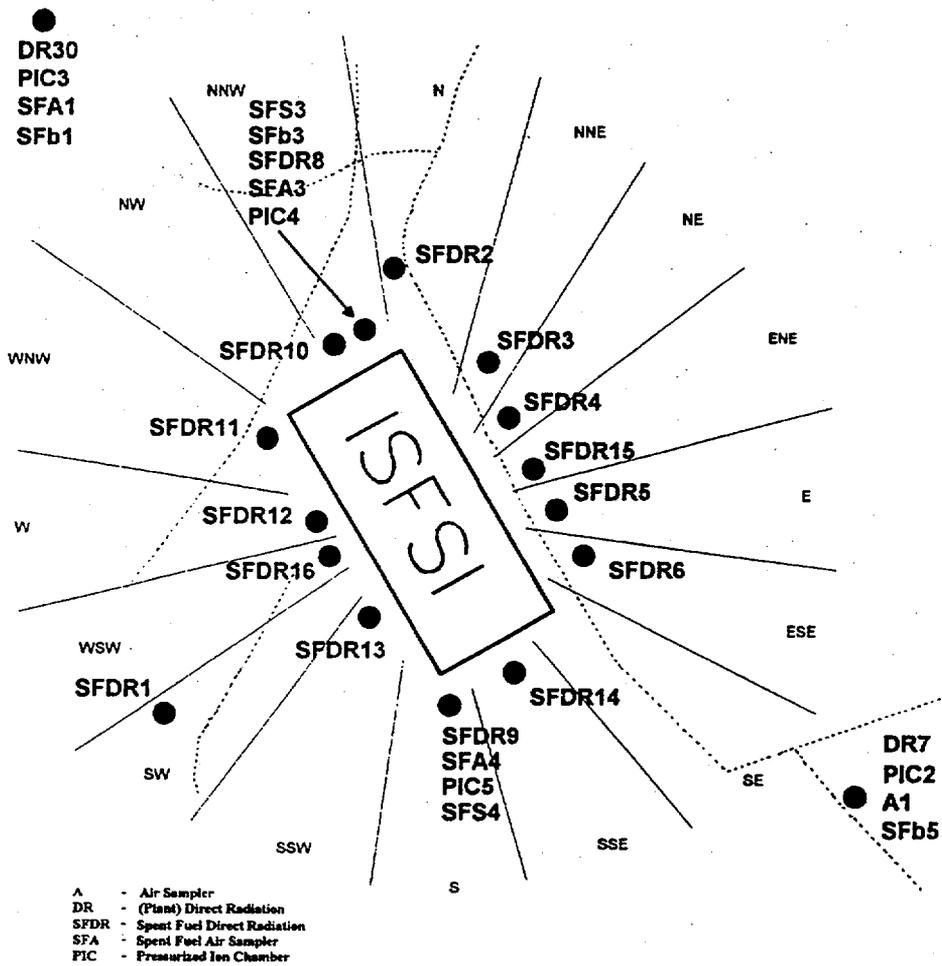

(LEFT BLANK)

APPENDIX B

Appendix B is a presentation of the analytical results of the 2001 Calvert Cliffs Nuclear Power Plant and the Independent Spent Fuel Storage Installation environmental monitoring programs.

(LEFT BLANK)

TABLE OF CONTENTS - ANALYTICAL RESULTS

Table	Title	Page
B-1	Concentration of Tritium and Gamma Emitters in Bay Water	50
B-2	Concentration of Gamma Emitters in the Flesh of Edible Fish	51
B-3	Concentration of Gamma Emitters in Oyster Samples	52
B-4	Concentration of Gamma Emitters in Shoreline Sediment.....	53
B-5	Concentration of Iodine-131 in Filtered Air	54
B-6	Concentration of Beta Emitters in Air Particulates.....	56
B-7	Concentration of Gamma Emitters in Air Particulates	60
B-8a	Concentration of Gamma Emitters in Vegetation Samples	61
B-8b	Concentration of Gamma Emitters in Vegetation From Locations Around the IFSFI.....	63
B-9	Concentration of Gamma Emitters in Soil Samples From Locations Around the ISFSI	64
B-10	Typical MDA Ranges for Gamma Spectrometry	65
B-11	Typical LLDs for Gamma Spectrometry	66
B-12	Direct Radiation	67

Table B-1

**Concentration of Tritium and Gamma Emitters in Bay Water
(Results in units of pCi/L \pm 2 σ)**

Sample Code	Sample Date	H-3 ¹	Gamma Emitters
Wa1 Intake Vicinity	01/15/2001		*2
	02/15/2001		*
	03/15/2001		*
	03/31/2001	107 \pm 37	
	04/15/2001		*
	05/15/2001		*
	06/15/2001		*
	06/30/2001	<40	
	07/15/2001		*
	08/15/2001		*
	09/28/2001		*
	09/30/2001	86 \pm 38	
	10/29/2001		*
	11/28/2001		*
12/28/2001		*	
	12/31/2001	95 \pm 37	
Wa2 Discharge Vicinity	01/15/2001		*
	02/15/2001		*
	03/15/2001		*
	03/31/2001	685 \pm 43	
	04/15/2001		*
	05/15/2001		*
	06/15/2001		*
	06/30/2001	192 \pm 39	
	07/15/2001		*
	08/15/2001		*
	09/28/2001		*
	09/30/2001	509 \pm 43	
	10/29/2001		*
	11/28/2001		*
12/28/2001		*	
	12/31/2001	233 \pm 39	

¹ Quarterly composite of monthly samples

² * Non-Natural Gamma Emitters <MDA

Table B-2

**Concentration of Gamma Emitters in the Flesh of Edible Fish
(Results in units of pCi/kg (wet) $\pm 2\sigma$)**

Sample Code	Sample Date	Sample Type	Gamma Emitters
la1 Discharge Area	08/08/2001	Spot	*
la2 Discharge Area	08/08/2001	Croaker	*
la4 ¹ Patuxent River	08/01/2001	Spot	*
la5 ¹ Patuxent River	08/01/2001	Croaker	*

* Non-Natural Gamma Emitters < MDA

¹ Control Location

Table B-3

**Concentration of Gamma Emitters in Oyster Samples
(Results in units of pCi/kg (wet) $\pm 2\sigma$)**

Sample Code	Sample Date	Ag-110m	Gamma Emitters
la3	03/29/2001	1	*
Camp Conoy	06/13/2001	46 \pm 10	*
	08/02/2001	95 \pm 12	*
	10/10/2001	71 \pm 11	*
la6 ²	03/29/2001	1	*
Kenwood	06/13/2001	1	*
Beach	08/02/2001	1	*
	10/10/2001	1	*

* Non-Natural Gamma Emitters < MDA

¹ This Isotope < MDA

² Control Location

Table B-4

**Concentration of Gamma Emitters in Shoreline Sediment
(Results in units of pCi/kg (dry) $\pm 2\sigma$)**

Sample Code	Sample Date	Gamma Emitters
Wb1 Shoreline at Barge Rd.	04/09/2001	¹
	10/08/2001	¹

¹ Non-Natural Gamma Emitters <MDA

Table B-5

**Concentration of Iodine-131 in Filtered Air
(Results in units of 10^{-3} pCi/m³ \pm 2 σ)**

Start Date	Stop Date	A1 Entrance to Camp Conoy	A2 Camp Conoy Siren	A3 Bay Breeze Rd	A4 Route 765 at Lusby	A5 ¹ EOF
01/02/2001	01/08/2001	*	*	*	*	*
01/08/2001	01/15/2001	*	*	*	*	*
01/15/2001	01/22/2001	*	*	*	*	*
01/22/2001	01/29/2001	*	*	*	*	*
01/29/2001	02/05/2001	*	*	*	*	*
02/05/2001	02/12/2001	*	*	*	*	*
02/12/2001	02/20/2001	*	*	*	*	*
02/20/2001	02/26/2001	*	*	*	*	*
02/26/2001	03/05/2001	*	*	*	*	*
03/05/2001	03/12/2001	*	*	*	*	*
03/12/2001	03/19/2001	*	*	*	*	*
03/19/2001	03/26/2001	*	*	*	*	*
03/26/2001	04/02/2001	*	*	*	*	*
04/02/2001	04/09/2001	*	*	*	*	*
04/09/2001	04/16/2001	*	*	*	*	*
04/16/2001	04/23/2001	*	*	*	*	*
04/23/2001	04/30/2001	*	*	*	*	*
04/30/2001	05/07/2001	*	*	*	*	*
05/07/2001	05/14/2001	*	*	*	*	*
05/14/2001	05/21/2001	*	*	*	*	*
05/21/2001	05/29/2001	*	*	*	*	*
05/29/2001	06/04/2001	*	*	*	*	*
06/04/2001	06/11/2001	*	*	*	*	*
06/11/2001	06/18/2001	*	*	*	*	*
06/18/2001	06/25/2001	*	*	*	*	*
06/25/2001	07/02/2001	*	*	*	*	*
07/02/2001	07/09/2001	*	*	*	*	*
07/09/2001	07/16/2001	*	*	*	*	*
07/16/2001	07/23/2001	*	*	*	*	*
07/23/2001	07/30/2001	*	*	*	*	*
07/30/2001	08/06/2001	*	*	*	*	*
08/06/2001	08/13/2001	*	*	*	*	*
08/13/2001	08/20/2001	*	*	*	*	*
08/20/2001	08/27/2001	*	*	*	*	*

* < MDA

¹ Control Location

Table B-5 - Continued

**Concentration of Iodine-131 in Filtered Air
(Results in units of 10^{-3} pCi/m³ \pm 2 σ)**

Start Date	Stop Date	A1 Entrance to Camp Conoy	A2 Camp Conoy Siren	A3 Bay Breeze Rd	A4 Route 765 at Lusby	A5 ¹ EOF
08/27/2001	09/04/2001	*	*	*	*	*
09/04/2001	09/10/2001	*	*	*	*	*
09/10/2001	09/17/2001	*	*	*	*	*
09/17/2001	09/24/2001	*	*	*	*	*
09/24/2001	10/01/2001	*	*	*	*	*
10/01/2001	10/08/2001	*	*	*	*	*
10/08/2001	10/15/2001	*	*	*	*	*
10/15/2001	10/22/2001	*	*	*	*	*
10/22/2001	10/29/2001	*	*	*	*	*
10/29/2001	11/05/2001	*	*	*	*	*
11/05/2001	11/12/2001	*	*	*	*	*
11/12/2001	11/19/2001	*	*	*	*	*
11/19/2001	11/26/2001	*	*	*	*	*
11/26/2001	12/03/2001	*	*	*	*	*
12/03/2001	12/10/2001	*	*	*	*	*
12/10/2001	12/17/2001	*	*	*	*	*
12/17/2001	12/26/2001	*	*	*	*	*
12/26/2001	12/31/2001	*	*	*	*	*

* < MDA

¹ Control Location

Table B-6

**Concentration of Beta Emitters in Air Particulates
(Results in units of 10^{-2} pCi/m³ \pm 2 σ)**

Start Date	Stop Date	A1 Entrance to Camp Conoy	A2 Camp Conoy Siren	A3 Bay Breeze Rd	A4 Route 765 at Lusby	A5 ¹ EOF
01/02/2001	01/08/2001	1.5 \pm 0.2	1.9 \pm 0.2	1.5 \pm 0.2	1.4 \pm 0.2	1.9 \pm 0.3
01/08/2001	01/15/2001	1.8 \pm 0.2	1.8 \pm 0.2	1.5 \pm 0.2	1.6 \pm 0.2	2.1 \pm 0.2
01/15/2001	01/22/2001	1.0 \pm 0.2	1.4 \pm 0.2	1.2 \pm 0.2	1.3 \pm 0.2	1.4 \pm 0.2
01/22/2001	01/29/2001	2.4 \pm 0.2	2.5 \pm 0.2	2.3 \pm 0.2	2.4 \pm 0.2	2.6 \pm 0.2
01/29/2001	02/05/2001	1.6 \pm 0.2	1.6 \pm 0.2	1.2 \pm 0.2	1.3 \pm 0.2	2.5 \pm 0.3
02/05/2001	02/12/2001	1.8 \pm 0.2	1.8 \pm 0.2	1.7 \pm 0.2	1.6 \pm 0.2	1.9 \pm 0.2
02/12/2001	02/20/2001	2.0 \pm 0.2	1.7 \pm 0.2	1.8 \pm 0.2	1.8 \pm 0.2	2.2 \pm 0.2
02/20/2001	02/26/2001	1.8 \pm 0.2	1.8 \pm 0.2	1.6 \pm 0.2	1.8 \pm 0.2	2.1 \pm 0.2
02/26/2001	03/05/2001	1.3 \pm 0.2	1.5 \pm 0.2	1.6 \pm 0.2	1.4 \pm 0.2	2.2 \pm 0.2
03/05/2001	03/12/2001	1.1 \pm 0.2	1.1 \pm 0.2	1.1 \pm 0.2	1.3 \pm 0.2	1.3 \pm 0.2
03/12/2001	03/19/2001	0.9 \pm 0.2	1.1 \pm 0.2	1.0 \pm 0.2	1.0 \pm 0.2	1.2 \pm 0.2
03/19/2001	03/26/2001	1.2 \pm 0.2	1.4 \pm 0.2	2.1 \pm 0.3	1.2 \pm 0.2	1.7 \pm 0.2
03/26/2001	04/02/2001	0.7 \pm 0.2	0.8 \pm 0.2	1.2 \pm 0.2	0.8 \pm 0.2	0.9 \pm 0.2
04/02/2001	04/09/2001	1.2 \pm 0.2	1.3 \pm 0.2	1.4 \pm 0.2	1.2 \pm 0.2	1.7 \pm 0.4
04/09/2001	04/16/2001	1.4 \pm 0.2	1.3 \pm 0.2	1.3 \pm 0.2	1.4 \pm 0.2	1.7 \pm 0.2
04/16/2001	04/23/2001	1.8 \pm 0.2	1.8 \pm 0.2	1.7 \pm 0.2	1.7 \pm 0.2	2.1 \pm 0.2
04/23/2001	04/30/2001	1.6 \pm 0.2	1.8 \pm 0.2	0.9 \pm 0.2	1.4 \pm 0.2	2.1 \pm 0.2
04/30/2001	05/07/2001	1.6 \pm 0.2	1.4 \pm 0.2	1.4 \pm 0.2	1.7 \pm 0.2	2.2 \pm 0.2
05/07/2001	05/14/2001	1.5 \pm 0.2	1.2 \pm 0.2	1.0 \pm 0.2	1.6 \pm 0.2	1.8 \pm 0.2
05/14/2001	05/21/2001	0.8 \pm 0.2	0.8 \pm 0.2	0.7 \pm 0.2	0.6 \pm 0.2	1.2 \pm 0.2
05/21/2001	05/29/2001	1.4 \pm 0.3	0.7 \pm 0.2	0.6 \pm 0.1	0.7 \pm 0.1	1.4 \pm 0.2
05/29/2001	06/04/2001	1.0 \pm 0.2	0.8 \pm 0.2	0.6 \pm 0.2	0.9 \pm 0.2	1.3 \pm 0.2
06/04/2001	06/11/2001	1.4 \pm 0.2	0.9 \pm 0.2	0.6 \pm 0.2	1.2 \pm 0.2	1.6 \pm 0.2
06/11/2001	06/18/2001	1.4 \pm 0.2	1.1 \pm 0.2	0.6 \pm 0.2	1.4 \pm 0.2	2.1 \pm 0.2
06/18/2001	06/25/2001	1.5 \pm 0.2	1.0 \pm 0.2	0.5 \pm 0.2	1.4 \pm 0.2	1.9 \pm 0.2
06/25/2001	07/02/2001	1.4 \pm 0.2	1.1 \pm 0.2	0.5 \pm 0.2	0.9 \pm 0.2	1.9 \pm 0.2
07/02/2001	07/09/2001	0.8 \pm 0.2	0.8 \pm 0.2	0.8 \pm 0.2	1.1 \pm 0.2	1.3 \pm 0.2
07/09/2001	07/16/2001	1.4 \pm 0.2	1.3 \pm 0.2	0.7 \pm 0.2	1.4 \pm 0.2	1.8 \pm 0.2
07/16/2001	07/23/2001	1.5 \pm 0.2	1.9 \pm 0.2	0.7 \pm 0.2	1.4 \pm 0.2	2.0 \pm 0.3
07/23/2001	07/30/2001	0.7 \pm 0.2	0.8 \pm 0.2	0.6 \pm 0.2	1.0 \pm 0.2	1.0 \pm 0.2
07/30/2001	08/06/2001	1.4 \pm 0.2	0.9 \pm 0.2	0.4 \pm 0.2	1.4 \pm 0.2	1.5 \pm 0.2
08/06/2001	08/13/2001	2.0 \pm 0.2	1.9 \pm 0.2	2.3 \pm 0.2	2.2 \pm 0.2	2.1 \pm 0.2
08/13/2001	08/20/2001	1.8 \pm 0.2	1.6 \pm 0.2	1.8 \pm 0.2	2.0 \pm 0.2	2.7 \pm 0.3
08/20/2001	08/27/2001	1.9 \pm 0.2	1.8 \pm 0.2	1.5 \pm 0.2	1.4 \pm 0.2	2.5 \pm 0.2

¹ Control Location

Table B-6 - Continued

**Concentration of Beta Emitters in Air Particulates
(Results in units of 10^{-2} pCi/m³ \pm 2 σ)**

Start Date	Stop Date	A1 Entrance to Camp Conoy	A2 Camp Conoy Siren	A3 Bay Breeze Rd	A4 Route 765 at Lusby	A5 ¹ EOF
08/27/2001	09/04/2001	1.8 \pm 0.2	1.8 \pm 0.2	1.6 \pm 0.2	1.7 \pm 0.2	2.6 \pm 0.2
09/04/2001	09/10/2001	1.4 \pm 0.2	1.5 \pm 0.2	1.4 \pm 0.2	1.6 \pm 0.2	2.2 \pm 0.3
09/10/2001	09/17/2001	1.4 \pm 0.2	1.5 \pm 0.2	1.3 \pm 0.2	1.6 \pm 0.2	2.2 \pm 0.2
09/17/2001	09/24/2001	1.9 \pm 0.2	1.5 \pm 0.2	1.4 \pm 0.2	1.9 \pm 0.2	2.7 \pm 0.3
09/24/2001	10/01/2001	1.2 \pm 0.2	1.2 \pm 0.2	0.8 \pm 0.1	1.1 \pm 0.2	2.0 \pm 0.2
10/01/2001	10/08/2001	2.6 \pm 0.2	2.3 \pm 0.2	1.9 \pm 0.2	2.1 \pm 0.2	2.7 \pm 0.3
10/08/2001	10/15/2001	0.8 \pm 0.2	1.3 \pm 0.2	0.7 \pm 0.2	1.3 \pm 0.2	1.5 \pm 0.2
10/15/2001	10/22/2001	1.4 \pm 0.2	1.3 \pm 0.2	1.7 \pm 0.2	1.5 \pm 0.2	1.6 \pm 0.2
10/22/2001	10/29/2001	1.5 \pm 0.2	1.3 \pm 0.2	1.6 \pm 0.2	1.4 \pm 0.2	0.9 \pm 0.2
10/29/2001	11/05/2001	2.1 \pm 0.2	1.9 \pm 0.2	2.2 \pm 0.2	2.2 \pm 0.2	2.2 \pm 0.2
11/05/2001	11/12/2001	2.1 \pm 0.2	2.0 \pm 0.2	2.3 \pm 0.2	2.3 \pm 0.2	2.1 \pm 0.2
11/12/2001	11/19/2001	2.7 \pm 0.2	2.6 \pm 0.2	2.8 \pm 0.2	2.6 \pm 0.2	3.0 \pm 0.2
11/19/2001	11/26/2001	1.6 \pm 0.2	1.7 \pm 0.2	1.7 \pm 0.2	1.5 \pm 0.2	1.7 \pm 0.2
11/26/2001	12/03/2001	2.1 \pm 0.2	1.2 \pm 0.1	2.2 \pm 0.2	2.2 \pm 0.2	2.2 \pm 0.2
12/03/2001	12/10/2001	2.8 \pm 0.2	2.9 \pm 0.3	2.5 \pm 0.2	2.7 \pm 0.3	2.5 \pm 0.2
12/10/2001	12/17/2001	2.2 \pm 0.2	2.5 \pm 0.3	1.1 \pm 0.2	2.0 \pm 0.2	1.7 \pm 0.2
12/17/2001	12/26/2001	1.9 \pm 0.2	2.1 \pm 0.2	1.9 \pm 0.2	1.8 \pm 0.2	2.1 \pm 0.2
12/26/2001	12/31/2001	2.7 \pm 0.3	3.0 \pm 0.3	2.8 \pm 0.3	2.8 \pm 0.3	2.8 \pm 0.3

¹ Control Location

Table B-6 - Continued

Concentration of Beta Emitters in Air Particulates
(Results in units of 10^{-2} pCi/m³ \pm 2 σ)

Start Date	Stop Date	SFA1 MET Station	SFA2 Visitors Center	SFA3 NNW of ISFSI	SFA4 South of ISFSI
01/02/2001	01/08/2001	1.6 \pm 0.2	1.5 \pm 0.2	1.7 \pm 0.2	1.7 \pm 0.2
01/08/2001	01/15/2001	1.9 \pm 0.2	1.7 \pm 0.2	1.7 \pm 0.2	2.0 \pm 0.2
01/15/2001	01/22/2001	1.4 \pm 0.2	1.3 \pm 0.2	1.3 \pm 0.2	1.3 \pm 0.2
01/22/2001	01/29/2001	2.6 \pm 0.2	2.6 \pm 0.2	2.6 \pm 0.2	2.6 \pm 0.2
01/29/2001	02/05/2001	1.6 \pm 0.2	2.0 \pm 0.2	1.6 \pm 0.2	1.7 \pm 0.2
02/05/2001	02/12/2001	1.8 \pm 0.2	1.7 \pm 0.2	1.7 \pm 0.2	1.9 \pm 0.2
02/12/2001	02/20/2001	1.9 \pm 0.2	2.0 \pm 0.2	2.0 \pm 0.2	2.1 \pm 0.2
02/20/2001	02/26/2001	1.8 \pm 0.2	1.8 \pm 0.2	1.9 \pm 0.2	2.2 \pm 0.2
02/26/2001	03/05/2001	1.5 \pm 0.2	1.2 \pm 0.2	1.5 \pm 0.2	1.6 \pm 0.2
03/05/2001	03/12/2001	1.2 \pm 0.2	1.1 \pm 0.2	1.2 \pm 0.2	1.4 \pm 0.2
03/12/2001	03/19/2001	1.1 \pm 0.2	1.0 \pm 0.2	1.1 \pm 0.2	1.2 \pm 0.2
03/19/2001	03/26/2001	1.4 \pm 0.2	1.5 \pm 0.2	1.5 \pm 0.2	1.4 \pm 0.2
03/26/2001	04/02/2001	0.9 \pm 0.2	0.8 \pm 0.2	0.8 \pm 0.2	0.8 \pm 0.2
04/02/2001	04/09/2001	1.3 \pm 0.2	1.2 \pm 0.2	1.2 \pm 0.2	1.3 \pm 0.2
04/09/2001	04/16/2001	1.3 \pm 0.2	1.4 \pm 0.2	¹	1.5 \pm 0.2
04/16/2001	04/23/2001	1.8 \pm 0.2	1.8 \pm 0.2	2.1 \pm 0.2	2.4 \pm 0.2
04/23/2001	04/30/2001	1.9 \pm 0.3	1.6 \pm 0.2	1.8 \pm 0.2	1.7 \pm 0.2
04/30/2001	05/07/2001	1.7 \pm 0.2	1.9 \pm 0.3	2.2 \pm 0.2	2.1 \pm 0.2
05/07/2001	05/14/2001	1.5 \pm 0.2	1.8 \pm 0.2	1.8 \pm 0.2	1.9 \pm 0.2
05/14/2001	05/21/2001	0.7 \pm 0.1	1.0 \pm 0.2	0.7 \pm 0.2	0.9 \pm 0.2
05/21/2001	05/29/2001	0.9 \pm 0.1	0.9 \pm 0.1	1.0 \pm 0.2	1.0 \pm 0.2
05/29/2001	06/04/2001	1.0 \pm 0.2	1.0 \pm 0.2	1.3 \pm 0.2	1.2 \pm 0.2
06/04/2001	06/11/2001	1.3 \pm 0.1	1.6 \pm 0.2	1.6 \pm 0.2	1.5 \pm 0.2
06/11/2001	06/18/2001	1.2 \pm 0.2	1.2 \pm 0.2	1.6 \pm 0.2	1.5 \pm 0.2
06/18/2001	06/25/2001	1.3 \pm 0.1	1.4 \pm 0.2	1.6 \pm 0.2	1.5 \pm 0.2
06/25/2001	07/02/2001	1.2 \pm 0.2	1.4 \pm 0.2	1.5 \pm 0.4	1.0 \pm 0.2
07/02/2001	07/09/2001	0.9 \pm 0.1	0.8 \pm 0.2	1.0 \pm 0.2	0.9 \pm 0.2
07/09/2001	07/16/2001	1.3 \pm 0.2	1.7 \pm 0.2	1.7 \pm 0.2	1.3 \pm 0.2
07/16/2001	07/23/2001	1.4 \pm 0.2	1.6 \pm 0.2	1.7 \pm 0.2	1.4 \pm 0.2
07/23/2001	07/30/2001	0.8 \pm 0.1	0.8 \pm 0.2	0.8 \pm 0.2	0.8 \pm 0.2
07/30/2001	08/06/2001	1.4 \pm 0.2	1.5 \pm 0.2	1.7 \pm 0.2	1.4 \pm 0.2
08/06/2001	08/13/2001	1.5 \pm 0.2	1.6 \pm 0.2	2.1 \pm 0.2	2.8 \pm 0.2
08/13/2001	08/20/2001	2.0 \pm 0.2	2.2 \pm 0.2	2.2 \pm 0.2	2.1 \pm 0.2
08/20/2001	08/27/2001	1.8 \pm 0.2	1.9 \pm 0.2	2.1 \pm 0.2	1.6 \pm 0.2

¹ Sampler malfunction

Table B-6 - Continued

**Concentration of Beta Emitters in Air Particulates
(Results in units of 10^{-2} pCi/m³ \pm 2 σ)**

Start Date	Stop Date	SFA1 MET Station	SFA2 Visitors Center	SFA3 NNW of ISFSI	SFA4 South of ISFSI
08/27/2001	09/04/2001	1.9 \pm 0.2	2.0 \pm 0.2	2.2 \pm 0.2	1.9 \pm 0.2
09/04/2001	09/10/2001	1.7 \pm 0.2	1.9 \pm 0.2	1.9 \pm 0.2	1.7 \pm 0.2
09/10/2001	09/17/2001	2.2 \pm 0.2	1.7 \pm 0.2	1.9 \pm 0.2	1.6 \pm 0.2
09/17/2001	09/24/2001	4.0 \pm 0.4	1.9 \pm 0.2	2.7 \pm 0.3	2.1 \pm 0.2
09/24/2001	10/01/2001	2.6 \pm 0.3	1.3 \pm 0.2	1.7 \pm 0.2	1.2 \pm 0.2
10/01/2001	10/08/2001	3.2 \pm 0.3	2.4 \pm 0.2	2.8 \pm 0.2	2.9 \pm 0.2
10/08/2001	10/15/2001	1.6 \pm 0.2	1.3 \pm 0.2	1.4 \pm 0.2	1.2 \pm 0.2
10/15/2001	10/22/2001	2.5 \pm 0.3	1.7 \pm 0.2	1.9 \pm 0.2	1.6 \pm 0.2
10/22/2001	10/29/2001	1.4 \pm 0.2	1.4 \pm 0.2	1.6 \pm 0.2	1.3 \pm 0.2
10/29/2001	11/05/2001	2.1 \pm 0.2	2.1 \pm 0.2	2.2 \pm 0.2	2.2 \pm 0.2
11/05/2001	11/12/2001	2.2 \pm 0.2	2.2 \pm 0.2	2.1 \pm 0.2	2.3 \pm 0.2
11/12/2001	11/19/2001	2.5 \pm 0.2	2.3 \pm 0.2	2.4 \pm 0.2	2.6 \pm 0.2
11/19/2001	11/26/2001	1.5 \pm 0.2	1.4 \pm 0.2	1.7 \pm 0.2	1.6 \pm 0.2
11/26/2001	12/03/2001	1.9 \pm 0.2	2.2 \pm 0.2	2.2 \pm 0.2	2.3 \pm 0.2
12/03/2001	12/10/2001	2.0 \pm 0.2	2.2 \pm 0.2	2.7 \pm 0.2	1.9 \pm 0.2
12/10/2001	12/17/2001	1.9 \pm 0.2	1.9 \pm 0.2	1.9 \pm 0.2	2.1 \pm 0.2
12/17/2001	12/26/2001	1.5 \pm 0.2	1.8 \pm 0.2	1.7 \pm 0.2	2.0 \pm 0.2
12/26/2001	12/31/2001	2.5 \pm 0.3	2.5 \pm 0.3	2.5 \pm 0.3	3.0 \pm 0.3

Table B-7

**Concentration of Gamma Emitters in Air Particulates
(Results in units of 10^{-3} pCi/m³ \pm 2 σ)**

Sample Date	A1 Entrance to Camp Conoy	A2 Camp Conoy Siren	A3 Bay Breeze Rd	A4 Route 765 at Lusby	A5 ¹ EOF
01/15/2001	*	*	*	*	*
02/15/2001	*	*	*	*	*
03/15/2001	*	*	*	*	*
04/15/2001	*	*	*	*	*
05/15/2001	*	*	*	*	*
06/15/2001	*	*	*	*	*
07/15/2001	*	*	*	*	*
08/15/2001	*	*	*	*	*
09/15/2001	*	*	*	*	*
10/15/2001	*	*	*	*	*
11/15/2001	*	*	*	*	*
12/15/2001	*	*	*	*	*

Sample Date	SFA1 MET Station	SFA2 ¹ Visitors Center	SFA3 NNW of ISFSI	SFA4 South of ISFSI
01/15/2001	*	*	*	*
02/15/2001	*	*	*	*
03/15/2001	*	*	*	*
04/15/2001	*	*	*	*
05/15/2001	*	*	*	*
06/15/2001	*	*	*	*
07/15/2001	*	*	*	*
08/15/2001	*	*	*	*
09/15/2001	*	*	*	*
10/15/2001	*	*	*	*
11/15/2001	*	*	*	*
12/15/2001	*	*	*	*

¹ Control Location

* Non-Natural Gamma Emitters < MDA

Table B-8a

**Concentration of Gamma Emitters in Vegetation Samples
(Results in units of pCi/kg (wet) $\pm 2\sigma$)**

Sample Code	Sample Date	Sample Type	Gamma Emitters
Ib1 Bay Breeze Rd	06/28/2001	Collards	*
	07/30/2001	Collards	*
	08/27/2001	Collards	*
	10/01/2001	Collards	*
Ib2 Bay Breeze Rd	06/28/2001	Cabbage	*
	07/30/2001	Cabbage	*
	08/27/2001	Cabbage	*
	10/01/2001	Cabbage	*
Ib3 Bay Breeze Rd	06/28/2001	Cauliflower	*
	07/30/2001	Brussels sprouts	*
	08/27/2001	Brussels sprouts	*
	10/01/2001	Brussels sprouts	*
Ib4 Camp Conoy Entrance	06/28/2001	Collards	*
	07/30/2001	Collards	*
	08/27/2001	Collards	*
	10/01/2001	Collards	*
Ib5 Camp Conoy Entrance	06/28/2001	Cabbage	*
	07/30/2001	Cabbage	*
	08/27/2001	Cabbage	*
	10/01/2001	Cabbage	*
Ib6 Camp Conoy Entrance	06/28/2001	Cauliflower	*
	07/30/2001	Brussels sprouts	*
	08/27/2001	Brussels sprouts	*
	10/01/2001	Brussels sprouts	*
Ib7 ¹ EOF	06/28/2001	Collards	*
	07/30/2001	Collards	*
	08/27/2001	Collards	*
	10/01/2001	Collards	*

* Non-Natural Gamma Emitters < MDA

¹ Control Location

Table B-8a - Continued

Concentration of Gamma Emitters in Vegetation Samples
(Results in units of pCi/kg (wet) $\pm 2\sigma$)

Sample Code	Sample Date	Sample Type	Gamma Emitters
lb8 ¹	06/28/2001	Cabbage	*
EOF	07/30/2001	Cabbage	*
	08/27/2001	Cabbage	*
	10/01/2001	Cabbage	*
lb9 ¹	06/28/2001	Cauliflower	*
EOF	07/30/2001	Brussels sprouts	*
	08/27/2001	Brussels sprouts	*
	10/01/2001	Brussels sprouts	*

* Non-Natural Gamma Emitters < MDA

¹ Control Location

Table B-8b

**Concentration of Gamma Emitters in Vegetation
From Locations Around the ISFSI
(Results in units of pCi/kg (wet) $\pm 2\sigma$)**

Sample Code	Sample Date	Cs-137	Gamma Emitters
SFb1 MET Station	03/12/2001	1	*
	06/04/2001	1	*
	09/24/2001	1	*
	11/19/2001	1	*
SFb2 ² Visitor's Center	03/12/2001	1	*
	06/04/2001	1	*
	09/24/2001	1	*
	11/19/2001	1	*
SFb3 NNW of ISFSI	03/12/2001	1	*
	06/04/2001	1	*
	09/24/2001	1	*
	11/19/2001	1	*
SFb4 South of ISFSI	03/12/2001	1	*
	06/04/2001	1	*
	09/24/2001	1	*
	11/19/2001	1	*
SFb5 On Site before Entrance to Camp Conoy	03/12/2001	21 \pm 12	*
	06/04/2001	1	*
	09/24/2001	1	*
	11/19/2001	1	*

* Non-Natural Gamma Emitters < MDA

¹ This Isotope < MDA

² Control Location

Table B-9

**Concentration of Gamma Emitters in Soil Samples
From Locations Around the ISFSI
(Results in units of pCi/kg (dry) $\pm 2\sigma$)**

Sample Code	Sample Date	Co-60	Cs-137	Gamma Emitters
SFS1 MET station	03/12/2001	31 \pm 17	1	*
	06/04/2001	1	1	*
	09/24/2001	1	1	*
	11/19/2001	1	1	*
SFS2 ² Visitors Center	03/12/2001	1	103 \pm 48	*
	06/04/2001	1	148 \pm 39	*
	09/24/2001	1	151 \pm 32	*
	11/19/2001	1	110 \pm 43	*
SFS3 NNW of ISFSI	03/12/2001	1	1	*
	06/04/2001	1	140 \pm 30	*
	09/24/2001	1	78 \pm 38	*
	11/19/2001	1	809 \pm 62	*
SFS4 South of ISFSI	03/12/2001	1	1	*
	06/04/2001	1	1	*
	09/24/2001	1	47 \pm 26	*
	11/19/2001	1	1	*
SFS5 Entrance to Camp Conoy	03/12/2001	1	600 \pm 56	*
	06/04/2001	1	447 \pm 36	*
	09/24/2001	1	343 \pm 37	*
	11/19/2001	1	209 \pm 31	*

¹ This Isotope < MDA

² Control Location

* Non-Natural Gamma Emitters <MDA

TABLE B-10
Typical MDA Ranges for Gamma Spectrometry

Selected Nuclides	Bay Water pCi/l	Fish pCi/kg	Shellfish pCi/kg	Shoreline pCi/kg	Vegetation pCi/kg	Soil pCi/kg	Particulates 10 ⁻³ pCi/m ³
Na-22	1.6 – 3.8	21 – 29	18 – 30	28 – 29	16 – 37	33 – 95	1.3 – 3.4
Cr-51	12 – 40	160 - 166	118 - 176	208 - 213	14 - 164	203 - 486	13 – 39
Mn-54	1.4 - 3.2	16 – 20	15 – 22	26 – 30	13 – 28	32 – 81	1.2 – 6.2
Co-58	1.5 - 4.0	20 – 23	16 - 26	28 – 32	13 – 26	28 – 79	1.4 – 3.4
Fe-59	3.5 – 11	53 – 74	36 – 65	60 – 77	28 – 69	65 - 174	3.7 – 8.2
Co-60	1.5 - 3.7	18 – 25	18 – 26	27 – 39	15 – 35	23 - 97	1.3 - 3.3
Zn-65	3.3 – 7.9	46 – 62	36 – 57	69 – 97	32 – 73	67 - 238	3.0 – 6.9
Nb-95	1.7 – 5.8	25 – 31	20 – 35	34 – 40	13 – 27	34 – 93	2.1 – 5.0
Zr-95	2.8 - 6.9	35 – 44	29 – 43	45 – 62	21 – 48	53 - 141	2.1 – 6.4
Ru-106	12 – 26	131-149	124 - 185	224 - 287	108 - 239	264 - 643	10 - 25
Ag-110m	1.2 – 2.9	15 – 18	15 – 18	21 – 31	11 – 25	29 – 88	0.1 - 2.6
Te-129m	18 – 60	247 - 280	192 - 284	321 - 367	135 - 281	346 - 855	19 – 55
I-131	2.4 - 49	99 - 121	30 – 89	50 – 52	11 – 37	32.7 – 179	¹
Cs-134	1.2 - 2.6	14 – 17	13 – 19	24 – 34.5	11 – 24	27 – 94	1.0 – 2.4
Cs-137	1.2 – 3.0	15 - 18	15 – 34	25 – 30	1.5 – 26	27 - 72	1.0 – 2.8
Ba-140	7.3 – 66	174 - 208	75 - 184	138 - 150	41 - 109	112 - 430	12 – 84
La-140	3.2 – 29	-	49 – 74	75 – 75	17 – 51	60 – 138	8.7 – 19
Ce-144	7.1 – 12	45 – 49	42 – 49	101 - 111	49 – 86	110 - 245	2.8 – 8.2

¹ The MDA range for I-131 on a silver zeolite cartridge is typically 4.16×10^{-3} to 3.40×10^{-2}

TABLE B-11
Typical LLDs for Gamma Spectrometry

Selected Nuclides	Bay Water pCi/l	Fish pCi/kg	Shellfish pCi/kg	Sediment pCi/kg	Particulate 10 ⁻³ pCi/m ³	Precipitation pCi/l	Vegetation pCi/Kg	Soil pCi/Kg	Well Water pCi/l
Na-22	2.9	22	22	24	2.9	2.9	35	24	2.9
Cr-51	17	88	88	110	12	17	162	110	17
Mn-54	2.4	17	17	18	2.1	2.4	27	18	2.4
Co-58	2.4	16	16	17	2.0	2.4	25	17	2.4
Fe-59	5.2	37	37	38	4.6	5.2	60	38	5.2
Co-60	2.8	22	22	21	2.7	2.8	33	21	2.8
Zn-65	5.6	23	23	54	2.8	5.6	66	54	5.6
Nb-95	2.2	15	15	18	1.9	2.2	25	18	2.2
Zr-95	3.8	27	27	29	3.3	3.8	44	29	3.8
Ru-106	20	135	135	146	17	20	223	146	20
Ag-110m	2.1	14	14	16	1.8	2.1	25	16	2.1
Te-129m	26	149	149	180	20	26	265	180	26
I-131	2.0	11	11	14	1.5*	2.0	20	14	2.0
Cs-134	2.2	15	15	20	1.9	2.2	24	20	2.2
Cs-137	2.3	15	15	17	1.8	2.3	27	17	2.3
Ba-140	7.3	48	48	54	6.1	7.3	80	54	7.3
La-140	4.1	26	26	25	3.4	4.1	41	25	4.1
Ce-144	12	43	43	75	5.5	12	101	75	12

*The LLD for I-131 measured on silver zeolite cartridge is 2.01x10⁻³ pCi/m³

Table B-12

**Direct Radiation
(Results in Units of mR/90 days $\pm 2\sigma$)**

Site Code	Location	First Quarter	Second Quarter	Third Quarter	Fourth Quarter
DR01	On Site, along Cliffs	11.35 \pm 0.88	12.91 \pm 0.88	13.64 \pm 2.30	12.66 \pm 1.02
DR02	Route 765, Auto Dump	9.47 \pm 0.78	10.42 \pm 0.82	10.67 \pm 0.88	9.33 \pm 0.75
DR03	Route 765, Giovanni's Tavern	9.52 \pm 0.67	10.83 \pm 0.26	11.30 \pm 0.96	9.66 \pm 0.31
DR04	Route 765, across from White Sands Drive.	10.97 \pm 0.41	12.50 \pm 0.53	12.67 \pm 1.12	11.91 \pm 0.72
DR05	Route 765, St. John's Creek	10.90 \pm 1.35	12.23 \pm 1.14	12.55 \pm 1.27	11.12 \pm 2.10
DR06	Route 765 at Lusby	9.28 \pm 0.50	10.71 \pm 0.30	10.52 \pm 1.08	9.17 \pm 1.45
DR07	Entrance to Camp Conoy	8.72 \pm 1.07	10.35 \pm 0.76	10.34 \pm 0.64	8.89 \pm 1.27
DR08	Camp Conoy Rd at Emergency Siren	12.92 \pm 1.79	14.71 \pm 0.41	15.17 \pm 1.80	13.67 \pm 0.77
DR09	Bay Breeze Rd	9.47 \pm 1.40	11.18 \pm 1.00	11.71 \pm 0.74	10.97 \pm 0.84
DR10	Decatur St. and Calvert Beach Rd.	9.57 \pm 0.36	10.54 \pm 1.04	11.04 \pm 0.28	9.45 \pm 0.37
DR11	Dirt road off Mackall & Parran Rd	9.74 \pm 0.69	¹	10.99 \pm 0.95	10.16 \pm 1.19
DR12	Mackall & Bowen Rds	9.71 \pm 1.12	10.28 \pm 0.36	11.10 \pm 1.17	10.67 \pm 1.39
DR13	Mackall Rd, near Wallville	10.79 \pm 1.13	11.80 \pm 1.10	12.16 \pm 1.24	11.25 \pm 1.04
DR14	Rodney Point	11.98 \pm 0.90	13.52 \pm 0.79	13.39 \pm 1.52	13.09 \pm 1.20
DR15	Mill Bridge & Turner Rds	10.38 \pm 0.56	12.14 \pm 0.41	12.63 \pm 1.78	11.50 \pm 0.81

¹ Missing Data

Table B-12

Direct Radiation
(Results in Units of mR/90 days $\pm 2\sigma$)

Site Code	Location	First Quarter	Second Quarter	Third Quarter	Fourth Quarter
DR16	Across from Appeal School	9.24 \pm 0.58	11.34 \pm 0.62	11.19 \pm 0.51	10.59 \pm 0.87
DR17	Cove Point & Little Cove Point Rds	10.51 \pm 0.49	12.57 \pm 2.05	12.81 \pm 2.17	12.38 \pm 1.42
DR18	Cove Point	8.53 \pm 1.12	9.65 \pm 1.00	9.56 \pm 1.63	8.91 \pm 0.87
DR19	Long Beach	8.96 \pm 0.88	10.65 \pm 1.27	10.87 \pm 0.65	10.40 \pm 1.37
DR20	On site, near Shore	11.44 \pm 0.35	13.15 \pm 0.66	13.46 \pm 1.70	13.12 \pm 2.21
DR21 ¹	EOF	10.85 \pm 1.18	12.83 \pm 0.45	12.35 \pm 1.30	12.42 \pm 0.67
DR22 ¹	Solomons Island	9.74 \pm 0.85	10.77 \pm 1.19	10.43 \pm 0.83	10.60 \pm 0.50
DR23 ¹	Taylors Island	13.66 \pm 2.13	15.86 \pm 2.03	16.12 \pm 0.88	15.51 \pm 1.56
DR30	MET Station	11.72 \pm 0.95	13.74 \pm 1.19	13.40 \pm 0.84	11.97 \pm 0.80
SFDR01	SW of ISFSI	14.72 \pm 1.50	17.39 \pm 1.58	17.28 \pm 2.13	15.22 \pm 1.86
SFDR02	North of ISFSI	18.05 \pm 1.40	18.87 \pm 1.92	21.13 \pm 3.02	16.27 \pm 1.47
SFDR03	NNE of ISFSI	34.09 \pm 3.98	38.93 \pm 5.23	40.75 \pm 5.53	28.84 \pm 4.38
SFDR04	NE of ISFSI	18.31 \pm 1.64	20.27 \pm 2.71	23.30 \pm 4.18	17.27 \pm 1.24
SFDR05	East of ISFSI	13.67 \pm 0.91	14.84 \pm 1.34	15.10 \pm 2.15	13.03 \pm 1.67
SFDR06	ESE of ISFSI	13.53 \pm 2.35	15.32 \pm 1.52	15.08 \pm 1.78	13.53 \pm 0.38

¹ Control Location

Table B-12 - Continued

Direct Radiation
(Results in Units of mR/90 days $\pm 2\sigma$)

Site Code	Location	First Quarter	Second Quarter	Third Quarter	Fourth Quarter
SFDR07 ¹	Visitor's Center	11.39 \pm 0.35	13.07 \pm 0.78	12.81 \pm 1.11	12.45 \pm 0.39
SFDR08	NNW of ISFSI	25.12 \pm 4.59	27.77 \pm 4.00	25.47 \pm 5.00	26.17 \pm 2.19
SFDR09	South of ISFSI	11.16 \pm 1.64	12.37 \pm 0.80	12.58 \pm 0.99	12.36 \pm 0.85
SFDR10	NNW of ISFSI	34.96 \pm 6.87	58.97 \pm 3.64	40.25 \pm 6.28	37.66 \pm 4.57
SFDR11	WNW ISFSI	25.23 \pm 4.97	32.98 \pm 5.55	38.25 \pm 3.38	27.31 \pm 7.77
SFDR12	West of ISFSI	32.76 \pm 3.69	28.09 \pm 7.32	29.76 \pm 5.23	35.51 \pm 3.64
SFDR13	SSW of ISFSI	12.07 \pm 1.30	14.21 \pm 1.52	16.93 \pm 1.31	13.09 \pm 1.64
SFDR14	SSE of ISFSI	10.81 \pm 1.17	12.50 \pm 0.93	13.94 \pm 1.43	11.75 \pm 0.46
SFDR15	ENE of ISFSI	15.99 \pm 2.85	19.73 \pm 1.46	17.01 \pm 2.37	15.96 \pm 0.33
SFDR16	WSW of ISFSI	20.86 \pm 2.25	23.23 \pm 3.10	23.89 \pm 3.50	21.71 \pm 2.87

¹ Control Location

(LEFT BLANK)

APPENDIX C

Appendix C is a summary of CPSG Laboratory's quality assurance program. It consists of Table C-1 which is a compilation of the results of the Laboratory's participation in cross check programs in 2002 with Analytics in Atlanta, Georgia and Environmental Resource Associates in Arvada, Colorado. It also consists of Table C-2 and Table C-3 that together form a compilation of the results of the Laboratory's participation in split sample programs with Teledyne Brown Engineering's Environmental Services in Knoxville, Tennessee during the period January 1, 2001 through June 30, 2001 and EnRad Laboratories (Duke Power) in Huntersville, North Carolina during the period July 1, 2001 through December 31, 2001.

All the CPSG Laboratory's results contained in Table C-1 agree with the cross check laboratory results with the exception of six isotopes for the filter sample type on 6/14/01 from Analytics. Reanalysis of the filter did not result in agreement within the 3 sigma control limit, however, five of the six original results were in agreement when using the NRC Resolution Test Criteria¹. The supplier was contacted to obtain the results of all participants in this cross check. Evaluation of all the data showed the presence of a systematic error and that the CPSG Laboratory data was consistent with other participants in the cross check program.

All the results contained in Table C-2 generally agree with the CPSG Laboratory replicates and split samples where appropriate with the exception of ISFSI Soil collected 6/4/01 at location SFS1 for Cs-137. Examination of the gamma spectra showed that the CPSG Laboratory MDA was about 35 pCi/kg which was just under the split sample result. The difference in results was due only to counting statistics. Samples whose nature precludes splitting them with another laboratory are marked "***" in the Split Analysis column.

The CPSG Laboratory participated in the 12th International Intercomparison of Environmental Dosimeters sponsored by the Department of Energy (DOE) which was held in 2000. Although a final report that provides a statistical evaluation of all the participant's data had not been completed by the DOE by the end of 2001, preliminary dose values were made available to participants in March 2001 and are provided below with CPSG values.

	DOE Reference (microGy)	CPSG Value (microGy)
Laboratory Cs-137	391	369
Field Only	161	144
Field + Cs-137 begin	548	528
Field + Cs-137 middle	391	371
Field + Cs-137 end	623	628

¹ NRC Inspection Manual, Inspection Procedure 84750, March 15, 1994

(LEFT BLANK)

TABLE OF CONTENTS - ANALYTICAL RESULTS

Table	Title	Page
C-1	Results of Participation in Cross Check Programs	75
C-2	Results of Quality Assurance Program for 2001	77
C-3	Teledyne Brown Engineering's Typical MDAs for Gamma Spectrometry.....	86
C-4	EnRad Laboratories Typical MDAs for Gamma Spectrometry.....	87

(LEFT BLANK)

TABLE C-1
Results of Participation in Cross Check Programs for 2001

Sample Date	Sample Type and Units	Isotope Observed	Reported Laboratory's Results ¹	Analytics Results ¹
3/22/01	Water-pCi/L	H-3	3040±93	3114±156
3/22/01	Water-pCi/L	Cs-134	119±12	129±6
		Cs-137	101±15	102±5
		Ce-141	99±20	94±5
		Zn-65	196±39	186±9
		Cr-51	240±96	242±12
		Mn-54	110±18	101±5
		Fe-59	88±21	84±4
		Co-60	152±16	147±7
		I-131	94±18	90±5
6/14/01	Filter-pCi/filter	Beta	82±2	87±4
6/14/01	Filter-pCi/filter	Ce-141	166±11 ²	140±7
		Cr-51	226±71	193±10
		Cs-134	108±6	115±6
		Cs-137	119±9 ²	104±5
		Mn-54	160±11 ²	130±7
		Fe-59	95±12 ²	75±4
		Zn-65	190±20 ²	156±8
		Co-58	93±9	83±4
		Co-60	133±8 ²	116±6

¹ Laboratory precision (3 sigma)

² See discussion at the beginning of this Appendix

TABLE C-1 - Continued
Results of Participation in Cross Check Programs for 2001

Sample Date	Sample Type and Units	Isotope Observed	Reported Laboratory's Results ²	ERA Results ¹
6/06/01	Water-pCi/L	Ba-133	29±3	36±5
		Cs-134	14±2	16±5
		Cs-137	203±11	197±10
		Zn-65	35±4	36±5
		Co-60	54±6	47±5
8/08/01	Water-pCi/L	H-3	2690±36	2730±356
10/4/01	Water-pCi/L	I-131	8±.1	8±.2
12/26/01	Water-pCi/L	Ba-133	60±4	69±7
		Cs-134	85±1	94±5
		Cs-137	42±2	42±5
		Zn-65	76±14	77±8
		Co-60	60±1	61±5

¹ Expected Deviation

² Experimental Deviation

TABLE C-2

Results of Quality Assurance Program for 2001

Sample Type And Location	Sample Date	Type of Analysis	Original Analysis	Replicate Analysis	Split Analysis
			10^{-2} pCi/m ³		
Air Iodine-A1	1/15/01	I-131	<0.5	<0.7	**
Air Iodine-A2	1/15/01	I-131	<0.6	<0.7	**
Air Filter -A1	1/15/01	Beta	1.8±0.2	1.8±0.2	**
Air Filter -A2	1/15/01	Beta	1.8±0.2	1.7±0.2	**
Air Filter -A3	1/15/01	Beta	1.5±0.2	1.6±0.2	**
Air Filter -A4	1/15/01	Beta	1.6±0.2	1.7±0.2	**
Air Filter -A5	1/15/01	Beta	2.1±0.2	2.1±0.2	**
Air Filter -SFA1	1/15/01	Beta	1.9±0.2	1.8±0.2	**
Air Filter -SFA2	1/15/01	Beta	1.7±0.2	1.7±0.2	**
Air Filter -SFA3	1/15/01	Beta	1.7±0.2	1.8±0.2	**
Air Filter -SFA4	1/15/01	Beta	2.0±0.2	2.0±0.2	**
Air Filter-A1	2/12/01	Beta	1.8±0.2	1.8±0.2	**
Air Filter-A2	2/12/01	Beta	1.8±0.2	1.8±0.2	**
Air Filter-A3	2/12/01	Beta	1.7±0.2	1.8±0.2	**
Air Filter-A4	2/12/01	Beta	1.6±0.2	1.7±0.2	**
Air Filter-A5	2/12/01	Beta	2.0±0.2	2.0±0.2	**
Air Filter-SFA1	2/12/01	Beta	1.8±0.2	1.8±0.2	**
Air Filter-SFA2	2/12/01	Beta	1.8±0.2	1.8±0.2	**
Air Filter-SFA3	2/12/01	Beta	1.7±0.2	1.9±0.2	**
Air Filter-SFA4	2/12/01	Beta	1.9±0.2	2.0±0.2	**
Air Iodine-A3	2/12/01	I-131	<0.5	<0.5	**
Air Iodine-A4	2/12/01	I-131	<0.4	<0.5	**
			pCi/L		
Bay Water-Wa2	2/15/01	Gamma	<MDA	<MDA	<MDA
Bay Water-Wa2	2/15/01	Tritium	685±43	643±43	570±80

**The nature of these samples precluded splitting them with an independent laboratory.

TABLE C-2 - Continued

Results of Quality Assurance Program for 2001

Sample Type And Location	Sample Date	Type of Analysis	Original Analysis	Replicate Analysis	Split Analysis
				10^{-2} pCi/m ³	
Air Filter-A1	3/05/01	Beta	1.3±0.2	1.3±0.2	**
Air Filter-A2	3/05/01	Beta	1.5±0.2	1.5±0.2	**
Air Filter-A3	3/05/01	Beta	1.6±0.2	1.8±0.2	**
Air Filter-A4	3/05/01	Beta	1.4±0.2	1.3±0.2	**
Air Filter-A5	3/05/01	Beta	2.2±0.2	2.2±0.2	**
Air Filter-SFA1	3/05/01	Beta	1.5±0.2	1.6±0.2	**
Air Filter-SFA2	3/05/01	Beta	1.2±0.2	1.3±0.2	**
Air Filter-SFA3	3/05/01	Beta	1.5±0.2	1.6±0.2	**
Air Filter-SFA4	3/05/01	Beta	1.6±0.2	1.7±0.2	**
Air Iodine-A4	3/12/01	I-131	<0.5	<0.5	**
Air Iodine-A5	3/12/01	I-131	<0.6	<0.7	**
				pCi /kg	
Soil-SFS1	3/12/01	Cs-137	<MDA	<MDA	20±2
Soil-SFS1	3/12/01	Co-60	31±17	<MDA	17±5
Soil-SFS2	3/12/01	Cs-137	103±48	88±42	109±19
Vegetation-SFb1	3/12/01	Gamma	<MDA	<MDA	<MDA
Vegetation-SFb2	3/12/01	Gamma	<MDA	<MDA	6±24
Oysters-Ia3	3/29/01	Ag-110m	<MDA	<MDA	<MDA
Shoreline-Wb1	4/09/01	Gamma	<MDA	<MDA	<MDA
				10^{-2} pCi/m ³	
Air Iodine-A3	4/09/01	I-131	<0.6	<0.7	**
Air Iodine-A4	4/09/01	I-131	<0.5	<0.5	**

**The nature of these samples precluded splitting them with an independent laboratory.

TABLE C-2 - Continued

Results of Quality Assurance Program for 2001

Sample Type And Location	Sample Date	Type of Analysis	Original Analysis	Replicate Analysis	Split Analysis
				10^{-2} pCi/m ³	
Air Filter-A1	4/09/01	Beta	1.2±0.2	1.2±0.2	**
Air Filter-A2	4/09/01	Beta	1.3±0.2	1.3±0.2	**
Air Filter-A3	4/09/01	Beta	1.4±0.2	1.3±0.2	**
Air Filter-A4	4/09/01	Beta	1.2±0.2	1.2±0.2	**
Air Filter-A5	4/09/01	Beta	1.7±0.2	1.4±0.2	**
Air Filter-SFA1	4/09/01	Beta	1.3±0.2	1.3±0.2	**
Air Filter-SFA2	4/09/01	Beta	1.2±0.2	1.2±0.2	**
Air Filter-SFA3	4/09/01	Beta	1.2±0.2	1.3±0.2	**
Air Filter-SFA4	4/09/01	Beta	1.3±0.2	1.3±0.2	**
				pCi /L	
Bay Water-Wa2	4/15/01	Gamma	<MDA	<MDA	<MDA
				10^{-2} pCi/m ³	
Air Iodine-A1	5/01/01	I-131	<0.5	<0.5	**
Air Iodine-A2	5/01/01	I-131	<0.6	<0.6	**
Air Filter-A1	5/21/01	Beta	0.8±0.2	0.9±0.2	**
Air Filter-A2	5/21/01	Beta	0.8±0.2	0.8±0.2	**
Air Filter-A3	5/21/01	Beta	0.7±0.2	0.7±0.2	**
Air Filter-A4	5/21/01	Beta	0.6±0.2	0.8±0.2	**
Air Filter-A5	5/21/01	Beta	1.2±0.2	1.3±0.2	**
Air Filter-SFA1	5/21/01	Beta	0.7±0.2	0.7±0.2	**
Air Filter-SFA2	5/21/01	Beta	1.0±0.2	1.1±0.2	**
Air Filter-SFA3	5/21/01	Beta	0.7±0.2	0.7±0.2	**
Air Filter-SFA4	5/21/01	Beta	0.9±0.2	0.9±0.2	**

**The nature of these samples precluded splitting them with an independent laboratory.

TABLE C-2 - Continued

Results of Quality Assurance Program for 2001

Sample Type And Location	Sample Date	Type of Analysis	Original Analysis	Replicate Analysis	Split Analysis
				pCi/kg	
Soil-SFS1	6/04/01	Cs-137	<MDA	<MDA	39±12
Soil-SFS5	6/04/01	Cs-137	447±36	462±37	559±29
Vegetation-SFb3	6/04/01	Gamma	<MDA	<MDA	<MDA
Vegetation-SFb4	6/04/01	Gamma	<MDA	<MDA	<MDA
				10 ⁻² pCi/m ³	
Air Iodine-A1	6/11/01	I-131	<0.7	<0.7	**
Air Iodine-A2	6/11/01	I-131	<0.6	<0.8	**
				10 ⁻³ pCi/m ³	
Air Filters-A1	6/15/01	Gamma	<MDA	<MDA	<MDA
Air Filters-A2	6/15/01	Gamma	<MDA	<MDA	<MDA
Air Filters-A3	6/15/01	Gamma	<MDA	<MDA	<MDA
Air Filters-A4	6/15/01	Gamma	<MDA	<MDA	<MDA
Air Filters-A5	6/15/01	Gamma	<MDA	<MDA	<MDA
Air Filters-SFA1	6/15/01	Gamma	<MDA	<MDA	<MDA
Air Filters-SFA2	6/15/01	Gamma	<MDA	<MDA	<MDA
Air Filters-SFA3	6/15/01	Gamma	<MDA	<MDA	<MDA
Air Filters-SFA4	6/15/01	Gamma	<MDA	<MDA	<MDA
				10 ⁻² pCi/m ³	
Air Filter-A1	6/18/01	Beta	1.4±0.2	1.4±0.2	**
Air Filter-A2	6/18/01	Beta	1.1±0.2	1.1±0.2	**
Air Filter-A3	6/18/01	Beta	0.6±0.2	0.8±0.2	**
Air Filter-A4	6/18/01	Beta	1.4±0.2	1.5±0.2	**
Air Filter-A5	6/18/01	Beta	2.1±0.2	2.2±0.2	**
Air Filter-SFA1	6/18/01	Beta	1.2±0.2	1.2±0.2	**
Air Filter-SFA2	6/18/01	Beta	1.2±0.2	1.2±0.2	**
Air Filter-SFA3	6/18/01	Beta	1.6±0.2	1.8±0.2	**
Air Filter-SFA4	6/18/01	Beta	1.5±0.2	1.5±0.2	**

**The nature of these samples precluded splitting them with an independent laboratory.

TABLE C-2 - Continued

Results of Quality Assurance Program for 2001

Sample Type And Location	Sample Date	Type of Analysis	Original Analysis	Replicate Analysis	Split Analysis
			mR/90 Days		
DR01	6/30/01	TLD	12.91±1.18	13.69±1.27	**
DR02	6/30/01	TLD	10.42±2.42	10.95±0.71	**
DR03	6/30/01	TLD	10.95±1.18	11.69±0.82	**
DR04	6/30/01	TLD	12.50±0.96	13.28±0.97	**
DR23	6/30/01	TLD	15.86±1.06	16.18±1.21	**
DR28	6/30/01	TLD	14.37±1.30	14.97±0.96	**
DR30	6/30/01	TLD	13.74±1.54	13.86±1.14	**
DR34	6/30/01	TLD	10.13±1.83	10.84±1.16	**
SFDR12	6/30/01	TLD	28.09±1.56	32.29±1.57	**
SFDR13	6/30/01	TLD	14.21±1.07	15.05±1.75	**
RPDR06	6/30/01	TLD	129.45±3.90	117.65±2.48	**
			10 ⁻² pCi/m ³		
Air Filter-A1	7/09/01	Beta	0.8±0.2	0.8±0.2	**
Air Filter-A2	7/09/01	Beta	0.8±0.2	1.1±0.2	**
Air Filter-A3	7/09/01	Beta	0.8±0.2	0.8±0.2	**
Air Filter-A4	7/09/01	Beta	1.1±0.2	1.2±0.2	**
Air Filter-A5	7/09/01	Beta	1.3±0.2	1.4±0.2	**
Air Filter-SFA1	7/09/01	Beta	0.9±0.1	0.9±0.1	**
Air Filter-SFA2	7/09/01	Beta	0.8±0.2	0.9±0.2	**
Air Filter-SFA3	7/09/01	Beta	1.0±0.2	1.1±0.2	**
Air Filter-SFA4	7/09/01	Beta	0.9±0.2	0.9±0.2	**
Air Iodine-A2	7/09/01	I-131	<0.6	<0.6	**
Air Iodine-A3	7/09/01	I-131	<0.7	<0.7	**
			pCi/L		
Bay Water-Wa2	7/26/01	Gamma	<MDA	<MDA	<MDA
			pCi/kg		
Oysters-Ia3	8/02/01	Ag-110m	94±12	103±14	70±5

**The nature of these samples precluded splitting them with an independent laboratory.

TABLE C-2 - Continued

Results of Quality Assurance Program for 2001

Sample Type And Location	Sample Date	Type of Analysis	Original Analysis	Replicate Analysis	Split Analysis
				pCi/kg	
Fish-Ia2	8/8/01	Gamma	<MDA	<MDA	<MDA
				10 ⁻² pCi/m ³	
Air Iodine-A4	8/13/01	I-131	<1	<1	**
Air Iodine-A5	8/13/01	I-131	<2	<1	**
				pCi/L	
Bay Water-Wa2	8/15/01	Tritium	509±43	497±43	470±20
				10 ⁻² pCi/m ³	
Air Filter-A1	8/20/01	Beta	1.8±0.2	1.9±0.2	**
Air Filter-A2	8/20/01	Beta	1.6±0.2	1.7±0.2	**
Air Filter-A3	8/20/01	Beta	1.8±0.2	2.0±0.2	**
Air Filter-A4	8/20/01	Beta	2.0±0.2	2.1±0.2	**
Air Filter-A5	8/20/01	Beta	2.7±0.3	2.8±0.3	**
Air Filter-SFA1	8/20/01	Beta	2.0±0.2	2.0±0.2	**
Air Filter-SFA2	8/20/01	Beta	2.2±0.2	2.4±0.2	**
Air Filter-SFA3	8/20/01	Beta	2.2±0.2	2.4±0.2	**
Air Filter-SFA4	8/20/01	Beta	2.1±0.2	2.3±0.2	**
Air Iodine-A3	9/10/01	I-131	<1	<1	**
Air Iodine-A4	9/10/01	I-131	<1	<2	**
Air Filter-A1	9/24/01	Beta	1.9±0.2	2.0±0.2	**
Air Filter-A2	9/24/01	Beta	1.5±0.2	1.5±0.2	**
Air Filter-A3	9/24/01	Beta	1.4±0.2	1.5±0.2	**
Air Filter-A4	9/24/01	Beta	1.9±0.2	2.0±0.2	**
Air Filter-A5	9/24/01	Beta	2.7±0.2	2.8±0.3	**
Air Filter-SFA1	9/24/01	Beta	4.0±0.4	4.3±0.4	**
Air Filter-SFA2	9/24/01	Beta	1.9±0.2	2.1±0.2	**
Air Filter-SFA3	9/24/01	Beta	2.7±0.2	2.9±0.3	**
Air Filter-SFA4	9/24/01	Beta	2.1±0.2	2.3±0.2	**

**The nature of these samples precluded splitting them with an independent laboratory.

TABLE C-2 - Continued

Results of Quality Assurance Program for 2001

Sample Type And Location	Sample Date	Type of Analysis	Original Analysis	Replicate Analysis	Split Analysis
				pCi /kg	
Vegetation-lb1	10/01/01	Gamma	<MDA	<MDA	<MDA
Vegetation-lb4	10/01/01	Gamma	<MDA	<MDA	<MDA
Vegetation-lb5	10/01/01	Gamma	<MDA	<MDA	<MDA
Vegetation-lb6	10/01/01	Gamma	<MDA	<MDA	<MDA
Vegetation-lb7	10/01/01	Gamma	<MDA	<MDA	<MDA
Vegetation-lb8	10/01/01	Gamma	<MDA	<MDA	<MDA
				10 ⁻² pCi/m ³	
Air Filter-A1	10/08/01	Beta	2.6±0.3	2.6±0.2	**
Air Filter-A2	10/08/01	Beta	2.3±0.2	2.4±0.2	**
Air Filter-A3	10/08/01	Beta	1.9±0.2	2.0±0.2	**
Air Filter-A4	10/08/01	Beta	2.1±0.2	2.1±0.2	**
Air Filter-A5	10/08/01	Beta	2.7±0.3	2.8±0.3	**
Air Filter-SFA1	10/08/01	Beta	3.2±0.3	3.3±0.3	**
Air Filter-SFA2	10/08/01	Beta	2.4±0.2	2.2±0.2	**
Air Filter-SFA3	10/08/01	Beta	2.8±0.2	3.1±0.3	**
Air Filter-SFA4	10/08/01	Beta	2.9±0.2	3.0±0.2	**
Air Iodine-A1	10/08/01	I-131	<1.4	<1.4	**
Air Iodine-A2	10/08/01	I-131	<1.6	<1.5	**

**The nature of these samples precluded splitting them with an independent laboratory.

TABLE C-2 - Continued

Results of Quality Assurance Program for 2001

Sample Type And Location	Sample Date	Type of Analysis	Original Analysis	Replicate Analysis	Split Analysis
				10^{-2} pCi/m ³	
Air Filter-A1	11/19/01	Beta	2.7±0.2	2.7±0.2	**
Air Filter-A2	11/19/01	Beta	2.6±0.2	2.6±0.2	**
Air Filter-A3	11/19/01	Beta	2.8±0.2	3.0±0.2	**
Air Filter-A4	11/19/01	Beta	2.6±0.2	2.7±0.2	**
Air Filter-A5	11/19/01	Beta	3.0±0.2	3.1±0.2	**
Air Filter-SFA1	11/19/01	Beta	2.5±0.2	2.7±0.2	**
Air Filter-SFA2	11/19/01	Beta	2.3±0.2	2.4±0.2	**
Air Filter-SFA3	11/19/01	Beta	2.4±0.2	2.7±0.2	**
Air Filter-SFA4	11/19/01	Beta	2.6±0.2	2.8±0.2	**
Air Iodine-A4	11/12/01	I-131	<1.3	<1.3	**
Air Iodine-A5	11/12/01	I-131	<1.4	<1.4	**
				pCi/L	
Bay Water-Wa2	11/28/01	Gamma	<MDA	<MDA	<MDA
				10^{-2} pCi/m ³	
Air Filter-A1	12/10/01	Beta	2.8±0.2	3.1±0.2	**
Air Filter-A2	12/10/01	Beta	2.9±0.3	3.1±0.3	**
Air Filter-A3	12/10/01	Beta	2.5±0.2	2.8±0.2	**
Air Filter-A4	12/10/01	Beta	2.7±0.3	2.9±0.2	**
Air Filter-A5	12/10/01	Beta	2.5±0.2	2.5±0.3	**
Air Filter-SFA1	12/10/01	Beta	2.0±0.2	2.2±0.2	**
Air Filter-SFA2	12/10/01	Beta	2.2±0.2	2.3±0.2	**
Air Filter-SFA3	12/10/01	Beta	2.7±0.2	2.9±0.2	**
Air Filter-SFA4	12/10/01	Beta	1.9±0.2	2.0±0.2	**
Air Iodine-A2	12/10/01	I-131	<1.3	<1.4	**
Air Iodine-A3	12/10/01	I-131	<1.6	<1.5	**

**The nature of these samples precluded splitting them with an independent laboratory.

TABLE C-2 - Continued

Results of Quality Assurance Program for 2001

Sample Type And Location	Sample Date	Type of Analysis	Original Analysis	Replicate Analysis	Split Analysis
				10^{-3} pCi/m ³	
Air Filters-A1	12/15/01	Gamma	<MDA	<MDA	<MDA
Air Filters-A2	12/15/01	Gamma	<MDA	<MDA	<MDA
Air Filters-A3	12/15/01	Gamma	<MDA	<MDA	<MDA
Air Filters-A4	12/15/01	Gamma	<MDA	<MDA	<MDA
Air Filters-A5	12/15/01	Gamma	<MDA	<MDA	<MDA
Air Filters-SFA1	12/15/01	Gamma	<MDA	<MDA	<MDA
Air Filters-SFA2	12/15/01	Gamma	<MDA	<MDA	<MDA
Air Filters-SFA3	12/15/01	Gamma	<MDA	<MDA	<MDA
Air Filters-SFA4	12/15/01	Gamma	<MDA	<MDA	<MDA

**The nature of these samples precluded splitting them with an independent laboratory.

TABLE C-3

Teledyne Brown Engineering's Typical MDAs for Gamma Spectrometry

Selected Nuclides	Bay Water pCi/l	Fish pCi/kg	Shellfish pCi/kg	Sediment pCi/kg	Vegetation pCi/kg	Particulate 10 ⁻³ pCi/m ³
H-3	175	NA	NA	NA	NA	NA
Na-22	1	8	3	12	6	5
Cr-51	12	105	4	104	50	63
Mn-54	1	9	3	12	5	4
Co-58	1	9	4	9	4	5
Fe-59	3	28	9	24	10	12
Co-60	1	9	4	12	5	6
Zn-65	2	20	8	25	10	5
Nb-95	1	12	7	14	6	9
Zr-95	2	18	8	20	9	9
Ru-106	9	75	30	90	41	40
Ag-110m	1	10	10	10	5	4
Te-129m	16	131	60	162	79	95
I-131	4	65	30	35	22	74
Cs-134	1	1	4	10	5	4
Cs-137	3	9	4	10	5	4
BaLa-140	3	32	15	25	14	36
Ce-144	7	40	16	54	26	18

TABLE C-4

EnRad Laboratories Typical MDAs for Gamma Spectrometry

Selected Nuclides	Bay Water pCi/l	Fish pCi/kg	Shellfish pCi/kg	Sediment pCi/kg	Vegetation pCi/kg	Particulate 10 ⁻³ pCi/m ³
H-3	175	NA	NA	NA	NA	NA
Na-22	1	8	10	15	5	5
Cr-51	15	105	100	150	50	30
Mn-54	1	9	8	15	5	4
Co-58	1	9	10	15	4	5
Fe-59	3	28	20	40	10	12
Co-60	1	9	10	18	5	6
Zn-65	3	20	20	30	10	5
Nb-95	2	12	15	20	6	5
Zr-95	3	18	20	30	9	5
Ru-106	10	75	70	120	30	15
Ag-110m	NA	10	10	NA	NA	NA
Te-129m	20	131	110	220	50	50
I-131	20	65	NA	NA	NA	70
Cs-134	1	8	8	12	5	4
Cs-137	1	9	8	12	5	4
BaLa-140	7	32	20	50	14	36
Ce-144	7	40	40	80	26	18

(LEFT BLANK)

APPENDIX D

Appendix D contains the results of a Land Use Survey conducted around Calvert Cliffs Nuclear Power Plant during August 2001. A table listing the raw data of this survey and a discussion of the results are included in this appendix.

Discussion

A Land Use Survey was conducted during August 2001 to identify, within a distance of 8 km, the location of the nearest milk animal, the nearest residence, and the nearest garden greater than 50 m² in each of the nine sectors over land. A detailed description of the Land Use Survey is given in a separate document (12). The position of the nearest residence and garden in each sector out to 8 km are given in the adjacent table. No dairy animal was found within 8 km in any direction. There has not been any significant change in the use of local lands in the last few years.

Sector	Distance From Plant (km)	
	Residence	Garden
SE	2.7	2.7
SSE	2.9	2.9
S	3.1	7.1
SSW	2.6	2.7
SW	2.1	2.2
WSW	1.9	1.9
W	2.1	2.4
WNW	2.6	2.6
NW	2.9	2.9

The closest residence and nearest garden is situated in the WSW sector, which is one of the least prevalent wind directions. In the S, SSE, and SE sectors, there is the highest probability of wind blowing from the direction of the plant. The two gardens used for vegetable samples by the Radiological Environmental Monitoring Program have been placed in the sectors with the highest X/Q. One sampling garden is located in the S sector at a distance of 0.7 km, and another is situated near the site boundary between the SSE and SE sectors at a distance of 2.6 km from the plant. These two sampling sites are considered good indicator locations for radioactive depositions around the plant.

The dose assessment using 2001 meteorological data was performed, and no significant impact from the plant was found.

(LEFT BLANK)

APPENDIX E

Appendix E is a presentation of the analytical results for additional samples collected in the environs of Calvert Cliffs Nuclear Power Plant during the year 2001. These extra samples are not required by the Off Site Dose Calculation Manual (6). They were collected and analyzed to maintain the historical continuity for samples and sampling pathways discontinued when the Environmental Technical Specifications were changed in March, 1985. Additionally, they include the Pressurized Ion Chambers added for the Independent Spent Fuel Storage Installation.

Table E-9 shows the average monthly direct radiation as measured by the pressurized ion chamber at five locations.

Table E-11 shows the direct radiation readings from TLDs placed at the perimeter of a temporary waste resin storage and cask transfer area located to the west of the ISFSI facility. The TLD values are higher than those in the REMP program due to their proximity to the source of the radiation. TLD doses for the second quarter were much higher than usual because of the movement of resin and filter casks that were a result of maintenance activities during a plant refueling outage. However, when the direct radiation readings for the ISFSI and Site Boundary TLDs are reviewed, it is apparent that temporary storage of spent resin and cask transfers are having no significant, measurable effect on the environs surrounding Calvert Cliffs Nuclear Power Plant.

During 2001 construction began on the Old Steam Generator Storage Facility (OSGSF) which will be used to store steam generators retired from service. The first set of steam generators is due to be placed in the new facility early in 2002. An environmental radiological monitoring program was initiated in 2001 to collect pre-operational data from construction site of the facility. Additional TLDs were placed around the perimeter of the construction site and soil samples were also collected and analyzed for gamma emitters. The TLDs that form the monitoring program for the OSGSF are OSG1, North of OSGSF, and OSG2, West of OSGSF. Completing the monitoring around the perimeter are SFDR2, North of ISFSI, and SFDR8, North Northwest of ISFSI which are also in common with the ISFSI REMP. The TLD and soil data collected during the pre-operational phase are included in the tables below.

TLD Data

Site Code	Location	First Quarter	Second Quarter	Third Quarter	Fourth Quarter
OSG1	North of OSGSF	15.56 ± 2.09	19.59 ± 1.27	17.62 ± 0.99	17.42 ± 1.67
OSG2	West of OSGSF	16.13 ± 1.26	20.71 ± 1.88	16.62 ± 3.77	14.98 ± 1.86
SFDR2	North of ISFSI	18.05 ± 1.40	18.87 ± 1.92	21.13 ± 3.02	16.27 ± 1.47
SFDR8	North Northwest of ISFSI	25.12 ± 4.59	27.77 ± 4.00	25.47 ± 5.00	26.17 ± 2.19

Soil Data

Sample Location	Cs-137 (pCi/kg)	Gamma Emitters	Location	Cs-137 (pCi/kg)	Gamma Emitters
North of OSGF (4 feet)	76 ± 26	*	North of OSGF (30 feet)	544 ± 57	*
South of OSGF (4 feet)	42 ± 38	*	South of OSGF (30 feet)	227 ± 37	*

- Non-natural gamma emitters <MDA

The results of the TLD and soil data are typical of results obtained from monitoring sites around Calvert Cliffs and the ISFSI and therefore constitute a baseline for future analysis data.

TABLE OF CONTENTS - ANALYTICAL RESULTS

Table	Title	Page
E-1	Locations of Non-ODCM Environmental Sampling Stations for Calvert Cliffs Nuclear Power Plant.....	94
E-2	Synopsis of 2001 Calvert Cliffs Nuclear Power Plant Non-ODCM Radiological Environmental Monitoring Program.....	95
E-3	Annual Summary for Calvert Cliffs Nuclear Power Plant Units 1 & 2 Non-ODCM Radiological Environmental Monitoring Program	96
E-4	Concentration of Gamma Emitters in Bottom Sediment	97
E-5	Concentration of Iodine-131 in Filtered Air	98
E-6	Concentration of Beta Emitters in Air Particulates.....	100
E-7	Concentration of Gamma Emitters in Air Particulates	102
E-8	Concentration of Tritium and Gamma Emitters in Taylors Island Well Water.....	103
E-9	Direct Radiation as Measured in Pressurized Ion Chamber	104
E-10	Direct Radiation	105
E-11	Direct Radiation from Resin Storage Area	106

TABLE E-1

**Locations of Non-ODCM Environmental Sampling Stations
for Calvert Cliffs Nuclear Power Plant**

Station	Description	Distance ¹		Direction ¹
		(KM)	(Miles)	(Sector)
A6	Long Beach	4.4	2.7	NW
A7	Taylor's Island, Carpenter's Property	12.6	7.8	ENE
A8	Cambridge, U of MD Estuarine Center	32.0	19.9	NE
DR24	Route 4 and Parran Road	3.0	1.9	SW
DR25	Camp Conoy Guard House	1.0	0.6	S
DR26	Route 235 & Clarks Landing Rd.	20.5	12.7	SW
DR27	Route 231 & Route 4	23.0	14.3	NW
DR28	Taylor's Island Emergency Siren #35	12.3	7.6	ENE
DR29	Taylor's Island Emergency Siren #38	12.5	7.8	E
DR31	Cambridge, U of MD Estuarine Center	32.0	19.9	NE
DR32	Twining Property, Taylor's Island	12.3	7.6	NE
DR33	P.A. Ransome Property, Taylor's Island	14.8	9.2	ESE
DR34	Shoreline at Barge Road	0.2	0.1	NE
PIC1	Taylor's Island, Carpenter's Property	12.6	7.8	ENE
PIC2	On Site before Entrance to Camp Conoy	0.7	0.4	S
PIC3	Meteorological Station	0.8	0.5	WSW
PIC4	NNW of ISFSI	0.6	0.4	SW
PIC5	South of ISFSI	0.6	0.4	SW
PIC8	CCNPP Visitor's Center	0.3	0.2	NW
Wbs2	Intake Area	0.2	0.1	NE
Wbs2	Discharge Area	0.3	0.2	N
Wbs3	Long Beach	4.4	2.7	NW
Wbs4	Camp Conoy/Rocky Point	3.0	1.9	SE
Ww1	Taylor's Island, Carpenter's Property	12.6	7.8	ENE

¹ Distance and direction from the central point between the two containment buildings.

Table E-2

**Synopsis of 2001 Calvert Cliffs Nuclear Power Plant
Non-ODCM Radiological Environmental Monitoring Program**

Sample Type	Sampling Frequency ¹	Number of Locations	Number Collected	Analysis	Analysis Frequency ¹	Number Analyzed
Aquatic Environment Bottom Sediment	Q	4	16	Gamma	Q	16
Atmospheric Environment Air Iodine ²	W	7	363	I-131	W	363
Air Particulates ³	W	3	156	Gross Beta Gamma	W MC	156 36
Direct Radiation Pressurized Ion Chamber	M	6	72	Gamma	M	72
Ambient Radiation	Q	18	426	TLD	Q	426
Terrestrial Environment Ground water	M	1	12	H-3 Gamma	M M	12 12

¹ W-weekly, M-monthly, Q-quarterly, SA-semiannual, A-annual, C-composite

² The collection device contains silver zeolite

³ Beta counting is performed after ≥ 72 hour decay. Gamma spectroscopy performed on monthly composites of weekly samples

Table E-3

**Annual Summary for Calvert Cliffs Nuclear Power Plant Units 1 & 2
Non-ODCM Radiological Environmental Monitoring Program**

Medium or Pathway Sampled (Unit of Measurement)	Type and Total Number of Analyses Performed	Lower Limit of Detection (LLD)	Indicator Locations Mean (F)/Range ¹	Location with Highest Annual Mean Name/Distance & Direction ²	Highest Annual Mean (F) / Range ¹	Control Locations Mean (F)/Range ¹
Aquatic Environment Bottom Sediment (pCi/kg)	Gamma (16) Cs-137	33	134 (12/12) (27-222)	Long Beach Wbs3 4.4 km NW	181 (4/4) (169-202)	143 (4/4) (126-160.90)
Atmospheric Environment Air Particulates (10 ⁻² pCi/m ³)	Gross Beta (156)	0.5	1.8 (104/104) (0.6-4.1)	Taylor's Island A7 12.6 km ENE	1.8 (52/52) (0.6-2.8)	1.8 (52/52) (0.6-2.77)
Direct Radiation Ambient Radiation (mR/90 days)	TLD (474)	-	28.35 (474/474) (8.71-166.45)	West Fence Right RPDR07 km	93.07 (24/24) (23.16-166.45)	12.60 (72/72) (9.74-16.12)
Pressurized Ion Chamber (mR/30 days)	Ionization Chamber (72)	-	5.92 (60/60) (3.63-10.82)	NNW of ISFSI PIC4 0.6 km SW	10.37 (12/12) (10.14-10.82)	6.04 (12/12) (5.66-6.56)

¹ Mean and range based upon detectable measurements only. Fraction (F) of detectable measurements at specified location is indicated in parentheses.

² From the centerpoint between the two containment buildings.

Table E-4

**Concentration of Gamma Emitters in Bottom Sediment
(Results in units of pCi/kg (dry) \pm 2 σ)**

Sample Code	Sample Date	Cs-137	Gamma Emitters
Wbs1 Intake Area	03/29/2001	36 \pm 26	*
	06/13/2001	43 \pm 24	*
	08/02/2001	84 \pm 27	*
	10/10/2001	27 \pm 21	*
Wbs2 Discharge Area	03/29/2001	173 \pm 50	*
	06/13/2001	173 \pm 54	*
	08/02/2001	129 \pm 37	*
	10/10/2001	222 \pm 38	*
Wbs3 Long Beach	03/29/2001	170 \pm 41	*
	06/13/2001	169 \pm 43	*
	08/02/2001	202 \pm 37	*
	10/10/2001	184 \pm 36	*
Wbs4 ¹ Camp Conoy/ Rocky Point	03/29/2001	126 \pm 41	*
	06/13/2001	135 \pm 41	*
	08/02/2001	151 \pm 43	*
	10/10/2001	161 \pm 37	*

* Non-Natural Gamma Emitters < MDA

¹ Control Location

Table E-5

Concentration of Iodine-131 in Filtered Air
 (Results in units of 10^{-3} pCi/m³ $\pm 2\sigma$)

Start Date	Stop Date	A6 Long Beach	A7 ¹ Taylors Island	CAM Cambridge	SFA1 MET Station	SFA2 ¹ Visitors Center	SFA3 NNW of ISFSI	SFA4 South of ISFSI
01/02/2001	01/08/2001	*	*	*	*	*	*	*
01/08/2001	01/15/2001	*	*	*	*	*	*	*
01/15/2001	01/22/2001	*	*	*	*	*	*	*
01/22/2001	01/29/2001	*	*	*	*	*	*	*
01/29/2001	02/05/2001	*	*	*	*	*	*	*
02/05/2001	02/12/2001	*	*	*	*	*	*	*
02/12/2001	02/20/2001	*	*	*	*	*	*	*
02/20/2001	02/26/2001	*	*	*	*	*	*	*
02/26/2001	03/05/2001	*	*	*	*	*	*	*
03/05/2001	03/12/2001	*	*	*	*	*	*	*
03/12/2001	03/19/2001	*	*	*	*	*	*	*
03/19/2001	03/26/2001	*	*	*	*	*	*	*
03/26/2001	04/02/2001	*	*	*	*	*	*	*
04/02/2001	04/09/2001	*	*	*	*	*	*	*
04/09/2001	04/16/2001	*	*	*	*	*	2	*
04/16/2001	04/23/2001	*	*	*	*	*	*	*
04/23/2001	04/30/2001	*	*	*	*	*	*	*
04/30/2001	05/07/2001	*	*	*	*	*	*	*
05/07/2001	05/14/2001	*	*	*	*	*	*	*
05/14/2001	05/21/2001	*	*	*	*	*	*	*
05/21/2001	05/29/2001	*	*	*	*	*	*	*
05/29/2001	06/04/2001	*	*	*	*	*	*	*
06/04/2001	06/11/2001	*	*	*	*	*	*	*
06/11/2001	06/18/2001	*	*	*	*	*	*	*
06/18/2001	06/25/2001	*	*	*	*	*	*	*
06/25/2001	07/02/2001	*	*	*	*	*	*	*
07/02/2001	07/09/2001	*	*	*	*	*	*	*
07/09/2001	07/16/2001	*	*	*	*	*	*	*
07/16/2001	07/23/2001	*	*	*	*	*	*	*
07/23/2001	07/30/2001	*	*	*	*	*	*	*

* < MDA

¹ Control Location² Sampler malfunction/low flow

Table E-5 - Continued

**Concentration of Iodine-131 in Filtered Air
(Results in units of 10^{-3} pCi/m³ \pm 2 σ)**

Start Date	Stop Date	A6 Long Beach	A7 ¹ Taylors Island	CAM Cambridge	SFA1 MET Station	SFA2 ¹ Visitors Center	SFA3 NNW of ISFSI	SFA4 South of ISFSI
07/30/2001	08/06/2001	*	*	*	*	*	*	*
08/06/2001	08/13/2001	*	*	*	*	*	*	*
08/13/2001	08/20/2001	*	*	*	*	*	*	*
08/20/2001	08/27/2001	*	*	*	*	*	*	*
08/27/2001	09/03/2001	*	*	*	*	*	*	*
09/04/2001	09/10/2001	*	*	*	*	*	*	*
09/10/2001	09/17/2001	*	*	*	*	*	*	*
09/17/2001	09/24/2001	*	*	*	*	*	*	*
09/24/2001	10/01/2001	*	*	*	*	*	*	*
10/01/2001	10/08/2001	*	*	*	*	*	*	*
10/08/2001	10/15/2001	*	*	*	*	*	*	*
10/15/2001	10/22/2001	*	*	*	*	*	*	*
10/22/2001	10/29/2001	*	*	*	*	*	*	*
10/29/2001	11/05/2001	*	*	*	*	*	*	*
11/05/2001	11/12/2001	*	*	*	*	*	*	*
11/12/2001	11/19/2001	*	*	*	*	*	*	*
11/19/2001	11/26/2001	*	*	*	*	*	*	*
11/26/2001	12/03/2001	*	*	*	*	*	*	*
12/03/2001	12/10/2001	*	*	*	*	*	*	*
12/10/2001	12/17/2001	*	*	*	*	*	*	*
12/17/2001	12/26/2001	*	*	*	*	*	*	*
12/26/2001	12/31/2001	*	*	*	*	*	*	*

* < MDA

¹ Control Location

Table E-6

**Concentration of Beta Emitters in Air Particulates
(Results in units of 10^{-2} pCi/m³ \pm 2 σ)**

Start Date	Stop Date	A6 Long Beach	A7 ¹ Taylors Island	CAM Cambridge
01/02/2001	01/08/2001	1.4 \pm 0.2	1.8 \pm 0.2	1.8 \pm 0.2
01/08/2001	01/15/2001	1.9 \pm 0.2	1.8 \pm 0.2	1.9 \pm 0.2
01/15/2001	01/22/2001	1.4 \pm 0.2	2.1 \pm 0.2	1.8 \pm 0.2
01/22/2001	01/29/2001	2.6 \pm 0.2	2.3 \pm 0.2	2.2 \pm 0.2
01/29/2001	02/05/2001	1.6 \pm 0.2	2.0 \pm 0.2	1.9 \pm 0.2
02/05/2001	02/12/2001	1.8 \pm 0.2	1.8 \pm 0.2	1.7 \pm 0.2
02/12/2001	02/20/2001	2.2 \pm 0.2	2.8 \pm 0.2	3.0 \pm 0.3
02/20/2001	02/26/2001	2.1 \pm 0.2	2.1 \pm 0.2	2.2 \pm 0.2
02/26/2001	03/05/2001	1.7 \pm 0.2	2.0 \pm 0.2	1.9 \pm 0.2
03/05/2001	03/12/2001	1.2 \pm 0.2	1.1 \pm 0.2	1.1 \pm 0.2
03/12/2001	03/19/2001	1.0 \pm 0.2	1.4 \pm 0.2	1.3 \pm 0.2
03/19/2001	03/26/2001	1.5 \pm 0.2	1.9 \pm 0.2	1.6 \pm 0.2
03/26/2001	04/02/2001	1.0 \pm 0.2	1.0 \pm 0.2	0.9 \pm 0.2
04/02/2001	04/09/2001	1.4 \pm 0.2	1.7 \pm 0.2	1.2 \pm 0.2
04/09/2001	04/16/2001	1.2 \pm 0.2	1.9 \pm 0.2	1.3 \pm 0.2
04/16/2001	04/23/2001	2.2 \pm 0.2	2.7 \pm 0.2	2.3 \pm 0.2
04/23/2001	04/30/2001	1.7 \pm 0.2	2.4 \pm 0.2	2.5 \pm 0.2
04/30/2001	05/07/2001	1.5 \pm 0.2	2.0 \pm 0.2	1.7 \pm 0.2
05/07/2001	05/14/2001	1.6 \pm 0.2	2.1 \pm 0.2	1.6 \pm 0.2
05/14/2001	05/21/2001	0.8 \pm 0.2	0.6 \pm 0.2	0.6 \pm 0.1
05/21/2001	05/29/2001	1.0 \pm 0.1	1.7 \pm 0.2	1.0 \pm 0.1
05/29/2001	06/04/2001	1.0 \pm 0.2	1.2 \pm 0.2	0.8 \pm 0.1
06/04/2001	06/11/2001	1.4 \pm 0.2	1.8 \pm 0.2	1.5 \pm 0.2
06/11/2001	06/18/2001	1.4 \pm 0.2	1.7 \pm 0.2	1.4 \pm 0.2
06/18/2001	06/25/2001	1.3 \pm 0.2	1.8 \pm 0.2	1.4 \pm 0.2
06/25/2001	07/02/2001	1.4 \pm 0.2	1.7 \pm 0.2	1.5 \pm 0.2
07/02/2001	07/09/2001	1.0 \pm 0.2	1.4 \pm 0.2	1.8 \pm 0.2
07/09/2001	07/16/2001	1.5 \pm 0.2	1.6 \pm 0.2	1.2 \pm 0.2
07/16/2001	07/23/2001	1.5 \pm 0.2	1.8 \pm 0.2	1.4 \pm 0.2
07/23/2001	07/30/2001	0.9 \pm 0.2	1.7 \pm 0.2	0.9 \pm 0.1

¹ Control Location

Table E-6 - Continued

**Concentration of Beta Emitters in Air Particulates
(Results in units of 10^{-2} pCi/m³ \pm 2 σ)**

Start Date	Stop Date	A6 Long Beach	A7 ¹ Taylors Island	CAM Cambridge
07/30/2001	08/06/2001	1.4 \pm 0.2	1.7 \pm 0.2	1.4 \pm 0.2
08/06/2001	08/13/2001	1.6 \pm 0.2	1.1 \pm 0.2	1.6 \pm 0.2
08/13/2001	08/20/2001	2.1 \pm 0.2	2.2 \pm 0.2	1.8 \pm 0.2
08/20/2001	08/27/2001	2.0 \pm 0.2	2.3 \pm 0.2	1.5 \pm 0.2
08/27/2001	09/03/2001	1.8 \pm 0.2	2.2 \pm 0.2	1.6 \pm 0.2
09/04/2001	09/10/2001	1.7 \pm 0.2	2.0 \pm 0.2	1.5 \pm 0.2
09/10/2001	09/17/2001	1.6 \pm 0.2	1.8 \pm 0.2	1.7 \pm 0.2
09/17/2001	09/24/2001	2.0 \pm 0.3	1.4 \pm 0.2	1.4 \pm 0.2
09/24/2001	10/01/2001	1.1 \pm 0.2	1.7 \pm 0.2	1.3 \pm 0.2
10/01/2001	10/08/2001	2.0 \pm 0.2	2.4 \pm 0.2	2.4 \pm 0.2
10/08/2001	10/15/2001	0.9 \pm 0.2	1.5 \pm 0.2	1.1 \pm 0.2
10/15/2001	10/22/2001	1.4 \pm 0.2	1.4 \pm 0.2	2.4 \pm 0.2
10/22/2001	10/29/2001	1.5 \pm 0.2	0.9 \pm 0.1	1.5 \pm 0.2
10/29/2001	11/05/2001	2.5 \pm 0.3	2.0 \pm 0.2	2.8 \pm 0.3
11/05/2001	11/12/2001	2.5 \pm 0.3	1.8 \pm 0.2	2.5 \pm 0.3
11/12/2001	11/19/2001	3.3 \pm 0.3	2.1 \pm 0.2	2.9 \pm 0.3
11/19/2001	11/26/2001	2.0 \pm 0.3	1.3 \pm 0.2	2.2 \pm 0.2
11/26/2001	12/03/2001	2.4 \pm 0.3	2.0 \pm 0.2	2.5 \pm 0.3
12/03/2001	12/10/2001	3.4 \pm 0.3	1.5 \pm 0.2	1.9 \pm 0.2
12/10/2001	12/17/2001	3.2 \pm 0.3	1.3 \pm 0.2	2.3 \pm 0.3
12/17/2001	12/26/2001	2.5 \pm 0.3	1.8 \pm 0.2	2.3 \pm 0.2
12/26/2001	12/31/2001	4.1 \pm 0.5	2.4 \pm 0.2	3.2 \pm 0.3

¹ Control Location

Table E-7

Concentration of Gamma Emitters in Air Particulates
(Results in units of 10^{-3} pCi/m³ \pm 2 σ)

Sample Date	A6 Long Beach	A7 ¹ Taylors Island	CAM Cambridge
01/15/2001	*	*	*
02/15/2001	*	*	*
03/15/2001	*	*	*
04/15/2001	*	*	*
05/15/2001	*	*	*
06/15/2001	*	*	*
07/15/2001	*	*	*
08/15/2001	*	*	*
09/15/2001	*	*	*
10/15/2001	*	*	*
11/15/2001	*	*	*
12/15/2001	*	*	*

* Non-Natural Gamma Emitters < MDA

¹ Control Location

Table E-8

**Concentration of Tritium and Gamma Emitters
in Taylors Island Well Water
(Results in units of pCi/L $\pm 2\sigma$)**

Sample Date	H-3	Gamma Emitters
01/02/2001	<37	*
02/06/2001	<39	*
02/27/2001	<38	*
04/03/2001	<38	*
05/01/2001	<39	*
06/05/2001	<39	*
06/27/2001	<39	*
07/31/2001	<40	*
09/04/2001	<40	*
10/02/2001	<40	*
10/30/2001	<39	*
12/04/2001	<39	*

* Non-Natural Gamma Emitters < MDA

Table E-9

**Direct Radiation as Measured in Pressurized Ion Chamber
(Results in units of mR/30 days \pm 10%)**

Sample Code	Month		Month	
PIC1 ¹ Taylor's Island	JAN	5.78 \pm 0.58	FEB	5.66 \pm 0.57
	MAR	5.92 \pm 0.59	APR	5.84 \pm 0.84
	MAY	6.33 \pm 0.63	JUN	5.99 \pm 0.60
	JUL	6.00 \pm 0.60	AUG	5.71 \pm 0.57
	SEP	6.04 \pm 0.60	OCT	6.10 \pm 0.61
	NOV	6.56 \pm 0.66	DEC	6.50 \pm 0.60
	PIC2 Entrance to Conoy Camp	JAN	4.37 \pm 0.44	FEB
MAR		4.34 \pm 0.43	APR	4.25 \pm 0.42
MAY		4.33 \pm 0.43	JUN	3.63 \pm 0.36
JUL		3.72 \pm 0.37	AUG	3.64 \pm 0.36
SEP		3.65 \pm 0.36	OCT	3.69 \pm 0.37
NOV		4.04 \pm 0.40	DEC	4.17 \pm 0.42
PIC3 MET Station		JAN	4.97 \pm 0.50	FEB
	MAR	4.91 \pm 0.49	APR	4.88 \pm 0.49
	MAY	5.65 \pm 0.56	JUN	5.51 \pm 0.55
	JUL	5.57 \pm 0.56	AUG	6.13 \pm 0.61
	SEP	5.33 \pm 0.53	OCT	5.89 \pm 0.59
	NOV	5.28 \pm 0.53	DEC	5.05 \pm 0.51
	PIC4 NNW of ISFSI	JAN	10.34 \pm 1.03	FEB
MAR		10.24 \pm 1.02	APR	10.18 \pm 1.02
MAY		10.82 \pm 1.08	JUN	10.60 \pm 1.06
JUL		10.60 \pm 1.06	AUG	10.30 \pm 1.03
SEP		10.14 \pm 1.01	OCT	10.32 \pm 1.03
NOV		10.33 \pm 1.03	DEC	10.34 \pm 1.03
PIC5 S of ISFSI		JAN	4.93 \pm 0.49	FEB
	MAR	4.89 \pm 0.49	APR	4.77 \pm 0.48
	MAY	4.92 \pm 0.49	JUN	5.00 \pm 0.50
	JUL	5.08 \pm 0.51	AUG	4.97 \pm 0.50
	SEP	4.95 \pm 0.50	OCT	4.97 \pm 0.50
	NOV	5.28 \pm 0.53	DEC	5.21 \pm 0.52
	PIC8 Visitor's Center	JAN	4.97 \pm 0.50	FEB
MAR		4.91 \pm 0.49	APR	4.83 \pm 0.48
MAY		4.93 \pm 0.49	JUN	4.84 \pm 0.48
JUL		4.94 \pm 0.49	AUG	4.87 \pm 0.49
SEP		4.88 \pm 0.49	OCT	4.93 \pm 0.49
NOV		4.93 \pm 0.49	DEC	4.86 \pm 0.49

¹ Control Location

Table E-10

Direct Radiation
(Results in units of mR/90 days \pm 2 σ)

Site Code	Location	First Quarter	Second Quarter	Third Quarter	Fourth Quarter
DR24	Rt. 4 and Parran Rd.	10.53 \pm 0.96	11.97 \pm 0.99	12.01 \pm 0.60	11.91 \pm 1.39
DR25	Camp Conoy Guard House	11.59 \pm 0.82	12.63 \pm 0.53	12.99 \pm 0.73	12.11 \pm 1.83
DR26	Rt. 234 and Clark's Landing Road	10.14 \pm 0.83	11.75 \pm 0.75	11.53 \pm 1.59	10.31 \pm 0.30
DR27	Rt. 231 and Rt. 4	10.87 \pm 0.59	11.35 \pm 0.45	11.69 \pm 0.67	10.67 \pm 0.88
DR28	Taylor's Is. Siren #35	12.65 \pm 1.44	14.37 \pm 1.87	15.11 \pm 2.84	14.25 \pm 0.94
DR29	Taylor's Is. Siren #38	12.87 \pm 1.52	14.01 \pm 1.19	14.29 \pm 1.07	13.87 \pm 1.49
DR31	Cambridge	12.61 \pm 1.06	15.57 \pm 1.10	15.54 \pm 1.95	13.94 \pm 0.55
DR32	Twining Property, Taylor's Island	9.40 \pm 0.80	10.75 \pm 0.57	10.31 \pm 0.45	9.71 \pm 1.06
DR33	P. A. Ransome Property	¹	15.39 \pm 0.62	14.92 \pm 1.57	13.91 \pm 1.07
DR34	Shoreline at Barge Rd.	8.71 \pm 1.38	10.13 \pm 0.38	10.43 \pm 1.06	8.92 \pm 1.18

¹ Missing Data

Table E-11

**Direct Radiation from Resin Storage Area
(Results in units of mR/90 days $\pm 2\sigma$)**

Site Code	Location	First Quarter	Second Quarter	Third Quarter	Fourth Quarter
RPDR05	North Fence Lower	16.07 \pm 2.15	51.86 \pm 8.62	38.54 \pm 1.33	17.54 \pm 1.39
RPDR06	North Fence Upper	16.88 \pm 2.85	129.45 \pm 9.27	50.32 \pm 3.06	20.19 \pm 1.10
RPDR07	West Fence Right	27.94 \pm 0.25	166.45 \pm 19.68	154.74 \pm 20.33	23.16 \pm 1.96
RPDR08	West Fence Left	16.66 \pm 2.16	124.63 \pm 19.70	146.91 \pm 12.08	19.72 \pm 1.29
RPDR09	South Fence Upper	32.02 \pm 4.27	113.28 \pm 10.98	122.34 \pm 20.39	19.62 \pm 1.52
RPDR10	South Fence Lower	29.56 \pm 0.96	48.70 \pm 5.22	52.91 \pm 5.40	21.49 \pm 2.38
RPDR11	East Fence Left	11.82 \pm 1.22	17.39 \pm 3.12	16.91 \pm 1.64	12.68 \pm 1.75
RPDR12	East Fence Right	21.36 \pm 2.90	29.98 \pm 3.19	32.08 \pm 5.68	21.98 \pm 3.18