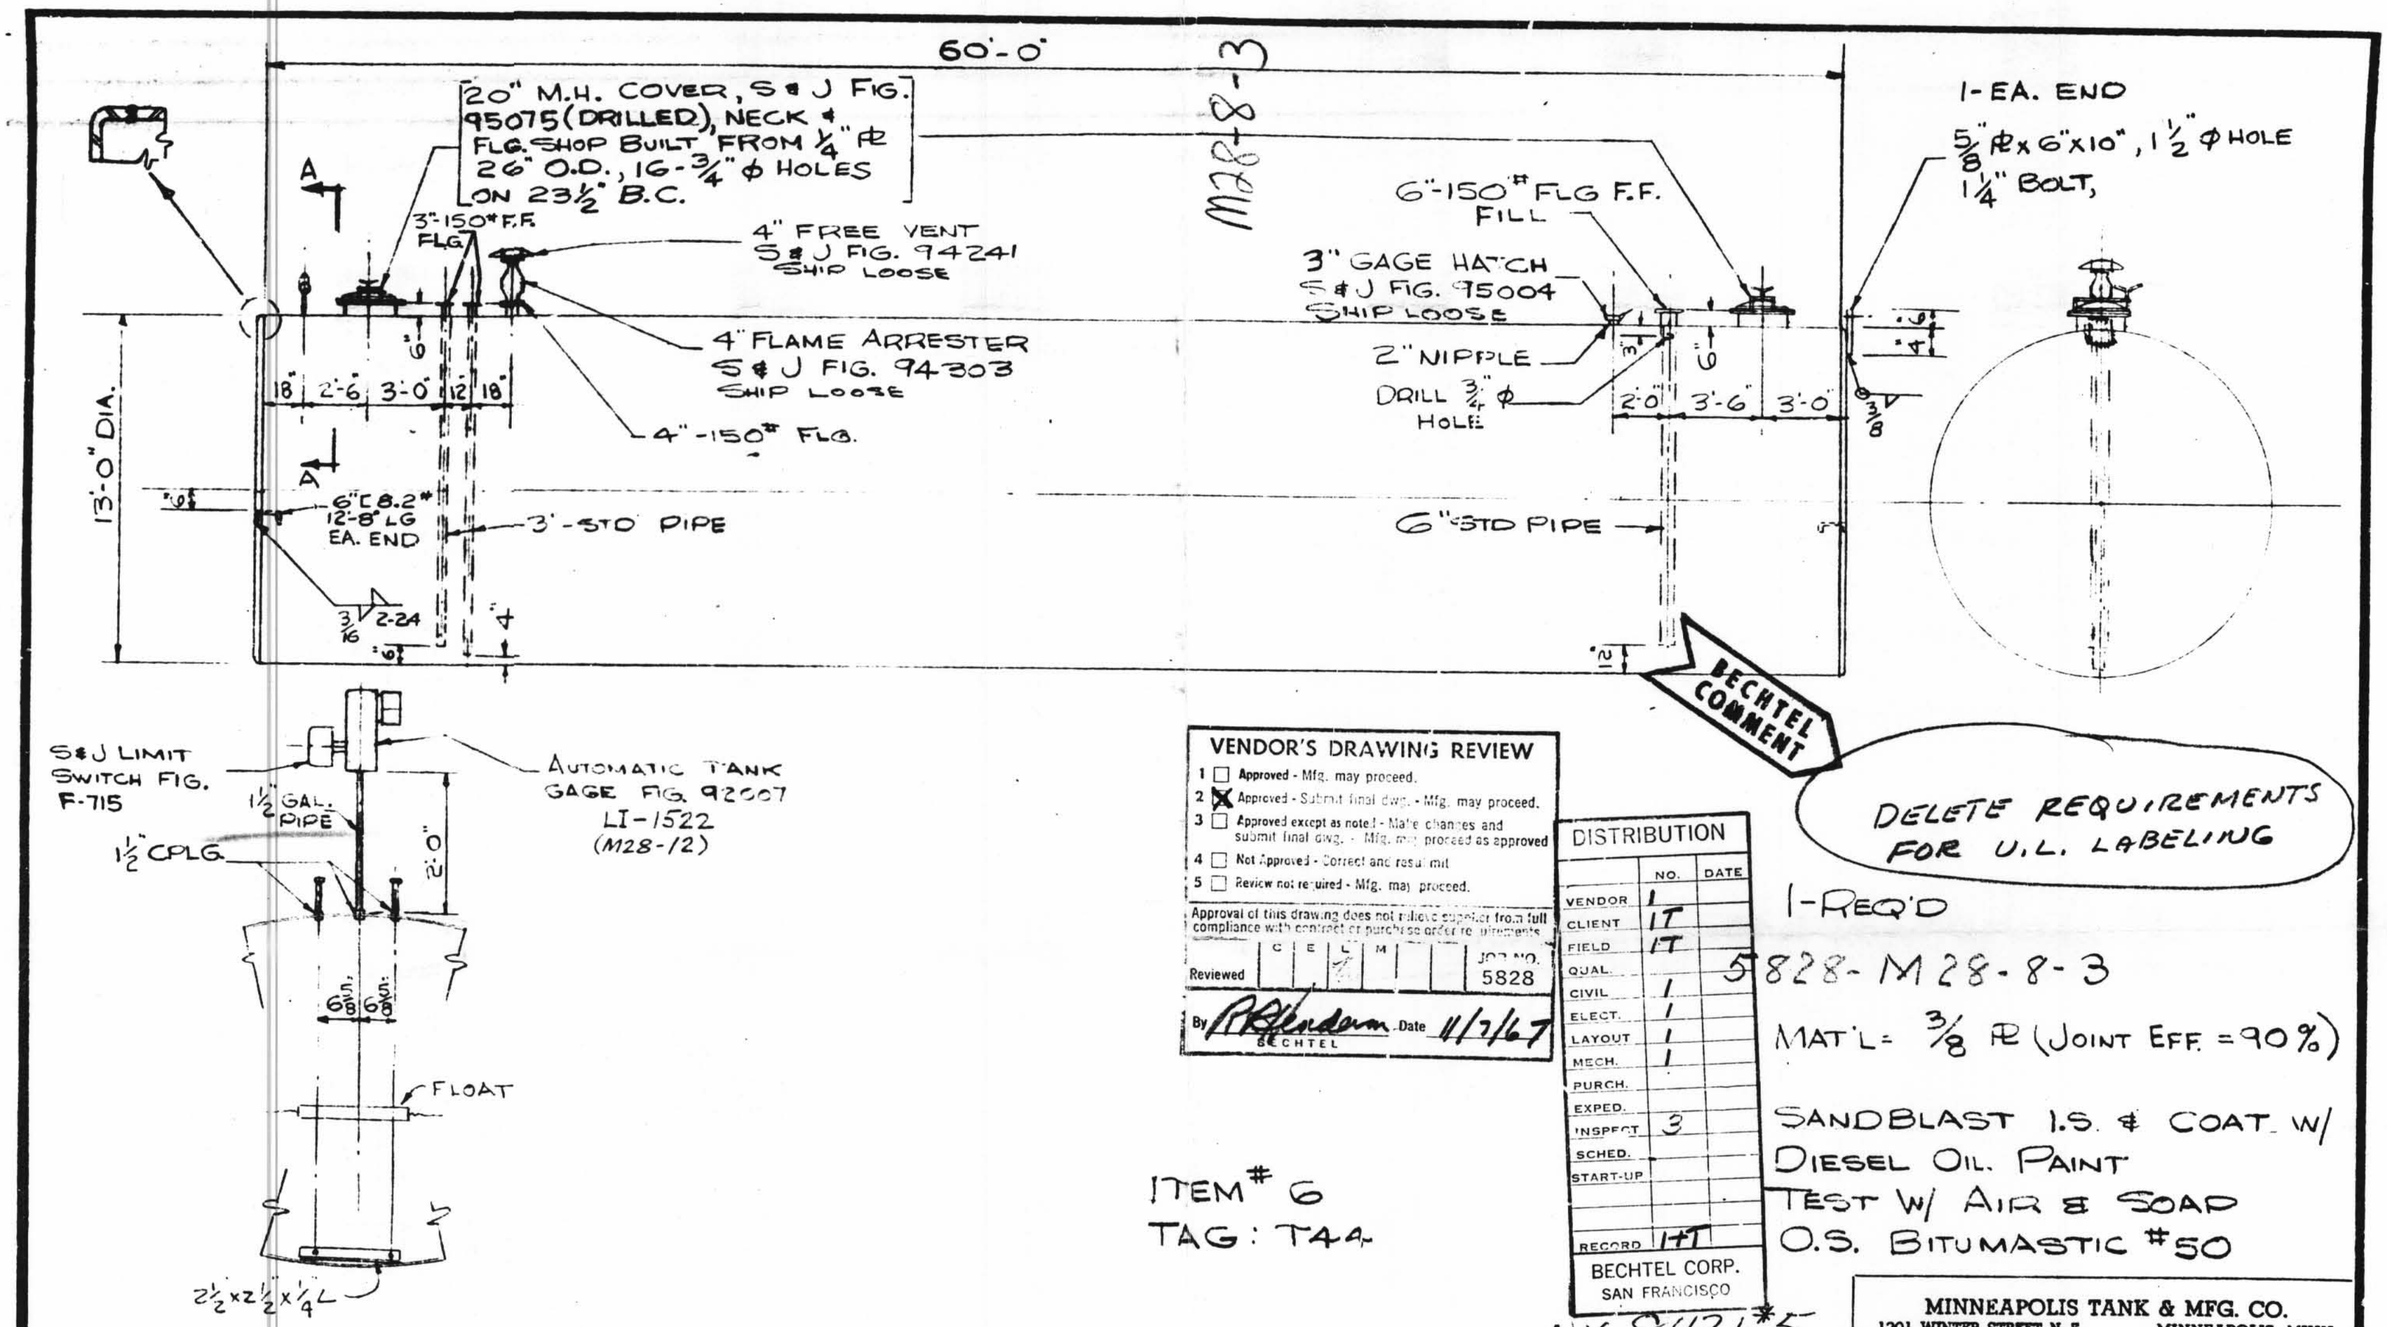

VENDOR'S DRAWING REVIEW

1 ☐ Approved - Mfg. may proceed.
2 ☒ Approved - Submit final dwg. - Mfg. may proceed.
3 ☐ Approved except as noted - Make changes and submit final dwg. - Mfg. may proceed as approved
4 ☐ Not Approved - Correct and resubmit
5 ☐ Review not required - Mfg. may proceed.

Approval of this drawing does not relieve supplier from full compliance with contract or purchase order requirements.

Reviewed | C | E | L | M | JOB NO. 5828

By R. Henderson Date 11/7/67
BECHTEL

DISTRIBUTION	NO.	DATE
VENDOR	1	
CLIENT	IT	
FIELD	IT	
QUAL.		
CIVIL	1	
ELECT.	1	
LAYOUT	1	
MECH.	1	
PURCH.		
EXPED.		
INSPECT	3	
SCHED.		
START-UP		
RECORD	IT	

BECHTEL CORP.
SAN FRANCISCO

1-REQ'D

5828-M28-8-3

MAT'L = 3/8 PL (JOINT EFF. = 90%)

SANDBLAST I.S. & COAT W/ DIESEL OIL PAINT
TEST W/ AIR & SOAP
O.S. BITUMASTIC #50

ITEM # 6
TAG: T44

NX-8431-5

FOR: N.S.P. NUCLEAR GEN. PLANT
MONTICELLO, MINN.
P.O. 5828-M-28-AC

MINNEAPOLIS TANK & MFG. CO.
1201 WINTER STREET N. E. MINNEAPOLIS, MINN.

50,000 GAL U.G. OIL TK
for BECHTEL CORP.

SCALE 3/16" = 1'	DWN STENSETH	DATE 9-5-67
S.O. 29591	CKD	DWG B779R3

NOV 6 1967

D-1