

50-387/588

MANUAL HARD COPY DISTRIBUTION

DOCUMENT TRANSMITTAL 2002-26461

USER INFORMATION:

~~FLAIRM*LAUREL B~~ EMPL#:23244 CA#: 0386

~~Address: NUGSA2~~

Phone#: 254-3658

TRANSMITTAL INFORMATION:

TO: ~~FLAIRM*LAUREL B~~ 05/24/2002
LOCATION: DOCUMENT CONTROL DESK
FROM: NUCLEAR RECORDS DOCUMENT CONTROL CENTER
(NUCSA-2)

THE FOLLOWING CHANGES HAVE OCCURRED TO THE HARDCOPY OR ELECTRONIC MANUAL ASSIGNED TO YOU:

132 - 132 - OSC COORDINATOR: EMERGENCY PLAN-
POSITION SPECIFIC PROCEDURE

REMOVE MANUAL TABLE OF CONTENTS DATE: 01/03/2002

ADD MANUAL TABLE OF CONTENTS DATE: 05/23/2002

CATEGORY: PROCEDURES TYPE: EP
ID: EP-PS-132

No Table of Contents

No Procedure

Replace contents of Tab 7

ALL DOCUMENTS WILL BE DISTRIBUTED IN ACCORDANCE WITH DEPARTMENT PROCEDURES. PLEASE MAKE ALL CHANGES AND ACKNOWLEDGE COMPLETE IN YOUR NIMS INBOX UPON RECEIPT OF HARD COPY. FOR ELECTRONIC MANUAL USERS, ELECTRONICALLY REVIEW THE APPROPRIATE DOCUMENTS AND ACKNOWLEDGE COMPLETE IN YOUR NIMS INBOX.

A045

ALARA REVIEW

Check

A. PERSON-REM ESTIMATION

- _____ 1. Assess the number of workers required.
- 2. Evaluate the use of fewer workers.
- 3. Investigate experience of workers selected.
- 4. Assure all workers have essential, productive tasks.
- 5. Assure workers have available exposure.
- 6. Evaluate criteria for emergency exposure.

B. PLANNING

- _____ 1. Preplanning meeting with supervisors and/or workers required.
- 2. Access to and exit from work are planned.
- 3. Evaluate staging/setup in accessible low dose rate area.
- 4. Prefabrication considered.
- 5. Evaluate use of remote handling devices or other special tools.
- 6. Cold equipment "mockups", rehearsals, or other practical exercise.

C. EXPOSURE REDUCTION CONTROLS

- _____ 1. Evaluate need for timekeeping.
- 2. Consider use of water bucket shielding for carrying hot parts.
- 3. Consider use of shielded drums or lead "pigs" for carrying hot parts.
- 4. Consider use of temporary shielding such as lead wool blankets, lead sheets, or lead bricks.
- 5. Consider use of shadow shields utilizing a portable curtain shield.
- 6. System or equipment to be filled with water.
- 7. System or equipment to be drained and flushed.
- 8. Assess exposure reduction by permitting decay of radiation sources during reactor shutdown or system isolation.
- 9. Assess the need of communication devices such as head sets, TV cameras, others.
- 10. Assess practicality of removing component from radiation area.
- 11. Evaluate use of photographs of "as installed equipment" to aid in worker briefings.

D. AIRBORNE/CONTAMINATION CONTROL

- _____ 1. Assess need for respiratory protection usage against effectiveness of engineering controls.
- 2. Assess individual's history of internal DAC-Hr exposure to airborne contamination.
- 3. Assess necessity of area decon before commencement of work.
- 4. Containment structure (tent) required.
- 5. Portable ventilation system required.
- 6. Assess need for flooding or draining rooms.
- 7. Assess hot particle or fuel fragment migration.

Performed by _____

Provided below are the instructions on how to retrieve an individual's occupational exposure information.

1. Log into NIMS, go to RPDPERX screen.
2. Query the individual.
3. Click on DOSE SUMMARIES button.
4. The screen in Figure 1 will appear.
5. The individual's YEAR-TO-DATE (YTD) dose will be provided as 'NRC PERIOD EXPOSURE' for the current calendar year.

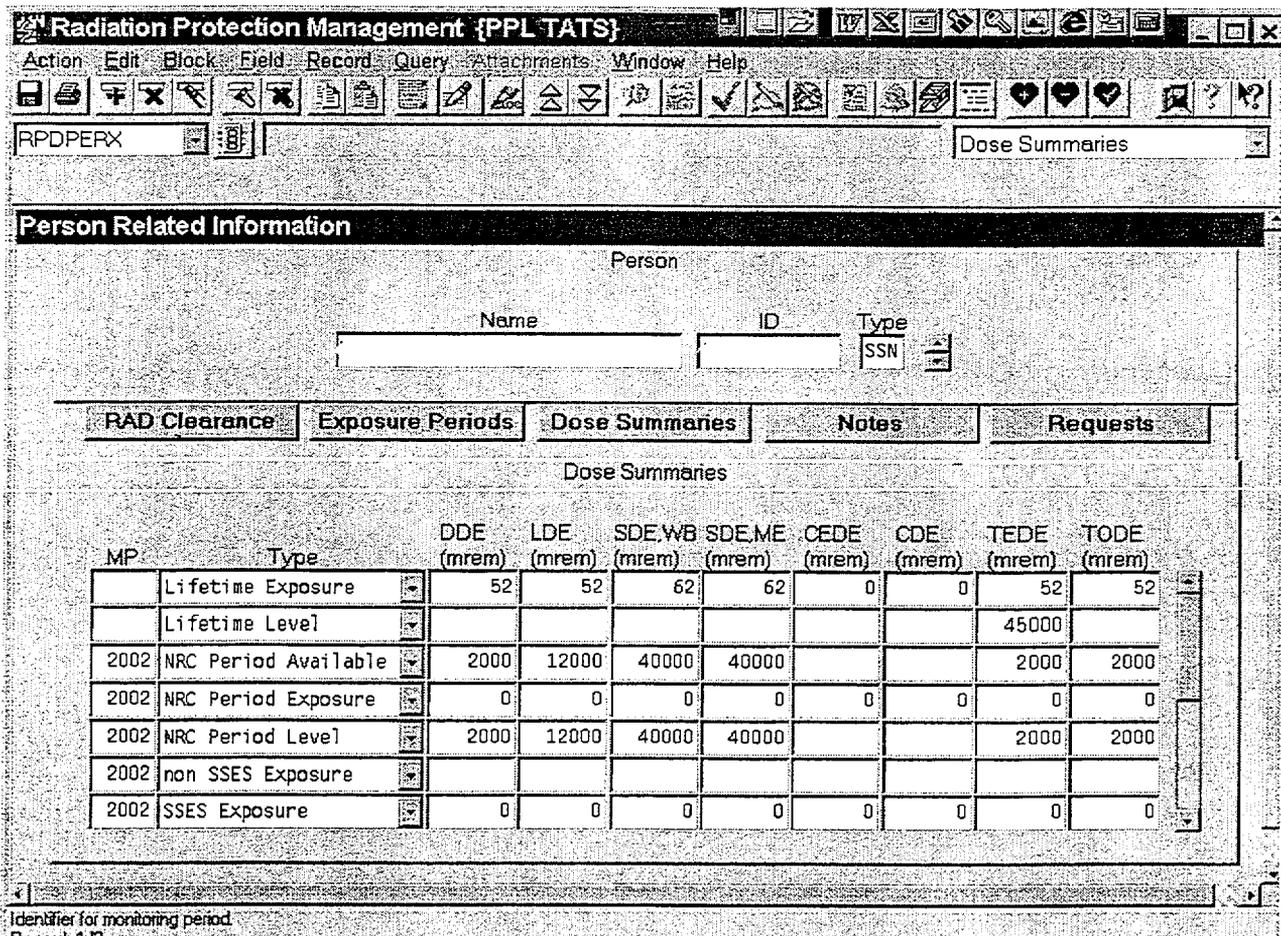


Figure 1

BREAKER TRIP CHECKOFF SHEET FOR LOAD SHED

INITIAL

1. To initiate the load shed for Unit 1 only:

Trip the following breakers in the Turbine Building:

<u>BREAKER#</u>	<u>LOCATION</u>
___ 1A101-11	Unit 1 Lower Switchgear Room (El. 699'-0")
___ 1A102-11	Unit 1 Lower Switchgear Room (El. 699'-0")

<u>Confirmed</u>	<u>Date</u>	<u>Time</u>
------------------	-------------	-------------

2. To initiate the load shed for Unit 2 only:

Trip the following breakers in the Turbine Building:

<u>BREAKER#</u>	<u>LOCATION</u>
___ 2A101-11	Unit 2 Lower Switchgear Room (El. 699'-0")
___ 2A102-11	Unit 2 Lower Switchgear Room (El. 699'-0")

<u>Confirmed</u>	<u>Date</u>	<u>Time</u>
------------------	-------------	-------------

EMERGENCY EXPOSURE EXTENSIONS

EXTENSION		APPROVAL	ACTIONS
FROM mrem (TEDE)	TO mrem (TEDE)		
2000	4000	ED, RPC, RM, or RSM	ALARA REVIEW
4000	<25000	ED and RPC/RM and RSM	ALL OF ABOVE AND APPLY EMERGENCY EXPOSURE CONSIDERATIONS
>25000		ED and RPC/RM and RSM	ALL OF ABOVE AND BRIEFING ON RISKS



TAB 7



