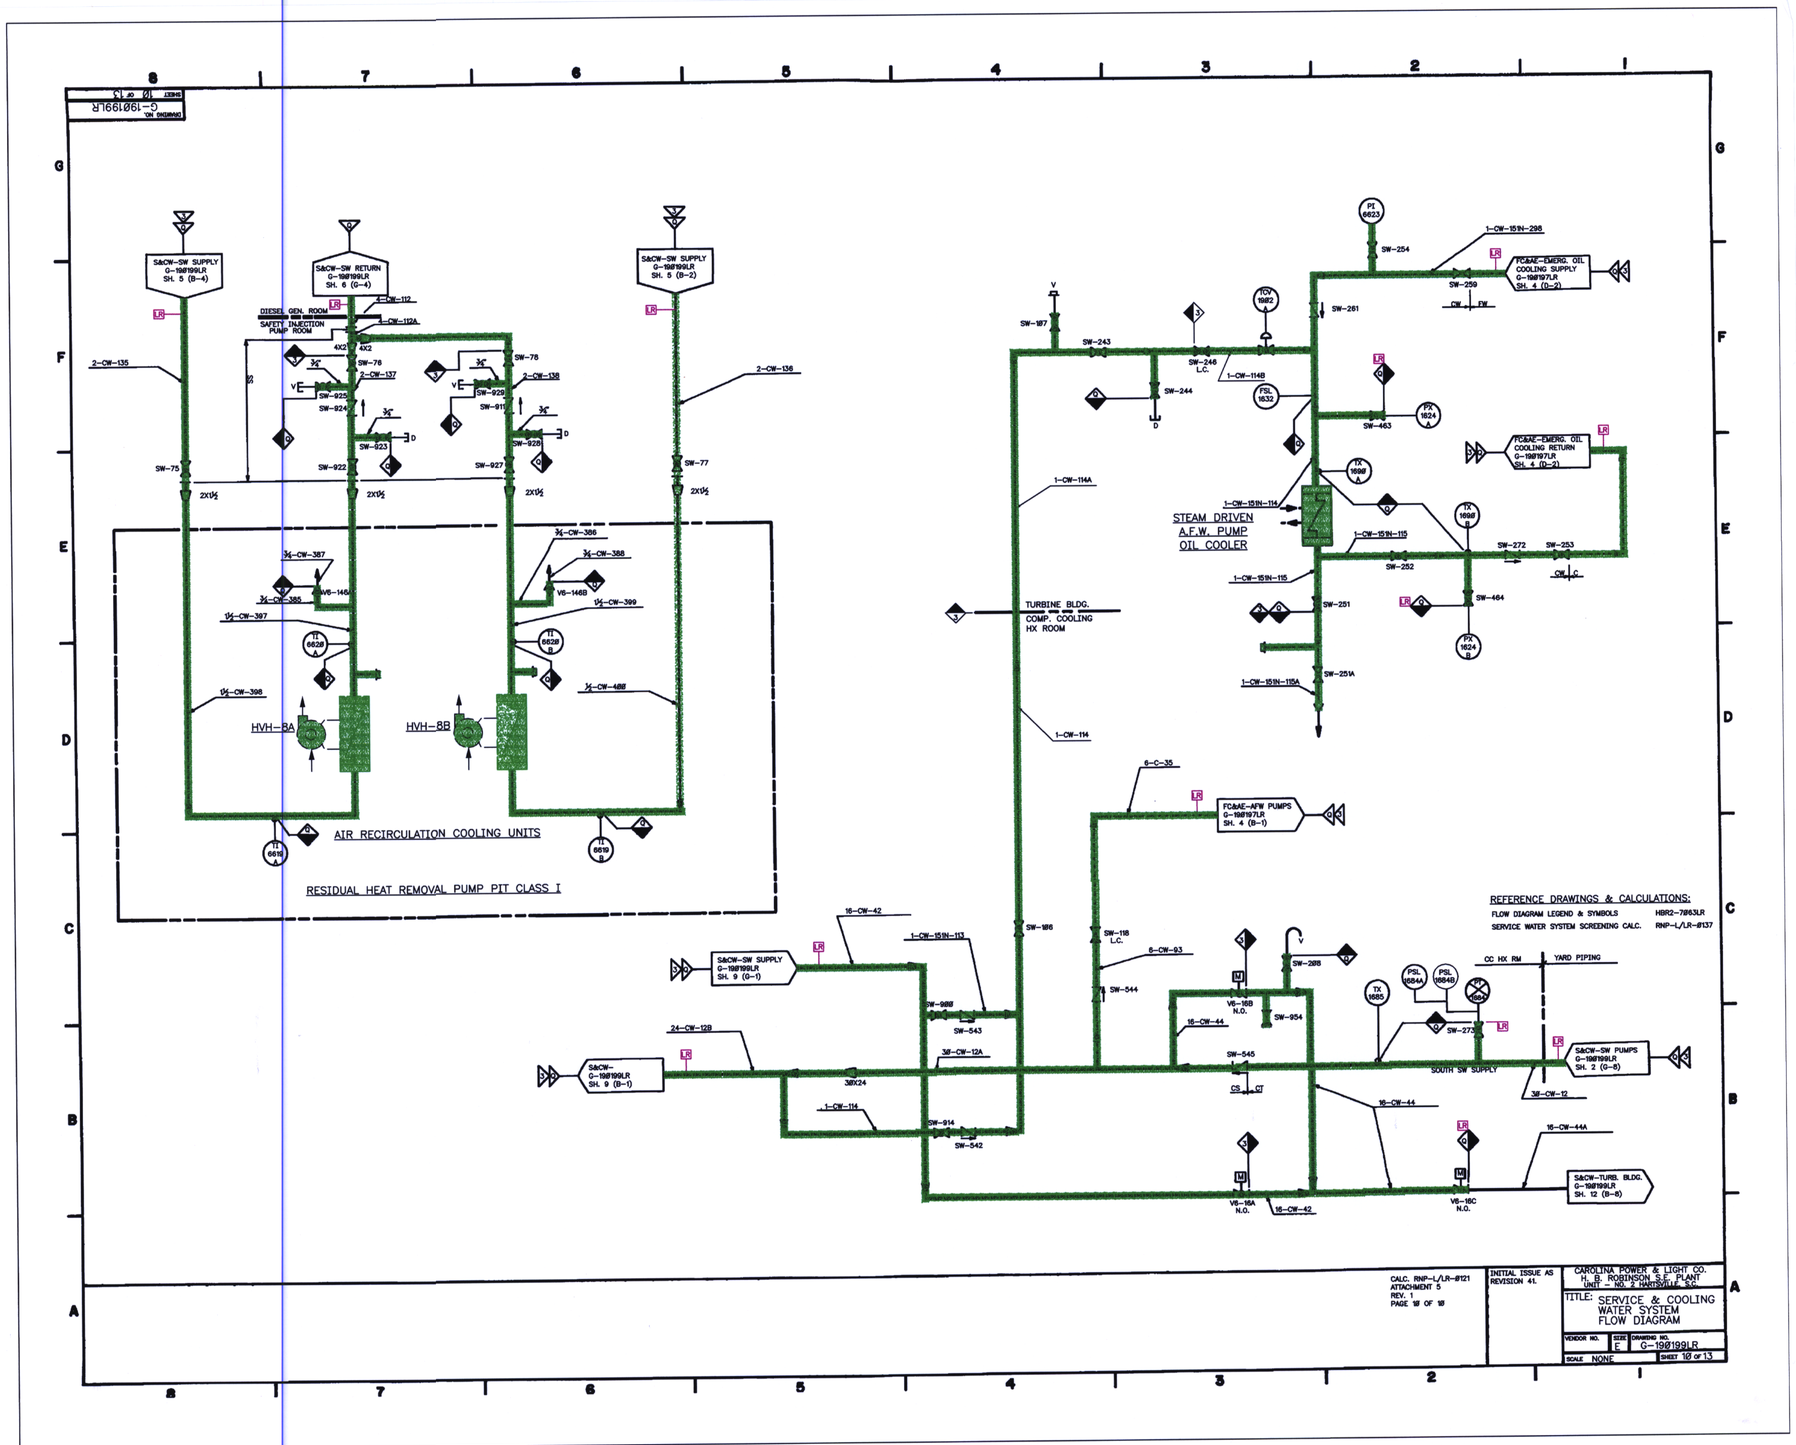

S&CW-SW SUPPLY G-190199LR SH. 5 (B-4)
S&CW-SW RETURN G-190199LR SH. 6 (G-4)
S&CW-SW SUPPLY G-190199LR SH. 5 (B-2)
DIESEL GEN. ROOM
SAFETY INJECTION PUMP ROOM
HVH-8A
HVH-8B
AIR RECIRCULATION COOLING UNITS
RESIDUAL HEAT REMOVAL PUMP PIT CLASS I
STEAM DRIVEN A.F.W. PUMP OIL COOLER
TURBINE BLDG. COMP. COOLING HX ROOM
FC&AE-EMERG. OIL COOLING SUPPLY G-190197LR SH. 4 (D-2)
FC&AE-EMERG. OIL COOLING RETURN G-190197LR SH. 4 (D-2)
FC&AE-AFW PUMPS G-190197LR SH. 4 (B-1)
S&CW-SW SUPPLY G-190199LR SH. 9 (G-1)
S&CW-SW PUMPS G-190199LR SH. 2 (G-8)
S&CW-TURB. BLDG. G-190199LR SH. 12 (B-8)
SOUTH SW SUPPLY
CC HX RM
YARD PIPING
REFERENCE DRAWINGS & CALCULATIONS:
FLOW DIAGRAM LEGEND & SYMBOLS HBR2-7063LR
SERVICE WATER SYSTEM SCREENING CALC. RNP-L/LR-0137
CALC. RNP-L/LR-0121 ATTACHMENT 5 REV. 1 PAGE 10 OF 10
INITIAL ISSUE AS REVISION 41.
CAROLINA POWER & LIGHT CO. H. B. ROBINSON S.E. PLANT UNIT - NO. 2 HARTSVILLE, S.C.
TITLE: SERVICE & COOLING WATER SYSTEM FLOW DIAGRAM
VENDOR NO.
SIZE E
DRAWING NO. G-190199LR
SCALE NONE
SHEET 10 OF 13

D-16