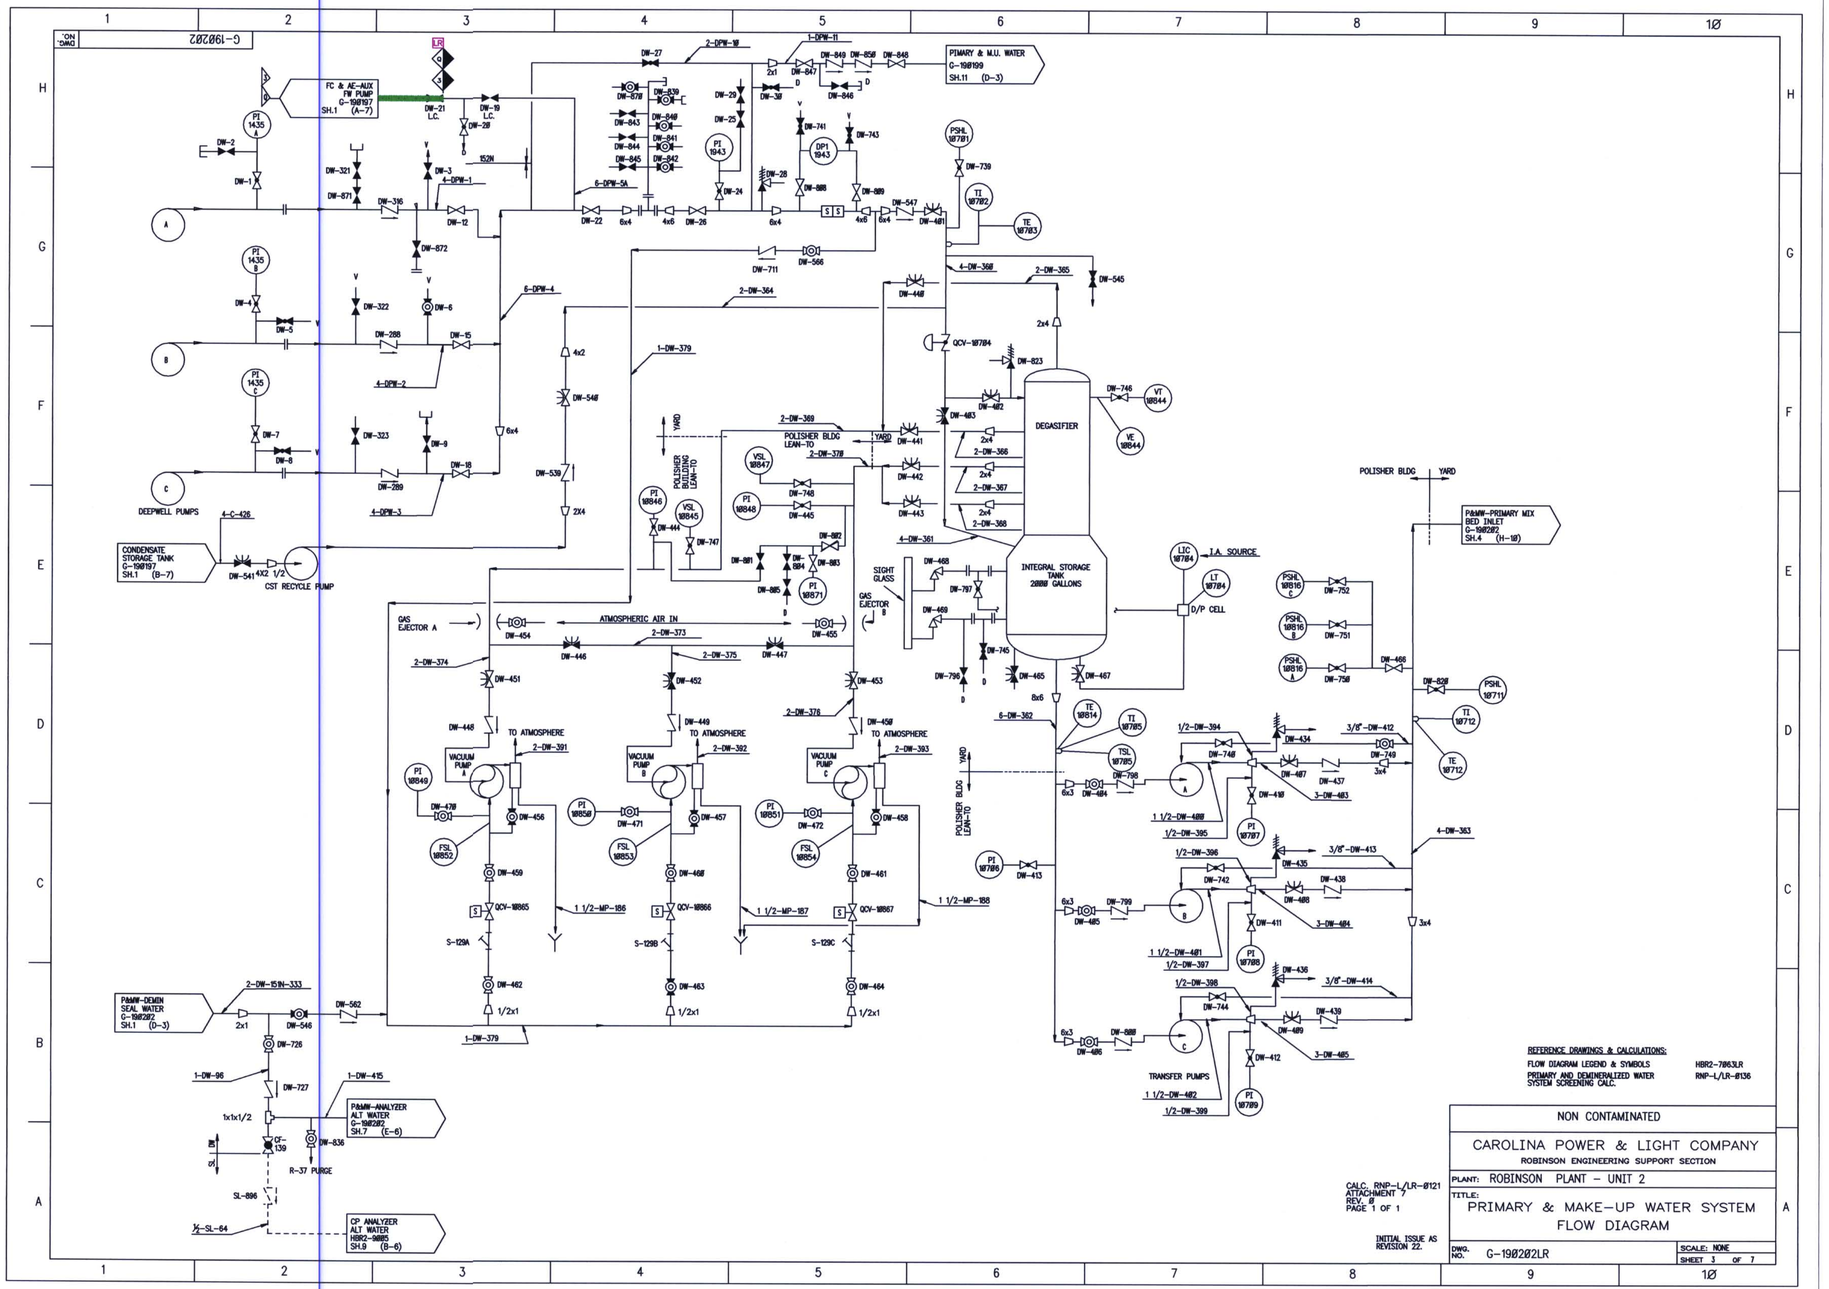
DEEPWELL PUMPS
CONDENSATE STORAGE TANK G-190197 SH.1 (B-7)
CST RECYCLE PUMP
FC & AE-AUX FW PUMP G-190197 SH.1 (A-7)
PRIMARY & M.U. WATER G-190199 SH.11 (D-3)
DEGASIFIER
INTEGRAL STORAGE TANK 200000 GALLONS
POLISHER BLDG LEAN-TO
POLISHER BUILDING LEAN-TO
YARD
SIGHT GLASS
GAS EJECTOR A
GAS EJECTOR B
ATMOSPHERIC AIR IN
VACUUM PUMP A
VACUUM PUMP B
VACUUM PUMP C
TO ATMOSPHERE
TRANSFER PUMPS
T.A SOURCE
D/P CELL
P&MW-PRIMARY MIX BED INLET G-190202 SH.4 (H-18)
P&MW-DEMIN SEAL WATER G-190202 SH.1 (D-3)
P&MW-ANALYZER ALT WATER G-190202 SH.7 (E-6)
CP ANALYZER ALT WATER HBR2-9882 SH.9 (B-6)
R-37 PURGE
REFERENCE DRAWINGS & CALCULATIONS:
FLOW DIAGRAM LEGEND & SYMBOLS HBR2-7863LR
PRIMARY AND DEMINERALIZED WATER SYSTEM SCREENING CALC. RNP-L/LR-0136
NON CONTAMINATED
CAROLINA POWER & LIGHT COMPANY
ROBINSON ENGINEERING SUPPORT SECTION
PLANT: ROBINSON PLANT - UNIT 2
TITLE: PRIMARY & MAKE-UP WATER SYSTEM FLOW DIAGRAM
DWG. NO. G-190202LR
SCALE: NONE
SHEET 3 OF 7
CALC. RNP-L/LR-0121 ATTACHMENT 7 REV. 0 PAGE 1 OF 1
INITIAL ISSUE AS REVISION 22.

D-21