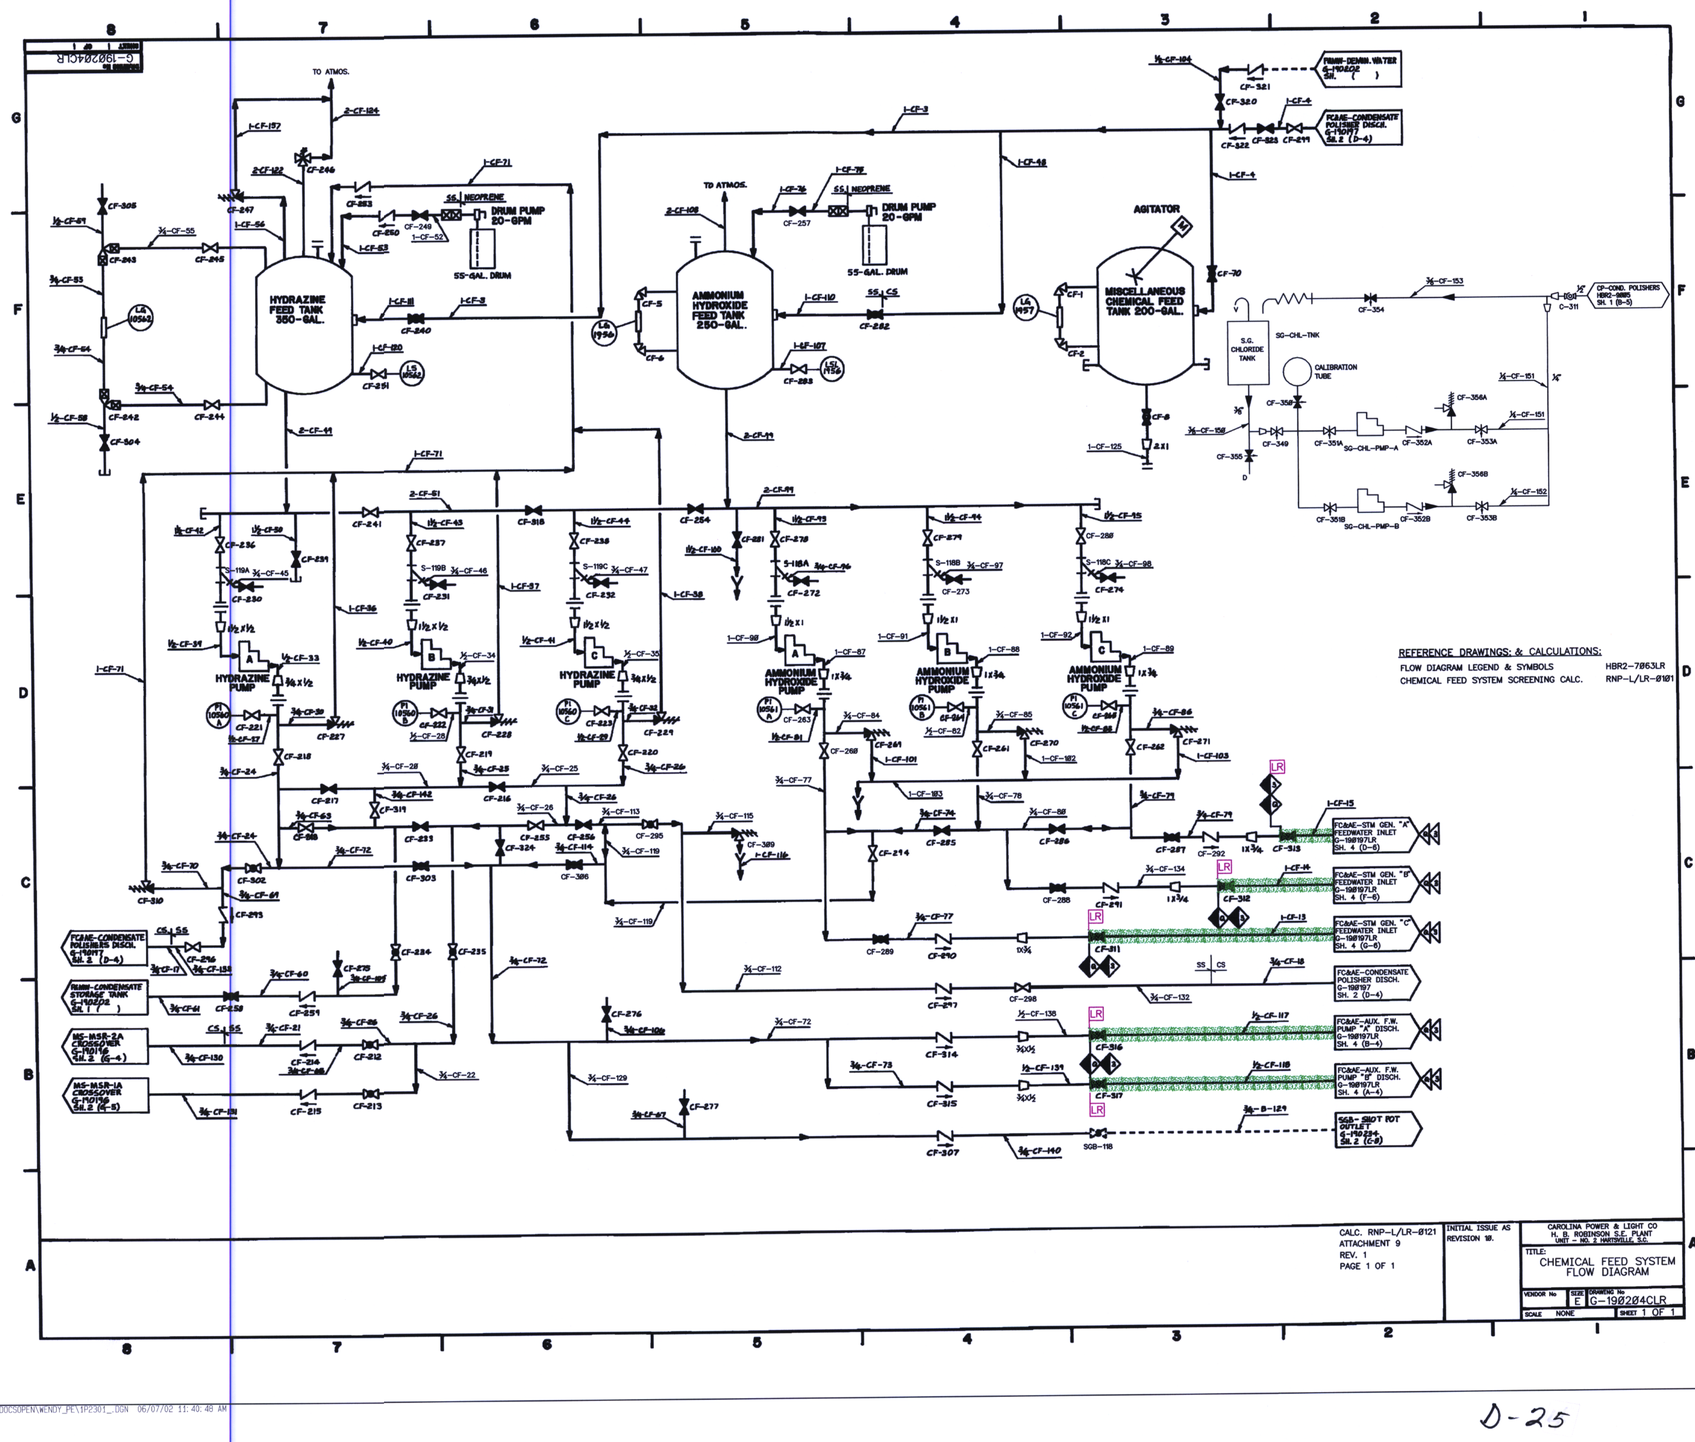
HYDRAZINE FEED TANK 350-GAL.
AMMONIUM HYDROXIDE FEED TANK 250-GAL.
MISCELLANEOUS CHEMICAL FEED TANK 200-GAL.
AGITATOR
TO ATMOS.
DRUM PUMP 20-GPM
55-GAL. DRUM
55 NEOPRENE
55 CS
S.G. CHLORIDE TANK
CALIBRATION TUBE
SG-CHL-TNK
SG-CHL-PMP-A
SG-CHL-PMP-B
HYDRAZINE PUMP
AMMONIUM HYDROXIDE PUMP
FROM-DEMIN. WATER G-190202 SH. ( )
FCAE-CONDENSATE POLISHER DISCH. G-190177 SH. 2 (D-4)
FCAE-CONDENSATE STORAGE TANK G-190202 SH. 1 ( )
MS-MSR-2A CROSSOVER G-190196 SH. 2 (G-4)
MS-MSR-1A CROSSOVER G-190196 SH. 2 (G-5)
FCAE-STM GEN. "A" FEEDWATER INLET G-198197LR SH. 4 (D-6)
FCAE-STM GEN. "B" FEEDWATER INLET G-198197LR SH. 4 (F-6)
FCAE-STM GEN. "C" FEEDWATER INLET G-198197LR SH. 4 (G-6)
FCAE-CONDENSATE POLISHER DISCH. G-198197 SH. 2 (D-4)
FCAE-AUX. F.W. PUMP "A" DISCH. G-198197LR SH. 4 (B-4)
FCAE-AUX. F.W. PUMP "B" DISCH. G-198197LR SH. 4 (A-4)
SGB-SHOT POT OUTLET 4-190224 SH. 2 (C-8)
CF-COND. POLISHERS HBR2-0885 SH. 1 (B-5)
REFERENCE DRAWINGS: & CALCULATIONS:
FLOW DIAGRAM LEGEND & SYMBOLS HBR2-7863LR
CHEMICAL FEED SYSTEM SCREENING CALC. RNP-L/LR-0101
CALC. RNP-L/LR-0121
ATTACHMENT 9
REV. 1
PAGE 1 OF 1
INITIAL ISSUE AS REVISION 18.
CAROLINA POWER & LIGHT CO
H. B. ROBINSON S.E. PLANT
UNIT - NO. 2 HARTSVILLE, S.C.
TITLE:
CHEMICAL FEED SYSTEM
FLOW DIAGRAM
VENDOR No
SIZE E
DRAWING No G-190204CLR
SCALE NONE
SHEET 1 OF 1
G-190204CLR

D-25