

Mr. Charles M. Dugger
Vice President Operations
Entergy Operations, Inc.
P. O. Box B
Killona, LA 70066

February 24, 1999

SUBJECT: WATERFORD STEAM ELECTRIC STATION, UNIT NO. 3 - CORRECTION TO
AMENDMENT NO. 147 TO FACILITY OPERATING LICENSE NPF-38 (TAC
NO. MA3382)

Dear Mr. Dugger:

On December 21, 1998, the Nuclear Regulatory Commission issued Amendment No. 147 to Facility Operating License No. NPF-38 for Waterford Steam Electric Station, Unit No. 3. This amendment involved changes in Technical Specifications affecting boron concentration in the Safety Injection Tanks and the Refueling Water Storage Pool in response to your application dated August 12, 1998.

Amendment No. 147 was issued with a typographical error in Figure 3.1-1. The word "ACCEPTABLE" should be "UNACCEPTABLE" in the lower portion of the figure. This error was introduced during processing of the Amendment. The corrected figure is enclosed.

We regret any inconvenience this oversight may have caused. If you have any questions, please call me at (301)- 415-3025.

Sincerely,

ORIGINAL SIGNED BY:

Chandu P. Patel, Project Manager
Project Directorate IV-1
Division of Licensing Project Management
Office of Nuclear Reactor Regulation

Docket No. 50-382

Enclosure: As stated

cc w/encl: See next page

DISTRIBUTION:

~~Docket File~~

C. Patel
K. Brockman, RIV
C. Lauron

PUBLIC
J. Hannon
ACRS
L. Hurley, RIV

PD4-1 r/f
C. Hawes
W. Beckner
J. Kilcrease, RIV

J. Zwolinski
G. Hill (2)
S. Black

Document Name: CORA3382.WPD

OFC	PM/PD4-1	LA/PD4-1	D/PD4-1
NAME	CPatel/vw	CHawes	JHannon
DATE	2/23/99	2/23/99	2/23/99
COPY	YES/NO	YES/NO	YES/NO

OFFICIAL RECORD COPY

9903010238 990224
PDR ADDCK 05000382
P PDR

11
DFol



UNITED STATES
NUCLEAR REGULATORY COMMISSION
WASHINGTON, D.C. 20555-0001

February 24, 1999

Mr. Charles M. Dugger
Vice President Operations
Entergy Operations, Inc.
P. O. Box B
Killona, LA 70066

SUBJECT: WATERFORD STEAM ELECTRIC STATION, UNIT NO. 3 - CORRECTION TO
AMENDMENT NO. 147 TO FACILITY OPERATING LICENSE NPF-38 (TAC
NO. MA3382)

Dear Mr. Dugger:

On December 21, 1998, the Nuclear Regulatory Commission issued Amendment No. 147 to Facility Operating License No. NPF-38 for Waterford Steam Electric Station, Unit No. 3. This amendment involved changes in Technical Specifications affecting boron concentration in the Safety Injection Tanks and the Refueling Water Storage Pool in response to your application dated August 12, 1998.

Amendment No. 147 was issued with a typographical error in Figure 3.1-1. The word "ACCEPTABLE" should be "UNACCEPTABLE" in the lower portion of the figure. This error was introduced during processing of the Amendment. The corrected figure is enclosed.

We regret any inconvenience this oversight may have caused. If you have any questions, please call me at (301)- 415-3025.

Sincerely,

Chandu P. Patel

Chandu P. Patel, Project Manager
Project Directorate IV-1
Division of Licensing Project Management
Office of Nuclear Reactor Regulation

Docket No. 50-382

Enclosure: As stated

cc w/encl: See next page

Mr. Charles M. Dugger
Entergy Operations, Inc.

Waterford 3

cc:

Administrator
Louisiana Radiation Protection Division
Post Office Box 82135
Baton Rouge, LA 70884-2135

Regional Administrator, Region IV
U.S. Nuclear Regulatory Commission
611 Ryan Plaza Drive, Suite 1000
Arlington, TX 76011

Vice President, Operations
Support
Entergy Operations, Inc.
P. O. Box 31995
Jackson, MS 39286

Resident Inspector/Waterford NPS
Post Office Box 822
Killona, LA 70066

Director
Nuclear Safety & Regulatory Affairs
Entergy Operations, Inc.
P. O. Box B
Killona, LA 70066

Parish President Council
St. Charles Parish
P. O. Box 302
Hahnville, LA 70057

Wise, Carter, Child & Caraway
P. O. Box 651
Jackson, MS 39205

Executive Vice-President
and Chief Operating Officer
Entergy Operations, Inc.
P. O. Box 31995
Jackson, MS 39286-1995

General Manager Plant Operations
Entergy Operations, Inc.
P. O. Box B
Killona, LA 70066

Chairman
Louisiana Public Service Commission
One American Place, Suite 1630
Baton Rouge, LA 70825-1697

Licensing Manager
Entergy Operations, Inc.
P. O. Box B
Killona, LA 70066

Winston & Strawn
1400 L Street, N.W.
Washington, DC 20005-3502

REQUIRED STORED BORIC ACID VOLUME AS A FUNCTION OF CONCENTRATION

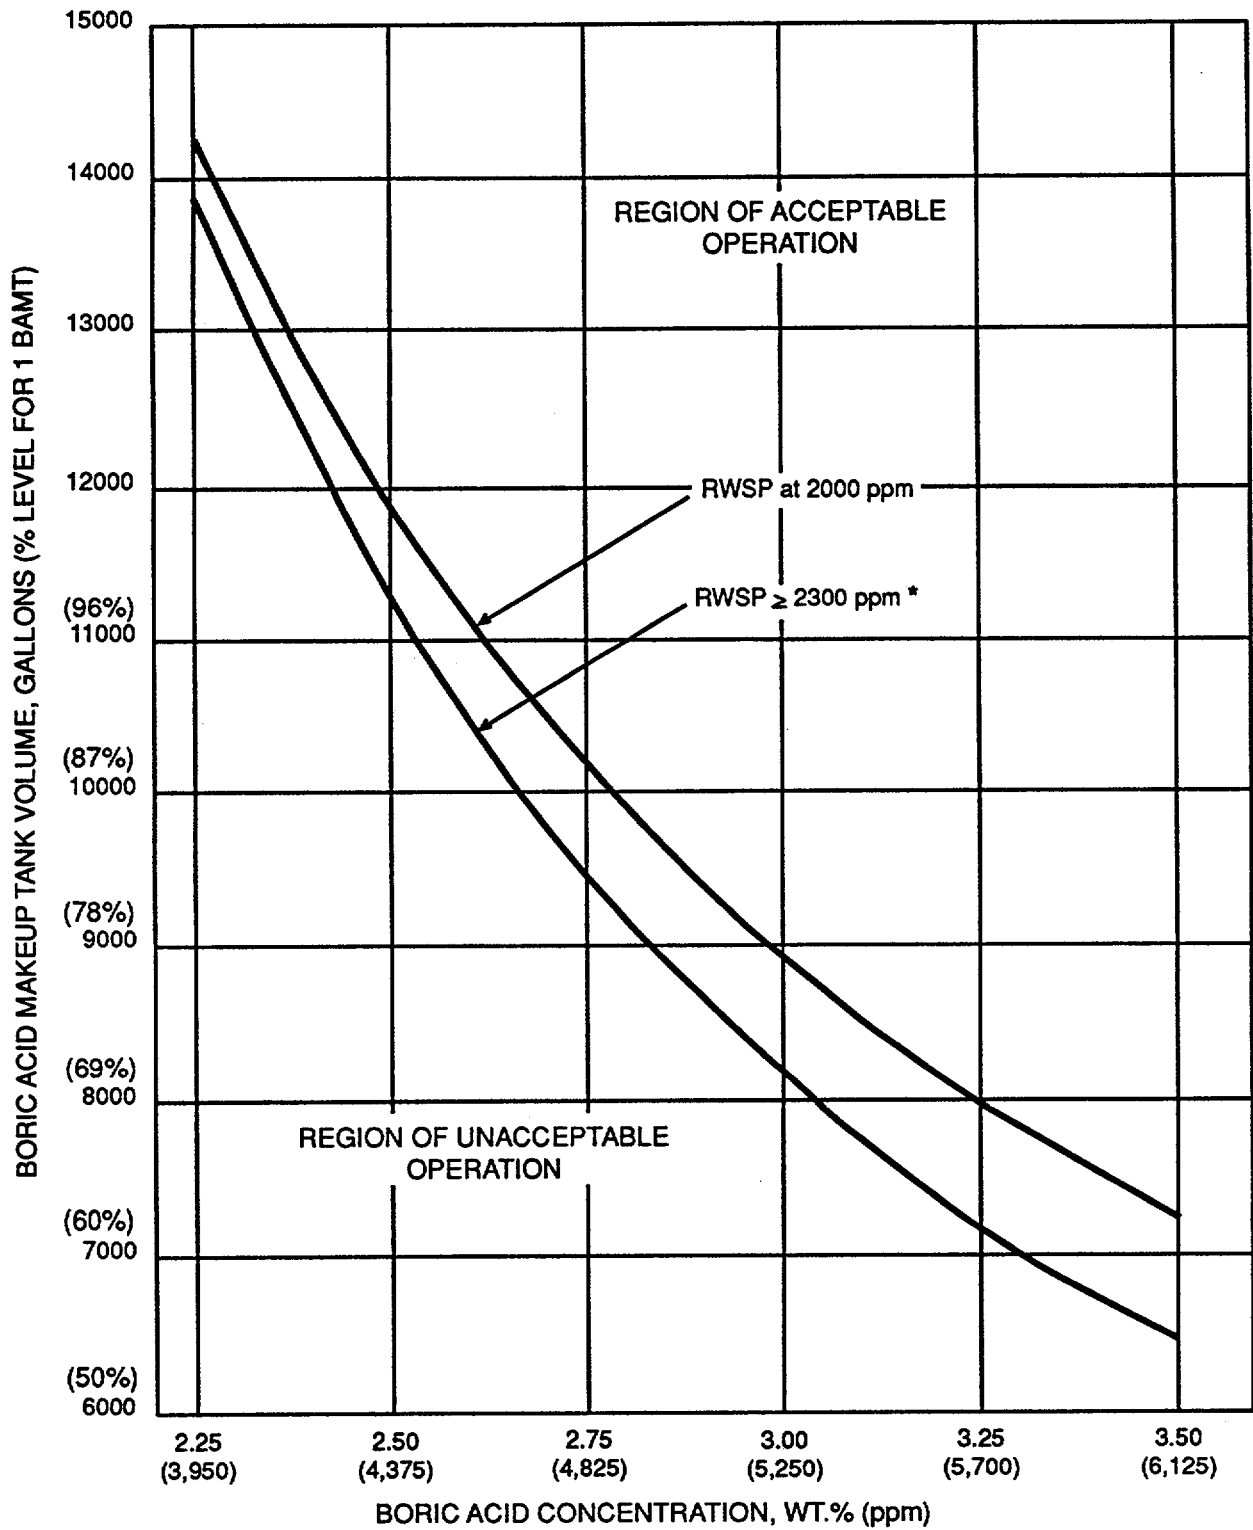


FIGURE 3.1-1

* This curve bounds RWSP concentrations ranging from 2300 ppm to 2900 ppm