

December 11, 1987

Docket No.: 50-440

Mr. Murray R. Edelman
Senior Vice President
The Cleveland Electric
Illuminating Company
P. O. Box 5000
Cleveland, Ohio 44101

DISTRIBUTION:

Docket File	JPartlow
NRC & Local PDR	TBarnhart (4)
PD31 Gray File	Wanda Jones
GHolahan	EButcher
RIngram	ACRS (10)
TColburn	GPA/PA
OGC-Beth	ARM/LFMB
DHagan	
EJordan	

Dear Mr. Edelman:

SUBJECT:

RE: Perry Nuclear Power Plant, Unit No. 1

The Commission has issued the enclosed Amendment No. 9 to Facility Operating License No. NPF-58 for the Perry Nuclear Power Plant, Unit No. 1. This amendment consists of changes to the Technical Specifications (TSs) in response to your application dated September 22, 1987.

This amendment makes various changes to the organization charts, Figures 6.2.1-1 and 6.2.2-1 of the Technical Specifications, to revise titles and delete non-key positions.

A copy of our Safety Evaluation is also enclosed. Notice of Issuance will be included in the Commission's biweekly Federal Register notice.

Sincerely,

Original signed by

Timothy G. Colburn, Project Manager
Project Directorate III-1
Division of Reactor Projects - III, IV, V
& Special Projects

Enclosures:

1. Amendment No. 9 to License No. NPF-58
2. Safety Evaluation

cc w/enclosures:
See next page

LA/PD31:DRSP
RIngram
12/9/87

PM/PD31:DRSP
TColburn
12/9/87

PEB/G.C. Colburn
LHEB JPJ for OGC
WRagan
12/11/87

D/PD31:DRSP
MVirgilio
12/6/87

8712150284 871211
PDR ADDCK 05000440
P PDR



UNITED STATES
NUCLEAR REGULATORY COMMISSION
WASHINGTON, D. C. 20555

CLEVELAND ELECTRIC ILLUMINATING COMPANY, ET AL

DOCKET NO. 50-440

PERRY NUCLEAR POWER PLANT, UNIT NO. 1

AMENDMENT TO FACILITY OPERATING LICENSE

Amendment No. 9
License No. NPF-58

1. The Nuclear Regulatory Commission (the Commission) has found that:
 - A. The application for amendment by Cleveland Electric Illuminating Company, Duquesne Light Company, Ohio Edison Company, Pennsylvania Power Company, and Toledo Edison Company (the licensees) dated September 22, 1987, complies with the standards and requirements of the Atomic Energy Act of 1954, as amended (the Act), and the Commission's rules and regulations set forth in 10 CFR Chapter I;
 - B. The facility will operate in conformity with the application, the provisions of the Act, and the rules and regulations of the Commission;
 - C. There is reasonable assurance (i) that the activities authorized by this amendment can be conducted without endangering the health and safety of the public, and (ii) that such activities will be conducted in compliance with the Commission's regulations;
 - D. The issuance of this amendment will not be inimical to the common defense and security or to the health and safety of the public; and
 - E. The issuance of this amendment is in accordance with 10 CFR Part 51 of the Commission's regulations and all applicable requirements have been satisfied.
2. Accordingly, the license is amended by changes to the Technical Specifications as indicated in the attachment to this license amendment, and paragraph 2.C.(2) of Facility Operating License No. NPF-58 is hereby amended to read as follows:


Technical Specifications

The Technical Specifications contained in Appendix A and the Environmental Protection Plan contained in Appendix B, as revised through Amendment No. 9 are hereby incorporated into this license. Cleveland Electric Illuminating Company shall operate the facility in accordance with the Technical Specifications and the Environmental Protection Plan.

8712150289 871211
PDR ADOCK 05000440
P PDR

3. This license amendment is effective as of its date of issuance.

FOR THE NUCLEAR REGULATORY COMMISSION

A handwritten signature in dark ink, appearing to read "M. J. Virgilio", is written over the typed name.

Martin J. Virgilio, Director
Project Directorate III-1
Division of Reactor Projects - III, IV, V
& Special Projects

Attachment:
Changes to the Technical
Specifications

Date of Issuance: December 11, 1987

ATTACHMENT TO LICENSE AMENDMENT NO. 9

FACILITY OPERATING LICENSE NO. NPF-58

DOCKET NO. 50-440

Replace the following pages of the Appendix "A" Technical Specifications with the attached pages. The revised pages are identified by Amendment number and contain vertical lines indicating the area of change. Overleaf page(s) provided to maintain document completeness.

Remove

6-3

6-4

6-5

Insert

6-3

6-4

6-5

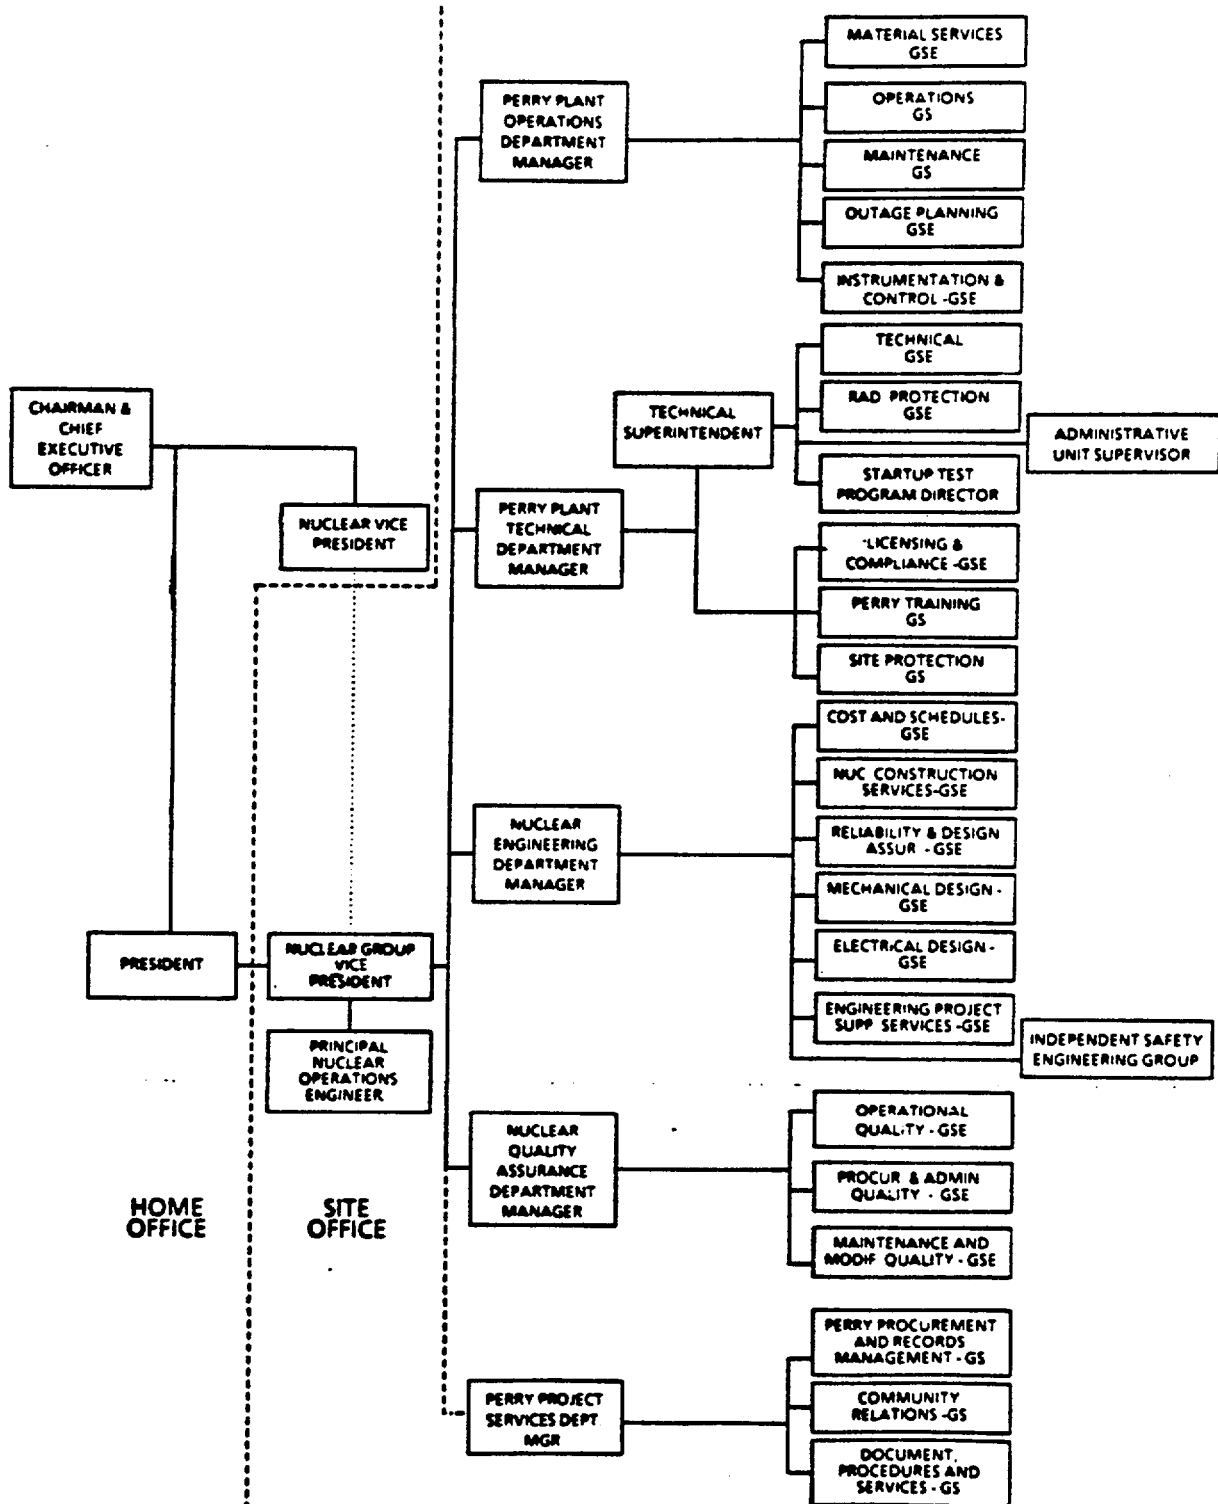


FIGURE 6.2.1-1
CORPORATE ORGANIZATION

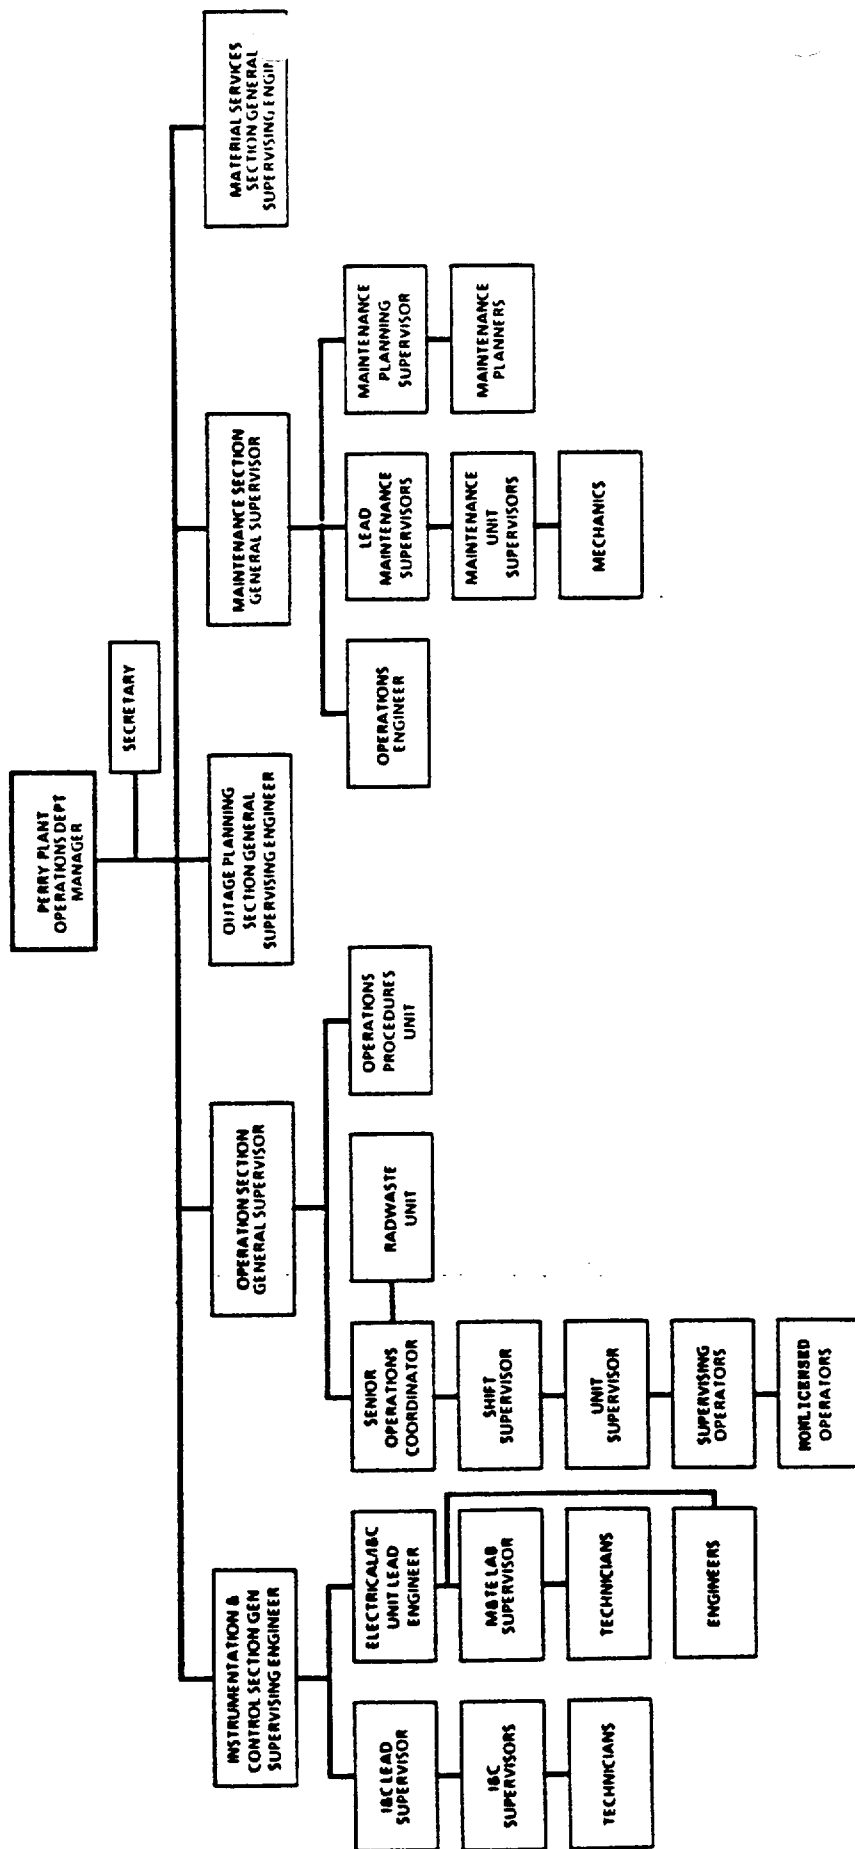


FIGURE 6.2.2-1
UNIT ORGANIZATION

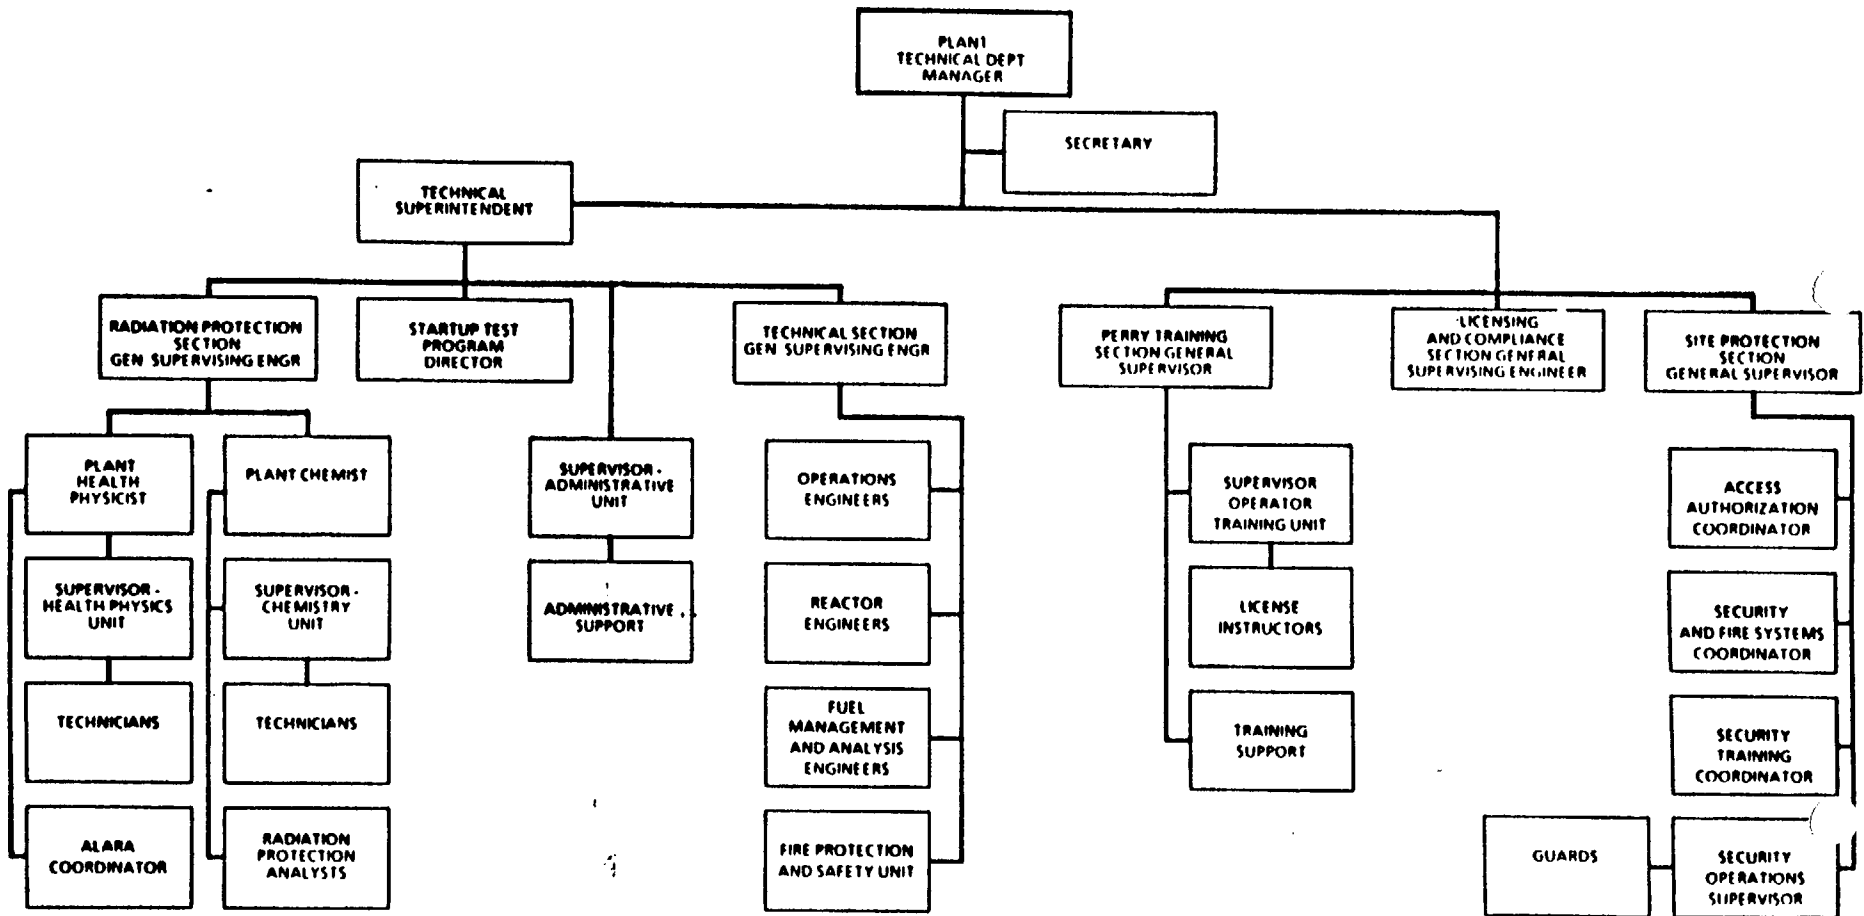


FIGURE 6.2.2-1 (Continued)
UNIT ORGANIZATION

TABLE 6.2.2-1
MINIMUM SHIFT CREW COMPOSITION

POSITION	NUMBER OF INDIVIDUALS REQUIRED TO FILL POSITION	
	CONDITION 1, 2, or 3	CONDITION 4 or 5
SS	1	1
SRO	1	None
RO	2	1
AO	2	1
STA	1	None

TABLE NOTATION

SS - Shift Supervisor with a Senior Operator license on Unit 1.
 SRO - Individual with a Senior Operator license on Unit 1.
 RO - Individual with an Operator or Senior Operator license on Unit 1.
 AO - Auxiliary Operator
 STA - Shift Technical Advisor

The shift crew composition may be one less than the minimum requirements of Table 6.2.2-1 for a period of time not to exceed 2 hours in order to accommodate unexpected absence of on-duty shift crew members provided immediate action is taken to restore the shift crew composition to within the minimum requirements of Table 6.2.2-1. This provision does not permit any shift crew position to be unmanned upon shift change due to an oncoming shift crewman being late or absent.

During any absence of the Shift Supervisor from the control room while the unit is in OPERATIONAL CONDITION 1, 2 or 3, an individual with a valid Senior Operator license shall be designated to assume the control room command function. During any absence of the Shift Supervisor from the control room while the unit is in OPERATIONAL CONDITION 4 or 5, an individual with a valid Senior Operator license or Operator license shall be designated to assume the control room command function.