



444 South 16th Street Mall  
Omaha NE 68102-2247

July 1, 2002  
LIC-02-0083

U. S. Nuclear Regulatory Commission  
ATTN: Document Control Desk  
Washington, DC 20555


Reference: Docket No. 50-285

**SUBJECT: Fort Calhoun Station (FCS) Steam Generator Tube Plugging Report - 2002 Refueling Outage**

Pursuant to FCS Unit No. 1 Technical Specifications (TS) 3.17(5)(i), the Omaha Public Power District (OPPD) completed eddy current testing of the steam generator tubes at Fort Calhoun Station (FCS) on May 22, 2002, during the twentieth refueling outage. This refueling outage was completed on June 2, 2002. In accordance with the TS, OPPD reports that 44 tubes were plugged in Steam Generator RC-2A and 44 tubes were plugged in Steam Generator RC-2B. To date, RC-2A has 262 plugged tubes and RC-2B has 271 plugged tubes. No tubes were repaired by sleeving in either steam generator during the 2002 Refueling Outage. Specific details in regard to steam generator tube plugging will be included in the six (6) month report required by Technical Specification 3.17(5)(ii).

Please contact me if you have any questions.

Sincerely,

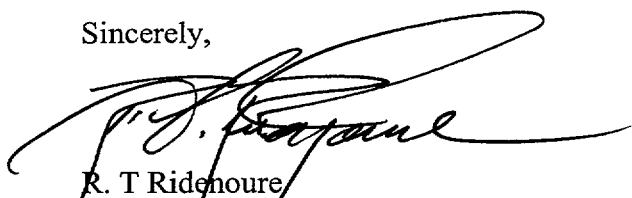

R. T Ridenoure  
Division Manager  
Nuclear Operations

RTR/TRB/trb

c: E. W. Merschoff, NRC Regional Administrator, Region IV  
Alan Wang, NRC Project Manager  
John G. Kramer, NRC Senior Resident Inspector  
Winston & Strawn

17A001