



444 South 16th Street Mall
Omaha NE 68102-2247

July 10, 2002
LIC-02-0082

U. S. Nuclear Regulatory Commission
ATTN: Document Control Desk
Washington, DC 20555-0001


Reference: Docket No. 50-285

SUBJECT: June 2002 Monthly Operating Report (MOR)

Pursuant to Fort Calhoun Station (FCS) Unit No. 1 Technical Specification 5.9.1.c, Omaha Public Power District (OPPD) submits the attached MOR for June 2002.

If you have any questions, please contact Mr. Erick Matzke at (402) 533-6855.

Sincerely,

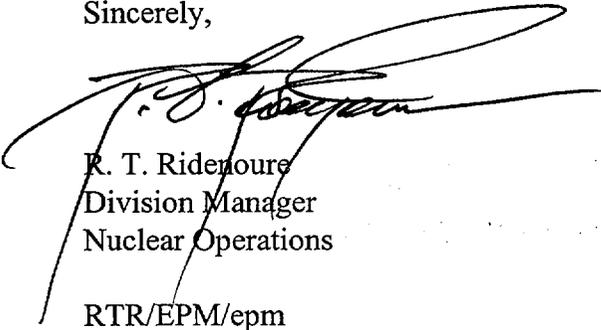

R. T. Ridenoure
Division Manager
Nuclear Operations

RTR/EPM/epm

Attachments

- c: E. W. Merschoff, NRC Regional Administrator, Region IV
- A. B. Wang, NRC Project Manager
- J. G. Kramer, NRC Senior Resident Inspector
- INPO Records Center
- Winston & Strawn

JE24

**ATTACHMENT 1
OPERATING DATA REPORT**

DOCKET NO.	<u>50-285</u>
UNIT NAME	<u>Fort Calhoun Station</u>
DATE	<u>July 01, 2002</u>
COMPLETED BY	<u>E. P. Matzke</u>
TELEPHONE	<u>(402) 533-6855</u>

REPORT PERIOD: June 2002

- | | | |
|--------------------------------|-------------------|------------|
| 1. Design Electrical Rating | <u>(MWe-Net):</u> | <u>478</u> |
| 2. Maximum Dependable Capacity | <u>(MWe-Net):</u> | <u>478</u> |

OPERATING STATUS

	MONTH	YEAR TO DATE	CUMULATIVE
3. Number of Hours Reactor was Critical:	714	3,665	203,545
4. Number of Hours Generator was On-line:	696	3,644	201,511
5. Unit Reserve Shutdown Hours:	0		
6. Net Electrical Energy Generated (MWh):	299,767	1,678,560	86,886,071

**ATTACHMENT 2
UNIT SHUTDOWNS**

REPORT MONTH June 2002

DOCKET NO. 50-285
UNIT NAME Fort Calhoun Station
DATE July 1, 2002
COMPLETED BY E. P. Matzke
TELEPHONE (402) 533-6855

No	Date (YY/MM/DD)	Type F: Forced S: Scheduled	Duration (Hours)	Reason ¹	Method of Shutting Down Reactor ²	Cause & Corrective Action to Prevent Recurrence
1	02/05/03	S	24.3	C	4	Scheduled refueling shutdown.

(1) Reason:

- A-Equipment Failure (Explain)
- B-Maintenance or Test
- C-Refueling
- D-Regulatory Restriction
- E-Operator Training/License Examination
- F-Administrative
- G-Operational Error (Explain)
- H-Other (Explain)

(2) Method:

- 1-Manual
- 2-Manual Trip/Scram
- 3-Automatic Trip/Scram
- 4-Continuation
- 5-Other (Explain)

OPERATIONS SUMMARY

The Fort Calhoun Station (FCS) began the month in a refueling outage. On June 1 at 0548 the reactor was taken critical. On June 2 at 0019 the main generator was aligned to the grid. Normal activities related to startup after a refueling outage were conducted. On June 4 the turbine and main generator were removed from service for just over an hour to perform turbine trip checks. The plant returned to 100 percent power on June 7.

SAFETY VALVE OR PORV CHALLENGES/FAILURES

No failures or challenges to safety valves or PORVs occurred during the month.