


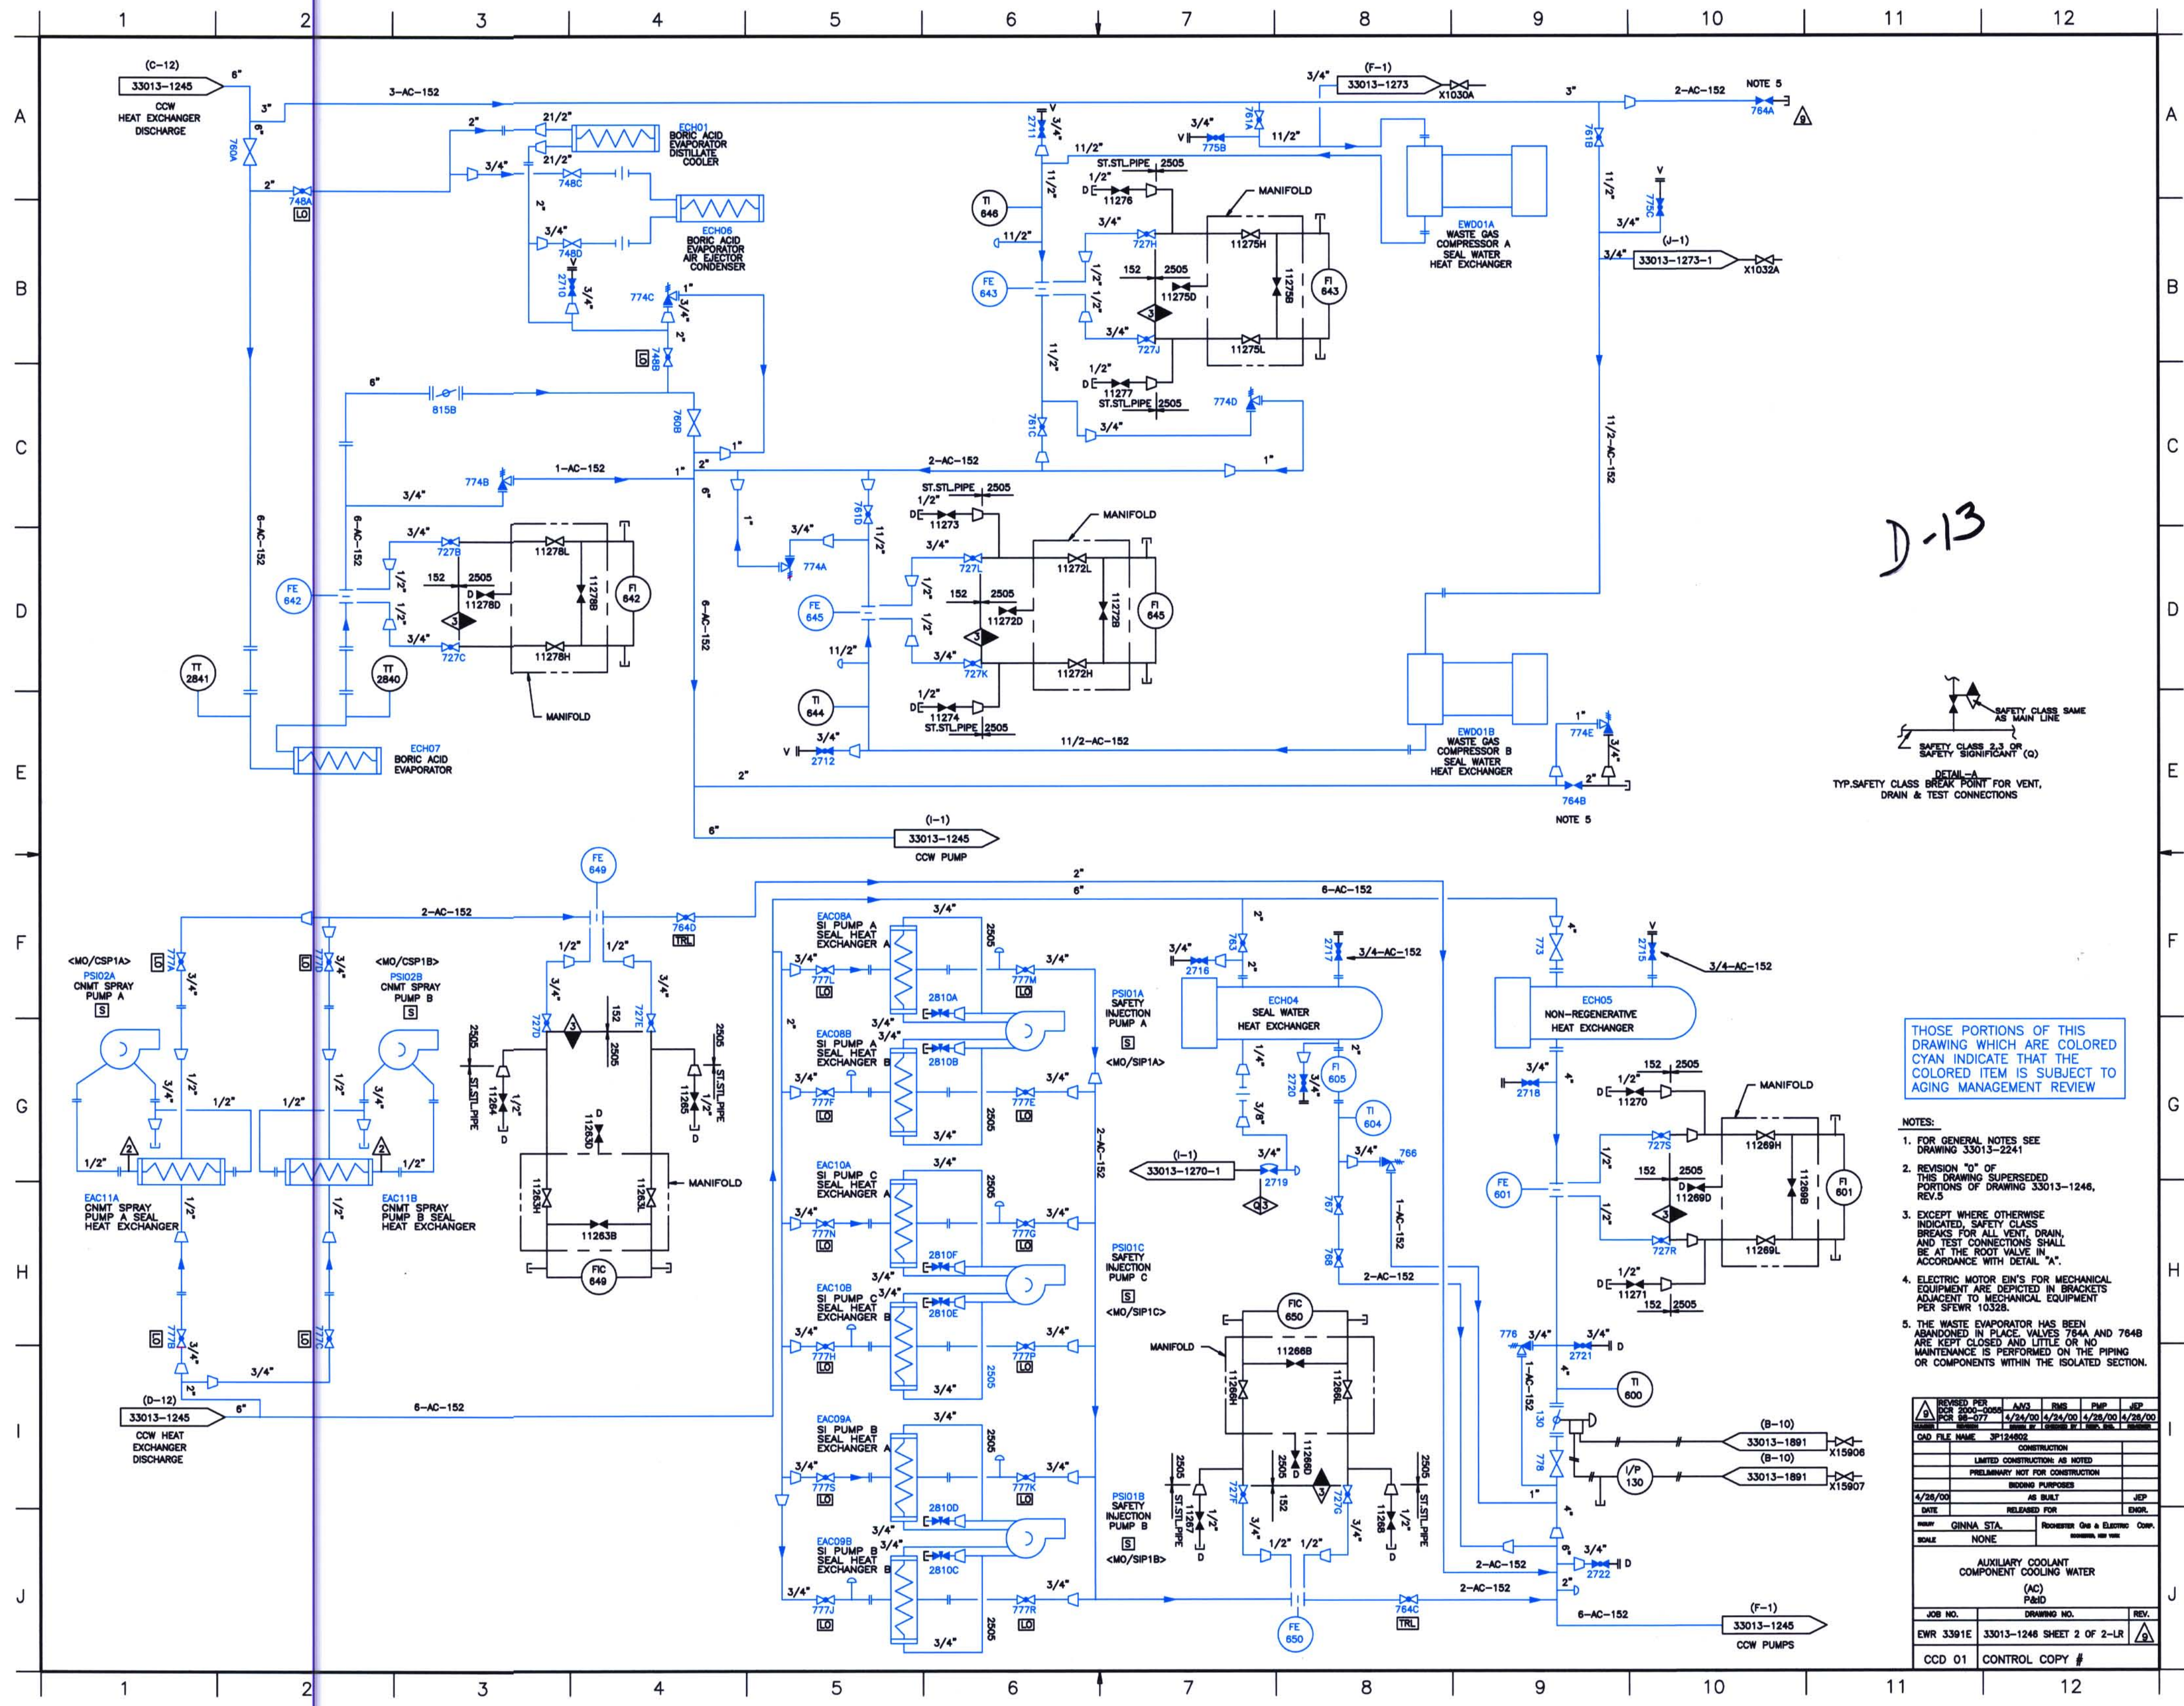

D-13

SAFETY CLASS SAME
AS MAIN LINE

SAFETY CLASS 2.3 OF
SAFETY SIGNIFICANT (C)

DETAIL A
TYP. SAFETY CLASS BREAK POINT FOR VENT,
DRAIN & TEST CONNECTIONS

THOSE PORTIONS OF THIS
DRAWING WHICH ARE COLORED
CYAN INDICATE THAT THE
COLORED ITEM IS SUBJECT TO
AGING MANAGEMENT REVIEW

- NOTES:
1. FOR GENERAL NOTES SEE
DRAWING 33013-1244
 2. REVISION "0" OF
THIS DRAWING SUPERSEDES
PORTIONS OF DRAWING 33013-1246,
REV'S
 3. EXCEPT WHERE OTHERWISE
INDICATED, SAFETY CLASS
BREAKS FOR ALL VENT, DRAIN,
AND TEST CONNECTIONS SHALL
BE AT THE ROOT VALVE IN
ACCORDANCE WITH DETAIL "A".
 4. ELECTRIC MOTOR EN'S FOR MECHANICAL
EQUIPMENT ARE DEPICTED IN BRACKETS
ADJACENT TO MECHANICAL EQUIPMENT
PER SPFW 10328.
 5. THE WASTE EVAPORATOR HAS BEEN
ABANDONED IN PLACE. VALVES 764A AND 764B
ARE KEPT CLOSED AND LITTLE OR NO
MAINTENANCE IS PERFORMED ON THE PIPING
OR COMPONENTS WITHIN THE ISOLATED SECTION.

REVISION	BY	DATE	APP'D	DATE
0	ANJ	4/24/00	IMP	4/24/00
1	ANJ	4/24/00	IMP	4/24/00
2	ANJ	4/24/00	IMP	4/24/00
3	ANJ	4/24/00	IMP	4/24/00
4	ANJ	4/24/00	IMP	4/24/00
5	ANJ	4/24/00	IMP	4/24/00
6	ANJ	4/24/00	IMP	4/24/00
7	ANJ	4/24/00	IMP	4/24/00
8	ANJ	4/24/00	IMP	4/24/00
9	ANJ	4/24/00	IMP	4/24/00
10	ANJ	4/24/00	IMP	4/24/00
11	ANJ	4/24/00	IMP	4/24/00
12	ANJ	4/24/00	IMP	4/24/00

QAD FILE NAME	33013-1246
CONSTRUCTION	
LIMITED CONSTRUCTION AS NOTED	
PRELIMINARY NOT FOR CONSTRUCTION	
ISSUED FOR CONSTRUCTION	
DATE	4/24/00
RELEASED FOR	IMP
BY	GINNA STA.
SCALE	NONE
AUXILIARY COOLANT COMPONENT COOLING WATER (AC) PAID	
JOB NO.	33013-1246 SHEET 2 OF 2-LR
DRAWING NO.	FE 601
REV.	
CCD 01	CONTROL COPY #