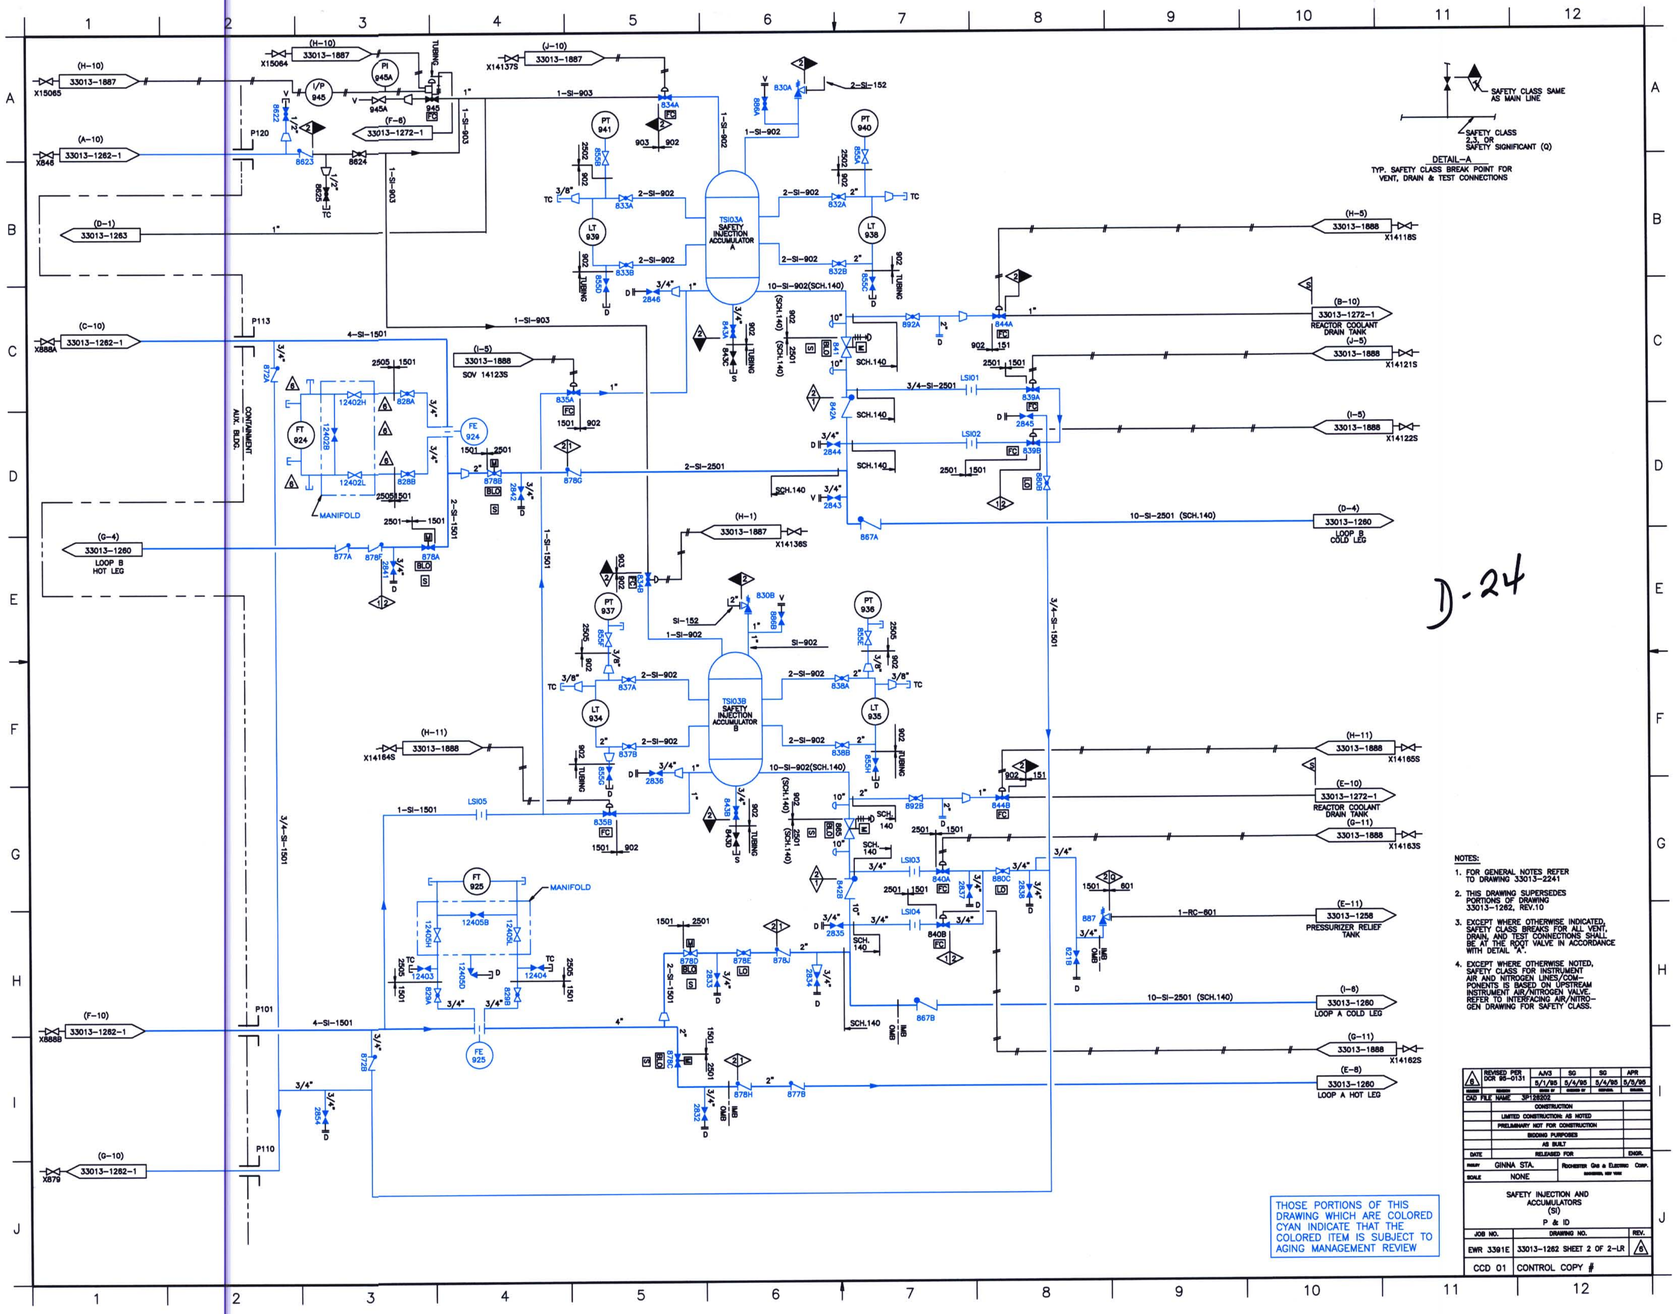

NOTES:

1. FOR GENERAL NOTES REFER TO DRAWING 33013-2241
2. THIS DRAWING SUPERSEDES PORTIONS OF DRAWING 33013-1262, REV.10
3. EXCEPT WHERE OTHERWISE INDICATED, SAFETY CLASS BREAKS FOR ALL VENT, DRAIN, AND TEST CONNECTIONS SHALL BE AT THE ROOT VALVE IN ACCORDANCE WITH DETAIL "A".
4. EXCEPT WHERE OTHERWISE NOTED, SAFETY CLASS FOR INSTRUMENT AIR AND NITROGEN LINES/COMPONENTS IS BASED ON UPSTREAM INSTRUMENT AIR/NITROGEN VALVE. REFER TO INTERFACING AIR/NITROGEN DRAWING FOR SAFETY CLASS.

THOSE PORTIONS OF THIS DRAWING WHICH ARE COLORED CYAN INDICATE THAT THE COLORED ITEM IS SUBJECT TO AGING MANAGEMENT REVIEW

REV.	REASON	ORIG. BY	CHKD BY	APPD.	DATE
A	REVISED PER DCR 95-0131	A/N3	SG	SG	APR
		5/1/95	5/4/95	5/4/95	5/5/95

CAD FILE NAME: 3P12B02E

	CONSTRUCTION
	LIMITED CONSTRUCTION AS NOTED
	PRELIMINARY NOT FOR CONSTRUCTION
	BIDDING PURPOSES
	AS BUILT
DATE	RELEASED FOR

DRAWN: GINNA STA.
SCALE: NONE
ROCHESTER GAS & ELECTRIC CORP. GINNA STA. ROT 1000

SAFETY INJECTION AND ACCUMULATORS (SI) P & ID

JOB NO.	DRAWING NO.	REV.
EWR 3391E	33013-1262 SHEET 2 OF 2-LR	A

CCD 01 | CONTROL COPY #