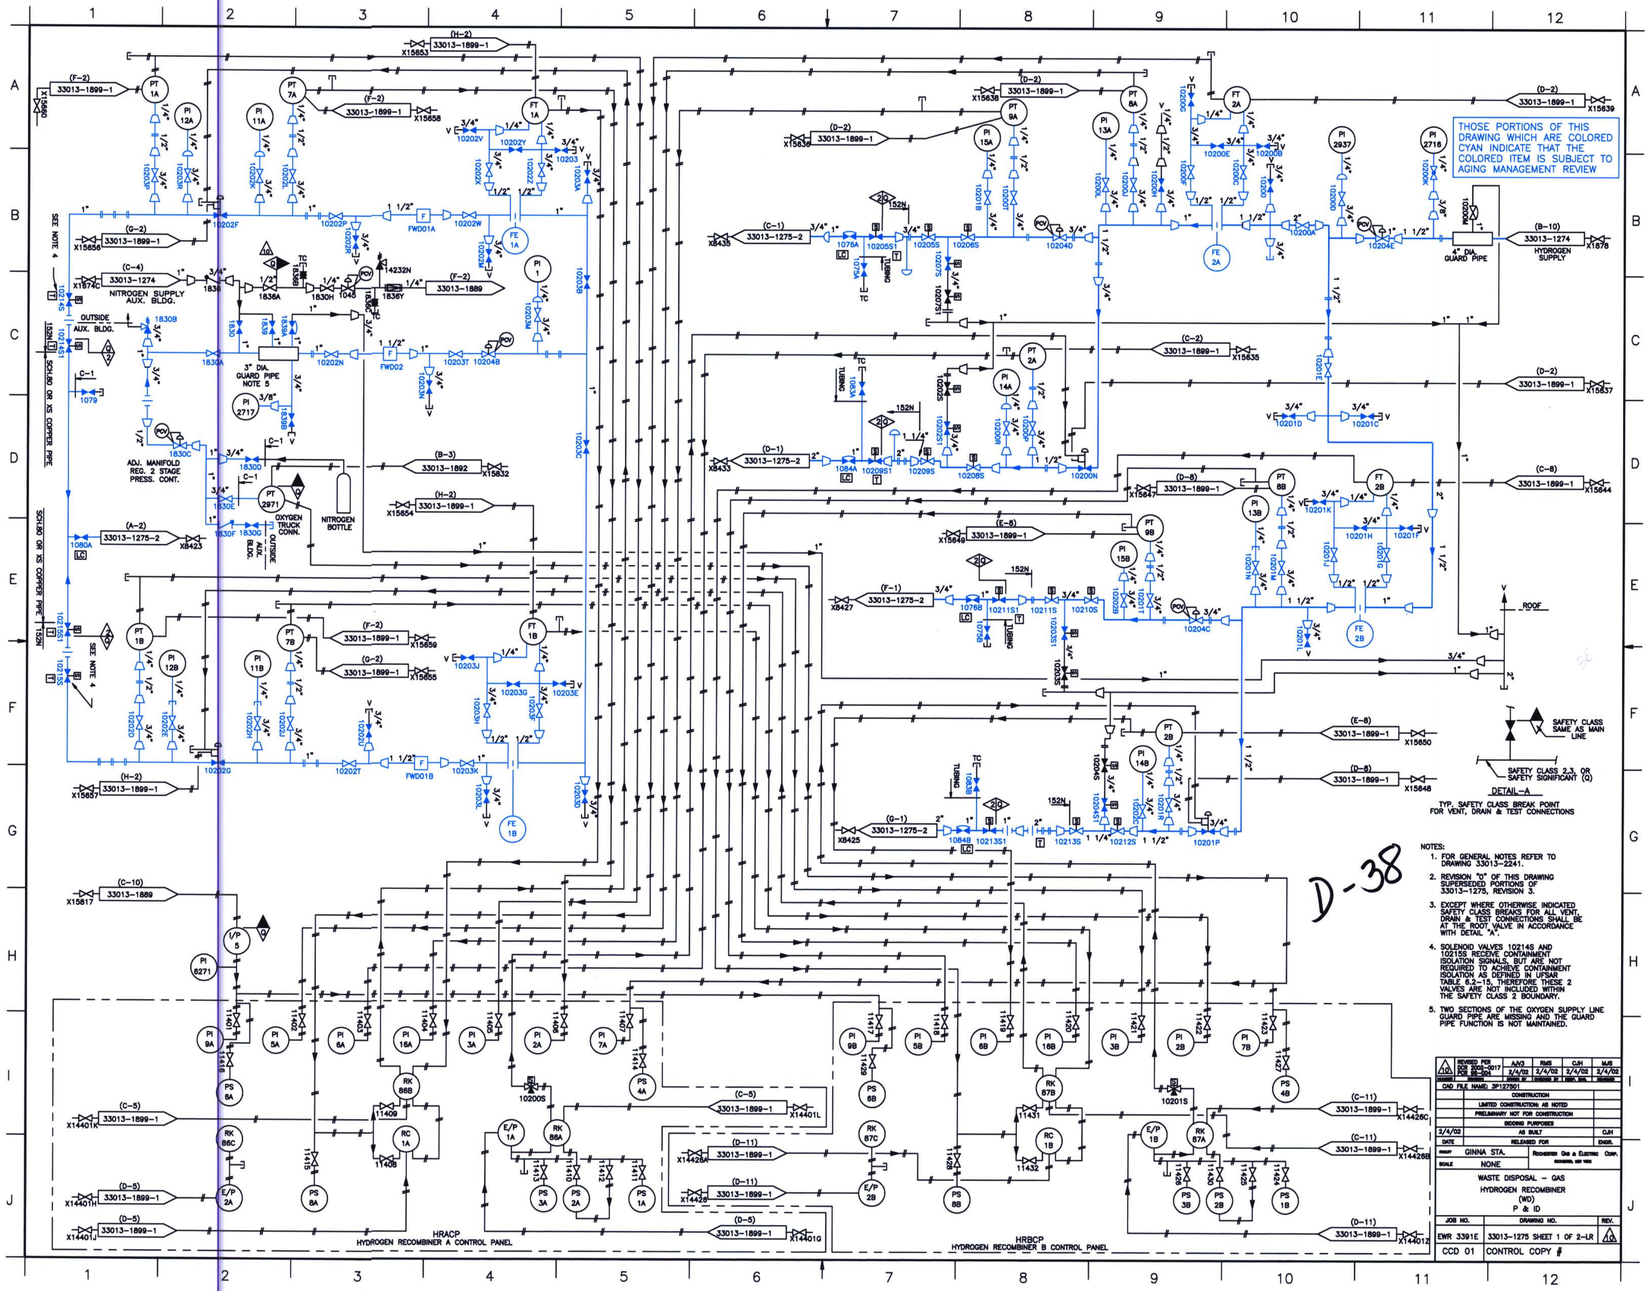
THOSE PORTIONS OF THIS DRAWING WHICH ARE COLORED CYAN INDICATE THAT THE COLORED ITEM IS SUBJECT TO AGING MANAGEMENT REVIEW
NITROGEN SUPPLY AUX. BLDG.
OUTSIDE AUX. BLDG.
3" DIA. GUARD PIPE NOTE 5
ADJ. MANIFOLD REG. 2 STAGE PRESS. CONT.
OXYGEN TRUCK CONN.
NITROGEN BOTTLE
OUTSIDE AUX. BLDG.
4" DIA. GUARD PIPE
HYDROGEN SUPPLY
ROOF
SAFETY CLASS SAME AS MAIN LINE
SAFETY CLASS 2,3, OR SAFETY SIGNIFICANT (Q)
DETAIL-A
TYP. SAFETY CLASS BREAK POINT FOR VENT, DRAIN & TEST CONNECTIONS
HRACP
HYDROGEN RECOMBINER A CONTROL PANEL
HRBCP
HYDROGEN RECOMBINER B CONTROL PANEL
D-38
NOTES:
1. FOR GENERAL NOTES REFER TO DRAWING 33013-2241.
2. REVISION "D" OF THIS DRAWING SUPERSEDED PORTIONS OF 33013-1275, REVISION 3.
3. EXCEPT WHERE OTHERWISE INDICATED SAFETY CLASS BREAKS FOR ALL VENT, DRAIN & TEST CONNECTIONS SHALL BE AT THE ROOT VALVE IN ACCORDANCE WITH DETAIL "A".
4. SOLENOID VALVES 10214S AND 10215S RECEIVE CONTAINMENT ISOLATION SIGNALS, BUT ARE NOT REQUIRED TO ACHIEVE CONTAINMENT ISOLATION AS DEFINED IN UFSAR TABLE 6.2-15, THEREFORE THESE 2 VALVES ARE NOT INCLUDED WITHIN THE SAFETY CLASS 2 BOUNDARY.
5. TWO SECTIONS OF THE OXYGEN SUPPLY LINE GUARD PIPE ARE MISSING AND THE GUARD PIPE FUNCTION IS NOT MAINTAINED.
CONSTRUCTION
LIMITED CONSTRUCTION AS NOTED
PRELIMINARY NOT FOR CONSTRUCTION
RECORD PURPOSES
AS BUILT
GINNA STA.
NONE
WASTE DISPOSAL - GAS
HYDROGEN RECOMBINER
(WD)
P & ID
EWR 3391E
33013-1275 SHEET 1 OF 2-LR
CCD 01
CONTROL COPY