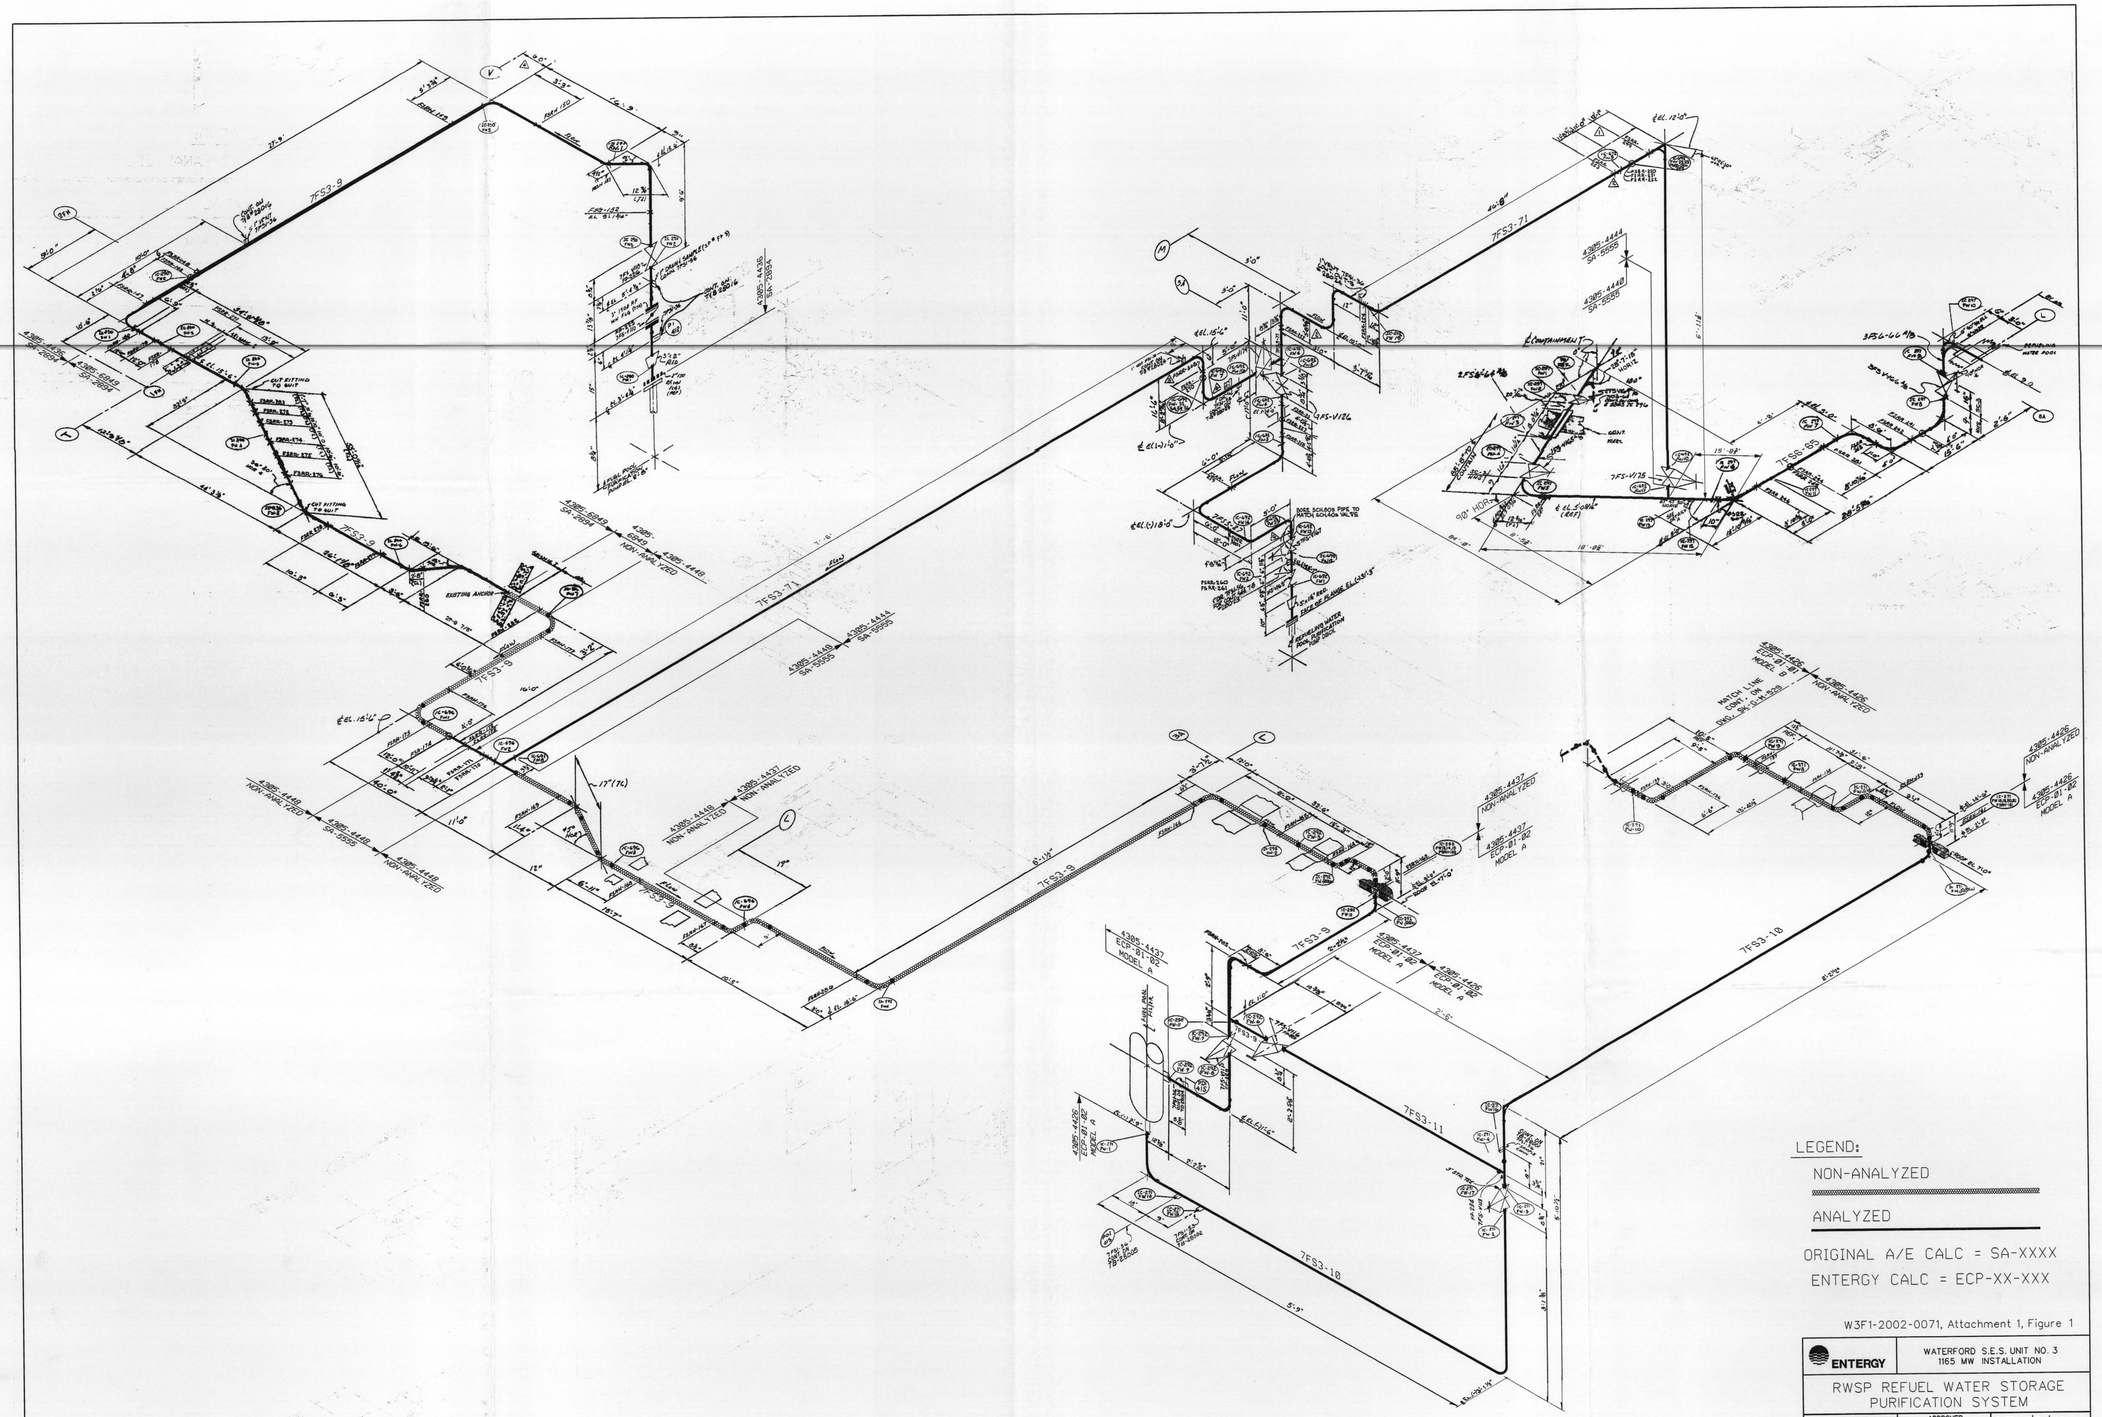
7FS3-9
7FS3-71
7FS3-10
7FS3-11
EXISTING ANCHOR
NON-ANALYZED
MATCH LINE CONT. ON DWG. SK-G-M-529
LEGEND:
NON-ANALYZED
ANALYZED
ORIGINAL A/E CALC = SA-XXXX
ENTERGY CALC = ECP-XX-XXX
W3F1-2002-0071, Attachment 1, Figure 1
ENTERGY
WATERFORD S.E.S. UNIT NO. 3
1165 MW INSTALLATION
RWSP REFUEL WATER STORAGE
PURIFICATION SYSTEM
SCALE: NTS
APPROVED
DATE: 7/30/02
DEPT. MECHANICAL
DR. T.H.SMITH
CH. D.DASGUPTA
SK-G-M-528
NO. DATE REVISION DESCRIPTION BY CH APPROVED
FILENAME: RWSP.DGN

D-01