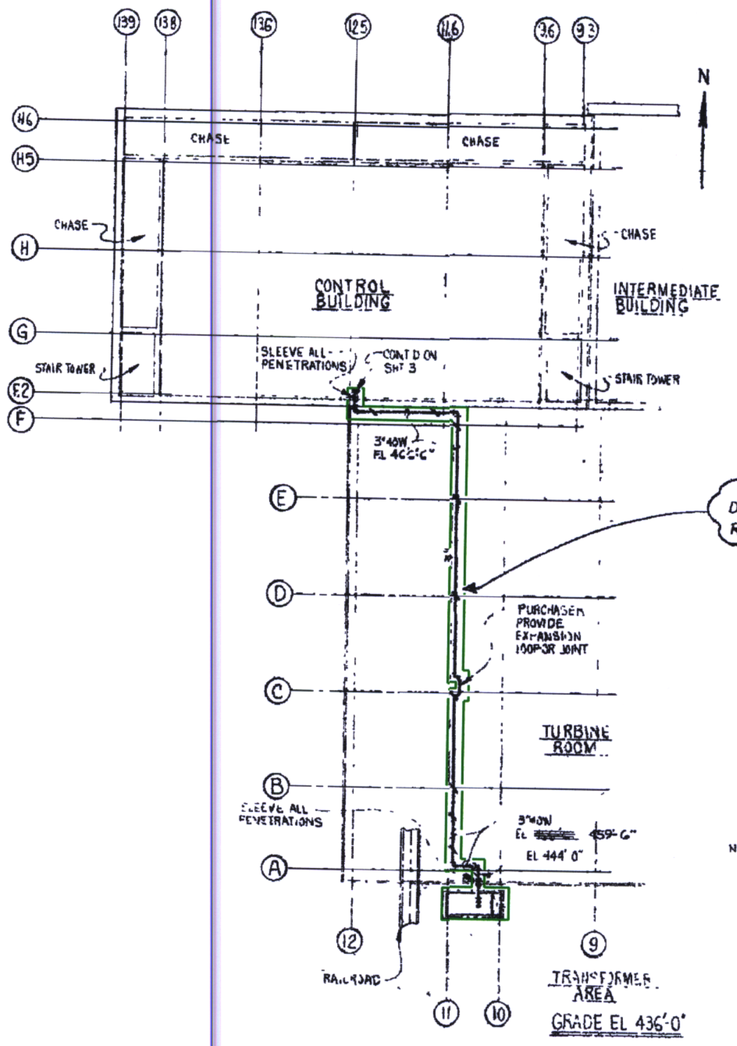

DETAILED PIPING DRAWINGS REQUIRED FOR APPROVAL

NOTE: HANGERS ARE SIZED ACCORDING TO CHEMETRON REQUIREMENTS

GENERAL PIPING ARRANGEMENT

SCALE 1" = 20'-0"

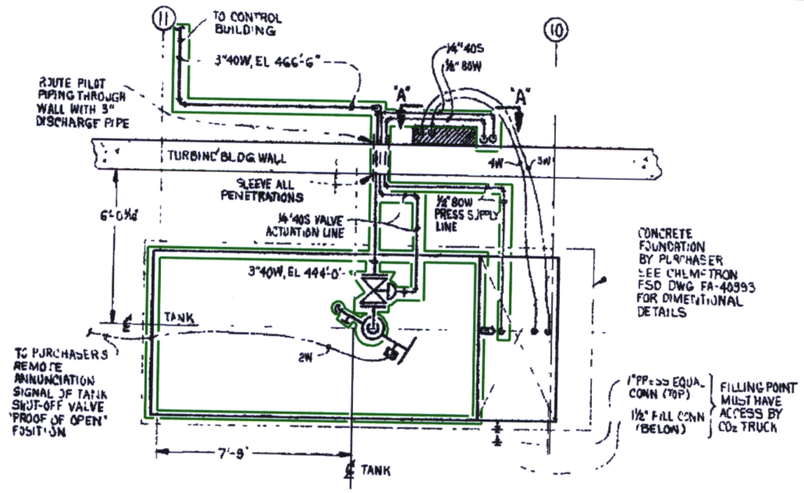

ENLARGED PLAN VIEW
AT CO_2 TANK AREA
APPROX SCALE 3/8" = 1'-0"

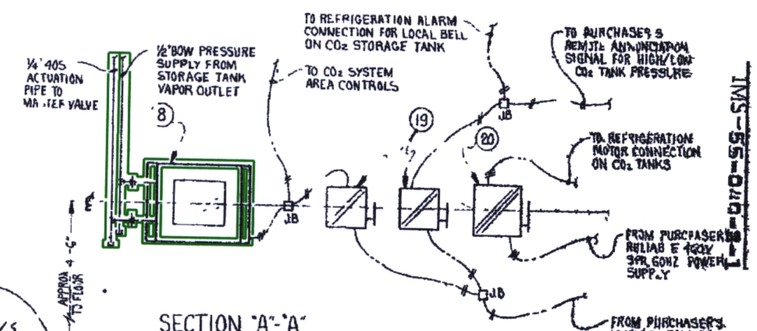

SECTION "A"-"A"
SUGGESTED CONTROL ARRANGEMENT
NTS

HANGER LOCATIONS ARE APPROVED

REVISIONS			
LET	BY	DATE	DESCRIPTION
A			SHOW HGR LOCATIONS & NOTE

CHEMETRON Fire Systems
SYSTEMS ENGINEERING
LOW PRESSURE CO_2 FIRE EXTINGUISHING SYSTEM
SCHEMATIC ARRANGEMENT
SOUTH CAROLINA ELECTRIC & GAS COMPANY
VIRGIL C SUMMER NUCLEAR STATION - UNIT 1
PARR, SOUTH CAROLINA
SCALE AS NOTED
FL-22425-3 SHEET 1 OF 1

D-28

PLEX Drawing TR00160-004

NO.	DATE	BY	REVISION	DKD. BY	LE APPROVAL

DESIGN ENGINEERING
T. C. SUMMER NUCLEAR STATION JENKINSVILLE, S.C.
IMS-55-040 2