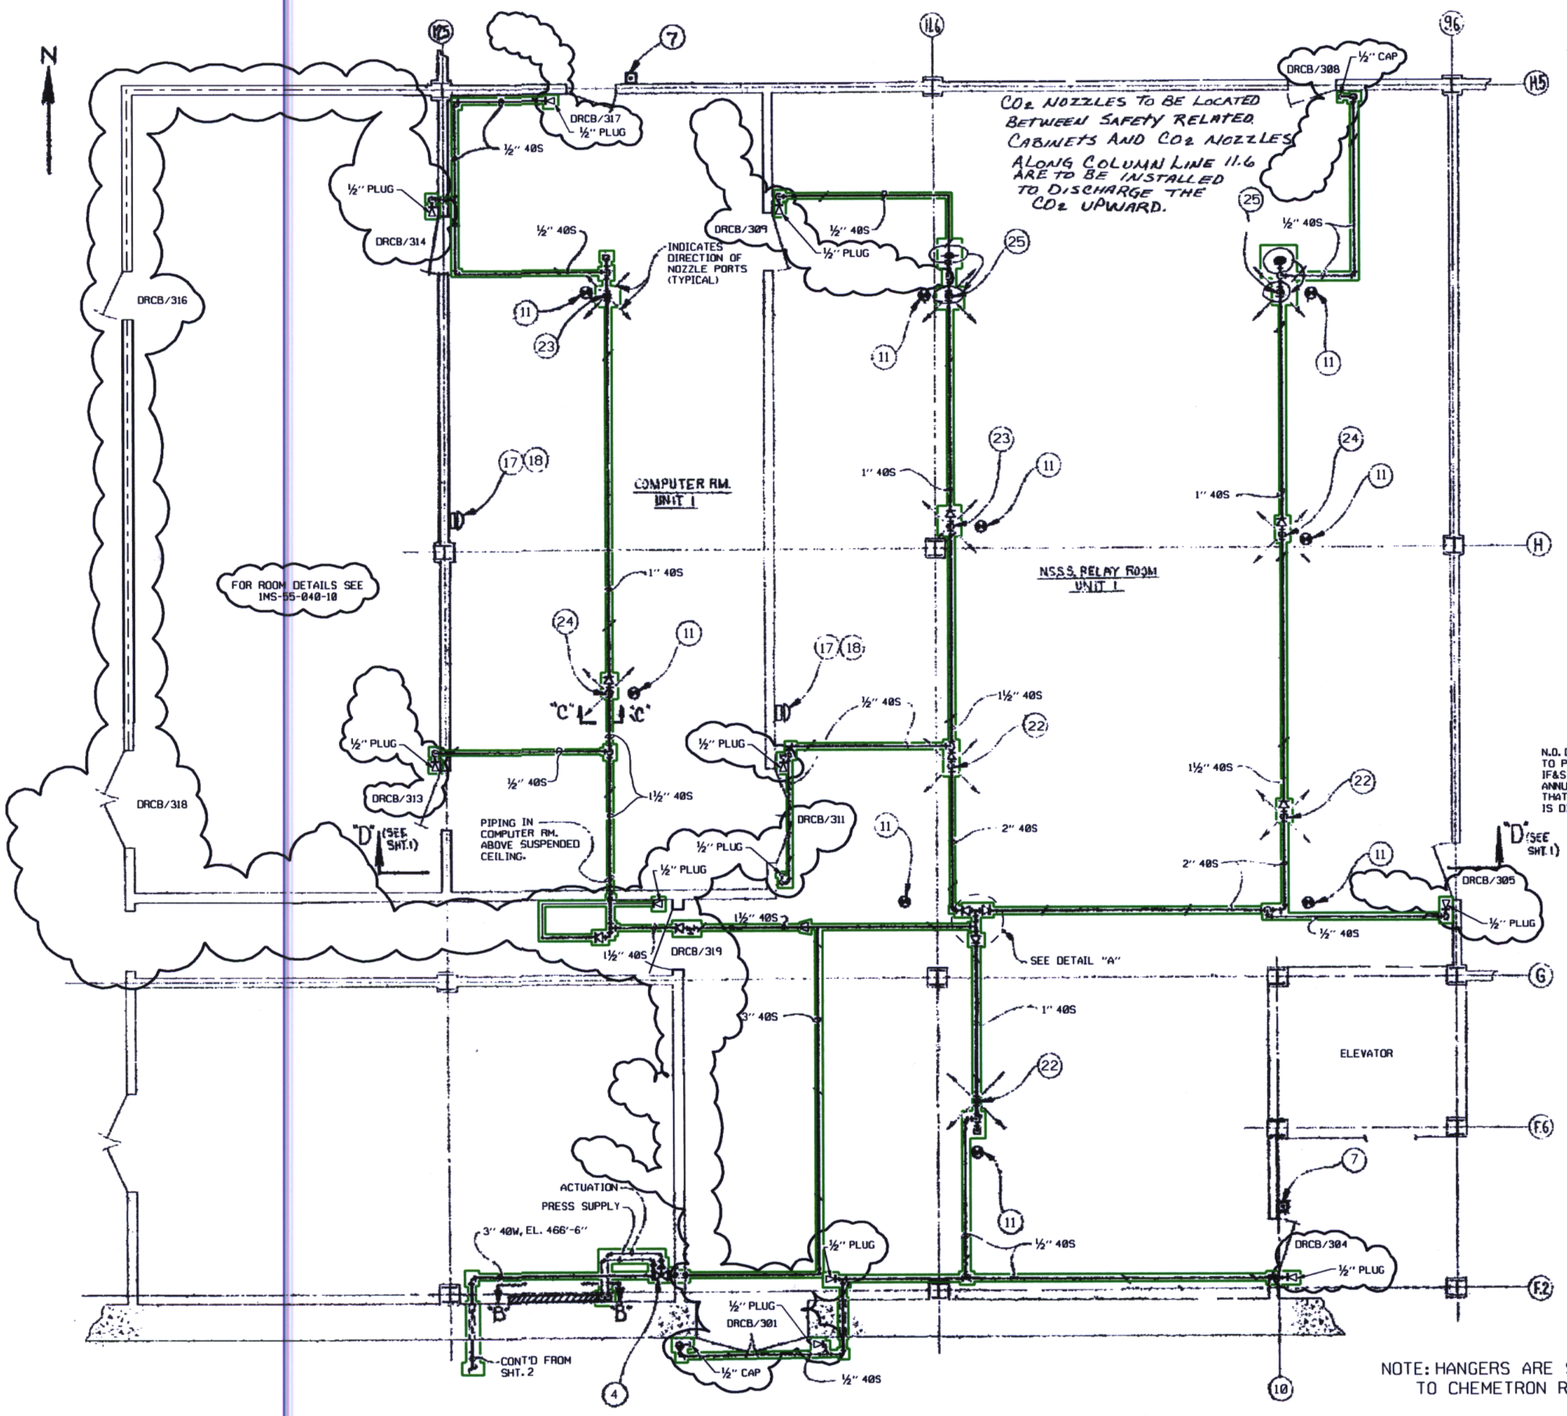

NOTE: HANGERS ARE SIZED ACCORDING TO CHEMETRON REQUIREMENTS



SECTION "C"-"C"
TYPICAL FOR ALL NOZZLES
N.T.S.



DETAIL "A"
N.T.S.

HANGER LOCATION ARE APPROVED.

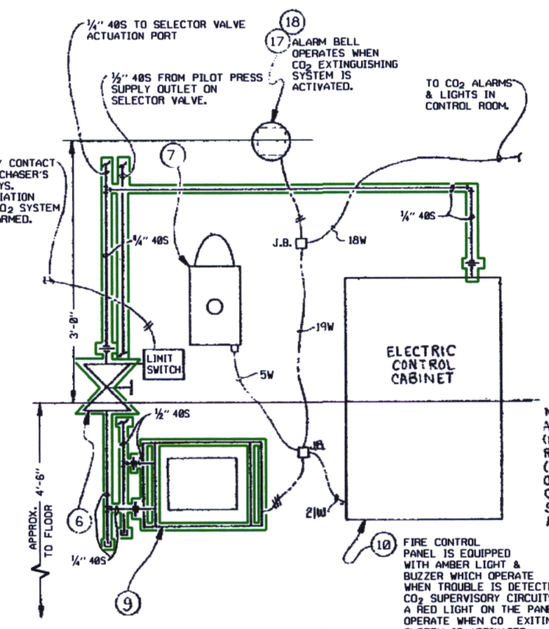

SECTION "B"-"B"
COMPUTER & RELAY ROOM
CO2 CONTROLS ARRANGEMENT
N.T.S.

D-29

DRAWING LEGIBILITY
CLASS 2
SCE&G CAD ENHANCED

PLEX Drawing TR00160-004

LOW PRESSURE CO_2 FIRE EXTINGUISHING SYSTEM
SCHEMATIC ARRANGEMENT

VENDOR/DRAWING NO.: CHEMETRON
FL-22425-3, SH. 3

SCE&G A SCANA COMPANY — DESIGN ENGINEERING — V. C. SUMMER NUCLEAR STATION JENKINSVILLE, S. C.

MADE	CHECKED	LE APPROVAL
1. A.V.N.	2. M.G.R.	3. M.S.B.

SCALE NO SCALE — DRAWING NUMBER 1MS-55-040 — SHT. NUMBER 3 — REV 5

NO.	DATE	BY	REVISION	CKD. BY	LE APPROVAL
5	09/07/95	AVN	REVISED PER MRF-22725	MGR	MSB

1/4"= 1'-0" 0' 5' 10' 15' 20'