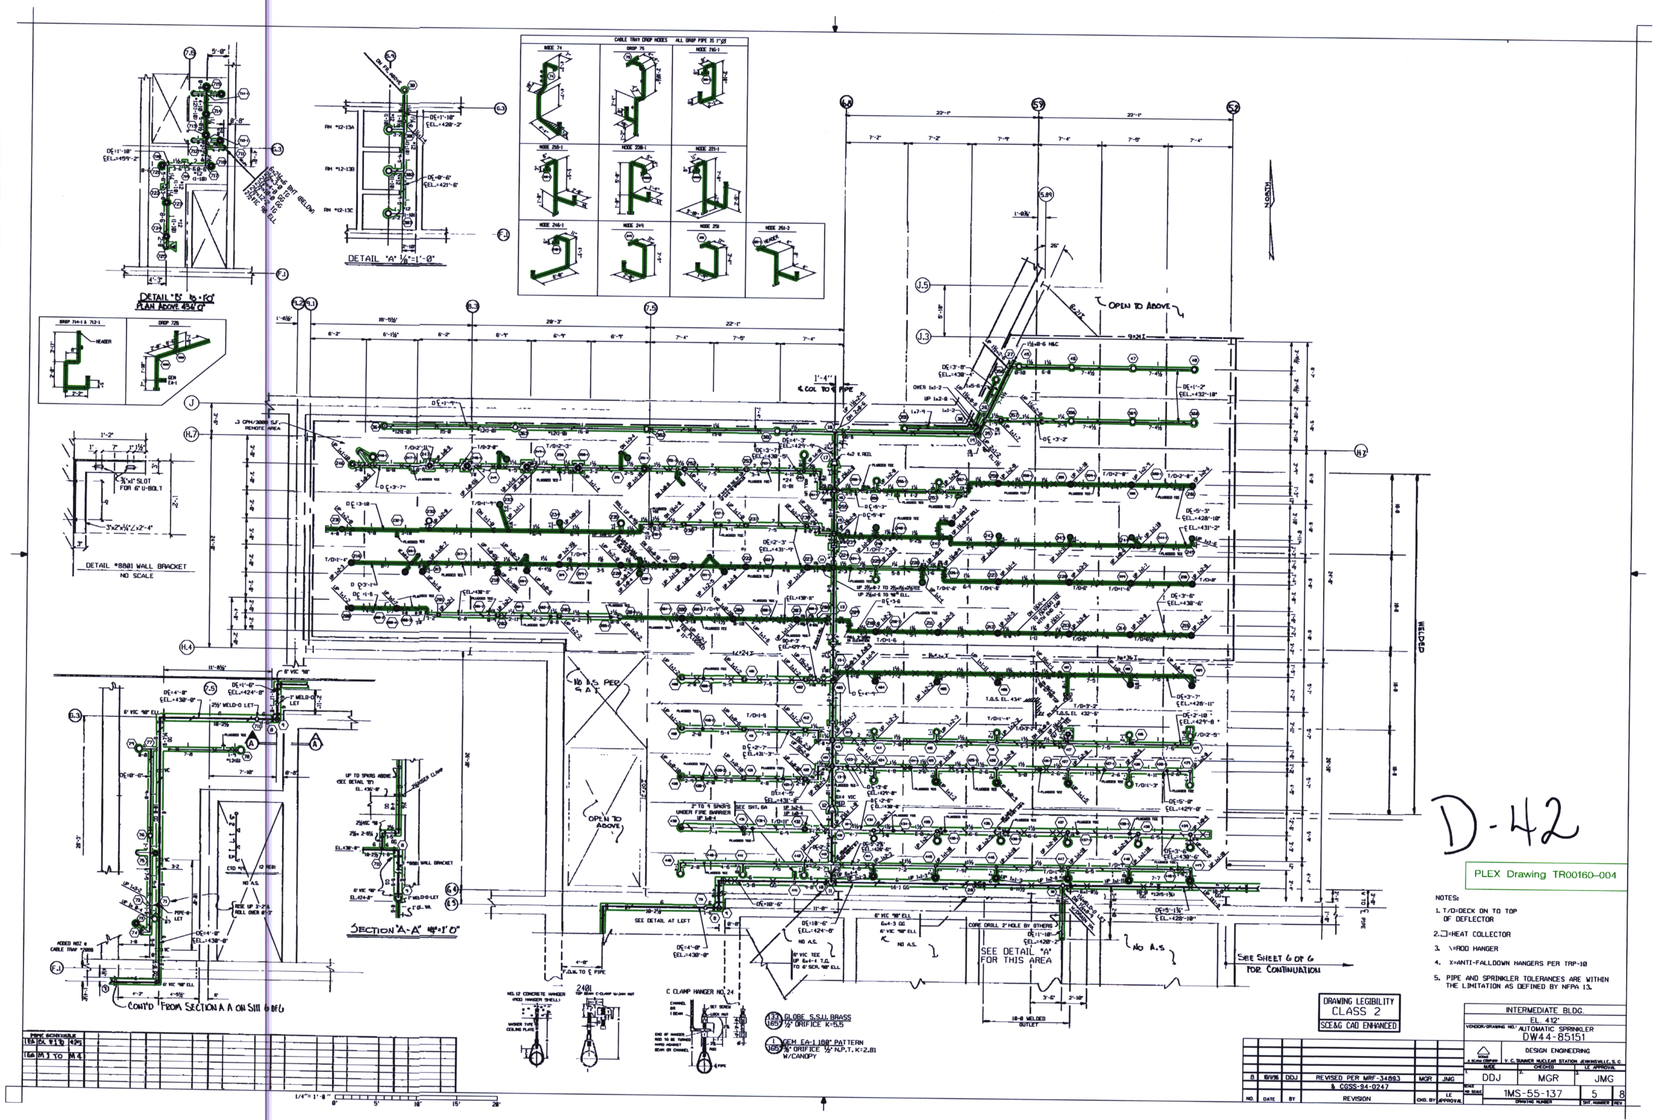

D-42

PLEX Drawing TR00160-004

NOTES:

1. T/D-DECK ON TO TOP OF DEFLECTOR
2. HEAT COLLECTOR
3. HOD HANGER
4. X=ANTI-FALLDOWN HANGERS PER TRP-10
5. PIPE AND SPRINKLER TOLERANCES ARE WITHIN THE LIMITATION AS DEFINED BY NFPA 13.

DRAWING LEGIBILITY
CLASS 2
SCE&G CAD ENHANCED

NO.	DATE	BY	REVISION	CHD. BY	LE APPROVAL
8	8/9/96	DDJ	REVISED PER MRF-34093 & CGSS-94-0247	MGR	JMG

INTERMEDIATE BLDG.
EL. 412'
VENDOR-DRAWING NO. AUTOMATIC SPRINKLER DW44-85151
DESIGN ENGINEERING
A SCHOLARSHIP
V. C. SUMNER NUCLEAR STATION JENKINSVILLE, S.C.

MADE	CHECKED	LE APPROVAL
DDJ	MGR	JMG

SCALE	DRAWING NUMBER	SHT	REV
1/4"=1'-0"	1MS-55-137	5	8