


14				13	
SYSTEM DATA					
	GPN	PSIG	°F	BY	REMARKS
1	740	125	150		

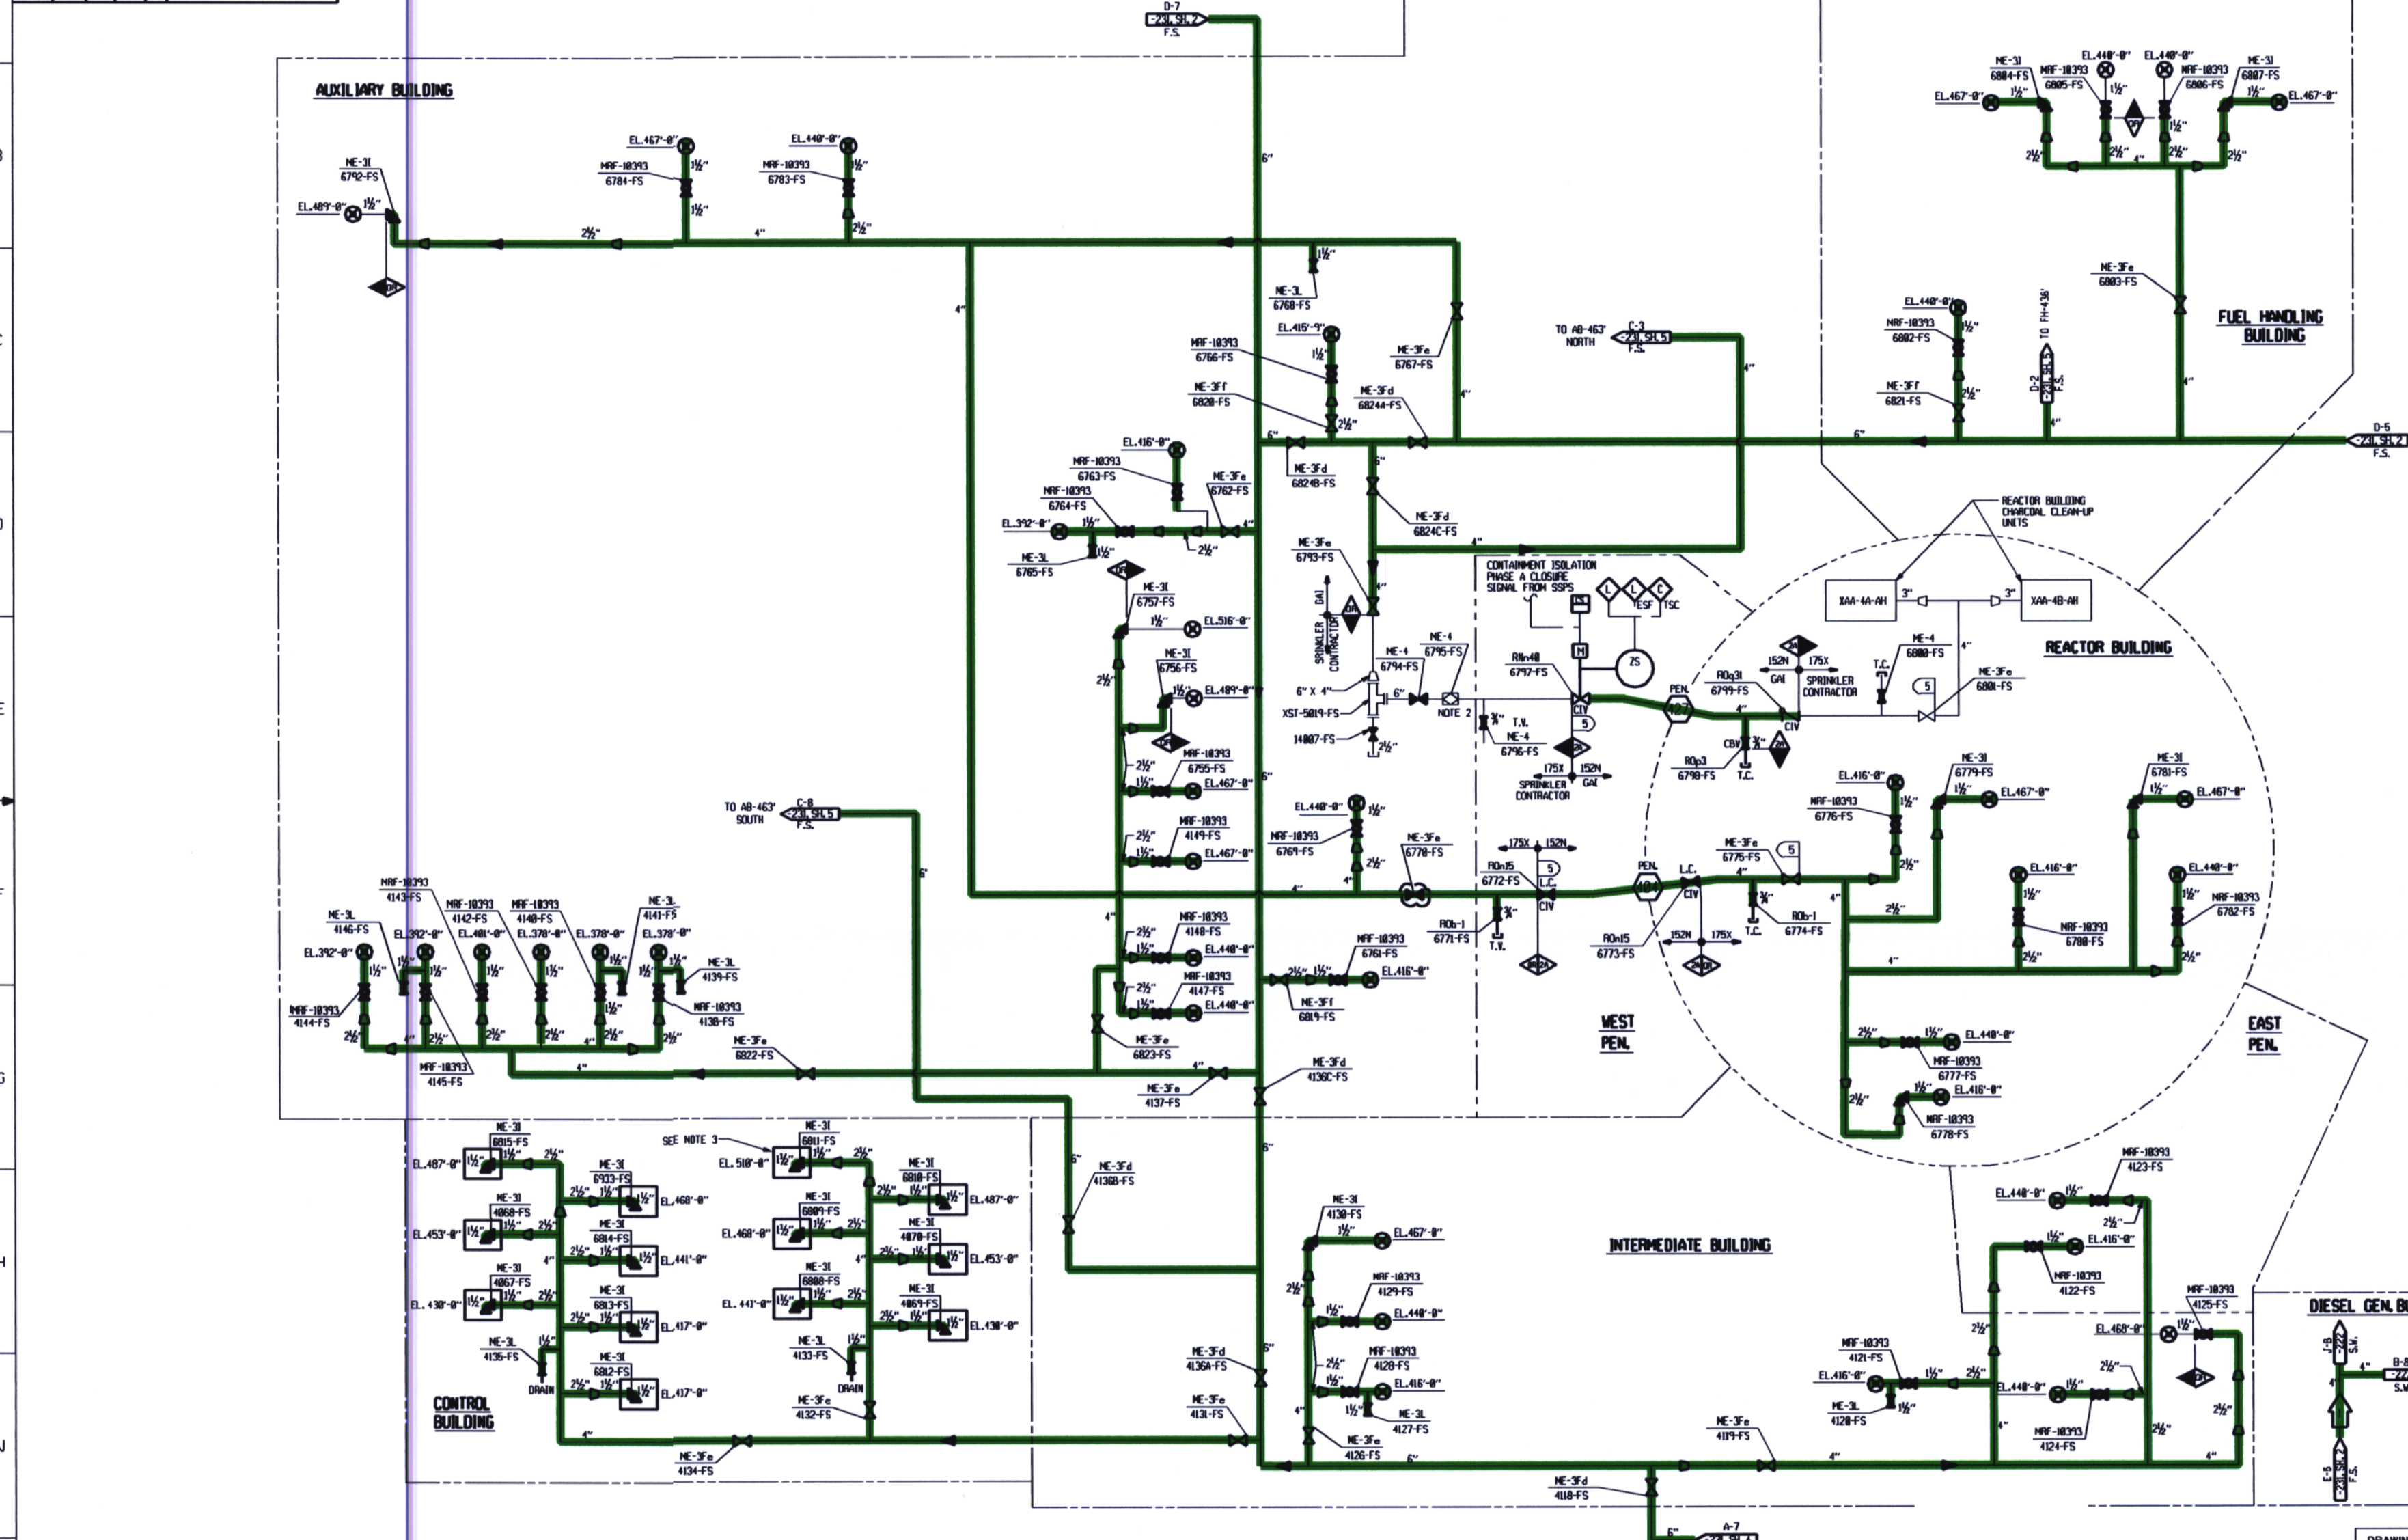

NOTES:

1. FOR NOTES AND REFERENCES SEE DRAWING D-382-231 SHEET 1.
2. REF. IMS-55-065-28
3. VALVE IS OR HOSE STATION IS NON-SAFETY RELATED

PLEX Drawing TR00160-004

THIS IS A
NUCLEAR SAFETY RELATED
DOCUMENT. NO DEVIATION SHALL BE
INITIATED OR PERFORMED WITHOUT PRIOR
DOCUMENTATION AND WRITTEN APPROVAL

FSAR Figure 9.5-1 SH.3

SOUTH CAROLINA ELECTRIC & GAS COMPANY

PIPING	SYSTEM FLOW DIAGRAM
	FIRE SERVICE

RB, AB, IB, DB, FH, CB

	DESIGN ENGINEERING
---	--------------------

A SCANA COMPANY		V. C. SUMNER NUCLEAR STATION JENKINSVILLE, S. C.	
MAX	CHECKED	LE APPROVAL	

¹ A.V.N.	² M.G.R.	³ J.E.W.
---------------------	---------------------	---------------------

SEAL	D-302-231	3	3
NO SEAL			

		(DRAWING NUMBER)	SHEET NUMBER	PAGE
--	--	------------------	--------------	------

DRAWING LEGIBILITY
CLASS 1

[illegible]

3	7/7/89	RH-M	REVISED PER NON-99-0964	MGR	CHR	T	
2	7/6/89	JMR	REVISED PER MRF -20951	MGR	JEG		
1	2/27/89	TMZ	REVISED PER CGSS-96-0722	MGR	TJK		
0	8/9/77/85	AVN	ISSUED PER MRF -22640	MGR	JEW		
NO.	DATE	BY	REVISION	DND BY	LE APPROVAL		

D-73