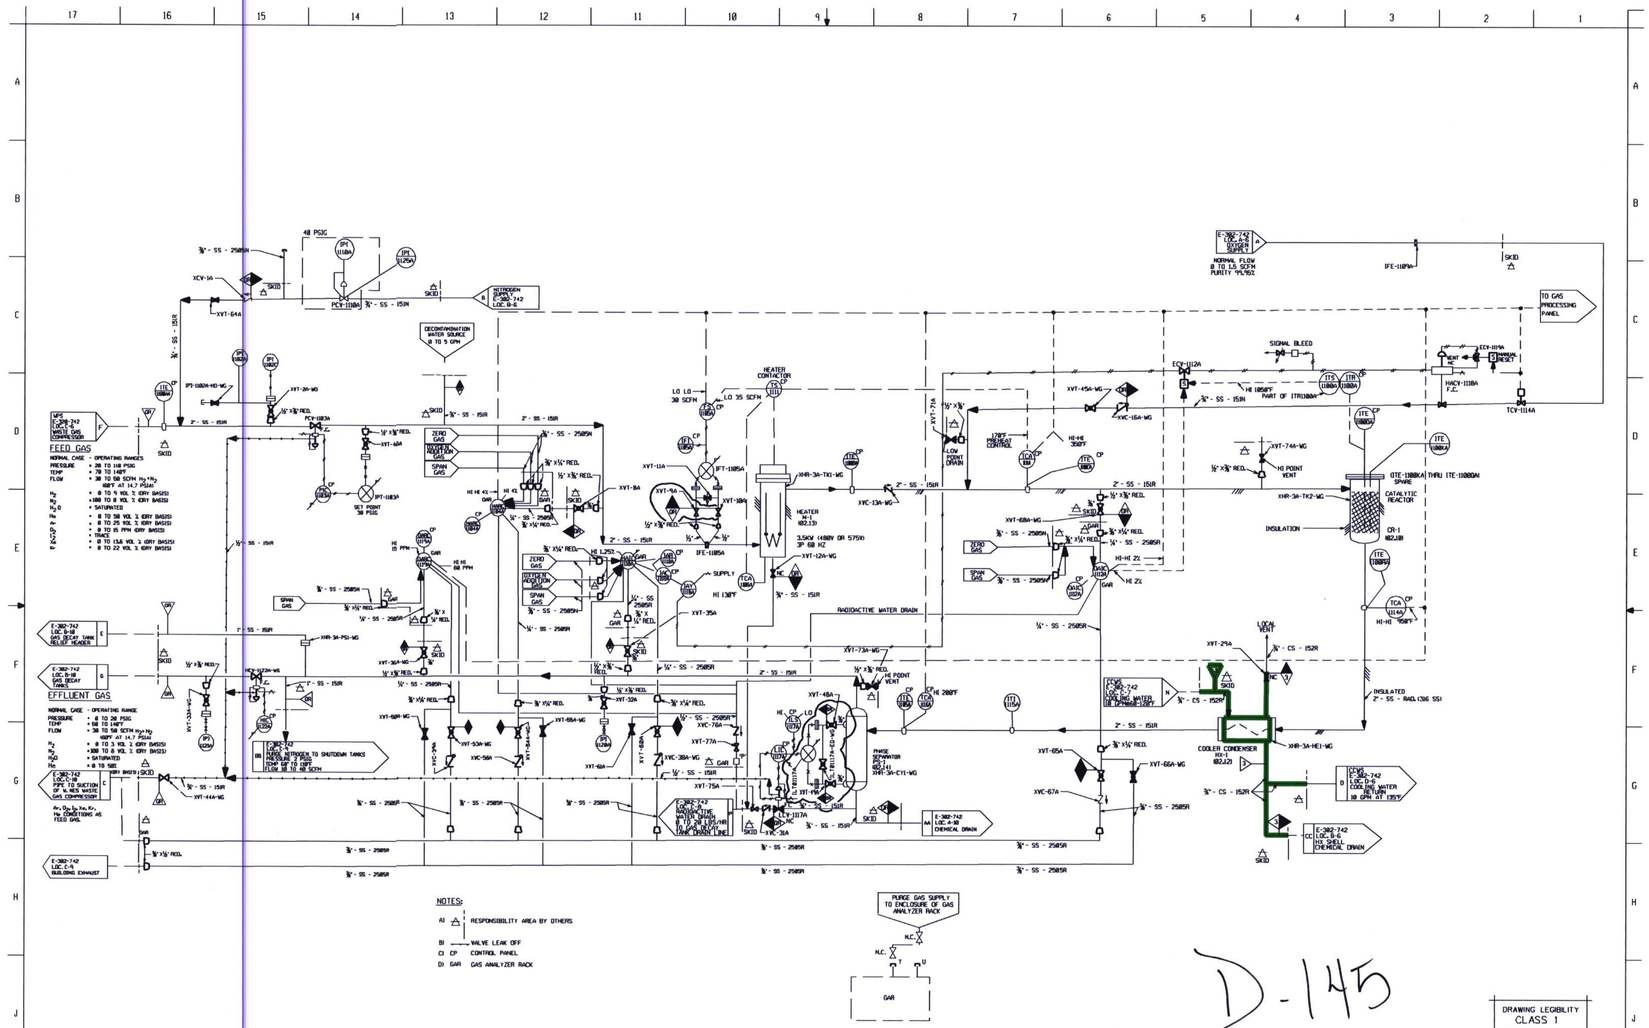
FEED GAS
EFFLUENT GAS
NOTES:
A) RESPONSIBILITY AREA BY OTHERS
B) VALVE LEAK OFF
C) CP CONTROL PANEL
D) GAR GAS ANALYZER RACK
PURGE GAS SUPPLY TO ENCLOSURE OF GAS ANALYZER RACK
TO GAS PROCESSING PANEL
CATALYTIC REACTOR
COOLER CONDENSER
DRAWING LEGIBILITY CLASS 1
PLEX Drawing TR00160-006
SOUTH CAROLINA ELECTRIC & GAS COMPANY
VIRGIL C. SUMMER NUCLEAR STATION
PIPING SYSTEM FLOW DIAGRAM
CATALYTIC HYDROGEN
RECOMBINER A
DESIGN ENGINEERING
V. C. SUMMER NUCLEAR STATION JENKINSVILLE, S.C.
ACI
MGR
TLW
E-302-744
3
REVISED PER COSS-98-0434
REVISED PER ECR-50054
REVISED PER COSS-95-1185
ISSUED PER MRC-21862
REVISION
D-145