

CHAPTER 6†: CRITICALITY EVALUATION

This chapter documents the criticality evaluation of the HI-STORM 100 System for the storage of spent nuclear fuel in accordance with 10CFR72.124. The results of this evaluation demonstrate that the HI-STORM 100 System is consistent with the Standard Review Plan for Dry Cask Storage Systems, NUREG-1536, and thus, fulfills the following acceptance criteria:

1. The multiplication factor (k_{eff}), including all biases and uncertainties at a 95-percent confidence level, should not exceed 0.95 under all credible normal, off-normal, and accident conditions.
2. At least two unlikely, independent, and concurrent or sequential changes to the conditions essential to criticality safety, under normal, off-normal, and accident conditions, should occur before an accidental criticality is deemed to be possible.
3. When practicable, criticality safety of the design should be established on the basis of favorable geometry, permanent fixed neutron-absorbing materials (poisons), or both.
4. Criticality safety of the cask system should not rely on use of the following credits:
 - a. burnup of the fuel
 - b. fuel-related burnable neutron absorbers
 - c. more than 75 percent for fixed neutron absorbers when subject to standard acceptance test.

In addition to demonstrating that the criticality safety acceptance criteria are satisfied, this chapter describes the HI-STORM 100 System design structures and components important to criticality safety and defines the limiting fuel characteristics in sufficient detail to identify the package accurately and provide a sufficient basis for the evaluation of the package. Analyses for the HI-STAR 100 System, which are applicable to the HI-STORM 100 System, have been previously submitted to the USNRC under Docket Numbers 72-1008 and 71-9261.

† This chapter has been prepared in the format and section organization set forth in Regulatory Guide 3.61. However, the material content of this chapter also fulfills the requirements of NUREG-1536. Pagination and numbering of sections, figures, and tables are consistent with the convention set down in *Chapter 1*, Section 1.0, herein. Finally, all terms-of-art used in this chapter are consistent with the terminology of the glossary (Table 1.0.1) and component nomenclature of the Bill-of-Materials (Section 1.5)

In conformance with the principles established in NUREG-1536 [6.1.1], 10CFR72.124 [6.1.2], and NUREG-0800 Section 9.1.2 [6.1.3], the results in this chapter demonstrate that the effective multiplication factor (k_{eff}) of the HI-STORM 100 System, including all biases and uncertainties evaluated with a 95% probability at the 95% confidence level, does not exceed 0.95 under all credible normal, off-normal, and accident conditions. Moreover, these results demonstrate that the HI-STORM 100 System is designed and maintained such that at least two unlikely, independent, and concurrent or sequential changes must occur to the conditions essential to criticality safety before a nuclear criticality accident is possible. These criteria provide a large subcritical margin, sufficient to assure the criticality safety of the HI-STORM 100 System when fully loaded with fuel of the highest permissible reactivity.

Criticality safety of the HI-STORM 100 System depends on the following four principal design parameters:

1. The inherent geometry of the fuel basket designs within the MPC (and the flux-trap water gaps in the MPC-24, MPC-24E and MPC-24EF);
2. The incorporation of permanent fixed neutron-absorbing panels (Boral) in the fuel basket structure;
3. An administrative limit on the maximum enrichment for PWR fuel and maximum planar-average enrichment for BWR fuel; and
4. An administrative limit on the minimum soluble boron concentration in the water for loading/unloading fuel with higher enrichments in the MPC-24, MPC-24E and MPC-24EF, and for loading/unloading fuel in the MPC-32.

The off-normal and accident conditions defined in Chapter 2 and considered in Chapter 11 have no adverse effect on the design parameters important to criticality safety, and thus, the off-normal and accident conditions are identical to those for normal conditions.

The HI-STORM 100 System is designed such that the fixed neutron absorber (Boral) will remain effective for a storage period greater than 20 years, and there are no credible means to lose it. Therefore, in accordance with 10CFR72.124(b), there is no need to provide a surveillance or monitoring program to verify the continued efficacy of the neutron absorber.

Criticality safety of the HI-STORM 100 System does not rely on the use of any of the following credits:

- burnup of fuel
- fuel-related burnable neutron absorbers
- more than 75 percent of the B-10 content for the fixed neutron absorber (Boral).

The following four interchangeable basket designs are available for use in the HI-STORM 100 System:

- a 24-cell basket (MPC-24), designed for intact PWR fuel assemblies with a specified maximum enrichment and, for higher enrichments, a minimum soluble boron concentration in the pool water for loading/unloading operations,
- a 24-cell basket (MPC-24E) for intact and damaged PWR fuel assemblies. This is a variation of the MPC-24, with an optimized cell arrangement, increased ^{10}B content in the Boral and with four cells capable of accommodating either intact fuel or a damaged fuel container (DFC). Additionally, a variation in the MPC-24E, designated MPC-24EF, is designed for intact and damaged PWR fuel assemblies and PWR fuel debris. The MPC-24E and MPC-24EF are designed for fuel assemblies with a specified maximum enrichment and, for higher enrichments, a minimum soluble boron concentration in the pool water for loading/unloading operations,
- a 32-cell basket (MPC-32), designed for intact PWR fuel assemblies of a specified maximum enrichment and minimum soluble boron concentration for loading/unloading, and
- a 68-cell basket (MPC-68), designed for both intact and damaged BWR fuel assemblies with a specified maximum planar-average enrichment. Additionally, variations in the MPC-68, designated MPC-68F and MPC-68FF, are designed for intact and damaged BWR fuel assemblies and BWR fuel debris with a specified maximum planar-average enrichment.

The HI-STORM 100 System includes the HI-TRAC transfer cask and the HI-STORM storage cask. The HI-TRAC transfer cask is required for loading and unloading fuel into the MPC and for transfer of the MPC into the HI-STORM storage cask. HI-TRAC uses a lead shield for gamma radiation and a water-filled jacket for neutron shielding. The HI-STORM storage cask uses concrete as a shield for both gamma and neutron radiation. Both the HI-TRAC transfer cask

and the HI-STORM storage cask, as well as the HI-STAR System[†], accommodate the interchangeable MPC designs. The three cask designs (HI-STAR, HI-STORM, and HI-TRAC) differ only in the overpack reflector materials (steel for HI-STAR, concrete for HI-STORM, and lead for HI-TRAC), which do not significantly affect the reactivity. Consequently, analyses for the HI-STAR System are directly applicable to the HI-STORM 100 system and vice versa. Therefore, the majority of criticality calculations to support both the HI-STAR and the HI-STORM System have been performed for only one of the two systems, namely the HI-STAR System. Only a selected number of analyses has been performed for both systems to demonstrate that this approach is valid. Therefore, unless specifically noted otherwise, all analyses documented throughout this chapter have been performed for the HI-STAR System. For the cases where analyses were performed for both the HI-STORM and HI-STAR System, this is clearly indicated.

The HI-STORM 100 System for storage (concrete overpack) is dry (no moderator), and thus, the reactivity is very low ($k_{eff} < 0.52$). However, the HI-STORM 100 System for cask transfer (HI-TRAC, lead overpack) is flooded for loading and unloading operations, and thus, represents the limiting case in terms of reactivity.

The MPC-24EF contains the same basket as the MPC-24E. More specifically, all dimensions relevant to the criticality analyses are identical between the MPC-24E and MPC-24EF. Therefore, all criticality results obtained for the MPC-24E are valid for the MPC-24EF and no separate analyses for the MPC-24EF are necessary.

The MPC-68FF contains the same basket as the MPC-68. More specifically, all dimensions relevant to the criticality analyses are identical between the MPC-68 and MPC-68FF. Therefore, all criticality results obtained for the MPC-68 are valid for the MPC-68FF and no separate analyses for the MPC-68FF are necessary.

Confirmation of the criticality safety of the HI-STORM 100 System was accomplished with the three-dimensional Monte Carlo code MCNP4a [6.1.4]. Independent confirmatory calculations were made with NITAWL-KENO5a from the SCALE-4.3 package [6.4.1]. KENO5a [6.1.5] calculations used the 238-group SCALE cross-section library in association with the NITAWL-II program [6.1.6], which adjusts the uranium-238 cross sections to compensate for resonance self-shielding effects. The Dancoff factors required by NITAWL-II were calculated with the CELLDAN code [6.1.13], which includes the SUPERDAN code [6.1.7] as a subroutine. K-factors for one-sided statistical tolerance limits with 95% probability at the 95% confidence level were obtained from the National Bureau of Standards (now NIST) Handbook 91 [6.1.8].

[†] Analyses for the HI-STAR System have previously been submitted to the USNRC under Docket Numbers 72-1008 and 71-9261.

To assess the incremental reactivity effects due to manufacturing tolerances, CASMO-3, a two-dimensional transport theory code [6.1.9-6.1.12] for fuel assemblies, and MCNP4a [6.1.4] were used. The CASMO-3 and MCNP4a calculations identify those tolerances that cause a positive reactivity effect, enabling the subsequent Monte Carlo code input to define the worst case (most conservative) conditions. CASMO-3 was not used for quantitative information, but only to qualitatively indicate the direction and approximate magnitude of the reactivity effects of the manufacturing tolerances.

Benchmark calculations were made to compare the primary code packages (MCNP4a and KENO5a) with experimental data, using critical experiments selected to encompass, insofar as practical, the design parameters of the HI-STORM 100 System. The most important parameters are (1) the enrichment, (2) the water-gap size (MPC-24, MPC-24E and MPC-24EF) or cell spacing (MPC-32 and MPC-68), (3) the ^{10}B loading of the neutron absorber panels, and (4) the soluble boron concentration in the water. The critical experiment benchmarking is presented in Appendix 6.A.

Applicable codes, standards, and regulations, or pertinent sections thereof, include the following:

- NUREG-1536, Standard Review Plan for Dry Cask Storage Systems, USNRC, Washington D.C., January 1997.
- 10CFR72.124, Criteria For Nuclear Criticality Safety.
- Code of Federal Regulations, Title 10, Part 50, Appendix A, General Design Criterion 62, Prevention of Criticality in Fuel Storage and Handling.
- USNRC Standard Review Plan, NUREG-0800, Section 9.1.2, Spent Fuel Storage, Rev. 3, July 1981.

To assure the true reactivity will always be less than the calculated reactivity, the following conservative design criteria and assumptions were made:

- The MPCs are assumed to contain the most reactive fresh fuel authorized to be loaded into a specific basket design.
- Consistent with NUREG-1536, no credit for fuel burnup is assumed, either in depleting the quantity of fissile nuclides or in producing fission product poisons.
- Consistent with NUREG-1536, the criticality analyses assume 75% of the manufacturer's minimum Boron-10 content for the Boral neutron absorber.

- The fuel stack density is conservatively assumed to be 96% of theoretical (10.522 g/cm^3) for all criticality analyses. Fuel stack density is approximately equal to 98% of the pellet density. Therefore, while the pellet density of some fuels may be slightly greater than 96% of theoretical, the actual stack density will be less.
- No credit is taken for the ^{234}U and ^{236}U in the fuel.
- When flooded, the moderator is assumed to be water, with or without soluble boron, at a temperature and density corresponding to the highest reactivity within the expected operating range.
- When credit is taken for soluble boron, a ^{10}B content of 18.0 wt% in boron is assumed.
- Neutron absorption in minor structural members and optional heat conduction elements is neglected, i.e., spacer grids, basket supports, and optional aluminum heat conduction elements are replaced by water.
- Consistent with NUREG-1536, the worst hypothetical combination of tolerances (most conservative values within the range of acceptable values), as identified in Section 6.3, is assumed.
- When flooded, the fuel rod pellet-to-clad gap regions are assumed to be flooded with pure unborated water.
- Planar-averaged enrichments are assumed for BWR fuel. (Consistent with NUREG-1536, analysis is presented in Appendix 6.B to demonstrate that the use of planar-average enrichments produces conservative results.)
- Consistent with NUREG-1536, fuel-related burnable neutron absorbers, such as the Gadolinia normally used in BWR fuel and IFBA normally used in PWR fuel, are neglected.
- For evaluation of the bias, all benchmark calculations that result in a k_{eff} greater than 1.0 are conservatively truncated to 1.0000, consistent with NUREG-1536.
- The water reflector above and below the fuel is assumed to be unborated water, even if borated water is used in the fuel region.

†

- For fuel assemblies that contain low-enriched axial blankets, the governing enrichment is that of the highest planar average, and the blankets are not included in determining the average enrichment.
- For intact fuel assemblies, as defined in the Certificate of Compliance, missing fuel rods must be replaced with dummy rods that displace a volume of water that is equal to, or larger than, that displaced by the original rods.

Results of the design basis criticality safety calculations for single internally flooded HI-TRAC transfer casks with full water reflection on all sides (limiting cases for the HI-STORM 100 System) loaded with intact fuel assemblies are listed in Tables 6.1.1 through 6.1.8, conservatively evaluated for the worst combination of manufacturing tolerances (as identified in Section 6.3), and including the calculational bias, uncertainties, and calculational statistics. To demonstrate that the overpack material does not significantly affect the reactivity, results of the design basis criticality safety calculations for single unreflected, internally flooded HI-STAR casks (limiting cases for the HI-STAR 100 System) are listed in Tables 6.1.1 through 6.1.8 for comparison. In addition, a few results for single internally dry (no moderator) HI-STORM storage casks with full water reflection on all external surfaces of the overpack, including the annulus region between the MPC and overpack, are listed to confirm the low reactivity of the HI-STORM 100 System in storage.

For each of the MPC designs, minimum soluble boron concentration (if applicable) and fuel assembly classes^{††}, Tables 6.1.1 through 6.1.8 list the bounding maximum k_{eff} value, and the associated maximum allowable enrichment. The maximum allowed enrichments and the minimum soluble boron concentrations are defined in Appendix B to the Certificate of Compliance. The candidate fuel assemblies, that are bounded by those listed in Tables 6.1.1 through 6.1.8, are given in Section 6.2.

Results of the design basis criticality safety calculations for single unreflected, internally flooded casks (limiting cases) loaded with damaged fuel assemblies or a combination of intact and damaged fuel assemblies are listed in Tables 6.1.9 through 6.1.11. The results include the calculational bias, uncertainties, and calculational statistics. For each of the MPC designs qualified for damaged fuel and/or fuel debris (MPC-24E, MPC-24EF, MPC-68, MPC-68F and MPC-68FF), Tables 6.1.9 through 6.1.11 indicate the maximum number of DFCs and list the fuel

^{††} For each array size (e.g., 6x6, 7x7, 14x14, etc.), the fuel assemblies have been subdivided into a number of assembly classes, where an assembly class is defined in terms of the (1) number of fuel rods; (2) pitch; (3) number and location of guide tubes (PWR) or water rods (BWR); and (4) cladding material. The assembly classes for BWR and PWR fuel are defined in Section 6.2.

assembly classes, the bounding maximum k_{eff} value and the associated maximum allowable enrichment. For the permissible location of DFCs see Subsection 6.4.4.2. The maximum allowed enrichments are defined in Appendix B to the Certificate of Compliance.

A table listing the maximum k_{eff} (including bias, uncertainties, and calculational statistics), calculated k_{eff} , standard deviation, and energy of the average lethargy causing fission (EALF) for each of the candidate fuel assemblies and basket configurations is provided in Appendix 6.C. These results confirm that the maximum k_{eff} values for the HI-STORM 100 System are below the limiting design criteria ($k_{eff} < 0.95$) when fully flooded and loaded with any of the candidate fuel assemblies and basket configurations. Analyses for the various conditions of flooding that support the conclusion that the fully flooded condition corresponds to the highest reactivity, and thus is most limiting, are presented in Section 6.4. The capability of the HI-STORM 100 System to safely accommodate damaged fuel and fuel debris is demonstrated in Subsection 6.4.4.

Accident conditions have also been considered and no credible accident has been identified that would result in exceeding the design criteria limit on reactivity. After the MPC is loaded with spent fuel, it is seal-welded and cannot be internally flooded. The HI-STORM 100 System for storage is dry (no moderator) and the reactivity is very low. For arrays of HI-STORM storage casks, the radiation shielding and the physical separation between overpacks due to the large diameter and cask pitch preclude any significant neutronic coupling between the casks.

Table 6.1.1

BOUNDING MAXIMUM k_{eff} VALUES FOR EACH ASSEMBLY CLASS IN THE MPC-24
(no soluble boron)

Fuel Assembly Class	Maximum Allowable Enrichment (wt% ^{235}U)	Maximum [†] k_{eff}		
		HI-STORM	HI-TRAC	HI-STAR
14x14A	4.6	0.3080	0.9283	0.9296
14x14B	4.6	---	0.9237	0.9228
14x14C	4.6	---	0.9274	0.9287
14x14D	4.0	---	0.8531	0.8507
14x14E	5.0	---	0.7627	0.7627
15x15A	4.1	---	0.9205	0.9204
15x15B	4.1	---	0.9387	0.9388
15x15C	4.1	---	0.9362	0.9361
15x15D	4.1	---	0.9354	0.9367
15x15E	4.1	---	0.9392	0.9368
15x15F	4.1	0.3648	0.9393 ^{††}	0.9395 ^{†††}
15x15G	4.0	---	0.8878	0.8876
15x15H	3.8	---	0.9333	0.9337
16x16A	4.6	0.3447	0.9273	0.9287
17x17A	4.0	0.3243	0.9378	0.9368
17x17B	4.0	---	0.9318	0.9324
17x17C	4.0	---	0.9319	0.9336

Note: The HI-STORM results are for internally dry (no moderator) HI-STORM storage casks with full water reflection on all sides, the HI-TRAC results are for internally fully flooded HI-TRAC transfer casks (which are part of the HI-STORM 100 System) with full water reflection on all sides, and the HI-STAR results are for unreflected, internally fully flooded HI-STAR casks.

[†] The term "maximum k_{eff} " as used here, and elsewhere in this document, means the highest possible k_{eff} , including bias, uncertainties, and calculational statistics, evaluated for the worst case combination of manufacturing tolerances

^{††} KENO5a verification calculation resulted in a maximum k_{eff} of 0.9383.

^{†††} KENO5a verification calculation resulted in a maximum k_{eff} of 0.9378.

Table 6.1.2

BOUNDING MAXIMUM k_{eff} VALUES FOR EACH ASSEMBLY CLASS IN THE MPC-24
WITH 400 PPM SOLUBLE BORON

Fuel Assembly Class	Maximum Allowable Enrichment (wt% ^{235}U)	Maximum [†] k_{eff}		
		HI-STORM	HI-TRAC	HI-STAR
14x14A	5.0	---	---	0.8884
14x14B	5.0	---	---	0.8900
14x14C	5.0	---	---	0.8950
14x14D	5.0	---	---	0.8518
14x14E	5.0	---	---	0.7132
15x15A	5.0	---	---	0.9119
15x15B	5.0	---	---	0.9284
15x15C	5.0	---	---	0.9236
15x15D	5.0	---	---	0.9261
15x15E	5.0	---	---	0.9265
15x15F	5.0	0.4013	0.9301	0.9314
15x15G	5.0	---	---	0.8939
15x15H	5.0	---	0.9345	0.9366
16x16A	5.0	---	---	0.8955
17x17A	5.0	---	---	0.9264
17x17B	5.0	---	---	0.9284
17x17C	5.0	---	0.9296	0.9294

Note: The HI-STORM results are for internally dry (no moderator) HI-STORM storage casks with full water reflection on all sides, the HI-TRAC results are for internally fully flooded HI-TRAC transfer casks (which are part of the HI-STORM 100 System) with full water reflection on all sides, and the HI-STAR results are for unreflected, internally fully flooded HI-STAR casks.

[†] The term "maximum k_{eff} " as used here, and elsewhere in this document, means the highest possible k-effective, including bias, uncertainties, and calculational statistics, evaluated for the worst case combination of manufacturing tolerances.

Table 6.1.3

BOUNDING MAXIMUM k_{eff} VALUES FOR EACH ASSEMBLY CLASS IN THE MPC-24E AND MPC-24EF (no soluble boron)

Fuel Assembly Class	Maximum Allowable Enrichment (wt% ^{235}U)	Maximum [†] k_{eff}		
		HI-STORM	HI-TRAC	HI-STAR
14x14A	5.0	---	---	0.9380
14x14B	5.0	---	---	0.9312
14x14C	5.0	---	---	0.9356
14x14D	5.0	---	---	0.8875
14x14E	5.0	---	---	0.7651
15x15A	4.5	---	---	0.9336
15x15B	4.5	---	---	0.9465
15x15C	4.5	---	---	0.9462
15x15D	4.5	---	---	0.9440
15x15E	4.5	---	---	0.9455
15x15F	4.5	0.3699	0.9465	0.9468
15x15G	4.5	---	---	0.9054
15x15H	4.2	---	---	0.9423
16x16A	5.0	---	---	0.9341
17x17A	4.4	---	0.9467	0.9447
17x17B	4.4	---	---	0.9421
17x17C	4.4	---	---	0.9433

Note: The HI-STORM results are for internally dry (no moderator) HI-STORM storage casks with full water reflection on all sides, the HI-TRAC results are for internally fully flooded HI-TRAC transfer casks (which are part of the HI-STORM 100 System) with full water reflection on all sides, and the HI-STAR results are for unreflected, internally fully flooded HI-STAR casks.

[†] The term "maximum k_{eff} " as used here, and elsewhere in this document, means the highest possible k-effective, including bias, uncertainties, and calculational statistics, evaluated for the worst case combination of manufacturing tolerances

Table 6.1.4

BOUNDING MAXIMUM k_{eff} VALUES FOR EACH ASSEMBLY CLASS IN THE MPC-24E
AND MPC-24EF WITH 300 PPM SOLUBLE BORON

Fuel Assembly Class	Maximum Allowable Enrichment (wt% ^{235}U)	Maximum [†] k_{eff}		
		HI-STORM	HI-TRAC	HI-STAR
14x14A	5.0	---	---	0.8963
14x14B	5.0	---	---	0.8974
14x14C	5.0	---	---	0.9031
14x14D	5.0	---	---	0.8588
14x14E	5.0	---	---	0.7249
15x15A	5.0	---	---	0.9161
15x15B	5.0	---	---	0.9321
15x15C	5.0	---	---	0.9271
15x15D	5.0	---	---	0.9290
15x15E	5.0	---	---	0.9309
15x15F	5.0	0.3897	0.9333	0.9332
15x15G	5.0	---	---	0.8972
15x15H	5.0	---	0.9399	0.9399
16x16A	5.0	---	---	0.9021
17x17A	5.0	---	0.9320	0.9332
17x17B	5.0	---	---	0.9316
17x17C	5.0	---	---	0.9312

Note: The HI-STORM results are for internally dry (no moderator) HI-STORM storage casks with full water reflection on all sides, the HI-TRAC results are for internally fully flooded HI-TRAC transfer casks (which are part of the HI-STORM 100 System) with full water reflection on all sides, and the HI-STAR results are for unreflected, internally fully flooded HI-STAR casks.

[†] The term "maximum k_{eff} " as used here, and elsewhere in this document, means the highest possible k-effective, including bias, uncertainties, and calculational statistics, evaluated for the worst case combination of manufacturing tolerances.

Table 6.1.5

BOUNDING MAXIMUM k_{eff} VALUES FOR EACH ASSEMBLY CLASS IN THE MPC-32
WITH 1900 PPM SOLUBLE BORON

Fuel Assembly Class	Maximum Allowable Enrichment (wt% ^{235}U)	Maximum [†] k_{eff}		
		HI-STORM	HI-TRAC	HI-STAR
14x14A	4.1	---	---	0.8372
14x14B	4.1	---	---	0.8626
14x14C	4.1	---	---	0.8776
14x14D	4.1	---	---	0.8405
14x14E	4.1	---	---	0.6288
15x15A	4.1	---	---	0.9075
15x15B	4.1	---	---	0.9239
15x15C	4.1	---	---	0.9108
15x15D	4.1	---	---	0.9375
15x15E	4.1	---	---	0.9348
15x15F	4.1	0.4691	0.9403	0.9411
15x15G	4.1	---	---	0.8980
15x15H	4.1	---	---	0.9267
16x16A	4.1	---	---	0.8831
17x17A	4.1	---	---	0.9105
17x17B	4.1	---	---	0.9309
17x17C	4.1	---	0.9365	0.9355

Note: The HI-STORM results are for internally dry (no moderator) HI-STORM storage casks with full water reflection on all sides, the HI-TRAC results are for internally fully flooded HI-TRAC transfer casks (which are part of the HI-STORM 100 System) with full water reflection on all sides, and the HI-STAR results are for unreflected, internally fully flooded HI-STAR casks

[†] The term "maximum k_{eff} " as used here, and elsewhere in this document, means the highest possible k-effective, including bias, uncertainties, and calculational statistics, evaluated for the worst case combination of manufacturing tolerances.

Table 6.1.6

BOUNDING MAXIMUM k_{eff} VALUES FOR EACH ASSEMBLY CLASS IN THE MPC-32
WITH 2600 PPM SOLUBLE BORON

Fuel Assembly Class	Maximum Allowable Enrichment (wt% ^{235}U)	Maximum [†] k_{eff}		
		HI-STORM	HI-TRAC	HI-STAR
14x14A	5.0	---	---	0.8362
14x14B	5.0	---	---	0.8633
14x14C	5.0	---	---	0.8901
14x14D	5.0	---	---	0.8485
14x14E	5.0	---	---	0.6240
15x15A	5.0	---	---	0.9121
15x15B	5.0	---	---	0.9313
15x15C	5.0	---	---	0.9181
15x15D	5.0	---	---	0.9466
15x15E	5.0	---	---	0.9434
15x15F	5.0	0.5142	0.9470	0.9483
15x15G	5.0	---	---	0.9135
15x15H	5.0	---	---	0.9317
16x16A	5.0	---	---	0.8924
17x17A	5.0	---	---	0.9160
17x17B	5.0	---	---	0.9371
17x17C	5.0	---	0.9436	0.9437

Note: The HI-STORM results are for internally dry (no moderator) HI-STORM storage casks with full water reflection on all sides, the HI-TRAC results are for internally fully flooded HI-TRAC transfer casks (which are part of the HI-STORM 100 System) with full water reflection on all sides, and the HI-STAR results are for unreflected, internally fully flooded HI-STAR casks.

[†] The term "maximum k_{eff} " as used here, and elsewhere in this document, means the highest possible k-effective, including bias, uncertainties, and calculational statistics, evaluated for the worst case combination of manufacturing tolerances.

Table 6.1.7

BOUNDING MAXIMUM k_{eff} VALUES FOR EACH ASSEMBLY CLASS IN THE MPC-68
AND MPC-68FF

Fuel Assembly Class	Maximum Allowable Planar-Average Enrichment (wt% ^{235}U)	Maximum [†] k_{eff}		
		HI-STORM	HI-TRAC	HI-STAR
6x6A	2.7 ^{††}	---	0.7886	0.7888 ^{†††}
6x6B [‡]	2.7 ^{††}	---	0.7833	0.7824 ^{†††}
6x6C	2.7 ^{††}	0.2759	0.8024	0.8021 ^{†††}
7x7A	2.7 ^{††}	---	0.7963	0.7974 ^{†††}
7x7B	4.2	0.4061	0.9385	0.9386
8x8A	2.7 ^{††}	---	0.7690	0.7697 ^{†††}
8x8B	4.2	0.3934	0.9427	0.9416
8x8C	4.2	0.3714	0.9429	0.9425
8x8D	4.2	---	0.9408	0.9403
8x8E	4.2	---	0.9309	0.9312
8x8F	4.0	---	0.9396	0.9411

Note: The HI-STORM results are for internally dry (no moderator) HI-STORM storage casks with full water reflection on all sides, the HI-TRAC results are for internally fully flooded HI-TRAC transfer casks (which are part of the HI-STORM 100 System) with full water reflection on all sides, and the HI-STAR results are for unreflected, internally fully flooded HI-STAR casks.

[†] The term "maximum k_{eff} " as used here, and elsewhere in this document, means the highest possible k-effective, including bias, uncertainties, and calculational statistics, evaluated for the worst case combination of manufacturing tolerances.

^{††} This calculation was performed for 3.0% planar-average enrichment, however, the actual fuel and Certificate of Compliance are limited to maximum planar-average enrichment of 2.7%. Therefore, the listed maximum k_{eff} value is conservative.

^{†††} This calculation was performed for a ^{10}B loading of 0.0067 g/cm², which is 75% of a minimum ^{10}B loading of 0.0089 g/cm². The minimum ^{10}B loading in the MPC-68 is 0.0372 g/cm². Therefore, the listed maximum k_{eff} value is conservative.

[‡] Assemblies in this class contain both MOX and UO₂ pins. The composition of the MOX fuel pins is given in Table 6.3.4. The maximum allowable planar-average enrichment for the MOX pins is given in the Certificate of Compliance.

Table 6.1.7 (continued)

BOUNDED MAXIMUM k_{eff} VALUES FOR EACH ASSEMBLY CLASS IN THE MPC-68
AND MPC-68FF

Fuel Assembly Class	Maximum Allowable Planar-Average Enrichment (wt% ^{235}U)	Maximum [†] k_{eff}		
		HI-STORM	HI-TRAC	HI-STAR
9x9A	4.2	0.3365	0.9434	0.9417
9x9B	4.2	---	0.9417	0.9436
9x9C	4.2	---	0.9377	0.9395
9x9D	4.2	---	0.9387	0.9394
9x9E	4.0		0.9402	0.9401
9x9F	4.0	---	0.9402	0.9401
9x9G	4.2	---	0.9307	0.9309
10x10A	4.2	0.3379	0.9448 [‡]	0.9457*
10x10B	4.2	---	0.9443	0.9436
10x10C	4.2	---	0.9430	0.9433
10x10D	4.0	---	0.9383	0.9376
10x10E	4.0	---	0.9157	0.9185

Note: The HI-STORM results are for internally dry (no moderator) HI-STORM storage casks with full water reflection on all sides, the HI-TRAC results are for internally fully flooded HI-TRAC transfer casks (which are part of the HI-STORM 100 System) with full water reflection on all sides, and the HI-STAR results are for unreflected, internally fully flooded HI-STAR casks.

† The term "maximum k_{eff} " as used here, and elsewhere in this document, means the highest possible k-effective, including bias, uncertainties, and calculational statistics, evaluated for the worst case combination of manufacturing tolerances.

‡ KENO5a verification calculation resulted in a maximum k_{eff} of 0.9451.

* KENO5a verification calculation resulted in a maximum k_{eff} of 0.9453.

Table 6.1.8

BOUNDING MAXIMUM k_{eff} VALUES FOR EACH ASSEMBLY CLASS IN THE MPC-68F

Fuel Assembly Class	Maximum Allowable Planar-Average Enrichment (wt% ^{235}U)	Maximum [†] k_{eff}		
		HI-STORM	HI-TRAC	HI-STAR
6x6A	2.7 ^{††}	---	0.7886	0.7888
6x6B ^{†††}	2.7	---	0.7833	0.7824
6x6C	2.7	0.2759	0.8024	0.8021
7x7A	2.7	---	0.7963	0.7974
8x8A	2.7	---	0.7690	0.7697

Notes:

- 1 The HI-STORM results are for internally dry (no moderator) HI-STORM storage casks with full water reflection on all sides, the HI-TRAC results are for internally fully flooded HI-TRAC transfer casks (which are part of the HI-STORM 100 System) with full water reflection on all sides, and the HI-STAR results are for unreflected, internally fully flooded HI-STAR casks.
2. These calculations were performed for a ^{10}B loading of 0.0067 g/cm^2 , which is 75% of a minimum ^{10}B loading of 0.0089 g/cm^2 . The minimum ^{10}B loading in the MPC-68F is 0.010 g/cm^2 . Therefore, the listed maximum k_{eff} values are conservative.

[†] The term "maximum k_{eff} " as used here, and elsewhere in this document, means the highest possible k-effective, including bias, uncertainties, and calculational statistics, evaluated for the worst case combination of manufacturing tolerances.

^{††} These calculations were performed for 3.0% planar-average enrichment, however, the actual fuel and Certificate of Compliance are limited to a maximum planar-average enrichment of 2.7%. Therefore, the listed maximum k_{eff} values are conservative.

^{†††} Assemblies in this class contain both MOX and UO_2 pins. The composition of the MOX fuel pins is given in Table 6.3.4. The maximum allowable planar-average enrichment for the MOX pins is specified in the Certificate of Compliance.

Table 6.1.9

BOUNDING MAXIMUM k_{eff} VALUES FOR THE MPC-24E AND MPC-24EF
WITH UP TO 4 DFCs

Fuel Assembly Class	Maximum Allowable Enrichment (wt% ^{235}U)		Maximum k_{eff}	
	Intact Fuel	Damaged Fuel	HI-TRAC	HI-STAR
All PWR Classes	4.0	4.0	0.9486	0.9480

Table 6.1.10

BOUNDING MAXIMUM k_{eff} VALUES FOR THE MPC-68, MPC-68F AND MPC-68FF
WITH UP TO 68 DFCs

Fuel Assembly Class	Maximum Allowable Planar-Average Enrichment (wt% ^{235}U)		Maximum k_{eff}	
	Intact Fuel	Damaged Fuel	HI-TRAC	HI-STAR
6x6A, 6x6B, 6x6C, 7x7A, 8x8A	2.7	2.7	0.8024	0.8021

Table 6.1.11

BOUNDING MAXIMUM k_{eff} VALUES FOR THE MPC-68 AND MPC-68FF
WITH UP TO 16 DFCs

Fuel Assembly Class	Maximum Allowable Planar-Average Enrichment (wt% ^{235}U)		Maximum k_{eff}	
	Intact Fuel	Damaged Fuel	HI-TRAC	HI-STAR
All BWR Classes	3.7	4.0	0.9328	0.9328

6.2 SPENT FUEL LOADING

Specifications for the BWR and PWR fuel assemblies that were analyzed are given in Tables 6.2.1 and 6.2.2, respectively. For the BWR fuel characteristics, the number and dimensions for the water rods are the actual number and dimensions. For the PWR fuel characteristics, the actual number and dimensions of the control rod guide tubes and thimbles are used. Table 6.2.1 lists 72 unique BWR assemblies while Table 6.2.2 lists 46 unique PWR assemblies, all of which were explicitly analyzed for this evaluation. Examination of Tables 6.2.1 and 6.2.2 reveals that there are a large number of minor variations in fuel assembly dimensions.

Due to the large number of minor variations in the fuel assembly dimensions, the use of explicit dimensions in the Certificate of Compliance could limit the applicability of the HI-STORM 100 System. To resolve this limitation, bounding criticality analyses are presented in this section for a number of defined fuel assembly classes for both fuel types (PWR and BWR). The results of the bounding criticality analyses justify using bounding fuel dimensions, as defined in the Certificate of Compliance.

6.2.1 Definition of Assembly Classes

For each array size (e.g., 6x6, 7x7, 15x15, etc.), the fuel assemblies have been subdivided into a number of defined classes, where a class is defined in terms of (1) the number of fuel rods; (2) pitch; (3) number and locations of guide tubes (PWR) or water rods (BWR); and (4) cladding material. The assembly classes for BWR and PWR fuel are defined in Tables 6.2.1 and 6.2.2, respectively. It should be noted that these assembly classes are unique to this evaluation and are not known to be consistent with any class designations in the open literature.

For each assembly class, calculations have been performed for all of the dimensional variations for which data is available (i.e., all data in Tables 6.2.1 and 6.2.2). These calculations demonstrate that the maximum reactivity corresponds to:

- maximum active fuel length,
- maximum fuel pellet diameter,
- minimum cladding outside diameter (OD),
- maximum cladding inside diameter (ID),
- minimum guide tube/water rod thickness, and
- maximum channel thickness (for BWR assemblies only)

Therefore, for each assembly class, a bounding assembly was defined based on the above characteristics and a calculation for the bounding assembly was performed to demonstrate compliance with the regulatory requirement of $k_{eff} < 0.95$. In some assembly classes this bounding assembly corresponds directly to one of the actual (real) assemblies; while in most assembly classes, the bounding assembly is artificial (i.e., based on bounding dimensions from

more than one of the actual assemblies). In classes where the bounding assembly is artificial, the reactivity of the actual (real) assemblies is typically much less than that of the bounding assembly; thereby providing additional conservatism. As a result of these analyses, the Certificate of Compliance will define acceptability in terms of the bounding assembly parameters for each class.

To demonstrate that the aforementioned characteristics are bounding, a parametric study was performed for a reference BWR assembly, designated herein as 8x8C04 (identified generally as a GE8x8R). Additionally, parametric studies were performed for a PWR assembly (the 15x15F assembly class) in the MPC-24 and MPC-32 with soluble boron in the water flooding the MPC. The results of these studies are shown in Table 6.2.3 through 6.2.5, and verify the positive reactivity effect associated with (1) increasing the pellet diameter, (2) maximizing the cladding ID (while maintaining a constant cladding OD), (3) minimizing the cladding OD (while maintaining a constant cladding ID), (4) decreasing the water rod/guide tube thickness, (5) artificially replacing the Zircaloy water rod tubes/guide tubes with water, and (6) maximizing the channel thickness (for BWR Assemblies). These results, and the many that follow, justify the approach for using bounding dimensions in the Certificate of Compliance. Where margins permit, the Zircaloy water rod tubes (BWR assemblies) are artificially replaced by water in the bounding cases to remove the requirement for water rod thickness from the Certificate of Compliance. As these studies were performed with and without soluble boron, they also demonstrate that the bounding dimensions are valid independent of the soluble boron concentration.

As mentioned, the bounding approach used in these analyses often results in a maximum k_{eff} value for a given class of assemblies that is much greater than the reactivity of any of the actual (real) assemblies within the class, and yet, is still below the 0.95 regulatory limit.

6.2.2 Intact PWR Fuel Assemblies

6.2.2.1 Intact PWR Fuel Assemblies in the MPC-24 without Soluble Boron

For PWR fuel assemblies (specifications listed in Table 6.2.2) the 15x15F01 fuel assembly at 4.1% enrichment has the highest reactivity (maximum k_{eff} of 0.9395). The 17x17A01 assembly (otherwise known as a Westinghouse 17x17 OFA) has a similar reactivity (see Table 6.2.20) and was used throughout this criticality evaluation as a reference PWR assembly. The 17x17A01 assembly is a representative PWR fuel assembly in terms of design and reactivity and is useful for the reactivity studies presented in Sections 6.3 and 6.4. Calculations for the various PWR fuel assemblies in the MPC-24 are summarized in Tables 6.2.6 through 6.2.22 for the fully flooded condition without soluble boron in the water.

Tables 6.2.6 through 6.2.22 show the maximum k_{eff} values for the assembly classes that are acceptable for storage in the MPC-24. All maximum k_{eff} values include the bias, uncertainties, and calculational statistics, evaluated for the worst combination of manufacturing tolerances. All

calculations for the MPC-24 were performed for a ^{10}B loading of 0.020 g/cm^2 , which is 75% of the minimum loading, 0.0267 g/cm^2 , specified on BM-1478, Bill of Materials for 24-Assembly HI-STAR 100 PWR MPC, in Section 1.5. The maximum allowable enrichment in the MPC-24 varies from 3.8 to 5.0 wt% ^{235}U , depending on the assembly class, and is defined in Tables 6.2.6 through 6.2.22. It should be noted that the maximum allowable enrichment does not vary within an assembly class. Table 6.1.1 summarizes the maximum allowable enrichments for each of the assembly classes that are acceptable for storage in the MPC-24.

Tables 6.2.6 through 6.2.22 are formatted with the assembly class information in the top row, the unique assembly designations, dimensions, and k_{eff} values in the following rows above the bold double lines, and the bounding dimensions selected for the Certificate of Compliance and corresponding bounding k_{eff} values in the final rows. Where the bounding assembly corresponds directly to one of the actual assemblies, the fuel assembly designation is listed in the bottom row in parentheses (e.g., Table 6.2.6). Otherwise, the bounding assembly is given a unique designation. For an assembly class that contains only a single assembly (e.g., 14x14D, see Table 6.2.9), the dimensions listed in the Certificate of Compliance are based on the assembly dimensions from that single assembly. All of the maximum k_{eff} values corresponding to the selected bounding dimensions are greater than or equal to those for the actual assembly dimensions and are below the 0.95 regulatory limit.

The results of the analyses for the MPC-24, which were performed for all assemblies in each class (see Tables 6.2.6 through 6.2.22), further confirm the validity of the bounding dimensions established in Section 6.2.1. Thus, for all following calculations, namely analyses of the MPC-24E, MPC-32, and MPC-24 with soluble boron present in the water, only the bounding assembly in each class is analyzed.

6.2.2.2 Intact PWR Fuel Assemblies in the MPC-24 with Soluble Boron

Additionally, the HI-STAR 100 system is designed to allow credit for the soluble boron typically present in the water of PWR spent fuel pools. For a minimum soluble boron concentration of 400ppm, the maximum allowable fuel enrichment is 5.0 wt% ^{235}U for all assembly classes identified in Tables 6.2.6 through 6.2.22. Table 6.1.2 shows the maximum k_{eff} for the bounding assembly in each assembly class. All maximum k_{eff} values are below the 0.95 regulatory limit. The 15x15H assembly class has the highest reactivity (maximum k_{eff} of 0.9366). The calculated k_{eff} and calculational uncertainty for each class is listed in Appendix 6.C.

6.2.2.3 Intact PWR Assemblies in the MPC-24E and MPC-24EF with and without Soluble Boron

The MPC-24E and MPC-24EF are variations of the MPC-24, which provide for storage of higher enriched fuel than the MPC-24 through optimization of the storage cell layout. The MPC-24E and MPC-24EF also allow for the loading of up to 4 PWR Damaged Fuel Containers (DFC) with damaged PWR fuel (MPC-24E and MPC-24EF) and PWR fuel debris (MPC-24EF only). The

requirements for damaged fuel and fuel debris in the MPC-24E and MPC-24EF are discussed in Section 6.2.4.3.

Without credit for soluble boron, the maximum allowable fuel enrichment varies between 4.2 and 5.0 wt% ^{235}U , depending on the assembly classes as identified in Tables 6.2.6 through 6.2.22. The maximum allowable enrichment for each assembly class is listed in Table 6.1.3, together with the maximum k_{eff} for the bounding assembly in the assembly class. All maximum k_{eff} values are below the 0.95 regulatory limit. The 15x15F assembly class at 4.5% enrichment has the highest reactivity (maximum k_{eff} of 0.9468). The calculated k_{eff} and calculational uncertainty for each class is listed in Appendix 6.C.

For a minimum soluble boron concentration of 300ppm, the maximum allowable fuel enrichment is 5.0 wt% ^{235}U for all assembly classes identified in Tables 6.2.6 through 6.2.22. Table 6.1.4 shows the maximum k_{eff} for the bounding assembly in each assembly class. All maximum k_{eff} values are below the 0.95 regulatory limit. The 15x15H assembly class has the highest reactivity (maximum k_{eff} of 0.9399). The calculated k_{eff} and calculational uncertainty for each class is listed in Appendix 6.C.

6.2.2.4 Intact PWR Assemblies in the MPC-32

When loading any PWR fuel assembly in the MPC-32, a minimum soluble boron concentration is required.

For a minimum soluble boron concentration of 1900ppm, the maximum allowable fuel enrichment is 4.1 wt% ^{235}U for all assembly classes identified in Tables 6.2.6 through 6.2.22. Table 6.1.5 shows the maximum k_{eff} for the bounding assembly in each assembly class. All maximum k_{eff} values are below the 0.95 regulatory limit. The 15x15F assembly class has the highest reactivity (maximum k_{eff} of 0.9411). The calculated k_{eff} and calculational uncertainty for each class is listed in Appendix 6.C.

For a minimum soluble boron concentration of 2600ppm, the maximum allowable fuel enrichment is 5.0 wt% ^{235}U for all assembly classes identified in Tables 6.2.6 through 6.2.22. Table 6.1.6 shows the maximum k_{eff} for the bounding assembly in each assembly class. All maximum k_{eff} values are below the 0.95 regulatory limit. The 15x15F assembly class has the highest reactivity (maximum k_{eff} of 0.9483). The calculated k_{eff} and calculational uncertainty for each class is listed in Appendix 6.C.

6.2.3 Intact BWR Fuel Assemblies in the MPC-68 and MPC-68FF

For BWR fuel assemblies (specifications listed in Table 6.2.1) the artificial bounding assembly for the 10x10A assembly class at 4.2% enrichment has the highest reactivity (maximum k_{eff} of

0.9457). Calculations for the various BWR fuel assemblies in the MPC-68 and MPC-68FF are summarized in Tables 6.2.23 through 6.2.40 for the fully flooded condition. In all cases, the gadolinia (Gd_2O_3) normally incorporated in BWR fuel was conservatively neglected.

For calculations involving BWR assemblies, the use of a uniform (planar-average) enrichment, as opposed to the distributed enrichments normally used in BWR fuel, produces conservative results. Calculations confirming this statement are presented in Appendix 6.B for several representative BWR fuel assembly designs. These calculations justify the specification of planar-average enrichments to define acceptability of BWR fuel for loading into the MPC-68.

Tables 6.2.23 through 6.2.40 show the maximum k_{eff} values for assembly classes that are acceptable for storage in the MPC-68 and MPC-68FF. All maximum k_{eff} values include the bias, uncertainties, and calculational statistics, evaluated for the worst combination of manufacturing tolerances. With the exception of assembly classes 6x6A, 6x6B, 6x6C, 7x7A, and 8x8A, which will be discussed in Section 6.2.4, all calculations for the MPC-68 and MPC-68FF were performed with a ^{10}B loading of 0.0279 g/cm^2 , which is 75% of the minimum loading, 0.0372 g/cm^2 , specified on BM-1479, Bill of Materials for 68-Assembly HI-STAR 100 BWR MPC, in Section 1.5. Calculations for assembly classes 6x6A, 6x6B, 6x6C, 7x7A, and 8x8A were conservatively performed with a ^{10}B loading of 0.0067 g/cm^2 . The maximum allowable enrichment in the MPC-68 and MPC-68FF varies from 2.7 to 4.2 wt% ^{235}U , depending on the assembly class. It should be noted that the maximum allowable enrichment does not vary within an assembly class. Table 6.1.7 summarizes the maximum allowable enrichments for all assembly classes that are acceptable for storage in the MPC-68 and MPC-68FF.

Tables 6.2.23 through 6.2.40 are formatted with the assembly class information in the top row, the unique assembly designations, dimensions, and k_{eff} values in the following rows above the bold double lines, and the bounding dimensions selected for the Certificate of Compliance and corresponding bounding k_{eff} values in the final rows. Where an assembly class contains only a single assembly (e.g., 8x8E, see Table 6.2.27), the dimensions listed in the Certificate of Compliance are based on the assembly dimensions from that single assembly. For assembly classes that are suspected to contain assemblies with thicker channels (e.g., 120 mils), bounding calculations are also performed to qualify the thicker channels (e.g. 7x7B, see Table 6.2.23). All of the maximum k_{eff} values corresponding to the selected bounding dimensions are shown to be greater than or equal to those for the actual assembly dimensions and are below the 0.95 regulatory limit.

For assembly classes that contain partial length rods (i.e., 9x9A, 10x10A, and 10x10B), calculations were performed for the actual (real) assembly configuration and for the axial segments (assumed to be full length) with and without the partial length rods. In all cases, the axial segment with only the full length rods present (where the partial length rods are absent) is bounding. Therefore, the bounding maximum k_{eff} values reported for assembly classes that

†

contain partial length rods bound the reactivity regardless of the active fuel length of the partial length rods. As a result, the Certificate of Compliance has no minimum requirement for the active fuel length of the partial length rods.

For BWR fuel assembly classes where margins permit, the Zircaloy water rod tubes are artificially replaced by water in the bounding cases to remove the requirement for water rod thickness from the Certificate of Compliance. For these cases, the bounding water rod thickness is listed as zero.

As mentioned, the highest observed maximum k_{eff} value is 0.9457, corresponding to the artificial bounding assembly in the 10x10A assembly class. This assembly has the following bounding characteristics: (1) the partial length rods are assumed to be zero length (most reactive configuration); (2) the channel is assumed to be 120 mils thick; and (3) the active fuel length of the full length rods is 155 inches. Therefore, the maximum reactivity value is bounding compared to any of the real BWR assemblies listed.

6.2.4 BWR and PWR Damaged Fuel Assemblies and Fuel Debris

In addition to storing intact PWR and BWR fuel assemblies, the HI-STORM 100 System is designed to store BWR and PWR damaged fuel assemblies and fuel debris. Damaged fuel assemblies and fuel debris are defined in Section 2.1.3 and Appendix B to the Certificate of Compliance. Both damaged fuel assemblies and fuel debris are required to be loaded into Damaged Fuel Containers (DFCs) prior to being loaded into the MPC. Four different DFC types with different cross sections are considered; three types for BWR fuel and one for PWR fuel. DFCs containing fuel debris must be stored in the MPC-68F, MPC-68FF or MPC-24EF. DFCs containing BWR damaged fuel assemblies may be stored in the MPC-68, MPC-68F or MPC-68FF. DFCs containing PWR damaged fuel may be stored in the MPC-24E and MPC-24EF. The criticality evaluation of various possible damaged conditions of the fuel is presented in Subsection 6.4.4.

6.2.4.1 Damaged BWR Fuel Assemblies and BWR Fuel Debris in Assembly Classes 6x6A, 6x6B, 6x6C, 7x7A and 8x8A

Tables 6.2.41 through 6.2.45 show the maximum k_{eff} values for the five assembly classes 6x6A, 6x6B, 6x6C, 7x7A and 8x8A. All maximum k_{eff} values include the bias, uncertainties, and calculational statistics, evaluated for the worst combination of manufacturing tolerances. All calculations were performed for a ^{10}B loading of 0.0067 g/cm^2 , which is 75% of a minimum loading, 0.0089 g/cm^2 . However, because the practical manufacturing lower limit for minimum ^{10}B loading is 0.01 g/cm^2 , the minimum ^{10}B loading of 0.01 g/cm^2 is specified on BM-1479, Bill of Materials for 68-Assembly HI-STAR 100 BWR MPC, in Section 1.5, for the MPC-68F. As an additional level of conservatism in the analyses, the calculations were performed for an enrichment of 3.0 wt% ^{235}U , while the maximum allowable enrichment for these assembly

classes is limited to 2.7 wt% ^{235}U in the Certificate of Compliance. Therefore, the maximum k_{eff} values for damaged BWR fuel assemblies and fuel debris are conservative. Calculations for the various BWR fuel assemblies in the MPC-68F are summarized in Tables 6.2.41 through 6.2.45 for the fully flooded condition.

For the assemblies that may be stored as damaged fuel or fuel debris, the 6x6C01 assembly at 3.0 wt% ^{235}U enrichment has the highest reactivity (maximum k_{eff} of 0.8021). Considering all of the conservatism built into this analysis (e.g., higher than allowed enrichment and lower than actual ^{10}B loading), the actual reactivity will be lower.

Because the analysis for the damaged BWR fuel assemblies and fuel debris was performed for a ^{10}B loading of 0.0089 g/cm², which conservatively bounds the analysis of damaged BWR fuel assemblies in an MPC-68 or MPC-68FF with a minimum ^{10}B loading of 0.0372 g/cm², damaged BWR fuel assemblies may also be stored in the MPC-68 or MPC-68FF. However, fuel debris is limited to the MPC-68F and MPC-68FF by Appendix B to the Certificate of Compliance.

Tables 6.2.41 through 6.2.45 are formatted with the assembly class information in the top row, the unique assembly designations, dimensions, and k_{eff} values in the following rows above the bold double lines, and the bounding dimensions selected for the Certificate of Compliance and corresponding bounding k_{eff} values in the final rows. Where an assembly class contains only a single assembly (e.g., 6x6C, see Table 6.2.43), the dimensions listed in the Certificate of Compliance are based on the assembly dimensions from that single assembly. All of the maximum k_{eff} values corresponding to the selected bounding dimensions are greater than or equal to those for the actual assembly dimensions and are well below the 0.95 regulatory limit.

6.2.4.2 Damaged BWR Fuel Assemblies and Fuel Debris in the MPC-68 and MPC-68FF

Damaged BWR fuel assemblies and fuel debris from all BWR classes may be loaded into the MPC-68 and MPC-68FF by restricting the locations of the DFCs to 16 specific cells on the periphery of the fuel basket. The MPC-68 may be loaded with up to 16 DFCs containing damaged fuel assemblies. The MPC-68FF may also be loaded with up to 16 DFCs, with up to 8 DFCs containing fuel debris.

For all assembly classes, the enrichment of the damaged fuel or fuel debris is limited to a maximum of 4.0 wt% ^{235}U , while the enrichment of the intact assemblies stored together with the damaged fuel is limited to a maximum of 3.7 wt% ^{235}U . The maximum k_{eff} is 0.9328. The criticality evaluation of the damaged fuel assemblies and fuel debris in the MPC-68 and MPC-68FF is presented in Section 6.4.4.2.

6.2.4.3 Damaged PWR Fuel Assemblies and Fuel Debris in the MPC-24E and MPC-24EF

In addition to storing intact PWR fuel assemblies, the HI-STORM 100 System is designed to store damaged PWR fuel assemblies (MPC-24E and MPC-24EF) and fuel debris (MPC-24EF only). Damaged fuel assemblies and fuel debris are defined in Section 2.1.3 and Appendix B of the Certificate of Compliance. Damaged PWR fuel assemblies and fuel debris are required to be loaded into PWR Damaged Fuel Containers (DFCs) prior to being loaded into the MPC. Up to four DFCs may be stored in the MPC-24E or MPC-24EF. When loaded with damaged fuel and/or fuel debris, the maximum enrichment for intact and damaged fuel is 4.0 wt% ^{235}U for all assembly classes listed in Table 6.2.6 through 6.2.22. The maximum k_{eff} for these classes is 0.9486. The criticality evaluation of the damaged fuel is presented in Subsection 6.4.4.2.

6.2.5 Thoria Rod Canister

Additionally, the HI-STORM 100 System is designed to store a Thoria Rod Canister in the MPC-68, MPC-68F or MPC-68FF. The canister is similar to a DFC and contains 18 intact Thoria Rods placed in a separator assembly. The reactivity of the canister in the MPC is very low compared to the approved fuel assemblies (The ^{235}U content of these rods correspond to UO_2 rods with an initial enrichment of approximately 1.7 wt% ^{235}U). It is therefore permissible to the Thoria Rod Canister together with any approved content in a MPC-68 or MPC-68F. Specifications of the canister and the Thoria Rods that are used in the criticality evaluation are given in Table 6.2.46. The criticality evaluation are presented in Subsection 6.4.6.

Table 6.2.1 (page 1 of 7)
 BWR FUEL CHARACTERISTICS AND ASSEMBLY CLASS DEFINITIONS
 (all dimensions are in inches)

Fuel Assembly Designation	Clad Material	Pitch	Number of Fuel Rods	Cladding OD	Cladding Thickness	Pellet Diameter	Active Fuel Length	Number of Water Rods	Water Rod OD	Water Rod ID	Channel Thickness	Channel ID
6x6A Assembly Class												
6x6A01	Zr	0.694	36	0.5645	0.0350	0.4940	110.0	0	n/a	n/a	0.060	4.290
6x6A02	Zr	0.694	36	0.5645	0.0360	0.4820	110.0	0	n/a	n/a	0.060	4.290
6x6A03	Zr	0.694	36	0.5645	0.0350	0.4820	110.0	0	n/a	n/a	0.060	4.290
6x6A04	Zr	0.694	36	0.5550	0.0350	0.4820	110.0	0	n/a	n/a	0.060	4.290
6x6A05	Zr	0.696	36	0.5625	0.0350	0.4820	110.0	0	n/a	n/a	0.060	4.290
6x6A06	Zr	0.696	35	0.5625	0.0350	0.4820	110.0	1	0.0	0.0	0.060	4.290
6x6A07	Zr	0.700	36	0.5555	0.03525	0.4780	110.0	0	n/a	n/a	0.060	4.290
6x6A08	Zr	0.710	36	0.5625	0.0260	0.4980	110.0	0	n/a	n/a	0.060	4.290
6x6B (MOX) Assembly Class												
6x6B01	Zr	0.694	36	0.5645	0.0350	0.4820	110.0	0	n/a	n/a	0.060	4.290
6x6B02	Zr	0.694	36	0.5625	0.0350	0.4820	110.0	0	n/a	n/a	0.060	4.290
6x6B03	Zr	0.696	36	0.5625	0.0350	0.4820	110.0	0	n/a	n/a	0.060	4.290
6x6B04	Zr	0.696	35	0.5625	0.0350	0.4820	110.0	1	0.0	0.0	0.060	4.290
6x6B05	Zr	0.710	35	0.5625	0.0350	0.4820	110.0	1	0.0	0.0	0.060	4.290
6x6C Assembly Class												
6x6C01	Zr	0.740	36	0.5630	0.0320	0.4880	77.5	0	n/a	n/a	0.060	4.542
7x7A Assembly Class												
7x7A01	Zr	0.631	49	0.4860	0.0328	0.4110	80	0	n/a	n/a	0.060	4.542

Table 6.2.1 (page 2 of 7)
 BWR FUEL CHARACTERISTICS AND ASSEMBLY CLASS DEFINITIONS
 (all dimensions are in inches)

Fuel Assembly Designation	Clad Material	Pitch	Number of Fuel Rods	Cladding OD	Cladding Thickness	Pellet Diameter	Active Fuel Length	Number of Water Rods	Water Rod OD	Water Rod ID	Channel Thickness	Channel ID
7x7B Assembly Class												
7x7B01	Zr	0.738	49	0.5630	0.0320	0.4870	150	0	n/a	n/a	0.080	5.278
7x7B02	Zr	0.738	49	0.5630	0.0370	0.4770	150	0	n/a	n/a	0.102	5.291
7x7B03	Zr	0.738	49	0.5630	0.0370	0.4770	150	0	n/a	n/a	0.080	5.278
7x7B04	Zr	0.738	49	0.5700	0.0355	0.4880	150	0	n/a	n/a	0.080	5.278
7x7B05	Zr	0.738	49	0.5630	0.0340	0.4775	150	0	n/a	n/a	0.080	5.278
7x7B06	Zr	0.738	49	0.5700	0.0355	0.4910	150	0	n/a	n/a	0.080	5.278
8x8A Assembly Class												
8x8A01	Zr	0.523	64	0.4120	0.0250	0.3580	110	0	n/a	n/a	0.100	4.290
8x8A02	Zr	0.523	63	0.4120	0.0250	0.3580	120	0	n/a	n/a	0.100	4.290

Table 6 2.1 (page 3 of 7)
 BWR FUEL CHARACTERISTICS AND ASSEMBLY CLASS DEFINITIONS
 (all dimensions are in inches)

Fuel Assembly Designation	Clad Material	Pitch	Number of Fuel Rods	Cladding OD	Cladding Thickness	Pellet Diameter	Active Fuel Length	Number of Water Rods	Water Rod OD	Water Rod ID	Channel Thickness	Channel ID
8x8B Assembly Class												
8x8B01	Zr	0.641	63	0.4840	0.0350	0.4050	150	1	0.484	0.414	0.100	5.278
8x8B02	Zr	0.636	63	0.4840	0.0350	0.4050	150	1	0.484	0.414	0.100	5.278
8x8B03	Zr	0.640	63	0.4930	0.0340	0.4160	150	1	0.493	0.425	0.100	5.278
8x8B04	Zr	0.642	64	0.5015	0.0360	0.4195	150	0	n/a	n/a	0.100	5.278
8x8C Assembly Class												
8x8C01	Zr	0.641	62	0.4840	0.0350	0.4050	150	2	0.484	0.414	0.100	5.278
8x8C02	Zr	0.640	62	0.4830	0.0320	0.4100	150	2	0.591	0.531	0.000	no channel
8x8C03	Zr	0.640	62	0.4830	0.0320	0.4100	150	2	0.591	0.531	0.080	5.278
8x8C04	Zr	0.640	62	0.4830	0.0320	0.4100	150	2	0.591	0.531	0.100	5.278
8x8C05	Zr	0.640	62	0.4830	0.0320	0.4100	150	2	0.591	0.531	0.120	5.278
8x8C06	Zr	0.640	62	0.4830	0.0320	0.4110	150	2	0.591	0.531	0.100	5.278
8x8C07	Zr	0.640	62	0.4830	0.0340	0.4100	150	2	0.591	0.531	0.100	5.278
8x8C08	Zr	0.640	62	0.4830	0.0320	0.4100	150	2	0.493	0.425	0.100	5.278
8x8C09	Zr	0.640	62	0.4930	0.0340	0.4160	150	2	0.493	0.425	0.100	5.278
8x8C10	Zr	0.640	62	0.4830	0.0340	0.4100	150	2	0.591	0.531	0.120	5.278
8x8C11	Zr	0.640	62	0.4830	0.0340	0.4100	150	2	0.591	0.531	0.120	5.215
8x8C12	Zr	0.636	62	0.4830	0.0320	0.4110	150	2	0.591	0.531	0.120	5.215

Table 6.2.1 (page 4 of 7)
 BWR FUEL CHARACTERISTICS AND ASSEMBLY CLASS DEFINITIONS
 (all dimensions are in inches)

Fuel Assembly Designation	Clad Material	Pitch	Number of Fuel Rods	Cladding OD	Cladding Thickness	Pellet Diameter	Active Fuel Length	Number of Water Rods	Water Rod OD	Water Rod ID	Channel Thickness	Channel ID
8x8D Assembly Class												
8x8D01	Zr	0.640	60	0.4830	0.0320	0.4110	150	2 large/ 2 small	0.591/ 0.483	0.531/ 0.433	0.100	5.278
8x8D02	Zr	0.640	60	0.4830	0.0320	0.4110	150	4	0.591	0.531	0.100	5.278
8x8D03	Zr	0.640	60	0.4830	0.0320	0.4110	150	4	0.483	0.433	0.100	5.278
8x8D04	Zr	0.640	60	0.4830	0.0320	0.4110	150	1	1.34	1.26	0.100	5.278
8x8D05	Zr	0.640	60	0.4830	0.0320	0.4100	150	1	1.34	1.26	0.100	5.278
8x8D06	Zr	0.640	60	0.4830	0.0320	0.4110	150	1	1.34	1.26	0.120	5.278
8x8D07	Zr	0.640	60	0.4830	0.0320	0.4110	150	1	1.34	1.26	0.080	5.278
8x8D08	Zr	0.640	61	0.4830	0.0300	0.4140	150	3	0.591	0.531	0.080	5.278
8x8E Assembly Class												
8x8E01	Zr	0.640	59	0.4930	0.0340	0.4160	150	5	0.493	0.425	0.100	5.278
8x8F Assembly Class												
8x8F01	Zr	0.609	64	0.4576	0.0290	0.3913	150	4 [†]	0.291 [†]	0.228 [†]	0.055	5.390
9x9A Assembly Class												
9x9A01	Zr	0.566	74	0.4400	0.0280	0.3760	150	2	0.98	0.92	0.100	5.278
9x9A02	Zr	0.566	66	0.4400	0.0280	0.3760	150	2	0.98	0.92	0.100	5.278
9x9A03	Zr	0.566	74/66	0.4400	0.0280	0.3760	150/90	2	0.98	0.92	0.100	5.278
9x9A04	Zr	0.566	66	0.4400	0.0280	0.3760	150	2	0.98	0.92	0.120	5.278

[†] Four rectangular water cross segments dividing the assembly into four quadrants

Table 6.2.1 (page 5 of 7)
 BWR FUEL CHARACTERISTICS AND ASSEMBLY CLASS DEFINITIONS
 (all dimensions are in inches)

Fuel Assembly Designation	Clad Material	Pitch	Number of Fuel Rods	Cladding OD	Cladding Thickness	Pellet Diameter	Active Fuel Length	Number of Water Rods	Water Rod OD	Water Rod ID	Channel Thickness	Channel ID
9x9B Assembly Class												
9x9B01	Zr	0.569	72	0.4330	0.0262	0.3737	150	1	1.516	1.459	0.100	5.278
9x9B02	Zr	0.569	72	0.4330	0.0260	0.3737	150	1	1.516	1.459	0.100	5.278
9x9B03	Zr	0.572	72	0.4330	0.0260	0.3737	150	1	1.516	1.459	0.100	5.278
9x9C Assembly Class												
9x9C01	Zr	0.572	80	0.4230	0.0295	0.3565	150	1	0.512	0.472	0.100	5.278
9x9D Assembly Class												
9x9D01	Zr	0.572	79	0.4240	0.0300	0.3565	150	2	0.424	0.364	0.100	5.278
9x9E Assembly Class [†]												
9x9E01	Zr	0.572	76	0.4170	0.0265	0.3530	150	5	0.546	0.522	0.120	5.215
9x9E02	Zr	0.572	48 28	0.4170 0.4430	0.0265 0.0285	0.3530 0.3745	150	5	0.546	0.522	0.120	5.215

[†] The 9x9E and 9x9F fuel assembly classes represent a single fuel type containing fuel rods with different dimensions (SPC 9x9-5). In addition to the actual configuration (9x9E02 and 9x9F02), the 9x9E class contains a hypothetical assembly with only small fuel rods (9x9E01), and the 9x9F class contains a hypothetical assembly with only large rods (9x9F01). This was done in order to simplify the specification of this assembly in the CoC.

Table 6.2.1 (page 6 of 7)
 BWR FUEL CHARACTERISTICS AND ASSEMBLY CLASS DEFINITIONS
 (all dimensions are in inches)

Fuel Assembly Designation	Clad Material	Pitch	Number of Fuel Rods	Cladding OD	Cladding Thickness	Pellet Diameter	Active Fuel Length	Number of Water Rods	Water Rod OD	Water Rod ID	Channel Thickness	Channel ID
9x9F Assembly Class*												
9x9F01	Zr	0.572	76	0.4430	0.0285	0.3745	150	5	0.546	0.522	0.120	5.215
9x9F02	Zr	0.572	48 28	0.4170 0.4430	0.0265 0.0285	0.3530 0.3745	150	5	0.546	0.522	0.120	5.215
9x9G Assembly Class												
9x9G01	Zr	0.572	72	0.4240	0.0300	0.3565	150	1	1.668	1.604	0.120	5.278
10x10A Assembly Class												
10x10A01	Zr	0.510	92	0.4040	0.0260	0.3450	155	2	0.980	0.920	0.100	5.278
10x10A02	Zr	0.510	78	0.4040	0.0260	0.3450	155	2	0.980	0.920	0.100	5.278
10x10A03	Zr	0.510	92/78	0.4040	0.0260	0.3450	155/90	2	0.980	0.920	0.100	5.278
10x10B Assembly Class												
10x10B01	Zr	0.510	91	0.3957	0.0239	0.3413	155	1	1.378	1.321	0.100	5.278
10x10B02	Zr	0.510	83	0.3957	0.0239	0.3413	155	1	1.378	1.321	0.100	5.278
10x10B03	Zr	0.510	91/83	0.3957	0.0239	0.3413	155/90	1	1.378	1.321	0.100	5.278

* The 9x9E and 9x9F fuel assembly classes represent a single fuel type containing fuel rods with different dimensions (SPC 9x9-5). In addition to the actual configuration (9x9E02 and 9x9F02), the 9x9E class contains a hypothetical assembly with only small fuel rods (9x9E01), and the 9x9F class contains a hypothetical assembly with only large rods (9x9F01). This was done in order to simplify the specification of this assembly in the CoC.

Table 6.2.1 (page 7 of 7)
 BWR FUEL CHARACTERISTICS AND ASSEMBLY CLASS DEFINITIONS
 (all dimensions are in inches)

Fuel Assembly Designation	Clad Material	Pitch	Number of Fuel Rods	Cladding OD	Cladding Thickness	Pellet Diameter	Active Fuel Length	Number of Water Rods	Water Rod OD	Water Rod ID	Channel Thickness	Channel ID
10x10C Assembly Class												
10x10C01	Zr	0.488	96	0.3780	0.0243	0.3224	150	5	1.227	1.165	0.055	5.347
10x10D Assembly Class												
10x10D01	SS	0.565	100	0.3960	0.0200	0.3500	83	0	n/a	n/a	0.08	5.663
10x10E Assembly Class												
10x10E01	SS	0.557	96	0.3940	0.0220	0.3430	83	4	0.3940	0.3500	0.08	5.663

Table 6.2.2 (page 1 of 4)
PWR FUEL CHARACTERISTICS AND ASSEMBLY CLASS DEFINITIONS
(all dimensions are in inches)

Fuel Assembly Designation	Clad Material	Pitch	Number of Fuel Rods	Cladding OD	Cladding Thickness	Pellet Diameter	Active Fuel Length	Number of Guide Tubes	Guide Tube OD	Guide Tube ID	Guide Tube Thickness
14x14A Assembly Class											
14x14A01	Zr	0.556	179	0.400	0.0243	0.3444	150	17	0.527	0.493	0.0170
14x14A02	Zr	0.556	179	0.400	0.0243	0.3444	150	17	0.528	0.490	0.0190
14x14A03	Zr	0.556	179	0.400	0.0243	0.3444	150	17	0.526	0.492	0.0170
14x14B Assembly Class											
14x14B01	Zr	0.556	179	0.422	0.0243	0.3659	150	17	0.539	0.505	0.0170
14x14B02	Zr	0.556	179	0.417	0.0295	0.3505	150	17	0.541	0.507	0.0170
14x14B03	Zr	0.556	179	0.424	0.0300	0.3565	150	17	0.541	0.507	0.0170
14x14B04	Zr	0.556	179	0.426	0.0310	0.3565	150	17	0.541	0.507	0.0170
14x14C Assembly Class											
14x14C01	Zr	0.580	176	0.440	0.0280	0.3765	150	5	1.115	1.035	0.0400
14x14C02	Zr	0.580	176	0.440	0.0280	0.3770	150	5	1.115	1.035	0.0400
14x14C03	Zr	0.580	176	0.440	0.0260	0.3805	150	5	1.111	1.035	0.0380
14x14D Assembly Class											
14x14D01	SS	0.556	180	0.422	0.0165	0.3835	144	16	0.543	0.514	0.0145

Table 6.2.2 (page 2 of 4)
PWR FUEL CHARACTERISTICS AND ASSEMBLY CLASS DEFINITIONS
(all dimensions are in inches)

Fuel Assembly Designation	Clad Material	Pitch	Number of Fuel Rods	Cladding OD	Cladding Thickness	Pellet Diameter	Active Fuel Length	Number of Guide Tubes	Guide Tube OD	Guide Tube ID	Guide Tube Thickness
14x14E Assembly Class											
14x14E01 [†]	SS	0.453 and 0.411	162 3 8	0.3415 0.3415 0.3415	0.0120 0.0285 0.0200	0.313 0.280 0.297	102	0	n/a	n/a	n/a
14x14E02 [†]	SS	0.453 and 0.411	173	0.3415	0.0120	0.313	102	0	n/a	n/a	n/a
14x14E03 [†]	SS	0.453 and 0.411	173	0.3415	0.0285	0.0280	102	0	n/a	n/a	n/a
15x15A Assembly Class											
15x15A01	Zr	0.550	204	0.418	0.0260	0.3580	150	21	0.533	0.500	0.0165

[†] This is the fuel assembly used at Indian Point 1 (IP-1). This assembly is a 14x14 assembly with 23 fuel rods omitted to allow passage of control rods between assemblies. It has a different pitch in different sections of the assembly, and different fuel rod dimensions in some rods.

Table 6.2.2 (page 3 of 4)
PWR FUEL CHARACTERISTICS AND ASSEMBLY CLASS DEFINITIONS
(all dimensions are in inches)

Fuel Assembly Designation	Clad Material	Pitch	Number of Fuel Rods	Cladding OD	Cladding Thickness	Pellet Diameter	Active Fuel Length	Number of Guide Tubes	Guide Tube OD	Guide Tube ID	Guide Tube Thickness
15x15B Assembly Class											
15x15B01	Zr	0.563	204	0.422	0.0245	0.3660	150	21	0.533	0.499	0.0170
15x15B02	Zr	0.563	204	0.422	0.0245	0.3660	150	21	0.546	0.512	0.0170
15x15B03	Zr	0.563	204	0.422	0.0243	0.3660	150	21	0.533	0.499	0.0170
15x15B04	Zr	0.563	204	0.422	0.0243	0.3659	150	21	0.545	0.515	0.0150
15x15B05	Zr	0.563	204	0.422	0.0242	0.3659	150	21	0.545	0.515	0.0150
15x15B06	Zr	0.563	204	0.420	0.0240	0.3671	150	21	0.544	0.514	0.0150
15x15C Assembly Class											
15x15C01	Zr	0.563	204	0.424	0.0300	0.3570	150	21	0.544	0.493	0.0255
15x15C02	Zr	0.563	204	0.424	0.0300	0.3570	150	21	0.544	0.511	0.0165
15x15C03	Zr	0.563	204	0.424	0.0300	0.3565	150	21	0.544	0.511	0.0165
15x15C04	Zr	0.563	204	0.417	0.0300	0.3565	150	21	0.544	0.511	0.0165
15x15D Assembly Class											
15x15D01	Zr	0.568	208	0.430	0.0265	0.3690	150	17	0.530	0.498	0.0160
15x15D02	Zr	0.568	208	0.430	0.0265	0.3686	150	17	0.530	0.498	0.0160
15x15D03	Zr	0.568	208	0.430	0.0265	0.3700	150	17	0.530	0.499	0.0155
15x15D04	Zr	0.568	208	0.430	0.0250	0.3735	150	17	0.530	0.500	0.0150
15x15E Assembly Class											
15x15E01	Zr	0.568	208	0.428	0.0245	0.3707	150	17	0.528	0.500	0.0140
15x15F Assembly Class											
15x15F01	Zr	0.568	208	0.428	0.0230	0.3742	150	17	0.528	0.500	0.0140

Table 6.2.2 (page 4 of 4)
PWR FUEL CHARACTERISTICS AND ASSEMBLY CLASS DEFINITIONS
(all dimensions are in inches)

Fuel Assembly Designation	Clad Material	Pitch	Number of Fuel Rods	Cladding OD	Cladding Thickness	Pellet Diameter	Active Fuel Length	Number of Guide Tubes	Guide Tube OD	Guide Tube ID	Guide Tube Thickness
15x15G Assembly Class											
15x15G01	SS	0.563	204	0.422	0.0165	0.3825	144	21	0.543	0.514	0.0145
15x15H Assembly Class											
15x15H01	Zr	0.568	208	0.414	0.0220	0.3622	150	17	0.528	0.500	0.0140
16x16A Assembly Class											
16x16A01	Zr	0.506	236	0.382	0.0250	0.3255	150	5	0.980	0.900	0.0400
16x16A02	Zr	0.506	236	0.382	0.0250	0.3250	150	5	0.980	0.900	0.0400
17x17A Assembly Class											
17x17A01	Zr	0.496	264	0.360	0.0225	0.3088	144	25	0.474	0.442	0.0160
17x17A02	Zr	0.496	264	0.360	0.0225	0.3088	150	25	0.474	0.442	0.0160
17x17A03	Zr	0.496	264	0.360	0.0250	0.3030	150	25	0.480	0.448	0.0160
17x17B Assembly Class											
17x17B01	Zr	0.496	264	0.374	0.0225	0.3225	150	25	0.482	0.450	0.0160
17x17B02	Zr	0.496	264	0.374	0.0225	0.3225	150	25	0.474	0.442	0.0160
17x17B03	Zr	0.496	264	0.376	0.0240	0.3215	150	25	0.480	0.448	0.0160
17x17B04	Zr	0.496	264	0.372	0.0205	0.3232	150	25	0.427	0.399	0.0140
17x17B05	Zr	0.496	264	0.374	0.0240	0.3195	150	25	0.482	0.450	0.0160
17x17B06	Zr	0.496	264	0.372	0.0205	0.3232	150	25	0.480	0.452	0.0140
17x17C Assembly Class											
17x17C01	Zr	0.502	264	0.379	0.0240	0.3232	150	25	0.472	0.432	0.0200
17x17C02	Zr	0.502	264	0.377	0.0220	0.3252	150	25	0.472	0.432	0.0200

Table 6.2.3
 REACTIVITY EFFECT OF ASSEMBLY PARAMETER VARIATIONS for BWR Fuel in the MPC-68
 (all dimensions are in inches)

Fuel Assembly/ Parameter Variation	reactivity effect	calculated k_{eff}	standard deviation	cladding OD	cladding ID	cladding thickness	pellet OD	water rod thickness	channel thickness
8x8C04 (GE8x8R)	reference	0.9307	0.0007	0.483	0.419	0.032	0.410	0.030	0.100
increase pellet OD (+0.001)	+0.0005	0.9312	0.0007	0.483	0.419	0.032	0.411	0.030	0.100
decrease pellet OD (-0.001)	-0.0008	0.9299	0.0009	0.483	0.419	0.032	0.409	0.030	0.100
increase clad ID (+0.004)	+0.0027	0.9334	0.0007	0.483	0.423	0.030	0.410	0.030	0.100
decrease clad ID (-0.004)	-0.0034	0.9273	0.0007	0.483	0.415	0.034	0.410	0.030	0.100
increase clad OD (+0.004)	-0.0041	0.9266	0.0008	0.487	0.419	0.034	0.410	0.030	0.100
decrease clad OD (-0.004)	+0.0023	0.9330	0.0007	0.479	0.419	0.030	0.410	0.030	0.100
increase water rod thickness (+0.015)	-0.0019	0.9288	0.0008	0.483	0.419	0.032	0.410	0.045	0.100
decrease water rod thickness (-0.015)	+0.0001	0.9308	0.0008	0.483	0.419	0.032	0.410	0.015	0.100
remove water rods (i.e., replace the water rod tubes with water)	+0.0021	0.9328	0.0008	0.483	0.419	0.032	0.410	0.000	0.100
remove channel	-0.0039	0.9268	0.0009	0.483	0.419	0.032	0.410	0.030	0.000
increase channel thickness (+0.020)	+0.0005	0.9312	0.0007	0.483	0.419	0.032	0.410	0.030	0.120

Table 6.2.4
 REACTIVITY EFFECT OF ASSEMBLY PARAMETER VARIATIONS in PWR Fuel in the MPC 24 with 400ppm soluble boron concentration
 (all dimensions are in inches)

Fuel Assembly/ Parameter Variation	reactivity effect	calculated k_{eff}	standard deviation	cladding OD	Cladding ID	cladding thickness	pellet OD	guide tube thickness
15x15F (15x15 B&W, 5.0% E)	reference	0.9271	0.0005	0.4280	0.3820	0.0230	0.3742	0.0140
increase pellet OD (+0.001)	-0.0008	0.9263	0.0004	0.4280	0.3820	0.0230	0.3752	0.0140
decrease pellet OD (-0.001)	-0.0002	0.9269	0.0005	0.4280	0.3820	0.0230	0.3732	0.0140
increase clad ID (+0.004)	+0.0040	0.9311	0.0005	0.4280	0.3860	0.0210	0.3742	0.0140
decrease clad ID (-0.004)	-0.0033	0.9238	0.0004	0.4280	0.3780	0.0250	0.3742	0.0140
increase clad OD (+0.004)	-0.0042	0.9229	0.0004	0.4320	0.3820	0.0250	0.3742	0.0140
decrease clad OD (-0.004)	+0.0035	0.9306	0.0005	0.4240	0.3820	0.0210	0.3742	0.0140
increase guide tube thickness (+0.004)	-0.0008	0.9263	0.0005	0.4280	0.3820	0.0230	0.3742	0.0180
decrease guide tube thickness (-0.004)	+0.0006	0.9277	0.0004	0.4280	0.3820	0.0230	0.3742	0.0100
remove guide tubes (i.e., replace the guide tubes with water)	+0.0028	0.9299	0.0004	0.4280	0.3820	0.0230	0.3742	0.000
voided guide tubes	-0.0318	0.8953	0.0005	0.4280	0.3820	0.0230	0.3742	0.0140

Table 6.2.5
 REACTIVITY EFFECT OF ASSEMBLY PARAMETER VARIATIONS in PWR Fuel in the MPC-32 with 2600ppm soluble boron concentration
 (all dimensions are in inches)

Fuel Assembly/ Parameter Variation	reactivity effect	calculated k_{eff}	standard deviation	cladding OD	cladding ID	cladding thickness	pellet OD	guide tube thickness
15x15F (15x15 B&W, 5.0% E)	reference	0.9389	0.0004	0.4280	0.3820	0.0230	0.3742	0.0140
increase pellet OD (+0.001)	+0.0019	0.9408	0.0004	0.4280	0.3820	0.0230	0.3752	0.0140
decrease pellet OD (-0.001)	0.0000	0.9389	0.0004	0.4280	0.3820	0.0230	0.3732	0.0140
increase clad ID (+0.004)	+0.0015	0.9404	0.0004	0.4280	0.3860	0.0210	0.3742	0.0140
decrease clad ID (-0.004)	-0.0015	0.9374	0.0004	0.4280	0.3780	0.0250	0.3742	0.0140
increase clad OD (+0.004)	-0.0002	0.9387	0.0004	0.4320	0.3820	0.0250	0.3742	0.0140
decrease clad OD (-0.004)	+0.0007	0.9397	0.0004	0.4240	0.3820	0.0210	0.3742	0.0140
increase guide tube thickness (+0.004)	-0.0003	0.9387	0.0004	0.4280	0.3820	0.0230	0.3742	0.0180
decrease guide tube thickness (-0.004)	-0.0005	0.9384	0.0004	0.4280	0.3820	0.0230	0.3742	0.0100
remove guide tubes (i.e., replace the guide tubes with water)	-0.0005	0.9385	0.0004	0.4280	0.3820	0.0230	0.3742	0.000
voided guide tubes	+0.0039	0.9428	0.0004	0.4280	0.3820	0.0230	0.3742	0.0140

Table 6.2. 6
 MAXIMUM K_{EFF} VALUES FOR THE 14X14A ASSEMBLY CLASS IN THE MPC-24
 (all dimensions are in inches)

14x14A (4.6% Enrichment, Boral ^{10}B minimum loading of 0.02 g/cm ²)									
179 fuel rods, 17 guide tubes, pitch=0.556, Zr clad									
Fuel Assembly Designation	maximum k_{eff}	calculated k_{eff}	standard deviation	cladding OD	cladding ID	cladding thickness	pellet OD	fuel length	guide tube thickness
14x14A01	0.9295	0.9252	0.0008	0.400	0.3514	0.0243	0.3444	150	0.017
14x14A02	0.9286	0.9242	0.0008	0.400	0.3514	0.0243	0.3444	150	0.019
14x14A03	0.9296	0.9253	0.0008	0.400	0.3514	0.0243	0.3444	150	0.017
Dimensions Listed in Certificate of Compliance				0.400 (min.)	0.3514 (max.)		0.3444 (max.)	150 (max.)	0.017 (min.)
bounding dimensions (14x14A03)	0.9296	0.9253	0.0008	0.400	0.3514	0.0243	0.3444	150	0.017

Table 6.2.7
 MAXIMUM K_{EFF} VALUES FOR THE 14X14B ASSEMBLY CLASS IN THE MPC-24
 (all dimensions are in inches)

14x14B (4.6% Enrichment, Boral ^{10}B minimum loading of 0.02 g/cm ²)									
179 fuel rods, 17 guide tubes, pitch=0.556, Zr clad									
Fuel Assembly Designation	maximum k_{eff}	calculated k_{eff}	standard deviation	cladding OD	cladding ID	cladding thickness	pellet OD	fuel length	guide tube thickness
14x14B01	0.9159	0.9117	0.0007	0.422	0.3734	0.0243	0.3659	150	0.017
14x14B02	0.9169	0.9126	0.0008	0.417	0.3580	0.0295	0.3505	150	0.017
14x14B03	0.9110	0.9065	0.0009	0.424	0.3640	0.0300	0.3565	150	0.017
14x14B04	0.9084	0.9039	0.0009	0.426	0.3640	0.0310	0.3565	150	0.017
Dimensions Listed in Certificate of Compliance				0.417 (min.)	0.3734 (max.)		0.3659 (max.)	150 (max.)	0.017 (min.)
bounding dimensions (B14x14B01)	0.9228	0.9185	0.0008	0.417	0.3734	0.0218	0.3659	150	0.017

Table 6 2 8
 MAXIMUM K_{EFF} VALUES FOR THE 14X14C ASSEMBLY CLASS IN THE MPC-24
 (all dimensions are in inches)

14x14C (4.6% Enrichment, Boral ^{10}B minimum loading of 0.02 g/cm ²)									
176 fuel rods, 5 guide tubes, pitch=0.580, Zr clad									
Fuel Assembly Designation	maximum k_{eff}	calculated k_{eff}	standard deviation	cladding OD	Cladding ID	cladding thickness	pellet OD	fuel length	guide tube thickness
14x14C01	0.9258	0.9215	0.0008	0.440	0.3840	0.0280	0.3765	150	0.040
14x14C02	0.9265	0.9222	0 0008	0.440	0.3840	0 0280	0.3770	150	0.040
14x14C03	0.9287	0.9242	0.0009	0.440	0.3880	0 0260	0.3805	150	0.038
Dimensions Listed in Certificate of Compliance				0.440 (min.)	0.3880 (max.)		0.3805 (max.)	150 (max.)	0.038 (min)
bounding dimensions (14x14C03)	0 9287	0.9242	0.0009	0.440	0.3880	0.0260	0.3805	150	0.038

Table 6.2.9
 MAXIMUM K_{EFF} VALUES FOR THE 14X14D ASSEMBLY CLASS IN THE MPC-24
 (all dimensions are in inches)

14x14D (4.0% Enrichment, Boral ^{10}B minimum loading of 0.02 g/cm ²)									
180 fuel rods, 16 guide tubes, pitch=0.556, SS clad									
Fuel Assembly Designation	maximum k_{eff}	calculated k_{eff}	standard deviation	cladding OD	Cladding ID	cladding thickness	pellet OD	fuel length	guide tube thickness
14x14D01	0.8507	0.8464	0.0008	0.422	0.3890	0.0165	0.3835	144	0.0145
Dimensions Listed in Certificate of Compliance				0.422 (min.)	0.3890 (max.)		0.3835 (max.)	144 (max.)	0.0145 (min)

Table 6.2.10
 MAXIMUM K_{EFF} VALUES FOR THE 14X14E ASSEMBLY CLASS IN THE MPC-24
 (all dimensions are in inches)

14x14E (5.0% Enrichment, Boral ^{10}B minimum loading of 0.02 g/cm ²)									
173 fuel rods, 0 guide tubes, pitch=0.453 and 0.441, SS clad [†]									
Fuel Assembly Designation	maximum k_{eff}	calculated k_{eff}	standard deviation	cladding OD	cladding ID	cladding thickness	pellet OD	fuel length ^{††}	guide tube thickness
14x14E01	0.7598	0.7555	0.0008	0.3415	0.3175 0.2845 0.3015	0.0120 0.0285 0.0200	0.3130 0.2800 0.2970	102	0.0000
14x14E02	0.7627	0.7586	0.0007	0.3415	0.3175	0.0120	0.3130	102	0.0000
14x14E03	0.6952	0.6909	0.0008	0.3415	0.2845	0.0285	0.2800	102	0.0000
Dimensions Listed in Certificate of Compliance				0.3415 (min.)	0.3175 (max.)		0.3130 (max.)	102 (max.)	0.0000 (min.)
Bounding dimensions (14x14E02)	0.7627	0.7586	0.0007	0.3415	0.3175	0.0120	0.3130	102	0.0000

[†] This is the IP-1 fuel assembly at Indian Point. This assembly is a 14x14 assembly with 23 fuel rods omitted to allow passage of control rods between assemblies. Fuel rod dimensions are bounding for each of the three types of rods found in the IP-1 fuel assembly.

^{††} Calculations were conservatively performed for a fuel length of 150 inches.

Table 6.2.11
 MAXIMUM K_{EFF} VALUES FOR THE 15X15A ASSEMBLY CLASS IN THE MPC-24
 (all dimensions are in inches)

15x15A (4.1% Enrichment, Boral ^{10}B minimum loading of 0.02 g/cm ²)									
204 fuel rods, 21 guide tubes, pitch=0.550, Zr clad									
Fuel Assembly Designation	maximum k_{eff}	calculated k_{eff}	standard deviation	cladding OD	cladding ID	cladding thickness	pellet OD	fuel length	guide tube thickness
15x15A01	0.9204	0.9159	0.0009	0.418	0.3660	0.0260	0.3580	150	0.0165
Dimensions Listed in Certificate of Compliance				0.418 (min.)	0.3660 (max.)		0.3580 (max.)	150 (max.)	0.0165 (min.)

Table 6.2.12
 MAXIMUM K_{EFF} VALUES FOR THE 15X15B ASSEMBLY CLASS IN THE MPC-24
 (all dimensions are in inches)

15x15B (4.1% Enrichment, Boral ^{10}B minimum loading of 0.02 g/cm ²)									
204 fuel rods, 21 guide tubes, pitch=0.563, Zr clad									
Fuel Assembly Designation	maximum k_{eff}	calculated k_{eff}	standard deviation	cladding OD	cladding ID	cladding thickness	pellet OD	fuel length	guide tube thickness
15x15B01	0.9369	0.9326	0.0008	0.422	0.3730	0.0245	0.3660	150	0.017
15x15B02	0.9338	0.9295	0.0008	0.422	0.3730	0.0245	0.3660	150	0.017
15x15B03	0.9362	0.9318	0.0008	0.422	0.3734	0.0243	0.3660	150	0.017
15x15B04	0.9370	0.9327	0.0008	0.422	0.3734	0.0243	0.3659	150	0.015
15x15B05	0.9356	0.9313	0.0008	0.422	0.3736	0.0242	0.3659	150	0.015
15x15B06	0.9366	0.9324	0.0007	0.420	0.3720	0.0240	0.3671	150	0.015
Dimensions Listed in Certificate of Compliance				0.420 (min.)	0.3736 (max.)		0.3671 (max.)	150 (max.)	0.015 (min.)
bounding dimensions (B15x15B01)	0.9388	0.9343	0.0009	0.420	0.3736	0.0232	0.3671	150	0.015

†

Table 6.2.13
 MAXIMUM K_{EFF} VALUES FOR THE 15X15C ASSEMBLY CLASS IN THE MPC-24
 (all dimensions are in inches)

15x15C (4.1% Enrichment, Boral ^{10}B minimum loading of 0.02 g/cm ²)									
204 fuel rods, 21 guide tubes, pitch=0.563, Zr clad									
Fuel Assembly Designation	maximum k_{eff}	calculated k_{eff}	standard deviation	cladding OD	cladding ID	cladding thickness	pellet OD	fuel length	guide tube thickness
15x15C01	0.9255	0.9213	0.0007	0.424	0.3640	0.0300	0.3570	150	0.0255
15x15C02	0.9297	0.9255	0.0007	0.424	0.3640	0.0300	0.3570	150	0.0165
15x15C03	0.9297	0.9255	0.0007	0.424	0.3640	0.0300	0.3565	150	0.0165
15x15C04	0.9311	0.9268	0.0008	0.417	0.3570	0.0300	0.3565	150	0.0165
Dimensions Listed in Certificate of Compliance				0.417 (min.)	0.3640 (max.)		0.3570 (max.)	150 (max)	0.0165 (min.)
bounding dimensions (B15x15C01)	0.9361	0.9316	0.0009	0.417	0.3640	0.0265	0.3570	150	0.0165

Table 6.2.14
 MAXIMUM K_{EFF} VALUES FOR THE 15X15D ASSEMBLY CLASS IN THE MPC-24
 (all dimensions are in inches)

15x15D (4 1% Enrichment, Boral ^{10}B minimum loading of 0.02 g/cm ²)									
208 fuel rods, 17 guide tubes, pitch=0.568, Zr clad									
Fuel Assembly Designation	maximum k_{eff}	calculated k_{eff}	standard deviation	cladding OD	cladding ID	cladding thickness	pellet OD	fuel length	guide tube thickness
15x15D01	0.9341	0.9298	0.0008	0.430	0.3770	0.0265	0.3690	150	0.0160
15x15D02	0.9367	0.9324	0.0008	0.430	0.3770	0.0265	0.3686	150	0.0160
15x15D03	0.9354	0.9311	0.0008	0.430	0.3770	0.0265	0.3700	150	0.0155
15x15D04	0.9339	0.9292	0.0010	0.430	0.3800	0.0250	0.3735	150	0.0150
Dimensions Listed in Certificate of Compliance				0.430 (min.)	0.3800 (max.)		0.3735 (max.)	150 (max.)	0.0150 (min.)
bounding dimensions (15x15D04)	0.9339 [†]	0.9292	0.0010	0.430	0.3800	0.0250	0.3735	150	0.0150

[†] The k_{eff} value listed for the 15x15D02 case is higher than that for the case with the bounding dimensions. Therefore, the 0.9367 (15x15D02) value is listed in Table 6.1.1 as the maximum.

Table 6.2.15
 MAXIMUM K_{EFF} VALUES FOR THE 15X15E ASSEMBLY CLASS IN THE MPC-24
 (all dimensions are in inches)

15x15E (4.1% Enrichment, Boral ^{10}B minimum loading of 0.02 g/cm ²)									
208 fuel rods, 17 guide tubes, pitch=0.568, Zr clad									
Fuel Assembly Designation	maximum k_{eff}	calculated k_{eff}	standard deviation	cladding OD	cladding ID	cladding thickness	pellet OD	fuel length	guide tube thickness
15x15E01	0.9368	0.9325	0.0008	0.428	0.3790	0.0245	0.3707	150	0.0140
Dimensions Listed in Certificate of Compliance				0.428 (min.)	0.3790 (max.)		0.3707 (max.)	150 (max.)	0.0140 (min.)

Table 6.2.16
 MAXIMUM K_{EFF} VALUES FOR THE 15X15F ASSEMBLY CLASS IN THE MPC-24
 (all dimensions are in inches)

15x15F (4.1% Enrichment, Boral ^{10}B minimum loading of 0.02 g/cm ²)									
208 fuel rods, 17 guide tubes, pitch=0.568, Zr clad									
Fuel Assembly Designation	maximum k_{eff}	calculated k_{eff}	standard deviation	cladding OD	cladding ID	cladding thickness	pellet OD	fuel length	guide tube thickness
15x15F01	0.9395 [†]	0.9350	0.0009	0.428	0.3820	0.0230	0.3742	150	0.0140
Dimensions Listed in Certificate of Compliance				0.428 (mm)	0.3820 (max.)		0.3742 (max.)	150 (max.)	0.0140 (min.)

[†] KENO5a verification calculation resulted in a maximum k_{eff} of 0.9383.

Table 6.2.17
 MAXIMUM K_{EFF} VALUES FOR THE 15X15G ASSEMBLY CLASS IN THE MPC-24
 (all dimensions are in inches)

15x15G (4.0% Enrichment, Boral ^{10}B minimum loading of 0.02 g/cm ²)									
204 fuel rods, 21 guide tubes, pitch=0.563, SS clad									
Fuel Assembly Designation	maximum k_{eff}	calculated k_{eff}	standard deviation	cladding OD	cladding ID	cladding thickness	pellet OD	fuel length	guide tube thickness
15x15G01	0.8876	0.8833	0.0008	0.422	0.3890	0.0165	0.3825	144	0.0145
Dimensions Listed in Certificate of Compliance				0.422 (min)	0.3890 (max.)		0.3825 (max.)	144 (max.)	0.0145 (min.)

Table 6.2.18
 MAXIMUM K_{EFF} VALUES FOR THE 15X15H ASSEMBLY CLASS IN THE MPC-24
 (all dimensions are in inches)

15x15H (3.8% Enrichment, Boral ^{10}B minimum loading of 0.02 g/cm ²)									
208 fuel rods, 17 guide tubes, pitch=0.568, Zr clad									
Fuel Assembly Designation	maximum k_{eff}	calculated k_{eff}	standard deviation	cladding OD	cladding ID	cladding thickness	pellet OD	fuel length	guide tube thickness
15x15H01	0.9337	0.9292	0 0009	0 414	0.3700	0.0220	0.3622	150	0.0140
Dimensions Listed in Certificate of Compliance				0 414 (min.)	0 3700 (max.)		0.3622 (max.)	150 (max.)	0.0140 (min.)

Table 6.2.19
 MAXIMUM K_{EFF} VALUES FOR THE 16X16A ASSEMBLY CLASS IN THE MPC-24
 (all dimensions are in inches)

16x16A (4.6% Enrichment, Boral ^{10}B minimum loading of 0.02 g/cm ²)									
236 fuel rods, 5 guide tubes, pitch=0.506, Zr clad									
Fuel Assembly Designation	maximum k_{eff}	calculated k_{eff}	standard deviation	cladding OD	cladding ID	cladding thickness	pellet OD	fuel length	guide tube thickness
16x16A01	0.9287	0.9244	0.0008	0.382	0.3320	0.0250	0.3255	150	0.0400
16x16A02	0.9263	0.9221	0.0007	0.382	0.3320	0.0250	0.3250	150	0.0400
Dimensions Listed in Certificate of Compliance				0.382 (min.)	0.3320 (max.)		0.3255 (max.)	150 (max.)	0.0400 (min.)
bounding dimensions (16x16A01)	0.9287	0.9244	0.0008	0.382	0.3320	0.0250	0.3255	150	0.0400

Table 6 2.20
 MAXIMUM K_{eff} VALUES FOR THE 17X17A ASSEMBLY CLASS IN THE MPC-24
 (all dimensions are in inches)

17x17A (4.0% Enrichment, Boral ^{10}B minimum loading of 0.02 g/cm ²)									
264 fuel rods, 25 guide tubes, pitch=0.496, Zr clad									
Fuel Assembly Designation	maximum k_{eff}	calculated k_{eff}	standard deviation	cladding OD	cladding ID	cladding thickness	pellet OD	fuel length	guide tube thickness
17x17A01	0.9368	0.9325	0.0008	0 360	0.3150	0.0225	0.3088	144	0.016
17x17A02	0.9368	0.9325	0.0008	0.360	0.3150	0 0225	0.3088	150	0.016
17x17A03	0.9329	0.9286	0.0008	0 360	0.3100	0.0250	0.3030	150	0.016
Dimensions Listed in Certificate of Compliance				0 360 (min.)	0.3150 (max.)		0.3088 (max.)	150 (max.)	0.016 (min.)
bounding dimensions (17x17A02)	0.9368	0.9325	0.0008	0.360	0 3150	0 0225	0.3088	150	0.016

†

Table 6.2.21
 MAXIMUM K_{EFF} VALUES FOR THE 17X17B ASSEMBLY CLASS IN THE MPC-24
 (all dimensions are in inches)

17x17B (4.0% Enrichment, Boral ^{10}B minimum loading of 0.02 g/cm ²)									
264 fuel rods, 25 guide tubes, pitch=0.496, Zr clad									
Fuel Assembly Designation	maximum k_{eff}	calculated k_{eff}	standard deviation	Cladding OD	cladding ID	cladding thickness	pellet OD	fuel length	guide tube thickness
17x17B01	0.9288	0.9243	0.0009	0.374	0.3290	0.0225	0.3225	150	0.016
17x17B02	0.9290	0.9247	0.0008	0.374	0.3290	0.0225	0.3225	150	0.016
17x17B03	0.9243	0.9199	0.0008	0.376	0.3280	0.0240	0.3215	150	0.016
17x17B04	0.9324	0.9279	0.0009	0.372	0.3310	0.0205	0.3232	150	0.014
17x17B05	0.9266	0.9222	0.0008	0.374	0.3260	0.0240	0.3195	150	0.016
17x17B06	0.9311	0.9268	0.0008	0.372	0.3310	0.0205	0.3232	150	0.014
Dimensions Listed in Certificate of Compliance				0.372 (min.)	0.3310 (max.)		0.3232 (max.)	150 (max.)	0.014 (min.)
bounding dimensions (17x17B06)	0.9311 [†]	0.9268	0.0008	0.372	0.3310	0.0205	0.3232	150	0.014

[†] The k_{eff} value listed for the 17x17B04 case is higher than that for the case with the bounding dimensions. Therefore, the 0.9324 (17x17B04) value is listed in Table 6.1.1 as the maximum.

Table 6.2.22
 MAXIMUM K_{EFF} VALUES FOR THE 17X17C ASSEMBLY CLASS IN THE MPC-24
 (all dimensions are in inches)

17x17C (4.0% Enrichment, Boral ^{10}B minimum loading of 0.02 g/cm ²)									
264 fuel rods, 25 guide tubes, pitch=0.502, Zr clad									
Fuel Assembly Designation	maximum k_{eff}	calculated k_{eff}	standard deviation	cladding OD	cladding ID	cladding thickness	pellet OD	fuel length	guide tube thickness
17x17C01	0.9293	0.9250	0.0008	0.379	0.3310	0.0240	0.3232	150	0.020
17x17C02	0.9336	0.9293	0.0008	0.377	0.3330	0.0220	0.3252	150	0.020
Dimensions Listed in Certificate of Compliance				0.377 (min.)	0.3330 (max.)		0.3252 (max.)	150 (max.)	0.020 (min.)
bounding dimensions (17x17C02)	0.9336	0.9293	0.0008	0.377	0.3330	0.0220	0.3252	150	0.020

Table 6.2.23
 MAXIMUM K_{EFF} VALUES FOR THE 7X7B ASSEMBLY CLASS IN THE MPC-68 and MPC-68FF
 (all dimensions are in inches)

7x7B (4.2% Enrichment, Boral ^{10}B minimum loading of 0.0279 g/cm ²)										
49 fuel rods, 0 water rods, pitch=0.738, Zr clad										
Fuel Assembly Designation	maximum k_{eff}	calculated k_{eff}	standard deviation	cladding OD	cladding ID	cladding thickness	pellet OD	fuel length	water rod thickness	channel thickness
7x7B01	0.9372	0.9330	0.0007	0.5630	0.4990	0.0320	0.4870	150	n/a	0.080
7x7B02	0.9301	0.9260	0.0007	0.5630	0.4890	0.0370	0.4770	150	n/a	0.102
7x7B03	0.9313	0.9271	0.0008	0.5630	0.4890	0.0370	0.4770	150	n/a	0.080
7x7B04	0.9311	0.9270	0.0007	0.5700	0.4990	0.0355	0.4880	150	n/a	0.080
7x7B05	0.9350	0.9306	0.0008	0.5630	0.4950	0.0340	0.4775	150	n/a	0.080
7x7B06	0.9298	0.9260	0.0006	0.5700	0.4990	0.0355	0.4910	150	n/a	0.080
Dimensions Listed in Certificate of Compliance				0.5630 (min.)	0.4990 (max.)		0.4910 (max.)	150 (max.)	n/a	0.120 (max.)
bounding dimensions (B7x7B01)	0.9375	0.9332	0.0008	0.5630	0.4990	0.0320	0.4910	150	n/a	0.102
bounding dimensions with 120 mil channel (B7x7B02)	0.9386	0.9344	0.0007	0.5630	0.4990	0.0320	0.4910	150	n/a	0.120

Table 6.2.24
 MAXIMUM K_{EFF} VALUES FOR THE 8X8B ASSEMBLY CLASS IN THE MPC-68 and MPC-68FF
 (all dimensions are in inches)

8x8B (4.2% Enrichment, Boral ^{10}B minimum loading of 0.0279 g/cm ²)												
63 or 64 fuel rods [†] , 1 or 0 water rods [†] , pitch [†] = 0.636-0.642, Zr clad												
Fuel Assembly Designation	maximum k_{eff}	calculated k_{eff}	standard deviation	Fuel rods	Pitch	cladding OD	cladding ID	cladding thickness	pellet OD	fuel length	water rod thickness	channel thickness
8x8B01	0.9310	0.9265	0.0009	63	0.641	0.4840	0.4140	0.0350	0.4050	150	0.035	0.100
8x8B02	0.9227	0.9185	0.0007	63	0.636	0.4840	0.4140	0.0350	0.4050	150	0.035	0.100
8x8B03	0.9299	0.9257	0.0008	63	0.640	0.4930	0.4250	0.0340	0.4160	150	0.034	0.100
8x8B04	0.9236	0.9194	0.0008	64	0.642	0.5015	0.4295	0.0360	0.4195	150	n/a	0.100
Dimensions Listed in Certificate of Compliance				63 or 64	0.636-0.642	0.4840 (min.)	0.4295 (max.)		0.4195 (max.)	150 (max.)	0.034	0.120 (max.)
bounding (pitch=0.636) (B8x8B01)	0.9346	0.9301	0.0009	63	0.636	0.4840	0.4295	0.02725	0.4195	150	0.034	0.120
bounding (pitch=0.640) (B8x8B02)	0.9385	0.9343	0.0008	63	0.640	0.4840	0.4295	0.02725	0.4195	150	0.034	0.120
bounding (pitch=0.642) (B8x8B03)	0.9416	0.9375	0.0007	63	0.642	0.4840	0.4295	0.02725	0.4195	150	0.034	0.120

[†] This assembly class was analyzed and qualified for a small variation in the pitch and a variation in the number of fuel and water rods.

Table 6.2.25
 MAXIMUM K_{EFF} VALUES FOR THE 8X8C ASSEMBLY CLASS IN THE MPC-68 and MPC-68FF
 (all dimensions are in inches)

8x8C (4.2% Enrichment, Boral ^{10}B minimum loading of 0.0279 g/cm ²)											
62 fuel rods, 2 water rods, pitch [†] = 0.636-0.641, Zr clad											
Fuel Assembly Designation	maximum k_{eff}	calculated k_{eff}	standard deviation	pitch	cladding OD	cladding ID	cladding thickness	pellet OD	fuel length	water rod thickness	channel thickness
8x8C01	0.9315	0.9273	0.0007	0.641	0.4840	0.4140	0.0350	0.4050	150	0.035	0.100
8x8C02	0.9313	0.9268	0.0009	0.640	0.4830	0.4190	0.0320	0.4100	150	0.030	0.000
8x8C03	0.9329	0.9286	0.0008	0.640	0.4830	0.4190	0.0320	0.4100	150	0.030	0.800
8x8C04	0.9348 ^{††}	0.9307	0.0007	0.640	0.4830	0.4190	0.0320	0.4100	150	0.030	0.100
8x8C05	0.9353	0.9312	0.0007	0.640	0.4830	0.4190	0.0320	0.4100	150	0.030	0.120
8x8C06	0.9353	0.9312	0.0007	0.640	0.4830	0.4190	0.0320	0.4110	150	0.030	0.100
8x8C07	0.9314	0.9273	0.0007	0.640	0.4830	0.4150	0.0340	0.4100	150	0.030	0.100
8x8C08	0.9339	0.9298	0.0007	0.640	0.4830	0.4190	0.0320	0.4100	150	0.034	0.100
8x8C09	0.9301	0.9260	0.0007	0.640	0.4930	0.4250	0.0340	0.4160	150	0.034	0.100
8x8C10	0.9317	0.9275	0.0008	0.640	0.4830	0.4150	0.0340	0.4100	150	0.030	0.120
8x8C11	0.9328	0.9287	0.0007	0.640	0.4830	0.4150	0.0340	0.4100	150	0.030	0.120
8x8C12	0.9285	0.9242	0.0008	0.636	0.4830	0.4190	0.0320	0.4110	150	0.030	0.120
Dimensions Listed in Certificate of Compliance				0.636-0.641	0.4830 (min.)	0.4250 (max.)		0.4160 (max.)	150 (max.)	0.000 (min.)	0.120 (max.)
bounding (pitch=0.636) (B8x8C01)	0.9357	0.9313	0.0009	0.636	0.4830	0.4250	0.0290	0.4160	150	0.000	0.120
bounding (pitch=0.640) (B8x8C02)	0.9425	0.9384	0.0007	0.640	0.4830	0.4250	0.0290	0.4160	150	0.000	0.120
Bounding (pitch=0.641) (B8x8C03)	0.9418	0.9375	0.0008	0.641	0.4830	0.4250	0.0290	0.4160	150	0.000	0.120

[†] This assembly class was analyzed and qualified for a small variation in the pitch.

^{††} KENO5a verification calculation resulted in a maximum k_{eff} of 0.9343.

Table 6.2.26
 MAXIMUM K_{EFF} VALUES FOR THE 8X8D ASSEMBLY CLASS IN THE MPC-68 and MPC-68FF
 (all dimensions are in inches)

8x8D (4.2% Enrichment, Boral ^{10}B minimum loading of 0.0279 g/cm ²)										
60-61 fuel rods, 1-4 water rods [†] , pitch=0.640, Zr clad										
Fuel Assembly Designation	maximum k_{eff}	calculated k_{eff}	standard deviation	Cladding OD	cladding ID	cladding thickness	pellet OD	fuel length	water rod thickness	channel thickness
8x8D01	0.9342	0.9302	0.0006	0.4830	0.4190	0.0320	0.4110	150	0.03/0.025	0.100
8x8D02	0.9325	0.9284	0.0007	0.4830	0.4190	0.0320	0.4110	150	0.030	0.100
8x8D03	0.9351	0.9309	0.0008	0.4830	0.4190	0.0320	0.4110	150	0.025	0.100
8x8D04	0.9338	0.9296	0.0007	0.4830	0.4190	0.0320	0.4110	150	0.040	0.100
8x8D05	0.9339	0.9294	0.0009	0.4830	0.4190	0.0320	0.4100	150	0.040	0.100
8x8D06	0.9365	0.9324	0.0007	0.4830	0.4190	0.0320	0.4110	150	0.040	0.120
8x8D07	0.9341	0.9297	0.0009	0.4830	0.4190	0.0320	0.4110	150	0.040	0.080
8x8D08	0.9376	0.9332	0.0009	0.4830	0.4230	0.0300	0.4140	150	0.030	0.080
Dimensions Listed in Certificate of Compliance				0.4830 (min.)	0.4230 (max.)		0.4140 (max.)	150 (max.)	0.000 (min.)	0.120 (max.)
bounding dimensions (B8x8D01)	0.9403	0.9363	0.0007	0.4830	0.4230	0.0300	0.4140	150	0.000	0.120

[†] Fuel assemblies 8x8D01 through 8x8D03 have 4 water rods that are similar in size to the fuel rods, while assemblies 8x8D04 through 8x8D07 have 1 large water rod that takes the place of the 4 water rods. Fuel assembly 8x8D08 contains 3 water rods that are similar in size to the fuel rods.

Table 6.2.27
 MAXIMUM K_{EFF} VALUES FOR THE 8X8E ASSEMBLY CLASS IN THE MPC-68 and MPC-68FF
 (all dimensions are in inches)

8x8E (4.2% Enrichment, Boral ^{10}B minimum loading of 0.0279 g/cm ²)										
59 fuel rods, 5 water rods, pitch=0.640, Zr clad										
Fuel Assembly Designation	maximum k_{eff}	calculated k_{eff}	standard deviation	cladding OD	cladding ID	cladding thickness	pellet OD	fuel length	water rod thickness	channel thickness
8x8E01	0.9312	0.9270	0.0008	0.4930	0.4250	0.0340	0.4160	150	0.034	0.100
Dimensions Listed in Certificate of Compliance				0.4930 (min.)	0.4250 (max.)		0.4160 (max.)	150 (max.)	0.034 (min.)	0.100 (max.)

Table 6 2.28
 MAXIMUM K_{EFF} VALUES FOR THE 8X8F ASSEMBLY CLASS IN THE MPC-68 and MPC-68FF
 (all dimensions are in inches)

8x8F (4.0% Enrichment, Boral ^{10}B minimum loading of 0.0279 g/cm ²)										
64 fuel rods, 4 rectangular water cross segments dividing the assembly into four quadrants, pitch=0.609, Zr clad										
Fuel Assembly Designation	maximum k_{eff}	calculated k_{eff}	standard deviation	cladding OD	cladding ID	cladding thickness	pellet OD	fuel length	water rod thickness	channel thickness
8x8F01	0.9411	0.9366	0.0009	0.4576	0.3996	0.0290	0.3913	150	0.0315	0.055
Dimensions Listed in Certificate of Compliance				0.4576 (min.)	0.3996 (max.)		0.3913 (max.)	150 (max.)	0.0315 (min.)	0.055 (max.)

Table 6.2.29
 MAXIMUM K_{EFF} VALUES FOR THE 9X9A ASSEMBLY CLASS IN THE MPC-68 and MPC-68FF
 (all dimensions are in inches)

9x9A (4 2% Enrichment, Boral ^{10}B minimum loading of 0.0279 g/cm ²)										
74/66 fuel rods [†] , 2 water rods, pitch=0.566, Zr clad										
Fuel Assembly Designation	maximum k_{eff}	calculated k_{eff}	standard deviation	cladding OD	cladding ID	cladding thickness	pellet OD	fuel length	water rod thickness	channel thickness
9x9A01 (axial segment with all rods)	0.9353	0.9310	0.0008	0.4400	0.3840	0.0280	0.3760	150	0.030	0.100
9x9A02 (axial segment with only the full length rods)	0.9388	0.9345	0.0008	0.4400	0.3840	0.0280	0.3760	150	0.030	0.100
9x9A03 (actual three-dimensional representation of all rods)	0.9351	0.9310	0.0007	0.4400	0.3840	0.0280	0.3760	150/90	0.030	0.100
9x9A04 (axial segment with only the full length rods)	0.9396	0.9355	0.0007	0.4400	0.3840	0.0280	0.3760	150	0.030	0.120
Dimensions Listed in Certificate of Compliance				0.4400 (min.)	0.3840 (max.)		0.3760 (max.)	150 (max.)	0.000 (min.)	0.120 (max.)
bounding dimensions (axial segment with only the full length rods) (B9x9A01)	0.9417	0.9374	0.0008	0.4400	0.3840	0.0280	0.3760	150	0.000	0.120

[†] This assembly class contains 66 full length rods and 8 partial length rods. In order to eliminate a requirement on the length of the partial length rods, separate calculations were performed for the axial segments with and without the partial length rods.

Table 6.2.30
 MAXIMUM K_{EFF} VALUES FOR THE 9X9B ASSEMBLY CLASS IN THE MPC-68 and MPC-68FF
 (all dimensions are in inches)

9x9B (4.2% Enrichment, Boral ^{10}B minimum loading of 0.0279 g/cm ²)											
72 fuel rods, 1 water rod (square, replacing 9 fuel rods), pitch=0.569 to 0.572 [†] , Zr clad											
Fuel Assembly Designation	maximum k_{eff}	calculated k_{eff}	standard deviation	pitch	cladding OD	cladding ID	cladding thickness	pellet OD	fuel length	water rod thickness	channel thickness
9x9B01	0.9380	0.9336	0.0008	0.569	0.4330	0.3807	0.0262	0.3737	150	0.0285	0.100
9x9B02	0.9373	0.9329	0.0009	0.569	0.4330	0.3810	0.0260	0.3737	150	0.0285	0.100
9x9B03	0.9417	0.9374	0.0008	0.572	0.4330	0.3810	0.0260	0.3737	150	0.0285	0.100
Dimensions Listed in Certificate of Compliance				0.572	0.4330 (min.)	0.3810 (max.)		0.3740 (max.)	150 (max.)	0.000 (min.)	0.120 (max.)
bounding dimensions (B9x9B01)	0.9436	0.9394	0.0008	0.572	0.4330	0.3810	0.0260	0.3740 ^{††}	150	0.000	0.120

[†] This assembly class was analyzed and qualified for a small variation in the pitch.

^{††} This value was conservatively defined to be larger than any of the actual pellet diameters.

Table 6.2.31
 MAXIMUM K_{EFF} VALUES FOR THE 9X9C ASSEMBLY CLASS IN THE MPC-68 and MPC-68FF
 (all dimensions are in inches)

9x9C (4.2% Enrichment, Boral ^{10}B minimum loading of 0.0279 g/cm ²)										
80 fuel rods, 1 water rods, pitch=0.572, Zr clad										
Fuel Assembly Designation	maximum k_{eff}	calculated k_{eff}	standard deviation	cladding OD	cladding ID	cladding thickness	pellet OD	fuel length	water rod thickness	channel thickness
9x9C01	0.9395	0.9352	0.0008	0.4230	0.3640	0.0295	0.3565	150	0.020	0.100
Dimensions Listed in Certificate of Compliance				0.4230 (min.)	0.3640 (max.)		0.3565 (max.)	150 (max.)	0.020 (min.)	0.100 (max.)

Table 6 2 32
 MAXIMUM K_{EFF} VALUES FOR THE 9X9D ASSEMBLY CLASS IN THE MPC-68 and MPC-68FF
 (all dimensions are in inches)

9x9D (4.2% Enrichment, Boral ^{10}B minimum loading of 0.0279 g/cm ²)										
79 fuel rods, 2 water rods, pitch=0.572, Zr clad										
Fuel Assembly Designation	maximum k_{eff}	calculated k_{eff}	standard deviation	cladding OD	cladding ID	cladding thickness	pellet OD	fuel length	water rod thickness	channel thickness
9x9D01	0.9394	0.9350	0.0009	0.4240	0.3640	0.0300	0.3565	150	0.0300	0.100
Dimensions Listed in Certificate of Compliance				0.4240 (min.)	0.3640 (max.)		0.3565 (max.)	150 (max.)	0.0300 (min.)	0.100 (max.)

Table 6.2.33
 MAXIMUM K_{EFF} VALUES FOR THE 9X9E ASSEMBLY CLASS IN THE MPC-68 and MPC-68FF

(all dimensions are in inches)

9x9E (4.0% Enrichment, Boral ^{10}B minimum loading of 0.0279 g/cm ²)										
76 fuel rods, 5 water rods, pitch=0.572, Zr clad										
Fuel Assembly Designation	maximum k_{eff}	calculated k_{eff}	standard deviation	cladding OD	cladding ID	cladding thickness	pellet OD	fuel length	water rod thickness	channel thickness
9x9E01	0.9334	0.9293	0.0007	0.4170	0.3640	0.0265	0.3530	150	0.0120	0.120
9x9E02	0.9401	0.9359	0.0008	0.4170 0.4430	0.3640 0.3860	0.0265 0.0285	0.3530 0.3745	150	0.0120	0.120
Dimensions Listed in Certificate of Compliance [†]				0.4170 (min.)	0.3640 (max.)		0.3530 (max.)	150 (max.)	0.0120 (min.)	0.120 (max.)
bounding dimensions (9x9E02)	0.9401	0.9359	0.0008	0.4170 0.4430	0.3640 0.3860	0.0265 0.0285	0.3530 0.3745	150	0.0120	0.120

[†] This fuel assembly, also known as SPC 9x9-5, contains fuel rods with different cladding and pellet diameters which do not bound each other. To be consistent in the way fuel assemblies are listed in the Certificate of Compliance, two assembly classes (9x9E and 9x9F) are required to specify this assembly. Each class contains the actual geometry (9x9E02 and 9x9F02), as well as a hypothetical geometry with either all small rods (9x9E01) or all large rods (9x9F01). The Certificate of Compliance lists the small rod dimensions for class 9x9E and the large rod dimensions for class 9x9F, and a note that both classes are used to qualify the assembly. The analyses demonstrate that all configurations, including the actual geometry, are acceptable.

Table 6.2.34
 MAXIMUM K_{EFF} VALUES FOR THE 9X9F ASSEMBLY CLASS IN THE MPC-68 and MPC-68FF

(all dimensions are in inches)

9x9F (4.0% Enrichment, Boral ^{10}B minimum loading of 0.0279 g/cm ²)										
76 fuel rods, 5 water rods, pitch=0.572, Zr clad										
Fuel Assembly Designation	maximum k_{eff}	calculated k_{eff}	standard deviation	cladding OD	cladding ID	cladding thickness	pellet OD	fuel length	water rod thickness	channel thickness
9x9F01	0.9307	0.9265	0.0007	0.4430	0.3860	0.0285	0.3745	150	0.0120	0.120
9x9F02	0.9401	0.9359	0.0008	0.4170 0.4430	0.3640 0.3860	0.0265 0.0285	0.3530 0.3745	150	0.0120	0.120
Dimensions Listed in Certificate of Compliance [†]				0.4430 (min.)	0.3860 (max.)		0.3745 (max.)	150 (max.)	0.0120 (min.)	0.120 (max.)
bounding dimensions (9x9F02)	0.9401	0.9359	0.0008	0.4170 0.4430	0.3640 0.3860	0.0265 0.0285	0.3530 0.3745	150	0.0120	0.120

[†] This fuel assembly, also known as SPC 9x9-5, contains fuel rods with different cladding and pellet diameters which do not bound each other. To be consistent in the way fuel assemblies are listed in the Certificate of Compliance, two assembly classes (9x9E and 9x9F) are required to specify this assembly. Each class contains the actual geometry (9x9E02 and 9x9F02), as well as a hypothetical geometry with either all small rods (9x9E01) or all large rods (9x9F01). The Certificate of Compliance lists the small rod dimensions for class 9x9E and the large rod dimensions for class 9x9F, and a note that both classes are used to qualify the assembly. The analyses demonstrate that all configurations, including the actual geometry, are acceptable.

Table 6.2 35
 MAXIMUM K_{EFF} VALUES FOR THE 9X9G ASSEMBLY CLASS IN THE MPC-68 and MPC-68FF
 (all dimensions are in inches)

9x9G (4.2% Enrichment, Boral ^{10}B minimum loading of 0.0279 g/cm ²)										
72 fuel rods, 1 water rod (square, replacing 9 fuel rods), pitch=0.572, Zr clad										
Fuel Assembly Designation	maximum k_{eff}	calculated k_{eff}	standard deviation	cladding OD	cladding ID	cladding thickness	pellet OD	fuel length	water rod thickness	channel thickness
9x9G01	0.9309	0.9265	0 0008	0.4240	0.3640	0.0300	0.3565	150	0.0320	0.120
Dimensions Listed in Certificate of Compliance				0.4240 (min.)	0.3640 (max.)		0.3565 (max.)	150 (max.)	0.0320 (min.)	0.120 (max.)

Table 6.2.36
 MAXIMUM K_{EFF} VALUES FOR THE 10X10A ASSEMBLY CLASS IN THE MPC-68 and MPC-68FF

(all dimensions are in inches)

10x10A (4 2% Enrichment, Boral ^{10}B minimum loading of 0.0279 g/cm ²)										
92/78 fuel rods [†] , 2 water rods, pitch=0.510, Zr clad										
Fuel Assembly Designation	maximum k_{eff}	calculated k_{eff}	standard deviation	cladding OD	cladding ID	cladding thickness	pellet OD	fuel length	water rod thickness	channel thickness
10x10A01 (axial segment with all rods)	0.9377	0.9335	0.0008	0.4040	0.3520	0.0260	0.3450	155	0.030	0.100
10x10A02 (axial segment with only the full length rods)	0.9426	0.9386	0.0007	0.4040	0.3520	0.0260	0.3450	155	0.030	0.100
10x10A03 (actual three-dimensional representation of all rods)	0.9396	0.9356	0.0007	0.4040	0.3520	0.0260	0.3450	155/90	0.030	0.100
Dimensions Listed in Certificate of Compliance				0.4040 (min.)	0.3520 (max.)		0.3455 (max.)	150 ^{††} (max.)	0.030 (min.)	0.120 (max.)
bounding dimensions (axial segment with only the full length rods) (B10x10A01)	0.9457 ^{†††}	0.9414	0.0008	0.4040	0.3520	0.0260	0.3455 [‡]	155	0.030	0.120

[†] This assembly class contains 78 full-length rods and 14 partial-length rods. In order to eliminate the requirement on the length of the partial length rods, separate calculations were performed for axial segments with and without the partial length rods

^{††} Although the analysis qualifies this assembly for a maximum active fuel length of 155 inches, the Certificate of Compliance limits the active fuel length to 150 inches. This is due to the fact that the Boral panels are 156 inches in length.

^{†††} KENO5a verification calculation resulted in a maximum k_{eff} of 0.9453.

[‡] This value was conservatively defined to be larger than any of the actual pellet diameters.

Table 6.2.37
 MAXIMUM K_{EFF} VALUES FOR THE 10X10B ASSEMBLY CLASS IN THE MPC-68 and MPC-68FF
 (all dimensions are in inches)

10x10B (4.2% Enrichment, Boral ^{10}B minimum loading of 0.0279 g/cm ²) 91/83 fuel rods [†] , 1 water rods (square, replacing 9 fuel rods), pitch=0.510, Zr clad										
Fuel Assembly Designation	maximum k_{eff}	calculated k_{eff}	standard deviation	cladding OD	cladding ID	cladding thickness	pellet OD	fuel length	water rod thickness	channel thickness
10x10B01 (axial segment with all rods)	0.9384	0.9341	0.0008	0.3957	0.3480	0.0239	0.3413	155	0.0285	0.100
10x10B02 (axial segment with only the full length rods)	0.9416	0.9373	0.0008	0.3957	0.3480	0.0239	0.3413	155	0.0285	0.100
10x10B03 (actual three-dimensional representation of all rods)	0.9375	0.9334	0.0007	0.3957	0.3480	0.0239	0.3413	155/90	0.0285	0.100
Dimensions Listed in Certificate of Compliance				0.3957 (min.)	0.3480 (max.)		0.3420 (max.)	150 ^{††} (max.)	0.000 (min.)	0.120 (max.)
bounding dimensions (axial segment with only the full length rods) (B10x10B01)	0.9436	0.9395	0.0007	0.3957	0.3480	0.0239	0.3420 ^{†††}	155	0.000	0.120

[†] This assembly class contains 83 full length rods and 8 partial length rods. In order to eliminate a requirement on the length of the partial length rods, separate calculations were performed for the axial segments with and without the partial length rods

^{††} Although the analysis qualifies this assembly for a maximum active fuel length of 155 inches, the Certificate of Compliance limits the active fuel length to 150 inches. This is due to the fact that the Boral panels are 156 inches in length.

^{†††} This value was conservatively defined to be larger than any of the actual pellet diameters.

Table 6 2.38
 MAXIMUM K_{EFF} VALUES FOR THE 10X10C ASSEMBLY CLASS IN THE MPC-68 and MPC-68FF

(all dimensions are in inches)

10x10C (4.2% Enrichment, Boral ^{10}B minimum loading of 0.0279 g/cm ²)										
96 fuel rods, 5 water rods (1 center diamond and 4 rectangular), pitch=0.488, Zr clad										
Fuel Assembly Designation	maximum k_{eff}	calculated k_{eff}	standard deviation	cladding OD	cladding ID	cladding thickness	pellet OD	fuel length	water rod thickness	channel thickness
10x10C01	0.9433	0.9392	0.0007	0.3780	0.3294	0.0243	0.3224	150	0.031	0.055
Dimensions Listed in Certificate of Compliance				0.3780 (min)	0.3294 (max.)		0.3224 (max)	150 (max.)	0.031 (min.)	0.055 (max.)

Table 6.2.39
 MAXIMUM K_{EFF} VALUES FOR THE 10X10D ASSEMBLY CLASS IN THE MPC-68 and MPC-68FF

(all dimensions are in inches)

10x10D (4.0% Enrichment, Boral ^{10}B minimum loading of 0.0279 g/cm ²)										
100 fuel rods, 0 water rods, pitch=0.565, SS clad										
Fuel Assembly Designation	maximum k_{eff}	calculated k_{eff}	standard deviation	cladding OD	cladding ID	cladding thickness	pellet OD	fuel length	water rod thickness	channel thickness
10x10D01	0.9376	0.9333	0.0008	0.3960	0.3560	0.0200	0.350	83	n/a	0.080
Dimensions Listed in Certificate of Compliance				0.3960 (min.)	0.3560 (max.)		0.350 (max.)	83 (max.)	n/a	0.080 (max.)

Table 6.2 40
 MAXIMUM K_{EFF} VALUES FOR THE 10X10E ASSEMBLY CLASS IN THE MPC-68 and MPC-68FF

(all dimensions are in inches)

10x10E (4.0% Enrichment, Boral ^{10}B minimum loading of 0.0279 g/cm ²)										
96 fuel rods, 4 water rods, pitch=0.557, SS clad										
Fuel Assembly Designation	maximum k_{eff}	calculated k_{eff}	standard deviation	cladding OD	cladding ID	cladding thickness	pellet OD	fuel length	water rod thickness	channel thickness
10x10E01	0.9185	0.9144	0.0007	0.3940	0.3500	0.0220	0.3430	83	0.022	0.080
Dimensions Listed in Certificate of Compliance				0.3940 (min.)	0.3500 (max)		0.3430 (max.)	83 (max.)	0.022 (min.)	0.080 (max.)

Table 6.2.41
 MAXIMUM K_{EFF} VALUES FOR THE 6X6A ASSEMBLY CLASS IN THE MPC-68F and MPC-68FF
 (all dimensions are in inches)

6x6A (3.0% Enrichment [†] , Boral ¹⁰ B minimum loading of 0.0067 g/cm ²)												
35 or 36 fuel rods ^{††} , 1 or 0 water rods ^{††} , pitch ^{††} =0.694 to 0.710, Zr clad												
Fuel Assembly Designation	maximum k_{eff}	calculated k_{eff}	standard deviation	pitch	fuel rods	cladding OD	cladding ID	cladding thickness	pellet OD	fuel length	water rod thickness	channel thickness
6x6A01	0.7539	0.7498	0.0007	0.694	36	0.5645	0.4945	0.0350	0.4940	110	n/a	0.060
6x6A02	0.7517	0.7476	0.0007	0.694	36	0.5645	0.4925	0.0360	0.4820	110	n/a	0.060
6x6A03	0.7545	0.7501	0.0008	0.694	36	0.5645	0.4945	0.0350	0.4820	110	n/a	0.060
6x6A04	0.7537	0.7494	0.0008	0.694	36	0.5550	0.4850	0.0350	0.4820	110	n/a	0.060
6x6A05	0.7555	0.7512	0.0008	0.696	36	0.5625	0.4925	0.0350	0.4820	110	n/a	0.060
6x6A06	0.7618	0.7576	0.0008	0.696	35	0.5625	0.4925	0.0350	0.4820	110	0.0	0.060
6x6A07	0.7588	0.7550	0.0005	0.700	36	0.5555	0.4850	0.03525	0.4780	110	n/a	0.060
6x6A08	0.7808	0.7766	0.0007	0.710	36	0.5625	0.5105	0.0260	0.4980	110	n/a	0.060
Dimensions Listed in Certificate of Compliance				0.710 (max.)	35 or 36	0.5550 (min.)	0.5105 (max.)	0.02225	0.4980 (max.)	120 (max.)	0.0	0.060 (max.)
bounding dimensions (B6x6A01)	0.7727	0.7685	0.0007	0.694	35	0.5550	0.5105	0.02225	0.4980	120	0.0	0.060
bounding dimensions (B6x6A02)	0.7782	0.7738	0.0008	0.700	35	0.5550	0.5105	0.02225	0.4980	120	0.0	0.060
bounding dimensions (B6x6A03)	0.7888	0.7846	0.0007	0.710	35	0.5550	0.5105	0.02225	0.4980	120	0.0	0.060

[†] Although the calculations were performed for 3.0%, the enrichment is limited in the Certificate of Compliance to 2.7%.

^{††} This assembly class was analyzed and qualified for a small variation in the pitch and a variation in the number of fuel and water rods.

Table 6.2 42
 MAXIMUM K_{EFF} VALUES FOR THE 6X6B ASSEMBLY CLASS IN THE MPC-68F and MPC-68FF
 (all dimensions are in inches)

6x6B (3.0% Enrichment [†] , Boral ¹⁰ B minimum loading of 0.0067 g/cm ²) 35 or 36 fuel rods ^{††} (up to 9 MOX rods), 1 or 0 water rods ^{††} , pitch ^{††} =0.694 to 0.710, Zr clad												
Fuel Assembly Designation	maximum k_{eff}	calculated k_{eff}	standard deviation	pitch	fuel rods	cladding OD	cladding ID	cladding thickness	pellet OD	fuel length	water rod thickness	channel thickness
6x6B01	0.7604	0.7563	0.0007	0.694	36	0.5645	0.4945	0.0350	0.4820	110	n/a	0.060
6x6B02	0.7618	0.7577	0.0007	0.694	36	0.5625	0.4925	0.0350	0.4820	110	n/a	0.060
6x6B03	0.7619	0.7578	0.0007	0.696	36	0.5625	0.4925	0.0350	0.4820	110	n/a	0.060
6x6B04	0.7686	0.7644	0.0008	0.696	35	0.5625	0.4925	0.0350	0.4820	110	0.0	0.060
6x6B05	0.7824	0.7785	0.0006	0.710	35	0.5625	0.4925	0.0350	0.4820	110	0.0	0.060
Dimensions Listed in Certificate of Compliance				0.710 (max.)	35 or 36	0.5625 (min.)	0.4945 (max.)		0.4820 (max.)	120 (max.)	0.0	0.060 (max.)
bounding dimensions (B6x6B01)	0.7822 ^{†††}	0.7783	0.0006	0.710	35	0.5625	0.4945	0.0340	0.4820	120	0.0	0.060

Note:

1. These assemblies contain up to 9 MOX pins. The composition of the MOX fuel pins is given in Table 6.3.4.

[†] The ²³⁵U enrichment of the MOX and UO₂ pins is assumed to be 0.711% and 3.0%, respectively.

^{††} This assembly class was analyzed and qualified for a small variation in the pitch and a variation in the number of fuel and water rods.

^{†††} The k_{eff} value listed for the 6x6B05 case is slightly higher than that for the case with the bounding dimensions. However, the difference (0.0002) is well within the statistical uncertainties, and thus, the two values are statistically equivalent (within 1 σ). Therefore, the 0.7824 value is listed in Tables 6.1.7 and 6.1.8 as the maximum.

Table 6 2 43
 MAXIMUM K_{EFF} VALUES FOR THE 6X6C ASSEMBLY CLASS IN THE MPC-68F and MPC-68FF

(all dimensions are in inches)

6x6C (3.0% Enrichment [†] , Boral ¹⁰ B minimum loading of 0.0067 g/cm ²)										
36 fuel rods, 0 water rods, pitch=0.740, Zr clad										
Fuel Assembly Designation	maximum k_{eff}	calculated k_{eff}	standard deviation	cladding OD	cladding ID	cladding thickness	pellet OD	fuel length	water rod thickness	channel thickness
6x6C01	0.8021	0.7980	0.0007	0.5630	0.4990	0.0320	0.4880	77.5	n/a	0.060
Dimensions Listed in Certificate of Compliance				0.5630 (min.)	0.4990 (max.)		0.4880 (max.)	77.5 (max.)	n/a	0.060 (max.)

[†] Although the calculations were performed for 3.0%, the enrichment is limited in the Certificate of Compliance to 2.7%.

Table 6.2.44
 MAXIMUM K_{EFF} VALUES FOR THE 7X7A ASSEMBLY CLASS IN THE MPC-68F and MPC-68FF

(all dimensions are in inches)

7x7A (3.0% Enrichment [†] , Boral ¹⁰ B minimum loading of 0.0067 g/cm ²)										
49 fuel rods, 0 water rods, pitch=0.631, Zr clad										
Fuel Assembly Designation	maximum k_{eff}	calculated k_{eff}	standard deviation	cladding OD	cladding ID	cladding thickness	pellet OD	fuel length	water rod thickness	channel thickness
7x7A01	0.7974	0.7932	0.0008	0.4860	0.4204	0.0328	0.4110	80	n/a	0.060
Dimensions Listed in Certificate of Compliance				0.4860 (min.)	0.4204 (max.)		0.4110 (max.)	80 (max.)	n/a	0.060 (max.)

[†] Although the calculations were performed for 3.0%, the enrichment is limited in the Certificate of Compliance to 2.7%.

Table 6.2 45
 MAXIMUM K_{EFF} VALUES FOR THE 8X8A ASSEMBLY CLASS IN THE MPC-68F and MPC-68FF

(all dimensions are in inches)

8x8A (3.0% Enrichment [†] , Boral ¹⁰ B minimum loading of 0.0067 g/cm ²)											
63 or 64 fuel rods ^{††} , 0 water rods, pitch=0.523, Zr clad											
Fuel Assembly Designation	maximum k_{eff}	calculated k_{eff}	standard deviation	fuel rods	cladding OD	cladding ID	cladding thickness	pellet OD	fuel length	water rod thickness	channel thickness
8x8A01	0.7685	0.7644	0.0007	64	0.4120	0.3620	0.0250	0.3580	110	n/a	0.100
8x8A02	0.7697	0.7656	0.0007	63	0.4120	0.3620	0.0250	0.3580	120	n/a	0.100
Dimensions Listed in Certificate of Compliance				63	0.4120 (min.)	0.3620 (max.)		0.3580 (max.)	120 (max.)	n/a	0.100 (max.)
bounding dimensions (8x8A02)	0.7697	0.7656	0.0007	63	0.4120	0.3620	0.0250	0.3580	120	n/a	0.100

[†] Although the calculations were performed for 3.0%, the enrichment is limited in the Certificate of Compliance to 2.7%.

^{††} This assembly class was analyzed and qualified for a variation in the number of fuel rods.

Table 6.2.46

SPECIFICATION OF THE THORIA ROD CANISTER AND THE THORIA RODS

Canister ID	4.81"
Canister Wall Thickness	0.11"
Separator Assembly Plates Thickness	0.11"
Cladding OD	0.412"
Cladding ID	0.362"
Pellet OD	0.358"
Active Length	110.5"
Fuel Composition	1.8% UO ₂ and 98.2% ThO ₂
Initial Enrichment	93.5 wt% ²³⁵ U for 1.8% of the fuel
Maximum k _{eff}	0.1813
Calculated k _{eff}	0.1779
Standard Deviation	0.0004

6.3 MODEL SPECIFICATION

6.3.1 Description of Calculational Model

Figures 6.3.1, 6.3.1.a, 6.3.2 and 6.3.3 show representative horizontal cross sections of the four types of cells used in the calculations, and Figures 6.3.4 through 6.3.6 illustrate the basket configurations used. Four different MPC fuel basket designs were evaluated as follows:

- a 24 PWR assembly basket
- an optimized 24 PWR assembly basket (24E / 24EF)
- a 32 PWR assembly basket
- a 68 BWR assembly basket.

For all four basket designs, the same techniques and the same level of detail are used in the calculational models.

Full three-dimensional calculations were used, assuming the axial configuration shown in Figure 6.3.7. Although the Boral neutron absorber panels are 156 inches in length, which is much longer than the active fuel length (maximum of 150 inches), they are assumed equal to the active fuel length in the calculations. As shown on the Drawings in Section 1.5, 16 of the 24 periphery Boral panels on the MPC-24 and MPC-24E/EF have reduced width (i.e., 6.25 inches wide as opposed to 7.5 inches). However, the calculational models for these baskets conservatively assume all of the periphery Boral panels are 6.25 inches in width.

The off-normal and accident conditions defined in Chapter 2 and considered in Chapter 11 have no adverse effect on the design conditions important to criticality safety (see Subsection 6.4.2.5), and thus from a criticality standpoint, the normal, off-normal, and accident conditions are identical and do not require individual models.

The calculational model explicitly defines the fuel rods and cladding, the guide tubes (or water rods for BWR assemblies), the water-gaps and Boral absorber panels on the stainless steel walls of the storage cells. Under the conditions of storage, when the MPC is dry, the resultant reactivity with the design basis fuel is very low ($k_{\text{eff}} < 0.52$). For the flooded condition (loading and unloading), pure, unborated water was assumed to be present in the fuel rod pellet-to-clad gaps. Appendix 6.D provides sample input files for two of the MPC basket designs (MPC-68 and MPC-24) in the HI-STORM 100 System.

The water thickness above and below the fuel is intentionally maintained less than or equal to the actual water thickness. This assures that any positive reactivity effect of the steel in the MPC is conservatively included. Furthermore, the water above and below the fuel is modeled as unborated water, even when borated water is present in the fuel region.

As indicated in Figures 6.3.1 through 6.3.3 and in Tables 6.3.1 and 6.3.2, calculations were made with dimensions assumed to be at their most conservative value with respect to criticality. CASMO-3 and MCNP4a were used to determine the direction of the manufacturing tolerances, which produced the most adverse effect on criticality. After the directional effect (positive effect with an increase in reactivity; or negative effect with a decrease in reactivity) of the manufacturing tolerances was determined, the criticality analyses were performed using the worst case tolerances in the direction which would increase reactivity.

CASMO-3 was used for one of each of the two principal basket designs, i.e. for the flux trap design MPC-24 and for the non-fluxtrap design MPC-68. The effects are shown in Table 6.3.1 which also identifies the approximate magnitude of the tolerances on reactivity. Generally, the conclusions in Table 6.3.1 are directly applicable to the MPC-24E/EF and the MPC-32. Exceptions are the conclusions for the water temperature and void percentage, which are not directly applicable to the MPC-32 due to the presence of high soluble boron concentrations in this canister. This condition is addressed in Section 6.4.2.1 where the optimum moderation is determined for the MPC-32.

Additionally, MCNP4a calculations are performed to evaluate the tolerances of the various basket dimensions of the MPC-68, MPC-24 and MPC-32 in further detail. The various basket dimensions are inter-dependent, and therefore cannot be individually varied (i.e., reduction in one parameter requires a corresponding reduction or increase in another parameter). Thus, it is not possible to determine the reactivity effect of each individual dimensional tolerance separately. However, it is possible to determine the reactivity effect of the dimensional tolerances by evaluating the various possible dimensional combinations. To this end, an evaluation of the various possible dimensional combinations was performed using MCNP4a. Calculated k_{eff} results (which do not include the bias, uncertainties, or calculational statistics), along with the actual dimensions, for a number of dimensional combinations are shown in Table 6.3.2 for the reference PWR and BWR assemblies. Each of the basket dimensions are evaluated for their minimum, nominal and maximum values from the Drawings of section 1.5. For PWR MPC designs, the reactivity effect of tolerances with soluble boron present in the water is additionally determined. Due to the close similarity between the MPC-24 and MPC-24E, the basket dimensions are only evaluated for the MPC-24, and the same dimensional assumptions are applied to both MPC designs.

Based on the MCNP4a and CASMO-3 calculations, the conservative dimensional assumptions listed in Table 6.3.3 were determined. Because the reactivity effect (positive or negative) of the

manufacturing tolerances are not assembly dependent, these dimensional assumptions were employed for the criticality analyses.

As demonstrated in this section, design parameters important to criticality safety are: fuel enrichment, the inherent geometry of the fuel basket structure, the fixed neutron absorbing panels (Boral) and the soluble boron concentration in the water during loading/unloading operations. As shown in Chapter 11, none of these parameters are affected during any of the design basis off-normal or accident conditions involving handling, packaging, transfer or storage.

6.3.2 Cask Regional Densities

Composition of the various components of the principal designs of the HI-STORM 100 System are listed in Table 6.3.4.

The HI-STORM 100 System is designed such that the fixed neutron absorber (Boral) will remain effective for a storage period greater than 20 years, and there are no credible means to lose it. A detailed physical description, historical applications, unique characteristics, service experience, and manufacturing quality assurance of Boral are provided in Section 1.2.1.3.1.

The continued efficacy of the Boral is assured by acceptance testing, documented in Section 9.1.5.3, to validate the ^{10}B (poison) concentration in the Boral. To demonstrate that the neutron flux from the irradiated fuel results in a negligible depletion of the poison material over the storage period, an MCNP4a calculation of the number of neutrons absorbed in the ^{10}B was performed. The calculation conservatively assumed a constant neutron source for 50 years equal to the initial source for the design basis fuel, as determined in Section 5.2, and shows that the fraction of ^{10}B atoms destroyed is only 2.6E-09 in 50 years. Thus, the reduction in ^{10}B concentration in the Boral by neutron absorption is negligible. In addition, analysis in Appendix 3.M.1 of the HI-STAR 100 FSAR demonstrates that the sheathing, which affixes the Boral panel, remains in place during all credible accident conditions, and thus, the Boral panel remains permanently fixed. Therefore, in accordance with 10CFR72.124(b), there is no need to provide a surveillance or monitoring program to verify the continued efficacy of the neutron absorber.

Table 6.3.1

CASMO-3 CALCULATIONS FOR EFFECT OF TOLERANCES AND TEMPERATURE

Change in Nominal Parameter [†]	Δk for Maximum Tolerance		Action/Modeling Assumption
	MPC-24 [‡]	MPC-68	
Reduce Boral Width to Minimum	N/A ^{†††} min.= nom.= 7.5" and 6.25"	N/A ^{†††} min. = nom. = 4.75"	Assume minimum Boral width
Increase UO ₂ Density to Maximum	+0.0017 max. = 10.522 g/cc nom. = 10.412 g/cc	+0.0014 max. = 10.522 g/cc nom. = 10.412 g/cc	Assume maximum UO ₂ density
Reduce Box Inside Dimension (I.D.) to Minimum	-0.0005 min.= 8.86" nom. = 8.92"	See Table 6.3.2	Assume maximum box I.D. for the MPC-24
Increase Box Inside Dimension (I.D.) to Maximum	+0.0007 max. = 8.98" nom. = 8.92"	-0.0030 max. = 6.113" nom. = 6.053"	Assume minimum box I.D. for the MPC-68
Decrease Water Gap to Minimum	+0.0069 min. = 1.09" nom. = 1.15"	N/A	Assume minimum water gap in the MPC-24

[†] Reduction (or increase) in a parameter indicates that the parameter is changed to its minimum (or maximum) value.

[‡] Calculations for the MPC-24 were performed with CASMO-4 [6.3.1-6.3.3].

^{††}

^{†††} The Boral width for the MPC-68 is 4.75" +0.125", -0", the Boral widths for the MPC-24 are 7.5" +0.125", -0" and 6.25" +0.125" -0" (i.e., the nominal and minimum values are the same).

Table 6.3.1 (continued)

CASMO-3 CALCULATIONS FOR EFFECT OF TOLERANCES AND TEMPERATURE

Change in Nominal Parameter	Δk Maximum Tolerance		Action/Modeling Assumption
	MPC-24 [‡]	MPC-68	
Increase in Temperature			Assume 20°C
20°C	Ref.	Ref.	
40°C	-0.0030	-0.0039	
70°C	-0.0089	-0.0136	
100°C	-0.0162	-0.0193	
10% Void in Moderator			Assume no void
20°C with no void	Ref.	Ref.	
20°C	-0.0251	-0.0241	
100°C	-0.0412	-0.0432	
Removal of Flow Channel (BWR)	N/A	-0.0073	Assume flow channel present for MPC-68

[‡] Calculations for the MPC-24 were performed with CASMO-4 [6.3.1-6.3.3].

Table 6.3.2

MCNP4a EVALUATION OF BASKET MANUFACTURING TOLERANCES[†]

Pitch		Box I.D.		Box Wall Thickness		MCNP4a Calculated k _{eff}
MPC-24 ^{††} (17x17A01 @ 4.0% Enrichment)						
nominal	(10.906")	maximum	(8.98")	nominal	(5/16")	0.9325±0.0008 ^{†††}
minimum	(10.846")	nominal	(8.92")	nominal	(5/16")	0.9300±0.0008
nominal	(10.906")	nom. - 0.04"	(8.88")	nom. + 0.05"	(0.3625")	0.9305±0.0007
MPC-68 (8x8C04 @ 4.2% Enrichment)						
minimum	(6.43")	minimum	(5.993")	nominal	(1/4")	0.9307±0.0007
nominal	(6.49")	nominal	(6.053")	nominal	(1/4")	0.9274±0.0007
maximum	(6.55")	maximum	(6.113")	nominal	(1/4")	0.9272±0.0008
nom. + 0.05"	(6.54")	nominal	(6.053")	nom. + 0.05"	(0.30")	0.9267±0.0007

Notes:

1. Values in parentheses are the actual value used.

[†] Tolerance for pitch and box I.D. are ± 0.06"
Tolerance for box wall thickness is +0.05", -0.00".

^{††} All calculations for the MPC-24 assume minimum water gap thickness (1.09").

^{†††} Numbers are 1σ statistical uncertainties.

Table 6.3.2 (cont.)

MCNP4a EVALUATION OF BASKET MANUFACTURING TOLERANCES[†]

Pitch		Box I.D.		Box Wall Thickness		MCNP4a Calculated k _{eff}
MPC-24 (17x17A @ 5.0% Enrichment) 400ppm soluble boron						
nominal	(10.906")	maximum	(8.98")	nominal	(5/16")	0.9236±0.0007 ^{††}
maximum	(10.966")	maximum	(8.98")	nominal	(5/16")	0.9176±0.0008
minimum	(10.846")	nominal	(8.92")	nominal	(5/16")	0.9227±0.0010
minimum	(10.846")	minimum	(8.86")	nominal	(5/16")	0.9159±0.0008
nominal	(10.906")	nominal-0.04"	(8.88")	nom.+0.05"	(0.3625")	0.9232±0.0009
nominal	(10.906")	nominal	(8.92")	nominal	(5/16")	0.9158±0.0007
MPC-32 (17x17A @ 5.0% Enrichment) 2600 ppm soluble boron						
minimum	(9.158")	minimum	(8.69")	nominal	(9/32")	0.9085±0.0007
nominal	(9.218")	nominal	(8.75")	nominal	(9/32")	0.9028±0.0007
maximum	(9.278")	maximum	(8.81")	nominal	(9/32")	0.8996±0.0008
nominal+0.05"	(9.268")	nominal	(8.75")	nominal+0.05"	(0.331")	0.9023±0.0008
minimum+0.05"	(9.208")	minimum	(8.69")	nominal+0.05"	(0.331")	0.9065±0.0007
maximum	(9.278")	Maximum-0.05"	(8.76")	nominal+0.05"	(0.331")	0.9030±0.0008

Notes:

- Values in parentheses are the actual value used.

† Tolerance for pitch and box I.D. are ± 0.06".
Tolerance for box wall thickness is +0.05", -0.00".

†† Numbers are 1σ statistical uncertainties.

Table 6.3.3

BASKET DIMENSIONAL ASSUMPTIONS

Basket Type	Pitch	Box I.D.	Box Wall Thickness	Water-Gap Flux Trap
MPC-24	nominal (10.906")	maximum (8.98")	nominal (5/16")	minimum (1.09")
MPC-24E	nominal (10.847")	maximum (8.81", 9.11" for DFC Positions)	nominal (5/16")	minimum (1.076", 0.776" for DFC Positions)
MPC-32	Minimum (9.158")	Minimum (8.69")	Nominal (9/32")	N/A
MPC-68	minimum (6.43")	Minimum (5.993")	nominal (1/4")	N/A

Table 6.3.4

COMPOSITION OF THE MAJOR COMPONENTS OF THE HI-STORM 100 SYSTEM

MPC-24, MPC-24E and MPC-32		
UO₂ 5.0% ENRICHMENT, DENSITY (g/cc) = 10.522		
Nuclide	Atom-Density	Wgt. Fraction
8016	4.696E-02	1.185E-01
92235	1.188E-03	4.408E-02
92238	2.229E-02	8.374E-01
UO₂ 4.0% ENRICHMENT, DENSITY (g/cc) = 10.522		
Nuclide	Atom-Density	Wgt. Fraction
8016	4.693E-02	1.185E-01
92235	9.505E-04	3.526E-02
92238	2.252E-02	8.462E-01
BORAL (0.02 g ¹⁰B/cm sq), DENSITY (g/cc) = 2.660 (MPC-24)		
Nuclide	Atom-Density	Wgt. Fraction
5010	8.707E-03	5.443E-02
5011	3.512E-02	2.414E-01
6012	1.095E-02	8.210E-02
13027	3.694E-02	6.222E-01
BORAL (0.0279 g ¹⁰B/cm sq), DENSITY (g/cc) = 2.660 (MPC-24E and MPC-32)		
Nuclide	Atom-Density	Wgt. Fraction
5010	8.071E-03	5.089E-02
5011	3.255E-02	2.257E-01
6012	1.015E-02	7.675E-02
13027	3.805E-02	6.467E-01

Table 6.3.4 (continued)

COMPOSITION OF THE MAJOR COMPONENTS OF THE HI-STORM 100 SYSTEM

BORATED WATER, 300 PPM, DENSITY (g/cc)=1.00		
Nuclide	Atom-Density	Wt. Fraction
5010	3.248E-06	5.400E-05
5011	1.346E-05	2.460E-04
1001	6.684E-02	1.1186E-01
8016	3.342E-02	8.8784E-01
BORATED WATER, 400PPM, DENSITY (g/cc)=1.00		
Nuclide	Atom-Density	Wgt. Fraction
5010	4.330E-06	7.200E-05
5011	1.794E-05	3.280E-04
1001	6.683E-02	1.1185E-01
8016	3.341E-02	8.8775E-01
BORATED WATER, 1900PPM, DENSITY (g/cc)=1.00		
Nuclide	Atom-Density	Wgt. Fraction
5010	2.057E-05	3.420E-04
5011	8.522E-05	1.558E-03
1001	6.673E-02	1.1169E-01
8016	3.336E-02	8.8641E-01
BORATED WATER, 2600PPM, DENSITY (g/cc)=0.93		
Nuclide	Atom-Density	Wgt. Fraction
5010	2.618e-05	4.680E-04
5011	1.085e-04	2.132E-03
1001	6.201e-02	1.1161E-01
8016	3.101e-02	8.8579E-01

Table 6.3.4 (continued)

COMPOSITION OF THE MAJOR COMPONENTS OF THE HI-STORM 100 SYSTEM

MPC-68		
UO₂ 4.2% ENRICHMENT, DENSITY (g/cc) = 10.522		
Nuclide	Atom-Density	Wgt. Fraction
8016	4.697E-02	1.185E-01
92235	9.983E-04	3.702E-02
92238	2.248E-02	8.445E-01
UO₂ 3.0% ENRICHMENT, DENSITY (g/cc) = 10.522		
Nuclide	Atom-Density	Wgt. Fraction
8016	4.695E-02	1.185E-01
92235	7.127E-04	2.644E-02
92238	2.276E-02	8.550E-01
MOX FUEL[†], DENSITY (g/cc) = 10.522		
Nuclide	Atom-Density	Wgt. Fraction
8016	4.714E-02	1.190E-01
92235	1.719E-04	6.380E-03
92238	2.285E-02	8.584E-01
94239	3.876E-04	1.461E-02
94240	9.177E-06	3.400E-04
94241	3.247E-05	1.240E-03
94242	2.118E-06	7.000E-05

[†] The Pu-238, which is an absorber, was conservatively neglected in the MOX description for analysis purposes

Table 6.3.4 (continued)

COMPOSITION OF THE MAJOR COMPONENTS OF THE HI-STORM 100 SYSTEM

BORAL (0.0279 g ¹⁰B/cm sq), DENSITY (g/cc) = 2.660		
Nuclide	Atom-Density	Wgt. Fraction
5010	8.071E-03	5.089E-02
5011	3.255E-02	2.257E-01
6012	1.015E-02	7.675E-02
13027	3.805E-02	6.467E-01
FUEL IN THORIA RODS, DENSITY (g/cc) = 10.522		
Nuclide	Atom-Density	Wgt. Fraction
5010	4.798E-02	1.212E-01
5011	4.001E-04	1.484E-02
6012	2.742E-05	1.030E-03
13027	2.357E-02	8.630E-01
COMMON MATERIALS		
ZR CLAD, DENSITY (g/cc) = 6.550		
Nuclide	Atom-Density	Wgt. Fraction
40000	4.323E-02	1.000E+00
MODERATOR (H₂O), DENSITY (g/cc) = 1.000		
Nuclide	Atom-Density	Wgt. Fraction
1001	6.688E-02	1.119E-01
8016	3.344E-02	8.881E-01

Table 6.3.4 (continued)

COMPOSITION OF THE MAJOR COMPONENTS OF THE HI-STORM 100 SYSTEM

STAINLESS STEEL, DENSITY (g/cc) = 7.840		
Nuclide	Atom-Density	Wgt. Fraction
24000	1.761E-02	1.894E-01
25055	1.761E-03	2.001E-02
26000	5.977E-02	6.905E-01
28000	8.239E-03	1.000E-01
ALUMINUM, DENSITY (g/cc) = 2.700		
Nuclide	Atom-Density	Wgt. Fraction
13027	6.026E-02	1.000E+00

Table 6.3.4 (continued)

COMPOSITION OF THE MAJOR COMPONENTS OF THE HI-STORM 100 SYSTEM

CONCRETE, DENSITY (g/cc) = 2.35		
Nuclide	Atom-Density	Wgt. Fraction
1001	8.806E-03	6.000E-03
8016	4.623E-02	5.000E-01
11000	1.094E-03	1.700E-02
13027	2.629E-04	4.800E-03
14000	1.659E-02	3.150E-01
19000	7.184E-04	1.900E-02
20000	3.063E-03	8.300E-02
26000	3.176E-04	1.200E-02
LEAD, DENSITY (g/cc) = 11.34		
Nuclide	Atom-Density	Wgt. Fraction
82000	3.296E-02	1.0
HOLTITE-A, DENSITY (g/cc) = 1.61		
1001	5.695E-02	5.920E-02
5010	1.365E-04	1.410E-03
5011	5.654E-04	6.420E-03
6012	2.233E-02	2.766E-01
7014	1.370E-03	1.980E-02
8016	2.568E-02	4.237E-01
13027	7.648E-03	2.129E-01

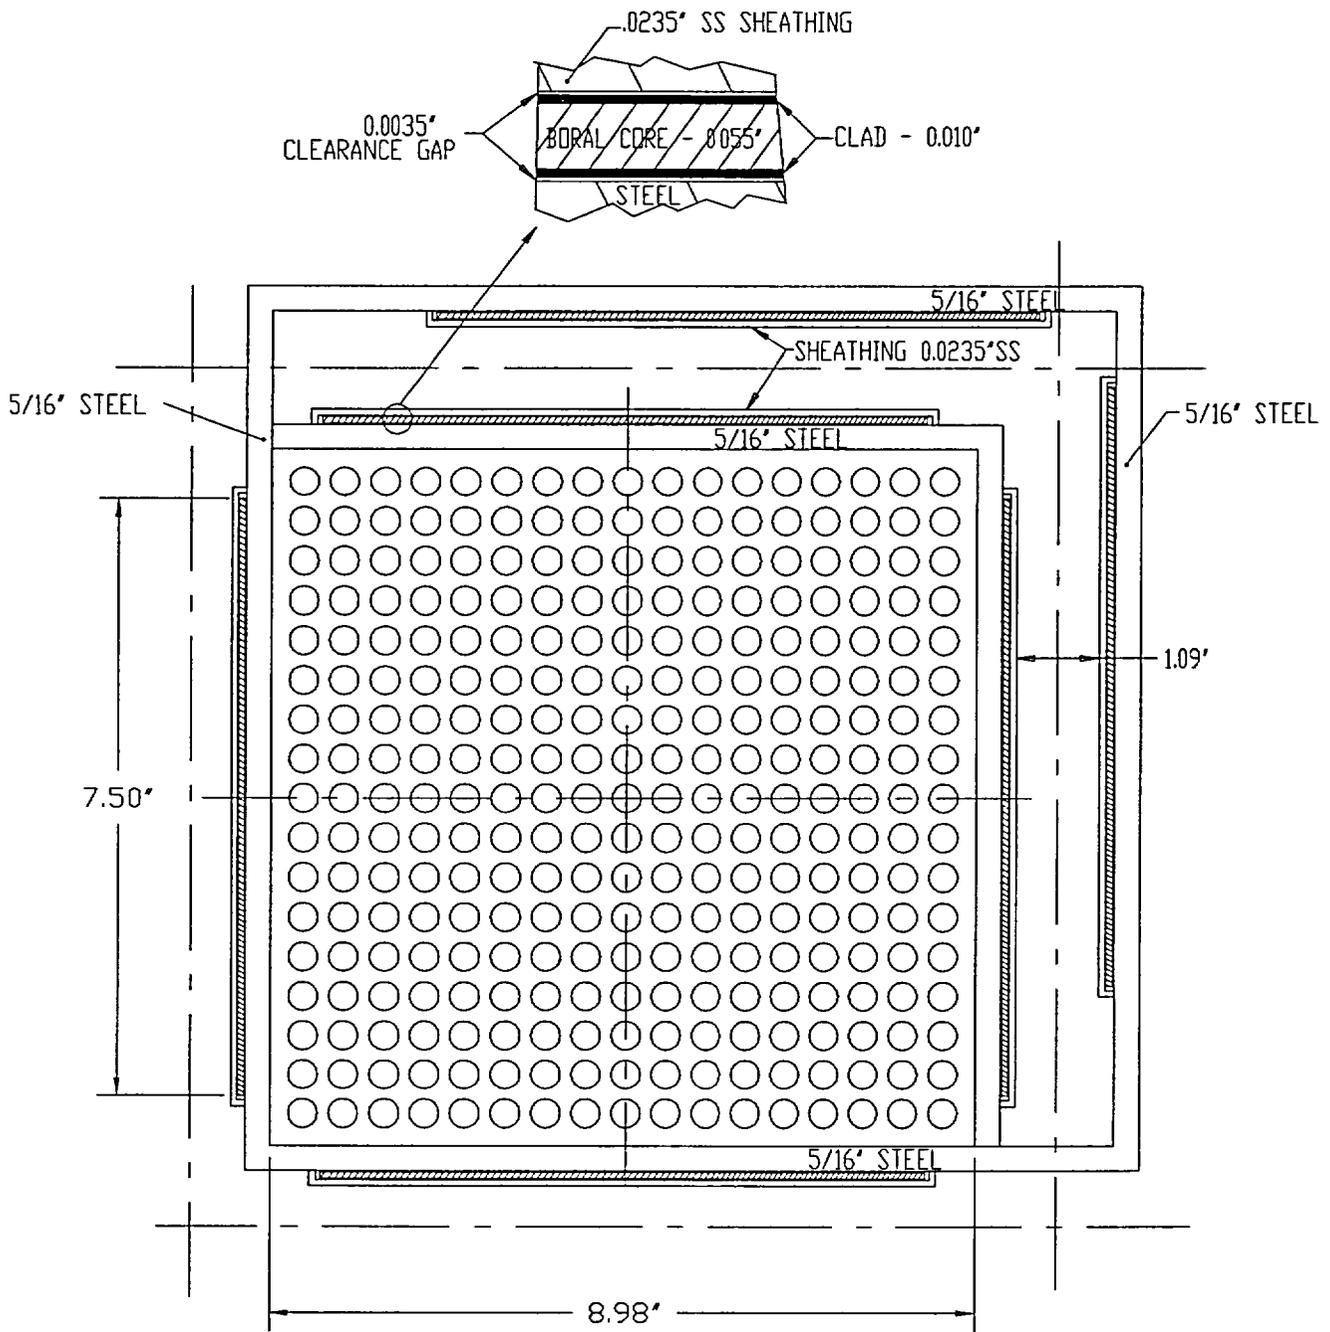


FIGURE 6.3.1; TYPICAL CELL IN THE CALCULATION MODEL (PLANAR CROSS-SECTION) WITH REPRESENTATIVE FUEL IN THE MPC-24 BASKET (SEE CHAPTER 1 FOR TRUE BASKET DIMENSIONS)

NOTE: THESE DIMENSIONS WERE CONSERVATIVELY USED FOR CRITICALITY ANALYSES.

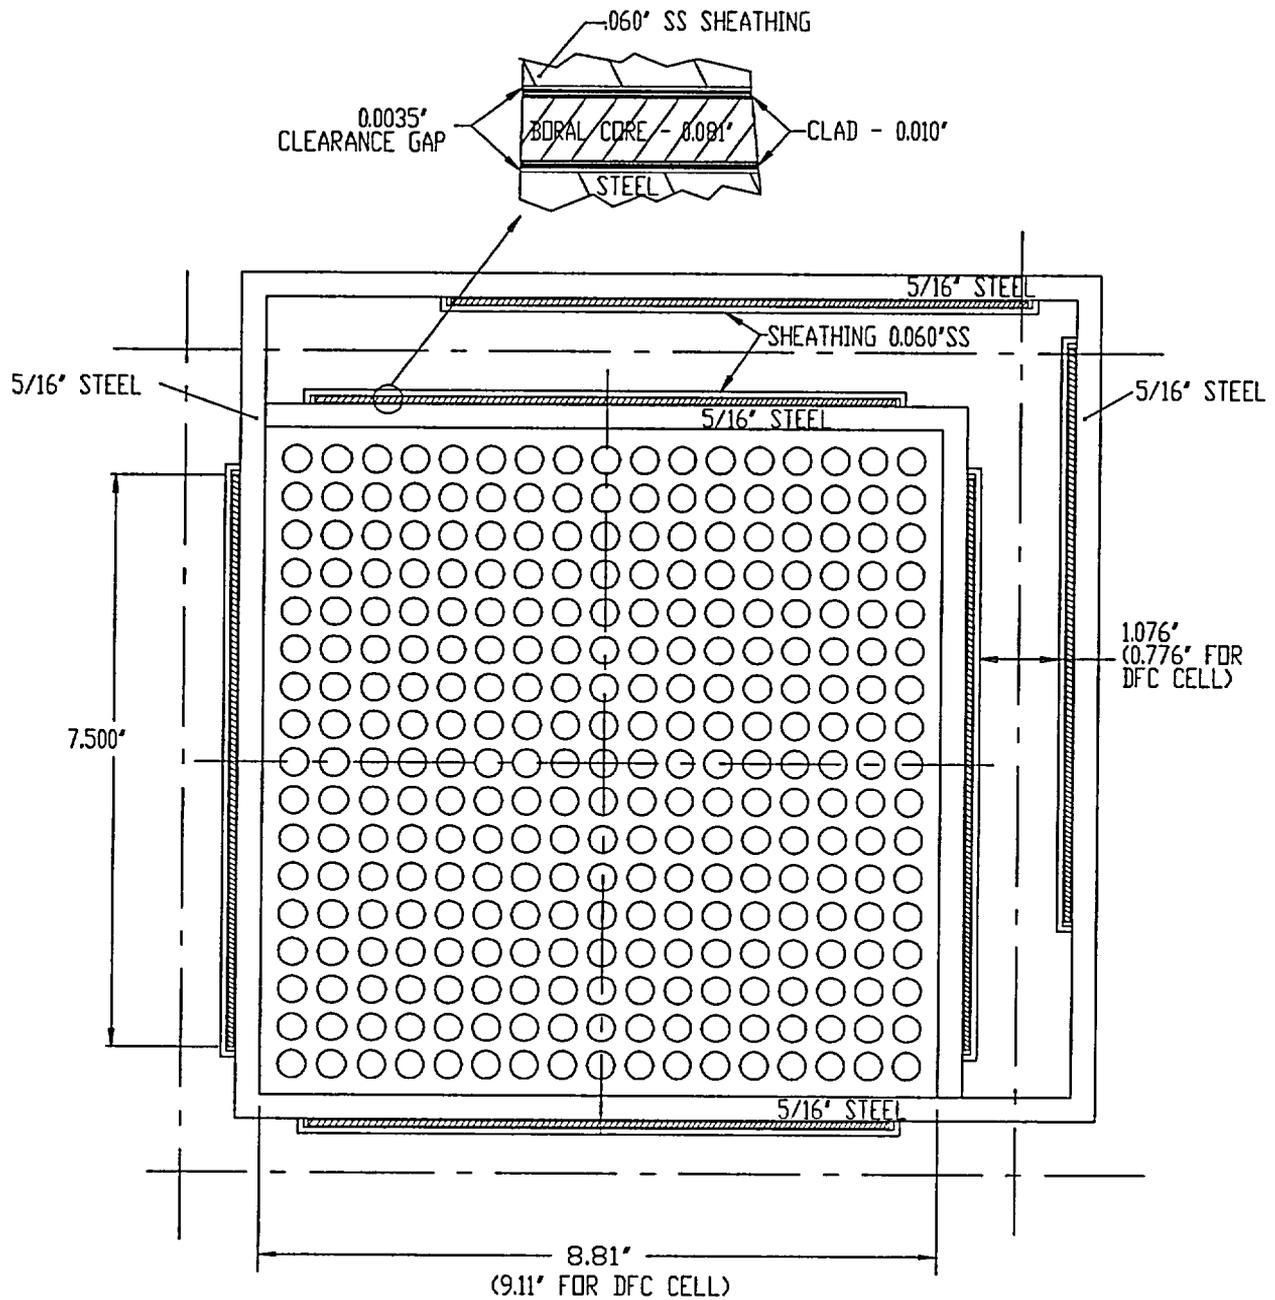


FIGURE 6.3.1A; TYPICAL CELL IN THE CALCULATION MODEL (PLANAR CROSS-SECTION)
 WITH REPRESENTATIVE FUEL IN THE MPC-24E BASKET
 (SEE CHAPTER 1 FOR TRUE BASKET DIMENSIONS)

NOTE: THESE DIMENSIONS WERE CONSERVATIVELY USED FOR CRITICALITY ANALYSES.

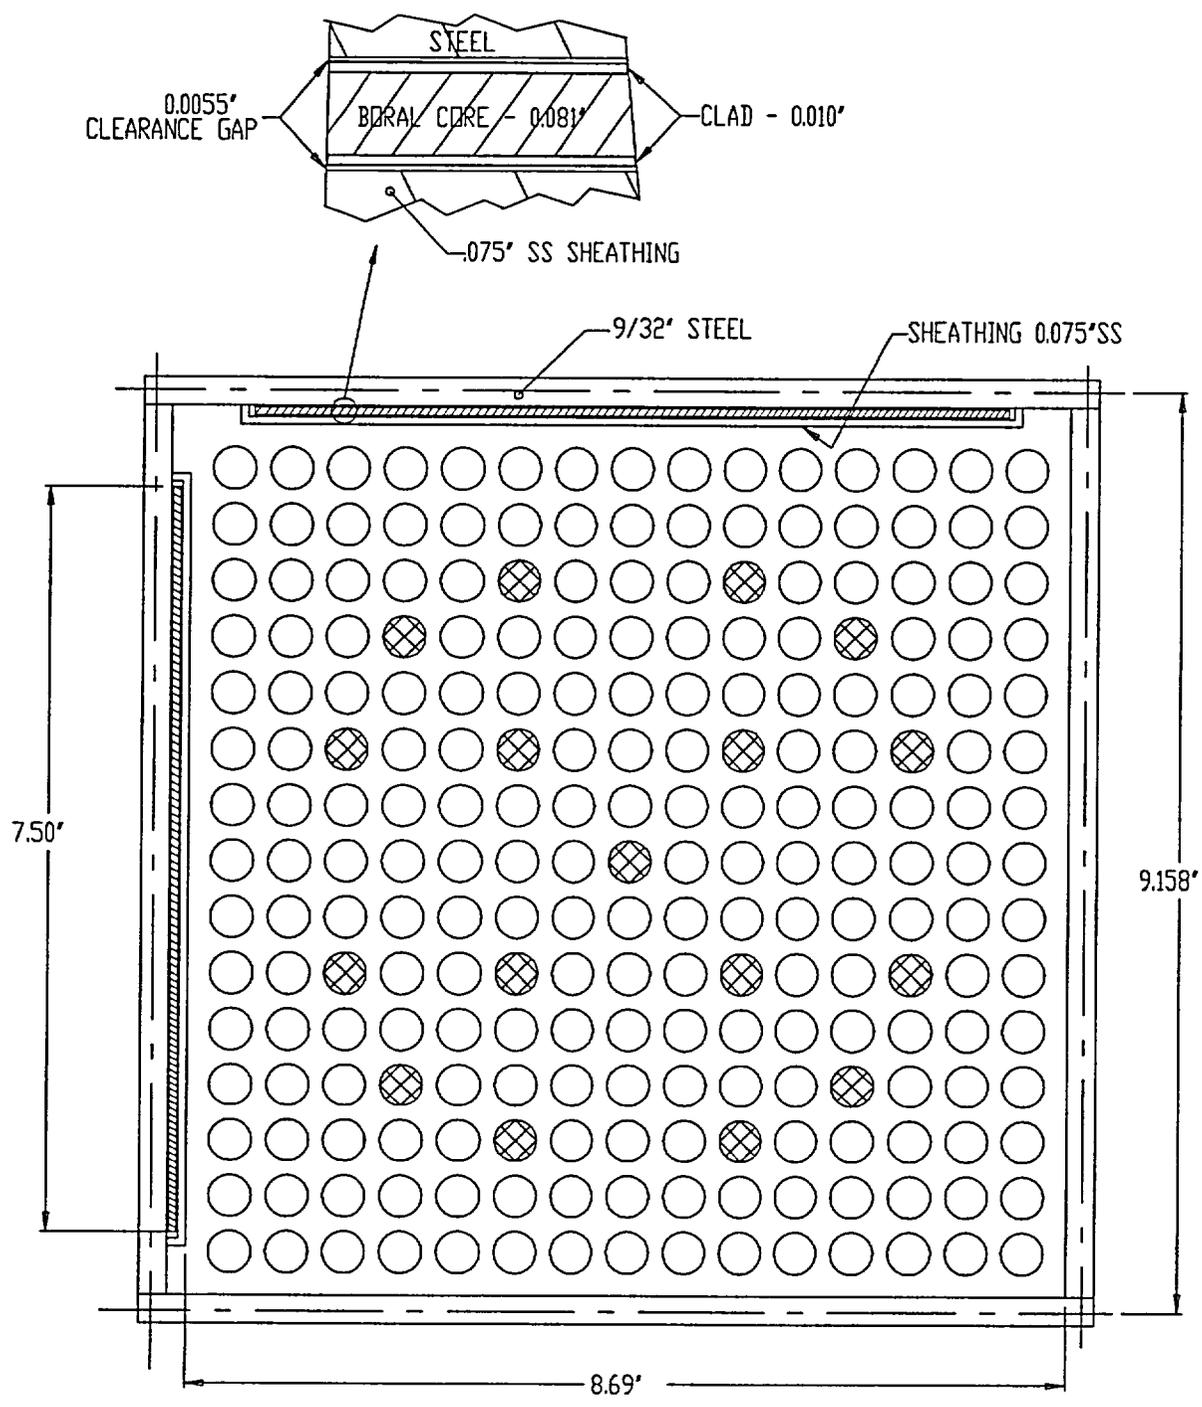


FIGURE 6.3.2; TYPICAL CELL IN THE CALCULATION MODEL (PLANAR CROSS-SECTION) WITH REPRESENTATIVE FUEL IN THE MPC-32 BASKET (SEE CHAPTER 1 FOR TRUE BASKET DIMENSIONS)

NOTE: THESE DIMENSIONS WERE CONSERVATIVELY USED FOR CRITICALITY ANALYSES.

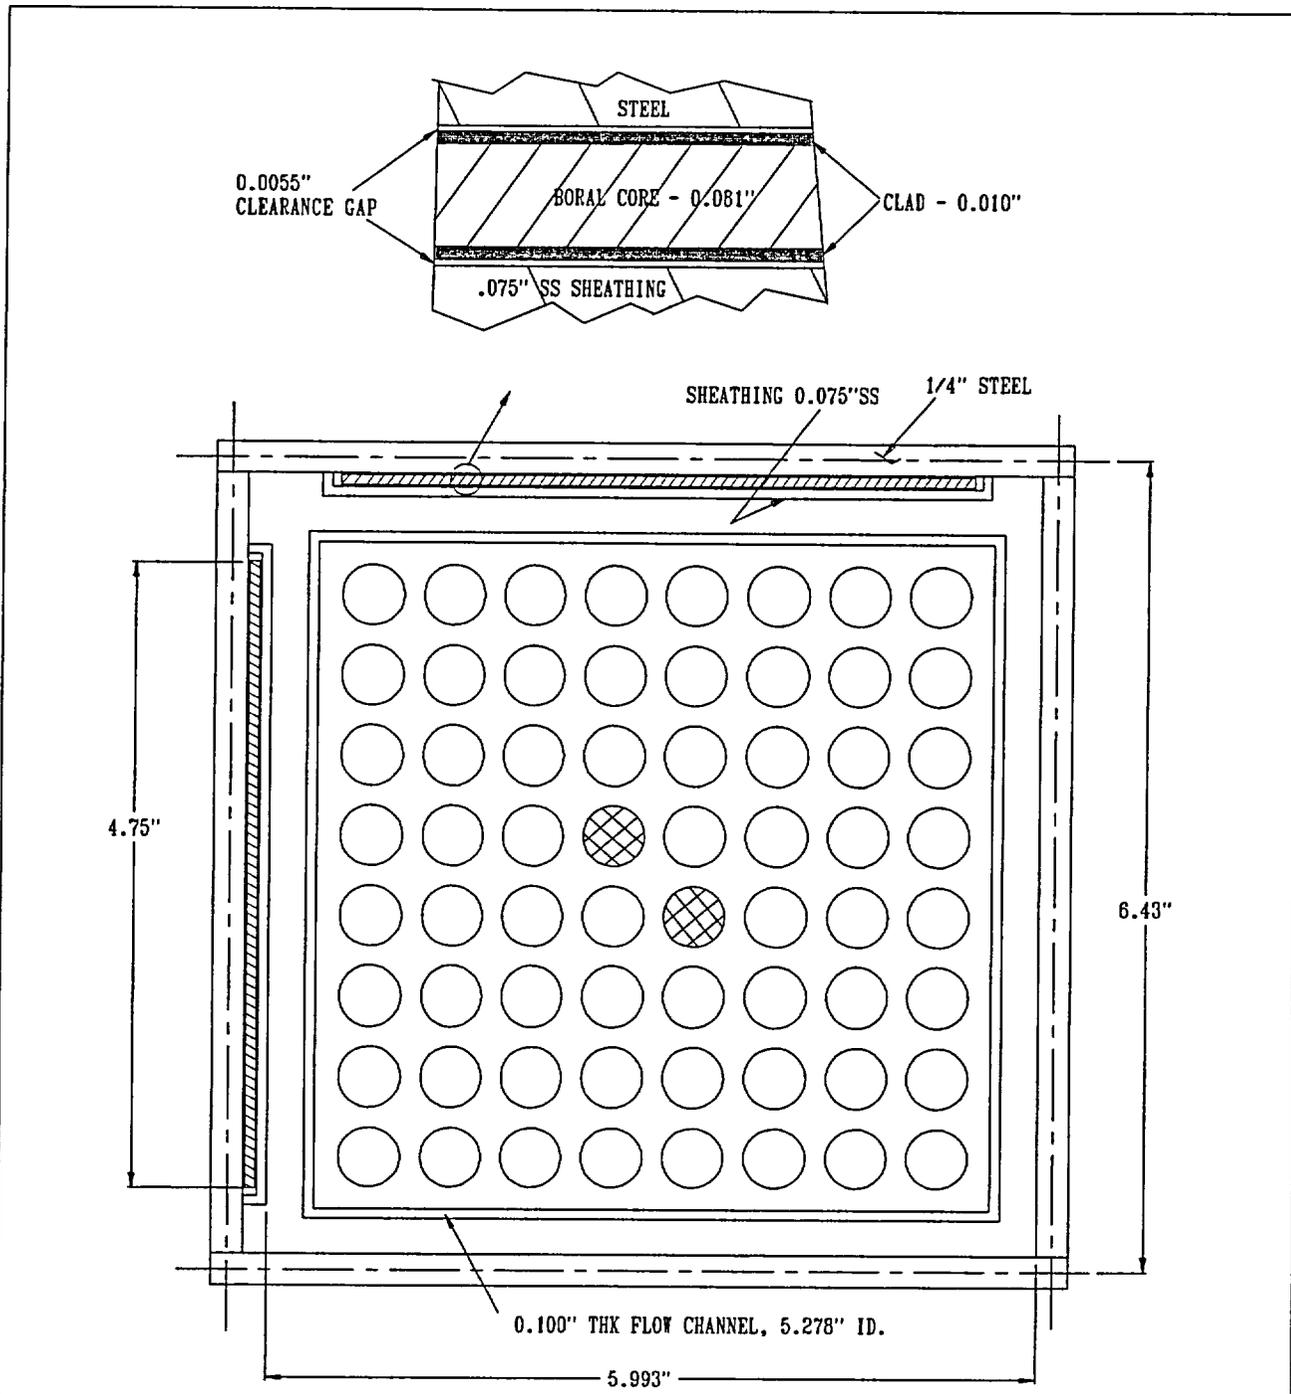


FIGURE 6.3.3; TYPICAL CELL IN THE CALCULATION MODEL (PLANAR CROSS-SECTION) WITH REPRESENTATIVE FUEL IN THE MPC-68 BASKET (SEE CHAPTER 1 FOR TRUE BASKET DIMENSIONS)

NOTE: THESE DIMENSIONS WERE CONSERVATIVELY USED FOR CRITICALITY ANALYSES.

REPORT HI-2002444

REVISION 0

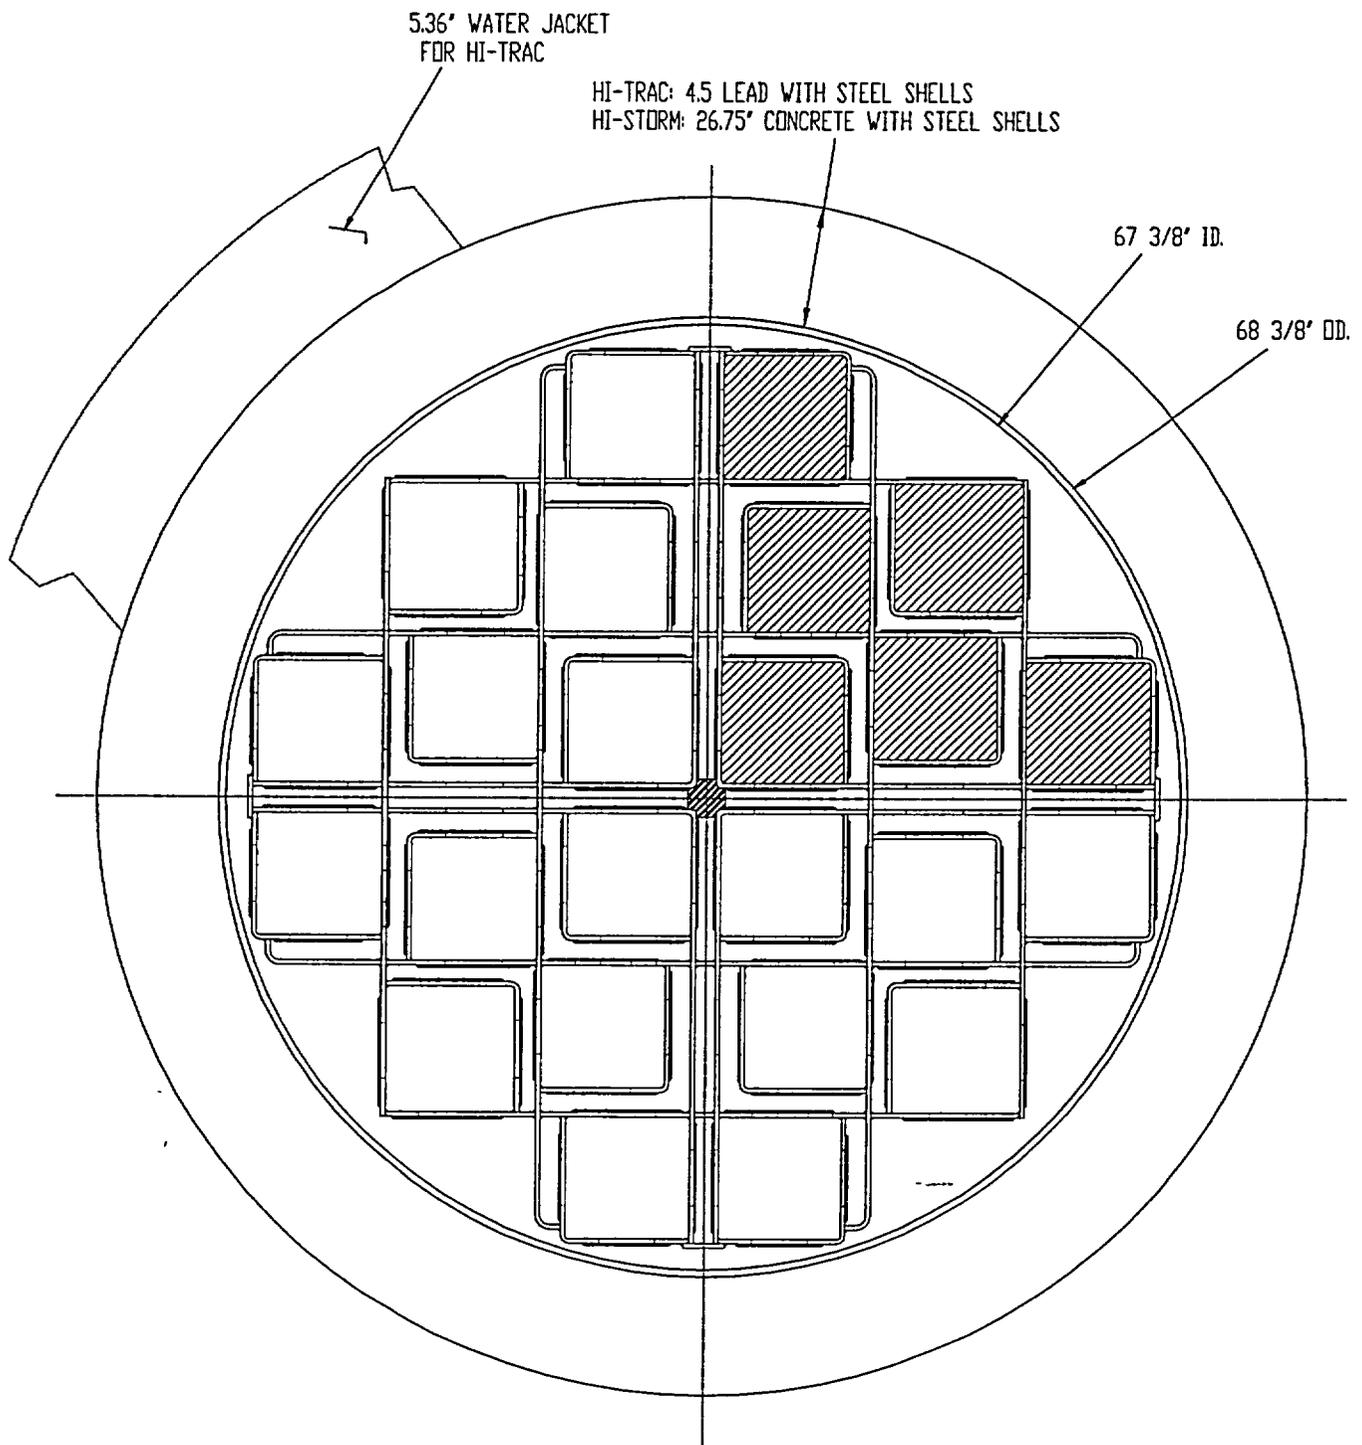


FIGURE 6.3.4; CALCULATION MODEL (PLANAR CROSS-SECTION)
WITH FUEL ILLUSTRATED IN ONE QUADRANT OF
THE MPC -24 AND THE MPC-24E.

(SEE CHAPTER 1 FOR TRUE BASKET DIMENSIONS)

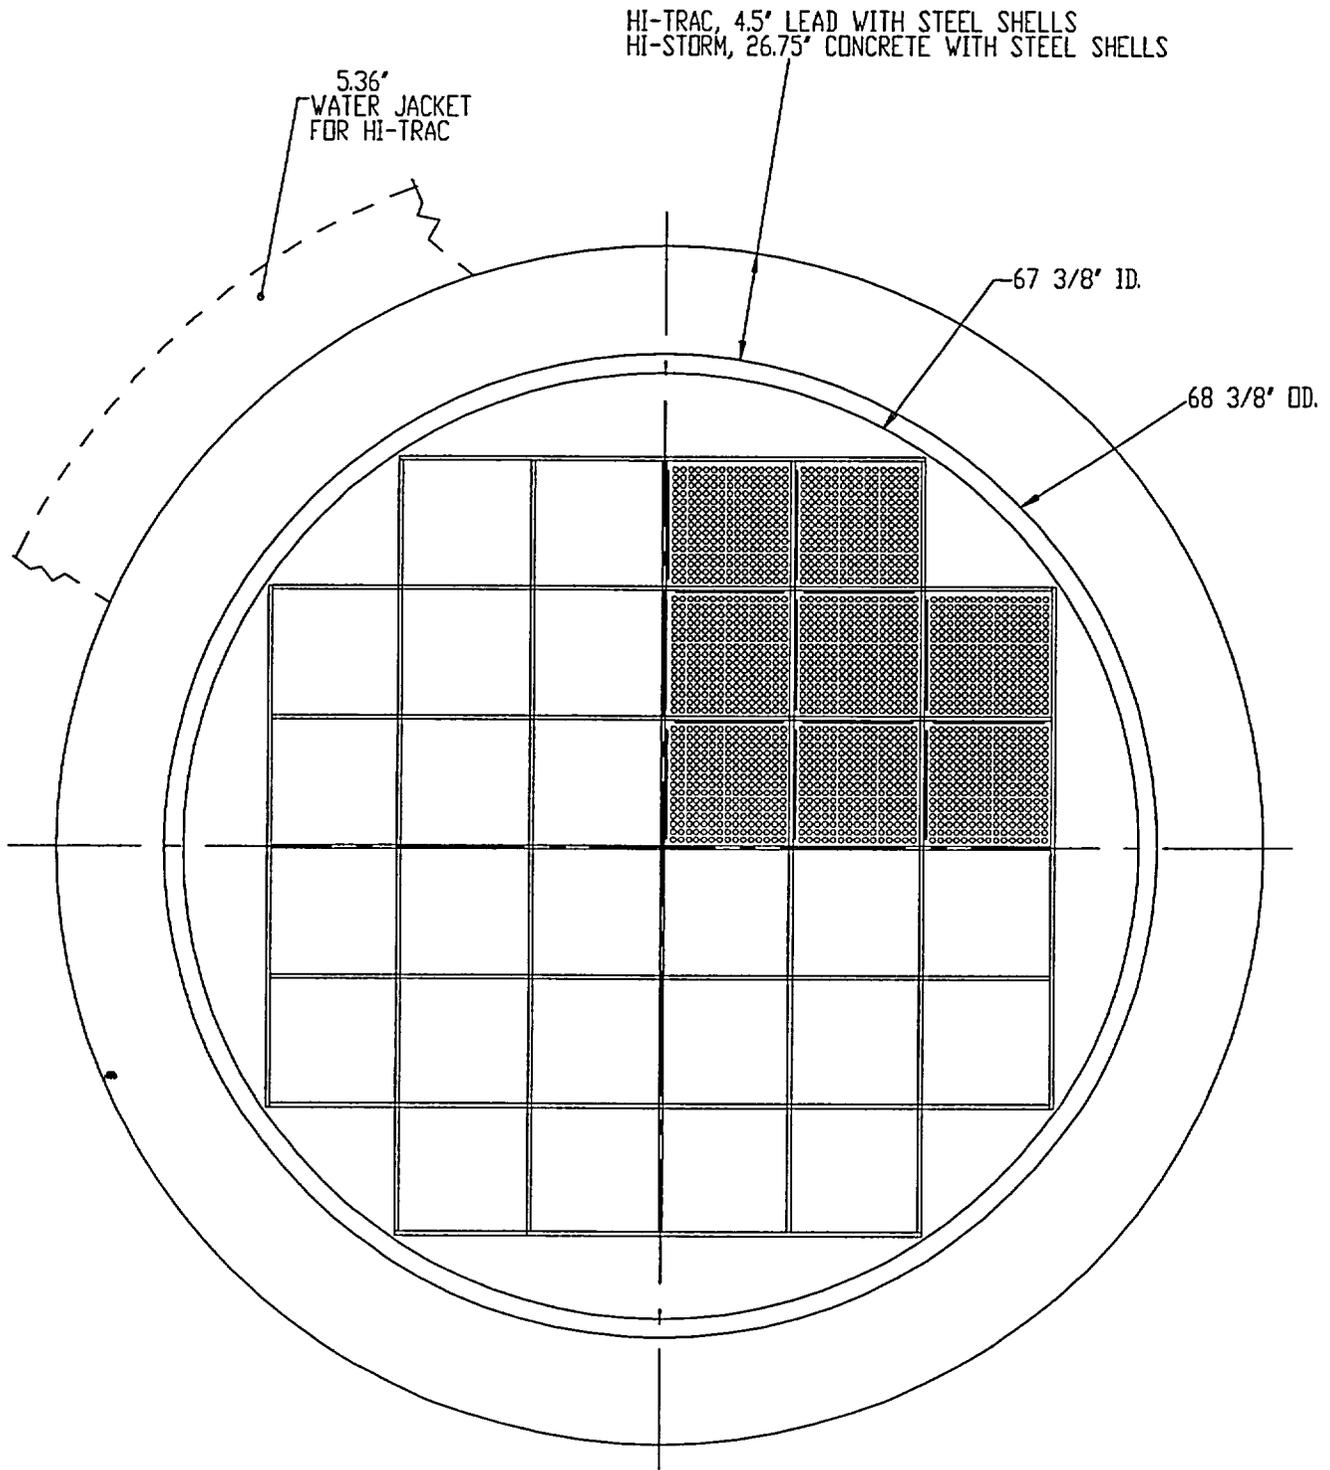


FIGURE 6.3.5; CALCULATION MODEL (PLANAR CROSS-SECTION)
 WITH FUEL ILLUSTRATED IN ONE QUADRANT OF
 THE MPC-32.
 (SEE CHAPTER 1 FOR TRUE BASKET DIMENSIONS)

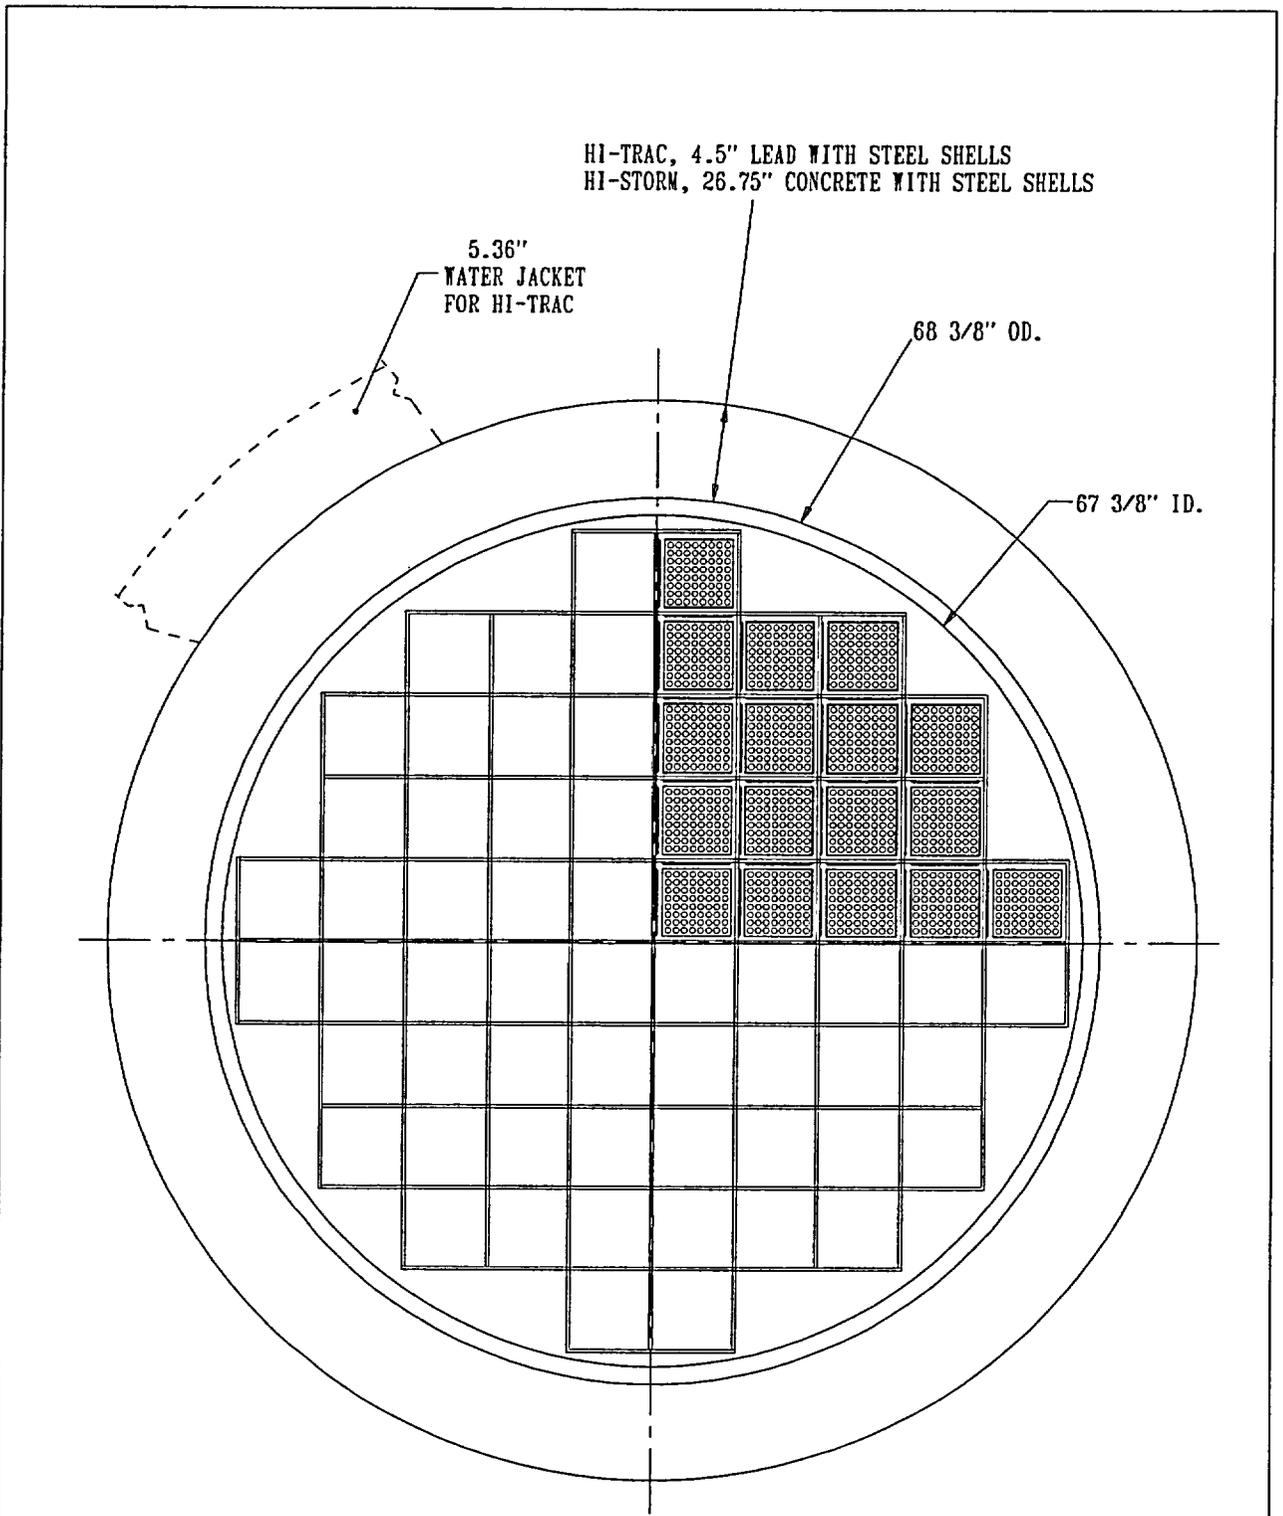


FIGURE 6.3.6; CALCULATION MODEL (PLANAR CROSS-SECTION)
 WITH FUEL ILLUSTRATED IN ONE QUADRANT OF
 THE MPC-68
 (SEE CHAPTER 1 FOR TRUE BASKET DIMENSIONS)

	ACTIVE FUEL LENGTH	LOWER WATER THICKNESS	UPPER WATER THICKNESS
MPC-68	SEE TABLE 6.2.1	7.30 IN.	8.46 IN.
MPC-24,-24E & -32	SEE TABLE 6.2.2	4.0 IN.	6.0 IN.

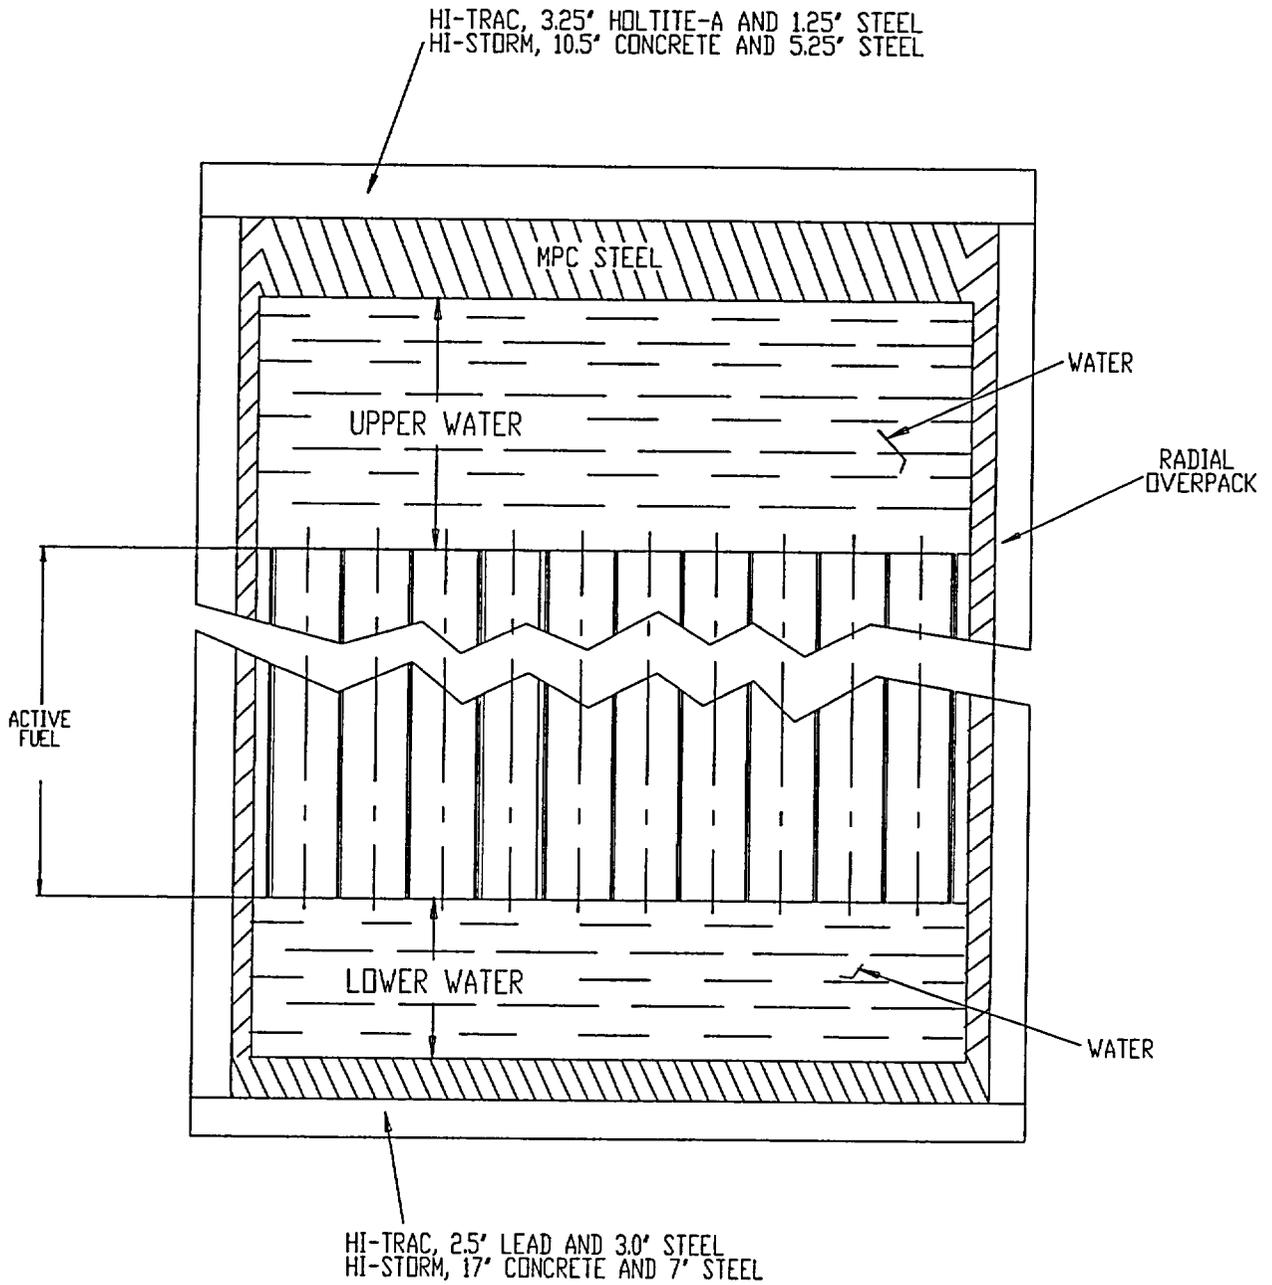


FIGURE 6.3.7; SKETCH OF THE CALCULATIONAL MODEL IN THE AXIAL DIRECTION

6.4 CRITICALITY CALCULATIONS

6.4.1 Calculational or Experimental Method

6.4.1.1 Basic Criticality Safety Calculations

The principal method for the criticality analysis is the general three-dimensional continuous energy Monte Carlo N-Particle code MCNP4a [6.1.4] developed at the Los Alamos National Laboratory. MCNP4a was selected because it has been extensively used and verified and has all of the necessary features for this analysis. MCNP4a calculations used continuous energy cross-section data based on ENDF/B-V, as distributed with the code [6.1.4]. Independent verification calculations were performed with NITAWL-KENO5a [6.1.5], which is a three-dimensional multigroup Monte Carlo code developed at the Oak Ridge National Laboratory. The KENO5a calculations used the 238-group cross-section library, which is based on ENDF/B-V data and is distributed as part of the SCALE-4.3 package [6.4.1], in association with the NITAWL-II program [6.1.6], which adjusts the uranium-238 cross sections to compensate for resonance self-shielding effects. The Dancoff factors required by NITAWL-II were calculated with the CELLDAN code [6.1.13], which includes the SUPERDAN code [6.1.7] as a subroutine.

The convergence of a Monte Carlo criticality problem is sensitive to the following parameters: (1) number of histories per cycle, (2) the number of cycles skipped before averaging, (3) the total number of cycles and (4) the initial source distribution. The MCNP4a criticality output contains a great deal of useful information that may be used to determine the acceptability of the problem convergence. This information was used in parametric studies to develop appropriate values for the aforementioned criticality parameters to be used in the criticality calculations for this submittal. Based on these studies, a minimum of 5,000 histories were simulated per cycle, a minimum of 20 cycles were skipped before averaging, a minimum of 100 cycles were accumulated, and the initial source was specified as uniform over the fueled regions (assemblies). Further, the output was examined to ensure that each calculation achieved acceptable convergence. These parameters represent an acceptable compromise between calculational precision and computational time. Appendix 6.D provides sample input files for the MPC-24 and MPC-68 basket in the HI-STORM-100 System.

CASMO-3 [6.1.9] was used for determining the small incremental reactivity effects of manufacturing tolerances. Although CASMO-3 has been extensively benchmarked, these calculations are used only to establish direction of reactivity uncertainties due to manufacturing tolerances (and their magnitude). This allows the MCNP4a calculational model to use the worst combination of manufacturing tolerances. Table 6.3.1 shows results of the CASMO-3 calculations.

6.4.2 Fuel Loading or Other Contents Loading Optimization

The basket designs are intended to safely accommodate fuel with enrichments indicated in Tables 6.1.1 through 6.1.8 . These calculations were based on the assumption that the HI-STORM 100 System (HI-TRAC transfer cask) was fully flooded with clean unborated water or water containing specific minimum soluble boron concentrations. In all cases, the calculations include bias and calculational uncertainties, as well as the reactivity effects of manufacturing tolerances, determined by assuming the worst case geometry.

Nominally, the fuel assemblies would be centrally positioned in each MPC basket cell. However, in accordance with NUREG-1536, the consequence of eccentric positioning was also evaluated and found to be negligible. To simulate eccentric positioning (and possible closer approach to the MPC steel shield), calculations were performed analytically decreasing the inner radius until it was 1 cm away[†] from the nearest fuel. Results showed a minor increase in reactivity of 0.0026 Δk maximum (MPC-68) which implies that the effect of eccentric location of fuel is negligible at the actual reflector spacing.

6.4.2.1 Internal and External Moderation

As required by NUREG-1536, calculations in this section demonstrate that the HI-STORM 100 System remains subcritical for all credible conditions of moderation.

6.4.2.1.1 Unborated Water

With a neutron absorber present (i.e., the Boral sheets or the steel walls of the storage compartments), the phenomenon of a peak in reactivity at a hypothetical low moderator density (sometimes called "optimum" moderation) does not occur to any significant extent. In a definitive study, Cano, et al. [6.4.2] has demonstrated that the phenomenon of a peak in reactivity at low moderator densities does not occur in the presence of strong neutron absorbing material or in the absence of large water spaces between fuel assemblies in storage. Nevertheless, calculations for a single reflected cask were made to confirm that the phenomenon does not occur with low density water inside or outside the casks.

Calculations for the MPC designs with internal and external moderators of various densities are shown in Table 6.4.1. For comparison purposes, a calculation for a single unreflected cask (Case

[†] PNL critical experiments have shown a small positive reactivity effect of thick steel reflectors, with the maximum effect at 1 cm distance from the fuel. In the cask designs, the fuel is mechanically prohibited from being positioned at a 1 cm spacing from the overpack steel.

1) is also included in Table 6.4.1. At 100% external moderator density, Case 2 corresponds to a single fully-flooded cask, fully reflected by water. Figure 6.4.10 plots calculated k_{eff} values ($\pm 2\sigma$) as a function of internal moderator density for both MPC designs with 100% external moderator density (i.e., full water reflection). Results listed in Table 6.4.1 support the following conclusions:

- For each type of MPC, the calculated k_{eff} for a fully-flooded cask is independent of the external moderator (the small variations in the listed values are due to statistical uncertainties which are inherent to the calculational method (Monte Carlo)), and
- For each type of MPC, reducing the internal moderation results in a monotonic reduction in reactivity, with no evidence of any optimum moderation. Thus, the fully flooded condition corresponds to the highest reactivity, and the phenomenon of optimum low-density moderation does not occur and is not applicable to the HI-STORM 100 System.

For each of the MPC designs, the maximum k_{eff} values are shown to be less than or statistically equal to that of a single internally flooded unreflected cask and are below the regulatory limit of 0.95.

6.4.2.1.2 Borated Water

With the presence of a soluble neutron absorber in the water, the discussion in the previous section is not always applicable. Calculations were made to determine the optimum moderator density for the MPC designs that require a minimum soluble boron concentration.

Calculations for the MPC designs with various internal moderator densities are shown in Table 6.4.6. As shown in the previous section, the external moderator density has a negligible effect on the reactivity, and is therefore not varied. Water containing soluble boron has a slightly higher density than pure water. Therefore, water densities up to 1.005 g/cm^3 were analyzed for the higher soluble boron concentrations. Additionally, for the higher soluble boron concentrations, analysis have been performed with empty (voided) guide tubes. This variation is discussed in detail in Section 6.4.8. Results listed in the Table 6.4.6 support the following conclusions:

- For all cases with a soluble boron concentration of up to 1900ppm, and for a soluble boron concentration of 2600ppm assuming voided guide tubes, the conclusion of the Section 6.4.2.1.1 applies, i.e. the maximum reactivity is corresponds to 100% moderator density.
- For 2600ppm soluble boron concentration with filled guide tubes, the results presented in Table 6.4.6 indicate that there is a maximum of the reactivity somewhere between 0.90 g/cm^3 and 1.00 g/cm^3 moderator density. However, a distinct maximum can not be

identified, as the reactivities in this range are very close. For the purpose of the calculations with 2600ppm soluble boron concentration, a moderator density of 0.93 g/cm^3 was chosen, which corresponds to the highest calculated reactivity listed in Table 6.4.6.

6.4.2.2 Partial Flooding

As required by NUREG-1536, calculations in this section address partial flooding in the HI-STORM 100 System and demonstrate that the fully flooded condition is the most reactive.

The reactivity changes during the flooding process were evaluated in both the vertical and horizontal positions for all MPC designs. For these calculations, the cask is partially filled (at various levels) with full density (1.0 g/cc) water and the remainder of the cask is filled with steam consisting of ordinary water at partial density (0.002 g/cc), as suggested in NUREG-1536. Results of these calculations are shown in Table 6.4.2. In all cases, the reactivity increases monotonically as the water level rises, confirming that the most reactive condition is fully flooded.

6.4.2.3 Clad Gap Flooding

As required by NUREG-1536, the reactivity effect of flooding the fuel rod pellet-to-clad gap regions, in the fully flooded condition, has been investigated. Table 6.4.3 presents maximum k_{eff} values that demonstrate the positive reactivity effect associated with flooding the pellet-to-clad gap regions. These results confirm that it is conservative to assume that the pellet-to-clad gap regions are flooded. For all cases that involve flooding, the pellet-to-clad gap regions are assumed to be flooded with clean, unborated water.

6.4.2.4 Preferential Flooding

Two different potential conditions of preferential flooding are considered: preferential flooding of the MPC basket itself (i.e. different water levels in different basket cells), and preferential flooding involving Damaged Fuel Containers.

Preferential flooding of the MPC basket itself for any of the MPC fuel basket designs is not possible because flow holes are present on all four walls of each basket cell and on the two flux trap walls at both the top and bottom of the MPC basket. The flow holes are sized to ensure that they cannot be blocked by crud deposits (see Chapter 11). Because the fuel cladding temperatures remain below their design limits (as demonstrated in Chapter 4) and the inertial loading remains below $63g$'s (the inertial loadings associated with the design basis drop accidents discussed in

Chapter 11 are limited to 45g's), the cladding remains intact (see Section 3.5). For damaged fuel assemblies and fuel debris, the assemblies or debris are pre-loaded into stainless steel Damaged Fuel Containers fitted with 250x250 fine mesh screens which prevent damaged fuel assemblies or fuel debris from blocking the basket flow holes. Therefore, the flow holes cannot be blocked.

However, when DFCs are present in the MPC, a condition could exist during the draining of the MPC, where the DFCs are still partly filled with water while the remainder of the MPC is dry. This condition would be the result of the water tension across the mesh screens. The maximum water level inside the DFCs for this condition is calculated from the dimensions of the mesh screen and the surface tension of water. The wetted perimeter of the screen openings is 50 ft per square inch of screen. With a surface tension of water of 0.005 lbf/ft, this results in a maximum pressure across the screen of 0.25 psi, corresponding to a maximum water height in the DFC of 7 inches. For added conservatism, a value of 12 inches is used. Assuming this condition, calculations are performed for all three possible DFC configurations:

- MPC-68 or MPC-68F with 68 DFCs (Assembly Classes 6x6A/B/C, 7x7A and 8x8A)
- MPC-68 or MPC-68FF with 16 DFCs (All BWR Assembly Classes)
- MPC-24E or MPC-24EF with 4 DFCs (All PWR Assembly Classes)

For each configuration, the case resulting in the highest maximum k_{eff} for the fully flooded condition (see Section 6.4.4) is re-analyzed assuming the preferential flooding condition. For these analyses, the lower 12 inches of the active fuel in the DFCs and the water region below the active fuel (see Figure 6.3.7) are filled with full density water (1.0 g/cc). The remainder of the cask is filled with steam consisting of ordinary water at partial density (0.002 g/cc). Table 6.4.4 lists the maximum k_{eff} for the three configurations in comparison with the maximum k_{eff} for the fully flooded condition. For all configurations, the preferential flooding condition results in a lower maximum k_{eff} than the fully flooded condition. Thus, the preferential flooding condition is bounded by the fully flooded condition.

Once established, the integrity of the MPC confinement boundary is maintained during all credible off-normal and accident conditions, and thus, the MPC cannot be flooded. In summary, it is concluded that the MPC fuel baskets cannot be preferentially flooded, and that the potential preferential flooding conditions involving DFCs are bounded by the result for the fully flooded condition listed in Section 6.4.4.

6.4.2.5 Design Basis Accidents

The analyses presented in Chapters 3 and 11 demonstrate that the damage resulting from the design basis accidents is limited to a loss of the water jacket for the HI-TRAC transfer cask and minor damage to the concrete radiation shield for the HI-STORM storage cask, which have no adverse effect on the design parameters important to criticality safety.

As reported in Chapter 3, Table 3.4.4, the minimum factor of safety for either MPC as a result of the hypothetical cask drop or tip-over accident is 1.1 against the Level D allowables for Subsection NG, Section III of the ASME Code. Therefore, because the maximum box wall stresses are well within the ASME Level D allowables, the flux-trap gap change will be insignificant compared to the characteristic dimension of the flux trap.

In summary, the design basis accidents have no adverse effect on the design parameters important to criticality safety, and therefore, there is no increase in reactivity as a result of any of the credible off-normal or accident conditions involving handling, packaging, transfer or storage. Consequently, the HI-STORM 100 System is in full compliance with the requirement of 10CRF72.124, which states that “before a nuclear criticality accident is possible, at least two unlikely, independent, and concurrent or sequential changes have occurred in the conditions essential to nuclear criticality safety.”

6.4.3 Criticality Results

Results of the design basis criticality safety calculations for the condition of full flooding with water (limiting cases) are presented in section 6.2 and summarized in Section 6.1. To demonstrate the applicability of the HI-STAR analyses, results of the design basis criticality safety calculations for the HI-STAR cask (limiting cases) are also summarized in Section 6.1 for comparison. These data confirm that for each of the candidate fuel types and basket configurations the effective multiplication factor (k_{eff}), including all biases and uncertainties at a 95-percent confidence level, do not exceed 0.95 under all credible normal, off-normal, and accident conditions.

Additional calculations (CASMO-3) at elevated temperatures confirm that the temperature coefficients of reactivity are negative as shown in Table 6.3.1. This confirms that the calculations for the storage baskets are conservative.

In calculating the maximum reactivity, the analysis used the following equation:

$$k_{eff}^{max} = k_c + K_c \sigma_c + Bias + \sigma_B$$

where:

- ⇒ k_c is the calculated k_{eff} under the worst combination of tolerances;
- ⇒ K_c is the K multiplier for a one-sided statistical tolerance limit with 95% probability at the 95% confidence level [6.1.8]. Each final k_{eff} value calculated by MCNP4a (or KENO5a) is the result of averaging 100 (or more) cycle k_{eff} values, and thus, is based on a sample size of 100. The K multiplier corresponding to a sample size of 100 is 1.93.

- However, for this analysis a value of 2.00 was assumed for the K multiplier, which is larger (more conservative) than the value corresponding to a sample size of 100;
- ⇒ σ_c is the standard deviation of the calculated k_{eff} , as determined by the computer code (MCNP4a or KENO5a);
- ⇒ *Bias* is the systematic error in the calculations (code dependent) determined by comparison with critical experiments in Appendix 6.A; and
- ⇒ σ_B is the standard error of the bias (which includes the K multiplier for 95% probability at the 95% confidence level; see Appendix 6.A).

The critical experiment benchmarking and the derivation of the bias and standard error of the bias (95% probability at the 95% confidence level) are presented in Appendix 6.A.

6.4.4 Damaged Fuel and Fuel Debris

Damaged fuel assemblies and fuel debris are required to be loaded into Damaged Fuel Containers (DFCs) prior to being loaded into the MPC. Four (4) different DFC types with different cross sections are analyzed. Three (3) of these DFCs are designed for BWR fuel assemblies, one (1) is designed for PWR fuel assemblies. Two of the DFCs for BWR fuel are specifically designed for fuel assembly classes 6x6A, 6x6B, 6x6C, 7x7A and 8x8A. These assemblies have a smaller cross section, a shorter active length and a low initial enrichment of 2.7 wt% ^{235}U , and therefore a low reactivity. The analysis for these assembly classes is presented in the following Section 6.4.4.1. The remaining two DFCs are generic DFCs designed for all BWR and PWR assembly classes. The criticality analysis for these generic DFCs is presented in Section 6.4.4.2.

6.4.4.1 MPC-68, MPC-68F or MPC-68FF loaded with Assembly Classes 6x6A, 6x6B, 6x6C, 7x7A and 8x8A

This section only addresses criticality calculations and results for assembly classes 6x6A, 6x6B, 6x6C, 7x7A and 8x8A, loaded into the MPC-68, MPC-68F or MPC-68FF. Up to 68 DFCs with these assembly classes are permissible to be loaded into the MPC. Two different DFC types with slightly different cross-sections are analyzed. DFCs containing fuel debris must be stored in the MPC-68F or MPC-68FF. DFCs containing damaged fuel assemblies may be stored in either the MPC-68, MPC-68F or MPC-68FF. Evaluation of the capability of storing damaged fuel and fuel debris (loaded in DFCs) is limited to very low reactivity fuel in the MPC-68F. Because the MPC-68 and MPC-68FF have a higher specified ^{10}B loading, the evaluation of the MPC-68F conservatively bounds the storage of damaged BWR fuel assemblies in a standard MPC-68 or MPC-68FF. Although the maximum planar-average enrichment of the damaged fuel is limited to 2.7% ^{235}U as specified in the Certificate of Compliance, analyses have been made for three

possible scenarios, conservatively assuming fuel^{††} of 3.0% enrichment. The scenarios considered included the following:

1. Lost or missing fuel rods, calculated for various numbers of missing rods in order to determine the maximum reactivity. The configurations assumed for analysis are illustrated in Figures 6.4.2 through 6.4.8.
2. Broken fuel assembly with the upper segments falling into the lower segment creating a close-packed array (described as a 8x8 array). For conservatism, the array analytically retained the same length as the original fuel assemblies in this analysis. This configuration is illustrated in Figure 6.4.9.
3. Fuel pellets lost from the assembly and forming powdered fuel dispersed through a volume equivalent to the height of the original fuel. (Flow channel and clad material assumed to disappear).

Results of the analyses, shown in Table 6.4.5, confirm that, in all cases, the maximum reactivity is well below the regulatory limit. There is no significant difference in reactivity between the two DFC types. Collapsed fuel reactivity (simulating fuel debris) is low because of the reduced moderation. Dispersed powdered fuel results in low reactivity because of the increase in ²³⁸U neutron capture (higher effective resonance integral for ²³⁸U absorption).

The loss of fuel rods results in a small increase in reactivity (i.e., rods assumed to collapse, leaving a smaller number of rods still intact). The peak reactivity occurs for 8 missing rods, and a smaller (or larger) number of intact rods will have a lower reactivity, as indicated in Table 6.4.5.

The analyses performed and summarized in Table 6.4.5 provides the relative magnitude of the effects on the reactivity. This information coupled with the maximum k_{eff} values listed in Table 6.1.3 and the conservatism in the analyses, demonstrate that the maximum k_{eff} of the damaged fuel in the most adverse post-accident condition will remain well below the regulatory requirement of $k_{eff} < 0.95$.

6.4.4.2 Generic BWR and PWR Damaged Fuel and Fuel Debris

The MPC-24E, MPC-24EF, MPC-68 and MPC-68FF are designed to contain PWR and BWR damaged fuel and fuel debris, loaded into generic DFCs. The number of generic DFCs is limited to 16 for the MPC-68 and MPC-68FF, and to 4 for the MPC-24E and MPC-24EF. The permissible locations of the DFCs are shown in Figure 6.4.11 for the MPC-68/68FF and in Figure 6.4.12 for the MPC-24E/24EF.

^{††} 6x6A01 and 7x7A01 fuel assemblies were used as representative assemblies.

Damaged fuel assemblies are assemblies with known or suspected cladding defects greater than pinholes or hairlines, or with missing rods, but excluding fuel assemblies with gross defects (for a full definition see Section 1.1 of the Certificate of Compliance). Therefore, apart from possible missing fuel rods, damaged fuel assemblies have the same geometric configuration as intact fuel assemblies and consequently the same reactivity. Missing fuel rods can result in a slight increase of reactivity. After a drop accident, however, it can not be assumed that the initial geometric integrity is still maintained. For a drop on either the top or bottom of the cask, the damaged fuel assemblies could collapse. This would result in a configuration with a reduced length, but increased amount of fuel per unit length. For a side drop, fuel rods could be compacted to one side of the DFC. In either case, a significant relocation of fuel within the DFC is possible, which creates a greater amount of fuel in some areas of the DFC, whereas the amount of fuel in other areas is reduced. Fuel debris can include a large variety of configurations ranging from whole fuel assemblies with severe damage down to individual fuel pellets.

In the cases of fuel debris or relocated damaged fuel, there is the potential that fuel could be present in axial sections of the DFCs that are outside the basket height covered with Boral. However, in these sections, the DFCs are not surrounded by any intact fuel, only by basket cell walls, non-fuel hardware, water and for the MPC-68/68FF by a maximum of one other DFC. Studies have shown that this condition does not result in any significant effect on reactivity, compared to a condition where the damaged fuel and fuel debris is restricted to the axial section of the basket covered by Boral. All calculations for generic BWR and PWR damaged fuel and fuel debris are therefore performed assuming that fuel is present only in the axial sections covered by Boral, and the results are directly applicable to any situation where damaged fuel and fuel debris is located outside these sections in the DFCs.

To address all the situations listed above and identify the configuration or configurations leading to the highest reactivity, it is impractical to analyze a large number of different geometrical configurations for each of the fuel classes. Instead, a bounding approach is taken which is based on the analysis of regular arrays of bare fuel rods without cladding. Details and results of the analyses are discussed in the following sections.

All calculations for generic damaged fuel and fuel debris are performed using a full cask model with the maximum permissible number of Damaged Fuel Containers. For the MPC-68 and MPC-68FF, the model therefore contains 52 intact assemblies, and 16 DFCs in the locations shown in Figure 6.4.11. For the MPC-24E and MPC-24EF, the model consists of 20 intact assemblies, and 4 DFCs in the locations shown in Figure 6.4.12. The bounding assumptions regarding the intact assemblies and the modeling of the damaged fuel and fuel debris in the DFCs are discussed in the following sections.

6.4.4.2.1 Bounding Intact Assemblies

Intact BWR assemblies stored together with DFCs are limited to a maximum planar average enrichment of 3.7 wt% ^{235}U , regardless of the fuel class. The results presented in Table 6.1.7 are for different enrichments for each class, ranging between 2.7 and 4.2 wt% ^{235}U , making it difficult to identify the bounding assembly. Therefore, additional calculations were performed for the bounding assembly in each assembly class with a planar average enrichment of 3.7 wt%. The results are summarized in Table 6.4.7 and demonstrate that the assembly classes 9x9E and 9x9F have the highest reactivity. These two classes share the same bounding assembly (see footnotes for Tables 6.2.33 and 6.2.34 for further details). This bounding assembly is used as the intact BWR assembly for all calculations with DFCs.

Intact PWR assemblies stored together with DFCs are limited to a maximum enrichment of 4.0 wt% ^{235}U , regardless of the fuel class. The results presented in Table 6.1.3 are for different enrichments for each class, ranging between 4.2 and 5.0 wt% ^{235}U , making it difficult to directly identify the bounding assembly. However, Table 6.1.4 shows results for an enrichment of 5.0 wt% for all fuel classes, with a soluble boron concentration of 300 ppm. The assembly class 15x15H has the highest reactivity. This is consistent with the results in Table 6.1.3, where the assembly class 15x15H is among the classes with the highest reactivity, but has the lowest initial enrichment. Therefore, the 15x15H assembly is used as the intact PWR assembly for all calculations with DFCs.

6.4.4.2.2 Bare Fuel Rod Arrays

A conservative approach is used to model both damaged fuel and fuel debris in the DFCs, using arrays of bare fuel rods:

- Fuel in the DFCs is arranged in regular, rectangular arrays of bare fuel rods, i.e. all cladding and other structural material in the DFC is replaced by water.
- The active length of these rods is chosen to be the maximum active fuel length of all fuel assemblies listed in Section 6.2, which is 155 inch for BWR fuel and 150 inch for PWR fuel.
- To ensure the configuration with optimum moderation and highest reactivity is analyzed, the amount of fuel per unit length of the DFC is varied over a large range. This is achieved by changing the number of rods in the array and the rod pitch. The number of rods are varied between 9 (3x3) and 189 (17x17) for BWR fuel, and between 64 (8x8) and 729 (27x27) for PWR fuel.

- Analyses are performed for the minimum, maximum and typical pellet diameter of PWR and BWR fuel.

This is a very conservative approach to model damaged fuel, and to model fuel debris configurations such as severely damaged assemblies and bundles of individual fuel rods, as the absorption in the cladding and structural material is neglected.

This is also a conservative approach to model fuel debris configurations such as bare fuel pellets due to the assumption of an active length of 155 inch (BWR) or 150 inch (PWR). The actual height of bare fuel pellets in a DFC would be significantly below these values due to the limitation of the fuel mass for each basket position.

To demonstrate the level of conservatism, additional analyses are performed with the DFC containing various realistic assembly configurations such as intact assemblies, assemblies with missing fuel rods and collapsed assemblies, i.e. assemblies with increased number of rods and decreased rod pitch.

As discussed in Section 6.4.4.2, all calculations are performed for full cask models, containing the maximum permissible number of DFCs together with intact assemblies.

Graphical presentations of the calculated maximum k_{eff} for each case as a function of the fuel mass per unit length of the DFC are shown in Figures 6.4.13 (BWR) and 6.4.14 (PWR). The results for the bare fuel rods show a distinct peak in the maximum k_{eff} at about 2 kg UO_2 /inch for BWR fuel, and at about 3.5 kg UO_2 /inch for PWR fuel.

The realistic assembly configurations are typically about 0.01 (delta-k) or more below the peak results for the bare fuel rods, demonstrating the conservatism of this approach to model damaged fuel and fuel debris configurations such as severely damaged assemblies and bundles of fuel rods.

For fuel debris configurations consisting of bare fuel pellets only, the fuel mass per unit length would be beyond the value corresponding to the peak reactivity. For example, for DFCs filled with a mixture of 60 vol% fuel and 40 vol% water the fuel mass per unit length is 3.36 kg UO_2 /inch for the BWR DFC and 7.92 kg UO_2 /inch for the PWR DFC. The corresponding reactivities are significantly below the peak reactivities. The difference is about 0.005 (delta-k) for BWR fuel and 0.01 (delta-k) or more for PWR fuel. Furthermore, the filling height of the DFC would be less than 70 inches in these examples due to the limitation of the fuel mass per basket position, whereas the calculation is conservatively performed for a height of 155 inch (BWR) or 150 inch (PWR). These results demonstrate that even for the fuel debris configuration of bare fuel pellets, the model using bare fuel rods is a conservative approach.

6.4.4.2.3 Distributed Enrichment in BWR Fuel

BWR fuel usually has an enrichment distribution in each planar cross section, and is characterized by the maximum planar average enrichment. For intact fuel it has been shown that using the average enrichment for each fuel rod in a cross section is conservative, i.e. the reactivity is higher than calculated for the actual enrichment distribution (See Appendix 6.B). For damaged fuel assemblies, additional configurations are analyzed to demonstrate that the distributed enrichment does not have a significant impact on the reactivity of the damaged assembly under accident conditions. Specifically, the following two scenarios were analyzed:

- As a result of an accident, fuel rods with lower enrichment relocate from the top part to the bottom part of the assembly. This results in an increase of the average enrichment in the top part, but at the same time the amount of fuel in that area is reduced compared to the intact assembly.
- As a result of an accident, fuel rods with higher enrichment relocate from the top part to the bottom part of the assembly. This results in an increase of the average enrichment in the bottom part, and at the same time the amount of fuel in that area is increased compared to the intact assembly, leading to a reduction of the water content.

In both scenarios, a compensation of effects on reactivity is possible, as the increase of reactivity due to the increased planar average enrichment might be offset by the possible reduction of reactivity due to the change in the fuel to water ratio. A selected number of calculations have been performed for these scenarios and the results show that there is only a minor change in reactivity. These calculations are shown in Figure 6.4.13 in the group of the explicit assemblies. Consequently, it is appropriate to qualify damaged BWR fuel assemblies and fuel debris based on the maximum planar average enrichment. For assemblies with missing fuel rods, this maximum planar average enrichment has to be determined based on the enrichment and number of rods still present in the assembly when loaded into the DFC.

6.4.4.2.4 Results for MPC-68 and MPC-68FF

The MPC-68 and MPC-68FF allows the storage of up to sixteen DFCs in the shaded cells on the periphery of the basket shown in Figure 6.4.11. In the MPC-68FF, up to 8 of these cells may contain DFCs with fuel debris. The various configurations outlined in Sections 6.4.4.2.2 and 6.4.4.2.3 are analyzed with an enrichment of the intact fuel of 3.7% ^{235}U and an enrichment of damaged fuel or fuel debris of 4.0% ^{235}U . For the intact assembly, the bounding assembly of the 9x9E and 9x9F fuel classes was chosen. This assembly has the highest reactivity of all BWR assembly classes for the initial enrichment of 3.7 wt% ^{235}U , as demonstrated in Table 6.4.7. The results for the various configurations are summarized in Figure 6.4.13 and in Table 6.4.8. Figure 6.4.13 shows the maximum k_{eff} , including bias and calculational uncertainties, for various actual and hypothetical damaged fuel or fuel debris configurations as a function of the fuel mass per

unit length of the DFC. Table 6.4.8 lists the highest maximum k_{eff} for the various configurations. All maximum k_{eff} values are below the 0.95 regulatory limit.

6.4.4.2.5 Results for MPC-24E and MPC-24EF

The MPC-24E allows the storage of up to four DFCs with damaged fuel in the four outer fuel baskets cells shaded in Figure 6.4.12. The MPC-24EF allows storage of up to four DFCs with damaged fuel or fuel debris in these locations. These locations are designed with a larger box ID to accommodate the DFCs. For an enrichment of 4.0 wt% ^{235}U for the intact fuel, damaged fuel and fuel debris, the results for the various configurations outlined in Section 6.4.4.2 are summarized in Figure 6.4.14 and in Table 6.4.9. Figure 6.4.14 shows the maximum k_{eff} , including bias and calculational uncertainties, for various actual and hypothetical damaged fuel and fuel debris configurations as a function of the fuel mass per unit length of the DFC. For the intact assemblies, the 15x15H assembly class was chosen. This assembly class has the highest reactivity of all PWR assembly classes for a given initial enrichment. This is demonstrated in Table 6.1.4. Table 6.4.9 lists the highest maximum k_{eff} for the various configurations. All maximum k_{eff} values are below the 0.95 regulatory limit.

6.4.5 Fuel Assemblies with Missing Rods

For fuel assemblies that are qualified for damaged fuel storage, missing and/or damaged fuel rods are acceptable. However, for fuel assemblies to meet the limitations of intact fuel assembly storage, missing fuel rods must be replaced with dummy rods that displace a volume of water that is equal to, or larger than, that displaced by the original rods.

6.4.6 Thoria Rod Canister

The Thoria Rod Canister is similar to a DFC with an internal separator assembly containing 18 intact fuel rods. The configuration is illustrated in Figure 6.4.15. The k_{eff} value for an MPC-68F filled with Thoria Rod Canisters is calculated to be 0.1813. This low reactivity is attributed to the relatively low content in ^{235}U (equivalent to UO_2 fuel with an enrichment of approximately 1.7 wt% ^{235}U), the large spacing between the rods (the pitch is approximately 1", the cladding OD is 0.412") and the absorption in the separator assembly. Together with the maximum k_{eff} values listed in Tables 6.1.7 and 6.1.8 this result demonstrates that the k_{eff} for a Thoria Rod Canister loaded into the MPC-68 or the MPC-68F together with other approved fuel assemblies or DFCs will remain well below the regulatory requirement of $k_{\text{eff}} < 0.95$.

6.4.7 Sealed Rods replacing BWR Water Rods

Some BWR fuel assemblies contain sealed rods filled with a non-fissile material instead of water rods. Compared to the configuration with water rods, the configuration with sealed rods has a reduced amount of moderator, while the amount of fissile material is maintained. Thus, the reactivity of the configuration with sealed rods will be lower compared to the configuration with water rods. Any configuration containing sealed rods instead of water rods is therefore bounded by the analysis for the configuration with water rods and no further analysis is required to demonstrate the acceptability. Therefore, for all BWR fuel assemblies analyzed, it is permissible that water rods are replaced by sealed rods filled with a non-fissile material.

6.4.8 Non-fuel Hardware in PWR Fuel Assemblies

Non-fuel hardware such as Thimble Plugs (TPs), Burnable Poison Rod Assemblies (BPRAs), Control Rod Assemblies (CRAs), Axial Power Shaping Rods (APSRs) and similar devices are permitted for storage with all PWR fuel types. Non-fuel hardware is inserted in the guide tubes of the assemblies. For pure water, the reactivity of any PWR assembly with inserts is bounded by (i.e. lower than) the reactivity of the same assembly without the insert. This is due to the fact that the insert reduces the amount of moderator in the assembly, while the amount of fissile material remains unchanged. This conclusion is supported by the calculation listed in Table 6.2.4, which shows a significant reduction in reactivity as a result of voided guide tubes, i.e. the removal of the water from the guide tubes.

With the presence of soluble boron in the water, non-fuel hardware not only displaces water, but also the neutron absorber in the water. It is therefore possible that the insertion results in an increase of reactivity, specifically for higher soluble boron concentrations. As a bounding approach for the presence of non-fuel hardware, analyses were performed with empty (voided) guide tubes, i.e. any absorption of the hardware is neglected. If assemblies contain an instrument tube, this tube remains filled with borated water. Table 6.4.6 shows results for the variation in water density for cases with filled and voided guide tubes. These results show that the optimum moderator density depends on the soluble boron concentration, and on whether the guide tubes are filled or assumed empty. For the MPC-24 with 400 ppm and the MPC-32 with 1900 ppm, voiding the guide tubes results in a reduction of reactivity. All calculations for the MPC-24 and MPC-24E, and for the MPC-32 with 1900 ppm are therefore performed with water in the guide tubes. For the MPC-32 with 2600 ppm, the reactivity for voided guide tubes slightly exceeds the reactivity for filled guide tubes. However, this effect is not consistent across all assembly classes. Table 6.4.10 shows results with filled and voided guide tubes for all assembly classes in the MPC-32 at 2600ppm. Some classes show an increase, other classes show a decrease as a result of voiding the guide tubes. Therefore, for the results presented in the Section 6.1, Table 6.1.6, the maximum value for each class is chosen.

In summary, from a criticality safety perspective, non-fuel hardware inserted into PWR assemblies are acceptable for all allowable PWR types, and, depending on the assembly class, can increase the safety margin.

6.4.9 Neutron Sources in Fuel Assemblies

Fuel assemblies containing start-up neutron sources are permitted for storage in the HI-STORM 100 System. The reactivity of a fuel assembly is not affected by the presence of a neutron source (other than by the presence of the material of the source, which is discussed later). This is true because in a system with a k_{eff} less than 1.0, any given neutron population at any time, regardless of its origin or size, will decrease over time. Therefore, a neutron source of any strength will not increase reactivity, but only the neutron flux in a system, and no additional criticality analyses are required. Sources are inserted as rods into fuel assemblies, i.e. they replace either a fuel rod or water rod (moderator). Therefore, the insertion of the material of the source into a fuel assembly will not lead to an increase of reactivity either.

6.4.10 Applicability of HI-STAR Analyses to HI-STORM 100 System

Calculations previously supplied to the NRC in applications for the HI-STAR 100 System (Docket Numbers 71-9261 and 72-1008) are directly applicable to the HI-STORM storage and HI-TRAC transfer casks. The MPC designs are identical. The cask systems differ only in the overpack shield material. The limiting condition for the HI-STORM 100 System is the fully flooded HI-TRAC transfer cask. As demonstrated by the comparative calculations presented in Tables 6.1.1 through 6.1.8, the shield material in the overpack (steel and lead for HI-TRAC, steel for HI-STAR) has a negligible impact on the eigenvalue of the cask systems. As a result, this analysis for the 125-ton HI-TRAC transfer cask is applicable to the 100-ton HI-TRAC transfer cask. In all cases, for the reference fuel assemblies, the maximum k_{eff} values are in good agreement and are conservatively less than the limiting k_{eff} value (0.95).

Table 6.4.1

MAXIMUM REACTIVITIES WITH REDUCED WATER DENSITIES FOR CASK ARRAYS[†]

Case Number	Water Density		MCNP4a Maximum k_{eff} ^{††}	
	Internal	External	MPC-24 (17x17A01 @ 4.0%)	MPC-68 (8x8C04 @ 4.2%)
1	100%	single cask	0.9368	0.9348
2	100%	100%	0.9354	0.9339
3	100%	70%	0.9362	0.9339
4	100%	50%	0.9352	0.9347
5	100%	20%	0.9372	0.9338
6	100%	10%	0.9380	0.9336
7	100%	5%	0.9351	0.9333
8	100%	0%	0.9342	0.9338
9	70%	0%	0.8337	0.8488
10	50%	0%	0.7426	0.7631
11	20%	0%	0.5606	0.5797
12	10%	0%	0.4834	0.5139
13	5%	0%	0.4432	0.4763
14	10%	100%	0.4793	0.4946

[†] For an infinite square array of casks with 60cm spacing between cask surfaces.

^{††} Maximum k_{eff} includes the bias, uncertainties, and calculational statistics, evaluated for the worst case combination of manufacturing tolerances.

Table 6.4.2

REACTIVITY EFFECTS OF PARTIAL CASK FLOODING

MPC-24 (17x17A01 @ 4.0% ENRICHMENT) (no soluble boron)			
Flooded Condition (% Full)	Vertical Orientation	Flooded Condition (% Full)	Horizontal Orientation
25	0.9157	25	0.8766
50	0.9305	50	0.9240
75	0.9330	75	0.9329
100	0.9368	100	0.9368
MPC-68 (8x8C04 @ 4.2% ENRICHMENT)			
Flooded Condition (% Full)	Vertical Orientation	Flooded Condition (% Full)	Horizontal Orientation
25	0.9132	23.5	0.8586
50	0.9307	50	0.9088
75	0.9312	76.5	0.9275
100	0.9348	100	0.9348
MPC-32 (15x15F @ 5.0 % ENRICHMENT) 2600ppm Soluble Boron			
Flooded Condition (% Full)	Vertical Orientation	Flooded Condition (% Full)	Horizontal Orientation
25	0.8927	31.25	0.9213
50	0.9215	50	0.9388
75	0.9350	68.75	0.9401
100	0.9445	100	0.9445

Notes:

1. All values are maximum k_{eff} which include bias, uncertainties, and calculational statistics, evaluated for the worst case combination of manufacturing tolerances.

Table 6.4.3

REACTIVITY EFFECT OF FLOODING THE PELLETT-TO-CLAD GAP

Pellet-to-Clad Condition	MPC-24 17x17A01 4.0% Enrichment	MPC-68 8x8C04 4.2% Enrichment
dry	0.9295	0.9279
flooded with unborated water	0.9368	0.9348

Notes:

1. All values are maximum k_{eff} which includes bias, uncertainties, and calculational statistics, evaluated for the worst case combination of manufacturing tolerances.

Table 6.4.4

REACTIVITY EFFECT OF PREFERENTIAL FLOODING OF THE DFCs

DFC Configuration	Preferential Flooding	Fully Flooded
MPC-68 or MPC-68F with 68 DFCs (Assembly Classes 6x6A/B/C, 7x7A and 8x8A)	0.6560	0.7857
MPC-68 or MPC-68FF with 16 DFCs (All BWR Assembly Classes)	0.6646	0.9328
MPC-24E or MPC-24EF with 4 DFCs (All PWR Assembly Classes)	0.7895	0.9480

Notes:

1. All values are maximum k_{eff} which includes bias, uncertainties, and calculational statistics, evaluated for the worst case combination of manufacturing tolerances.

Table 6.4.5

MAXIMUM k_{eff} VALUES[†] IN THE DAMAGED FUEL CONTAINER

Condition	MCNP4a Maximum ^{††} k_{eff}	
	DFC Dimensions: ID 4.93" THK. 0.12"	DFC Dimensions: ID 4.81" THK. 0.11"
<u>6x6 Fuel Assembly</u>		
6x6 Intact Fuel	0.7086	0.7016
w/32 Rods Standing	0.7183	0.7117
w/28 Rods Standing	0.7315	0.7241
w/24 Rods Standing	0.7086	0.7010
w/18 Rods Standing	0.6524	0.6453
Collapsed to 8x8 array	0.7845	0.7857
Dispersed Powder	0.7628	0.7440
<u>7x7 Fuel Assembly</u>		
7x7 Intact Fuel	0.7463	0.7393
w/41 Rods Standing	0.7529	0.7481
w/36 Rods Standing	0.7487	0.7444
w/25 Rods Standing	0.6718	0.6644

[†] These calculations were performed with a planar-average enrichment of 3.0% and a ¹⁰B loading of 0.0067 g/cm², which is 75% of a minimum ¹⁰B loading of 0.0089 g/cm². The minimum ¹⁰B loading in the MPC-68F is 0.010 g/cm². Therefore, the listed maximum k_{eff} values are conservative

^{††} Maximum k_{eff} includes bias, uncertainties, and calculational statistics, evaluated for the worst case combination of manufacturing tolerances.

Table 6.4.6

MAXIMUM k_{eff} VALUES WITH REDUCED BORATED WATER DENSITIES

Internal Water Density [†] in g/cm ³	Maximum k_{eff}				
	MPC-24 (400ppm) @ 5.0 %	MPC-32 (1900ppm) @ 4.1 %		MPC-32 (2600ppm) @ 5.0 %	
Guide Tubes	filled	filled	void	filled	void
1.005	NC ^{††}	0.9403	0.9395	NC	0.9481
1.00	0.9314	0.9411	0.9400	0.9445	0.9483
0.99	NC	0.9393	0.9396	0.9438	0.9462
0.98	0.9245	0.9403	0.9376	0.9447	0.9465
0.97	NC	0.9397	0.9391	0.9453	0.9476
0.96	NC	NC	NC	0.9446	0.9466
0.95	0.9186	0.9380	0.9384	0.9451	0.9468
0.94	NC	NC	NC	0.9445	0.9467
0.93	0.9130	0.9392	0.9352	0.9465	0.9460
0.92	NC	NC	NC	0.9458	0.9450
0.91	NC	NC	NC	0.9447	0.9452
0.90	0.9061	0.9384	NC	0.9449	0.9454
0.80	0.8774	0.9322	NC	0.9431	0.9390
0.70	0.8457	0.9190	NC	0.9339	0.9259
0.60	0.8095	0.8990	NC	0.9194	0.9058
0.40	0.7225	0.8280	NC	0.8575	0.8410
0.20	0.6131	0.7002	NC	0.7421	0.7271
0.10	0.5486	0.6178	NC	0.6662	0.6584

[†] External moderator is modeled at 0%. This is consistent with the results demonstrated in Table 6.4.1.

^{††} NC: Not Calculated

Table 6.4.7

MAXIMUM k_{eff} VALUES FOR INTACT BWR FUEL ASSEMBLIES WITH A MAXIMUM PLANAR AVERAGE ENRICHMENT OF 3.7 wt% ^{235}U

Fuel Assembly Class	Maximum k_{eff}
6x6A	0.8287
6x6C	0.8436
7x7A	0.8399
7x7B	0.9109
8x8A	0.8102
8x8B	0.9131
8x8C	0.9115
8x8D	0.9125
8x8E	0.9049
8x8F	0.9233
9x9A	0.9111
9x9B	0.9134
9x9C	0.9103
9x9D	0.9096
9x9E	0.9237
9x9F	0.9237
9x9G	0.9005
10x10A	0.9158
10x10B	0.9156
10x10C	0.9152
10x10D	0.9182
10x10E	0.8970

Table 6.4.8

MAXIMUM k_{eff} VALUES IN THE GENERIC BWR DAMAGED FUEL CONTAINER FOR A
 MAXIMUM INITIAL ENRICHMENT OF 4.0 wt% ^{235}U FOR DAMAGED FUEL AND 3.7
 wt% ^{235}U FOR INTACT FUEL

Model Configuration inside the DFC	Maximum k_{eff}
Intact Assemblies (4 assemblies analyzed)	0.9241
Assemblies with missing rods (7 configurations analyzed)	0.9240
Assemblies with distributed enrichment (4 configurations analyzed)	0.9245
Collapsed Assemblies (6 configurations analyzed)	0.9258
Regular Arrays of Bare Fuel Rods (31 configurations analyzed)	0.9328

Table 6.4.9

MAXIMUM k_{eff} VALUES IN THE GENERIC PWR DAMAGED FUEL CONTAINER FOR A
MAXIMUM INITIAL ENRICHMENT OF 4.0 wt% ^{235}U .

Model Configuration inside the DFC	Maximum k_{eff}
Intact Assemblies (2 assemblies analyzed)	0.9340
Assemblies with missing rods (4 configurations analyzed)	0.9350
Collapsed Assemblies (6 configurations analyzed)	0.9360
Regular Arrays of Bare Fuel Rods (36 configurations analyzed)	0.9480

Table 6.4.10

MAXIMUM k_{eff} VALUES WITH FILLED AND VOIDED GUIDE TUBES

Fuel Class	MPC-32 (2600ppm)@ 5.0 %	
	Guide Tubes Filled, Moderator Density 0.93	Guide Tubes Voided, Moderator Density 1.00
14x14A	0.8362	0.8326
14x14B	0.8633	0.8585
14x14C	0.8808	0.8901
14x14D	0.8485	0.8413
14x14E	0.6240	0.6240
15x15A	0.9121	0.9094
15x15B	0.9286	0.9313
15x15C	0.9150	0.9181
15x15D	0.9419	0.9466
15x15E	0.9415	0.9434
15x15F	0.9465	0.9483
15x15G	0.9109	0.9135
15X15H	0.9301	0.9317
16X16A	0.8868	0.8924
17x17A	0.9145	0.9160
17x17B	0.9358	0.9371
17X17C	0.9431	0.9437