




# Generic Environmental Impact Statement for License Renewal of Nuclear Plants



Supplement 11



Regarding  
St. Lucie Units 1 and 2



Draft Report for Comment



U.S. Nuclear Regulatory Commission  
Office of Nuclear Reactor Regulation  
Washington, DC 20555-0001



## AVAILABILITY OF REFERENCE MATERIALS IN NRC PUBLICATIONS

### NRC Reference Material

As of November 1999, you may electronically access NUREG-series publications and other NRC records at NRC's Public Electronic Reading Room at <http://www.nrc.gov/reading-rm.html>.

Publicly released records include, to name a few, NUREG-series publications; *Federal Register* notices; applicant, licensee, and vendor documents and correspondence; NRC correspondence and internal memoranda; bulletins and information notices; inspection and investigative reports; licensee event reports; and Commission papers and their attachments.

NRC publications in the NUREG series, NRC regulations, and *Title 10, Energy*, in the Code of *Federal Regulations* may also be purchased from one of these two sources.

1. The Superintendent of Documents  
U.S. Government Printing Office  
Mail Stop SSOP  
Washington, DC 20402-0001  
Internet: [bookstore.gpo.gov](http://bookstore.gpo.gov)  
Telephone: 202-512-1800  
Fax: 202-512-2250
2. The National Technical Information Service  
Springfield, VA 22161-0002  
[www.ntis.gov](http://www.ntis.gov)  
1-800-553-6847 or, locally, 703-605-6000

A single copy of each NRC draft report for comment is available free, to the extent of supply, upon written request as follows:

Address: Office of the Chief Information Officer,  
Reproduction and Distribution  
Services Section  
U.S. Nuclear Regulatory Commission  
Washington, DC 20555-0001  
E-mail: [DISTRIBUTION@nrc.gov](mailto:DISTRIBUTION@nrc.gov)  
Facsimile: 301-415-2289

Some publications in the NUREG series that are posted at NRC's Web site address <http://www.nrc.gov/reading-rm/doc-collections/nuregs> are updated periodically and may differ from the last printed version. Although references to material found on a Web site bear the date the material was accessed, the material available on the date cited may subsequently be removed from the site.

### Non-NRC Reference Material

Documents available from public and special technical libraries include all open literature items, such as books, journal articles, and transactions, *Federal Register* notices, Federal and State legislation, and congressional reports. Such documents as theses, dissertations, foreign reports and translations, and non-NRC conference proceedings may be purchased from their sponsoring organization.

Copies of industry codes and standards used in a substantive manner in the NRC regulatory process are maintained at—

The NRC Technical Library  
Two White Flint North  
11545 Rockville Pike  
Rockville, MD 20852-2738

These standards are available in the library for reference use by the public. Codes and standards are usually copyrighted and may be purchased from the originating organization or, if they are American National Standards, from—

American National Standards Institute  
11 West 42<sup>nd</sup> Street  
New York, NY 10036-8002  
[www.ansi.org](http://www.ansi.org)  
212-642-4900

Legally binding regulatory requirements are stated only in laws; NRC regulations; licenses, including technical specifications; or orders, not in NUREG-series publications. The views expressed in contractor-prepared publications in this series are not necessarily those of the NRC.

The NUREG series comprises (1) technical and administrative reports and books prepared by the staff (NUREG-XXXX) or agency contractors (NUREG/CR-XXXX), (2) proceedings of conferences (NUREG/CP-XXXX), (3) reports resulting from international agreements (NUREG/IA-XXXX), (4) brochures (NUREG/BR-XXXX), and (5) compilations of legal decisions and orders of the Commission and Atomic and Safety Licensing Boards and of Directors' decisions under Section 2.206 of NRC's regulations (NUREG-0750).

**Generic Environmental  
Impact Statement for  
License Renewal of  
Nuclear Plants**

**Supplement 11**

**Regarding  
St. Lucie Units 1 and 2**

**Draft Report for Comment**

---

---

Manuscript Completed: September 2002

Date Published: October 2002

**Division of Regulatory Improvement Programs  
Office of Nuclear Reactor Regulation  
U.S. Nuclear Regulatory Commission  
Washington, DC 20555-0001**



## COMMENTS ON DRAFT REPORT

Any interested party may submit comments on this report for consideration by the NRC staff. Comments may be accompanied by additional relevant information or supporting data. Please specify the report number NUREG-1437, Supplement 11, draft, in your comments, and send them by January 15, 2003 to the following address:

Chief, Rules Review and Directives Branch  
U.S. Nuclear Regulatory Commission  
Mail Stop T6-D59  
Washington, DC 20555-0001

Electronic comments may be submitted by the Internet at *StLucieDSEIS@nrc.gov*.

For any questions about the material in this report, please contact:

Dr. Michael T. Masnik  
U.S. Nuclear Regulatory Commission  
Mail Stop O12-D3  
Washington, DC 20555-0001  
Phone: 301-415-1191  
E-mail: *MTM2@nrc.gov*

# Abstract

1  
2  
3  
4 The U.S. Nuclear Regulatory Commission (NRC) considered the environmental impacts of  
5 renewing nuclear power plant operating licenses (OLs) for a 20-year period in its *Generic*  
6 *Environmental Impact Statement for License Renewal of Nuclear Plants* (GEIS), NUREG-1437,  
7 Volumes 1 and 2, and codified the results in 10 CFR Part 51. In the GEIS (and its  
8 Addendum 1), the staff identifies 92 environmental issues and reaches generic conclusions  
9 related to environmental impacts for 69 of these issues that apply to all plants or to plants with  
10 specific design or site characteristics. Additional plant-specific review is required for the  
11 remaining 23 issues. These plant-specific reviews are to be included in a supplement to the  
12 GEIS.

13  
14 This draft supplemental environmental impact statement (SEIS) has been prepared in response  
15 to an application submitted to the NRC by the Florida Power and Light Company (FPL) to renew  
16 the OLs for St. Lucie Units 1 and 2 for an additional 20 years under 10 CFR Part 54. This draft  
17 SEIS includes the NRC staff's analysis that considers and weighs the environmental impacts of  
18 the proposed action, the environmental impacts of alternatives to the proposed action, and  
19 mitigation measures available for reducing or avoiding adverse impacts. It also includes the  
20 staff's preliminary recommendation regarding the proposed action.

21  
22 Neither FPL nor the staff has identified information that is both new and significant for any issue  
23 for which the GEIS reached generic conclusions that applies to St. Lucie Units 1 and 2. The  
24 staff determined that information provided during the scoping process did not call into question  
25 the conclusions in the GEIS. Therefore, the staff concludes that the impacts of renewing the  
26 St. Lucie OLs will not be greater than impacts identified for these issues in the GEIS. For each  
27 of these issues, the staff's conclusion in the GEIS is that the impact is of SMALL<sup>(a)</sup> significance  
28 (except for collective offsite radiological impacts from the fuel cycle and from high-level waste  
29 and spent fuel, which were not assigned a single significance level).

30  
31 Each of the remaining issues that applies to St. Lucie Units 1 and 2 is addressed in detail in this  
32 draft SEIS. For each applicable issue, the staff concludes that the significance of the potential  
33 environmental impacts of renewal of the OLs is SMALL. The staff also concludes that  
34 additional mitigation measures are not likely to be sufficiently beneficial as to be warranted.  
35 The staff determined that information provided during the scoping process did not identify any  
36 new issue that has a significant environmental impact.

37  
38 The NRC staff's preliminary recommendation is that the Commission determine that the  
39 adverse environmental impacts of license renewal for St. Lucie Units 1 and 2 are not so great

---

(a) Environmental effects are not detectable or are so minor that they will neither destabilize nor noticeably alter any important attribute of the resource.

## Abstract

1 that preserving the option of license renewal for energy-planning decisionmakers would be  
2 unreasonable. This recommendation is based on (1) the analysis and findings in the GEIS;  
3 (2) the Environmental Report submitted by FPL; (3) consultation with Federal, State, and local  
4 agencies; (4) the staff's own independent review; and (5) the staff's consideration of public  
5 comments received during the scoping process.  
6  
7

# Contents

1  
2  
3  
4  
5  
6  
7  
8  
9  
10  
11  
12  
13  
14  
15  
16  
17  
18  
19  
20  
21  
22  
23  
24  
25  
26  
27  
28  
29  
30  
31  
32  
33  
34  
35  
36  
37  
38  
39  
40  
41  
42

Abstract .....	iii
Executive Summary .....	xv
Abbreviations/Acronyms .....	xxi
1.0 Introduction .....	1-1
1.1 Report Contents .....	1-1
1.2 Background .....	1-2
1.2.1 Generic Environmental Impact Statement .....	1-3
1.2.2 License Renewal Evaluation Process .....	1-4
1.3 The Proposed Federal Action .....	1-7
1.4 The Purpose and Need for the Proposed Action .....	1-7
1.5 Compliance and Consultations .....	1-8
1.6 References .....	1-9
2.0 Description of Nuclear Power Plant and Site and Plant Interaction with the Environment .....	2-1
2.1 Plant and Site Description and Proposed Plant Operation During the Renewal Term .....	2-1
2.1.1 External Appearance and Setting .....	2-5
2.1.2 Reactor Systems .....	2-5
2.1.3 Cooling and Auxiliary Water Systems .....	2-7
2.1.4 Radioactive Waste Management Systems and Effluent Control Systems .....	2-10
2.1.4.1 Liquid Waste Processing Systems and Effluent Controls .....	2-11
2.1.4.2 Gaseous Waste Processing Systems and Effluent Controls ..	2-12
2.1.4.3 Solid Waste Processing .....	2-13
2.1.5 Nonradioactive Waste Systems .....	2-13
2.1.6 Plant Operation and Maintenance .....	2-14
2.1.7 Power Transmission System .....	2-14

Contents

1           2.2 Plant Interaction with the Environment ..... 2-15  
2  
3           2.2.1 Land Use ..... 2-15  
4           2.2.2 Water Use ..... 2-16  
5           2.2.3 Water Quality ..... 2-16  
6           2.2.4 Air Quality ..... 2-17  
7           2.2.5 Aquatic Resources ..... 2-18  
8  
9                 2.2.5.1 Atlantic Ocean ..... 2-18  
10                2.2.5.2 Indian River Lagoon ..... 2-21  
11                2.2.5.3 Threatened or Endangered Aquatic Species ..... 2-22  
12  
13           2.2.6 Terrestrial Resources ..... 2-24  
14           2.2.7 Radiological Impacts ..... 2-32  
15           2.2.8 Socioeconomic Factors ..... 2-34  
16  
17                 2.2.8.1 Housing ..... 2-34  
18                 2.2.8.2 Public Services ..... 2-36  
19                 2.2.8.3 Offsite Land Use ..... 2-38  
20                 2.2.8.4 Visual Aesthetics and Noise ..... 2-40  
21                 2.2.8.5 Demography ..... 2-40  
22                 2.2.8.6 Taxes ..... 2-42  
23  
24           2.2.9 Historic and Archaeological Resources ..... 2-43  
25  
26                 2.2.9.1 Cultural Background ..... 2-43  
27                 2.2.9.2 Historic and Archaeological Resources at St. Lucie Site ..... 2-47  
28  
29           2.2.10 Related Federal Project Activities and Consultations ..... 2-47  
30  
31           2.3 References ..... 2-48  
32  
33           3.0 Environmental Impacts of Refurbishment ..... 3-1  
34  
35           3.1 References ..... 3-3  
36  
37           4.0 Environmental Impacts of Operation ..... 4-1  
38  
39           4.1 Cooling Systems ..... 4-2  
40  
41                 4.1.1 Entrainment of Fish and Shellfish in Early Life Stages ..... 4-10  
42                 4.1.2 Impingement of Fish and Shellfish ..... 4-11

1	4.1.3 Heat Shock .....	4-13
2		
3	4.2 Transmission Lines .....	4-13
4		
5	4.2.1 Electromagnetic Fields – Acute Effects .....	4-17
6	4.2.2 Electromagnetic Fields – Chronic Effects .....	4-18
7		
8	4.3 Radiological Impacts of Normal Operations .....	4-19
9	4.4 Socioeconomic Impacts of Plant Operations During the License	
10	Renewal Period .....	4-20
11		
12	4.4.1 Housing Impacts During Operations .....	4-22
13	4.4.2 Public Services: Public Utility Impacts During Operations .....	4-24
14	4.4.3 Offsite Land Use During Operations .....	4-25
15	4.4.4 Public Services: Transportation Impacts During Operations .....	4-26
16	4.4.5 Historic and Archaeological Resources .....	4-27
17	4.4.6 Environmental Justice .....	4-28
18		
19	4.5 Groundwater Use and Quality .....	4-31
20	4.6 Threatened or Endangered Species .....	4-33
21		
22	4.6.1 Aquatic Species .....	4-34
23		
24	4.6.1.1 Turtles .....	4-34
25	4.6.1.2 Mammals .....	4-37
26	4.6.1.3 Johnson's Seagrass .....	4-38
27	4.6.1.4 Fish .....	4-39
28		
29	4.6.2 Terrestrial Species .....	4-39
30	4.6.3 Conclusion .....	4-40
31		
32	4.7 Evaluation of Potential New and Significant Information on Impacts of	
33	Operations During the Renewal Term .....	4-41
34	4.8 Summary of Impacts of Operations During the Renewal Term .....	4-41
35	4.9 References .....	4-42
36		
37	5.0 Environmental Impacts of Postulated Accidents .....	5-1
38		
39	5.1 Postulated Plant Accidents .....	5-1
40		
41	5.1.1 Design-Basis Accidents .....	5-2

## Contents

1	5.1.2 Severe Accidents . . . . .	5-3
2		
3	5.2 Severe Accident Mitigation Alternatives . . . . .	5-4
4		
5	5.2.1 Introduction . . . . .	5-5
6	5.2.2 Estimate of Risk for St. Lucie Units 1 and 2 . . . . .	5-5
7		
8	5.2.2.1 FPL's Risk Estimates . . . . .	5-6
9	5.2.2.2 Review of FPL's Risk Estimates . . . . .	5-8
10		
11	5.2.3 Potential Design Improvements . . . . .	5-13
12		
13	5.2.3.1 Process for Identifying Potential Design Improvements . . . . .	5-13
14	5.2.3.2 Staff Evaluation . . . . .	5-14
15	5.2.3.3 Risk Reduction Potential of Design Improvements . . . . .	5-16
16	5.2.3.4 Cost Impacts of Candidate Design Improvements . . . . .	5-19
17		
18	5.2.4 Cost-Benefit Comparison . . . . .	5-19
19	5.2.5 Conclusions . . . . .	5-24
20		
21	5.3 References . . . . .	5-25
22		
23	6.0 Environmental Impacts of the Uranium Fuel Cycle and Solid Waste Management . . . . .	6-1
24		
25	6.1 The Uranium Fuel Cycle . . . . .	6-2
26	6.2 References . . . . .	6-9
27		
28	7.0 Environmental Impacts of Decommissioning . . . . .	7-1
29		
30	7.1 References . . . . .	7-4
31		
32	8.0 Environmental Impacts of Alternatives to Operating License Renewal . . . . .	8-1
33		
34	8.1 No-Action Alternative . . . . .	8-1
35		
36	8.1.1 Land Use . . . . .	8-3
37	8.1.2 Ecology . . . . .	8-3
38	8.1.3 Water Use and Quality . . . . .	8-4
39	8.1.4 Air Quality . . . . .	8-4
40	8.1.5 Waste . . . . .	8-4
41	8.1.6 Human Health . . . . .	8-5
42	8.1.7 Socioeconomics . . . . .	8-5

1	8.1.8 Aesthetics .....	8-6
2	8.1.9 Historic and Archaeological Resources .....	8-6
3	8.1.10 Environmental Justice .....	8-6
4		
5	8.2 Alternative Energy Sources .....	8-7
6		
7	8.2.1 Coal-Fired Generation .....	8-9
8		
9	8.2.1.1 Closed-Cycle Cooling System .....	8-11
10	8.2.1.2 Once-Through Cooling System .....	8-21
11		
12	8.2.2 Natural Gas-Fired Generation .....	8-21
13		
14	8.2.2.1 Closed-Cycle Cooling System .....	8-23
15	8.2.2.2 Once-Through Cooling System .....	8-28
16		
17	8.2.3 Nuclear Power Generation .....	8-29
18		
19	8.2.3.1 Closed-Cycle Cooling System .....	8-30
20	8.2.3.2 Once-Through Cooling System .....	8-34
21		
22	8.2.4 Purchased Electrical Power .....	8-35
23		
24	8.2.5 Other Alternatives .....	8-36
25		
26	8.2.5.1 Oil-Fired Generation .....	8-36
27	8.2.5.2 Wind Power .....	8-36
28	8.2.5.3 Solar Power .....	8-37
29	8.2.5.4 Hydropower .....	8-37
30	8.2.5.5 Geothermal Energy .....	8-38
31	8.2.5.6 Wood Waste .....	8-38
32	8.2.5.7 Municipal Solid Waste .....	8-39
33	8.2.5.8 Other Biomass-Derived Fuels .....	8-40
34	8.2.5.9 Fuel Cells .....	8-40
35	8.2.5.10 Delayed Retirement .....	8-40
36	8.2.5.11 Utility-Sponsored Conservation .....	8-41
37		
38	8.2.6 Combination of Alternatives .....	8-42
39		
40	8.3 Summary of Alternatives Considered .....	8-44
41		

Contents

1	8.4	References	8-45
2			
3	9.0	Summary and Conclusions	9-1
4			
5	9.1	Environmental Impacts of the Proposed Action – License Renewal	9-4
6			
7	9.1.1	Unavoidable Adverse Impacts	9-5
8	9.1.2	Irreversible or Irretrievable Resource Commitments	9-6
9	9.1.3	Short-Term Use Versus Long-Term Productivity	9-6
10			
11	9.2	Relative Significance of the Environmental Impacts of License Renewal	
12		and Alternatives	9-7
13	9.3	Staff Conclusions and Recommendations	9-7
14	9.4	References	9-9
15			

1	Appendix A -	Comments Received on the Environmental Review . . . . .	A-1
2	Appendix B -	Contributors to the Supplement . . . . .	B-1
3	Appendix C -	Chronology of NRC Staff Environmental Review Correspondence	
4		Related to the Florida Power and Light Company's Application for	
5		License Renewal of St. Lucie Units 1 and 2 . . . . .	C-1
6	Appendix D -	Organizations Contacted . . . . .	D-1
7	Appendix E -	Florida Power and Light Company's Compliance Status and	
8		Consultation Correspondence . . . . .	E-1
9	Appendix F -	GEIS Environmental Issues Not Applicable to St. Lucie Units 1 and 2 .	F-1

# Figures

1		
2		
3		
4	2-1	Location of St. Lucie Units 1 and 2, 80-km (50-mi) Region ..... 2-2
5	2-2	Location of St. Lucie Units 1 and 2, 10-km (6-mi) Region ..... 2-3
6	2-3	St. Lucie Units 1 and 2, Site Boundary ..... 2-4
7	2-4	St. Lucie Units 1 and 2, Power Block Area ..... 2-6
8		
9	4-1	Geographic Distribution of Minority Populations (shown in shaded areas) Within 80 km
10		(50 mi) of the St. Lucie Site Based on Census Block Group Data ..... 4-30
11	4-2	Geographic Distribution of Low-Income Populations (shown in shaded areas) Within
12		80 km (50 mi) of the St. Lucie Site Based on Census Block Group Data ..... 4-32

# Tables

1		
2		
3		
4	2-1	Calculated Flow Velocities at Various Points in the Intake System
5		of St. Lucie Units 1 and 2 . . . . . 2-9
6	2-2	Federally Listed and Florida State-Listed Aquatic Species Potentially Occurring in
7		Miami-Dade and Monroe Counties . . . . . 2-23
8	2-3	Terrestrial Species Listed as Endangered or Threatened by the U.S. Fish and Wildlife
9		Service that Have Been Reported to Occur Within St. Lucie County, Florida . . . . . 2-26
10	2-4	Additional Terrestrial Species Listed by the State of Florida as Endangered, Threatened,
11		or of Special Concern that Have Been Reported in St. Lucie County . . . . . 2-30
12	2-5	St. Lucie Units 1 and 2, Employee and Contract Employee Residence by County . . . 2-34
13	2-6	Total Occupied and Vacant (Available) Housing Units by County 1990 and 2000 . . . 2-35
14	2-7	Population Growth in Martin and St. Lucie Counties, 1970 to 2020 . . . . . 2-35
15	2-8	Major Public Water Supply Systems in Martin and St. Lucie Counties . . . . . 2-36
16	2-9	Land Use in St. Lucie and Martin Counties, Florida . . . . . 2-38
17	2-10	Major Employment Sectors in St. Lucie and Martin Counties (2000) . . . . . 2-41
18	2-11	Property Taxes Paid to St. Lucie County by FPL for St. Lucie Units 1 and 2 . . . . . 2-42
19		
20	3-1	Category 1 Issues for Refurbishment Evaluation . . . . . 3-2
21	3-2	Category 2 Issues for Refurbishment Evaluation . . . . . 3-3
22		
23	4-1	Category 1 Issues Applicable to the Operation of the St. Lucie Units 1 and 2
24		Cooling System During the Renewal Term . . . . . 4-2
25	4-2	Category 2 Issues Applicable to the Operation of the St. Lucie Units 1 and 2 Cooling
26		System During the Renewal Term . . . . . 4-9
27	4-3	Category 1 Issues Applicable to the St. Lucie Transmission Lines During the
28		Renewal Term . . . . . 4-14
29	4-4	Chronic Effects of Electromagnetic Fields and GEIS Category 2 Issue Applicable to
30		the St. Lucie Transmission Lines During the Renewal Term . . . . . 4-17
31	4-5	Category 1 Issues Applicable to Radiological Impacts of Normal Operations
32		During the Renewal Term . . . . . 4-19
33	4-6	Category 1 Issues Applicable to Socioeconomics During the Renewal Term . . . . . 4-20
34	4-7	Environmental Justice and GEIS Category 2 Issues Applicable to
35		Socioeconomics During the Renewal Term . . . . . 4-22
36	4-8	Category 2 Issue Applicable to Groundwater Use and Quality During the
37		Renewal Term . . . . . 4-33
38	4-9	Category 2 Issue Applicable to Threatened or Endangered Species During the
39		Renewal Term . . . . . 4-33
40		
41	5-1	Category 1 Issue Applicable to Postulated Accidents During the Renewal Term . . . . . 5-3
42	5-2	Category 2 Issue Applicable to Postulated Accidents During the Renewal Term . . . . . 5-4
43	5-3	St. Lucie Core Damage Frequency . . . . . 5-7
44	5-4	Breakdown of Population Dose by Containment Release Mode . . . . . 5-8

1	5-5	SAMA Cost/Benefit Screening Analysis .....	5-17
2	5-6	Uncertainty in the Calculated CDF for St. Lucie Units 1 and 2 .....	5-23
3			
4	6-1	Category 1 Issues Applicable to the Uranium Fuel Cycle and Solid Waste Management During the Renewal Term .....	6-2
5			
6			
7	7-1	Category 1 Issues Applicable to the Decommissioning of St. Lucie Units 1 and 2 Following the Renewal Term .....	7-2
8			
9			
10	8-1	Summary of Environmental Impacts of the No-Action Alternative .....	8-3
11	8-2	Summary of Environmental Impacts of Coal-Fired Generation Using Closed- Cycle Cooling at an Alternate Florida Site .....	8-12
12			
13	8-3	Summary of Environmental Impacts of Coal-Fired Generation at an Alternate Florida Site with Once-Through Cooling .....	8-21
14			
15	8-4	Summary of Environmental Impacts of Natural Gas-Fired Generation Using Closed- Cycle Cooling at an Alternate Florida Site .....	8-22
16			
17	8-5	Summary of Environmental Impacts of Natural Gas-Fired Generation with Once-Through Cooling at an Alternate Florida Site .....	8-29
18			
19	8-6	Summary of Environmental Impacts of a New Nuclear Generation Using Closed- Cycle Cooling at an Alternate Florida Site .....	8-31
20			
21	8-7	Summary of Environmental Impacts of New Nuclear Power Generation Using Once- Through Cooling at an Alternate Florida Site .....	8-35
22			
23	8-8	Summary of Environmental Impacts for an Assumed Combination of Generating and Acquisition Alternatives .....	8-43
24			
25			
26	9-1	Summary of Environmental Significance of License Renewal, the No-Action Alternative, and Alternative Methods of Generation Using Closed-Cycle Cooling .....	9-8
27			
28			
29	E-1	Federal, State, Local, and Regional Licenses, Permits, Consultations, and Other Approvals for St. Lucie Units 1 and 2 .....	E-2
30			
31			
32	F-1	GEIS Environmental Issues Not Applicable to St. Lucie Units 1 and 2 .....	F-1

# Executive Summary

1  
2  
3  
4 By letter dated November 29, 2001, the Florida Power and Light Company (FPL) submitted an  
5 application to the U.S. Nuclear Regulatory Commission (NRC) to renew the operating licenses  
6 (OLs) for St. Lucie Units 1 and 2 for an additional 20-year period. If the OLs are renewed, State  
7 regulatory agencies and FPL will ultimately decide whether the plant will continue to operate  
8 based on factors such as the need for power or other matters within the State's jurisdiction or  
9 the purview of the owners. If the OLs are not renewed, then the plant must be shut down at or  
10 before the expiration dates of the current OLs, which are March 1, 2016, for Unit 1, and  
11 April 6, 2023, for Unit 2.

12  
13 Section 102 of the National Environmental Policy Act (NEPA) (42 USC 4321) directs that an  
14 environmental impact statement (EIS) is required for major Federal actions that significantly  
15 affect the quality of the human environment. The NRC has implemented Section 102 of NEPA  
16 in 10 CFR Part 51. Part 51 identifies licensing and regulatory actions that require an EIS. In  
17 10 CFR 51.20(b)(2), the Commission requires preparation of an EIS or a supplement to an EIS  
18 for renewal of a reactor OL; 10 CFR 51.95(c) states that the EIS prepared at the OL renewal  
19 stage will be a supplement to the *Generic Environmental Impact Statement for License  
20 Renewal of Nuclear Plants* (GEIS), NUREG-1437, Volumes 1 and 2.<sup>(a)</sup>

21  
22 Upon acceptance of the FPL application, the NRC staff began the environmental review  
23 process described in 10 CFR Part 51 by publishing a notice of intent to prepare an EIS and  
24 conduct scoping. The staff visited the St. Lucie site in April 2002 and held public scoping  
25 meetings on April 3, 2002, in Port St. Lucie, Florida. In the preparation of this draft  
26 Supplemental Environmental Impact Statement (SEIS) for St. Lucie Units 1 and 2, the staff  
27 reviewed the FPL Environmental Report (ER) and compared it to the GEIS, consulted with other  
28 agencies, conducted an independent review of the issues following the guidance set forth in  
29 NUREG-1555, Supplement 1, the *Standard Review Plans for Environmental Reviews for  
30 Nuclear Power Plants, Supplement 1: Operating License Renewal*, and considered the public  
31 comments received during the scoping process. The comments that were considered to be  
32 within the scope of the environmental review are provided in Appendix A, Part I, of this SEIS.

33  
34 The staff will hold two public meetings in Port St. Lucie, Florida, in December 2002, to describe  
35 the preliminary results of the NRC environmental review, answer questions, and provide  
36 members of the public with information to assist them in formulating comments on this SEIS.  
37 When the comment period ends, the staff will consider and disposition all of the comments  
38 received. These comments will be addressed in Appendix A, Part II, of this SEIS.  
39

---

1 (a) The GEIS was originally issued in 1996. Addendum 1 to the GEIS was issued in 1999.  
2 Hereafter, all references to the "GEIS" include the GEIS and its Addendum 1.

## Executive Summary

1 This draft SEIS includes the NRC staff's preliminary analysis that considers and weighs the  
2 environmental effects of the proposed action, the environmental impacts of alternatives to the  
3 proposed action, and mitigation measures for reducing or avoiding adverse effects. It also  
4 includes the staff's preliminary recommendation regarding the proposed action.

5  
6 The Commission has adopted the following statement of purpose and need for license renewal  
7 from the GEIS:

8  
9 The purpose and need for the proposed action (renewal of an operating license) is to  
10 provide an option that allows for power generation capability beyond the term of a current  
11 nuclear power plant operating license to meet future system generating needs, as such  
12 needs may be determined by State, utility, and, where authorized, Federal (other than NRC)  
13 decisionmakers.

14  
15 The goal of the staff's environmental review, as defined in 10 CFR 51.95(c)(4) and the GEIS, is  
16 to determine

17  
18 ... whether or not the adverse environmental impacts of license renewal are so great that  
19 preserving the option of license renewal for energy planning decisionmakers would be  
20 unreasonable.

21  
22 Both the statement of purpose and need and the evaluation criterion implicitly acknowledge that  
23 there are factors, in addition to license renewal, that will ultimately determine whether an  
24 existing nuclear power plant continues to operate beyond the period of the current OL.

25  
26 NRC regulations [10 CFR 51.95(c)(2)] contain the following statement regarding the content of  
27 SEISs prepared at the license renewal stage:

28  
29 The supplemental environmental impact statement for license renewal is not required to  
30 include discussion of need for power or the economic costs and economic benefits of the  
31 proposed action or of alternatives to the proposed action except insofar as such benefits  
32 and costs are either essential for a determination regarding the inclusion of an alternative in  
33 the range of alternatives considered or relevant to mitigation. In addition, the supplemental  
34 environmental impact statement prepared at the license renewal stage need not discuss  
35 other issues not related to the environmental effects of the proposed action and the  
36 alternatives, or any aspect of the storage of spent fuel for the facility within the scope of the  
37 generic determination in § 51.23(a) ["Temporary storage of spent fuel after cessation of  
38 reactor operation—generic determination of no significant environmental impact"] and in  
39 accordance with § 51.23(b).

40

1 The GEIS contains the results of a systematic evaluation of the consequences of renewing an  
2 OL and operating a nuclear power plant for an additional 20 years. It evaluates  
3 92 environmental issues using the NRC's three-level standard of significance—SMALL,  
4 MODERATE, or LARGE—developed using the Council on Environmental Quality guidelines.  
5 The following definitions of the three significance levels are set forth in footnotes to Table B-1 of  
6 10 CFR Part 51, Subpart A, Appendix B:

7  
8 **SMALL** – Environmental effects are not detectable or are so minor that they will neither  
9 destabilize nor noticeably alter any important attribute of the resource.

10  
11 **MODERATE** – Environmental effects are sufficient to alter noticeably, but not to  
12 destabilize, important attributes of the resource.

13  
14 **LARGE** – Environmental effects are clearly noticeable and are sufficient to destabilize  
15 important attributes of the resource.

16  
17 For 69 of the 92 issues considered in the GEIS, the analysis in the GEIS reached the following  
18 conclusions:

- 19  
20 (1) The environmental impacts associated with the issue have been determined to apply either  
21 to all plants or, for some issues, to plants having a specific type of cooling system or other  
22 specified plant or site characteristics.  
23  
24 (2) A single significance level (i.e., SMALL, MODERATE, or LARGE) has been assigned to the  
25 impacts (except for collective offsite radiological impacts from the fuel cycle and from high-  
26 level waste and spent fuel disposal).  
27  
28 (3) Mitigation of adverse impacts associated with the issue has been considered in the analysis,  
29 and it has been determined that additional plant-specific mitigation measures are not likely  
30 to be sufficiently beneficial to warrant implementation.

31  
32 These 69 issues were identified in the GEIS as Category 1 issues. In the absence of new and  
33 significant information, the staff relied on conclusions as amplified by supporting information in  
34 the GEIS for issues designated as Category 1 in Table B-1 of 10 CFR Part 51, Subpart A,  
35 Appendix B.

36  
37 Of the 23 issues that do not meet the criteria set forth above, 21 are classified as Category 2  
38 issues requiring analysis in a plant-specific supplement to the GEIS. The remaining two issues,

## Executive Summary

1 environmental justice and chronic effects of electromagnetic fields, were not categorized.  
2 Environmental justice was not evaluated on a generic basis and must be addressed in a plant-  
3 specific supplement to the GEIS. Information on the chronic effects of electromagnetic fields  
4 was not conclusive at the time the GEIS was prepared.  
5

6 This draft SEIS documents the staff's evaluation of all 92 environmental issues considered in  
7 the GEIS. The staff considered the environmental impacts associated with alternatives to  
8 license renewal and compared the environmental impacts of license renewal and the  
9 alternatives. The alternatives to license renewal that were considered include the no-action  
10 alternative (not renewing the OLs for St. Lucie Units 1 and 2) and alternative methods of power  
11 generation. Based on projections made by the U.S. Department of Energy's (DOE's) Energy  
12 Information Administration (EIA), gas- and coal-fired generation appear to be the most likely  
13 power-generation alternatives if the power from Units 1 and 2 is replaced. These alternatives  
14 are evaluated assuming that the replacement power generation plant is located at an  
15 unspecified alternate location in Florida.  
16

17 FPL and the staff have established independent processes for identifying and evaluating the  
18 significance of any new information on the environmental impacts of license renewal. Neither  
19 FPL nor the staff has identified information that is both new and significant related to Category  
20 1 issues that would call into question the conclusions in the GEIS. Similarly, neither the  
21 scoping process nor the staff has identified any new issue applicable to St. Lucie Units 1 and 2  
22 that has a significant environmental impact. Therefore, the staff relies upon the conclusions of  
23 the GEIS for all of the Category 1 issues that are applicable to St. Lucie Units 1 and 2.  
24

25 FPL's license renewal application presents an analysis of the Category 2 issues plus  
26 environmental justice and chronic effects from electromagnetic fields. The staff has reviewed  
27 the FPL analysis for each issue and has conducted an independent review of each issue. Five  
28 Category 2 issues are not applicable, because they are related to plant design features or site  
29 characteristics not found at St. Lucie. Four Category 2 issues are not discussed in this draft  
30 SEIS, because they are specifically related to refurbishment. FPL has stated that its evaluation  
31 of structures and components, as required by 10 CFR 54.21, did not identify any major plant  
32 refurbishment activities or modifications as necessary to support the continued operation of  
33 St. Lucie Units 1 and 2 for the license renewal period. In addition, any replacement of  
34 components or additional inspection activities are within the bounds of normal plant component  
35 replacement, and therefore, are not expected to affect the environment outside of the bounds of  
36 the plant operations evaluated in the U.S. Atomic Energy Commission's 1973 Final  
37 Environmental Statement Related to Operation of St. Lucie Plant Unit No. 1 and U.S. Nuclear  
38 Regulatory Commission's 1982 Final Environmental Statement Related to Operation of St.  
39 Lucie Plant, Unit No. 2.  
40

1 Twelve Category 2 issues related to operational impacts and postulated accidents during the  
2 renewal term, as well as environmental justice and chronic effects of electromagnetic fields, are  
3 discussed in detail in this draft SEIS. For all 12 Category 2 issues and environmental justice,  
4 the staff concludes that the potential environmental effects are of SMALL significance in the  
5 context of the standards set forth in the GEIS. In addition, the staff determined that appropriate  
6 Federal health agencies have not reached a consensus on the existence of chronic adverse  
7 effects from electromagnetic fields. Therefore, no further evaluation of this issue is required.  
8 For severe accident mitigation alternatives (SAMAs), the staff concludes that a reasonable,  
9 comprehensive effort was made to identify and evaluate SAMAs. Based on its review of the  
10 SAMAs for St. Lucie Units 1 and 2 and the plant improvements already made, the staff  
11 concludes that none of the candidate SAMAs are cost-beneficial.

12  
13 Mitigation measures were considered for each Category 2 issue. Current measures to mitigate  
14 the environmental impacts of plant operation were found to be adequate, and no additional  
15 mitigation measures were deemed sufficiently beneficial to be warranted.

16  
17 If the St. Lucie OLs are not renewed and the units cease operation on or before the expiration  
18 of their current OLs, then the adverse impacts of likely alternatives will not be smaller than  
19 those associated with continued operation of St. Lucie Units 1 and 2. The impacts may, in fact,  
20 be greater in some areas.

21  
22 The preliminary recommendation of the NRC staff is that the Commission determine that the  
23 adverse environmental impacts of license renewal for St. Lucie Units 1 and 2 are not so great  
24 that preserving the option of license renewal for energy planning decisionmakers would be  
25 unreasonable. This recommendation is based on (1) the analysis and findings in the GEIS;  
26 (2) the ER submitted by FPL; (3) consultation with other Federal, State, and local agencies;  
27 (4) the staff's own independent review; and (5) the staff's consideration of public comments  
28 received during the scoping process.

29

# Abbreviations/Acronyms

1		
2		
3		
4	°	degree(s)
5	μCi	microcurie(s)
6	μCi/mL	microcurie(s) per milliliter
7	μGy	microgray(s)
8	μm	micrometer(s)
9	μSv	microsievert(s)
10		
11	ac	acre(s)
12	AC	alternating current
13	AB	auxiliary building
14	ACC	averted cleanup and decontamination costs
15	AEA	Atomic Energy Act of 1954
16	AEC	U.S. Atomic Energy Commission
17	AOC	present value of averted offsite property damage costs
18	AOE	present value of averted occupational exposure
19	AOSC	present value of averted onsite costs
20	AOT	allowed outage time
21	APE	present value of averted public exposure
22	ATWS	anticipated transient without scram
23		
24	BEA	Bureau of Economic Analysis
25	Bq	becquerel(s)
26	BMT	basemat melt-through
27	Btu	British thermal unit(s)
28		
29	C	Celsius
30	CCW	component cooling water
31	CDF	core damage frequency
32	CEQ	Council on Environmental Quality
33	CFR	Code of Federal Regulations
34	CHRS	containment heat removal system
35	Ci	curie(s)
36	cm	centimeter(s)
37	CEOG	Combustion Engineering Owners Group
38	COE	cost of enhancement
39	COPC	chemicals of potential concern
40	CVCS	chemical and volume control system
41	CWA	Clean Water Act
42	CZMA	Coastal Zone Management Act
43		
44	DBA	design-basis accident

## Abbreviations/Acronyms

1	DCH	direct containment heating
2	DOE	U.S. Department of Energy
3	DOH	Department of Health
4	DPR	demonstration project reactor
5	DSM	demand-side management
6		
7	EDG	emergency diesel generator
8	EIA	Energy Information Administration (of DOE)
9	EIS	environmental impact statement
10	ELF-EMF	extremely low frequency-electromagnetic field
11	EOP	Emergency Operating Procedure
12	EPA	U.S. Environmental Protection Agency
13	EQ	equipment qualification
14	ER	Environmental Report
15	ESA	Endangered Species Act
16	ESRP	Environmental Standard Review Plan, NUREG-1555, Supplement 1, Operating License Renewal
17		
18		
19	F	Fahrenheit
20	FAA	Federal Aviation Administration
21	FES	Final Environmental Statement
22	FDEP	Florida Department of Environmental Protection
23	FFWCC	Florida Fish and Wildlife Conservation Commission
24	FNAI	Florida Natural Areas Inventory
25	FPL	Florida Power and Light Company
26	FPSC	Florida Public Service Commission
27	FR	Federal Register
28	FSAR	Final Safety Analysis Report
29	ft	foot/feet
30	FWPCA	Federal Water Pollution Control Act (also known as the Clean Water Act of 1977)
31		
32	FWS	U.S. Fish and Wildlife Service
33		
34	gal	gallon(s)
35	GDC	general design criteria
36	GEIS	Generic Environmental Impact Statement for License Renewal of Nuclear Plants, NUREG-1437
37		
38	gpm	gallons per minute
39		
40	ha	hectare(s)
41	HHSI	high head safety injection

## Abbreviations/Acronyms

1	HLW	high-level waste
2	HPSI	high pressure safety injection
3	hr	hour(s)
4	Hz	Hertz
5		
6	in.	inch(es)
7	IPE	Individual Plant Examination
8	IPEEE	Individual Plant Examination of External Events
9	ISFSI	independent spent fuel storage installation
10	ISLOCA	interfacing system loss-of-coolant accident
11		
12	J	joule(s)
13		
14	kg	kilogram(s)
15	km	kilometer(s)
16	kV	kilovolt(s)
17	kV/m	kilovolt(s) per meter
18	kWh	kilowatt hour(s)
19		
20	L	liter(s)
21	lb	pound
22	LNG	liquefied natural gas
23	LOCA	loss-of-coolant accident
24	LOOP	loss-of-offsite power
25	LOS	level-of-service (designation)
26	LWR	light-water reactor
27		
28	m	meter(s)
29	m/s	meter(s) per second
30	m <sup>3</sup> /d	cubic meter(s) per day
31	m <sup>3</sup> /s	cubic meter(s) per second
32	mA	milliampere(s)
33	MAB	maximum attainable benefit
34	MACCS	MELCOR Accident Consequence Code System
35	MACCS2	MELCOR Accident Consequence Code System 2
36	MBq	megabecquerel(s)
37	MGD	million gallon(s) per day
38	mGy	milligray(s)
39	mi	mile(s)
40	MJ	megajoule(s)
41	mL	milliliter(s)

## Abbreviations/Acronyms

1	mph	mile(s) per hour
2	mrad	millirad(s)
3	mrem	millirem(s)
4	mSv	millisievert(s)
5	MT	metric ton(s) (or tonne[s])
6	MTHM	metric tonne(s) heavy metal
7	MTU	metric ton(s)-uranium
8	MW	megawatt(s)
9	MWd/MTU	megawatt-day(s) per metric ton of uranium
10	MW(e)	megawatt(s) electric
11	MW(t)	megawatt(s) thermal
12	MWh	megawatt hour(s)
13		
14	NA	not applicable
15	NAS	National Academy of Sciences
16	NCI	National Cancer Institute
17	NEPA	National Environmental Policy Act of 1969
18	NESC	National Electric Safety Code
19	ng/J	nanogram(s) per joule
20	NHPA	National Historic Preservation Act
21	NIEHS	National Institute of Environmental Health Sciences
22	NMFS	National Marine Fisheries Service
23	NO <sub>x</sub>	nitrogen oxide(s)
24	NOAA	National Oceanographic and Atmospheric Administration
25	NPDES	National Pollutant Discharge Elimination System
26	NRC	U.S. Nuclear Regulatory Commission
27		
28	ODCM	Offsite Dose Calculation Manual
29	OL	operating license
30		
31	PAR	passive autocatalytic recombiners
32	PARS	Publicly Available Records System
33	PDS	plant damage state
34	PM <sub>10</sub>	particulate matter, 10 microns or less in diameter
35	ppt	parts per thousand
36	PRA	Probabilistic Risk Assessment
37	PSA	Probabilistic Safety Assessment
38	PSD	prevention of significant deterioration
39	PSW	plant service water
40	PWR	pressurized water reactor
41		

1	QA	quality assurance
2		
3	RAB	reactor auxiliary building
4	RAI	request for additional information
5	RCP	reactor coolant pump
6	RCS	reactor coolant system
7	REMP	radiological environmental monitoring program
8	rms	root mean square
9	RPC	replacement power cost
10	RRW	risk reduction worth
11	RWST	Refueling Water Storage Tank
12	ry	reactor-year(s)
13		
14	s	second(s)
15	SAG	Severe Accident Guideline
16	SAMA	severe accident mitigation alternative
17	SAMG	Severe Accident Management Guideline
18	SAR	Safety Analysis Report
19	SBO	station blackout
20	SCR	selective catalytic reduction
21	SEIS	supplemental environmental impact statement
22	SER	Safety Evaluation Report
23	SFWMD	South Florida Water Management District
24	SG	steam generator
25	SGTR	steam generator tube rupture
26	SHPO	State Historic Preservation Office
27	SO <sub>2</sub>	sulfur dioxide
28	SO <sub>x</sub>	sulfur oxide(s)
29	SR	State Road or State Route
30	SSC	species of special concern
31	Sv	sievert(s)
32		
33	TBq	terrabecquerel(s)
34		
35	UDB	urban development boundary
36	UFSAR	Updated Final Safety Analysis Report
37	U.S.	United States
38	USACE	U.S. Army Corps of Engineers
39	USB	Urban Service Boundary
40	USC	United States Code
41	USCB	U.S. Census Bureau

## Abbreviations/Acronyms

1	USDA	U.S. Department of Agriculture
2		
3	yr	year(s)

# 1.0 Introduction

Under the Nuclear Regulatory Commission's (NRC's) environmental protection regulations in Title 10 of the Code of Federal Regulations (CFR) Part 51, which implement the National Environmental Policy Act (NEPA), renewal of a nuclear power plant operating license (OL) requires the preparation of an environmental impact statement (EIS). In preparing the EIS, the NRC staff is required first to issue the statement in draft form for public comment, and then issue a final statement after considering public comments on the draft. To support the preparation of the EIS, the staff has prepared a *Generic Environmental Impact Statement for License Renewal of Nuclear Plants* (GEIS), NUREG-1437, Volumes 1 and 2 (NRC 1996; 1999)<sup>(a)</sup>. The GEIS is intended to (1) provide an understanding of the types and severity of environmental impacts that may occur as a result of license renewal of nuclear power plants under 10 CFR Part 54, (2) identify and assess the impacts that are expected to be generic to license renewal, and (3) support 10 CFR Part 51 to define the number and scope of issues that need to be addressed by the applicants in plant-by-plant renewal proceedings. Use of the GEIS guides the preparation of complete plant-specific information in support of the OL renewal process.

The Florida Power and Light Company (FPL) operates St. Lucie Units 1 and 2 in Florida under OLs DPR-67 and NPF-16, which were issued by the NRC. These OLs will expire on March 1, 2016, for Unit 1 and April 6, 2023, for Unit 2. On November 29, 2001, FPL submitted an application to the NRC to renew the St. Lucie OLs for an additional 20 years under 10 CFR Part 54 (FPL 2001a). FPL is a *licensee* for the purposes of its current OLs and an *applicant* for the renewal of the OLs. Pursuant to 10 CFR 54.23 and 51.53(c), FPL submitted an Environmental Report (ER; FPL 2001b) in which FPL analyzed the environmental impacts associated with the proposed license renewal action, considered alternatives to the proposed action, and evaluated mitigation measures for reducing adverse environmental effects.

This report is the draft plant-specific supplement to the GEIS (the supplemental EIS [SEIS]) for the FPL license renewal application. This SEIS is a supplement to the GEIS because it relies, in part, on the findings of the GEIS. The staff will also prepare a separate safety evaluation report in accordance with 10 CFR Part 54.

## 1.1 Report Contents

The following sections of this introduction (1) describe the background for the preparation of this SEIS, including the development of the GEIS and the process used by the staff to assess

---

(a) The GEIS was originally issued in 1996. Addendum 1 to the GEIS was issued in 1999. Hereafter, all references to the "GEIS" include the GEIS and its Addendum 1.

## Introduction

1 the environmental impacts associated with license renewal, (2) describe the proposed Federal  
2 action to renew the St. Lucie Units 1 and 2 OLS, (3) discuss the purpose and need for the  
3 proposed action, and (4) present the status of FPL's compliance with environmental quality  
4 standards and requirements that have been imposed by Federal, State, regional, and local  
5 agencies that are responsible for environmental protection.

6  
7 The ensuing chapters of this SEIS closely parallel the contents and organization of the GEIS.  
8 Chapter 2 describes the site, power plant, and interactions of the plant with the environment.  
9 Chapters 3 and 4, respectively, discuss the potential environmental impacts of plant refurbish-  
10 ment and plant operation during the renewal term. Chapter 5 contains an evaluation of  
11 potential environmental impacts of plant accidents and includes consideration of severe  
12 accident mitigation alternatives. Chapter 6 discusses the uranium fuel cycle and solid waste  
13 management, Chapter 7 discusses decommissioning, and Chapter 8 discusses alternatives to  
14 license renewal. Finally, Chapter 9 summarizes the findings of the preceding chapters and  
15 draws conclusions about the adverse impacts that cannot be avoided (the relationship between  
16 short-term uses of the human environment and the maintenance and enhancement of long-  
17 term productivity, and the irreversible or irretrievable commitment of resources). Chapter 9 also  
18 presents the staff's preliminary recommendation with respect to the proposed license renewal  
19 action.

20  
21 Additional information is included in appendixes. Appendix A contains public comments  
22 received on the environmental review for license renewal and staff responses. Appendixes B  
23 through F, respectively, list the following:

- 24 • the preparers of the supplement
- 25
- 26
- 27 • the chronology of NRC correspondence regarding this SEIS
- 28
- 29 • the organizations contacted during the development of this SEIS
- 30
- 31 • FPL's compliance status in Table E-1 and copies of consultation correspondence
- 32 prepared and sent during the evaluation process
- 33
- 34 • GEIS environmental issues that are not applicable to St. Lucie.
- 35

## 36 1.2 Background

37  
38 Use of the GEIS, which examines the possible environmental impacts that could occur as a  
39 result of renewing individual nuclear power plant OLS under 10 CFR Part 54, and the  
40 established license renewal evaluation process supports the thorough evaluation of the impacts  
41 of renewal of OLS.

### 1.2.1 Generic Environmental Impact Statement

The NRC initiated a generic assessment of the environmental impacts associated with the license renewal term to improve the efficiency of the license renewal process by documenting the assessment results and codifying the results in the Commission's regulations. This assessment is provided in the GEIS, which serves as the principal reference for all nuclear power plant license renewal EISs.

The GEIS documents the results of the systematic approach that was taken to evaluate the environmental consequences of renewing the licenses of individual nuclear power plants and operating them for an additional 20 years. For each potential environmental issue, the GEIS (1) describes the activity that affects the environment, (2) identifies the population or resource that is affected, (3) assesses the nature and magnitude of the impact on the affected population or resource, (4) characterizes the significance of the effect for both beneficial and adverse effects, (5) determines whether the results of the analysis apply to all plants, and (6) considers whether additional mitigation measures would be warranted for impacts that would have the same significance level for all plants.

The NRC's standard of significance was established using the Council on Environmental Quality (CEQ) terminology for "significantly" (40 CFR 1508.27, which requires consideration of both "context" and "intensity"). Using the CEQ terminology, the NRC established three significance levels—SMALL, MODERATE, or LARGE. The definitions of the three significance levels are set forth in the footnotes to Table B-1 of 10 CFR Part 51, Subpart A, Appendix B, as follows:

**SMALL** – Environmental effects are not detectable or are so minor that they will neither destabilize nor noticeably alter any important attribute of the resource.

**MODERATE** – Environmental effects are sufficient to alter noticeably, but not to destabilize, important attributes of the resource.

**LARGE** – Environmental effects are clearly noticeable and are sufficient to destabilize important attributes of the resource.

The GEIS assigns a significance level to each environmental issue, assuming that ongoing mitigation measures would continue.

The GEIS includes a determination of whether the analysis of the environmental issue could be applied to all plants and whether additional mitigation measures would be warranted. Issues

## Introduction

1 are then assigned a Category 1 or a Category 2 designation. As set forth in the GEIS,  
2 **Category 1** issues are those that meet all of the following criteria:

- 3
- 4 (1) The environmental impacts associated with the issue have been determined to apply either  
5 to all plants or, for some issues, to plants having a specific type of cooling system or other  
6 specified plant or site characteristic.
  - 7
  - 8 (2) A single significance level (i.e., SMALL, MODERATE, or LARGE) has been assigned to the  
9 impacts (except for collective offsite radiological impacts from the fuel cycle and from high-  
10 level waste and spent fuel disposal).
  - 11
  - 12 (3) Mitigation of adverse impacts associated with the issue has been considered in the analysis,  
13 and it has been determined that additional plant-specific mitigation measures are likely not  
14 to be sufficiently beneficial to warrant implementation.
  - 15

16 For issues that meet the three Category 1 criteria, no additional plant-specific analysis is  
17 required in this SEIS unless new and significant information is identified.

18

19 **Category 2** issues are those that do not meet one or more of the criteria of Category 1, and  
20 therefore, additional plant-specific review for these issues is required.

21

22 In the GEIS, the staff assessed 92 environmental issues and determined that 69 qualified as  
23 Category 1 issues, 21 qualified as Category 2 issues, and 2 issues were not categorized. The  
24 latter two issues, environmental justice and chronic effects of electromagnetic fields, are to be  
25 addressed in a plant-specific analysis. Of the 92 issues, 11 are related only to refurbishment,  
26 6 are related only to decommissioning, 67 apply only to operation during the renewal term, and  
27 8 apply to both refurbishment and operation during the renewal term. A summary of the  
28 findings for all 92 issues in the GEIS is codified in Table B-1 of 10 CFR Part 51, Subpart A,  
29 Appendix B.

### 30

### 31 **1.2.2 License Renewal Evaluation Process**

32

33 An applicant seeking to renew its OLS is required to submit an ER as part of its application.  
34 The license renewal evaluation process involves careful review of the applicant's ER and  
35 assurance that all new and potentially significant information not already addressed in or  
36 available during the GEIS evaluation is identified, reviewed, and assessed to verify the  
37 environmental impacts of the proposed license renewal.

1 In accordance with 10 CFR 51.53(c)(2) and (3), the ER submitted by the applicant must

- 2
- 3 • provide an analysis of the Category 2 issues in Table B-1 of 10 CFR Part 51,
  - 4 Subpart A, Appendix B in accordance with 10 CFR 51.53(c)(3)(ii)
  - 5 • discuss actions to mitigate any adverse impacts associated with the proposed
  - 6 action and environmental impacts of alternatives to the proposed action.
- 7

8 In accordance with 10 CFR 51.53(c)(2), the ER does not need to

- 9
- 10 • consider the economic benefits and costs of the proposed action and
  - 11 alternatives to the proposed action except insofar as such benefits and costs are
  - 12 either (1) essential for making a determination regarding the inclusion of an
  - 13 alternative in the range of alternatives considered, or (2) relevant to mitigation
  - 14 • consider the need for power and other issues not related to the environmental
  - 15 effects of the proposed action and the alternatives
  - 16 • discuss any aspect of the storage of spent fuel within the scope of the generic
  - 17 determination in 10 CFR 51.23(a) in accordance with 10 CFR 51.23(b)
  - 18 • contain an analysis of any Category 1 issue unless there is significant new
  - 19 information on a specific issue—this is pursuant to 10 CFR 51.23(c)(3)(iii) and
  - 20 (iv).
- 21

22 New and significant information is (1) information that identifies a significant environmental

23 issue not covered in the GEIS and codified in Table B-1 of 10 CFR Part 51, Subpart A,

24 Appendix B, or (2) information that was not considered in the analyses summarized in the GEIS

25 and that leads to an impact finding that is different from the finding presented in the GEIS and

26 codified in 10 CFR Part 51.

27

28 In preparing to submit its application to renew the St. Lucie OLS, FPL developed a process to

29 ensure that information not addressed in or available during the GEIS evaluation regarding the

30 environmental impacts of license renewal for St. Lucie Units 1 and 2 would be properly

31 reviewed before submitting the ER, and to ensure that such new and potentially significant

32 information related to renewal of the licenses would be identified, reviewed, and assessed

33 during the period of NRC review. FPL reviewed the Category 1 issues that appear in Table B-1

34 of 10 CFR Part 51, Subpart A, Appendix B, to verify that the conclusions of the GEIS remained

35 valid with respect to St. Lucie Units 1 and 2. This review was performed by personnel from FPL

36 and its support organization who were familiar with NEPA issues and the scientific disciplines

37 involved in the preparation of a license renewal ER.

38

39 The NRC staff also has a process for identifying new and significant information. That process

40 is described in detail in *Standard Review Plans for Environmental Reviews for Nuclear Power*

## Introduction

1 *Plants, Supplement 1: Operating License Renewal (ESRP)*, NUREG-1555, Supplement 1  
2 (NRC 2000). The search for new information includes (1) review of an applicant's ER and the  
3 process for discovering and evaluating the significance of new information; (2) review of  
4 records of public comments; (3) review of environmental quality standards and regulations;  
5 (4) coordination with Federal, State, and local environmental protection and resource agencies;  
6 and (5) review of the technical literature. New information discovered by the staff is evaluated  
7 for significance using the criteria set forth in the GEIS. For Category 1 issues where new and  
8 significant information is identified, reconsideration of the conclusions for those issues is limited  
9 in scope to an assessment of the relevant new and significant information; the scope of the  
10 assessment does not include other facets of the issue that are not affected by the new  
11 information.

12  
13 Chapters 3 through 7 discuss the environmental issues considered in the GEIS that are  
14 applicable to St. Lucie Units 1 and 2. At the beginning of the discussion of each set of issues, a  
15 table identifies the issues to be addressed and lists the sections in the GEIS where the issue is  
16 discussed. Category 1 and Category 2 issues are listed in separate tables. For Category 1  
17 issues for which there is no new and significant information, the table is followed by a set of  
18 short paragraphs that state the GEIS conclusion codified in Table B-1 of 10 CFR Part 51,  
19 Subpart A, Appendix B, followed by the staff's analysis and conclusion. For Category 2 issues,  
20 in addition to the list of GEIS sections where the issue is discussed, the tables list the  
21 subparagraph of 10 CFR 51.53(c)(3)(ii) that describes the analysis required and the draft SEIS  
22 sections where the analysis is presented. The draft SEIS sections that discuss the Category 2  
23 issues are presented immediately following the table.

24  
25 The NRC prepares an independent analysis of the environmental impacts of license renewal  
26 and compares these impacts with the environmental impacts of alternatives. The evaluation of  
27 the FPL license renewal application began with publication of a notice of acceptance for  
28 docketing and opportunity for a hearing in the *Federal Register* (67 FR 4288 [NRC 2002a]) on  
29 January 29, 2002. The staff published a notice of intent to prepare an EIS and conduct scoping  
30 (67 FR 9333 [NRC 2002b]) on February 28, 2002. Two public scoping meetings were held on  
31 April 3, 2002, in Port St. Lucie, Florida. Comments received during the scoping period were  
32 summarized in the *Environmental Impact Statement Scoping Process: Summary Report – St.*  
33 *Lucie Units 1 and 2, Florida* (NRC 2002c) dated June 2002. Comments applicable to this  
34 environmental review are presented in Part I of Appendix A.

35  
36 The staff followed the review guidance contained in the ESRP (NRC 2000). The staff and  
37 contractors retained to assist the staff visited the St. Lucie site on April 2, 2002, to gather  
38 information and to become familiar with the site and its environs. The staff also reviewed the  
39 comments received during scoping, and consulted with Federal, State, regional, and local  
40 agencies. A list of the organizations consulted is provided in Appendix D. Other documents  
41 related to St. Lucie were reviewed and are referenced.

1 This draft SEIS presents the staff's analysis that considers and weighs the environmental  
2 effects of the proposed renewal of the St. Lucie OLS, the environmental impacts of alternatives  
3 to license renewal, and mitigation measures available for avoiding adverse environmental  
4 effects. Chapter 9, "Summary and Conclusions," provides the NRC staff's preliminary  
5 recommendation to the Commission on whether or not the adverse environmental impacts of  
6 license renewal are so great that preserving the option of license renewal for energy-planning  
7 decision makers would be unreasonable.

8  
9 A 75-day comment period will begin on the date of publication of the U.S. Environmental  
10 Protection Agency Notice of Filing of the draft SEIS to allow members of the public to comment  
11 on the preliminary results of the NRC staff's review. During this comment period, two public  
12 meetings will be held in Port St. Lucie, Florida, in December 2002. During these meetings, the  
13 staff will describe the preliminary results of the NRC environmental review and answer  
14 questions related to it to provide members of the public with information to assist them in  
15 formulating their comments.

### 17 **1.3 The Proposed Federal Action**

18  
19 The proposed Federal action is renewal of the OLS for St. Lucie Units 1 and 2. The St. Lucie  
20 nuclear plant is located on Hutchinson Island in St. Lucie County, Florida. Port St. Lucie is the  
21 largest city within 80 km (50 mi) of St. Lucie Units 1 and 2.

22  
23 The current OL for Unit 1 expires on March 1, 2016, and for Unit 2 on April 6, 2023. By letter  
24 dated November 29, 2001, FPL submitted an application to the NRC (FPL 2001a) to renew  
25 these OLS for an additional 20 years of operation (i.e., until March 1, 2036, for Unit 1 and April  
26 6, 2043, for Unit 2).

27  
28 The plant has two Westinghouse-designed light-water reactors, each with a design rating for a  
29 net electrical power output of 839 megawatts electric (MW[e]). Once-through cooling water  
30 from the Atlantic Ocean is used to remove heat from the main (turbine) condensers via the  
31 circulating water system and from other auxiliary equipment via the intake cooling water system  
32 (i.e., the auxiliary cooling water system). The majority of this cooling water is used for the  
33 circulating water system. St. Lucie produces enough electricity to supply the needs of more  
34 than 500,000 homes.

### 36 **1.4 The Purpose and Need for the Proposed Action**

37  
38 Although a licensee must have a renewed license to operate a reactor beyond the term of the  
39 existing OL, the possession of that license is just one of a number of conditions that must be

## Introduction

1 met for the licensee to continue plant operation during the term of the renewed license. Once  
2 an OL is renewed, State regulatory agencies and the owners of the plant will ultimately decide  
3 whether the plant will continue to operate based on factors such as the need for power or other  
4 matters within the jurisdiction of the State or the purview of the owners.

5  
6 Thus, for license renewal reviews, the NRC has adopted the following definition of purpose and  
7 need (GEIS Section 1.3):

8  
9 The purpose and need for the proposed action (renewal of an operating license) is to  
10 provide an option that allows for power generation capability beyond the term of a  
11 current nuclear power plant operating license to meet future system generating needs,  
12 as such needs may be determined by State, utility, and where authorized, Federal (other  
13 than NRC) decisionmakers.

14  
15 This definition of purpose and need reflects the Commission's recognition that, unless there are  
16 findings in the safety review required by the Atomic Energy Act of 1954 or findings in the NEPA  
17 environmental analysis that would lead the NRC to reject a license renewal application, the  
18 NRC does not have a role in the energy-planning decisions of State regulators and utility  
19 officials as to whether a particular nuclear power plant should continue to operate. From the  
20 perspective of the licensee and the State regulatory authority, the purpose of renewing an OL is  
21 to maintain the availability of the nuclear plant to meet system energy requirements beyond the  
22 current term of the plant's license.

## 23 24 **1.5 Compliance and Consultations**

25  
26 FPL is required to hold certain Federal, State, and local environmental permits, as well as meet  
27 relevant Federal and State statutory requirements. In the St. Lucie ER (FPL 2001b), FPL  
28 provided a list of the authorizations from Federal, State, and local authorities for current  
29 operations as well as environmental approvals and consultations associated with renewal of the  
30 St. Lucie OLs. Authorizations and consultations relevant to the proposed OL renewal action  
31 are included in Appendix E.

32  
33 The staff has reviewed the list and consulted with the appropriate Federal, State, and local  
34 agencies to identify any compliance or permit issues or significant environmental issues of  
35 concern to the reviewing agencies. These agencies did not identify any new and significant  
36 environmental issues. The ER (FPL 2001b) states that FPL is in compliance with applicable  
37 environmental standards and requirements for St. Lucie Units 1 and 2. The staff also has not  
38 identified any environmental issues that are both new and significant.

## 1.6 References

10 CFR 51. Code of Federal Regulations, Title 10, *Energy*, Part 51, “Environmental Protection Regulations for Domestic Licensing and Related Regulatory Functions.”

10 CFR 54. Code of Federal Regulations, Title 10, *Energy*, Part 54, “Requirements for Renewal of Operating Licenses for Nuclear Power Plants.”

40 CFR 1508. Code of Federal Regulations, Title 40, *Protection of Environment*, Part 1508, “Terminology and Index.”

Atomic Energy Act of 1954 (AEA). 42 USC 2011, et seq.

Florida Power and Light Company (FPL). 2001a. *Application for Renewed Operating Licenses, St. Lucie Units 1 and 2*. Miami, Florida.

Florida Power and Light Company (FPL). 2001b. *Applicant’s Environmental Report – Operating License Renewal Stage St. Lucie Units 1 and 2*. Miami, Florida.

National Environmental Policy Act of 1969 (NEPA). 42 USC 4321, et seq.

U.S. Nuclear Regulatory Commission (NRC). 1996. *Generic Environmental Impact Statement for License Renewal of Nuclear Plants*. NUREG-1437, Volumes 1 and 2, Washington, D.C.

U.S. Nuclear Regulatory Commission (NRC). 1999. *Generic Environmental Impact Statement for License Renewal of Nuclear Plants Main Report*, “Section 6.3 – Transportation, Table 9.1, Summary of findings on NEPA issues for license renewal of nuclear power plants, Final Report.” NUREG-1437, Volume 1, Addendum 1, Washington, D.C.

U.S. Nuclear Regulatory Commission (NRC). 2000. *Standard Review Plans for Environmental Reviews for Nuclear Power Plants, Supplement 1: Operating License Renewal*. NUREG-1555, Supplement 1, Washington, D.C.

U.S. Nuclear Regulatory Commission (NRC). 2002a. “Notice of Acceptance for Docketing of the Application and Notice of Opportunity for a Hearing Regarding Renewal of License Nos. DPR-67 and NPF-16 for an Additional Twenty-Year Period.” *Federal Register*. Vol. 67, No. 198, pp. 4288-4290. January 29, 2002

## Introduction

- 1 U.S. Nuclear Regulatory Commission (NRC). 2002b. "Notice of Intent to Prepare an  
2 Environmental Impact Statement and Conduct Scoping Process." *Federal Register*. Vol. 67,  
3 No. 40, pp. 9333-9335. February 28, 2002.  
4
- 5 U.S. Nuclear Regulatory Commission (NRC). 2002c. *Environmental Impact Statement*  
6 *Scoping Process: Summary Report – St. Lucie Units 1 and 2, Port St. Lucie, Florida.*  
7 Washington, D.C.  
8  
9  
10  
11

1                   **2.0 Description of Nuclear Power Plant and Site**  
2                   **and Plant Interaction with the Environment**  
3  
4

5                   The Florida Power and Light Company's (FPL's) St. Lucie Units 1 and 2 are located on  
6                   Hutchinson Island in St. Lucie County, Florida. The nearest municipalities are Fort Pierce,  
7                   approximately 11 km (7 mi) northwest of the plant; Port St. Lucie, approximately 7 km (4.5 mi)  
8                   to the west; and Stuart, approximately 13 km (8 mi) to the south. The plant consists of two  
9                   units, Units 1 and 2, which are nuclear reactors and the subject of this action. The plant and its  
10                  environs are described in Section 2.1, and the plant's interaction with the environment is  
11                  presented in Section 2.2.  
12

13                  **2.1 Plant and Site Description and Proposed Plant**  
14                  **Operation During the Renewal Term**  
15

16                  The St. Lucie Units 1 and 2 site consists of approximately 457 ha (1130 ac) of land on the  
17                  widest section of Hutchinson Island in an area previously degraded by mosquito control  
18                  projects, as described in the FPL Environmental Report (ER; FPL 2001a). Figures 2-1 and 2-2  
19                  show the site location and features within 80 km and 10 km (50 mi and 6 mi), respectively.  
20                  Figure 2-3 shows the site boundary in relation to the power block and adjacent features.  
21

22                  St. Lucie Units 1 and 2 are located on the west side of State Road A1A in a relatively flat,  
23                  sheltered area of Hutchinson Island. West of the facility, the land gradually slopes downward to  
24                  a mangrove fringe bordering the intertidal shoreline of the Indian River Lagoon. East of the  
25                  facility, land rises from the ocean shore to form dunes and ridges approximately 4.6 m (15 ft)  
26                  above mean low water (FPL 2001a). Two county parks with beach access, Blind Creek Pass  
27                  Park and Walton Rocks Park, lie within the St. Lucie Units 1 and 2 property boundary.  
28                  Recreational facilities for FPL employees and their families are also available within the site  
29                  property boundary.  
30

31                  The Indian River Lagoon is a long, shallow, tidally influenced estuary stretching along Florida's  
32                  central east coast between the mainland and a series of offshore islands. At St. Lucie Units 1  
33                  and 2, the Indian River Lagoon is approximately 2195 m (7200 ft) wide. Blind Creek and Big  
34                  Mud Creek, inlets off the Indian River Lagoon, are adjacent to the site. The stretch of lagoon  
35                  adjacent to the site is designated as the Jensen Beach to Juniper Inlet Aquatic Preserve. The  
36                  North Fork St. Lucie River Aquatic Preserve is located on the north fork of the river as it  
37                  parallels the coast north of where it flows into the St. Lucie River at Port St. Lucie. The  
38                  St. Lucie Canal connects the St. Lucie River with Lake Okeechobee and parallels  
39                  State Road 76, south of Stuart.  
40


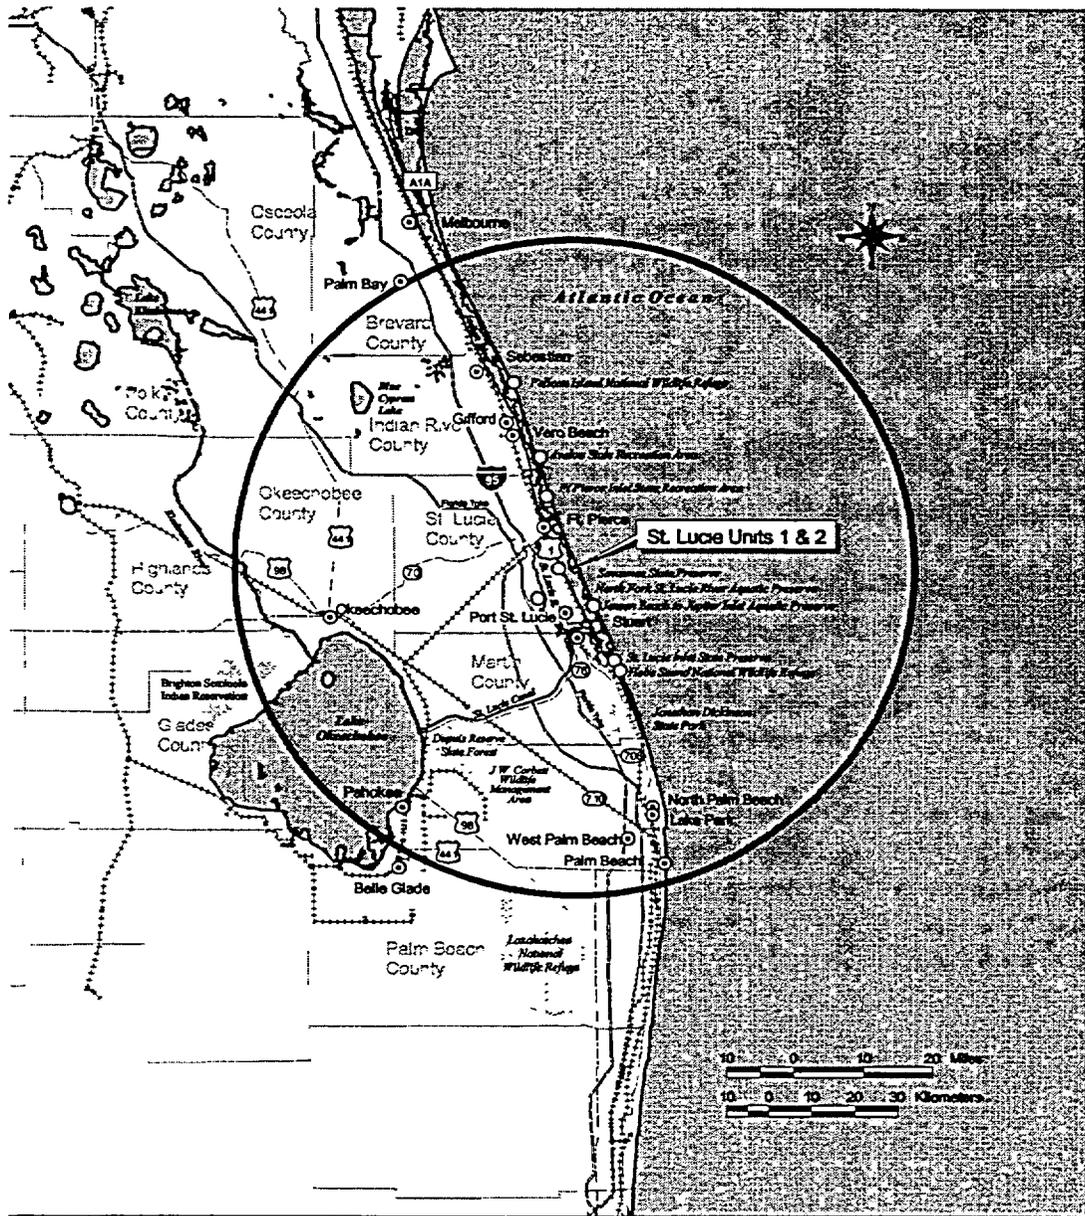


Figure 2-1. Location of St. Lucie Units 1 and 2, 80-km (50-mi) Region

1  
2

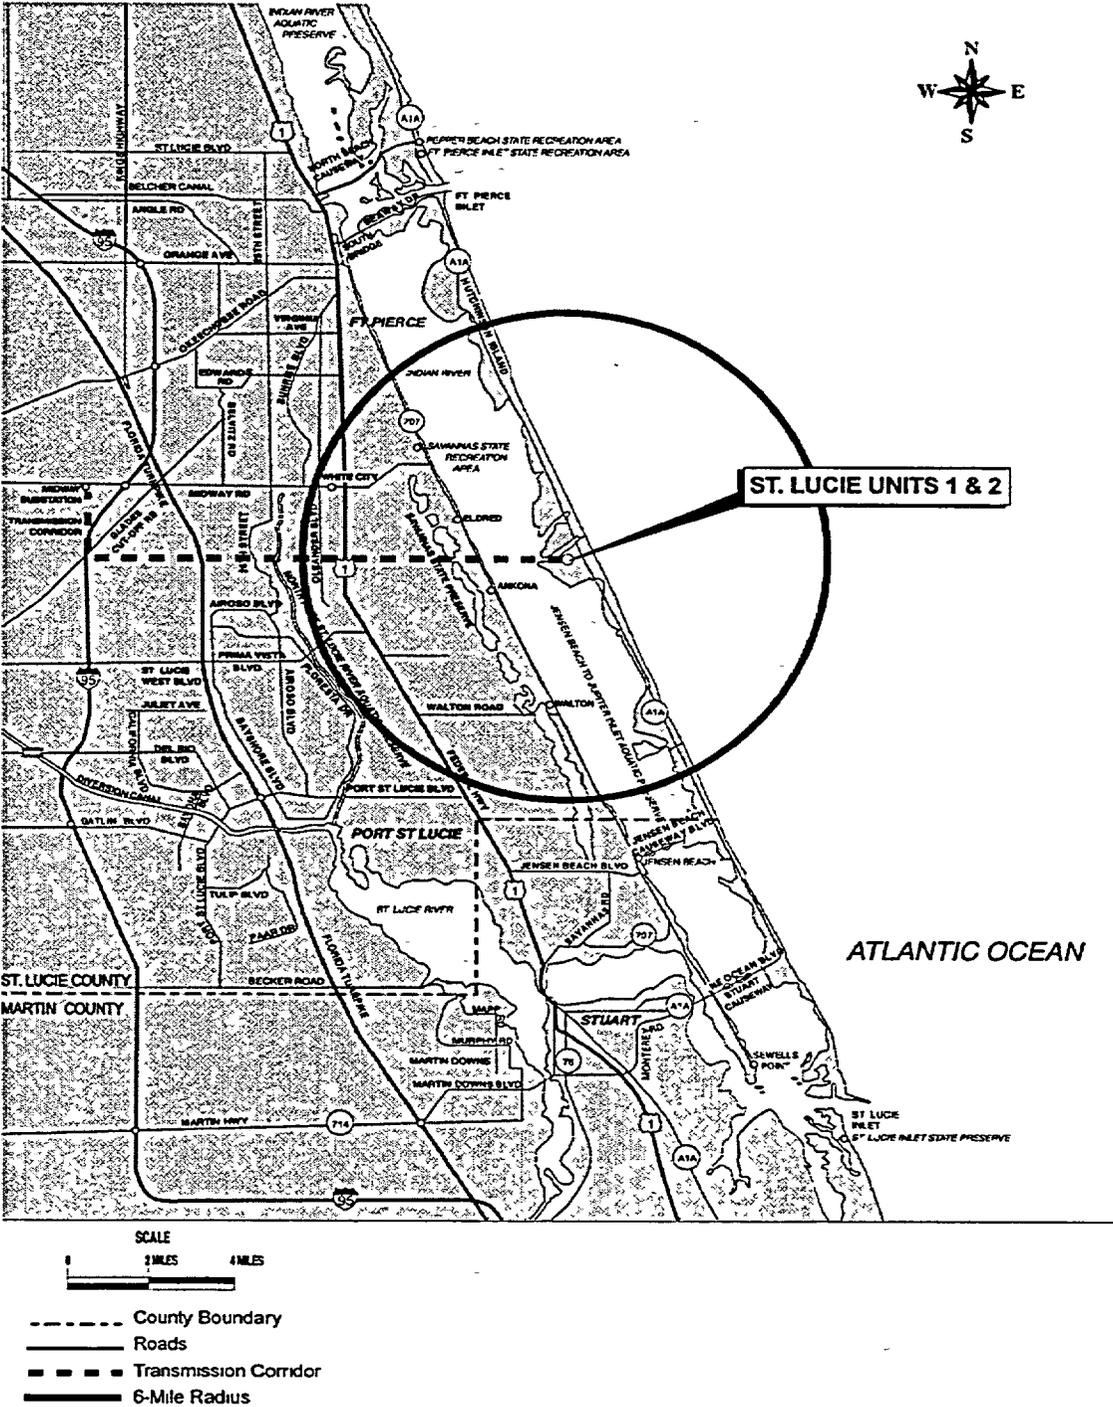

1  
2

Figure 2-2. Location of St. Lucie Units 1 and 2, 10-km (6-mi) Region

Plant and the Environment

1  
2  
3  
4  
5  
6  
7  
8  
9  
10  
11  
12  
13  
14  
15  
16  
17  
18  
19  
20  
21  
22  
23  
24  
25  
26  
27  
28  
29  
30  
31  
32  
33  
34  
35  
36  
37  
38  
39  
40

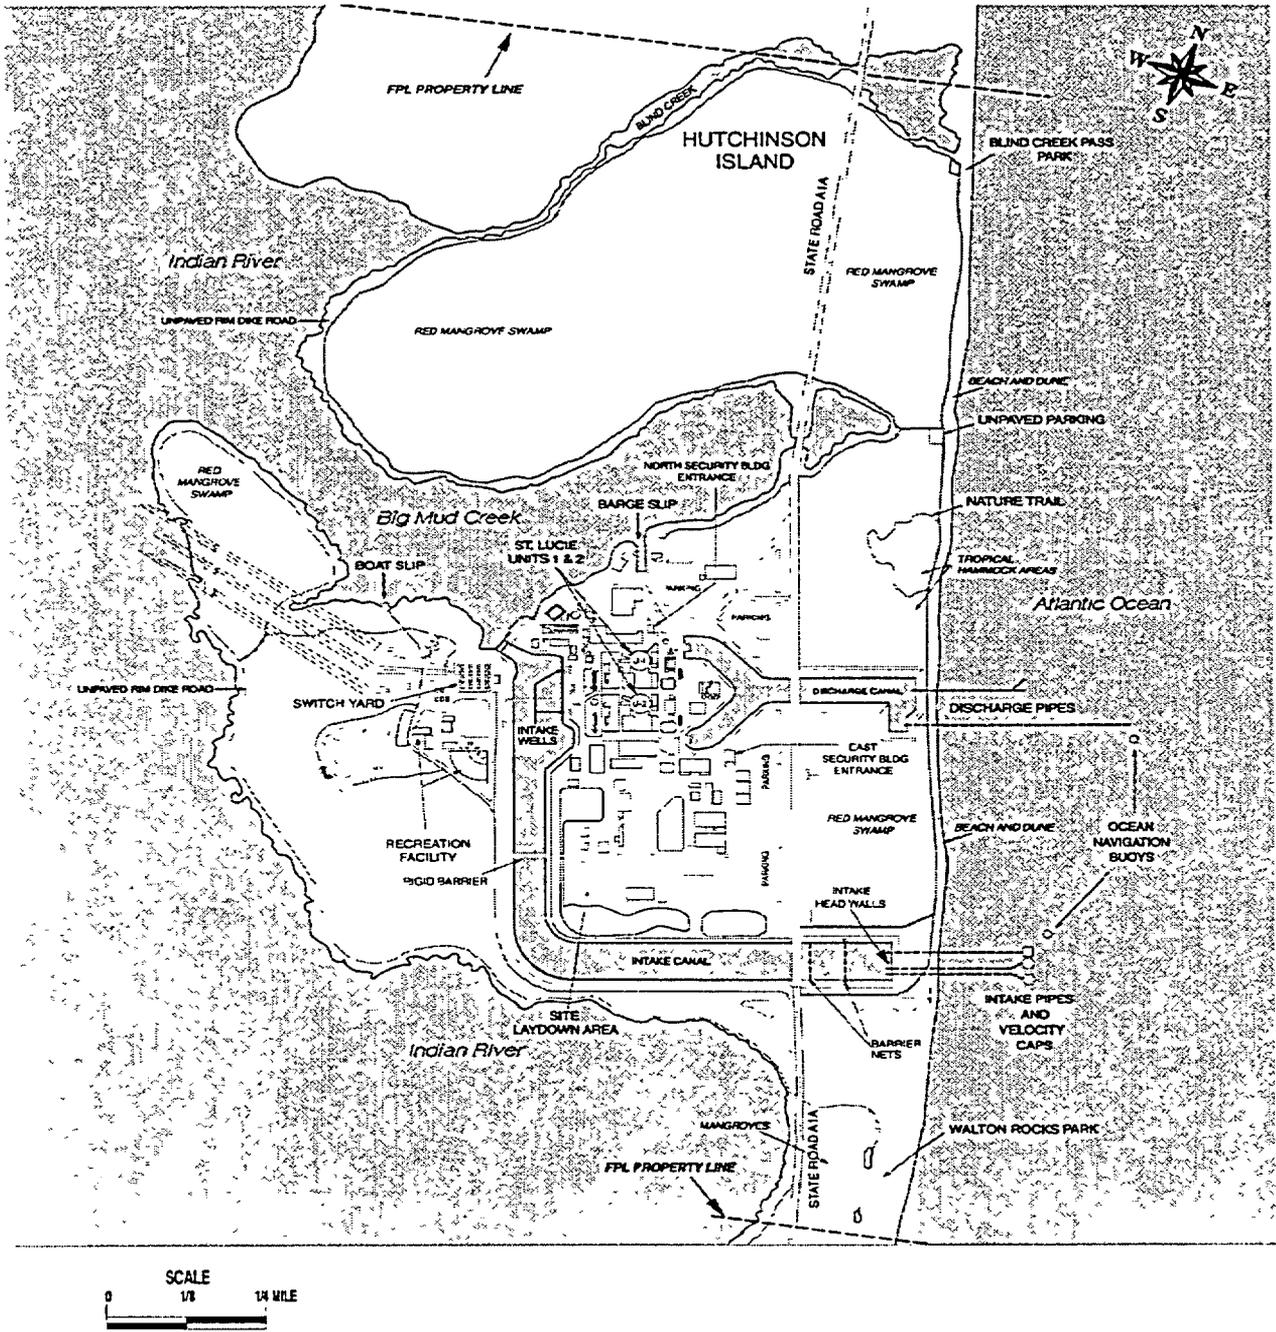


Figure 2-3. St. Lucie Units 1 and 2, Site Boundary

1 Fort Pierce Inlet State Recreation Area is approximately 14 km (9 mi) north of St. Lucie Units 1  
2 and 2 immediately north of the Fort Pierce Inlet. Recreation area activities include beach  
3 access, swimming, picnicking, camping, and hiking. Other state recreation areas include  
4 Avalon, Savannas, and Pepper Beach. The Savannas State Preserve, a freshwater lagoon, is  
5 located on the mainland approximately 3.2 km (2 mi) west of St. Lucie Units 1 and 2, and offers  
6 fishing, hiking, picnicking, and other outdoor related activities. Other prominent features within  
7 80 km (50 mi) of St. Lucie Units 1 and 2 include Lake Okeechobee; Blue Cypress Lake;  
8 Jonathan Dickinson State Park; the Dupuis Reserve State Forest; J.W. Corbett Wildlife  
9 Management Area; a portion of the Brighton Seminole Indian Reservation; and the Hobe  
10 Sound, Pelican Island, and Loxahatchee National Wildlife Refuges (FPL 2001a).  
11

### 12 **2.1.1 External Appearance and Setting**

13  
14 The prominent structures and housed facilities and equipment associated with each of the units  
15 include the containment building, which houses the nuclear steam supply system including the  
16 reactor, steam generators, reactor coolant pumps, and related equipment; the turbine generator  
17 building, where the turbine generator and associated main condensers are located; the auxiliary  
18 building, which houses waste management facilities, engineered safety features components,  
19 and other facilities; and the fuel handling building, where the spent fuel storage pool and  
20 storage facilities for new fuel are located. Prominent features beyond the power block area  
21 include the intake canal, discharge canal, intake wells, evaporation/percolation ponds,  
22 switchyard, technical and administrative support facilities, and public education facilities. The  
23 taller buildings on the site, particularly the containment buildings (approximately 61 m [200 ft]  
24 high) are visible from the mainland (FPL 2001a). Four evaporation-percolation ponds on the  
25 southern part of the site (Figure 2-4) accommodate storm-water runoff.  
26


27 Two main aquifers are found in the area: a shallow, nonartesian or locally artesian aquifer  
28 within the Anastasia Formation, and a deeper, artesian aquifer known as the Florida Aquifer.  
29 The two aquifers are separated by the Hawthorne Formation, which acts as an aquiclude. The  
30 groundwater flow direction in the Anastasia Formation is to the east precluding movement from  
31 the site westward toward the mainland. The piezometric level in the Florida Aquifer is higher  
32 than that in the Anastasia Formation aquifer. This, in addition to the aquiclude (Hawthorne  
33 Formation) that separates the two aquifers, precludes water from moving from the site  
34 downward to the Florida Aquifer (FPL 2001a).  
35

### 36 **2.1.2 Reactor Systems**

37  
38 The arrangement of St. Lucie Units 1 and 2 major structures and equipment in the power block  
39 and nearby areas is shown in Figure 2-4. The nuclear power units for St. Lucie Units 1 and 2  
40 are of comparable design, each consisting of a pressurized light-water reactor with two steam  
41 generators that produce steam, which turns a turbine to generate electricity. Each unit is

Plant and the Environment

1

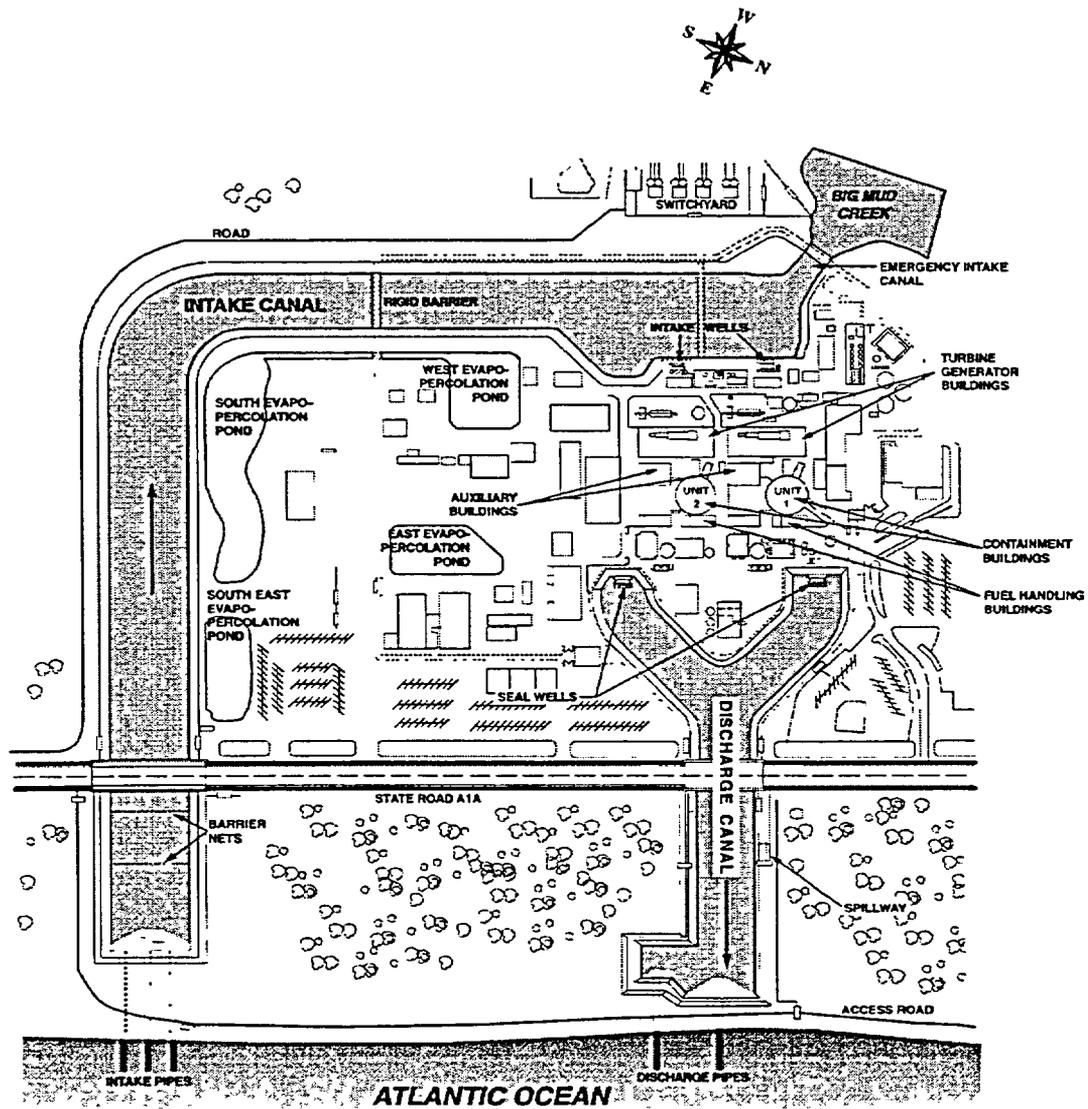

- LEGEND:
-  = COOLING WATER
  -  = EVAPO-PERCOLATION PONDS
  -  = MANGROVE IMPOUNDMENTS
  -  = PARKING

2  
3

Figure 2-4. St. Lucie Units 1 and 2, Power Block Area

1 currently licensed to operate at an output of approximately 2700 megawatts (thermal) [MW(t)],  
2 with a corresponding gross electrical output of approximately 890 megawatts (electric) [MW(e)],  
3 for a combined plant capability of 1678 MW(e), discounting onsite electrical power usage (net  
4 summer rating [FPL 2001a]).  
5

6 Each reactor is housed in a containment structure comprising a steel-containment vessel  
7 surrounded by a reinforced concrete shield building. The dry-containment structures are  
8 designed to withstand environmental effects and the internal pressure and temperature  
9 accompanying a postulated loss-of-coolant accident (LOCA). Together with its engineered  
10 safety features, each containment structure is designed to retain adequately fission products  
11 that could escape from the reactor coolant system in the event of a LOCA.  
12

13 St. Lucie Units 1 and 2 are licensed for uranium-dioxide fuel that is slightly enriched with up to  
14 4.5 percent by weight uranium-235. The uranium-dioxide fuel is in the form of pellets contained  
15 in zircaloy tubes with welded end plugs to confine radionuclides. The tubes are fabricated into  
16 assemblies designed for loading into the reactor core. Each reactor core includes 217 fuel  
17 assemblies.  
18

19 FPL currently replaces approximately one-third of the fuel assemblies in each reactor at an  
20 interval of approximately 18 months. FPL operates the reactors such that the average burnup  
21 is approximately 47,000 megawatt/days per metric ton uranium (MWd/MTU).  
22

### 23 **2.1.3 Cooling and Auxiliary Water Systems**

24

25 Water from the Atlantic Ocean is used at St. Lucie Units 1 and 2 to remove heat from the main  
26 condensers and other auxiliary equipment. Most of this cooling water is used for the circulating-  
27 water system. Heat generated in the reactors is transferred in a way that useful energy is  
28 extracted to produce electricity. St. Lucie Units 1 and 2 have a two-loop, three-stage heat-  
29 transfer design. The primary system circulates reactor coolant (demineralized water that has  
30 been treated to control chemistry and corrosion) under high pressure through the reactor and  
31 two steam generators. The steam generators, steam turbine, and main turbine condensers are  
32 connected in a secondary closed loop containing treated, demineralized water. Secondary-  
33 system water flashes to steam in the steam generators, and the steam turns the turbine to  
34 generate electricity. After exiting the turbine, the steam in the secondary system passes  
35 through the main condensers, where it is cooled to liquid water before returning to the steam  
36 generator to complete the secondary loop.  
37

38 The circulating-water system is the final (tertiary) stage in this heat-transfer system. The  
39 tertiary stage is unconfined. Water is drawn through three offshore ocean intake structures into  
40 the intake canal. This water is then pumped from the intake canal at the intake wells through  
41 the main condensers to the discharge canal. The heated water is finally discharged back to the

## Plant and the Environment

1 Atlantic Ocean through offshore diffusers (Figures 2-3 and 2-4). Water circulation in the  
2 system is provided by eight circulating water pumps (four per unit) located at the intake wells.  
3 Nominal total capacity of the pumps is 61,070 L/s (968,000 gpm), though capacity may range  
4 from 50,470 to 70,660 L/s (800,000 gpm to 1,120,000 gpm), depending on condenser  
5 cleanliness (FPL 1996). When all pumps are operating and both units are operating at  
6 100 percent capacity, temperature rise across the condensers is about 13°C (24°F).

7  
8 The three cooling-water intake structures for St. Lucie Units 1 and 2 are located about 370 m  
9 (1200 ft) offshore, where the water is about 7 m (23 ft) deep. Two of the structures were  
10 installed before startup of Unit 1 in 1976. The third intake structure is larger than the initial two  
11 and was installed in 1983. The designs of the structures are essentially identical, featuring a  
12 large concrete base with a vertical cylindrical opening in the center and a concrete velocity cap  
13 supported by columns extending about 1.8 m (6 ft) from the base (NRC 1982). The velocity  
14 cap configuration was designed to reduce potential entrainment of marine organisms by  
15 eliminating vertical flows and limiting horizontal flow velocities. Water withdrawn from the  
16 structures is conveyed through separate buried pipes, beneath the beach and dune system, to  
17 the intake canal. The inside diameters of the pipes, which correspond to those of the vertical  
18 cylindrical openings in the concrete bases of the structures, are 4.9 m (16 ft) for the large intake  
19 and 3.7 m (12 ft) for the two smaller intakes. Flow velocities vary within the intake system  
20 (Table 2-1) (Ecological Associates 2000).

21  
22 The intake canal, a 1500-m (4920-ft) -long trapezoidal channel about 55 m (180 ft) wide and  
23 9.1 m (30 ft) deep at normal water levels (USACE 1993), conveys cooling water to the intake  
24 wells during normal operation. FPL has installed and maintains three barriers in the channel to  
25 reduce potential losses of marine life, particularly sea turtles, and to facilitate the return of  
26 turtles to the ocean. These include deployment of a 12.7-cm (5-in.) mesh barrier net across the  
27 channel approximately midway between State Road A1A and the canal headwall, a 20.3-cm  
28 (8-in.) mesh barrier net immediately east of State Road A1A, and installation of a rigid barrier  
29 across the north-south arm of the intake canal (Figure 2-3) (Ecological Associates 2000).

30  
31 FPL dredged accumulated sediments from the intake canal on one occasion (in the mid-1990s)  
32 in accordance with a U.S. Army Corps of Engineers (USACE) permit (USACE 1993), and sold  
33 the dewatered sediments for clean fill. The permit includes provisions for periodic dredging in  
34 the future, if needed (USACE 1993). Under emergency conditions (e.g., failure of the intake  
35 canal headwall as a result of a design-basis earthquake), water can be withdrawn from Big Mud  
36 Creek via the emergency intake canal (Figure 2-4) through two 137-cm (54-in.) pipe assemblies  
37 in the barrier wall that separates the creek from the canal. FPL does not use this intake during  
38 normal operations but does test this system semiannually by exercising the valves in the two  
39 pipe inlets.

**Table 2.1** Calculated Flow Velocities at Various Points in the Intake System of St. Lucie Units 1 and 2

Location	Velocity m/s (ft/s)	
	3.7-m (12-ft) Diameter Intakes	4.9-m (16-ft) Diameter Intake
Velocity Cap Intake	0.11 to 0.12 (0.37 to 0.41)	0.27 to 0.30 (0.9 to 1.0)
Vertical Section	0.37 to 0.40 (1.2 to 1.3)	1.9 to 2.1 (6.2 to 6.8)
Intake Pipe	1.3 to 1.4 (4.2 to 4.7)	1.8 to 2.1 (5.9 to 6.8)
Intake Canal	0.30 <sup>(a)</sup> (1.0)	

(a) Flow rate represents the combined flow from all intake pipes once merged in the intake canal.

Water is withdrawn from the intake canal at eight separate intake wells (four per unit). Water enters the wells through a series of trash racks (vertical bars spaced 7.6 cm [3 in.] apart), then through traveling screens (1-cm [3/8-in.] mesh), which are periodically backwashed. The water is then pumped from the wells through the main turbine condensers. Heated water is discharged to the discharge canal. Biofouling of the condenser tubes and other system components is controlled exclusively using plastic foam balls (Taprogge® system) and injecting sodium hypochlorite. The foam balls are injected upstream from the condenser, scrub the condenser tubes as they pass through the tubes, and are collected in ball strainers downstream from the condensers (FPL 1996). FPL uses best management practices to minimize ball loss to the environment. Sodium hypochlorite injections are controlled to ensure that free available oxidant is at or below 0.5 mg/L at the condenser outlet and total residual oxidant concentration at the eastern end of the discharge canal is at or below 0.10 mg/L, as required by the Industrial Wastewater Facility Permit for St. Lucie Units 1 and 2 (FDEP 2000).

The discharge canal is about 670 m (2200 ft) long with transverse dimensions similar to those described for the intake canal. The canal transports the heated cooling water to two discharge pipes at its eastern terminus. The pipes transport water beneath the beach and dune system back to the Atlantic Ocean. One pipe, completed in 1975 to serve St. Lucie Unit 1, is 3.7 m (12 ft) in diameter, extends about 460 m (1500 ft) offshore, and terminates in a two-port "Y" diffuser. The second pipe, installed in 1981 for two-unit operation, is about 4.9 m (16 ft) in diameter, extends about 1040 m (3400 ft) offshore, and features a multiport diffuser. This diffuser consists of 58 41-cm (16-in.) -diameter ports located 7.3 m (24 ft) apart on the easternmost 430 m (1400 ft) of the pipe. The discharge of heated water through the Y-port and multiport diffusers ensure distribution over a wide area and rapid and efficient mixing with ambient waters (FPL 1996; Foster Wheeler 2000). Modeling studies presented by the U.S. Atomic Energy Commission (USACE) and NRC in the operating stage Final Environmental Statements indicate that under typical conditions, the areas of the thermal plumes to the 1.1°C (2°F) isotherm (above ambient) from the St. Lucie Units 1 and 2 diffusers would be about 73 ha (180 ac) and 71 ha (175 ac), respectively (USAEC 1973; NRC 1982).

1 The temperature of the discharged cooling water is limited by the Industrial Wastewater Facility  
2 Permit for St. Lucie Units 1 and 2 (FDEP 2000). These limits require that heated water from  
3 the diffusers, as measured near the exit from the discharge canal, do not exceed 45°C (113°F)  
4 or 16.7°C (30°F) above ambient during normal operations. A maximum temperature of 47.2°C  
5 (117°F) or 17.8°C (32°F) above ambient is permitted during certain maintenance operations,  
6 when throttling circulating water pumps to minimize use of chlorine and when cleaning the  
7 circulating-water system.

8  
9 The auxiliary cooling-water system for St. Lucie Units 1 and 2 is also a once-through cooling  
10 system, but uses much less water than the circulating-water systems. Up to 3660 L/s  
11 (58,000 gpm) of ocean cooling water is pumped from the intake canal using intake cooling-  
12 water pumps. This noncontact cooling water is pumped through heat exchangers to provide  
13 cooling for a wide variety of plant equipment and is discharged to the discharge canal. Low-  
14 level chlorination is used to control biofouling of this system (FPL 1996).

#### 15 16 **2.1.4 Radioactive Waste Management Systems and Effluent Control Systems**

17  
18 FPL uses liquid, gaseous, and solid radioactive waste management systems to collect and  
19 process the liquid, gaseous, and solid wastes that are the by-products of the operation of  
20 St. Lucie Units 1 and 2. These systems process radioactive liquid, gaseous, and solid effluents  
21 to maintain releases to the environment within regulatory limits. The St. Lucie Units 1 and 2  
22 waste disposal system meets the design objectives of 10 CFR Part 50, Appendix I ("Numerical  
23 guides for design objectives, and limiting conditions for operation to meet the criterion 'As Low  
24 as is Reasonably Achievable' for radioactive material in light-water-cooled nuclear power  
25 reactor effluents") and controls the processing, disposal, and release of radioactive liquid,  
26 gaseous, and solid wastes. Radioactive material in the reactor coolant is the source of  
27 gaseous, liquid, and solid radioactive wastes in light-water reactors. Radioactive fission  
28 products build up within the fuel as a consequence of the fission process. These fission  
29 products are contained in the sealed fuel rods, but small quantities escape from the fuel rods  
30 and contaminate the reactor coolant. Neutron activation of the primary coolant system is also  
31 responsible for coolant contamination.

32  
33 Nonfuel solid wastes result from treating and separating radionuclides from gases and liquids  
34 and from removing contaminated material from various reactor areas. Solid wastes also consist  
35 of reactor components, equipment, and tools removed from service, as well as contaminated  
36 protective clothing, paper, rags, and other trash generated from plant design modifications and  
37 operations and routine maintenance activities. Solid wastes are shipped to a waste processor  
38 to reduce its volume before disposal at a licensed burial site. Spent resins and filters are stored

1 or packaged for shipment to a licensed offsite processing or disposal facility. St. Lucie Units 1  
2 and 2 have separate radwaste systems. For reporting effluent releases and calculating offsite  
3 doses, the releases for the two units are combined ( FPL 2000, 2001b).  
4

5 Fuel rods that have exhausted a certain percentage of their fuel and are removed from the  
6 reactor core for disposal are called spent fuel. St. Lucie Units 1 and 2 currently operate on a  
7 staggered 18-month refueling cycle per unit. Spent fuel is stored onsite in the spent fuel pool in  
8 the Fuel Handling Building (FPL 2001a).  
9

10 The *Offsite Dose Calculation Manual* (ODCM; FPL 2002) is subject to NRC inspection and  
11 describes the methods and parameters used for calculating offsite doses resulting from  
12 radioactive gaseous and liquid effluents. It is also used for calculating gaseous and liquid  
13 effluent monitoring alarm/trip setpoints for release of effluents from St. Lucie Units 1 and 2.  
14 The operational limits for releasing liquid and gaseous effluents are specified in the *St. Lucie*  
15 *Units 1 and 2, Annual Radioactive Effluent Release Report* (FPL 2001b) to ensure compliance  
16 with NRC regulations.  
17

#### 18 **2.1.4.1 Liquid Waste Processing Systems and Effluent Controls**

19

20 Potentially radioactive liquid wastes are processed by two systems: a boron recovery system  
21 and a liquid waste system. The boron recovery system processes water from the reactor  
22 coolant system that will be recycled in the plant. The liquid waste system processes liquid  
23 waste from outside of containment, such as process water from equipment drains, floor drains,  
24 laboratory drains, decontamination drains, building sumps, and laundry wastes (FPL 2000,  
25 2001b).  
26

27 The reactor coolant wastes, which are of potentially high activity, are collected from the  
28 chemical and volume control system and from valve and equipment leakage from containment  
29 drains and are placed in holdup tanks. The holdup tanks provide storage until there is an  
30 appropriate volume for batch processing. Storage allows for decay of the short-lived  
31 radionuclides. Degasification that occurs during storage is monitored by the plant vent  
32 monitors. The holdup tanks are sampled and processed until the contents meet the criteria for  
33 discharge. Before the controlled discharge of the treated liquid waste, the fluid is analyzed to  
34 determine that the activity is acceptably low for discharge. Discharged liquids pass through an  
35 effluent radiation monitor that records the release activity level and automatically terminates the  
36 release upon high radiation to the circulating water discharge. If the liquid is to be reused in the  
37 plant, the fluid is analyzed for acceptability of both chemistry and activity (FPL 2000, 2001b).  
38

39 The ODCM provides the control statements, limits, action statements, and surveillance  
40 requirements for ensuring that the liquid effluents released to unrestricted areas or the site  
41 boundary will be maintained within the requirements of 10 CFR Part 20, 40 CFR Part 190,

1 10 CFR 50.36.a, and 10 CFR Part 50, Appendix I. The ODCM also contains the calculation of  
2 the liquid effluent monitoring alarm/trip setpoints. The alarm/trip setpoint for each liquid-effluent  
3 monitor is based on the measurements of radioactivity in a batch of liquid to be released or in  
4 the continuous liquid discharge (FPL 2002).

5  
6 During 2000, there were 31 batch releases for each unit at St. Lucie with a total volume of  
7  $7.2 \times 10^7$  L ( $1.9 \times 10^7$  gal) of liquid waste released before dilution for the two units. This liquid  
8 waste had a total fission and activation product activity of 2800 MBq (0.076 Ci) and total tritium  
9 activity of  $2.1 \times 10^7$  MBq (557 Ci). These volumes and activities are typical of past years. The  
10 actual liquid waste generated is reported in the *St. Lucie Units 1 and 2, 2000 Annual*  
11 *Radioactive Effluent Release Report* (FPL 2001b).

12  
13 FPL does not anticipate any increase in liquid waste releases during the renewal period.

#### 14 15 **2.1.4.2 Gaseous Waste Processing Systems and Effluent Controls**

16  
17 The gaseous waste systems for St. Lucie Units 1 and 2 process the vent gases from equipment  
18 located in the chemical volume control system, waste management system, and fuel pool  
19 system. Gaseous releases come from the reactor auxiliary building ventilation, turbine system  
20 leakage, steam jet air ejector operation, gland steam condenser operation, and containment  
21 purging in addition to releases from the gas collection header and gas surge header. The  
22 gaseous waste system is designed to protect workers and the public as well as meet the  
23 requirements in 10 CFR 20 and 10 CFR 50, Appendix I (FPL 2000, 2001b). Gases handled by  
24 the gaseous waste system may be compressed and stored in the gas decay tanks or may be  
25 released to the plant vent if the activity is sufficiently low. After decay, the gas in the waste gas  
26 decay tanks is sampled to ensure that the radioactivity levels are within acceptable limits for  
27 release. The monitored gaseous release points are the containment building purge, the reactor  
28 auxiliary building, the fuel handling building, and the turbine generator building (FPL 2000).  
29 These release points are continuously monitored for noble gases, radioiodines, and particulate  
30 activity. The ODCM prescribes alarm/trip setpoints for these effluent monitors and control  
31 instrumentation to ensure that the alarm/trip will occur before exceeding the limits of 10 CFR  
32 Part 20 for gaseous effluents. These release points are continuously monitored and provide  
33 alarms and automatic valve closure when radiation levels exceed a preset level, thus  
34 terminating discharge.

35  
36 During 2000, there was a total fission and activation gas activity of  $5.2 \times 10^5$  MBq (14 Ci), a total  
37 iodine activity of 0.55 MBq ( $1.5 \times 10^{-5}$  Ci), a total particulate activity including gross alpha, beta,

1 and gamma of 14 MBq ( $3.8 \times 10^{-4}$  Ci), and a total tritium activity of  $6.6 \times 10^6$  MBq (178 Ci)  
2 released from the two units. These releases are typical of past years. In addition, during 2000,  
3 there was a minor unplanned gaseous release from Unit 2 that resulted in a release of  $2.3 \times 10^5$   
4 MBq (6.2 Ci) of radioactive material (FPL 2001b). The dose contribution from this unplanned  
5 release was negligible and no site release rate, quarterly dose limits, or annual dose limits were  
6 exceeded.

7  
8 FPL does not anticipate any increase in gaseous releases during the renewal period and  
9 releases will remain within the regulatory limits.

### 10 11 **2.1.4.3 Solid Waste Processing**

12  
13 The solid wastes from St. Lucie Units 1 and 2 consist of concentrated liquid sludge, spent resin,  
14 spent filter cartridges, solid noncompactible and compactible trash, and miscellaneous  
15 materials from station and radwaste facility operation and maintenance. The Solid Waste  
16 Management System collects, controls, processes, packages, and temporarily stores solid  
17 radioactive waste and certain liquid radioactive waste generated as a result of normal plant  
18 operations. Concentrated liquid sludge is segregated by type, flushed to storage tanks, slurried  
19 into an appropriate container, and stored onsite before shipment offsite for disposal. Ion-  
20 exchange resins are sluiced into the spent resin tank or shipping container and dewatered.  
21 Filters are moved into shipping containers. Compressible waste is compacted if possible, or  
22 shipped offsite to a reduction facility for processing. Noncompressible waste is packaged in  
23 boxes or bags. All of these wastes are packaged and shipped offsite to an appropriate disposal  
24 or processing system (FPL 2000, 2001b).

25  
26 In 2000, FPL made 21 shipments of solid waste from St. Lucie with a volume of  $78.8 \text{ m}^3$   
27 ( $2785.3 \text{ ft}^3$ ), and a total activity of  $1.99 \times 10^7$  MBq (537 Ci) (FPL 2001b). These shipments are  
28 representative of the shipments made in the past several years and are not expected to change  
29 appreciably during the license renewal period.

### 30 31 **2.1.5 Nonradioactive Waste Systems**

32  
33 When St. Lucie Units 1 and 2 were originally licensed, the sanitary waste system in use was a  
34 septic tank and associated leaching fields for treatment and disposal of onsite sewage. The  
35 flow of groundwater is predominately to the east towards the Atlantic Ocean. Because of the  
36 inherent problems with septic systems, the licensee anticipated tying into the municipal sewage  
37 facilities when a sewer line was installed on the island (AEC 1973, 1974). Since September  
38 1997, upon completion of St. Lucie County's South Hutchinson Island Water Reclamation  
39 Facility, site sanitary wastewater has been discharged in the St. Lucie County system for  
40 treatment (FPL 2001a).

1 **2.1.6 Plant Operation and Maintenance**

2  
3 Routine maintenance performed on plant systems and components is necessary for safe and  
4 reliable operation of a nuclear power plant. Maintenance activities at St. Lucie Units 1 and 2  
5 include inspection, testing, and surveillance to maintain the current licensing basis of the plant  
6 and to ensure compliance with environmental and safety requirements. Certain activities can  
7 be performed while the reactor is operating. Others require that the plant be shut down. Long-  
8 term outages are scheduled for refueling and for certain types of repairs or maintenance, such  
9 as replacement of a major component. FPL refuels each of the St. Lucie nuclear units on an  
10 18-month schedule, resulting in at least one refueling every year and two refuelings every third  
11 year (FPL 2001a). A third of the core is offloaded at each refueling. An additional 575 to 870  
12 workers are temporarily onsite during a typical 30- to 40-day outage.

13  
14 FPL provided its aging management review for each unit in its application to the U.S. NRC for  
15 renewed operating licenses for St. Lucie Units 1 and 2 (FPL 2001c). Chapter 3 and Appendix B  
16 of the St. Lucie Units 1 and 2 license renewal application outline the programs and activities  
17 that will manage the effects of aging during the license renewal period (FPL 2001c). FPL  
18 expects to conduct the activities related to the management of aging effects during plant  
19 operation or normal refueling and other outages, but plans no outages specifically for the  
20 purpose of refurbishment. FPL has no plans to add additional full-time staff (non-outage  
21 workers) at the plant during the period of the renewal licenses.

22  
23 **2.1.7 Power Transmission System**

24  
25 FPL constructed three 230-kV transmission lines to connect St. Lucie Units 1 and 2 to the  
26 transmission system (FPL 2001a). These three lines are all within a single transmission line  
27 right-of-way that runs west from the St. Lucie plant, crosses the Indian River, then runs over  
28 land for approximately 18 km (11 mi), terminating at the Midway substation (Figure 2-2). Most  
29 of the right-of-way is approximately 200 m (660 ft) wide, except for the last several miles where  
30 the three St. Lucie transmission lines share the right-of-way with other transmission lines that  
31 are not directly associated with St. Lucie Units 1 and 2. The last 2.4 km (1.5 mi) of the right-of-  
32 way is shared with three other 230-kV lines and one 500-kV line. The total right-of-way width is  
33 approximately 330 m (1080 ft). In total, the right-of-way occupies approximately 310 ha  
34 (766 ac). FPL is the property owner for all of the transmission line right-of-way except for the  
35 last 2.4 km (1.5 mi), which is held in easement.

36  
37 There are a variety of land uses and habitat types within the St. Lucie-to-Midway right-of-way  
38 including abandoned agricultural lands, pasture lands, sand pine scrub, dry prairie, pine

1 flatwoods, wet prairie, isolated marshes, and ruderal and disturbed sites (FPL 2001a). The  
2 right-of-way passes through a portion of the Savannas State Preserve, a nearly 2000-ha  
3 (4900-ac) environmental area managed by the Florida Department of Environmental Protection  
4 (FDEP) – Division of Parks.

5  
6 FPL maintains the transmission right-of-way using a combination of trimming, mowing, and  
7 herbicide application. When required, FPL trims trees at a height of 4.3 m (14 ft) to maintain  
8 clearances below the conductors. Tree trimming is typically needed only at midspan. In open  
9 areas, FPL usually follows a 5-year mowing cycle. Herbicides are used both for spot treatment  
10 of individual trees and occasionally as broadcast applications to control exotic grasses. FPL  
11 uses only nonrestricted-use herbicides, which are applied under the supervision of licensed  
12 pesticide applicators.

## 14 **2.2 Plant Interaction with the Environment**

15  
16 Sections 2.2.1 through 2.2.8 provide general descriptions of the environment as background  
17 information. They also provide detailed descriptions where needed to support the analysis of  
18 potential environmental impacts of refurbishment and operation during the renewal term, as  
19 discussed in Chapters 3 and 4. Section 2.2.9 describes the historic and archaeological  
20 resources in the area, and Section 2.2.10 describes possible impacts on other Federal project  
21 activities.

### 23 **2.2.1 Land Use**

24  
25 St. Lucie Units 1 and 2 are located on Hutchinson Island in an unincorporated portion of  
26 St. Lucie County, Florida. The nearest municipalities are Fort Pierce, located approximately  
27 11 km (7 mi) northwest of the plant; Port St. Lucie, located approximately 7 km (4.5 mi) west of  
28 the plant; and Stuart, located approximately 13 km (8 mi) south of the plant. Fort Pierce is the  
29 county seat of St. Lucie County. Port St. Lucie is the largest city within 80 km (50 mi) of the  
30 plant site.

31  
32 St. Lucie Units 1 and 2 occupy approximately 457 ha (1130 ac) on the widest portion of  
33 Hutchinson Island. The plant site is zoned for utility use under the St. Lucie County Land  
34 Development Code.

35  
36 Section 307(c)(3)(A) of the Coastal Zone Management Act [16 USC 1456(c)(3)(A)] requires that  
37 applicants for Federal licenses to conduct an activity in a coastal zone certify that the proposed  
38 activity is consistent with the enforceable policies of the State's coastal zone program. A copy  
39 of the certification is also to be provided to the State. The State is to notify the Federal agency  
40 whether the State concurs with or objects to the applicant's certification. This notification is to  
41 occur within 6 months of the State's receipt of the certification. The St. Lucie plant is within

## Plant and the Environment

1 Florida's coastal zone for purposes of the Act. Following submission of the FPL certification of  
2 consistency, the Florida Department of Community Affairs determined that renewal of the  
3 operating licenses (OLs) for St. Lucie Units 1 and 2 would be consistent with the Florida  
4 Coastal Management Program (Collins 2002). A copy of the determination is in Appendix E of  
5 this draft SEIS.  
6

### 7 **2.2.2 Water Use**

8  
9 St. Lucie Units 1 and 2 receive water from the City of Fort Pierce and the Fort Pierce Utilities  
10 Authority for potable and service uses at the plant. This freshwater is derived from groundwater  
11 sources on the mainland, and plant operations do not involve any additional groundwater  
12 withdrawal. Current plant usage averages approximately  $4.98 \times 10^5$  L (131,500 gal) per day  
13 with no restrictions on supply. Noncontact cooling water for St. Lucie Units 1 and 2 is  
14 withdrawn from the Atlantic Ocean. Additional minor amounts of ocean water are used to  
15 enhance the growth of mangroves, assist in mosquito control, and for mariculture and related  
16 projects.  
17

### 18 **2.2.3 Water Quality**

19  
20 In accordance with the Federal Water Pollution Control Act (also known as the Clean Water  
21 Act), the water quality of plant effluent discharges is regulated through the National Pollutant  
22 Discharge Elimination System (NPDES). The FDEP is the agency in the State of Florida  
23 delegated by the U.S. Environmental Protection Agency to issue discharge permits in Florida.  
24

25 Groundwater is generally very shallow at the site, and typically is just a few inches above mean  
26 sea level. Recharge of freshwater is via infiltration of rainfall, and the depth of fresh water is  
27 only a foot or so below the water table. No groundwater is withdrawn as part of plant  
28 operations. Groundwater was previously withdrawn from the site to address a diesel fuel spill  
29 that occurred in 1992. The remediation is ongoing, with approximately 19,000 L (5000 gal) of  
30 spilled diesel fuel recovered to date. Approximately 760 L (200 gal) per year are still being  
31 recovered. Most of the diesel fuel has been filtered and reused onsite.  
32

33 The current Industrial Wastewater Facility Permit (FDEP 2000) for St. Lucie Units 1 and 2  
34 requires no groundwater monitoring at the site. Plant effluent is discharged to the Atlantic  
35 Ocean (a Class III marine water), the mangrove impoundment, and the intake canal. All  
36 discharges are monitored and regulated under the Industrial Wastewater Facility Permit  
37 (FDEP 2000).  
38

1 An onsite package plant was originally used to treat the site sanitary wastewater, which was  
2 previously discharged into the discharge canal and is now discharged to the St. Lucie County's  
3 South Hutchinson Island Water Reclamation Facility for treatment.

4  
5 St. Lucie Units 1 and 2 have not had any significant NPDES compliance issues based on  
6 annual inspections the FDEP has conducted since 1993 (Davis 2002). Anticipated future  
7 operations at St. Lucie Units 1 and 2 suggest that compliance with NPDES regulations will  
8 continue.

#### 9 10 **2.2.4 Air Quality**

11  
12 The St. Lucie site has a subtropical climate with mild dry winters and long, warm summers with  
13 abundant rainfall. Climatological records for West Palm Beach, Florida, are generally  
14 representative of the St. Lucie site; the position of St. Lucie between the Indian River Lagoon  
15 and the Atlantic Ocean tends to moderate temperatures and alter precipitation amounts and  
16 timing.<sup>(a)</sup> Climatological records for West Palm Beach indicate that the dry season lasts from  
17 mid-November through April, and the wet season is from May through mid-November. Normal  
18 daily maximum temperatures for West Palm Beach range from about 24°C (75°F) in January to  
19 a high of about 32°C (90°F) in July and August. Normal minimum temperatures range from  
20 about 13°C (56°F) in January to about 24°C (75°F) in August. Normal monthly precipitation  
21 ranges from 5 to 8 cm (2 to 3 in.) in the dry season to 15 to 20 cm (6 to 8 in.) in the wet season.

22  
23 Although thunderstorms occur in all months in the area, more than 80 percent of them occur  
24 from May through September. During July and August, thunderstorms occur on more than  
25 50 percent of the days (FPL 2000). August and September are the height of the hurricane  
26 season. In any year, the probability of hurricane-force winds striking the site is about 1 in 15  
27 (FPL 2000). Based on statistics for the 30 years from 1954 through 1983 (Ramsdell and  
28 Andrews 1986), the probability of a tornado striking the site is expected to be about  $5 \times 10^{-5}$   
29 per year. Waterspouts, which are similar to weak tornadoes, occasionally occur along the  
30 Florida coast in the vicinity of St. Lucie. FPL estimates the probability of a waterspout striking a  
31 point offshore within 3.2 km (2 mi) of the coastline to be about  $5 \times 10^{-4}$  per year (FPL 2000).

32  
33 The wind energy resource in Florida is limited. The annual average wind power in most of  
34 Florida is rated 1 on a scale of 1 through 7; in coastal areas, the rating is 2 at best (Elliott  
35 et al. 1987). Areas suitable for wind turbine applications have a rating of 3 or higher. No area  
36 in Florida is rated 3 or higher.

37  

---

  
(a) Climatological data for West Palm Beach are available at  
<http://www.ncdc.noaa.gov/ol/climate/climatedata.html>.

## Plant and the Environment

1 Most of the year, the region is under the influence of the Bermuda high-pressure system. High-  
2 pressure systems are generally associated with low winds and increased potential for air  
3 pollution. However, because of its coastal location, meteorological conditions conducive to high  
4 air pollution are infrequent at St. Lucie. The St. Lucie site is located within the South Florida  
5 Intrastate Air Quality Control Region. In addition, the Central Florida Interstate Air Quality  
6 Control Region and the Southwest Florida Intrastate Air Quality Control Region are within  
7 80 km (50 mi) of St. Lucie. These regions are designated as in attainment or unclassified for all  
8 criteria pollutants in 40 CFR 81.310.

9  
10 The Everglades National Park is designated in 40 CFR 81.407 as a mandatory Class 1 Federal  
11 area in which visibility is an important value. The park, which is the closest Class 1 area to  
12 St. Lucie, is approximately 180 km (110 mi) from the St. Lucie site. The other Class 1 areas in  
13 Florida are more than 240 km (150 mi) from the site.

14  
15 Diesel generators, boilers, and other activities and facilities associated with St. Lucie Units 1  
16 and 2 emit various pollutants. Emissions from these sources are regulated under Air Permit  
17 1110071-003-AO issued by the FDEP. The current air emissions permit expires on June 26,  
18 2005.

### 2.2.5 Aquatic Resources

19  
20  
21  
22 The St. Lucie Units 1 and 2 location on Hutchinson Island places it between two major aquatic  
23 ecosystems: the Atlantic Ocean to the east and the Indian River Lagoon to the west. The plant  
24 uses a once-through cooling-water system that withdraws from and discharges into the Atlantic  
25 Ocean via offshore intake and discharge structures. The plant is also equipped with an  
26 emergency cooling-water intake that can withdraw water from the Indian River Lagoon via Big  
27 Mud Creek, but this pathway is closed during normal operation (see Section 2.1.3). These  
28 areas contain markedly different habitats and biotic communities, as discussed below.

#### 2.2.5.1 Atlantic Ocean

29  
30  
31  
32 Submerged coquinooid rock formations parallel much of Hutchinson Island. A notable beach  
33 frontage feature at the plant site, just south of the St. Lucie Units 1 and 2 intake canal, is an  
34 intertidal coquina-rock formation that protrudes through the sand at Walton Rocks Park. The  
35 hard substrate is colonized extensively by an encrusting tube-building marine polychaete  
36 worms, family Sabellariidae. These worm reef communities in turn support a rich and diverse  
37 association of other invertebrates, algae, and fishes. The near shore area has no reef  
38 structures, grass beds, or rock outcroppings. Seaward, the ocean floor consists of  
39 unconsolidated sediments composed of quartz and calcareous sands, broken shell fragments,  
40 and negligible amounts of silts and clays. The sea floor gently slopes into a trough with a

1 maximum depth of about 11.9 m (39 ft) at about 1.9 km (1 nautical mile) offshore. Continuing  
2 offshore, the sea floor rises to form the Pierce Shoal at about 3.2 km (2 mi).

3  
4 The marine communities in the vicinity of St. Lucie Units 1 and 2 were studied in detail prior to  
5 startup of Unit 1 in 1976 (FPL 1973). Phytoplankton were collected at five locations offshore of  
6 Hutchinson Island. Densities ranged from 1 to over 35,000 cells/L during the study period, but  
7 varied little from location to location. The community was dominated by diatoms, the most  
8 common of which were the genera *Nitzschia*, *Bellerochea*, and *Chaetoceros*, and the species  
9 *Thalassionema nitzschioides* and *Skeletonema costatum*. The data indicated the possibility of  
10 two blooms per year, one during September and October and one during January.  
11 Chlorophyll *a* concentrations ranged from about 0.1 to 7.7 mg/m<sup>3</sup> and correlated well with the  
12 September-October phytoplankton bloom. The composition of the phytoplankton communities  
13 was typical of those described for other nearshore areas along the eastern seaboard of the  
14 United States.

15  
16 Zooplankton were sampled at the same locations as phytoplankton, and ranged in density from  
17 about 250 to 12,000 organisms/m<sup>3</sup>. The zooplankton community was characterized primarily by  
18 neritic holoplanktonic species (species that spend their entire life cycle in the water column).  
19 Copepods dominated the collections with the genera *Acartia*, *Paracalamis*, *Oithona*, *Temora*,  
20 *Undinula*, *Corycaeus*, *Euterpina*, and *Labidocera* being common. Zooplankton density  
21 appeared to be broadly correlated with phytoplankton density.

22  
23 Monitoring data indicated that there were three sub-tidal microhabitats offshore of the plant:  
24 shallow beach terrace, offshore shoal, and a deeper trough in between the two. Sediment  
25 composition differed among these zones. The biological composition of macroinvertebrate  
26 communities is largely influenced by sediment composition. Because of the sediment  
27 heterogeneity, the trough supports the most abundant fauna. It was characterized by high  
28 diversity and relatively rapid turnover of less abundant and more transient species. In the  
29 intertidal zone, the worm reef community provided yet another distinct habitat for  
30 macroinvertebrates. Patterns of fish abundance and diversity were also largely aligned along  
31 microhabitat boundaries. In addition to the habitats identified above, the surf zone harbored yet  
32 another distinct assemblage of fish.

33  
34 Baseline data include 127 species of arthropods and nearly 300 species of mollusks. The  
35 diverse makeup of these groups, and to some extent their seasonal variability, was attributed to  
36 the transitional temperate, subtropical, and tropical mix of climate and water masses in the  
37 general vicinity of Hutchinson Island. Some estuarine affinities were also noted and attributed  
38 to water mass intrusions from the Indian River Lagoon by way of St. Lucie Inlet and prevailing  
39 northerly coastal currents. Among species of direct commercial value, the Atlantic calico  
40 scallop (*Argopecten gibbus*) was the only mollusk recorded. Arthropods of potential commercial

## Plant and the Environment

1 value included shrimp (of the family Penaeidae) and the blue crab (*Callinectes sapidus*).  
2 However, these species were generally collected in small numbers and infrequently.

3  
4 Benthic studies conducted through 1984 produced remarkable databases for regional  
5 sediments, hydrology, and bottom dwelling organisms. A total of 934 taxa of benthic  
6 macroinvertebrates, many species new to science, were identified.

7  
8 The fish communities offshore are transitional assemblages of temperate and tropical forms.  
9 Since oceanic ichthyofauna are most diverse and abundant near reefs and other hard-bottom  
10 areas, FPL sited intake and discharge structures for St. Lucie Units 1 and 2 in areas devoid of  
11 these habitats.

12  
13 Fisheries assessments were carried out in association with startup and operations of St. Lucie  
14 Units 1 and 2. Bottom trawls were used for several years, but collected few fish (FPL 1973).  
15 For example, sampling every other month at five Hutchinson Island offshore locations from  
16 September 1971 to March 1972 resulted in 39 fish (13 species) collected. The sheepshead  
17 (*Archosargus probatocephalus*) was most abundant in these collections. Beach seines were  
18 deployed over this same time period. Ninety-eight percent of the catch of 11,598 fish was  
19 collected in November 1971, and consisted primarily of Cuban and longnose anchovies  
20 (*Anchoa cubana* and *A. nasuta*) and 20 other less abundant species. Ichthyoplankton was also  
21 sampled during the earlier monitoring (NRC 1982). Larvae of herring and anchovies were most  
22 common, and generally abundant during spring and summer. This monitoring yielded 5570  
23 individuals distributed among 49 species. The five most abundant species accounted for nearly  
24 70 percent of the catch: Atlantic bumper (*Chloroscombrus chrysurus*), Spanish mackerel  
25 (*Scomberomorus maculatus*), Atlantic croaker (*Micropogonias undulatus*), spot (*Leiostomus*  
26 *xanthurus*), and bluefish (*Pomatomus saltatrix*). Catches were higher in fall and winter than  
27 spring and summer. In comparing 8 years of monitoring data (1977-1984), investigators found  
28 temporal and spatial distributions to be highly variable (Applied Biology 1985).

29  
30 Commercial and recreational fishing are important activities in the vicinity of St. Lucie Units 1  
31 and 2. Commercial landing data for St. Lucie County were summarized for 1970-1972  
32 (FPL 1973). Their evaluation focused on the three most abundant species in commercial  
33 catches at that time, bluefish, Spanish mackerel, and king mackerel (*Scomberomorus cavalla*).  
34 All are highly migratory, spawn in coastal waters from late summer into winter (depending on  
35 species), and migrate northward along the East Coast during the warmer seasons. For the  
36 1971 season, landed weights of bluefish, Spanish mackerel, and king mackerel from St. Lucie  
37 County were about 104,000 kg (228,663 lb), 308,000 kg (679,110 lb), and 525,000 kg  
38 (1,217,356 lb), respectively. These landings represented 10.7 percent, 6.8 percent, and  
39 21.6 percent, respectively, of total Florida landings. These species were also prominent in the  
40 1982 landings for St. Lucie County (Applied Biology 1985), ranging from about 104,000 kg

1 (236,146 lb) of bluefish to about 408,000 kg (899,944 lb) of Spanish mackerel. However,  
2 several other species were quite abundant in 1982, including tilefish (*Caulolatilus* spp.)  
3 (267,000 kg [587,654 lb]) and swordfish (*Xiphias gladius*) (205,000 kg [451,503 lb]).  
4

5 St. Lucie County is the northernmost county on Florida's east coast that has an extensive winter  
6 sport fishery (FPL 1973). Ladyfish (*Elops saurus*), common snook (*Centropomus undecimalis*),  
7 and various billfish species were common in recreational catches. Pre-operational studies  
8 revealed that the three most important commercially valuable fish in local ocean fisheries  
9 (bluefish, Spanish mackerel, and king mackerel) occur farther offshore than where the intake  
10 and discharge lines now terminate (i.e., trough habitat). These species are only seasonally  
11 abundant during migrations in spring and fall.  
12

### 13 2.2.5.2 Indian River Lagoon

14  
15 The Indian River Lagoon is a productive estuary that abuts the western edge of the St. Lucie  
16 Units 1 and 2 property. Environmental studies were conducted in the Lagoon from the late  
17 1960s into the 1980s in association with siting, construction, and operation of St. Lucie Units 1  
18 and 2 (FPL 1973; NRC 1982).  
19

20 The Lagoon is characterized by extensive growths of manatee grass (*Syringodium filiforme*)  
21 and red algae such as the dominant form *Gracilaria* sp. In turn, the grass and algae are  
22 inhabited by a variety of gammarids, shrimp, isopods, crabs, and juvenile fish. A variety of  
23 microscopic organisms are supported by this vegetative community, including diatoms attached  
24 to the plant leaves. Planktonic organisms are abundant and diverse in the Indian River Lagoon  
25 owing to constant deposition of organic matter from the floral community. The organic matter is  
26 decomposed by bacteria, releasing mineral nutrients that are used by algae (including  
27 phytoplankton). Zooplankton such as protozoa, rotifers, and copepods maintain abundant  
28 populations by feeding on the bacteria. More than 90 phytoplankton species have been  
29 reported from the Lagoon. Benthic organisms are also abundant and include tube-dwelling  
30 worms and crustaceans, the latter including larger shellfish such as shrimp and blue crabs.  
31 Twenty four decapod species (e.g., shrimp, crabs) were collected from Big Mud Creek near  
32 St. Lucie Units 1 and 2 in the early 1970s.  
33

34 Big Mud Creek, a backwater cove of the Indian River Lagoon, was dredged to a maximum  
35 depth of approximately 14 m (46 ft) during plant construction to provide deep-water access to  
36 the Intracoastal Waterway. Being some distance from both the Fort Pierce and St. Lucie inlets,  
37 Big Mud Creek receives little tidal influence and so has minimal water exchange with Indian  
38 River Lagoon. This results in water stratification in the summer and anoxic conditions on the  
39 bottom. During the winter months, the water masses turn over as the surface cools. A diverse  
40 and abundant fish community of over 300 species has been identified in the southern portion of  
41 the Indian River Lagoon (NRC 1982). Red drum (*Sciaenops ocellatus*), spotted seatrout

## Plant and the Environment

1 (*Cynoscion nebulosus*), common snook, sheepshead (*Archosargus probatocephalus*), and gray  
2 snapper (*Lutjanus griseus*) were commonly reported. During the last 20 years, the increasing  
3 levels of human activities in its watershed have impacted the lagoon's water, sediment, and  
4 habitat quality. As the construction of extensive agricultural and urban drainage projects have  
5 increased the watershed's size, the land-use changes associated with increased residential,  
6 commercial, agricultural, and industrial development have altered the freshwater inputs to the  
7 Lagoon. Alteration of the normal patterns of freshwater inputs has contributed to changes in  
8 the biological communities in the lagoon. Reductions in abundance and distribution of sea  
9 grasses and oysters are evidence of these changes.

### 10 11 **2.2.5.3 Threatened or Endangered Aquatic Species**

12  
13 Fifteen species of aquatic fauna and flora, observed on or near the St. Lucie Units 1 and 2 site,  
14 are listed as threatened, endangered, or State species of special concern (SSC) by Federal or  
15 State agencies (Table 2-2). Several species of sea turtle and the Florida manatee (*Trichechus*  
16 *manatus*) have been documented at the St. Lucie Units 1 and 2 site. The most common  
17 occurrences of threatened or endangered species at the site are the sea turtles.

18  
19 Five species of sea turtle have been reported from Hutchinson Island. The Federally  
20 threatened loggerhead sea turtle (*Caretta caretta*) has historically been most common.  
21 Between 5000 and 8000 loggerhead nests have been reported on Hutchinson Island over the  
22 last 10 years (Ecological Associates 2000). The endangered green sea turtle (*Chelonia mydas*  
23 *mydas*) also nests on Hutchinson Island, but these nests are less abundant than those of the  
24 loggerhead. The endangered leatherback sea turtle (*Dermochelys coriacea*) infrequently nests  
25 on Hutchinson Island. Nest numbers have shown an upward trend in the last 20 years, though  
26 they have varied widely. During 1996 through 2000, the number of leatherback nests has  
27 ranged from 42 in 1997 to 143 in 1999 (FPL 2001d). The endangered Kemp's ridley sea turtle  
28 (*Lepidochelys kempi*) and hawksbill sea turtle (*Eretmochelys imbricata*) do not nest on  
29 Hutchinson Island and have only infrequently been reported from the area.

30  
31 Six protected mammals (five species of whales and the Florida manatee) occur in the vicinity of  
32 the St. Lucie site. The whales are listed as endangered by the Federal government and Florida  
33 State. All occur in ocean waters of Hutchinson Island. Both humpback (*Megaptera*  
34 *novaeanliae*) and North Atlantic right whales (*Eubalaena glacialis*) have been observed in  
35 relatively close proximity to the shore in the immediate vicinity of the plant. These sightings  
36 occur between January and March. Waters of the southeastern United States are considered  
37 wintering and calving grounds for right whales (Waring et al. 1999). Three additional species of  
38 whale have been reported on rare occasions.

1 The Florida, or West Indian, manatee inhabits the Indian River Lagoon and Atlantic coastal  
 2 waters off Hutchinson Island. Although preferred habitats are in the Indian River Lagoon and  
 3 other inland waterways, where food sources are abundant, they do occasionally travel up and  
 4 down the coast near the shore. Manatees are known to congregate in the warm water effluents  
 5 of power plants during winter months. There are abundant food resources near the facilities  
 6 where they congregate.

8 None of the fish species are Federally listed, but of those listed in Table 2-2, all are designated  
 9 as Species of Special Concern by the State of Florida. The Atlantic sturgeon (*Acipenser*  
 10 *oxyrinchus*) inhabits salt or brackish water and may move into fresh water to spawn  
 11 (Gilbert 1992). It has been collected along the Atlantic coast of Hutchinson Island and is listed  
 12 as an occasional inhabitant of the nertic and surf zones over sand and shell bottoms (Gilmore  
 13 et al. 1981). Atlantic sturgeon have not been collected in the intake canal or during operational  
 14 monitoring offshore near St. Lucie Units 1 and 2.

16 The mangrove rivulus (*Rivulus marmoratus*) is listed as a rare inhabitant of mangroves,  
 17 freshwater tributaries, canals, and mosquito impoundments (Gilmore et al. 1981).

19 The common snook is a highly prized recreational species common to the Indian River Lagoon  
 20 and nearshore ocean water adjacent to the St. Lucie plant. Fishing for this species is regulated  
 21 by the State of Florida. Closed seasons permit snook to migrate and spawn without substantial  
 22 impacts to the population. During open seasons, regulations regarding the number and size of  
 23 individuals that can be kept are strictly enforced. Snook were taken in offshore trawls during  
 24 operational studies, and they are regularly entrained with cooling water.

26 The only listed species of aquatic vegetation found in the vicinity of the St. Lucie plant is  
 27 Johnson's seagrass (*Halophila johnsonii*). Johnson's seagrass is found in the Indian River  
 28 Lagoon, most often near inlets.

30 **Table 2-2. Federally Listed and Florida State-Listed Aquatic Species Potentially Occurring**  
 31 **in Miami-Dade and Monroe Counties**

33	Scientific Name	Common Name	Federal Status <sup>(a,b)</sup>	State Status <sup>(a,b)</sup>
34	<i>Caretta caretta</i>	loggerhead sea turtle	T	T
35	<i>Chelonia mydas mydas</i>	green sea turtle	E	E
36	<i>Dermochelys coriacea</i>	leatherback sea turtle	E	E
37	<i>Eretmochelys imbricata</i>	hawksbill sea turtle	E	E
38	<i>Lepidochelys kemp</i>	Kemp's ridley sea turtle	E	E
39	<i>Balaenoptera borealis</i>	Sei whale	E	E

Table 2-2. (cont'd)

	Scientific Name	Common Name	Federal Status <sup>(a)</sup>	State Status <sup>(a)</sup>
3	<i>Balaenoptera phusalus</i>	finback whale	E	E
4	<i>Eualaena glacialis</i>	North Atlantic right whale	E	E
5	<i>Megaptera novaeangliae</i>	humpback whale	E	E
6	<i>Physeter catodon</i>	sperm whale	E	E
7	<i>Trichechus manatus</i>	Florida manatee	E	E
8	<i>Acipenser oxyrinchus</i>	Atlantic sturgeon	-	SSC
9	<i>Centropomus undecimalis</i>	common snook	-	SSC
10	<i>Rivulus marmoratus</i>	mangrove rivulus	-	SSC
11	<i>Halophila johnsonii</i>	Johnson's seagrass	T	T

NOTES:  
a. Sources: (Florida Department of Agricultural and Consumer Services 1998; FFWCC 2001)  
b. E = endangered; T = threatened, - = no listing status, SSC = State species of special concern.

## 2.2.6 Terrestrial Resources

Hutchinson Island is typical of the offshore sandbars that line the southern U.S. Atlantic coastline. It consists of a sandbar on the eastern side that rises to about 4.6 m (15 ft) above mean sea level and a broader, sloping swale on the western side. The seaward side of the dunes currently has no vegetation, and the inland side of the dunes is dominated by sea oats (*Unida paniculata*), sea grape (*Coccoloba uvifera*), salt marsh hay (*Spartina patens*), Australian pine (*Casuarina equisetifolia*), marsh ox-eye (*Barrichia frutescens*), beach sunflower (*Helianthus debilis*), marsh elder (*Iva frutescens*), bay bean (*Canavalia rosea*), and railroad vine (*Ipomoea pescaprae*) (Foster Wheeler 2001).

Before the 1930s, the mangrove swamps on the western side of the island were maintained by tidal and occasional storm-driven incursions of sea water as well as by rain (AEC 1973). The swales were dominated by red mangrove (*Rhizophora mangle*), with black mangrove (*Avicennia nitida*) and white mangrove (*Raguncularia racemosa*) established in the higher and less frequently flooded ground. These mangrove swamps are noteworthy for their high productivity and the rich animal communities they support. Much of these natural mangrove swamps was destroyed during the 1930s and 1940s as part of a mosquito control program initiated by the Work Project Administration. The swamps were trenched, diked, and flooded with sea water, which greatly reduced mosquito breeding but also led to the loss of many trees, especially the black mangrove (AEC 1973). Since that time, there has been partial restoration of the swales, but much of the area continues to be maintained in an inundated state by the local mosquito control districts.

1 A few small tropical hammock habitats exist on Hutchinson Island near the St. Lucie site; the  
2 largest is found in the mangrove stands north of the discharge canal. These habitats are  
3 unusual this far north. Prominent species include gumbo-limbo (*Bursera simaruba*), paradise  
4 tree (*Simarouba glauca*), white and Spanish stoppers (*Eugenia axillaris* and *E. foetida*), wild  
5 lime (*Zanthoxylum fagara*), white indigo berry (*Randia aculeata*), mastic (*Mastichodendron*  
6 *foetidissimum*), and snow berry (*Chiocococca alba*).

7  
8 Habitat in the transmission line right-of-way is a mixture of human-altered areas, sand pine  
9 scrub, prairie/pine flatwoods, wet prairie, and isolated marshes. In the 1970s, much of the  
10 right-of-way was used for agricultural purposes such as orange groves, row crops, and  
11 pastureland (AEC 1973). Most of that agricultural use has since been abandoned, except for  
12 the western portions used for grazing.

13  
14 There are no designated critical habitat areas for any Federal-listed endangered or threatened  
15 species at the St. Lucie site or along the transmission line right-of-way. However, the beach  
16 areas on the eastern side of Hutchinson Island are important nesting areas for the loggerhead  
17 sea turtle, and they are also used to a lesser extent by green and leatherback sea turtles.  
18 Critical habitat for the Everglades snail kite (*Rostrhamus sociabilis*) is located approximately 19  
19 km (11.8 mi) northwest of the Midway substation.

20  
21 At least 13 species listed as threatened or endangered under the Federal Endangered Species  
22 Act (ESA) are within St. Lucie County (Table 2-3). There are no species currently proposed for  
23 formal listing or considered candidates for listing in St. Lucie County. The status of the  
24 Federally listed species in the vicinity of the plant site and transmission line right-of-way is  
25 discussed in the following paragraphs.

26  
27 The eastern indigo snake (*Drymarchon corias couperi*) has not been observed on the St. Lucie  
28 site or along the transmission line right-of-way, but it has been observed elsewhere on  
29 Hutchinson Island (FPL 2001a). Gopher tortoises (*Gopherus polyphemus*) are present on the  
30 site, especially on the leeward side of the dunes to the east of the St. Lucie site and  
31 intake/discharge canals in areas with soft soil not subject to flooding (FPL 2001a). Gopher  
32 tortoises also are known to occur within the St. Lucie to Midway transmission line right-of-way,  
33 at least in the strip between the Indian River and the eastern marshes of the Savannas State  
34 Preserve (Foster Wheeler 2001). Indigo snakes are known to seek out gopher tortoise burrows  
35 for shelter and denning (FWS 1999), and they have been observed elsewhere on Hutchinson  
36 Island and in St. Lucie County. Therefore, it is likely that there are eastern indigo snakes either  
37 onsite or in the near vicinity of the St. Lucie site or transmission line right-of-way.

38  
39 American alligators (*Alligator mississippiensis*) are common in freshwater wetland areas  
40 throughout South Florida. They are not present at the St. Lucie site because all aquatic  
41 environments in the immediate vicinity of the site are either salty or brackish. Although not

Plant and the Environment

**Table 2-3. Terrestrial Species Listed as Endangered or Threatened by the U.S. Fish and Wildlife Service that Have Been Reported to Occur Within St. Lucie County, Florida**

Scientific Name	Common Name	Federal Status <sup>(a)</sup>	State Status <sup>(a)</sup>
<b>Reptiles</b>			
<i>Drymarchon corias couperi</i>	eastern indigo snake	T	T
<i>Alligator mississippiensis</i>	American alligator	T(S/A)	SSC
<b>Birds</b>			
<i>Aphelocoma coerulescens</i>	Florida scrub-jay	T	T
<i>Haliaeetus leucocephalus</i>	bald eagle	T	T
<i>Mycteria americana</i>	wood stork	E	E
<i>Picoides borealis</i>	red-cockaded woodpecker	E	T
<i>Polyborus plancus audubonii</i>	Audubon's crested caracara	T	T
<i>Rostrhamus sociabilis</i>	Everglades snail kite	E	E
<b>Mammals</b>			
<i>Peromyscus polionotus niveiventris</i>	southeastern beach mouse	T	T
<b>Plants</b>			
<i>Asimina tetramera</i>	four-petal paw paw	E	E
<i>Dicerandra immaculate</i>	Lakela's mint	E	E
<i>Harrisia (Cereus) eriophorus</i>	fragrant prickly apple	E	E
<i>Polygala smallii</i>	tiny milkwort	E	E

(a) E = endangered, T = threatened, T(S/A) = threatened due to similarity of appearance, SSC = State species of special concern.

Sources: Based on U.S. Fish and Wildlife Service (FWS 2002a; 2002b); and the Internet sites of the Florida Natural Areas Inventory (FNAI) (FNAI 2002), Florida Fish and Wildlife Conservation Commission (FFWCC 2002), University of South Florida, Atlas of Florida Vascular Plants (2002); and Florida Geographic Data Library (2002).

observed during field surveys (Foster Wheeler 2001), alligators are likely to occur occasionally in the freshwater marsh areas and along the St. Lucie River within or near the transmission line right-of-way.

The southeastern beach mouse (*Peromyscus polionotus niveiventris*) inhabits the sea oats zone of the primary coastal dunes (FWS 1999). In many cases, suitable habitat for the southeastern beach mouse may only be a few meters wide, and in most cases it is highly heterogeneous. They primarily feed on the seeds of sea oats and panic grass (*Panicum amarum*), although they will eat insects and seeds of other dune species. The current distribution is severely limited by the modification and destruction of habitat along the Florida barrier islands. The largest populations are located at Canaveral National Seashore, while Brevard County and Indian River County have a number of populations. Populations have been

1 reported from St. Lucie County at Pepper Beach County Park, Fort Pierce Inlet State  
2 Recreation Area, and Surfside Beach State Park, all located at least 13 km (8.1 mi) north of the  
3 St. Lucie plant. However, recent surveys have failed to detect any southeastern beach mice at  
4 these sites within St. Lucie County, and they may have been extirpated from the county. There  
5 have been no specific surveys for this species at the St. Lucie site; however, if it were present,  
6 the site would probably be a refuge for this species because of the limited disturbance and  
7 human interference.

8  
9 Florida scrub jays (*Aphelocoma coerulescens*) are found in various forms of Florida scrub,  
10 including the coastal scrub found in eastern St. Lucie County. The largest populations of  
11 Florida scrub jays are located in the central portion of the Florida Peninsula in Polk and  
12 Highlands counties, but they are also found along both coasts and north of Orlando in Volusia,  
13 Lake, and Marion counties. Although it is fairly widespread throughout peninsular Florida, it has  
14 extremely specific habitat requirements (FWS 1999). It is endemic to the ancient dune  
15 ecosystems that are dominated by xeric oaks (*Quercus* sp.). Although this species is not  
16 known from the St. Lucie Plant Site, scrub jays have been observed beneath the St. Lucie-to-  
17 Midway transmission lines within a narrow band of vegetation between the Indian River and the  
18 Savannas State Preserve that is suitable scrub jay habitat. There have been other periodic  
19 sightings of Florida scrub jays within the coastal scrub areas along the west shore of the Indian  
20 River within approximately 3 km (1.9 mi) of the St. Lucie transmission line (FGDL 2002). In  
21 general, the maintenance practices used by the applicant within the St. Lucie-to-Midway  
22 corridor may help to maintain the open scrub habitat required by the scrub jays.

23  
24 Bald eagles (*Haliaeetus leucocephalus*) are known to nest approximately 2 km (1.2 mi) south of  
25 the St. Lucie transmission line corridor. They usually nest in tall trees near major waterways  
26 and feed on fish, waterfowl, and occasionally carrion. Bald eagles are occasionally observed  
27 along the Indian River and near the St. Lucie site, but they are not regular inhabitants of these  
28 areas.

29  
30 The Audubon's crested caracara (*Polyborus plancus audubonii*) is a large, long-legged, boldly  
31 patterned, nonmigratory raptor. It occurs in south Texas, southwestern Arizona, and through  
32 Mexico from Baja California to Panama and Cuba. Only the Florida population is protected  
33 under the ESA (FWS 1999). In south Florida, the caracara occurs in dry or wet prairies with  
34 scattered cabbage palms (*Sabal palmetto*) or occasionally in lightly wooded areas. They  
35 usually build well-concealed nests within cabbage palms. Much of the historical habitat areas  
36 for the caracara have been greatly modified or destroyed, but there are indications that the  
37 caracara is able to use improved or semi-improved pastures (FWS 1999). Caracaras are  
38 opportunistic feeders and will consume both carrion and live prey. Although they may be  
39 present in the vicinity of the transmission line right-of-way, there are no known observations in  
40 the area, and they are primarily found in the western portions of St. Lucie County. Caracaras  
41 have not been observed at the St. Lucie site.

## Plant and the Environment

1 Wood storks (*Mycteria americana*) are large wading birds that rely on freshwater and estuarine  
2 habitats for nesting, roosting, and foraging. They build nests in colonies, usually in medium to  
3 tall trees that occur in either swamps or on islands surrounded by open water (FWS 1999), and  
4 they often share rookeries with other wading birds. Wood storks forage by tactolocation and  
5 therefore rely on prey that is relatively concentrated. The alterations of the natural hydrologic  
6 regime in south Florida have eliminated much of the seasonal variation on which wood storks  
7 historically relied—they exploited the fish that would become concentrated in alligator holes and  
8 other depressions during the dry season. Wood storks are observed occasionally in the vicinity  
9 of the St. Lucie site and the transmission line right-of-way, but there are no known rookeries  
10 within many miles of the site or transmission line right-of-way.

11  
12 The Everglades snail kite (*Rostrhamus sociabilis*) is a medium-sized raptor that feeds almost  
13 exclusively on apple snails (*Pomacea paludosa*) that are found in freshwater marshes and the  
14 shallow, vegetated edges of lakes. Most of the snail kite populations are located on the west  
15 side of Lake Okeechobee and in the Everglades west of Palm Beach, Fort Lauderdale, and  
16 Miami. However, there is one small area within St. Lucie County that has been designated as  
17 critical habitat for the snail kite. This area includes the Cloud Lake and Strazzulla reservoirs,  
18 approximately 19 km (12 mi) northwest of the Midway substation. This species has been  
19 observed within several kilometers of the transmission line right-of-way (FGDL 2002), and it is  
20 possible they may use the scattered freshwater marshes in the vicinity for foraging.

21  
22 Red-cockaded woodpeckers (*Picoides borealis*) occur throughout the southeastern United  
23 States in pine stands or pine-dominated pine-hardwood stands with sparse understory and  
24 ample old-growth trees (FWS 1999). Population levels have drastically declined over the last  
25 century due to logging and conversion of habitat to other uses. The status of red-cockaded  
26 woodpeckers in south Florida, including St. Lucie County, is not well known (FWS 1999), but  
27 because of the requirements for old growth, pine-dominated forests, they are highly unlikely to  
28 occur at or near the St. Lucie site. Suitable habitat is very limited or absent from the  
29 transmission line right-of-way (Foster Wheeler 2001).

30  
31 The four-petal pawpaw (*Asimina tetramera*) is an aromatic shrub approximately 1 to 3 m (3 to  
32 10 ft) tall. It occurs in sand pine scrub within the coastal dune system. Its historic range has  
33 been greatly reduced by habitat conversion, and it is now known from a few locations between  
34 Palm Beach Gardens and the Savannas State Preserve in Martin County, and a few locations  
35 in northern St. Lucie County (FWS 1999). This species is found in various seral stages of sand  
36 pine scrub and is adapted to infrequent, intense fires. This species is not likely to be found at  
37 the St. Lucie site or along the transmission line right-of-way; it would only be found near the  
38 west shore of the Indian River where suitable habitat is present. Field surveys have not  
39 detected this species within the transmission line right-of-way (Foster Wheeler 2001).

40

1 Lakela's mint (*Dicerandra immaculate*) is a small aromatic shrub that inhabits scrub areas of  
2 the Atlantic coastal ridge (FWS 1999). It occupies sites with varying amounts of organic litter,  
3 from partly covered to bare sand. This species is currently known from approximately six sites  
4 between Fort Pierce and Vero Beach, and at Hobe Sound National Wildlife Refuge, where it  
5 was introduced in 1991 and 1992 (FWS 1999). Although suitable habitat exists in the vicinity of  
6 the transmission line right-of-way at the western shore of the Indian River, this species was not  
7 found during field surveys (Foster Wheeler 2001).  
8

9 The fragrant prickly apple (*Harrisia [Cereus] eriophorus*) is a solitary tree cactus that is endemic  
10 to St. Lucie County and is known only from approximately 11 small, disjunct sites, all along the  
11 Atlantic Coastal Ridge on the western shore of the Indian River (FWS 1999). The St. Lucie-to-  
12 Midway transmission line right-of-way crosses this ridge between the Indian River and the  
13 marshes on the east side of the Savannas State Preserve. Several of the known populations  
14 are located within 2 to 3 km (1.2 to 1.9 mi) of the St. Lucie-to-Midway transmission line right-of-  
15 way but none of the known populations is close enough to the transmission line right-of-way to  
16 be affected by corridor maintenance. Field surveys of the corridor did not reveal any fragrant  
17 prickly apple (Foster Wheeler 2001).  
18

19 The tiny milkwort (*Polygala smallii*) is a small, short-lived, herbaceous species that is restricted  
20 to sand pockets within pine rocklands, open sand pine scrub, slash pine, high pine, and well-  
21 drained coastal spoil (FWS 1999). It requires high light levels, and little to no organic litter  
22 accumulation. All known populations are within 9.7 km (6 mi) of the Atlantic coast between  
23 Miami-Dade County and St. Lucie County. The only known population in St. Lucie County is  
24 located approximately 6.9 km (4.3 mi) south of the St. Lucie-to-Midway transmission line. Field  
25 surveys of the transmission line right-of-way did not detect the presence of the tiny milkwort  
26 (Foster Wheeler 2001).  
27

28 In addition to the species listed in Table 2-2, several other Federal-listed species have been  
29 reported from the counties surrounding St. Lucie County. These conceivably could occur in the  
30 vicinity of the St. Lucie plant or associated transmission line right-of-way. These species  
31 include Atlantic salt marsh snake (*Nerodia fasciata taeniata*), Florida grasshopper sparrow  
32 (*Ammodramus savannarum floridanus*), piping plover (*Charadrius melodus*), Florida panther  
33 (*Felis concolor coryi*), perforate reindeer lichen (*Cladonia perforata*), and beach clustervine  
34 (*Jacquemontia reclinata*).  
35

36 In addition to the Federally listed species, at least 72 species listed by the State of Florida as  
37 endangered, threatened, or of special concern occur in St. Lucie County (Table 2-4). Florida-  
38 State-listed animal species that have been observed at the site include a number of wading  
39 birds common to the region such as white ibis (*Eudocimus albus*), little blue heron (*Egretta*  
40 *caerulea*), tri-colored heron (*Egretta tricolor*), snowy egret, (*Egretta thula*) and roseate spoonbill  
41 (*Ajaja ajaja*), as well as the brown pelican (*Pelicanus occidentalis*) and southeastern American

Plant and the Environment

1 kestrel (*Falco sparverius paulus*). Black skimmers (*Rynchops niger*) and American  
 2 oystercatchers (*Haematopus palliatus*) are known to nest along the intake canal shoreline, and  
 3 the least tern (*Sterna antillarum*) has been found to nest atop buildings on the St. Lucie site  
 4 (FPL 2001a). As described above, gopher tortoises are common within the stabilized dune  
 5 system on the east side of the St. Lucie site and in the ancient dune system between the Indian  
 6 River and the marshes of the Savannas State Preserve. State-listed plant species that have  
 7 been observed at the St. Lucie site include the inkberry (*Scaevola plumieri*), common prickly  
 8 pear (*Opuntia stricta*), burrowing four-o'clock (*Okenia hypogaea*), and coastal vervain (*Verbena*  
 9 [*Glandularia*] *maritima*). Several additional Florida State plant species of concern have been  
 10 observed within the St. Lucie-to-Midway transmission line right-of-way, including the yellow  
 11 butterwort (*Pinguicula lutea*), satinleaf (*Chrysophyllum oliviforme*), and the large-flowered false  
 12 rosemary (*Conradina grandiflora*) (Foster Wheeler 2001).

14 **Table 2-4.** Additional Terrestrial Species Listed by the State of Florida as Endangered,  
 15 Threatened, or of Special Concern that Have Been Reported in St. Lucie County  
 16

17	Scientific Name	Common Name	State Status <sup>(a)</sup>
18	<b>Reptiles</b>		
19	<i>Gopherus polyphemus</i>	gopher tortoise	SSC
20	<i>Pituophis melanoleucus mugitus</i>	Florida pine snake	SSC
21	<b>Amphibians</b>		
22	<i>Rana capito aesopus</i>	Florida gopher frog	SSC
23	<b>Birds</b>		
24	<i>Ajaia ajaja</i>	roseate spoonbill	SSC
25	<i>Aramus guarana</i>	limpkin	SSC
26	<i>Egretta caerulea</i>	little blue heron	SSC
27	<i>Egretta rufescens</i>	reddish egret	SSC
28	<i>Egretta thula</i>	snowy egret	SSC
29	<i>Egretta tricolor</i>	Louisiana heron	SSC
30	<i>Eudocimus albus</i>	white ibis	SSC
31	<i>Falco peregrinus</i>	peregrine falcon	E
32	<i>Falco sparverius paulus</i>	southeastern American kestrel	T
33	<i>Grus canadensis pratensis</i>	Florida sandhill crane	T
34	<i>Haematopus palliatus</i>	American oystercatcher	SSC
35	<i>Pelacanus occidentalis</i>	brown pelican	SSC
36	<i>Rynchops niger</i>	black skimmer	SSC
37	<i>Speotyto cunicularia</i>	burrowing owl	SSC
38	<i>Sterna antillarum</i>	least tern	T

Table 2-4. (contd)

	Scientific Name	Common Name	State Status <sup>(a)</sup>
1			
2			
3	<b>Mammals</b>		
4	<i>Podomys floridanus</i>	Florida mouse	SSC
5	<i>Sciurus niger shermani</i>	Sherman's fox squirrel	SSC
6	<b>Plants</b>		
7	<i>Acanthocereus (Cereus) pentagonus</i>	barbed wire cactus	T
8	<i>Argusia gnaphalodes</i>	sea lavender	E
9	<i>Asclepias curtissii</i>	Curtiss' milkweed	E
10	<i>Caesalpinia major</i>	yellow nickerbean	E
11	<i>Calopogon multiflorus</i>	many-flowered grass pink	E
12	<i>Chamaesyce cumulicola</i>	sand dune spurge	E
13	<i>Chrysophyllum oliviforme</i>	satinleaf	T
14	<i>Coelorachis tuberculosa</i>	piedmont jointgrass	T
15	<i>Conradina grandiflora</i>	large-flowered false rosemary	T
16	<i>Drypetes lateriflora</i>	guina plum	T
17	<i>Encyclia boothiana</i>	dollar orchid	E
18	<i>Erithalis fruticosa</i>	black torch	T
19	<i>Ermodea littoralis</i>	beach creeper	T
20	<i>Eulophia (Pteroglossaspis) ecristata</i>	non-crested coco	T
21	<i>Harrisia (Cereus) gracilis var. simpsonii</i>	prickly applecactus	E
22	<i>Lantana depressa</i>	pineland lantana	E
23	<i>Lechea cernua</i>	nodding pinweed	T
24	<i>Lechea divaricata</i>	pine pinweed	E
25	<i>Lilium catesbaei</i>	Catesby's lily	T
26	<i>Linum carteri var. smallii</i>	south Florida flax	E
27	<i>Myrcianthes fragrans</i>	Simpson's stopper	T
28	<i>Nemastylis floridana</i>	celestial lily	E
29	<i>Nephrolepis biserrata</i>	giant sword fern	T
30	<i>Okenia hypogaea</i>	burrowing four-o'clock	E
31	<i>Oncidium bahamensis</i>	dancing lady orchid	E
32	<i>Ophioglossum palmatum</i>	hand fern	E
33	<i>Opuntia stricta</i>	common prickly pear	T
34	<i>Peperomia humilis</i>	pepper	E
35	<i>Pinguicula caerulea</i>	blue butterwort	T
36	<i>Pinguicula lutea</i>	yellow butterwort	T
37	<i>Pithecellobium keyense</i>	blackbead	T
38	<i>Platanthera nivea</i>	snowy orchid	T
39	<i>Pogonia ophioglossoides</i>	rose pogonia	T

Table 2-4. (cont'd)

Scientific Name	Common Name	State Status <sup>(a)</sup>
<b>Plants (cont'd)</b>		
<i>Polypodium (Pecluma) dispersa</i>	polypoda fern	E
<i>Polypodium (Pecluma) plumula</i>	plume polypoda fern	E
<i>Polypodium (Pecluma) ptilodon</i>	swamp plume polypoda fern	E
<i>Polystachya concreta</i>	pale-flowered polystachya	E
<i>Pteris bahamensis</i>	Bahama brake	E
<i>Remirea maritima</i>	beach star	E
<i>Scaevola plumieri</i>	inkberry	T
<i>Spermacoce terminalis</i>	false buttonweed	T
<i>Spiranthes lacinata</i>	lace-lipped ladies' tresses	T
<i>Spiranthes tuberosa</i>	little pearl-twist	T
<i>Stenorrhynchos lanceolatus</i>	leafless beaked orchid	T
<i>Tephrosia angustissima</i> var. <i>curtissii</i>	hoary pea	E
<i>Tillandsia balbisiana</i>	inflated wild pine	T
<i>Tillandsia flexuosa</i>	twisted and banded airplant	T
<i>Tillandsia valenzuelana</i>	soft leaved wild pine	T
<i>Vanilla mexicana</i>	unscented vanilla	E
<i>Verbena (Glandularia) maritima</i>	coastal vervain	E
<i>Verbena (Glandularia) tampensis</i>	Tampa vervain	E
<i>Zephyranthes simpsonii</i>	Simpson's zephyr lily	T

(a) State status: E = endangered, T = threatened, SSC = species of special concern.

Sources: Based on FNAI, FFWCC, Atlas of Florida Vascular Plants, and Florida Geographic Data Library Internet sites as of March 2002.

### 2.2.7 Radiological Impacts

FPL began conducting a radiological environmental monitoring program (REMP) at St. Lucie in 1971 (AEC 1973, 1974). The radiological impacts to workers, the public, and the environment have been carefully monitored, documented, and compared to the appropriate standards. The twofold purpose of the REMP is to

- provide representative measurements of radiation and radioactive materials in those exposure pathways for those radionuclides that lead to the highest potential radiation exposures of members of the public
- supplement the radiological effluent monitoring program by verifying that the measurable concentrations of radioactive materials and levels of radiation are not higher than expected

1 on the basis of the effluent measurements and the modeling of the environmental exposure  
2 pathways.

3  
4 Radiological releases are summarized in two annual reports: *Annual Radiological Environmental*  
5 *Operating Report* (e.g., FPL 2001e) and *Annual Radioactive Effluent Release Report* (e.g., FPL  
6 2001b). The limits for all radiological releases are specified in the St. Lucie ODCM and the *Annual*  
7 *Radioactive Effluent Release Report*, and these limits are designed to meet Federal standards and  
8 requirements (FPL 2002, 2001b). The REMP includes monitoring of the airborne exposure  
9 pathway, direct exposure pathway (i.e., ambient radiation), water exposure pathway (i.e., surface  
10 water), aquatic exposure pathway (i.e., shoreline sediments), and ingestion exposure pathway (i.e.,  
11 fish and invertebrates, and broadleaf vegetables). Radiological environmental monitoring for the St.  
12 Lucie plant is conducted by the State of Florida, Department of Health (DOH), Bureau of Radiation  
13 Control. Samples are collected and analyzed by DOH personnel (FPL 2001e)

14  
15 Review of historical data on releases and the resultant dose calculations revealed that the doses to  
16 maximally exposed individuals in the vicinity of the St. Lucie plant were a small fraction of the limits  
17 specified in the EPA's environmental radiation standards in 40 CFR Part 190 as required by  
18 10 CFR 20.1301(d). For 2000 (the most recent year that data were available), dose estimates were  
19 calculated based on actual liquid and gaseous effluent release data (FPL 2001c). Calculations  
20 were performed using the plant effluent release data, onsite meteorological data or historical data,  
21 and appropriate pathways identified in the ODCM.

22  
23 According to the 2000 Annual Radioactive Effluent Release Report for St. Lucie Units 1 and 2,  
24 assessment of radiation dose from radioactive effluents to members of the public assumes a visitor  
25 is onsite 6 hours per day, 312 days per year, and is located 1.6 km (1 mi) southeast of the plant  
26 (FPL 2001b). The visitor was assumed to have received exposure from both Unit 1 and 2 gaseous  
27 effluents released during 2000. The total beta and gamma air dose from noble gases was  
28 estimated to be  $2.4 \times 10^{-7}$  mGy ( $2.4 \times 10^{-5}$  mrad) and total body dose from gases, particulate, and  
29 iodine of  $1.7 \times 10^{-5}$  mSv (0.0017 mrem). The air dose due to noble gases in gaseous effluents was  
30  $1.1 \times 10^{-7}$  mGy ( $1.1 \times 10^{-5}$  mrad) gamma radiation ( $5.5 \times 10^{-5}$  percent of the 0.20 mGy [20 mrad]  
31 gamma dose limit<sup>(a)</sup>), and  $1.3 \times 10^{-5}$  mGy (0.0013 mrad) beta radiation (0.003 percent of the 0.40  
32 mGy [40 mrad] beta dose limit<sup>(a)</sup>) (FPL 2001b).

33  
34 Total body dose from liquid effluents was  $0.34 \mu\text{Sv}$  (0.034 mrem), which is 0.6 percent of the 0.06  
35 mSv (6 mrem) dose limit.<sup>(a)</sup> The critical organ doses to the gastrointestinal tract and thyroid from  
36 liquid effluents were  $1 \mu\text{Sv}$  (0.1 mrem) and  $0.024 \mu\text{Sv}$  (0.0024 mrem), respectively. These doses  
37 were 0.5 percent and 0.01 percent of the respective 0.20 mSv (20 mrem) dose limit<sup>(a)</sup> (FPL 2001b).  
38

---

(a) The design objective is twice the 10 CFR 50, Appendix I, dose limit because the limit is per unit and St. Lucie has two operating units.

## Plant and the Environment

1 The applicant does not anticipate any significant changes to the radioactive effluent releases or  
2 exposures from St. Lucie Units 1 and 2 operations during the renewal period and, therefore, the  
3 impacts to the environment are not expected to change.  
4

### 5 **2.2.8 Socioeconomic Factors**

6  
7 The staff reviewed the applicant's ER (FPL 2001a) and information obtained from several county,  
8 city, and economic development staff during a site visit to St. Lucie and Martin counties from  
9 April 1 through 5, 2002. The following information describes the economy, population, and  
10 communities near the St. Lucie Units 1 and 2.  
11

#### 12 **2.2.8.1 Housing**

13  
14 The full-time work force at St. Lucie is approximately 791 plant and 138 contract employees.  
15 Approximately 46 percent of these employees (plant and contract) live in St. Lucie County,  
16 37 percent in Martin County, 8 percent in Indian River County, 6 percent in Palm Beach County,  
17 with the remainder living in other locations (see Table 2-5). Since approximately 83 percent of the  
18 St. Lucie employees live in St. Lucie and Martin counties, and St. Lucie is where the plant is  
19 located, the focus of the socioeconomic analysis is on these two counties.  
20

21 FPL refuels St. Lucie Units 1 and 2 on an 18-month cycle. Typically, this means that at least one  
22 unit is refueled every year, and both units would be refueled every third year. During refueling, the  
23 number of employees increases by as many as 575 to 870 temporary workers for a period of 30 to  
24 40 days. These temporary employees stay at hotels, motels, and temporary rental housing  
25 available in Ft. Pierce, Port St. Lucie, and Stuart.  
26

27 **Table 2-5. St. Lucie Units 1 and 2, Employee and Contract Employee Residence by County**

28

29 County	Number of Personnel	Percent of Total Personnel
30 St. Lucie	427	46
31 Martin	344	37
32 Indian River	74	8
33 Palm Beach	56	6
34 Other	28	3
35 <b>Total</b>	<b>929</b>	<b>100</b>

36 Source: FPL 2001a  
37

38 Table 2-6 provides the number of housing units and housing unit vacancies for St. Lucie and  
39 Martin counties for 1990 and 2000. Of interest is the fact that not only has the stock of housing

increased, but the number of vacant units in both counties declined over the decade. This could reflect the very high population growth in the counties and the resultant increase in demand for available housing.

Planning agencies in both Martin and St. Lucie counties require that urban development be confined to areas of the county where public services and facilities are already provided or planned to be made available. In addition, neither county has growth control measures in place restricting the development of new housing, and both counties have programs in place to promote the development of affordable housing.

**Table 2-6. Total Occupied and Vacant (Available) Housing Units by County, 1990 and 2000**

	1990	2000	Approximate Percentage Change
<b>ST. LUCIE COUNTY</b>			
Housing Units	73,843	91,262	23.6
Occupied Units	58,174	76,933	32.2
Vacant Units	15,669	14,329	-8.6
<b>MARTIN COUNTY</b>			
Housing Units	54,199	65,471	20.8
Occupied Units	43,022	55,288	28.5
Vacant Units	11,177	10,183	-8.9

Sources: U.S. Census Bureau (USCB) 2000a and USCB 1990a.

Table 2-7 contains data on population, estimated population, and annual population growth rates for St. Lucie and Martin counties. Both counties saw similar growth in population during the 1990s.

**Table 2-7. Population Growth in Martin and St. Lucie Counties, 1970 to 2020**

	Martin County		St. Lucie County	
	Population	Annual Growth Percent <sup>(a)</sup>	Population	Annual Growth Percent
1970	28,033	--	50,837	--
1980	64,014	8.3	87,182	5.4
1990	100,900	4.6	150,171	5.5
2000	126,731	2.3	192,695	2.5
2010	152,701 (estimated)	1.9	234,383 (estimated)	2.0
2020	178,511 (estimated)	1.6	276,886 (estimated)	1.7

(a) Annual percent growth rate is calculated over the previous decade.

-- = No data available.

Sources: Florida Legislature 2001 (population for the years 1970 to 1990 and estimates for 2010 and 2020); and USCB 2000a (populations for year 2000 that are actual accounts from the 2000 census).

2.2.8.2 Public Services

Public services include water supply, education, and transportation.

- Water Supply

The South Florida Water Management District (SFWMD) estimated that in 1990, approximately 42 percent of St. Lucie County and 46 percent of Martin County residents obtained potable water from private wells (SFWMD 1998). The remaining residents receive their water from 107 and 139 water supply systems in St. Lucie and Martin counties, respectively, many of which are privately owned (FPL 2001a). The primary source of potable water supplies in the two counties is the shallow, unconfined surficial aquifer (SFWMD 1998).

Table 2-8 summarizes the daily consumption and areas served by the major (those permitted at over  $3.8 \times 10^3$  m<sup>3</sup>/d [1 million gallons/day [MGD]]) public water supply districts. The primary public water service providers in St. Lucie County are Ft. Pierce and Port St. Lucie at approximately  $7.6 \times 10^4$  m<sup>3</sup>/d (20 MGD) and  $4.2 \times 10^4$  m<sup>3</sup>/d [11 MGD]), respectively, with average daily demand being well below permitted capacity. In addition, Port St. Lucie is expanding its water and sewage treatment systems.

**Table 2-8. Major<sup>(a)</sup> Public Water Supply Systems in Martin and St. Lucie Counties<sup>(b)</sup>**

Water System	County	Source	Permitted Capacity m <sup>3</sup> /d (MGD)	Average Daily Demand m <sup>3</sup> /d (MGD)	Peak Demand Per Day m <sup>3</sup> /d (MGD)	Area Served
City of Stuart	Martin	Surficial Aquifer	$2.3 \times 10^4$ (6.0)	$1.2 \times 10^4$ (3.2) <sup>(b)</sup>	$2.2 \times 10^4$ (5.8)	City of Stuart
Port Salerno	Martin	Surficial Aquifer	$1.2 \times 10^4$ (3.0)	$6.1 \times 10^3$ (1.6)	$1.1 \times 10^4$ (2.8)	Port Salerno
Hobe Sound	Martin	Surficial Aquifer	$1.2 \times 10^4$ (3.0)	N/A	N/A	Hobe Sound
North Martin County	Martin	Surficial Aquifer	$1.2 \times 10^4$ (3.0)	N/A	N/A	North Martin County
Fort Pierce Utilities Authority	St. Lucie	Surficial Aquifer	$7.6 \times 10^4$ (20)	$3.2 \times 10^4$ (8.5)	$4.2 \times 10^4$ (11)	City of Fort Pierce and part of St. Lucie County

Table 2-8. (cont'd)

Water System	County	Source	Permitted Capacity m <sup>3</sup> /d (MGD)	Average Daily Demand m <sup>3</sup> /d (MGD)	Peak Demand Per Day m <sup>3</sup> /d (MGD)	Area Served
St. Lucie County Utilities	St. Lucie	Surficial Aquifer	1.1x10 <sup>3</sup> (0.3)	N/A	N/A	Holiday Pines and Lakewood Park Subdivision

(a) Only permitted plants with a treatment capacity greater than  $3.8 \times 10^3$  m<sup>3</sup>/day (1 MGD) are listed in the table.

(b) SFWMD 1998; City of Port St. Lucie 1997; St. Lucie County Utilities 2000; FPL 2001a

In Martin County, Stuart, Port Salerno, North Martin County, and Hobe Sound all have permitted capacities of at least  $1.1 \times 10^4$  m<sup>3</sup>/d (3 MGD). Of these, Stuart's water treatment plant is the largest in Martin County, with a permitted capacity of  $2.3 \times 10^4$  m<sup>3</sup>/d (6 MGD) and average daily demand of  $1.2 \times 10^4$  m<sup>3</sup>/d (3.2 MGD), which is below its permitted capacity (SFWMD 1998).

#### • Transportation

There are nine counties wholly or partially within the 80-km (50-mi) radius of St. Lucie. The nine-county area is served by one interstate freeway (Interstate 95 [I-95]) and the Florida Turnpike. I-95 enters the region from the north, connects St. Lucie and Martin counties to points south, and ends in downtown Miami. The Florida Turnpike begins in south Miami-Dade County and generally runs north, paralleling I-95, and crosses I-95 near Ft. Pierce. State Road 70 comes in from the west, transects Highlands and Okeechobee counties before entering St. Lucie County, crosses both I-95 and the Florida Turnpike, and ends in downtown Ft. Pierce. U.S. Route 1 (US-1) is the coastal highway that runs north and south through both Port St. Lucie, Ft. Pierce (St. Lucie County), and Stuart in Martin County. US-1 serves as a major north-south thoroughfare through these cities and carries mostly local and regional traffic. Access to the St. Lucie site is via State Road A1A, a two-lane road running the length of Hutchinson Island.

The St. Lucie County International Airport is located north of Ft. Pierce. It is a general aviation airport with several flight schools, an airplane manufacturer, and several businesses ancillary to the airport and flight operations. In total, there are 32 businesses at the airport with approximately 400 employees. An airport industrial park, to the east of the airport, contains 52 businesses with approximately 870 employees (St. Lucie County 2001).

The Port of Ft. Pierce is the region's only deep-water port. The port is approximately 35 ha (87 ac) and is largely undeveloped, except for a privately owned cargo operation at the southern

## Plant and the Environment

1 end. The majority of the 35 ha (87 ac) is privately owned. The channel from the ocean leading  
2 to the port is 8.5 m (28 ft) deep. The port is mainly used for the import and export of  
3 agricultural commodities (St. Lucie County 2001).

### 4 5 2.2.8.3 Offsite Land Use

6  
7 St. Lucie and Martin counties are located along Florida's southeast coast, approximately  
8 160 km (100 mi) from Ft. Lauderdale and Miami. The following is a discussion of land use in  
9 St. Lucie and Martin counties.

#### 10 11 • St. Lucie County

12  
13 Table 2-9 presents the major land use for both St. Lucie and Martin counties. St. Lucie County  
14 can be divided into three major land use areas, the coastal area, the developed area, and the  
15 agricultural area. The coastal area consists of the barrier islands and areas that front the  
16 Atlantic Ocean, and is approximately 34 km (21 mi) long. Approximately 11 km (7 mi) of the 34  
17 km (21 mi) are under public ownership. About 3 km (2 mi) are owned by FPL and are the site  
18 of St. Lucie Units 1 and 2. These lands are largely undisturbed. The remaining oceanfront  
19 property is privately owned, and approximately 45 percent of that has been developed (St.  
20 Lucie County 2001). The major land uses within the coastal area are residential, commercial,  
21 and recreational (see Table 2.9).

22  
23 **Table 2-9. Land Use in St. Lucie and Martin Counties, Florida**

24  
25

Land Use	St. Lucie County <sup>(a)</sup>			Martin County <sup>(b)</sup>		
	Square Kilometers	Square Miles	% of Total	Square Kilometers	Square Miles	% of Total
Agriculture	945	365	67.3	999	386	71.7
Residential	97	138	7.1	221	85	15.8
Commercial	41	16	2.9	14	5	1.0
Industrial	11	4	0.7	21	8	1.5
Recreation	86	33	6.2	5	2	0.4
Other	222	85	15.8	134	52	9.6
Total	1402	542	100.0	1394	538	100.0

26  
27  
28  
29  
30  
31  
32  
33  
34 (a) Existing unincorporated land use as of 2002. Personal communication Janet Merkt, April 29, 2002.

35 (b) Unincorporated Martin County only. Existing land use as of 1995.

36 Sources: Martin County 1999.

37  
38 The developed area of the county lies generally between the Indian River Intercoastal  
39 Waterway, I-95, and the Florida Turnpike. This area establishes an Urban Service Boundary

1 (USB) for which the county will provide services. Growth is targeted to take place within the  
2 USB. This area comprises the cities and towns of Port St. Lucie, St. Lucie West, Lakewood  
3 Park, St. Lucie Village, and Ft. Pierce. The major land uses within this area are residential,  
4 commercial, and industrial.  
5

6 To the west of the I-95/Florida Turnpike corridor is the agricultural area. The current county  
7 administration intends to restrict development and preserve agricultural lands. St. Lucie  
8 County does not have growth management restrictions in place; however, it does require that  
9 new development activities are authorized only in conjunction with the availability of the required  
10 public services to support the development. These services are generally provided only within  
11 the USB. Development west of the USB can occur, but it is limited to densities that range from  
12 one dwelling unit per 0.4047 ha (1 ac) or one dwelling unit per 2 ha (5 ac). While greater  
13 densities can be approved, they require an amendment to the land use map for the area, and  
14 any approval of the amendment requires the developer to provide the necessary infrastructure  
15 services at no cost to the local government. In addition, the conversion of agricultural land to  
16 residential or small farm use must maintain the viability of agricultural uses and activities on  
17 adjacent lands.  
18

19 • **Martin County**  
20

21 As with St. Lucie County, most urban development in Martin County occurs within the coastal  
22 area between the Florida Turnpike and I-95 and the Atlantic Ocean. The most intense  
23 urbanization is occurring around the Town of Stuart, the county seat of government, and urban  
24 core of Martin County.  
25

26 The part of the county west of the Turnpike is mainly for agricultural use. There are scattered,  
27 older residential and mobile home developments, and a developing western urban core in the  
28 Indiantown area. Indiantown contains a high percentage of minority and low-income  
29 populations.  
30

31 Agriculture is one of the county's major exporting industries. As population growth in Martin  
32 County continues and the availability of land for development near the coast declines,  
33 development pressure on interior agricultural lands will increase. Such growth could increase  
34 the pressure for urbanization at the possible expense of agricultural and environmental quality.  
35 However, it is the policy of the county administrators that agricultural land is not vacant land.  
36 Agricultural activities are viewed as important for the economic diversity and health of the  
37 county and, as such, lands used for agricultural purposes are to be protected for future benefits  
38 and community identity (Martin County 1999).  
39

1           **2.2.8.4 Visual Aesthetics and Noise**

2  
3 St. Lucie Units 1 and 2 are located on Hutchinson Island, a barrier island separating mainland  
4 St. Lucie County from the Atlantic Ocean. The St. Lucie plant site occupies an area of 457 ha  
5 (1130 ac) on the widest part of Hutchinson Island. The plant is bordered by the Atlantic Ocean  
6 on the east and the Indian River Intercoastal Waterway on the west. The topography of the site  
7 is flat with low sand dunes on the ocean side of the island.

8  
9 The most prominent topographic feature on the island is State Road A1A, which runs almost  
10 the entire island's length and passes through the eastern portion of the St. Lucie site. Between  
11 the dunes on the Atlantic side of the island and State Road A1A, the principal feature is a series  
12 of mangrove-dominated mosquito impoundments interspersed with islands of natural, stranded  
13 coastal vegetation.

14  
15 Approaching from the south on State Road A1A, the St. Lucie site is not visible until  
16 approximately 1.2 km (0.75 mi) from the main entrance of the site. The view is blocked by  
17 vegetation along the west side of the road and disappears as the main entrance is reached.  
18 However, the transmission lines from the plant are visible from greater distances due to their  
19 elevation. Approaching the plant from the north, the units are not visible until approximately  
20 0.8 km (0.5 mi) from the site entrance.

21  
22 From across Indian River, on the Ft. Pierce and Port St. Lucie side, the plant is visible from the  
23 north and south from Indian River Drive. Many upscale homes (\$280,000 and up [The Real  
24 Estate Book Not Dated]) abut Indian River Drive and look out over Indian River toward the  
25 plant. Noise from the St. Lucie plant, at locations on the plant site, are barely noticeable except  
26 very close to the reactor containment vessels. From offsite, approaching from the north or  
27 south along State Road A1A or across Indian River, no noise is heard from the plant.

28  
29 The nearest municipalities to the St Lucie site are Ft. Pierce, located approximately 11 km  
30 (7 mi) northwest of the plant, and Port St. Lucie, located approximately 7 km (4.5 mi) west of  
31 the plant across Indian River. Stuart, in neighboring Martin County, is approximately 13 km  
32 (8 mi) south of the plant.

33  
34           **2.2.8.5 Demography**

35  
36           • **Resident Population Within 80 km (50 mi)**

37  
38 Population was estimated from the St. Lucie site out to 80 km (50 mi) in 16-km (10-mi) annular  
39 rings (FPL 1999, 2000). An estimated 345,000 people live within 32 km (20 mi) of St. Lucie,  
40 and 1,180,000 live within 80 km (50 mi) (FPL 2001a).

1 The largest population center within a portion of the 16-km (10-mi) area is Port St. Lucie  
 2 (population 88,769 [USCB 2000b]). The next largest town is Fort Pierce (population 37,516  
 3 ([USCB 2000b]). It is followed by the city of Stuart, which serves as the county seat for Martin  
 4 County, and has a population of 14,633 (USCB 2000b). St. Lucie and Martin are two of the  
 5 fastest growing counties in Florida. Between 1990 and 2000, the St. Lucie County population  
 6 grew by approximately 28 percent (USCB 1990b, 2000a), and the Martin County population  
 7 grew by 26 percent.

8  
 9 Table 2-10 presents information on the major employment sectors and number of employees  
 10 for St. Lucie and Martin counties.

11  
 12 **Table 2-10. Major Employment Sectors in St. Lucie and Martin Counties (2000)**

Employment Sector	Number of Employees	
	St. Lucie	Martin
Services	21,145	27,537
Retail trade	12,981	13,864
Government & government enterprises	10,549	5,500
Finance, insurance, and real estate	5,581	7,149
Construction	5,225	6,308
Total jobs – full- and part-time	71,795	73,216

13  
 14  
 15  
 16  
 17  
 18  
 19  
 20  
 21  
 22 Source: Bureau of Economic Analysis (BEA) 2000

23  
 24 • **Migrant Labor**

25  
 26 Migrant farm workers are individuals whose employment requires travel to harvest agricultural  
 27 crops. These workers may or may not have a permanent residence. Some migrant workers  
 28 may follow the harvesting of crops through Florida, Georgia, the Carolinas, and Virginia.  
 29 Others may be permanent residents near the St. Lucie site who travel from farm to farm  
 30 harvesting crops.

31  
 32 Migrant workers can be members of minority or low-income populations. Because migrant  
 33 workers travel and can spend a significant amount of time in an area without being an actual  
 34 residents, they may be unavailable for census takers to count. If this occurs, these workers  
 35 would be “underrepresented” in USCB minority and low-income population counts (FPL 2001a).

36  
 37 Approximately 67 percent of St. Lucie County and 71 percent of Martin County are used for  
 38 agriculture (see Table 2-10). In addition to St. Lucie and Martin Counties, 7 counties are wholly  
 39 or partially within the 80-km (50-mi) radius of the St. Lucie site. All of the counties have  
 40 agricultural production and farms that hire migrant or other labor (USDA 1997a). In 1997,  
 41 St. Lucie and Martin counties contained 805 individual farms (USDA 1997b). While many follow

Plant and the Environment

1 the crop cycle, they maintain their permanent residence in the counties, where they may spend  
2 as much as 50 to 70 percent of their time.<sup>(a)</sup>

3  
4 In 1997, approximately 20,800 farm workers worked in the seven-county area<sup>(b)</sup> around  
5 St. Lucie Units 1 and 2 (USDA 1997a). In July 2001, approximately 11 percent of hired farm  
6 workers (at the national level) were classified as migrant labor (USDA 2001a)<sup>(c)</sup>. Using this  
7 11-percent figure, approximately 2290 of the farm workers may have been migrant workers for  
8 the seven-county area. Given the large geographic area and the small number of migrants,  
9 FPL did not expect the migrant farm worker population to materially change the population  
10 characteristics of any particular census tract in the seven-county area (FPL 2001a). FPL's  
11 conclusion is based on the assumption that the migrant laborers would be located throughout  
12 the seven-county agricultural area and not clustered in a single location.

13  
14 **2.2.8.6 Taxes**

15  
16 The St. Lucie plant is the largest source of tax revenue for St. Lucie County. Table 2-11  
17 presents information on the total real and personal property taxes the St. Lucie site paid to St.  
18 Lucie County and the relationship of taxes paid to total taxes levied by the county. The  
19 percentage of taxes paid by the St. Lucie site to the total amount collected by the county  
20 ranged between 7.9 and 10.6 percent.

21  
22 **Table 2-11. Property Taxes Paid to St. Lucie County by FPL for St. Lucie Units 1 and 2**

	Real and Personal Tax		
Year	Paid to St. Lucie County for St. Lucie 1 and 2	Total St. Lucie Property Tax Levied	Percent of Total County Property Taxes
1996	\$19,449,952	\$196,823,727	9.9
1997	\$16,717,273	\$211,942,795	7.9
1998	\$19,766,291	\$210,294,416	9.4
1999	\$22,807,970	\$221,893,569	10.6
2000	\$18,888,240	\$222,310,596	10.0

23  
24  
25  
26  
27  
28  
29  
30 Source: Personal communication provided by the office of Mr. Robert Davis, St. Lucie County Tax  
31 Collector, April 23, 2002  
32

(a) Ms. Anita Neal (County Extension Director, St. Lucie County Extension), personal interview April 5, 2002, and Ms. Carol Bailey (County Extension Director, Martin County Extension), personal interview April 3, 2002.

(b) Specifically the following: St. Lucie, Martin, Indian River, Brevard, Okeechobee, Palm Beach, and Glades counties.

(c) Florida State data on migrant farm workers were not available.

## 2.2.9 Historic and Archaeological Resources

This description of the cultural background and the known historic and archaeological resources at the St. Lucie site and in the surrounding area is based on information from the ER (FPL 2001a), archives and records stored at the Florida Master File in the Florida Division of Historical Resources, and published literature on the history of southern and central Florida.

### 2.2.9.1 Cultural Background

The St. Lucie plant is located in St. Lucie County, about 45 km (28 mi) northeast of Lake Okeechobee in south-central Florida. The plant is located on Hutchinson Island, a barrier island that protects the lengthy shallow estuary known as Indian River Lagoon.

The archaeological site of Fort Pierce near the juncture of Fort Pierce Creek with the Indian River Lagoon is the nearest established and developed cultural or historic park. The developed reservation lands of the nearest Federally recognized Native American tribes are those of the Brighton Seminole, located about 76 km (47 mi) to the east of the St. Lucie plant and west of Lake Okeechobee. Also nearby are the Big Cypress Seminole and the Miccosukee located about 109 km (68 mi) southeast of the plant and directly south of Lake Okeechobee. However, in 1996, the U.S. Bureau of Indian Affairs purchased 20 ha (50 ac) of land in St. Lucie County to be held in trust for the Seminole Tribe for the purpose of becoming the Ft. Pierce Reservation. As of April 2002, development of housing for tribal members on this area had not begun.

The archaeological sequence of central and eastern Florida began at least 12,000 years ago (Rouse 1951; McGoun 1993; Bense 1994; Milanich 1994, 1998; Milanich and Proctor 1994; MacCauley 2000). The cultural history of the area can be divided into four major periods: (1) Paleoindian (10,000 B.C., and perhaps as early as 13,000 B.C., to around 8000 B.C.); (2) Archaic (8000 to 500 B.C.); (3) various regional cultural traditions, including that of the Indian River culture in the vicinity of the St. Lucie plant (500 B.C. to around A.D. 1500); and (4) Historic/Modern (A.D. 1500 to the present).

During the Paleoindian period, the native people apparently were organized into small mobile bands with economies based on hunting and fishing. The environment of the Paleoindian period was significantly different from the environment today. The last ice age was ending at that time, and glaciers covered much of the northern portion of North America. The presence of the glaciers also meant that ocean levels were much lower than present levels, perhaps on the order 23 to 30 m (75 to 100 ft) lower. Thus, many of the archaeological sites dating from this time period would be under water today or situated in and around wetlands.

## Plant and the Environment

1 The transition between the Paleoindian and Archaic periods was accompanied by substantial  
2 environmental change; most notable was the rise in sea level as the glaciers melted. These  
3 changing conditions led to the disappearance of megafauna such as the mammoth that  
4 traditionally had been quarry for the indigenous inhabitants of the region. In response, the  
5 Native Americans adapted by becoming more dependent on river systems and beginning the  
6 domestication of plants. The greatest cultural change occurred during the middle Archaic  
7 period when ocean levels reached or even slightly exceeded current levels. Evidence (e.g., the  
8 presence of storage pits, extensive refuse middens, and large quantities of fire-cracked rock)  
9 from middle and late Archaic period archaeological sites indicate that during that period the  
10 cultures of the Native Americans became more sedentary.

11  
12 In the Indian River period (named for the Indian River Lagoon), Native American cultures along  
13 the east-central coast of Florida reached their modern configurations as observed and noted at  
14 the time of the initial European contact in the 16<sup>th</sup> and 17<sup>th</sup> centuries. The Indian River period is  
15 subdivided into two phases: the Malabar I phase (500 B.C. to A.D. 750) and the Malabar II  
16 phase (A.D. 750 to around 1550). The Native American culture that existed during the Indian  
17 River period mirrors the better known St. Johns I and II period culture of the people immediately  
18 to the north of St. Lucie and Indian River counties, although the Indian River people had their  
19 own distinct economy and material culture.

20  
21 During the Malabar I phase, groundwater and sea levels were lower than present levels;  
22 therefore, the environment in and around the Indian River Lagoon was dominated by prairies,  
23 pine flatwoods, and cabbage palm hammocks. That kind of environment would not be  
24 particularly productive, so Native American population levels in the Indian River region probably  
25 were lower than in surrounding regions, such as the St. Johns Basin.

26  
27 In the Malabar II phase, estuaries such as the Indian River Lagoon would have become wetter  
28 and more biologically productive, and thus more capable of sustaining larger populations of  
29 Native Americans. However, Indian River period coastal settlements were probably used only  
30 seasonally as bases for collecting shellfish (mainly oysters) and fishing (mainly marine catfish).  
31 The Indian River period people probably were primarily foragers rather than full-time sedentary  
32 agriculturalists as was the case for the Native Americans in neighboring regions. Indeed, most  
33 of the regions surrounding the Indian River Lagoon area, with the possible exception of Lake  
34 Okeechobee, apparently participated in the widespread and complex Mississippian culture  
35 phenomenon that resulted in the development of a number of chiefdoms throughout the  
36 Southeast. Even the Lake Okeechobee area, although not directly linked with the Mississippian  
37 culture, might have been an important center of ceremonial activities.  
38

1 An example of a large Indian River period archaeological site is the King's Mound located  
2 immediately west of the St. Lucie plant on the west side of the Indian River Lagoon. This site  
3 contains a ramped sand mound, approximately 4 m (13.1 ft) in height and 30 m (97.6 ft) in  
4 diameter, along with an associated refuse midden that covers an area of about 5000 m<sup>2</sup>  
5 (5980 yd<sup>2</sup>).  
6

7 At the beginning of the 16<sup>th</sup> century, the area around Indian River Lagoon was occupied by the  
8 Ais Indians, who probably were descendants of the earlier Indian River period populations. The  
9 historic Ais were linguistically related to the better known Muskogean-speaking Tekesta  
10 (Tequesta) of the southern tip of Florida and the Calusa of southeastern Florida. All three  
11 groups relied on foraging to a much greater extent than did the tribes of northern Florida.  
12

13 The Historic period in Florida began in 1513 when the first European explorers arrived. In that  
14 year, the Spanish explorer Ponce de León explored the southern coasts of Florida from the Gulf  
15 coast area around Fort Myers to the Atlantic coast south of Cape Canaveral (Rouse 1951;  
16 Bense 1994; Milanich 1998; Cumming 1998). An attempt to colonize a portion of the Calusa  
17 territory led to the death of Ponce de León in 1521 and the subsequent abandonment of the  
18 colony. In 1564, the French established Fort Caroline at the mouth of the St. James River  
19 about 300 km (186 mi) north of the modern St. Lucie site. The French colonists were  
20 slaughtered in 1565 by a Spanish force under Pedro Menéndez de Avilés, who subsequently  
21 established the colony of St. Augustine at this location. The English buccaneer Sir Francis  
22 Drake sacked and burned St. Augustine in 1586, but the Spanish reoccupied, rebuilt, and  
23 fortified the colony.  
24

25 After an unsuccessful attempt at establishing a mission by the Jesuit Order in the middle of the  
26 16<sup>th</sup> century, the Catholic Church supported the Franciscan mission in Florida during the 17<sup>th</sup>  
27 and early 18<sup>th</sup> centuries (McEwan 1993). However, disease, slave raids, European warfare,  
28 and enforced removal to Cuba decimated the Ais, Calusa, and Tekesta tribes during the latter  
29 half of the 16<sup>th</sup> century and throughout the 17<sup>th</sup> century. By the mid-1600s most of the original  
30 Florida tribes were represented by a few hundred people, mostly attached to the Spanish  
31 missions. By the mid-18<sup>th</sup> century the Ais, Calusa, and Tekesta tribes had disappeared from  
32 the historic record and are now considered extinct.  
33

34 One other notable event associated with the colonial history of the region occurred during the  
35 18<sup>th</sup> century. During a hurricane on July 31, 1715, a 12-ship Spanish treasure fleet was lost on  
36 the reefs along the coast of the modern St. Lucie and Indian River counties. The 1500  
37 survivors of this shipwreck established a camp and salvors station located about 60 km (37 mi)  
38 north of the modern St. Lucie plant.  
39

40 During the period of the early to mid-1700s, Creek Indians began moving into northern and  
41 central Florida and by the 1760s were beginning to be recognized by the name Seminole. In

## Plant and the Environment

1 1817, Andrew Jackson attacked Seminole villages in Spanish Florida as a continuation of  
2 earlier warfare with the Creek Indians in Alabama and Georgia. This action is known as the  
3 First Seminole War.  
4

5 In 1819, after a period of more than 100 years of contested colonization in the Southeast  
6 among France, England, and Spain, the United States annexed Florida. In 1830, then  
7 President Andrew Jackson was successful in convincing Congress to pass the Indian Removal  
8 Act. Under this Act, the Southeastern Indian tribes, including the Seminoles, were to be forcibly  
9 removed to lands west of the Mississippi River in what was to become the State of Oklahoma.  
10 The Seminoles refused to go, and in 1835, they launched what became known as the Second  
11 Seminole War. Two years later, 400 Seminole warriors and 800 Federal troops fought a  
12 pitched battle just north of Lake Okeechobee. After this battle, U.S. Army Lt. Col. Benjamin  
13 Kendrick Pierce established a fort to be used as the army headquarters for the duration of the  
14 Second Seminole War. After five more years of warfare, the Seminoles took refuge in the  
15 Everglades in 1842.  
16

17 With the diminished threat of warfare, Ft. Pierce began to develop rapidly into a civilian  
18 community that continues to exist. St. Lucie County was formally established from a portion of  
19 Mosquito County in 1844. The name of the county was changed to Brevard during the 1850s,  
20 but the name reverted to St. Lucie in 1905.  
21

22 In 1845, Florida became the 27<sup>th</sup> State to join the United States of America, and in January  
23 1861, it seceded from the Union and joined the Confederacy. Although no major Civil War  
24 battles were fought in southern or central Florida, Florida was involved in supplying people,  
25 materials, and food to the Confederate war effort. The physical effects of the Civil War and the  
26 abolishment of slavery fundamentally changed the economic basis of the Southeast between  
27 1865 and 1917 (Bense 1994). While plantations were typically returned to their former owners,  
28 plant operations became dependent on voluntary contracts or tenant farming with their labor  
29 force. Over time, plantations became smaller; the average size was less than 40 ha (100 ac)  
30 by 1920. Expansion of the railroads, rebuilding of basic infrastructure, and the Industrial  
31 Revolution all led to major cultural changes.  
32

33 The City of Ft. Pierce was incorporated in 1901. The Ft. Pierce economy at the end of the 19<sup>th</sup>  
34 and beginning of the 20<sup>th</sup> centuries was based on water transportation, fishing and the canning  
35 of fish, and cash crops dominated by pineapple and later by citrus fruit. The period between  
36 World War I and World War II saw the continued growth of small towns and small plantations  
37 and independent farms. The railroad system allowed the City of Ft. Pierce to become the  
38 economic and commercial hub of Florida's so-called Treasure Coast.  
39

### 2.2.9.2 Historic and Archaeological Resources at St. Lucie Site

As previously noted, historic and archaeological site file searches were conducted at the Florida Master File in the Florida Division of Historical Resources to identify specific historic cultural resources that might be present at the St. Lucie plant. In addition, record searches were conducted for nearby locations to gain perspective on the types of historic resources that may be present in the previously undeveloped and unsurveyed portions of the St. Lucie site.

An archaeological survey was conducted at the St. Lucie site in 1973 before construction of the St. Lucie plant (Morrell 1973). No archaeological or historical properties were identified within the area directly developed for the St. Lucie plant. Recent record searches revealed five known archaeological sites located on or immediately adjacent to the property boundaries for the St. Lucie Plant. Archaeological Site 8SL13 ("Blind Creek I") and Site 8SL44 ("Blind Creek II") are north of Blind Creek and situated immediately adjacent to, but outside, the northern property line of the plant. These sites represent Malabar I and possibly Malabar II mounds and middens, including a burial mound with a surface area of approximately 4 ha (10 ac). Archaeological Site 8SL26 is a historic shipwreck (a side-wheeler of undetermined origin) situated on sand and dead reef fragments about 610 m (2000 ft) offshore from Hutchinson Island, which is immediately north and east of the eastern end of Blind Creek and outside the St. Lucie plant property boundary. Archaeological Site 8SL33 ("Swamp Wreck") is a buried shipwreck of undetermined origin (but more than 50 years old) situated in mangroves immediately inside of the southern property boundary of the St. Lucie plant. Archaeological Site 8SL55, a 19<sup>th</sup> century shipwreck of undetermined origin, is located along the shoreline of Hutchinson Island in the vicinity of and immediately south of Site 8SL33. Archaeological Site 8SL22, the remains of an undetermined vessel from the 1715 Spanish treasure fleet, is located in the vicinity of and immediately south of Site 8SL55. No structures or buildings at or near the St. Lucie plant are 50 years in age or older.

As previously mentioned, the original Native American inhabitants of the Indian River Lagoon area, the Ais and their predecessors from the Indian River period, became extinct as a tribe during the 18<sup>th</sup> century. However, the modern Seminole and Miccosukee Tribes have taken on tribal responsibilities for cultural resources issues pertaining to the archaeology of the Ais culture and their predecessors.

### 2.2.10 Related Federal Project Activities and Consultations

The staff reviewed the possibility that activities of other Federal agencies might impact the renewal of the OLS for St. Lucie Units 1 and 2. Any such activities could result in cumulative environmental impacts, and the possible need for a Federal agency to become a cooperating agency for preparation of this supplemental environmental impact statement (SEIS) [10 CFR 51.10(b)(2)].

## Plant and the Environment

1 The closest Federal lands to the St. Lucie plant are (1) Hope Sound National Wildlife Refuge  
2 located approximately 35 km (22 mi) south of the plant site, (2) Pelican Island National Wildlife  
3 Refuge located approximately 51 km (32 mi) north of the plant site, and (3) Loxahatchee  
4 National Wildlife Refuge located approximately 77 km (48 mi) south of the plant site. The U.S.  
5 Air Force Avon Park bombing and gunnery range is located approximately 95 km (59 mi)  
6 northwest of the plant. Patrick Air Force Base is located approximately 103 km (64 mi) north of  
7 the St. Lucie site.

8  
9 The closest Native American land to the St. Lucie plant is the Brighton Seminole Indian  
10 Reservation located approximately 77 km (48 mi) southwest of the plant.

11  
12 After reviewing the Federal activities in the vicinity of the St. Lucie plant, the staff determined  
13 that there were no Federal project activities that would make it desirable for another Federal  
14 agency to become a cooperating agency for preparation of the SEIS.

15  
16 NRC is required under Section 102(C) of National Environmental Policy Act of 1969 to consult  
17 with and obtain the comments of any Federal agency that has jurisdiction by law or special  
18 expertise with respect to any environmental impact involved. During the preparation of this  
19 SEIS, NRC consulted with the U.S. Fish and Wildlife Service and the National Marine Fisheries  
20 Service. Consultation correspondence is included in Appendix E.

## 22 2.3 References

23  
24 10 CFR 20. Code of Federal Regulations, Title 10, *Energy*, Part 20, "Standards for Protection  
25 Against Radiation."

26  
27 10 CFR 50. Code of Federal Regulations, Title 10, *Energy*, Part 50, "Domestic Licensing of  
28 Production and Utilization Facilities."

29  
30 10 CFR 51. Code of Federal Regulations, Title 10, *Energy*, Part 51, "Environmental Protection  
31 Regulations for Domestic Licensing and Related Regulatory Functions."

32  
33 10 CFR 54. Code of Federal Regulations, Title 10, *Energy*, Part 54, "Requirements for  
34 Renewal of Operating Licenses for Nuclear Power Plants."

35  
36 40 CFR 81. Code of Federal Regulations, Title 40, *Protection of the Environment*, Part 81,  
37 "Designation of Areas for Air Quality Planning Purposes."

38  
39 40 CFR 190. Code of Federal Regulations, Title 40, *Protection of Environment*, Part 190,  
40 "Environmental Radiation Protection Standards for Nuclear Power Operations."

1 Applied Biology, Inc. 1985. "Florida Power and Light Company St. Lucie Plant Annual Non-  
2 Radiological Environmental Monitoring Report 1984." Atlanta, Georgia. (L-85-174) April 30,  
3 1985.

4  
5 Bense, J. A. 1994. *Archaeology of the Southeastern United States*. Academic Press,  
6 New York.

7  
8 Bureau of Economic Analysis (BEA). Regional Accounts Data, 2000. *Table CA25 Total Full*  
9 *and Private Employment: Nonfarm Employment (Martin and St. Lucie Counties)*.  
10 <http://www.bea.doc.gov/bea/regional/reis/>. Accessed July 22, 2002.

11  
12 City of Port St. Lucie. 1997. *City of Port St. Lucie Comprehensive Growth Management Plan,*  
13 *Potable Water Sub-Element*. Port St. Lucie, Florida.

14  
15 Coastal Zone Management Act (CZMA). 16 USC 1451, et seq.

16  
17 Collins. 2002. Letter from Shirley W. Collins, Acting Administrator, Florida Coastal  
18 Management Program, Florida Department of Community Affairs, to FPL. Project No.  
19 FL200201111376C (March 6, 2002).

20  
21 Cumming, W. P. 1998. *The Southeast in Early Maps*. University of North Carolina Press,  
22 Third Edition, Chapel Hill, North Carolina.

23  
24 Davis, T. 2002. Email correspondence from Terry Davis, Florida Department of Environmental  
25 Protection (FDEP). Tallahassee, Florida, April 23, 2002.

26  
27 Ecological Associates, Inc. 2000. *Physical and Ecological Factors Influencing Sea Turtle*  
28 *Entrainment Levels at the St. Lucie Nuclear Plant: 1976-1998*. L-2000-78, Jensen Beach,  
29 Florida.

30  
31 Elliott, D. L., C. G. Holladay, W. R. Barchet, H. P. Foote, and W. F. Sandusky. 1987. *Wind*  
32 *Energy Resource Atlas of the United States*. DOE/CH 10093-4, U.S. Department of Energy,  
33 Washington, D.C.

34  
35 Endangered Species Act (ESA). 16 USC 1531, et seq.

36  
37 Federal Water Pollution Control Act (FWPCA). 33 USC 1251, et seq. (Also known as the  
38 Clean Water Act [CWA]).

## Plant and the Environment

1 Florida Department of Agricultural and Consumer Services (FDACS). 1998. *Preservation of*  
2 *Native Flora of Florida*. Chapter 5B-40.0055, "Division of Plant Industry." Tallahassee, Florida.  
3 Amended October 5, 1998.

4  
5 Florida Department of Environmental Protection (FDEP). 2000. "State of Florida Industrial  
6 Wastewater Facility Permit. Permit No. FL0002208-Major." Issued to Florida Power and Light  
7 Company for St. Lucie Power Plant Units 1 and 2. Tallahassee, Florida. January 10, 2000.

8  
9 Florida Fish and Wildlife Conservation Commission (FFWCC). 2001. *Florida's Endangered*  
10 *Species, Threatened Species, and Species of Special Concern, Official List*. August 1, 1997.  
11 <http://floridaconservation.org/pubs/endanger.html>. Accessed April 16, 2001.

12  
13 Florida Fish and Wildlife Conservation Commission (FFWCC). 2002. FFWC endangered  
14 species. Available URL: <http://floridaconservation.org/pubs/endanger.html>

15  
16 Florida Geographic Data Library (FGDL). 2002. Florida Geographic Data Library, Version 3.0,  
17 State Data. GeoPlan Center, University of Florida, Gainesville, Florida.  
18 <http://www/fgdl.org/fgdl.htm>.

19  
20 Florida Legislature. 2001. "Total County Population: April 1 1970, 1975, 1980, 1985, 1990,  
21 2000, 2010, 2020 (updated 1/312002)." Office of Economic and Demographic Research.  
22 <http://www.state.fl.us/edr/Population/webpage10.txt> . Accessed January 31, 2002.

23  
24 Florida Natural Areas Inventory (FNAI). 2002. FNAI Web site: <http://www.fnai.org>.

25  
26 Florida Power and Light Company (FPL). 1973. *St. Lucie Plant Unit 2 Environmental Report*  
27 (as amended). Juno Beach, Florida.

28  
29 Florida Power and Light Company (FPL). 1996. "St. Lucie Plant Wastewater Permit  
30 Application." Jensen Beach, Florida.

31  
32 Florida Power and Light Company (FPL). 1998. St. Lucie Units 1 and 2. *Unit 2 Final Safety*  
33 *Analysis Report, Amendment 12*. Miami, Florida.

34  
35 Florida Power and Light Company (FPL). 1999. *St Lucie Unit 1 Updated Final Safety Analysis*  
36 *Report. Amendment No. 18*. Miami, Florida.

37  
38 Florida Power and Light Company (FPL). 2000. *St. Lucie Unit 2 Updated Final Safety Analysis*  
39 *Report. Amendment No. 13*. Miami, Florida.

40

1 Florida Power and Light Company (FPL). 2001a. *Applicant's Environmental Report –*  
 2 *Operating License Renewal Stage St. Lucie Units 1 and 2.* Docket Nos. 50-335 and 50-389,  
 3 Miami, Florida.

4  
 5 Florida Power and Light Company (FPL). 2001b. *St. Lucie Units 1 and 2, 2000 Annual*  
 6 *Radioactive Effluent Release Report.* Docket Nos. 50-335 and 50-389, pp. 7-10, Miami,  
 7 Florida.

8  
 9 Florida Power and Light Company (FPL). 2001c. *Application for Renewed Operating Licenses,*  
 10 *St. Lucie Units 1 and 2.* Docket Nos. 50-335 and 50-389, Miami, Florida.

11  
 12 Florida Power and Light Company (FPL). 2001d. *Annual Environmental Operating Report*  
 13 *2000.* L-2001-90, Juno Beach, Florida.

14  
 15 Florida Power and Light Company (FPL). 2001e. *St. Lucie Units 1 and 2, Annual Radiological*  
 16 *Environmental Operating Report.* Miami, Florida.

17  
 18 Florida Power and Light Company (FPL). 2002. *Offsite Dose Calculation Manual (ODCM),*  
 19 *Rev. 24.* Miami, Florida.

20  
 21 Foster Wheeler Environmental Corporation. 2001. *Florida Power and Light Co. St. Lucie*  
 22 *Power Plant and Transmission Line Threatened and Endangered Species Survey.* Stuart,  
 23 Florida.

24  
 25 Foster Wheeler Environmental Corporation. 2000. *Annual Operation & Maintenance Status*  
 26 *Report (1999-2000) for FPL St. Lucie Power Plant Unit 1 and Unit 2 Remedial Action.* Stuart,  
 27 Florida.

28  
 29 Gilbert, C.R. (Editor). 1992. *Rare and endangered biota of Florida, Vol. II, Fishes.* University  
 30 of Florida Press, Gainesville, Florida

31  
 32 Gilmore, G.R., Jr., C. J. Donohoe, D. W. Cooke, and D. J. Herrema. 1981. *Fishes of the*  
 33 *Indian River Lagoon and Adjacent Waters, Florida.* Harbor Branch Foundation, Inc. Technical  
 34 Report No. 41, Florida Museum of Natural History, Gainesville, Florida.

35  
 36 MacCauley, C. 2000. *The Seminole Indians of Florida.* University Press of Florida,  
 37 Gainesville, Florida.

38  
 39 Martin County. 1999. *County Comprehensive Growth Management Plan.* Text Amendment  
 40 00-01. Chapter 4, "Future Land Use Elements."  
 41 <http://webserver.martin.fl.us/GOVT/depts/gmd/gmp/cpa00.01/cpa01-attachmentb.html>.  
 42 Accessed April 23, 2002.

## Plant and the Environment

- 1 McEwan, Bonnie G. (ed.). 1993. *The Spanish Missions of Florida*. University Press of Florida,  
2 Gainesville, Florida.  
3
- 4 McGoun, W. E. 1993. *Prehistoric Peoples of South Florida*. University of Alabama Press,  
5 Tuscaloosa, Alabama.  
6
- 7 Milanich, J. T. 1994. *Archaeology of Precolumbian Florida*. University Press of Florida,  
8 Gainesville, Florida.  
9
- 10 Milanich, J. T., and Samuel Proctor (eds). 1994. *Tacachale: Essays on the Indians of Florida*  
11 *and Southeastern Georgia During the Historic Period*. Florida Museum of Natural History,  
12 University Press of Florida, Gainesville, Florida.  
13
- 14 Milanich, J. T. 1998. *Florida's Indians from Ancient Times to the Present*. University Press of  
15 Florida, Gainesville, Florida.  
16
- 17 Morrell, L. R. 1973. Letter from State Archaeologist and Chief, Bureau of Historic Sites and  
18 Properties, State of Florida Division of Archives, History, and Resources Management, to  
19 W. J. Barrow, Jr., Environmental Affairs, Florida Power and Light Company Tallahassee,  
20 Florida (May 31, 1973).  
21
- 22 National Environmental Policy Act of 1969 (NEPA). 42 USC 4321, et. seq.  
23
- 24 Ramsdell, J. V., and G. L. Andrews. 1986. *Tornado Climatology of the Contiguous United*  
25 *States*. NUREG/CR-4461, Nuclear Regulatory Commission, Washington, D.C.  
26
- 27 Rouse, I. 1951. *A Survey of Indian River Archaeology*. Yale University Publications in  
28 Archaeology 44, New Haven, Connecticut.  
29
- 30 South Florida Water Management District (SFWMD). 1998. "Upper East Coast (UEC) Water  
31 Supply Plan, Support Document. Appendix E – Water and Treatment Facilities." Available  
32 URL: <http://www.sfwmd.gov/org/pld/proj/wsp/uec/webfiles/appxe.pdf> (Accessed  
33 March 20, 2002).  
34
- 35 St. Lucie County. 2001. *Comprehensive Plan Update*. Prepared by St. Lucie County Board of  
36 County Commissioners and Department of Community Development, Fort Pierce, Florida.  
37

1 St. Lucie County Utilities. 2000. *St. Lucie County Water & Wastewater Plan*. Fort Pierce,  
2 Florida. As cited in: Florida Power and Light Company (FPL) Not Dated. *Application for*  
3 *License Renewal for St. Lucie, Units 1 and 2. Environmental report – Operating License*  
4 *Renewal Stage*. Miami, Florida.

5  
6 The Real Estate Book. Not Dated. St. Lucie and Okeechobee County. Volume 14, Number 3.  
7 <http://www.realestatebook.com>.

8  
9 University of South Florida. 2002. "Atlas of Florida Vascular Plants."  
10 <http://www.plantatlas.usf.edu>.

11  
12 U.S. Army Corps of Engineers (USACE). 1993. "Department of the Army Permit No.  
13 199301803." U.S. Army Engineer District, Jacksonville, Florida.

14  
15 U.S. Atomic Energy Commission (AEC). 1973. *Final Environmental Statement Related to the*  
16 *St. Lucie Plant Unit No. 1; Florida Power and Light Company*. Docket No. 50-335, Directorate  
17 of Licensing, Washington, D.C.

18  
19 U.S. Atomic Energy Commission (AEC). 1974. *Final Environmental Statement Related to*  
20 *Construction of St. Lucie Plant Unit 2; Florida Power and Light Company*. Docket No. 50-389,  
21 Washington, D.C.

22  
23 U.S. Census Bureau (USCB). 1990a. "American Fact Finder. Housing Units by County in  
24 Florida." [http://factfinder.census.gov/servlet/BasicFactsServlet?\\_basicfacts=1&\\_mult1=](http://factfinder.census.gov/servlet/BasicFactsServlet?_basicfacts=1&_mult1=22225710&_geo2=ST-2&_current=&_action=_SLSelected&_child_geo_id=undefined&_lang=en)  
25 [22225710&\\_geo2=ST-2&\\_current=&\\_action=\\_SLSelected&\\_child\\_geo\\_id=undefined&\\_lang=en](http://factfinder.census.gov/servlet/BasicFactsServlet?_basicfacts=1&_mult1=22225710&_geo2=ST-2&_current=&_action=_SLSelected&_child_geo_id=undefined&_lang=en)  
26 Accessed January 30, 2002.

27  
28 U.S. Census Bureau (USCB). 1990b. "American Fact Finder. 1990 Census. Population by  
29 County in Florida." [http://factfinder.census.gov/servlet/BasicFactsServlet?\\_basicfacts=](http://factfinder.census.gov/servlet/BasicFactsServlet?_basicfacts=1&_mult1=22326853&_geo2=ST-2&_current=&_action=_SLSelected&_child_geo_id=undefined&_lang=en)  
30 [1&\\_mult1=22326853&\\_geo2=ST-2&\\_current=&\\_action=\\_SLSelected&\\_child\\_geo\\_id=undefined](http://factfinder.census.gov/servlet/BasicFactsServlet?_basicfacts=1&_mult1=22326853&_geo2=ST-2&_current=&_action=_SLSelected&_child_geo_id=undefined&_lang=en)  
31 [&\\_lang=en](http://factfinder.census.gov/servlet/BasicFactsServlet?_basicfacts=1&_mult1=22326853&_geo2=ST-2&_current=&_action=_SLSelected&_child_geo_id=undefined&_lang=en). Accessed April 25, 2002.

32  
33 U.S. Census Bureau (USCB). 2000. "American Fact Finder. 2000 Census. Population and  
34 Housing by County in Florida." [http://factfinder.census.gov/servlet/](http://factfinder.census.gov/servlet/BasicFactsServlet?_basicfacts=1&_mult1=22225649&_geo2=050&_geoType1=86086400&_current=1&_action=_geoTypeSelected&_child_geo_id=&_lang=en)  
35 [BasicFactsServlet?\\_basicfacts=1&\\_mult1=22225649&\\_geo2=050&\\_geoType1=86086400&\\_cur](http://factfinder.census.gov/servlet/BasicFactsServlet?_basicfacts=1&_mult1=22225649&_geo2=050&_geoType1=86086400&_current=1&_action=_geoTypeSelected&_child_geo_id=&_lang=en)  
36 [rent=1&\\_action=\\_geoTypeSelected&\\_child\\_geo\\_id=&\\_lang=en](http://factfinder.census.gov/servlet/BasicFactsServlet?_basicfacts=1&_mult1=22225649&_geo2=050&_geoType1=86086400&_current=1&_action=_geoTypeSelected&_child_geo_id=&_lang=en). Accessed January 30, 2002.

## Plant and the Environment

1 U.S. Department of Agriculture (USDA). 1997a. "1997 Census of Agriculture – County Data.  
2 Table 5. Hired Farm Labor-Workers and Payroll 1997. County Summary Highlights: 1997.  
3 National Agricultural Statistic Service. Florida County Level Data. Volume 1: Part 9, Chapter  
4 2." Washington, D.C. [http://www.nass.usda.gov/census/census97/volume1/fl-9/fl2\\_05.pdf](http://www.nass.usda.gov/census/census97/volume1/fl-9/fl2_05.pdf).  
5 Accessed May 1, 2002.

6  
7 U.S. Department of Agriculture (USDA). 1997b. "Census of Agriculture – County Data.  
8 Table 1. County Summary Highlights: 1997." National Agricultural Statistic Service. Florida  
9 County Level Data. Volume 1: Part 9, Chapter 2. Washington, D.C.  
10 <http://www.nass.usda.gov/census/census97/volume1/fl-9/toc297.htm>. Accessed May 1, 2002.

11  
12 U.S. Department of Agriculture (USDA). 2001. (Released August 17, 2001). "Farm Labor."  
13 National Agricultural Statistics Service. <http://usda.mannlib.cornell.edu>. Accessed May 2,  
14 2002.

15  
16 U.S. Fish and Wildlife Service (FWS). 1999. *South Florida Multi-Species Recovery Plan*.  
17 p. 2172, Atlanta, Georgia.

18  
19 U.S. Fish and Wildlife Service (FWS). 2000. "Endangered and Threatened Wildlife and Plants,  
20 Wintering Piping Plovers, Proposed Rules." Federal Register, Vol. 65, No. 130, pp. 41782-  
21 41812. Department of the Interior, Washington, D.C.

22  
23 U.S. Fish and Wildlife Service (FWS). 2002a. Letter from Ms. Linda Ferrell, FWS to  
24 Mr. Christopher Grimes, NRC.

25  
26 U.S. Fish and Wildlife Service (FWS). 2002b. Vero Beach Ecological Services Web site:  
27 <http://verobeach.fws.gov>.

28  
29 U.S. Nuclear Regulatory Commission (NRC). 1982. *Final Environmental Statement Related to*  
30 *the Operation of St. Lucie Plant, Unit No. 2. Florida Power and Light Company, Orlando*  
31 *Utilities Commission of the City of Orlando, Florida*. Docket No. 50-389, NUREG-0842, Office  
32 of Nuclear Reactor Regulation, Washington, D.C.

33  
34 U.S. Nuclear Regulatory Commission (NRC). 1991. *Offsite Dose Calculation Natural*  
35 *Guidance: Standard Radiological Effluent controls for Pressurized Water Reactors*. NUREG-  
36 1301, Washington D.C.

1 Waring, G. T., D. L. Palka, P. J. Clapham, S. Swartz, M. C. Rossman, T. V. N. Cole,  
2 L. J. Hansen, K. D. Isack, K. D. Mullin, R. S. Wells, D. K. Odell, and N.B. Barros. 1999.  
3 "U.S. Atlantic and Gulf of Mexico Marine Mammal Stock Assessments – 1999." NOAA  
4 Technical Memorandum, NMFS-NE-153, National Oceanic and Atmospheric Administration,  
5 Northeast Fisheries Science Center, Woods Hole, Massachusetts.  
6  
7

### 3.0 Environmental Impacts of Refurbishment

Environmental issues associated with refurbishment activities are discussed in the *Generic Environmental Impact Statement for License Renewal of Nuclear Plants* (GEIS), NUREG-1437, Volumes 1 and 2 (NRC 1996, 1999).<sup>(a)</sup> The GEIS includes a determination of whether the analysis of the environmental issues could be applied to all plants and whether additional mitigation measures would be warranted. Issues are then assigned a Category 1 or a Category 2 designation. As set forth in the GEIS, Category 1 issues are those that meet all of the following criteria:

- (1) The environmental impacts associated with the issue have been determined to apply either to all plants or, for some issues, to plants having a specific type of cooling system or other specified plant or site characteristic.
- (2) A single significance level (i.e., SMALL, MODERATE, or LARGE) has been assigned to the impacts (except for collective offsite radiological impacts from the fuel cycle and from high level waste and spent fuel disposal).
- (3) Mitigation of adverse impacts associated with the issue has been considered in the analysis, and it has been determined that additional plant-specific mitigation measures are likely not to be sufficiently beneficial to warrant implementation.

For issues that meet the three Category 1 criteria, no additional plant-specific analysis is required in this supplemental environmental impact statement (SEIS) unless new and significant information is identified.

Category 2 issues are those that do not meet one or more of the criteria for Category 1 and, therefore, additional plant-specific review of these issues is required.

License renewal actions may require refurbishment activities for the extended plant life. These actions may have an impact on the environment that requires evaluation, depending on the type of action and the plant-specific design. Environmental issues associated with refurbishment that were determined to be Category 1 issues are listed in Table 3-1.

Environmental issues related to refurbishment considered in the GEIS for which these conclusions could not be reached for all plants, or for specific classes of plants, are Category 2 issues. These are listed in Table 3-2.

---

(a) The GEIS was originally issued in 1996. Addendum 1 to the GEIS was issued in 1999. Hereafter, all references to the "GEIS" include the GEIS and its Addendum 1.

Environmental Impacts of Refurbishment

Table 3-1. Category 1 Issues for Refurbishment Evaluation

ISSUE—10 CFR Part 51, Subpart A, Appendix B, Table B-1	GEIS Section
<b>SURFACE-WATER QUALITY, HYDROLOGY, AND USE (FOR ALL PLANTS)</b>	
Impacts of refurbishment on surface-water quality	3.4.1
Impacts of refurbishment on surface-water use	3.4.1
<b>AQUATIC ECOLOGY (FOR ALL PLANTS)</b>	
Refurbishment	3.5
<b>GROUNDWATER USE AND QUALITY</b>	
Impacts of refurbishment on groundwater use and quality	3.4.2
<b>LAND USE</b>	
Onsite land use	3.2
<b>HUMAN HEALTH</b>	
Radiation exposures to the public during refurbishment	3.8.1
Occupational radiation exposures during refurbishment	3.8.2
<b>SOCIOECONOMICS</b>	
Public services: public safety, social services, and tourism and recreation	3.7.4; 3.7.4.3; 3.7.4.4; 3.7.4.6
Aesthetic impacts (refurbishment)	3.7.8

Category 1 and Category 2 issues related to refurbishment that are not applicable to St. Lucie Units 1 and 2 are listed in Appendix F. Because they are related to plant design features or site characteristics not found at St. Lucie they are not considered further in this section.

The potential environmental effects of refurbishment actions would be identified and the analysis would be summarized within this section, if such actions were planned. Florida Power and Light Company (FPL) indicated that it has performed an evaluation of structures and components pursuant to 10 CFR 54.21 to identify activities that are necessary to continue operation of St. Lucie Units 1 and 2 during the requested 20-year period of extended operation. These activities include replacement of certain components as well as new inspection activities and are described in the Environmental Report (FPL 2001).

However, FPL stated that the replacement of these components and the additional inspection activities are within the bounds of normal plant component replacement and inspections; therefore, they are not expected to affect the environment outside the bounds of plant operations as evaluated in the final environmental statement (AEC 1972, 1974). In addition, FPL's evaluation of structures and components as required by 10 CFR 54.21 did not identify any major plant refurbishment activities or modifications necessary to support the continued

Table 3-2. Category 2 Issues for Refurbishment Evaluation

ISSUE—10 CFR Part 51, Subpart A, Appendix B, Table B-1	GEIS Section	10 CFR 51.53 (c)(3)(ii) Subparagraph
<b>TERRESTRIAL RESOURCES</b>		
Refurbishment impacts	3.6	E
<b>THREATENED OR ENDANGERED SPECIES (FOR ALL PLANTS)</b>		
Threatened or endangered species	3.9	E
<b>AIR QUALITY</b>		
Air quality during refurbishment (nonattainment and maintenance areas)	3.3	F
<b>SOCIOECONOMICS</b>		
Housing impacts	3.7.2	I
Public services: public utilities	3.7.4.5	I
Public services: education (refurbishment)	3.7.4.1	I
Offsite land use (refurbishment)	3.7.5	I
Public services, transportation	3.7.4.2	J
Historic and archaeological resources	3.7.7	K
<b>ENVIRONMENTAL JUSTICE</b>		
Environmental justice	Not addressed <sup>(a)</sup>	Not addressed <sup>(a)</sup>
(a) Guidance related to environmental justice was not in place at the time the GEIS and the associated revision to 10 CFR Part 51 were prepared. If an applicant plans to undertake refurbishment activities for license renewal, environmental justice must be addressed in the applicant's environmental report and the staff's environmental impact statement.		

operation of St. Lucie Units 1 and 2 beyond the end of the existing operating licenses. Therefore, refurbishment is not considered in this draft supplemental environmental impact statement.

### 3.1 References

10 CFR 51. Code of Federal Regulations, Title 10, *Energy*, Part 51, "Environmental Protection Regulations for Domestic Licensing and Related Regulatory Functions."

10 CFR 54. Code of Federal Regulations, Title 10, *Energy*, Part 54, "Requirements for Renewal of Operating Licenses for Nuclear Power Plants."

## Environmental Impacts of Refurbishment

- 1 Florida Power and Light Company (FPL). 2001. *Applicant's Environmental Report – Operating*  
2 *License Renewal Stage St. Lucie Units 1 and 2*. Miami, Florida.
- 3
- 4 U.S. Atomic Energy Commission (AEC). 1972. *Final Environmental Statement Related to*  
5 *Operation of St. Lucie Plant Unit 1, Florida Power and Light Company*. Dockets No. 50-250  
6 and 50-251, Washington, D.C.
- 7
- 8 U.S. Atomic Energy Commission (AEC). 1974. *Final Environmental Statement Related to*  
9 *Operation of St. Lucie Plant Unit 2, Florida Power and Light Company*. Docket Nos. 50-389,  
10 Washington D.C.
- 11
- 12 U.S. Nuclear Regulatory Commission (NRC). 1996. *Generic Environmental Impact Statement*  
13 *for License Renewal of Nuclear Plants*. NUREG-1437, Volumes 1 and 2, Washington, D.C.
- 14
- 15 U.S. Nuclear Regulatory Commission (NRC). 1999. *Generic Environmental Impact Statement*  
16 *for License Renewal of Nuclear Plants, Main Report*, "Section 6.3 – Transportation, Table 9.1,  
17 Summary of findings on NEPA issues for license renewal of nuclear power plants, Final  
18 Report." NUREG-1437, Volume 1, Addendum 1, Washington, D.C.
- 19
- 20

## 4.0 Environmental Impacts of Operation

Environmental issues associated with the operation of a nuclear power plant during the renewal term are discussed in the *Generic Environmental Impact Statement for License Renewal of Nuclear Plants* (GEIS), NUREG-1437, Volumes 1 and 2 (NRC 1996,1999)<sup>(a)</sup>. The GEIS includes a determination of whether the analysis of the environmental issues could be applied to all plants and whether additional mitigation measures would be warranted. Issues are then assigned a Category 1 or a Category 2 designation. As set forth in the GEIS, Category 1 issues are those that meet all of the following criteria:

- (1) The environmental impacts associated with the issue have been determined to apply either to all plants or, for some issues, to plants having a specific type of cooling system or other specified plant or site characteristic.
- (2) A single significance level (i.e., SMALL, MODERATE, or LARGE) has been assigned to the impacts (except for collective offsite radiological impacts from the fuel cycle and from high-level waste and spent fuel disposal).
- (3) Mitigation of adverse impacts associated with the issue has been considered in the analysis, and it has been determined that additional plant-specific mitigation measures are likely not to be sufficiently beneficial to warrant implementation.

For issues that meet the three Category 1 criteria, no additional plant-specific analysis is required unless new and significant information is identified.

Category 2 issues are those that do not meet one or more of the criteria for Category 1, and therefore, additional plant-specific review of these issues is required.

This chapter addresses the issues related to operation during the renewal term that are listed in Table B-1 of 10 CFR Part 51, Subpart A, Appendix B, and are applicable to the St. Lucie Units 1 and 2. Section 4.1 addresses issues applicable to the St. Lucie cooling system. Section 4.2 addresses issues related to transmission lines and onsite land use. Section 4.3 addresses the radiological impacts of normal operation, and Section 4.4 addresses issues related to the socioeconomic impacts of normal operation during the renewal term. Section 4.5 addresses issues related to groundwater use and quality, while Section 4.6 discusses the impacts of renewal-term operations on threatened and endangered species. Section 4.7 addresses potential new information that was raised during the scoping period. The results of the evaluation of environmental issues related to operation during the renewal term are

---

(a) The GEIS was originally issued in 1996. Addendum 1 to the GEIS was issued in 1999. Hereafter, all references to the "GEIS" include the GEIS and its Addendum 1.

## Environmental Impacts of Operation

1 summarized in Section 4.8. Finally, Section 4.9 lists the references for Chapter 4.0.  
2 Category 1 and Category 2 issues that are not applicable because they are related to plant  
3 design features or site characteristics not found at St. Lucie Units 1 and 2 are listed in  
4 Appendix F.  
5

### 6 **4.1 Cooling Systems**

7  
8 Category 1 issues in Table B-1 of 10 CFR Part 51, Subpart A, Appendix B, that are applicable  
9 of the St. Lucie Units 1 and 2 cooling system operation during the renewal term are listed in  
10 Table 4-1. Florida Power & Light (FPL) stated in the Environmental Report (ER) that there is no  
11 new and significant information associated with the renewal of St. Lucie Units 1 and 2 that  
12 would warrant additional plant-specific analysis of the remaining Category 1 issues applicable to  
13 St. Lucie Units 1 and 2 (FPL 2001a). The staff has not identified any significant new  
14 information during its independent review of the ER (FPL 2001a), the staff's site visit, the  
15 scoping process, or its evaluation of other available information. Therefore, the staff concludes  
16 that there are no impacts related to these issues beyond those discussed in the GEIS. For all  
17 Category 1 issues, the staff concluded in the GEIS that the impacts are SMALL, and additional  
18 plant-specific mitigation measures are not likely to be sufficiently beneficial to be warranted.  
19

20 **Table 4-1. Category 1 Issues Applicable to the Operation of the St. Lucie Units 1 and 2**  
21 **Cooling System During the Renewal Term**

22

ISSUE—10 CFR Part 51, Subpart A, Appendix B, Table B-1	GEIS Section
<b>SURFACE WATER QUALITY, HYDROLOGY, AND USE (FOR ALL PLANTS)</b>	
Altered current patterns at intake and discharge structures	4.2.1.2.1; 4.3.2.2; 4.4.2
Altered salinity gradients	4.2.1.2.2; 4.4.2.2
Temperature effects on sediment transport capacity	4.2.1.2.3; 4.4.2.2
Scouring caused by discharged cooling water	4.2.1.2.3; 4.4.2.2
Discharge of chlorine or other biocides	4.2.1.2.4; 4.4.2.2
Discharge of sanitary wastes and minor chemical spills	4.2.1.2.4; 4.4.2.2
Discharge of other metals in wastewater	4.2.1.2.4; 4.3.2.2; 4.4.2.2
Eutrophication	4.2.1.2.3; 4.4.2.2
Water use conflicts (plants with once-through cooling systems)	4.2.1.3

23  
24  
25  
26  
27  
28  
29  
30  
31  
32  
33

Table 4-1. (contd)

ISSUE—10 CFR Part 51, Subpart A, Appendix B, Table B-1	GEIS Section
<b>AQUATIC ECOLOGY (FOR ALL PLANTS)</b>	
Accumulation of contaminants in sediments or biota	4.2.1.2.4; 4.3.3; 4.4.3; 4.4.2.2
Entrainment of phytoplankton and zooplankton	4.2.2.1.1; 4.3.3; 4.4.3
Cold shock	4.2.2.1.5; 4.3.3; 4.4.3
Thermal plume barrier to migrating fish	4.2.2.1.6; 4.4.3
Distribution of aquatic organisms	4.2.2.1.6; 4.4.3
Gas super saturation (gas bubble disease)	4.2.2.1.8; 4.4.3
Low dissolved oxygen in the discharge	4.2.2.1.9; 4.3.3; 4.4.3
Losses from predation, parasitism, and disease among organisms exposed to sublethal stresses	4.2.2.1.10; 4.4.3
Stimulation of nuisance organisms	4.2.2.1.11; 4.4.3
<b>HUMAN HEALTH</b>	
Noise	4.3.7

A brief description of the staff's review and the GEIS conclusions, as codified in Table B-1, for each of these issues follows:

- Altered current patterns at intake and discharge structures. Based on information in the GEIS, the Commission found that

Altered current patterns have not been found to be a problem at operating nuclear power plants and are not expected to be a problem during the license renewal term.

The staff has not identified any significant new information during its independent review of the FPL ER (FPL 2001a), the staff's site visit, the scoping process, or its evaluation of other available information. Therefore, the staff concludes that there are no impacts of altered current patterns at intake and discharge structures during the renewal term beyond those discussed in the GEIS.

- Altered salinity gradients. Based on information in the GEIS, the Commission found that

Salinity gradients have not been found to be a problem at operating nuclear power plants and are not expected to be a problem during the license renewal term.

The staff has not identified any significant new information during its independent review of the FPL ER (FPL 2001a), the staff's site visit, the scoping process, or its evaluation of other

## Environmental Impacts of Operation

1 available information. Therefore, the staff concludes that there are no impacts of altered  
2 salinity gradients during the renewal term beyond those discussed in the GEIS.

- 3  
4 • Temperature effects on sediment transport capacity. Based on information in the GEIS,  
5 the Commission found that

6  
7 These effects have not been found to be a problem at operating nuclear power  
8 plants and are not expected to be a problem during the license renewal term.

9  
10 The staff has not identified any significant new information during its independent review of  
11 the FPL ER (FPL 2001a), the staff's site visit, the scoping process, or its evaluation of other  
12 available information. Therefore, the staff concludes that there are no impacts of  
13 temperature effects on sediment transport capacity during the renewal term beyond those  
14 discussed in the GEIS.

- 15  
16 • Scouring caused by discharged cooling water. Based on information in the GEIS, the  
17 Commission found that

18  
19 Scouring has not been found to be a problem at most operating nuclear power  
20 plants and has caused only localized effects at a few plants. It is not expected to  
21 be a problem during the license renewal term.

22  
23 The staff has not identified any significant new information during its independent review of  
24 the FPL ER (FPL 2001a), the staff's site visit, the scoping process, or its evaluation of other  
25 available information. Therefore, the staff concludes that there are no impacts of scouring  
26 caused by discharged cooling water during the renewal term beyond those discussed in the  
27 GEIS.

- 28  
29 • Eutrophication. Based on information in the GEIS, the Commission found that

30  
31 Eutrophication has not been found to be a problem at operating nuclear power  
32 plants and is not expected to be a problem during the license renewal term.

33  
34 The staff has not identified any significant new information during its independent review of  
35 the FPL ER (FPL 2001a), the staff's site visit, the scoping process, or its evaluation of other  
36 available information including plant monitoring data and technical reports. Therefore, the  
37 staff concludes that there are no impacts of eutrophication during the renewal term beyond  
38 those discussed in the GEIS.

39

- 1 • Discharge of chlorine or other biocides. Based on information in the GEIS, the  
2 Commission found that

3  
4 Effects are not a concern among regulatory and resource agencies, and are not  
5 expected to be a problem during the license renewal term.  
6

7 The staff has not identified any significant new information during its independent review of  
8 the FPL ER (FPL 2001a), the staff's site visit, the scoping process, or its evaluation of other  
9 available information. Compliance with the National Pollutant Discharge Elimination System  
10 (NPDES) permit for St. Lucie Units 1 and 2 has also been demonstrated (FDEP 2002).  
11 Therefore, the staff concludes that there are no impacts of discharge of chlorine or other  
12 biocides during the renewal term beyond those discussed in the GEIS.  
13

- 14 • Discharge of sanitary wastes and minor chemical spills. Based on information in the  
15 GEIS, the Commission found that

16  
17 Effects are readily controlled through NPDES permit and periodic modifications,  
18 if needed, and are not expected to be a problem during the license renewal term.  
19

20 The staff has not identified any significant new information during its independent review of  
21 the FPL ER (FPL 2001a), the staff's site visit, the scoping process, or its evaluation of other  
22 available information including the NPDES (FDEP 2000) permit for St. Lucie Units 1 and 2.  
23 Therefore, the staff concludes that there are no impacts of discharges of sanitary wastes  
24 and minor chemical spills during the renewal term beyond those discussed in the GEIS.  
25

- 26 • Discharge of other metals in wastewater. Based on information in the GEIS, the  
27 Commission found that

28  
29 These discharges have not been found to be a problem at operating nuclear  
30 power plants with cooling-tower-based heat dissipation systems and have been  
31 satisfactorily mitigated at other plants. They are not expected to be a problem  
32 during the license renewal term.  
33

34 The staff has not identified any significant new information during its independent review of  
35 the FPL ER (FPL 2001a), the staff's site visit, the scoping process, or its evaluation of other  
36 available information including the NPDES permit (FDEP 2000) for St. Lucie Units 1 and 2  
37 and the ecological risk assessment study for the cooling canal system (Ecological  
38 Associates 2001). Therefore, the staff concludes that there are no impacts of discharges of  
39 other metals in wastewater during the renewal term beyond those discussed in the GEIS.  
40

## Environmental Impacts of Operation

- 1 • Water-use conflicts (plants with once-through cooling systems). Based on information  
2 in the GEIS, the Commission found that

3  
4 These conflicts have not been found to be a problem at operating nuclear power  
5 plants with once-through heat dissipation systems.  
6

7 The staff has not identified any significant new information during its independent review of  
8 the FPL ER (FPL 2001a), the staff's site visit, the scoping process, or its evaluation of other  
9 available information. Therefore, the staff concludes that there are no impacts of water-use  
10 conflicts for plants with once-through cooling systems during the renewal term beyond those  
11 discussed in the GEIS.  
12

- 13 • Accumulation of contaminants in sediments or biota. Based on information in the GEIS,  
14 the Commission found that

15  
16 Accumulation of contaminants has been a concern at a few nuclear power plants  
17 but has been satisfactorily mitigated by replacing copper alloy condenser tubes  
18 with those of another metal. It is not expected to be a problem during the license  
19 renewal term.  
20

21 The staff has not identified any significant new information during its independent review of  
22 the FPL ER (FPL 2001a), the staff's site visit, the scoping process, or its evaluation of  
23 available information, including the ecological risk assessment for the cooling canal system  
24 (Ecological Associates 2001). Therefore, the staff concludes that there are no impacts of  
25 accumulation of contaminants in sediments or biota during the renewal term beyond those  
26 discussed in the GEIS.  
27

- 28 • Entrainment of phytoplankton and zooplankton. Based on information in the GEIS, the  
29 Commission found that

30  
31 Entrainment of phytoplankton and zooplankton has not been found to be a  
32 problem at operating nuclear power plants and is not expected to be a problem  
33 during the license renewal term.  
34

35 The staff has not identified any significant new information during its independent review of  
36 the FPL ER (FPL 2001a), the staff's site visit, the scoping process, or its evaluation of other  
37 available information. Therefore, the staff concludes that there are no impacts of  
38 entrainment of phytoplankton and zooplankton during the renewal term beyond those  
39 discussed in the GEIS.  
40

- 1 • Cold shock. Based on information in the GEIS, the Commission found that

2  
3 Cold shock has been satisfactorily mitigated at operating nuclear plants with  
4 once-through cooling systems, has not endangered fish populations or been  
5 found to be a problem at operating nuclear power plants with cooling towers or  
6 cooling ponds, and is not expected to be a problem during the license renewal  
7 term.

8  
9 The staff has not identified any significant new information during its independent review of  
10 the FPL ER (FPL 2001a), the staff's site visit, the scoping process, or its evaluation of other  
11 available information. Therefore, the staff concludes that there are no impacts of cold  
12 shock during the renewal term beyond those discussed in the GEIS.

- 13  
14 • Thermal plume barrier to migrating fish. Based on information in the GEIS, the  
15 Commission found that

16  
17 Thermal plumes have not been found to be a problem at operating nuclear  
18 power plants and are not expected to be a problem during the license renewal  
19 term.

20  
21 The staff has not identified any significant new information during its independent review of  
22 the FPL ER (FPL 2001a), the staff's site visit, the scoping process, or its evaluation of other  
23 available information. Therefore, the staff concludes that there are no impacts of thermal  
24 plume barriers to migrating fish during the renewal term beyond those discussed in the  
25 GEIS.

- 26  
27 • Distribution of aquatic organisms. Based on information in the GEIS, the Commission  
28 found that

29  
30 Thermal discharge may have localized effects but is not expected to effect the  
31 larger geographical distribution of aquatic organisms.

32  
33 The staff has not identified any significant new information during its independent review of  
34 the FPL ER (FPL 2001a), the staff's site visit, the scoping process, or its evaluation of other  
35 available information. Therefore, the staff concludes that there are no impacts on  
36 distribution of aquatic organisms during the renewal term beyond those discussed in the  
37 GEIS.

- 38  
39 • Gas supersaturation (gas bubble disease). Based on information in the GEIS, the  
40 Commission found that

## Environmental Impacts of Operation

1 Gas supersaturation was a concern at a small number of operating nuclear  
2 power plants with once-through cooling systems but has been satisfactorily  
3 mitigated. It has not been found to be a problem at operating nuclear power  
4 plants with cooling towers or cooling ponds and is not expected to be a problem  
5 during the license renewal term.  
6

7 The staff has not identified any significant new information during its independent review of  
8 the FPL ER (FPL 2001a), the staff's site visit, the scoping process, or its evaluation of other  
9 available information. Therefore, the staff concludes that there are no impacts of gas  
10 supersaturation during the renewal term beyond those discussed in the GEIS.  
11

- 12 • Low dissolved oxygen in the discharge. Based on information in the GEIS, the  
13 Commission found that

14  
15 Low dissolved oxygen has been a concern at one nuclear power plant with a  
16 once-through cooling system but has been effectively mitigated. It has not been  
17 found to be a problem at operating nuclear power plants with cooling towers or  
18 cooling ponds and is not expected to be a problem during the license renewal  
19 term.  
20

21 The staff has not identified any significant new information during its independent review of  
22 the FPL ER (FPL 2001a), the staff's site visit, the scoping process, or its evaluation of other  
23 available information. Therefore, the staff concludes that there are no impacts of low  
24 dissolved oxygen during the renewal term beyond those discussed in the GEIS.  
25

- 26 • Losses from predation, parasitism, and disease among organisms exposed to sublethal  
27 stresses. Based on information in the GEIS, the Commission found that

28  
29 These types of losses have not been found to be a problem at operating nuclear  
30 power plants and are not expected to be a problem during the license renewal  
31 term.  
32

33 The staff has not identified any significant new information during its independent review of  
34 the FPL ER (FPL 2001a), the staff's site visit, the scoping process, or its evaluation of other  
35 available information. Therefore, the staff concludes that there are no impacts of losses  
36 from predation, parasitism, and disease among organisms exposed to sub-lethal stresses  
37 during the renewal term beyond those discussed in the GEIS.  
38

- 39 • Stimulation of nuisance organisms. Based on information in the GEIS, the Commission  
40 found that

1 Stimulation of nuisance organisms has been satisfactorily mitigated at the single  
 2 nuclear power plant with a once-through cooling system where previously it was  
 3 a problem. It has not been found to be a problem at operating nuclear power  
 4 plants with cooling towers or cooling ponds and is not expected to be a problem  
 5 during the license renewal term.  
 6

7 The staff has not identified any significant new information during its independent review of  
 8 the FPL ER (FPL 2001a), the staff's site visit, the scoping process, or its evaluation of other  
 9 available information. Therefore, the staff concludes that there are no impacts of  
 10 stimulation of nuisance organisms during the renewal term beyond those discussed in the  
 11 GEIS.  
 12

- 13 • Noise. Based on information in the GEIS, the Commission found that

14  
 15 Noise has not been found to be a problem at operating plants and is not  
 16 expected to be a problem at any plant during the license renewal term.  
 17

18 The staff has not identified any significant new information during its independent review of  
 19 the FPL ER (FPL 2001a), the staff's site visit, the scoping process, or its evaluation of other  
 20 available information. Therefore, the staff concludes that there are no impacts of noise  
 21 during the renewal term beyond those discussed in the GEIS.  
 22

23 The Category 2 issues related to cooling system operation during the renewal term that are  
 24 applicable to St. Lucie Units 1 and 2 are listed in Table 4-2 and are discussed in the following  
 25 sections.  
 26

27 **Table 4-2. Category 2 Issues Applicable to the Operation of the St. Lucie Units 1 and 2**  
 28 **Cooling System During the Renewal Term**  
 29

ISSUE—10 CFR Part 51, Subpart A, Appendix B, Table B-1	GEIS Sections	10 CFR 51.53(c)(3)(ii) Subparagraph	SEIS Section
<b>AQUATIC ECOLOGY (FOR PLANTS WITH ONCE-THROUGH AND COOLING POND HEAT-DISSIPATION SYSTEMS)</b>			
Entrainment of fish and shellfish in early life stages	4.2.2.1.2; 4.3.3	B	4.1.1
Impingement of fish and shellfish	4.2.2.1.3; 4.3.3	B	4.1.2
Heat shock	4.2.2.1.4; 4.3.3	B	4.1.3

1 **4.1.1 Entrainment of Fish and Shellfish in Early Life Stages**

2  
3 The NRC made impacts on fish and shellfish resources resulting from entrainment a Category 2  
4 issue because it could not assign a single significance level (SMALL, MODERATE, or LARGE)  
5 to the issue; the impacts of entrainment are SMALL at many plants, but they may be  
6 MODERATE or LARGE impacts at some plants. Also, ongoing restoration efforts may increase  
7 the number of fish susceptible to intake effects during the license renewal period (NRC 1996).  
8 Information to be ascertained includes (1) the type of cooling system (whether once-through or  
9 cooling pond) and (2) the current Clean Water Act Section 316(b) determination or equivalent  
10 state documentation.

11  
12 As indicated in Section 2.1.3, Cooling and Auxiliary Water Systems, St. Lucie Units 1 and 2  
13 have a once-through heat dissipation system. Entrainment at St. Lucie Units 1 and 2 was  
14 evaluated based on densities of fauna and flora in the ocean during preoperational and early  
15 operational monitoring for Unit 1. The NRC summarized early Unit 1 operational data from  
16 ocean ichthyoplankton surveys. The most common larval fishes in the area of the intakes were  
17 herrings and anchovies of the family Clupeidae (NRC 1982a). Based on 5 years of  
18 ichthyoplankton sampling, an estimate was made of the conditional mortality of fish larvae due  
19 to entrainment. Under normal conditions, it was estimated that 0.4 percent of the fish eggs and  
20 larvae passing the site could be entrained. Using the most conservative assumptions, the loss  
21 was estimated at less than 4 percent. Based on this assessment, the NRC concluded that  
22 entrainment losses would not represent a significant impact to the local fisheries (NRC 1982a).

23  
24 As indicated in the current Industrial Wastewater Facility Permit No. FL0002208 for St. Lucie  
25 Units 1 and 2 (FDEP 2000), both units have documentation of Clean Water Act Section 316(b)  
26 compliance indicating that the existing intake structure reflects the best technology available for  
27 minimizing environmental impacts at the plant.

28  
29 The staff has reviewed the available information, and based on the results of entrainment  
30 studies and the operating history of the St. Lucie Units 1 and 2 intake structure, concludes that  
31 the potential impacts of entrainment of fish and shellfish in the early life stages in the cooling-  
32 water intake system are SMALL. During the course of the Supplemental Environmental Impact  
33 Statement (SEIS) preparation, the staff considered mitigation measures for the continued  
34 operation of St. Lucie Units 1 and 2 along with cumulative impacts of past, current, and future  
35 activities at the site. Continued operation for an additional 20 years was considered as were all  
36 of the specific effects on the environment (whether or not "significant"). Based on the  
37 assessment to date, the staff concludes that the measures in place at St. Lucie Units 1 and 2  
38 (e.g., placement of the intake pipes) mitigate impacts related to entrainment, and no new  
39 mitigation measures are warranted.

#### 4.1.2 Impingement of Fish and Shellfish

The NRC made impacts on fish and shellfish resources resulting from impingement a Category 2 issue because it could not assign a single significance level to the issue; impingement impacts are small at many plants, but might be moderate or large at a few plants. Information to be ascertained includes (1) type of cooling system (whether once-through or cooling pond) and (2) current Clean Water Act 316(b) determination or equivalent state documentation.

St. Lucie Units 1 and 2 have a once-through heat dissipation system. The NRC summarized impingement sampling carried out at St. Lucie Unit 1 during 1976 through 1978, as directed by the Unit 1 operating license (NRC 1982a). During this period, 226 24-hour collections were made of fish and shellfish trapped on the traveling intake screens. Assuming continuous operation, annual impingement rates were estimated at 34,000 (1978) to 131,000 (1976) finfish, and 26,000 (1976) to 37,000 (1978) shellfish. Over the entire study, mean numbers of finfish and shellfish impinged per 24-hour period were 222 and 82 individuals, respectively. Corresponding mean total weights per 24-hour period were 1.7 kg (3.7 lb) and 0.5 kg (1.1 lb) respectively. The most commonly impinged species groups were anchovy (*Anchoa* sp.), grunt (Haemulidae), jack (Carangidae), croaker (*Micropogonias* sp.), mojarro (Gerreidae), shrimp (Panaeidae), and blue crab (*Callinectes sapidus*). The length of over 80 percent of the impinged fish was 8 cm or less, and virtually all of the impinged shrimp were 4 cm or less in length. In January 1979, the NRC issued an amendment to the Unit 1 operating license deleting the requirement for impingement monitoring. It was concluded that impingement losses at Unit 1 were insignificant when compared to the fish populations in the site vicinity and (for shrimp) the number caught commercially off of Florida's east coast (NRC 1982b).

The NRC acknowledged that startup of Unit 2 would double the intake flow volume and increase impingement rates over those measured during Unit 1 operation (NRC 1982b). It was projected that a doubling of the weight of organisms impinged would be equivalent to less than one-half of one percent of the commercial catch of fish and shellfish in either St. Lucie or Martin County. Based on this, the NRC concluded that even the combined estimates of Unit 1 and Unit 2 impingement would be insignificant when compared to local commercial landings. Additional impingement monitoring for Unit 2 was not required.

Applied Biology (1985) reported on intake canal gill-net sampling carried out annually from 1976 to 1984. The purpose of this program was to determine the extent of entrapment and accumulation of fish and shellfish in the intake canal, and whether this could represent an adverse impact to the communities in the site vicinity. It was concluded that fish and shellfish were not accumulating in the intake canal, based on an average catch rate for the study period of 3.5 to 12.5 fish per 30 m (98 ft) of gill net per day. There were peaks in some years due to

## Environmental Impacts of Operation

1 influxes of blue runners (*Caranx crysos*), crevalle jacks (*C. hippos*), and smooth dogfish  
2 (*Mustelus canis*) in 1977, 1978, and 1984, respectively. The highest mean catch rate for the  
3 period occurred in 1980 and resulted from an influx of spot (*Leiostomus xanthurus*) into the  
4 intake canal. In spite of these sporadic influxes of some species into the canal, no  
5 accumulation was documented. It is possible that factors such as predation within the canal  
6 operate to keep the numbers low. Some of the fish entrapped in the intake canal were  
7 commercial species, but losses were negligible relative to the weight of commercial landings.  
8 Of particular note is that of three of the most important commercial species, only five Spanish  
9 mackerel (*Scomberomorus maculatus*), 10 king mackerel (*S. cavalla*), and 37 bluefish  
10 (*Pomatomus saltatrix*) were found in the intake canal over the 9-year study period. The low rate  
11 of entrapment was attributed to the velocity caps at the ocean intakes, which create horizontal  
12 currents that are more easily avoided by fish than vertical currents.

13  
14 Pursuant to a special condition of the St. Lucie Unit 2 site certification issued by the Florida  
15 Department of Environmental Protection (FDEP) in compliance with Florida law (FDEP 1976), a  
16 mitigation program was implemented whereby FPL periodically traps fish from the intake canal,  
17 tags them, and releases them in the ocean. This program is carried out at the behest of the  
18 Florida Fish and Wildlife Conservation Commission (FFWCC). Although the special condition  
19 specified that this mitigation take place during construction of St. Lucie Unit 2, FPL has  
20 continued the program beyond the construction period. Collections are made on a quarterly to  
21 a monthly basis, with a goal of tagging and releasing 1000 fish per year. FPL cooperates with  
22 various institutions to provide specimens for display and research.

23  
24 As indicated in the current Industrial Wastewater Facility Permit No. FL0002208 for St. Lucie  
25 Units 1 and 2 (FDEP 2000), St. Lucie Units 1 and 2 have documentation of Clean Water Act  
26 316(b) compliance indicating that the existing intake structure reflects the best technology  
27 available for minimizing environmental impacts at the plant.

28  
29 The staff has reviewed the available information and, based on the results of impingement  
30 studies and the operating history of the St. Lucie Units 1 and 2 intake structure, concludes that  
31 the potential impacts of impingement of fish and shellfish on the debris screens of the cooling  
32 water intake system are SMALL. While preparing the draft SEIS, the staff considered  
33 mitigation measures for the continued operation of St. Lucie Units 1 and 2 along with  
34 cumulative impacts of past, current, and foreseeable future activities at the site. When  
35 continued operation for an additional 20 years is considered as a whole, all environmental  
36 impacts due to plant operation (whether or not "significant") were considered. Based on the  
37 assessment to date, the staff expects that the measures in place at St. Lucie Units 1 and 2  
38 (e.g., intake screens and the placement of the intake pipes) will provide mitigation for all  
39 impacts related to entrainment and no new mitigation measures are warranted.

40

### 4.1.3 Heat Shock

The NRC made impacts on fish and shellfish resources resulting from heat shock a Category 2 issue because of continuing concerns about thermal discharge effects and the possible need to modify thermal discharges in the future in response to changing environmental conditions. Information to be ascertained includes (1) type of cooling system (whether once-through or cooling pond) and (2) evidence of a Clean Water Act 316(a) variance or equivalent State documentation.

St. Lucie Units 1 and 2 have a once-through heat dissipation system (FPL 2001a). Before startup of both Units 1 and 2, extensive thermal plume modeling studies were conducted, as summarized by the NRC (NRC 1982b) and its predecessor agency, the U.S. Atomic Energy Commission (USAEC 1973). These studies described rapidly rising, buoyant thermal plumes from the diffuser discharges with resulting surface temperatures less than the 36°C (97°F) surface water limitation in the Water Quality Standards (FDEP 1996). Potential interaction of the thermal plume with benthic, planktonic, and nektonic (fish and sea turtles) communities was evaluated and projected to be minimal. No detectable impact was predicted due to scouring of the benthic community, plume entrainment of plankton (including fish eggs and larvae), or heat shock to adult fish or turtle hatchlings. As indicated in Section 3(C)(1) of the Fact Sheet associated with the current Industrial Wastewater Facility Permit No. FL0002208 for St. Lucie Units 1 and 2 (FDEP 2000), the thermal discharge from the plant complies with Florida Water Quality Standards without recourse to a Clean Water Act Section 316(a) variance.

The staff has reviewed the available information, and based on the conditions of the NPDES permit and the operating history of St. Lucie Units 1 and 2 discharge and concludes that the potential impacts of discharging heated water from the cooling water intake system are SMALL. While preparing the draft SEIS, the staff considered mitigation measures for the continued operation of St. Lucie Units 1 and 2 along with cumulative impacts of past, current, and future activities at the site. When continued operation for an additional 20 years is considered as a whole, all environmental impacts due to plant operation (whether or not "significant") were considered. Based on the assessment to date, the staff expects that the measures in place at St. Lucie Units 1 and 2 (e.g., the placement of the discharge pipes) will provide mitigation for all impacts related to heat shock and no new mitigation measures are warranted.

## 4.2 Transmission Lines

The Final Environmental Statements for St. Lucie Units 1 and 2 (AEC 1973, 1974) describe three transmission lines that connect the plant with the transmission system. These transmission lines are all in a single right-of-way that covers approximately 310 ha (766 ac) over a total right-of-way length of approximately 18 km (11 mi). Tree trimming is normally required

## Environmental Impacts of Operation

1 only at mid-span or when exotic species such as Australian pine (*Casuarina equisetifolia*)  
2 invade the tower pads or right-of-way. Herbicides are used occasionally, primarily applied to  
3 individual trees or shrubs to prevent re-sprouting, although broadcast applications are used to  
4 control exotic grasses. FPL only uses nonrestricted-use herbicides, and all applications are  
5 performed under the supervision of licensed applicators. Mowing follows a 5-year cycle. FPL  
6 uses a computer database to prepare management prescriptions for each section of  
7 transmission line right-of-way that incorporates known management concerns and  
8 environmental sensitivities.

9  
10 Category 1 issues in 10 CFR Part 51, Subpart A, Appendix B, Table B-1, that are applicable to  
11 transmission lines from St. Lucie Units 1 and 2 are listed in Table 4-3. FPL stated in its ER  
12 (FPL 2001a) that it is not aware of any new and significant information associated with the  
13 renewal of the operating licenses (OLs) for St. Lucie Units 1 and 2. The staff has not identified  
14 any significant new information during its independent review of the ER (FPL 2001a), the staff's  
15 site visit, the scoping process, or its evaluation of other available information. Therefore, the  
16 staff concludes that there are no impacts related to these issues beyond those discussed in the  
17 GEIS. For all of those Category 1 issues, the staff concluded in the GEIS that the impacts are  
18 SMALL, and additional plant-specific mitigation measures are not likely to be sufficiently  
19 beneficial to be warranted.

20  
21 **Table 4-3. Category 1 Issues Applicable to the St. Lucie Transmission Lines During the**  
22 **Renewal Term**

23  
24

ISSUE—10 CFR Part 51, Subpart A, Appendix B, Table B-1	GEIS Section
<b>TERRESTRIAL RESOURCES</b>	
Power line right-of-way management (cutting and herbicide application)	4.5.6.1
Bird collisions with power lines	4.5.6.2
Impacts of electromagnetic fields on flora and fauna (plants, agricultural crops, honeybees, wildlife, livestock)	4.5.6.3
Flood plains and wetland on power line right-of-way	4.5.7
<b>AIR QUALITY</b>	
Air-quality effects of transmission lines	4.5.2
<b>LAND USE</b>	
Onsite land use	4.5.3
Power line right-of-way	4.5.3

25  
26  
27  
28  
29  
30  
31  
32  
33  
34  
35  
36

37 A brief description of the staff's review and GEIS conclusions, as codified in 10 CFR Part 51,  
38 Subpart A, Appendix B, Table B-1, for each of these issues follows:  
39

- 1 • Power line right-of-way management (cutting and herbicide application). Based on  
2 information in the GEIS, the Commission found that

3  
4 The impacts of right-of-way maintenance on wildlife are expected to be of small  
5 significance at all sites.  
6

7 The staff has not identified any significant new information during its independent review of  
8 the FPL ER (FPL 2001a), the staff's site visit, the scoping process, consultation with the  
9 U.S. Fish and Wildlife Service (FWS) and the FFWCC, or its evaluation of other information.  
10 Therefore, the staff concludes that there are no impacts of power line right-of-way  
11 maintenance during the renewal term beyond those discussed in the GEIS.  
12

- 13 • Bird collisions with power lines. Based on information in the GEIS, the Commission  
14 found that

15  
16 Impacts are expected to be of small significance at all sites.  
17

18 The staff has not identified any significant new information during its independent review of  
19 the ER (FPL 2001a), the staff's site visit, the scoping process, consultation with the FWS  
20 and FFWCC, or its evaluation of other information. Therefore, the staff concludes that there  
21 are no impacts of bird collisions with power lines during the renewal term beyond those  
22 discussed in the GEIS.  
23

- 24 • Impacts of electromagnetic fields on flora and fauna (plants, agricultural crops,  
25 honeybees, wildlife, livestock). Based on information in the GEIS, the Commission  
26 found that

27  
28 No significant impacts of electromagnetic fields on terrestrial flora and fauna  
29 have been identified. Such effects are not expected to be a problem during the  
30 license renewal term.  
31

32 The staff has not identified any significant new information during its independent review of  
33 the ER (FPL 2001a), the staff's site visit, the scoping process, or its evaluation of other  
34 information. Therefore, the staff concludes that there are no impacts of electromagnetic  
35 fields on flora and fauna during the renewal term beyond those discussed in the GEIS.  
36

- 37 • Flood plains and wetlands on power line right-of-way. Based on information in the  
38 GEIS, the Commission found that  
39

## Environmental Impacts of Operation

1           Periodic vegetation control is necessary in forested wetlands underneath power  
2           lines and can be achieved with minimal damage to the wetland. No significant  
3           impact is expected at any nuclear power plant during the license renewal term.  
4

5           The staff has not identified any significant new information during its independent review of  
6           the ER (FPL 2001a), the staff's site visit, the scoping process, consultation with the FWS  
7           and FFWCC, or its evaluation of other information. Therefore, the staff concludes that there  
8           are no impacts of power line rights-of-way on flood plains and wetlands during the renewal  
9           term beyond those discussed in the GEIS.

- 10
- 11   • Air-quality effects of transmission lines. Based on the information in the GEIS, the  
12   Commission found that

13

14           Production of ozone and oxides of nitrogen is insignificant and does not  
15           contribute measurably to ambient levels of these gases.  
16

17           The staff has not identified any significant new information during its independent review of  
18           the ER (FPL 2001a), the staff's site visit, the scoping process, or its evaluation of other  
19           information. Therefore, the staff concludes that there are no air quality impacts of  
20           transmission lines during the renewal term beyond those discussed in the GEIS.  
21

- 22   • Onsite land use. Based on the information in the GEIS, the Commission found that

23

24           Projected onsite land use changes required during ... the renewal period would  
25           be a small fraction of any nuclear power plant site and would involve land that is  
26           controlled by the applicant.  
27

28           The staff has not identified any significant new information during its independent review of  
29           the ER (FPL 2001a), the staff's site visit, the scoping process, or its evaluation of other  
30           information. Therefore, the staff concludes that there are no onsite land-use impacts  
31           during the renewal term beyond those discussed in the GEIS.  
32

- 33   • Power line right-of-way (land use). Based on information in the GEIS, the Commission  
34   found that

35

36           Ongoing use of power line right of ways would continue with no change in  
37           restrictions. The effects of these restrictions are of small significance.  
38

39           The staff has not identified any significant new information during its independent review of  
40           the ER (FPL 2001a), the staff's site visit, the scoping process, or its evaluation of other

1 information. Therefore, the staff concludes that there are no impacts of power line rights-of-  
2 way during the renewal term beyond those discussed in the GEIS.

3  
4 There is one Category 2 issue related to transmission lines, and another issue related to  
5 transmission lines is being treated as a Category 2 issue. These issues are listed in Table 4-4  
6 and are discussed in Sections 4.2.1 and 4.2.2.

7  
8 **Table 4-4. Chronic Effects of Electromagnetic Fields and GEIS Category 2 Issue Applicable**  
9 **to the St. Lucie Transmission Lines During the Renewal Term**

ISSUE—10 CFR Part 51, Subpart A, Appendix B, Table B-1	GEIS Section	10 CFR 51.53(c)(3)(ii) Subparagraph	SEIS Section
<b>HUMAN HEALTH</b>			
Electromagnetic fields, acute effects (electric shock)	4.5.4.1	H	4.2.1
Electromagnetic fields, chronic effects	4.5.4.2	NA	4.2.2

17  
18 **4.2.1 Electromagnetic Fields – Acute Effects**

19  
20 Based on information in the GEIS, the Commission found that without a review of the  
21 conformance of each nuclear plant transmission line with National Electrical Safety Code  
22 (NESC 1997) criteria, it is not possible to determine the significance of the electric shock  
23 potential. Evaluation of individual plant transmission lines is necessary because the issue of  
24 electric shock safety was not addressed in the licensing process for some plants. For other  
25 plants, land use in the vicinity of transmission lines may have changed, or power distribution  
26 companies may have chosen to upgrade line voltage. To comply with 10 CFR  
27 51.53(c)(3)(ii)(H), an applicant for licence renewal must provide an assessment of the potential  
28 shock hazard if the transmission lines that were constructed for the specific purpose of  
29 connecting the plant to the transmission system do not meet the recommendations of the  
30 NESC for preventing electric shock from induced currents.

31  
32 Three 230-kV transmission lines were constructed to connect St. Lucie Units 1 and 2 to the  
33 transmission system. The transmission lines run approximately 18 km (11 mi) from the plant  
34 switchyard to the Midway substation in a single corridor. After the lines leave the St. Lucie  
35 substation they run west across the Indian River (Intracoastal Waterway) and then turn  
36 northward for the final 2.4 km (1.5 mi). Over the Intracoastal Waterway, the minimum  
37 transmission line clearance is 27 m (90 ft), and over the remainder of the river the clearance is  
38 18 m (60 ft). Over land, the minimum transmission line clearance is 6.7 m (22 ft). The  
39 St. Lucie 230-kV lines are the only lines in the corridor for most of the route. However, several

## Environmental Impacts of Operation

1 other 230-kV lines and a 500-kV line not associated with St. Lucie share the corridor for  
2 approximately 6 km (4 mi) near the Midway substation.

3  
4 The St. Lucie transmission lines were constructed before the NESC was adopted; therefore,  
5 FPL evaluated the potential electric shock impacts from the transmission lines using guidance  
6 developed by the Electric Power Research Institute (EPRI 1987), and the EPRI ENVIRO  
7 computer code (EPRI 1994). In the evaluation, a 20-m-(65-ft)-long tractor-trailer was assumed  
8 to be parked beneath the 230-kV lines. The maximum steady-state current was estimated to  
9 be 2.3 mA. The analysis was repeated for the section of the corridor where the St. Lucie  
10 transmission lines share the corridor with a 500-kV line. For this section of corridor, the  
11 maximum steady-state current was estimated to be 4.5 mA. In both cases, the maximum  
12 steady-state current is below the NESC limit of 5 mA.

13  
14 The calculations described above are specifically for a tractor-trailer parked beneath the  
15 transmission line. The FPL staff also considered the potential electric shock impacts for various  
16 classes of boats passing beneath the transmission lines crossing the Indian River. The FPL  
17 staff concluded that the potential impacts for boats were less than those for trucks.

18  
19 On the basis of the results of these calculations, the staff concludes that the impact of the  
20 potential for electric shock is SMALL and additional mitigation is not warranted.

### 21 **4.2.2 Electromagnetic Fields – Chronic Effects**

22  
23  
24 In the GEIS, the chronic effects of 60-Hz electromagnetic fields from power lines were not  
25 designated as Category 1 or 2. They will not be categorized until a scientific consensus is  
26 reached on the health implications of these fields.

27  
28 The potential for chronic effects from these fields continues to be studied and is not known at  
29 this time. The National Institute of Environmental Health Sciences (NIEHS) directs related  
30 research through the U.S. Department of Energy. A recent report (NIEHS 1999) contains the  
31 following conclusion:

32  
33 The NIEHS concludes that ELF-EMF [extremely low frequency-electromagnetic field]  
34 exposure cannot be recognized as entirely safe because of weak scientific evidence that  
35 exposure may pose a leukemia hazard. In our opinion, this finding is insufficient to warrant  
36 aggressive regulatory concern. However, because virtually everyone in the United States  
37 uses electricity and therefore is routinely exposed to ELF-EMF, passive regulatory action is  
38 warranted such as a continued emphasis on educating both the public and the regulated  
39 community on means aimed at reducing exposures. The NIEHS does not believe that other

1 cancers or non-cancer health outcomes provide sufficient evidence of a risk to currently  
 2 warrant concern.

3  
 4 This statement is not sufficient to cause the staff to change its position with respect to the  
 5 chronic effects of electromagnetic fields. The staff considers the GEIS finding of “not  
 6 applicable” still appropriate and will continue to follow developments on this issue.  
 7

8 **4.3 Radiological Impacts of Normal Operations**

9  
 10 Category 1 issues in 10 CFR Part 51, Subpart A, Appendix B, Table B-1, that are applicable to  
 11 St. Lucie Units 1 and 2 in regard to radiological impacts are listed in Table 4-5. FPL stated in  
 12 its ER (FPL 2001a) that it is not aware of any new and significant information associated with  
 13 the renewal of the St. Lucie OLS. No significant new information has been identified by the staff  
 14 during its independent review. Therefore, the staff concludes that there are no impacts related  
 15 to these issues beyond those discussed in the GEIS. For these issues, the GEIS concluded  
 16 that the impacts are SMALL, and plant-specific mitigation measures are not likely to be  
 17 sufficiently beneficial to be warranted.  
 18

19 **Table 4-5. Category 1 Issues Applicable to Radiological Impacts of Normal Operations**  
 20 **During the Renewal Term**  
 21

ISSUE—10 CFR Part 51, Subpart A, Appendix B, Table B-1	GEIS Section
<b>HUMAN HEALTH</b>	
Radiation exposures to public (license renewal term)	4.6.2
Occupational radiation exposures (license renewal term)	4.6.3

22  
 23  
 24  
 25  
 26  
 27 A brief description of the staff’s review and the GEIS conclusions, as codified in Table B-1, for  
 28 each of these issues follows:  
 29

- 30 • Radiation exposures to public (license renewal term). Based on information in the  
 31 GEIS, the Commission found that

32  
 33 Radiation doses to the public will continue at current levels associated with  
 34 normal operations.  
 35

36 The staff has not identified any significant new information during its independent review of  
 37 the ER (FPL 2001a), the staff’s site visit, the scoping process, or its evaluation of other  
 38 available information. Therefore, the staff concludes that there are no impacts of radiation  
 39 exposures to the public during the renewal term beyond those discussed in the GEIS.

## Environmental Impacts of Operation

- Occupational radiation exposures (license renewal term). Based on information in the GEIS, the Commission found that

Projected maximum occupational doses during the license renewal term are within the range of doses experienced during normal operations and normal maintenance outages, and would be well below regulatory limits.

The staff has not identified any significant new information during its independent review of the ER (FPL 2001a), the staff's site visit, the scoping process, or its evaluation of other available information. Therefore, the staff concludes that there are no impacts of occupational radiation exposures during the renewal term beyond those discussed in the GEIS.

There are no Category 2 issues related to radiological impacts of routine operations.

### 4.4 Socioeconomic Impacts of Plant Operations During the License Renewal Period

Category 1 issues in 10 CFR Part 51, Subpart A, Appendix B, Table B-1, that are applicable to socioeconomic impacts during the renewal term are listed in Table 4-6. FPL stated in its ER (FPL 2001a) that it is not aware of any new and significant information associated with the renewal of St. Lucie Units 1 and 2 OLS. The staff has not identified any significant new information during its independent review of the ER (FPL 2001a), the staff's site visit, the scoping process, or its evaluation of other information. Therefore, the staff concludes that there are no impacts related to these issues beyond those discussed in the GEIS (NRC 1996). For these issues, the staff concluded in the GEIS that the impacts are SMALL, and additional plant-specific mitigation measures are not likely to be sufficiently beneficial to be warranted.

**Table 4-6. Category 1 Issues Applicable to Socioeconomics During the Renewal Term**

ISSUE—10 CFR Part 51, Subpart A, Appendix B, Table B-1	GEIS Section
<b>SOCIOECONOMIC</b>	
Public services: public safety, social services, and tourism and recreation	4.7.3; 4.7.3.3; 4.7.3.4; 4.7.3.6
Public services: education (license renewal term)	4.7.3.1
Aesthetic impacts (license renewal term)	4.7.6
Aesthetic impacts of transmission lines (license renewal term)	4.5.8

1 A brief description of the staff's review and the GEIS conclusions, as codified in Table B-1, for  
2 each of these issues follows:

- 3  
4 • Public services – public safety, social services, and tourism and recreation. Based on  
5 information in the GEIS, the Commission found that

6  
7 Impacts to public safety, social services, and tourism and recreation are  
8 expected to be of small significance at all sites.  
9

10 The staff has not identified any significant new information during its independent review of  
11 the ER (FPL 2001a), the staff's site visit, the scoping process, or its evaluation of other  
12 available information. Therefore, the staff concludes that there are no impacts on public  
13 safety, social services, and tourism and recreation during the renewal term beyond those  
14 discussed in the GEIS.  
15

- 16 • Public services – education (license renewal term). Based on information in the GEIS,  
17 the Commission found that

18 Only impacts of small significance are expected.

19 The staff has not identified any significant new information during its independent review of  
20 the ER (FPL 2001a), the staff's site visit, the scoping process, or its evaluation of other  
21 available information. Therefore, the staff concludes that there are no impacts on education  
22 during the renewal term beyond those discussed in the GEIS.  
23  
24

- 25  
26 • Aesthetic impacts (license renewal term). Based on information in the GEIS, the  
27 Commission found that

28 No significant impacts are expected during the license renewal term.

29 The staff has not identified any significant new information during its independent review of  
30 the ER (FPL 2001a), the staff's site visit, the scoping process, or its evaluation of other  
31 available information. Therefore, the staff concludes that there are no aesthetic impacts  
32 during the renewal term beyond those discussed in the GEIS.  
33  
34

- 35  
36 • Aesthetic impacts of transmission lines (license renewal term). Based on information in  
37 the GEIS, the Commission found that

38 No significant impacts are expected during the license renewal term.  
39  
40

## Environmental Impacts of Operation

The staff has not identified any significant new information during its independent review of the FPL ER (FPL 2001a), the staff's site visit, the scoping process, or its evaluation of other available information. Therefore, the staff concludes that there are no aesthetic impacts of transmission lines during the renewal term beyond those discussed in the GEIS.

Table 4-7 lists the Category 2 socioeconomic issues, which require plant-specific analysis and environmental justice, which was not addressed in the GEIS. These issues are discussed in Sections 4.4.1 through 4.4.6.

**Table 4-7. Environmental Justice and GEIS Category 2 Issues Applicable to Socioeconomics During the Renewal Term**

ISSUE—10 CFR Part 51, Subpart A, Appendix B, Table B-1	GEIS Section	10 CFR 51.53(c)(3)(ii) Subparagraph	SEIS Section
<b>SOCIOECONOMIC</b>			
Housing impacts	4.7.1	I	4.4.1
Public services: public utilities	4.7.3.5	I	4.4.2
Offsite land use (license renewal term)	4.7.4	I	4.4.3
Public services, transportation	4.7.3.2	J	4.4.4
Historic and archaeological resources	4.7.7	K	4.4.5
Environmental justice	Not addressed <sup>(a)</sup>	Not addressed <sup>(a)</sup>	4.4.6

(a) Guidance related to environmental justice was not in place at the time the GEIS and the associated revision to 10 CFR Part 51 were prepared. Therefore, environmental justice must be addressed in the licensee's ER and the staff's environmental impact statement.

### 4.4.1 Housing Impacts During Operations

Impacts on housing are considered SMALL when a small or not easily discernible change in housing availability occurs. Impacts are considered MODERATE when there is discernible but short-lived reduction in available housing units because of project-induced migration. Impacts are considered LARGE when project-related housing demands result in very limited housing availability and would increase rental rates and housing values well above normal inflation (NRC 1996).

In determining housing impacts, the applicant chose to follow Appendix C of the GEIS (NRC 1996), which presents a population characterization method that is based on two factors, "sparseness" and "proximity." Sparseness measures population density within 32 km (20 mi) of the site, and proximity measures population density and city size within 80 km (50 mi). Each factor has categories of density and size (GEIS Table C.1), and a matrix is used to rank the population category as low, medium, or high (GEIS Figure C.1).

1 In 2000, the population living within 32 km (20 mi) of St. Lucie Units 1 and 2 is estimated to be  
2 approximately 345,000 (FPL 2001a). This total converts to a population density of about  
3 212 persons/km<sup>2</sup> (550 persons/mi<sup>2</sup>) living on the land area within a 32-km (20-mi) radius of  
4 St. Lucie.<sup>(a)</sup> This concentration falls into the GEIS sparseness Category 4 (i.e., having greater  
5 than or equal to 46 persons/km<sup>2</sup> [120 persons/mi<sup>2</sup> ]  
6

7 An estimated 1,180,000 people live within 80 km (50 mi) of the St. Lucie site (FPL 2000a),  
8 equating to a population density of around 116 persons/km<sup>2</sup> (300 persons/mi<sup>2</sup>) on the available  
9 land area.<sup>(b)</sup> Applying the GEIS proximity measures (NRC 1996), St. Lucie Units 1 and 2 are  
10 classified as Category 4 (i.e., having greater than or equal to 73 persons/km<sup>2</sup> [190 persons/mi<sup>2</sup>]  
11 within 80 km [50 mi] of the site). According to the GEIS, these sparseness and proximity  
12 scores identify the nuclear units as being located in a high-population area.  
13

14 10 CFR Part 51, Subpart A, Appendix B, Table B-1, states that impacts on housing availability  
15 are expected to be of SMALL significance at plants located in a high-population area where  
16 growth-control measures are not in effect. The St. Lucie site is located in a high-population  
17 area. Martin and St. Lucie counties are not subject to growth-control measures that would limit  
18 housing development.  
19

20 SMALL impacts result when no discernible change in housing availability occurs, changes in  
21 rental rates and housing values are similar to those occurring statewide, and no housing  
22 construction or conversion is required to meet new demand (NRC 1996). The GEIS assumes  
23 that an additional staff of 60 permanent per-unit workers might be needed during the license  
24 renewal period to perform routine maintenance and other activities. FPL has performed some  
25 major construction activities at St. Lucie (e.g., Unit 1 steam generator replacement and velocity  
26 cap repair [FPL 2001a]). Other major refurbishment or replacement actions during the license  
27 renewal period have not been identified by FPL, and as a result, employment will not change as  
28 a result of such activities. Thus, FPL concludes that there are no impacts to housing from  
29 license renewal activities (FPL 2001a). However, to establish an upper bound on possible  
30 increased employment during the license renewal term, FPL assumes the hiring of 60 additional  
31 permanent workers. The hiring of 60 additional employees would result in 78 indirect jobs, or  
32 an increased demand for a total of 138 housing units. Using the fact that 83 percent of its  
33 employees live in Martin and St. Lucie counties (see Table 2-5), FPL concludes that a demand  
34 for 115 housing units would be created in the two counties. The demand for the housing units

- 
- (a) These numbers differ from those presented in the ER (FPL 2001a). In their calculations, FPL took the surface area in the 32-km (20-mi) and 80-km (50-mi) radii and distributed the population evenly within the circles. However, the circles encompass a large area of the Atlantic Ocean. It was assumed that the ocean encompasses half the area for the 32-km (20-mi) and 80-km (50-mi) circles. As such, the population concentrations were adjusted, resulting in higher population concentrations than those reported in the ER.
- (b) Note that these conclusions differ from FPL's ER for the reasons stated in footnote (a).

## Environmental Impacts of Operation

1 could be met with the construction of new housing or use of existing, unoccupied housing. In  
2 2000, St. Lucie and Martin counties had a total of 156,733 housing units (see Table 2-6) and  
3 vacancy rates in both counties were more than 15 percent. The increase in projected housing  
4 units would not create a discernible change in housing availability, change in rental rates or  
5 housing values, or spur new construction or conversion. As a result, FPL concludes that the  
6 impacts would be SMALL, and mitigation measures would not be necessary or effective  
7 (FPL 2001a).<sup>(a)</sup>

8  
9 The staff reviewed the available information relative to housing impacts and FPL's conclusions.  
10 Based on this review, the staff concludes that the impact on housing during the license renewal  
11 period would be SMALL, and additional mitigation is not warranted.

### 12 13 **4.4.2 Public Services: Public Utility Impacts During Operations**

14  
15 Impacts on public utility services are considered SMALL if there is little or no change in the  
16 ability of the system to respond to the level of demand, and thus there is no need to add capital  
17 facilities. Impacts are considered MODERATE if overtaking of service capabilities occurs  
18 during periods of peak demand. Impacts are considered LARGE if existing levels of service  
19 (e.g., water or sewer services) are substantially degraded and additional capacity is needed to  
20 meet ongoing demands for services. The GEIS indicates that, in the absence of new and  
21 significant information to the contrary, the only impacts on public utilities that could be  
22 significant are impacts on public water supplies (NRC 1996).

23  
24 Analysis of impacts on the public water supply system considered both plant demand and plant-  
25 related population growth. Section 2.2.2 describes the St. Lucie Units 1 and 2 permitted  
26 withdrawal rate and actual use of water. FPL plans no refurbishment at St. Lucie Units 1 and 2,  
27 so plant demand would not change beyond current demands (FPL 2001a).

28  
29 The staff assumed an increase of 60 license renewal employees, the generation of 138 new  
30 jobs, and a net overall population increase of approximately 339 as a result of those jobs.<sup>(b)</sup>  
31 The plant-related population increase would require an additional 64 to 100 m<sup>3</sup>/d (1.7 x 10<sup>-2</sup> to  
32 2.7 x 10<sup>-2</sup> MGD) of water (FPL 2001a). This amount is within the total residual capacity of all  
33 water treatment plants greater than 3.8 X 10<sup>3</sup> m<sup>3</sup>/d (1 MGD) serving Martin and St. Lucie  
34 counties (see Table 2-8) Thus, the staff concludes that the impact of increased water use  
35 resulting from the potential increase in employment is SMALL, and mitigation is not warranted.

---

(a) The FPL estimate of 138 housing units (115 units for Martin and St. Lucie counties) is likely to be an extreme "upper bound" estimate. Most of the potentially new jobs would likely be filled by existing area residents, thus creating no, or little, net demand for housing.

(b) Calculated by assuming that the average number of persons per household is 2.46 in the State of Florida (138 jobs X 2.46 = 339) (USCB 2000).

1 The staff reviewed the available information relative to impacts on public utility services. Based  
2 on this review, the staff concludes that the impacts on public utility services during the license  
3 renewal period would be SMALL, and additional mitigation is not warranted.  
4

#### 5 **4.4.3 Offsite Land Use During Operations**

6

7 Offsite land use during the license renewal term is a Category 2 issue (10 CFR 51, Subpart A,  
8 Appendix B, Table B-1). Table B-1 of 10 CFR 51 Subpart A, Appendix B, notes that "significant  
9 changes in land use may be associated with population and tax revenue changes resulting from  
10 license renewal."  
11

12 Section 4.7.4 of the GEIS defines the magnitude of land-use changes as a result of plant  
13 operation during the license renewal term as follows:  
14

15 **SMALL** – Little new development and minimal changes to an area's land-use pattern.  
16

17 **MODERATE** – Considerable new development and some changes to the land-use pattern.  
18

19 **LARGE** – Large-scale new development and major changes in the land-use pattern.  
20

21 FPL has identified a maximum of 60 additional employees during the license renewal term plus  
22 an additional 78 indirect jobs (total 138) in the community (FPL 2001a). Section 3.7.5 of the  
23 GEIS (NRC 1996) states that if plant-related population growth is less than 5 percent of the  
24 study area's total population, offsite land-use changes would be small, especially if the study  
25 area has established patterns of residential and commercial development, a population density  
26 of at least 23 persons/km<sup>2</sup> (60 persons/mi<sup>2</sup>), and at least one urban area with a population of  
27 100,000 or more within 80 km (50 mi). In this case, population growth will be less than  
28 5 percent of the area's total population, the area has established patterns of residential and  
29 commercial development (see Table 2-9), a population density of well over 23 persons/km<sup>2</sup>  
30 (60 persons/mi<sup>2</sup>), but no urban area with a population of 100,000 or more within 80 km (50 mi).  
31 However, the combined populations of the cities of Port St. Lucie and Ft. Pierce, which share a  
32 common boundary, exceed 100,000 (see discussion under Section 2.2.8.5, Demography).  
33 Consequently, the staff concludes that population changes resulting from license renewal are  
34 likely to result in SMALL offsite land-use impacts.  
35

36 Tax revenue can affect land use because it enables local jurisdictions to be able to provide the  
37 public services (e.g., transportation and utilities) necessary to support development.

38 Section 4.7.4.1 of the GEIS states that the assessment of tax-driven land-use impacts during  
39 the license renewal term should consider (1) the size of the plant's tax payments relative to the  
40 community's total revenues, (2) the nature of the community's existing land-use pattern, and

## Environmental Impacts of Operation

1 (3) the extent to which the community already has public services in place to support and guide  
2 development. If the plant's tax payments are projected to be small relative to the community's  
3 total revenue, tax-driven land-use changes during the plant's license renewal term would be  
4 small, especially where the community has pre-established patterns of development and has  
5 provided adequate public services to support and guide development. Section 4.7.2.1 of the  
6 GEIS states that if tax payments by the plant owner are less than 10 percent of the taxing  
7 jurisdictions revenue, the significance level would be SMALL (NRC 1996). If the plant's tax  
8 payments are projected to be medium to large relative to the community's total revenue, new  
9 tax-driven land-use changes would be MODERATE.

10  
11 St. Lucie County is the only local jurisdiction that receives personal and real property tax  
12 payments for St. Lucie Units 1 and 2. FPL's tax payments to the county for Units 1 and 2  
13 averaged about 9.6 percent of the county's total property tax revenue over the 5 years between  
14 1996 and 2000 (see Table 2-11). Both St. Lucie and Martin counties are operating under the  
15 State-required Growth Management Policy Plan and an established Urban Service Boundary  
16 (USB) requiring that adequate public services be provided to support new development. It is  
17 the policy of both counties that development is not to take place outside the USB. In  
18 combination, these two factors (lack of growth directly related to the presence of St. Lucie Units  
19 1 and 2 and directed growth to stay within the USB) are expected to result in SMALL land-use  
20 impacts from taxes derived from St. Lucie.

21  
22 No adverse effects on offsite land use will occur because of license renewal. Consequently, the  
23 staff concludes that tax revenue changes resulting from license renewal are likely to result in  
24 SMALL offsite land-use impacts.

### 25 26 **4.4.4 Public Services: Transportation Impacts During Operations**

27  
28 On October 4, 1999, 10 CFR 51.53(c)(3)(ii)(J) and 10 CFR Part 51, Subpart A, Appendix B,  
29 Table B-1, were revised to clearly state that "Public Services: Transportation Impacts During  
30 Operations" is a Category 2 issue (see NRC 1999 for more discussion of this clarification). The  
31 issue is treated as such in this draft SEIS.

32  
33 In 2002, most of the roadways within Martin and St. Lucie counties were operating at  
34 acceptable levels of service (LOS). As discussed in Section 2.2.8.2, both Martin and St. Lucie  
35 counties have as public policy the targeting of growth within the USB. Interstate 95 (I-95), State  
36 Road 70 (SR-70), the Florida Turnpike, and U.S. Highway 1 (US-1) serve as the main  
37 transportation routes for both counties and can be crowded during the busiest times of the day,  
38 particularly U.S.-1 in Ft. Pierce, Port St. Lucie, and Stuart. State Road A1A, providing access  
39 to the St. Lucie site on Hutchinson Island, carries a LOS designation of "A" in the vicinity of the  
40 site. North and south of the site, State Road A1A carries an LOS designation of "B" (FPL

1 2001a). Personal observations by staff during the site visit (April 1 to 5) showed State Road  
2 A1A to be relatively uncongested except during shift changes at St. Lucie Units 1 and 2 and at  
3 the southern and northern terminus of the road near Stuart/Port St. Lucie and Ft. Pierce;  
4 respectively.

5  
6 St. Lucie and Martin counties experienced approximately a 28 and 26 percent, respectively,  
7 growth in population over the last decade (see Table 2-7). The growth is not related directly to  
8 the presence of the St. Lucie Units 1 and 2. St. Lucie and Martin counties do not have growth  
9 control measures that limit housing. Both counties are expected to grow about 20 percent in  
10 population over the next decade (Table 2-7). Land-use projections for both counties show that  
11 new residential, commercial, and industrial development is expected to take place east of the I-  
12 95 and Florida Turnpike corridors.

13  
14 However, none of this expected growth is due directly to increases in employment at the St.  
15 Lucie site. St. Lucie Units 1 and 2 currently employ 929 workers (see Table 2-5) (FPL 2001a).  
16 During periods of refueling, once or twice a year, an additional 575 to 870 temporary workers  
17 are hired. The "upper bound" potential increase in permanent staff during the license renewal  
18 term is 60 additional workers, or approximately 6.4 percent of the current permanent work  
19 force. The level of access to the St. Lucie site is over secondary, as opposed to primary, roads.  
20 Based on these facts, FPL concluded that the impacts on transportation during the license  
21 renewal term would be SMALL, and no mitigative measures would be warranted.

22  
23 The staff reviewed FPL's assumptions and resulting conclusions. The staff concludes that any  
24 impact of FPL on transportation service degradation is likely to be SMALL and would not  
25 require mitigation.

#### 26 27 **4.4.5 Historic and Archaeological Resources**

28  
29 The National Historic Preservation Act of 1966 (NHPA), as amended, requires Federal  
30 agencies to take into account the effects of their undertakings on historic properties. The  
31 historic preservation review process mandated by Section 106 of the NHPA is outlined in  
32 regulations issued by the Advisory Council on Historic Preservation at 36 CFR Part 800. Under  
33 the regulations, the NRC is to make a reasonable effort to identify historic properties in the  
34 areas of potential effects. If no historic properties are present or affected, the NRC is required  
35 to notify the State Historic Preservation Officer (SHPO) before proceeding. If it is determined  
36 that historic properties are present, the NRC is required to assess and resolve possible adverse  
37 effects of the undertaking.

38  
39 In April 2001, FPL wrote to the Florida SHPO, requesting their comments on the St. Lucie  
40 Units 1 and 2 license renewal process. In this letter, FPL determined that the continued

## Environmental Impacts of Operation

1 operation of St. Lucie will have no impact on historic properties (FPL 2001c). In a response  
2 dated May 22, 2001, the Florida SHPO stated that the license renewal was not an undertaking  
3 that would affect historic properties (SHPO 2001).  
4

5 However, the Florida SHPO cautioned that there was a moderate to high likelihood for the  
6 presence of significant prehistoric archaeological sites in the currently undeveloped portions of  
7 the St. Lucie site, as evidenced by the presence of the archaeological remains along Blind  
8 Creek at the northern end of the site boundaries. Major refurbishment of the St. Lucie plant is  
9 not required during the license renewal period, so there will be no need to use currently  
10 undeveloped portions of the site for operations during the renewal period. Operation of St.  
11 Lucie Units 1 and 2, as planned under the application for license renewal, would protect  
12 undiscovered historic or archaeological resources on the site because the undeveloped natural  
13 landscape and vegetation would remain undisturbed, and access to the site would remain  
14 restricted.  
15

16 However, care should be taken during normal operational and maintenance conditions to  
17 ensure that historic properties are not inadvertently impacted. These activities may include not  
18 only operation of the plant itself, but also land management-related actions such as recreation,  
19 wildlife habitat enhancement, or maintaining/upgrading plant access roads through the plant  
20 site and on transmission line rights-of-way.  
21

22 Based on the staff's cultural resources analysis and consultation, on the claims made by the  
23 licensee that major refurbishment activities will not be undertaken related to the renewal of the  
24 St. Lucie Units 1 and 2 OLs, and on the fact that operation will continue within the bounds of  
25 plant operations as evaluated in the FES (AEC 1973, 1974), the staff concludes that the  
26 potential impacts on historic and archaeological resources are SMALL, and no additional  
27 mitigation is warranted.  
28

### 29 **4.4.6 Environmental Justice**

30

31 Environmental justice refers to a Federal policy that requires Federal agencies to identify and  
32 address, as appropriate, disproportionately high and adverse human health or environmental  
33 effects of its actions on minority<sup>(a)</sup> or low-income populations. The memorandum accompanying  
34 Executive Order 12898 (59 FR 7629) directs Federal executive agencies to consider  
35 environmental justice under the National Environmental Policy Act of 1969 (NEPA). The  
36 Council on Environmental Quality (CEQ) has provided guidance for addressing environmental  
37 justice (CEQ 1997). Although the Executive Order is not mandatory for independent agencies,

---

(a) The NRC Guidance for performing environmental justice reviews defines "minority" as American Indian or Alaskan Native, Asian or Pacific Islander, Black not of Hispanic Origin, or Hispanic (NRC 2001).

1 the NRC has voluntarily committed to undertake environmental justice reviews. Specific  
 2 guidance is provided in NRC Office of Nuclear Reactor Regulation Office Instruction LIC-203,  
 3 Procedural Guidance for Preparing Environmental Assessments and Considering  
 4 Environmental Issues (NRC 2001).

5  
 6 The staff examined the geographic distribution of minority and low-income populations within  
 7 80 km (50 mi) of the St. Lucie site, employing the 1990 census (USCB 1991) for low-income  
 8 populations<sup>(a)</sup> and the 2000 census (USCB 2000) for minority populations. The populations  
 9 within an 80-km (50-mi) radius of St. Lucie encompassed parts of 9 counties. The staff  
 10 supplemented its analysis by field inquires to county planning departments, social service  
 11 agencies, agricultural extension personnel in St. Lucie and Martin counties, and a private social  
 12 service agency in St. Lucie County.

13  
 14 For the purpose of the staff's review, a minority population is defined to exist if the percentage  
 15 of each minority, or aggregated minority category within the census block groups<sup>(b)</sup> potentially  
 16 affected by the license renewal of St. Lucie Units 1 and 2, exceeds the corresponding  
 17 percentage of minorities in the entire State of Florida by 20 percent, or if the corresponding  
 18 percentage of minorities within the census block group is at least 50 percent. A low-income  
 19 population is defined to exist if the percentage of low-income population within a census block  
 20 group exceeds the corresponding percentage of low-income population in the entire State of  
 21 Florida by 20 percent, or if the corresponding percentage of low-income population within a  
 22 census block group is at least 50 percent.


23  
 24 FPL used 1990 census data for identifying minority and low-income populations within 80 km  
 25 (50 mi) of the St. Lucie site. FPL also followed the convention of employing census tracts, as  
 26 opposed to census block groups, and included tracts if 50 percent or greater of their area lay  
 27 within the 80-km (50-mi) radius of St. Lucie (FPL 2001a). Using this convention, the 80-km  
 28 (50-mi) radius includes 194 census tracts for minority populations and 7 census tracts for low-  
 29 income populations. The "more than 20 percentage points" above the comparison area  
 30 criterion was used to determine whether a census tract should be counted as containing  
 31 minority or low-income populations (FPL 2001a). Because the 20 percentage points criterion is  
 32 a lower threshold, the 50 percent criterion was not used.

---

(a) Note that the Census Bureau plans release of income statistics from the 2000 Census during the Summer of 2002. Until then, only 1990 Census data on income are available.

(b) A census block group is a combination of census blocks, which are statistical subdivisions of a census tract. A census block is the smallest geographic entity for which the Census Bureau collects and tabulates decennial census information. A census tract is a small, relatively permanent statistical subdivision of counties delineated by local committees of census data users in accordance with Census Bureau guidelines for the purpose of collecting and presenting decennial census data. Census block groups are subsets of census tracts (USCB 2001).

1

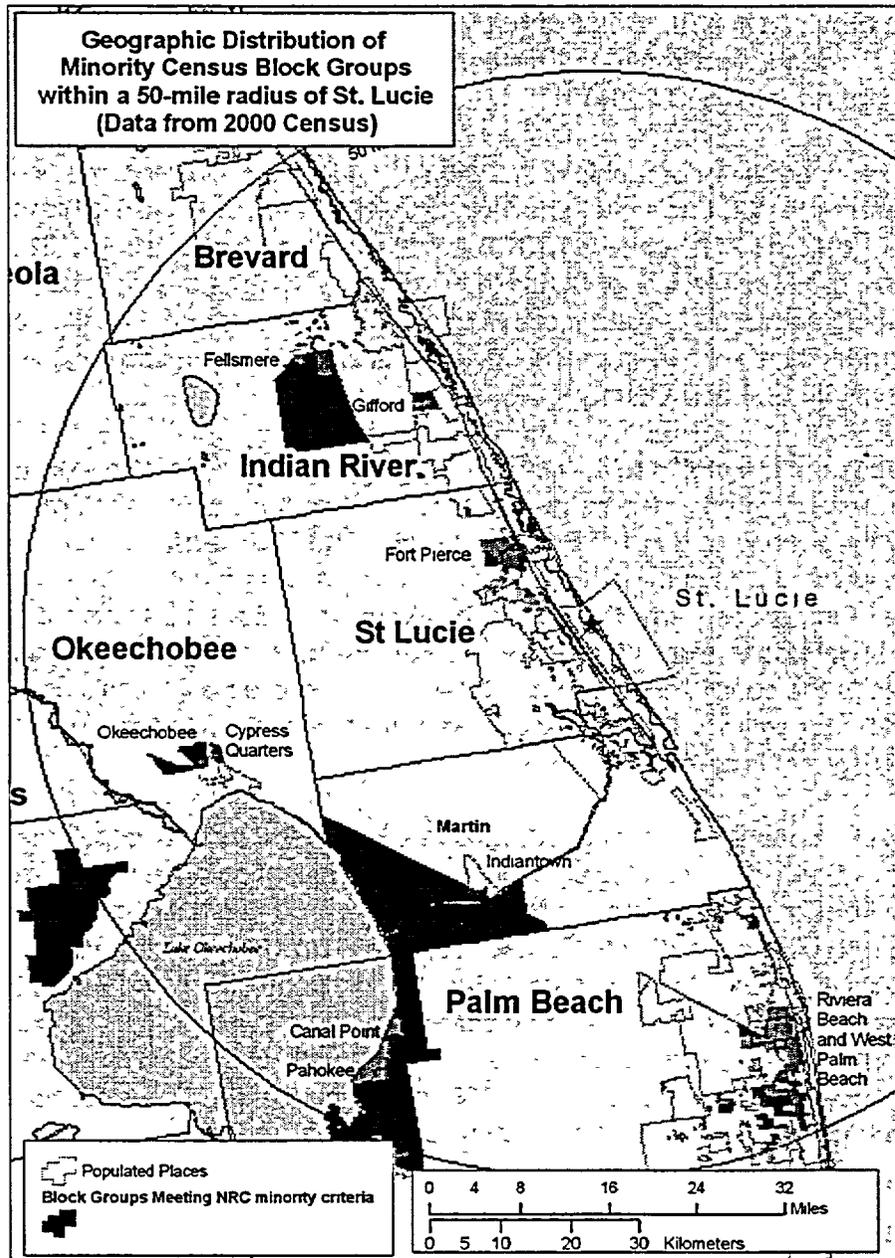

2 **Figure 4-1. Geographic Distribution of Minority Populations (shown in shaded areas) Within**  
3 **80 km (50 mi) of the St. Lucie Site Based on Census Block Group Data<sup>(a)</sup>**

(a) Note: Some of the census block groups extend into Lake Okeechobee.

1 The staff followed the convention of employing census block groups and counts of individuals in  
2 minority or low-income status. Figure 4-1 shows the distribution of minority populations  
3 (shaded areas) within the 80-km (50-mi) radius. Minority populations are present in all counties  
4 within the 80-km (50-mi) radius of the St. Lucie site, particularly in the agricultural areas of the  
5 counties around Lake Okeechobee.


6  
7 Data from the 1990 census characterize low-income populations within the 80-km (50-mi)  
8 radius of the St. Lucie site (USCB 1990). Applying the NRC criterion of "more than 20 percent  
9 greater," the census block groups containing low-income populations were identified. Figure  
10 4-2 shows the locations of the low-income populations within 80 km (50 mi) of the St. Lucie site.  
11 Census block groups containing low-income populations are concentrated in Gifford (Indian  
12 River County), Ft. Pierce (St. Lucie County), Pahokee (Palm Beach County near Lake  
13 Okeechobee), the agricultural areas around Lake Okeechobee, and Hobe Sound  
14 (Martin County).

15  
16 With the locations of minority and low-income populations identified, the staff proceeded to  
17 evaluate whether any of the environmental impacts of the proposed action could affect these  
18 populations in a disproportionately high and adverse manner. Based on staff guidance  
19 (NRC 2001), air, land, and water resources within about 80 km (50 mi) of the St. Lucie site were  
20 examined. Within that area, a few potential environmental impacts could affect human  
21 populations; all of these were considered SMALL for the general population.

22  
23 The pathways through which the environmental impacts associated with St. Lucie Units 1 and 2  
24 license renewal can affect human populations are discussed in each associated section. The  
25 staff found no unusual resource dependencies or practices such as subsistence agriculture,  
26 hunting, or fishing through which minority and/or low-income populations could be  
27 disproportionately highly and adversely affected. In addition, the staff did not identify any  
28 location-dependent disproportionately high and adverse impacts affecting these minority and  
29 low-income populations. The staff concludes that offsite impacts from St. Lucie Units 1 and 2  
30 to minority and low-income populations would be SMALL, and no special mitigation actions are  
31 warranted.

## 32 33 **4.5 Groundwater Use and Quality**

34  
35 Category 1 and 2 issues in 10 CFR Part 51, Subpart A, Appendix B, Table B-1, were reviewed  
36 by FPL. FPL determined that issues related to groundwater use and quality are not applicable  
37 because they apply to design, operational, or location features that do not exist at St. Lucie  
38 Units 1 and 2 and because FPL does not directly withdraw groundwater for St. Lucie Units  
39 1 and 2. Additionally, Category 1 issues related to refurbishment are not applicable because  
40

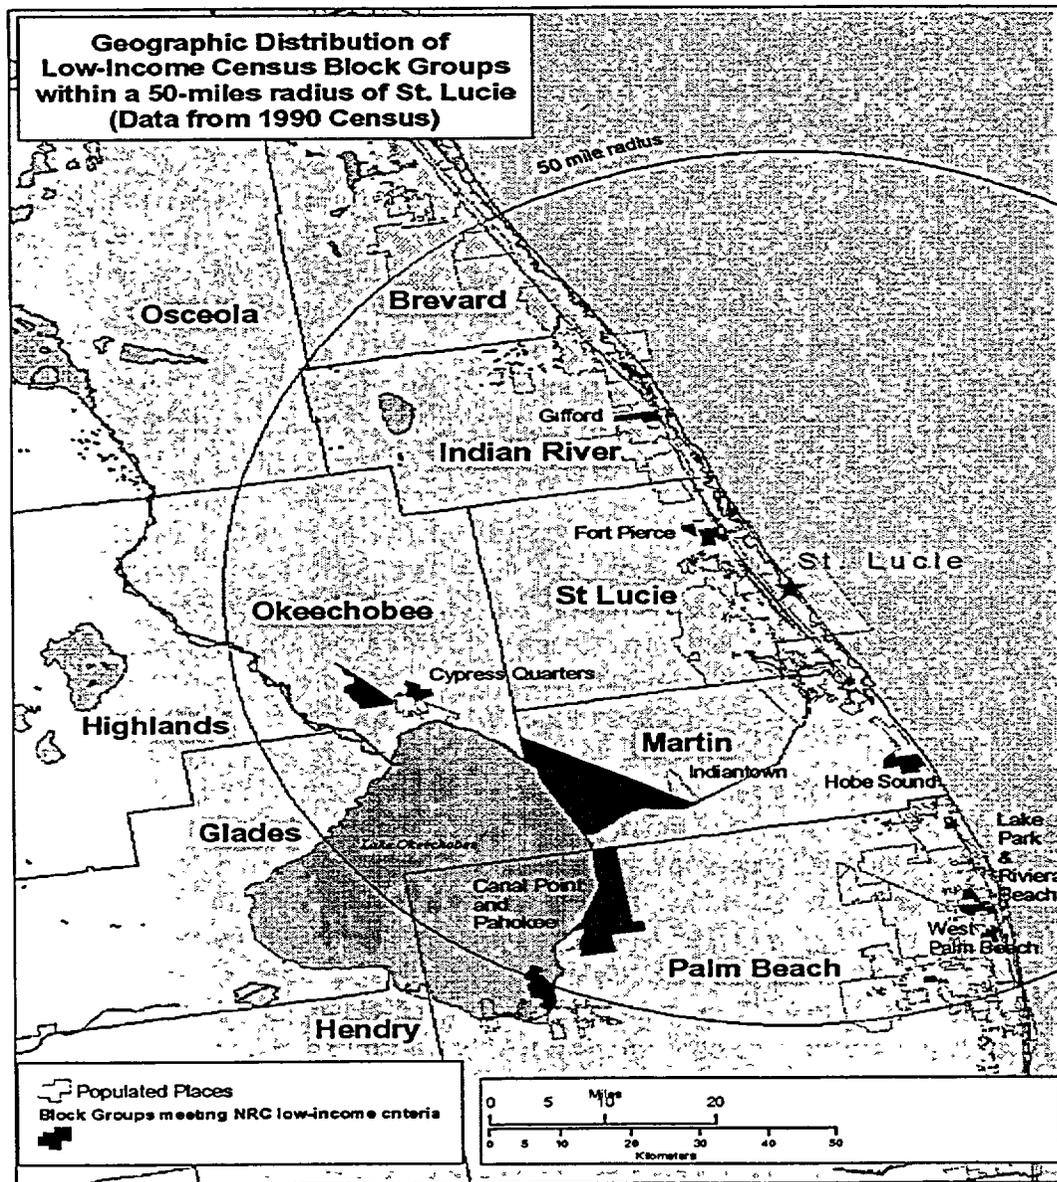

1 **Figure 4-2. Geographic Distribution of Low-Income Populations (shown in shaded areas)**  
2 **Within 80 km (50 mi) of the St. Lucie Site based on Census Block Group Data<sup>(a)</sup>**

(a) Note: Some of the census block groups extend into Lake Okeechobee.

1 refurbishment activities are not planned for St. Lucie Units 1 and 2. However, indirect  
 2 withdrawal of groundwater occurs at the St. Lucie site. There are no Category 1 issues  
 3 applicable to groundwater use and quality for St. Lucie Units 1 and 2 during the renewal term.  
 4 The applicable Category 2 issue is listed in Table 4-8 and is discussed below. Withdrawal of  
 5 potable and service water at St. Lucie Units 1 and 2 ( $5.3 \times 10^3 \text{ m}^3/\text{d}$  [1.4 MGD]) represents less  
 6 than 10 percent of county-wide supplies ( $14.8 \times 10^4 \text{ m}^3/\text{d}$  [35.3 MGD]) (NRC 1996). The staff  
 7 concluded in the GEIS that nuclear plant contributions to deterioration of groundwater quality  
 8 were SMALL where the plants consumption is less than 10 percent of the regional total.  
 9 Therefore, the staff concludes that there are no impacts related to groundwater use and quality  
 10 beyond those discussed in the GEIS. For the issue of groundwater use and quality, the GEIS  
 11 concluded that the impacts are SMALL, and additional plant-specific mitigation measures are  
 12 not likely to be sufficiently beneficial to be warranted.

13  
 14 **Table 4-8. Category 2 Issue Applicable to Groundwater Use and Quality During the**  
 15 **Renewal Term**

ISSUE—10 CFR Part 51, Subpart A, Appendix B, Table B-1	GEIS Section	10 CFR 51.53(c)(3)(ii) Subparagraph	SEIS Section
<b>GROUNDWATER USE AND QUALITY</b>			
Groundwater use conflicts (potable and service water; plants that use >379 l/min [>100 gpm]).	4.8.1.1; 4.8.2.1	C	4.5

23  
 24 **4.6 Threatened or Endangered Species**

25  
 26 Threatened or endangered species are listed as a Category 2 issue in 10 CFR Part 51,  
 27 Subpart A, Appendix B, Table B-1. This issue is listed in Table 4-9 and discussed in  
 28 Sections 4.6.1 through 4.6.3.

29  
 30 **Table 4-9. Category 2 Issue Applicable to Threatened or Endangered Species During the**  
 31 **Renewal Term**

ISSUE—10 CFR Part 51, Subpart A, Appendix B, Table B-1	GEIS Section	10 CFR 51.53(c)(3)(ii) Subparagraph	SEIS Section
<b>THREATENED OR ENDANGERED SPECIES (FOR ALL PLANTS)</b>			
Threatened or endangered species	4.1	E	4.6

32  
 33  
 34  
 35  
 36  
 37  
 38 The NRC made impacts to threatened and endangered species a Category 2 issue because  
 39 the status of species is reviewed on an on-going basis, and site-specific assessment is required  
 40 to determine whether any identified species could be affected by refurbishment activities or

## Environmental Impacts of Operation

1 continued plant operations through the renewal period. This issue requires consultation with  
2 appropriate agencies to determine whether threatened or endangered species are present and  
3 whether they would be adversely affected by continued operation of the nuclear plant during the  
4 license renewal term. The presence of threatened or endangered species in the vicinity of the  
5 St. Lucie site is discussed in Sections 2.2.5 and 2.2.6.  
6

### 7 **4.6.1 Aquatic Species**

8  
9 Sections 2.2.5.1 and 2.2.5.2 of this supplement discuss aquatic habitats at St. Lucie Units 1  
10 and 2. Section 2.2.5.3 presents a list of Federally threatened and endangered species and  
11 State species of special concern that may occur at St. Lucie Units 1 and 2. In this section, the  
12 environmental consequences of the plant operation to sea turtles, manatees, whales, three  
13 species of fish, and Johnson's seagrass are assessed.  
14

#### 15 **4.6.1.1 Turtles**

16  
17 During the almost 20 years of commercial operation of St. Lucie Units 1 and 2, the only notable  
18 effect of the facility's operation on protected species has been related to sea turtles that have  
19 entered the intake canal. Soon after startup of St. Lucie Unit 1, in 1976, sea turtles were  
20 discovered in the intake canal (Ecological Associates 2000; NRC 1982b). These turtles entered  
21 the offshore velocity cap intake and were swept through the intake pipe into the canal. A  
22 program was initiated to capture the turtles from the intake canal and return them to the ocean.  
23 In 1978, a large-mesh (20-cm [8-in]) barrier net was deployed in the canal to capture turtles  
24 before they transited the entire intake canal, entered the intake wells, and became impinged on  
25 the traveling intake screens. A Biological Assessment and Endangered Species Act Section 7  
26 Consultation was completed in 1982 (NRC 1982b) to address turtle entrapment in light of the  
27 pending construction and operation of St. Lucie Unit 2. At that time, the turtle entrapment  
28 history at St. Lucie Unit 1 was approximately 150 turtles per year from 1976 to 1981. Mortality  
29 rates for loggerhead (*Caretta caretta*) and green sea turtles (*Chelonia mydas mydas*) for this  
30 period were 14.6 percent and 8.9 percent, respectively. Projecting mortality losses to include  
31 operation of St. Lucie Unit 2, the Biological Assessment indicated that turtle losses at St. Lucie  
32 Units 1 and 2 would represent 0.1 percent (loggerhead sea turtles) to 0.03 percent (green sea  
33 turtles) of the respective adult Caribbean populations. It was concluded that no impact to the  
34 population of either species would be expected (NRC 1982b). The assessment made several  
35 recommendations for enhancement of the ongoing capture-release and beach-nest monitoring  
36 programs.  
37

38 During 1995, in response to an increase in the number of sea turtles that had entered the intake  
39 canal, particularly green sea turtles, the NRC reinitiated the Endangered Species Act Section 7  
40 Consultation process with the National Marine Fisheries Service (NMFS). During this process,

1 construction of a new, smaller mesh barrier east of the large mesh barrier was identified as  
 2 appropriate, and construction of this small-mesh (13-cm [5 in]) barrier net was completed in  
 3 January 1996. The size of the mesh was selected to be smaller than any of the green sea  
 4 turtles that had entered the intake canal during the first half of 1995. The new net was located  
 5 halfway between the old 20-cm (8-in) mesh barrier net and the intake headwall, thus confining  
 6 sea turtles that entered the intake canal to a smaller area and facilitating their safe capture and  
 7 release. The new net is anchored along the bottom of the canal and held up by an aerial wire  
 8 strung between towers on the sides of the canal. The net is inspected and maintained  
 9 regularly.

10  
 11 As a result of the 1995 consultation, the NMFS issued a biological opinion (NMFS 1997). In the  
 12 Biological Opinion, the NMFS concluded that the continued operation of St. Lucie Units 1 and 2  
 13 is not likely to jeopardize the existence of the sea turtle species. To increase protective  
 14 measures for the turtles, NMFS included an incidental take statement in the Biological Opinion.  
 15 This statement specified the permissible annual mortality level of sea turtles entering the intake  
 16 canal. The requirements of the incidental take statement were incorporated as part of the St.  
 17 Lucie Units 1 and 2 OLs. If the annual mortality level criteria were exceeded, a new Section 7  
 18 Consultation would be required.

19  
 20 In November 1999, the NRC formally requested that the Section 7 process be initiated after  
 21 St. Lucie Units 1 and 2 exceeded the NMFS's anticipated incidental take of green turtles per  
 22 year established in the incidental take statement of the 1997 Biological Opinion. In  
 23 March 2000, FPL submitted a report to NMFS analyzing the physical and ecological facts  
 24 influencing sea turtle entrainment levels during the period 1976 through 1998 (Ecological  
 25 Associates 2000). In May 2001, the NMFS issued its Biological Opinion and revised the  
 26 incidental take statement. The Biological Opinion reiterates the previous conclusions and  
 27 states

28  
 29 It is NMFS' biological opinion that the continued use of St. Lucie Nuclear Power Plant's  
 30 circulating seawater cooling system is not likely to jeopardize the continued existence of  
 31 the endangered green, leatherback, hawksbill, and Kemp's ridley sea turtles or the  
 32 threatened loggerhead sea turtle (NMFS 2001).

33  
 34 The NMFS specified that the annual incidental capture could be up to 1000 turtles with that  
 35 number being in any combination of the 5 species found in the area. The permissible annual  
 36 mortality of entrapped green and loggerhead sea turtles that is causally related to plant  
 37 operation for the next 10 years is greater than or equal to 1 percent of the total combined  
 38 number of green and loggerhead sea turtles captured, rounded up to the next whole turtle. The  
 39 permissible mortality for the other three species of sea turtles found in the area are two Kemp's  
 40 ridley turtles (*Lepidochelys kempi*) per year and one hawksbill (*Eretmochelys imbricata*) or

## Environmental Impacts of Operation

1 leatherback turtle (*Dermochelys coriacea*) every 2 years for the next 10 years. Some of the  
2 terms and conditions of the previous opinion were also revised. Specifically, there are  
3 additional requirements for the intake canal capture-and-release program. Citing the loss rate  
4 on flipper tags and the scarring that can result, the NMFS now requires all turtles captured in  
5 the intake canal to be tagged with a passive integrated transponder tag. Those turtles not  
6 exhibiting flipper scarring and damage also will be flipper-tagged so data can continue to be  
7 collected on loss rates. Additionally, FPL biologists must notify staff from the Florida Sea Turtle  
8 Stranding and Salvage Network of any sick or injured turtles within 30 minutes of discovery so  
9 the turtles can receive proper attention. The NMFS again stipulated that if the incidental take  
10 statement requirements are met or exceeded, a new Section 7 Consultation is required.

11  
12 In addition to the take restrictions, FPL has a program in place at St. Lucie Units 1 and 2 to  
13 mitigate the effects on sea turtles that enter the intake canal. This program includes recovery  
14 of turtles from the intake canal and release to the ocean, beach-nest monitoring, beach-  
15 stranding monitoring, and compliance with facility lighting restrictions to protect turtles. The  
16 canal-monitoring program is based on the protection afforded by barrier nets in the canal. This  
17 system of barriers restricts turtles to the eastern end of the canal, where capture efficiency is  
18 greatest and residency time is reduced. The canal and barrier nets are monitored 7 days a  
19 week, 8 to 12 hours per day, by onsite biologists. In addition to entanglement nets, which are  
20 used only in daylight hours and under continual surveillance, turtles are removed by dip nets  
21 and hand captured by divers. These captures reduce residence time for turtles in the canal.  
22 FPL constantly evaluates its netting program to minimize trauma to turtles and to maximize  
23 capture efficiency. Captured turtles are identified, measured, weighed, tagged, and examined  
24 for health condition (Ecological Associates 2000). Healthy turtles are released to the ocean the  
25 day of capture. Sick or injured turtles are sent to rehabilitation facilities determined by the  
26 FFWCC. Dead turtles are processed similarly and, if in fresh condition, necropsied. Additional  
27 mitigation carried out by FPL includes performance of sea turtle nesting surveys, participation in  
28 the Sea Turtle Stranding and Salvage Network, and sponsorship of educational public sea turtle  
29 walks. FPL has also created a vegetative light screen and uses shielded security lighting to  
30 prevent direct lighting of the beach. This is done to avoid disorientation of turtle hatchlings and  
31 discouragement of females from nesting near the St. Lucie site. FPL also participates in a  
32 24-hour, on-call (beach) stranding monitoring program (FPL 1995).

33  
34 The increase in the number of sea turtles entering the intake canal at St. Lucie Units 1 and 2  
35 over the operating history of the plant is likely due to an increase in turtle abundance in the area  
36 (NMFS 1997). NMFS acknowledged that protective measures have been refined and  
37 enhanced over the years. Improvements to the canal capture program have included  
38 improvements to the barrier net and capture techniques, and leaving the entanglement nets in

1 the water for longer time intervals. The turtle barrier net installed in 1996 greatly restricts the  
2 movement of turtles within the intake canal and facilitates their capture and removal. Since  
3 1996, mortality rates have been less than 1 percent for loggerhead and green sea turtles  
4 (NMFS 1997).  
5

6 At the initiation of the process to prepare this SEIS, NRC staff contacted the NMFS to informally  
7 consult on the status of protected species in the vicinity of St. Lucie Units 1 and 2. In a letter  
8 dated June 3, 2002 (NRC 2002c), the NRC staff informed NMFS that the licensee had  
9 requested a renewal of the OL for St. Lucie Units 1 and 2. Based on the existence of the  
10 May 4, 2001, Biological Opinion, the NRC staff believed that no additional consultation is  
11 necessary at this time related to the license renewal effort. NMFS responded in a letter dated  
12 July 30, 2002, (NMFS 2002) stating that with respect to the St. Lucie license renewal  
13 application, "...NOAA Fisheries does not believe additional consultation is required at this time."  
14 As discussed above, the NRC has a long history of Section 7 consultations with NMFS at the  
15 St. Lucie plant and expects the consultation interactions to continue throughout the operating  
16 life of the facility.  
17

#### 18 4.6.1.2 Mammals 19

20 Six species of protected mammals (five species of whales and the Florida manatee) occur in  
21 vicinity of the St. Lucie site. There have been five occasions when manatees have entered in  
22 the intake canal. During 1991, FPL coordinated capture efforts with the FWS and Florida  
23 Department of Environmental Protection (FDEP) (predecessor to the FFWCC). After capture,  
24 the animals underwent evaluation and rehabilitation and were released to the wild. Except for  
25 the first manatee, the animals were removed from the canal within a day of each first sighting.  
26 Two of these animals were taken to rehabilitation facilities before their release. One was  
27 treated for deep boat propeller wounds it incurred before entering the canal, and one appeared  
28 to be a small calf separated from its mother. None of the manatees appeared to have been  
29 harmed or to have died as a result of entering the intake canal. FPL procedures require  
30 coordination with the FFWCC on the capture and evaluation of entrapped manatees. FPL  
31 assists the FFWCC, as needed, in transporting ill or injured animals to approved rehabilitation  
32 facilities and in releasing animals that have entered the intake canal back to the wild (Ecological  
33 Associates 2001).  
34

35 In addition to potential impacts from the water intake system, the attraction to or contact with  
36 the warm waters discharged from the plant need to be considered. The discharge canal  
37 transports the heated cooling water to two discharge pipes. The pipes transport water beneath  
38 the beach and dune system back to the Atlantic Ocean. The pipes extend about 460 m  
39 (1500 ft) and 1040 m (3400 ft) offshore and terminate in a two-port "Y" diffuser. The discharge  
40 of heated water through the Y-port and multiport diffusers ensures distribution over a wide area

## Environmental Impacts of Operation

1 and rapid and efficient mixing with ambient waters (FPL 1996; Foster Wheeler 2000). Modeling  
2 studies presented by the AEC and NRC in the operating stage Final Environmental Statements  
3 indicate that the areas of the thermal plumes to the 1.1°C (2°F) isotherm from the St. Lucie  
4 Units 1 and 2 diffusers under typical conditions would be about 73 ha (180 ac) and 71 ha  
5 (175 ac), respectively (AEC 1973; NRC 1982a). Considering that some of the manatee  
6 captures have occurred during summer months, there seems to be no compelling evidence to  
7 infer that manatees congregate at, or are attracted to, the warm water discharges from  
8 St. Lucie Plant Units 1 and 2.

9  
10 The manatee inhabits the Indian River Lagoon and Atlantic coastal waters off Hutchinson  
11 Island, although preferred habitats are in the Indian River Lagoon and other inland waterways.  
12 The entire inland section of water known as the Indian River is designated as critical habitat for  
13 the manatee (50 CFR 17.108). Manatees are mostly found where food sources are abundant.  
14 They do occasionally travel up and down the coast near shore. Water is not withdrawn or  
15 discharged to the Indian River for normal operations at St. Lucie Units 1 and 2, and there is little  
16 attached vegetation in the nearshore environment adjacent to the plant. Manatees are present  
17 in the area known as Big Mud Creek within the plant boundaries. This area has been closed to  
18 public access due to NRC security concerns, and any boats that are operated within Big Mud  
19 Creek are required to travel at idle speed and produce no wake.

20  
21 Five species of whales are known to occur in the vicinity of the St. Lucie site. Because of their  
22 size and habits, adult whales are unlikely to be entrained with cooling water. Additionally,  
23 whales do not appear to be attracted to the thermal discharges. The only incident involving a  
24 whale at the St. Lucie plant occurred in March 1982, when a right whale became entangled in  
25 gill nets used to monitor offshore fish populations. The whale was untangled and released,  
26 unharmed.

### 27 28 **4.6.1.3 Johnson's Seagrass**

29  
30 Johnson's seagrass is found in the Indian River Lagoon, most often near inlets. Major threats  
31 to Johnson's seagrass include loss of habitat through dredge and fill activities and degradation  
32 of water clarity. Due to turbulence and sediment instability, it is unlikely that Johnson's  
33 seagrass could inhabit the nearshore waters off Hutchinson Island. Water depths and anoxic  
34 bottom conditions probably preclude its presence in the dredged channel of Big Mud Creek.  
35 Consequently, the species is not likely to suffer thermal or other impacts associated with  
36 operators of St. Lucie Units 1 and 2 (Ecological Associates 2001).

#### 4.6.1.4 Fish

There are no Federally protected fish species in the vicinity of St. Lucie Units 1 and 2; however, there are three State-protected species. The Atlantic sturgeon (*Acipenser oxyrinchus*) occurs in the Atlantic Ocean near the plant, but they have not been collected in any of the impingement samples at the plant (FPL 2001a). Rivulus (*Rivulus marmoratus*) occurs along the margins of the wetlands onsite. Because plant operations are not expected to involve the loss of wetlands, there should be no impacts to rivulus populations (St. Lucie County 2002). The common snook (*Centropomus undecimalis*) is a highly prized recreational species common to the Indian River Lagoon and nearshore ocean water adjacent to the plant. FPL coordinates the removal and assessment of snook with the appropriate wildlife agencies and assists in their return to the ocean. This program reduces the extent of impacts to snook entrained at St. Lucie Units 1 and 2.

#### 4.6.2 Terrestrial Species

There are a number of Federally listed endangered or threatened terrestrial species in St. Lucie County (Table 2.3), but none has been observed to regularly inhabit the immediate vicinity of St. Lucie Units 1 and 2. However, eastern indigo snakes (*Drymarchon corias couper*) are assumed to be present at or near the site because they have been observed on Hutchinson Island and gopher tortoise burrows are present within the boundaries of the St. Lucie site. Eastern indigo snakes often use abandoned gopher tortoise burrows as dens and are often found in areas with plentiful gopher tortoise burrows. FPL has a program to train personnel involved with site and transmission line right-of-way maintenance to recognize and avoid indigo snakes in the field. Southeastern beach mice (*Peromyscus polionotus neveiventris*) could be present near the plant site, but they have not been found during any recent surveys on Hutchinson Island and may have been extirpated from the island. Other species such as the wood stork (*Mycteria americana*) and the bald eagle (*Haliaeetus leucocephalus*) are occasional visitors to the plant vicinity. There have been no reported collisions or electrocutions of wood storks, bald eagles, or any other birds at the St. Lucie site or along the transmission lines.

Several Federally listed endangered or threatened species may be present in the vicinity of the St. Lucie transmission line right-of-way. The Florida scrub jay (*Aphelocoma coerulescens*) inhabits the transmission line right-of-way on the eastern edge of the Savannas State Preserve. The Audubon's crested caracara (*Polyborus plancus audubonii*), Everglades snail kite (*Rostrhamus sociabilis*), and American alligator (*Alligator mississippiensis*) occasionally may be present in the transmission line right-of-way. Plant species potentially occurring near the transmission line right-of-way include the fragrant prickly apple (*Harrisia [Cereus] eriophorus*) and the four-petal paw paw (*Asimina tetramera*). The transmission line right-of-way maintenance practices employed by FPL are likely to have little or no detrimental impact on the

## Environmental Impacts of Operation

1 species potentially present in or near the transmission line rights-of-way, and in some cases the  
2 maintenance practices may be beneficial. For instance, thinning of the larger trees on the east  
3 side of the Savannas State Reserve may help to maintain the open shrubby habitat preferred  
4 by the Florida scrub jay.

5  
6 Informal consultation with the FWS was initiated by FPL in April 2001 (FPL 2001b), and was  
7 continued in February 2002 by the NRC with a request for information concerning which  
8 species are potentially present in the vicinity of St. Lucie Units 1 and 2 (NRC 2002a). The FWS  
9 responded to NRC with a list of species potentially present in the vicinity of the site in March  
10 2002 (FWS 2002). NRC staff met with representatives from FWS in December 2001 and April  
11 2002 to discuss potential impacts to threatened or endangered species from continued  
12 operation of St. Lucie Units 1 and 2. Correspondence related to this informal consultation is  
13 provided in Appendix E.

14  
15 The staff evaluated the potential impacts of continued operation of St. Lucie Units 1 and 2 for  
16 an additional 20-year license term to Federally listed threatened or endangered species and  
17 sent this evaluation to the FWS in July 2002 (NRC 2002b). This Biological Assessment is  
18 included in Appendix E of this draft SEIS. In its evaluation, the staff concluded that the  
19 proposed license renewal was not likely to adversely affect the eastern indigo snake, bald  
20 eagle, wood stork, southeastern beach mouse, Florida scrub jay, four-petal paw paw, and  
21 fragrant prickly apple. License renewal was determined to have no effect on Audubon's crested  
22 caracara, Everglades snail kite, Lakela's mint (*Dicerandra immaculate*), tiny milkwort (*Polygala*  
23 *smallii*), American alligator, or any other Federally listed endangered or threatened terrestrial  
24 species. Copies of correspondence related to this consultation are provided in Appendix E.

25  
26 Florida State-listed threatened, endangered, or other species of concern (Table 2-3) were not  
27 specifically considered within the NRC's June 2002 evaluation. The staff has determined that  
28 the generic conclusions regarding transmission line maintenance impacts on wildlife and  
29 wetlands, bird collisions with power lines, the effects of electromagnetic fields, and plant and  
30 cooling system operation effects on wildlife and native vegetation are applicable to the State-  
31 listed species, and therefore the potential impacts are SMALL, and additional mitigation  
32 measures are not warranted.

### 33 34 **4.6.3 Conclusion**

35  
36 The staff has reviewed the available information including that provided by the applicant, the  
37 FWS, the FFWCC, the scoping process, and other public information sources. Using this  
38 information, the staff evaluated the potential impacts to endangered or threatened species that  
39 could be affected by continued operation and maintenance of St. Lucie Units 1 and 2 and  
40 associated transmission lines. It is the preliminary conclusion of the staff that the potential

1 impacts to Federally listed threatened or endangered species of an additional 20-year license  
2 term for operation of St. Lucie Units 1 and 2 are SMALL.

3  
4 During the course of its evaluation, the staff considered mitigation measures for continued  
5 operation of St. Lucie Units 1 and 2 along with cumulative impacts of past, current, and future  
6 activities at the site. Based on this evaluation, the staff expects that mitigation measures  
7 currently in place concerning sea turtle protection and recovery are appropriate and no  
8 additional mitigation measures are warranted. Additionally, the staff expects that FPL will  
9 continue to maintain the transmission line right-of-way on the eastern edge of the Savannas  
10 State Preserve as it has since constructing the transmission line, and that these maintenance  
11 procedures will continue to provide or enhance habitat for the Florida scrub jay and other  
12 threatened or endangered species potentially present in that area. This will provide adequate  
13 mitigation for potential impacts to terrestrial threatened or endangered species, and no  
14 additional mitigation measures are warranted.

#### 15 16 **4.7 Evaluation of Potential New and Significant Information** 17 **on Impacts of Operations During the Renewal Term**

18  
19 The staff has not identified significant new information on environmental issues listed in 10 CFR  
20 Part 51, Subpart A, Appendix B, Table B-1, related to operation during the renewal term. The  
21 staff reviewed the discussion of environmental impacts associated with operation during the  
22 renewal term in the GEIS and has conducted its own independent review, including public  
23 scoping meetings, to identify issues with significant new information. Processes for  
24 identification and evaluation of new information are described in Section 1.2.2.

#### 25 26 **4.8 Summary of Impacts of Operations During the** 27 **Renewal Term**

28  
29 Neither FPL nor the staff is aware of information that is both new and significant related to any  
30 of the applicable Category 1 issues associated with the operation of St. Lucie Units 1 and 2  
31 during the renewal term. Consequently, the staff concludes that the environmental impacts  
32 associated with these issues are bounded by the impacts described in the GEIS. For each of  
33 these issues, the GEIS concluded that the impacts would be SMALL and that additional plant-  
34 specific mitigation measures are not likely to be sufficiently beneficial to warrant  
35 implementation.

36  
37 Plant-specific environmental evaluations were conducted for 12 Category 2 issues applicable to  
38 the operation of St. Lucie Units 1 and 2 during the renewal term and for environmental justice

## Environmental Impacts of Operation

1 and chronic effects of electromagnetic fields. For all 12 issues and environmental justice, the  
2 staff concluded that the potential environmental impact of renewal term operations of St. Lucie  
3 Units 1 and 2 would be of SMALL significance in the context of the standards set forth in the  
4 GEIS and that additional mitigation would not be warranted. For threatened and endangered  
5 species, the staff's preliminary conclusion is that the impact resulting from license renewal  
6 would be SMALL and further mitigation is not warranted. In addition, the staff determined that a  
7 consensus has not been reached by appropriate Federal health agencies regarding chronic  
8 adverse effects from electromagnetic fields. Therefore, no further evaluation of this issue is  
9 possible.

### 10 11 4.9 References

12  
13 10 CFR 51. Code of Federal Regulations, Title 10, *Energy*, Part 51, "Environmental Protection  
14 Regulations for Domestic Licensing and Related Regulatory Functions."

15  
16 36 CFR 800. Code of Federal Regulations, Title 36, *Parks, Forests, and Public Property*, Part  
17 800, "Protection of Historic Properties."

18  
19 50 CFR 17. Code of Federal Regulation, Title 50, *Wildlife and Fisheries*, Part 17, "Endangered  
20 and Threatened Wildlife and Plants."

21  
22 59 FR 7629. Executive Order 12898. "Federal Actions to Address Environmental Justice in  
23 Minority and Low-Income Populations." Federal Register. Vol. 59, No. 32. February 11, 1994.

24  
25 Applied Biology, Inc. 1985. "Florida Power and Light Company St. Lucie Plant Annual Non-  
26 Radiological Environmental Monitoring Report 1984." L-85-174, April 30, 1985, Atlanta,  
27 Georgia.

28  
29 Council on Environmental Quality (CEQ). 1997. "Environmental Justice Guidance Under the  
30 National Environmental Policy Act." Executive Office of the President, Washington, D.C.  
31 <http://ceq.eh.doe.gov/nepa/regs/ej/justice.pdf>. Accessed February 9, 2002.

32  
33 Ecological Associates, Inc. 2000. *Physical and Ecological Factors Influencing Sea Turtle*  
34 *Entrainment Levels at St. Lucie Nuclear Power Plant: 1976-1998*. L-2000-78, Jensen Beach  
35 Florida.

36  
37 Ecological Associates, Inc. 2001. *Survey of Aquatic Environments Potentially Affected by the*  
38 *Operation of the St. Lucie Power Plant, Hutchinson Island, Florida*. Prepared for Florida Power  
39 and Light Company, Jensen Beach Florida.

1 Electric Power Research Institute (EPRI). 1987. *Transmission Line Reference Book 345kV*  
2 *and Above*. 2<sup>nd</sup> Edition, Revised. Palo Alto, California

3  
4 Electric Power Research Institute (EPRI). 1994. *Electromagnetic Workstation: ENVIRO Code*  
5 *Version 3.1*, Palo Alto, California.

6  
7 Endangered Species Act (ESA). 16 USC 1531, et seq.

8  
9 Federal Water Pollution Control Act (FWPCA) of 1977. As amended 33 USC 1251 et seq.  
10 (Also known as the Clean Water Act)

11  
12 Florida Department of Environmental Protection (FDEP). 1976. "Site Certification, St. Lucie  
13 Power Plant Unit 2, Florida Power & Light Co." Certification No. PA 74-02C, OGC Case  
14 No. 94-1053. 1976 (and subsequent modifications). Tallahassee, Florida.

15  
16 Florida Department of Environmental Protection (FDEP). 1996. "Surface Water Quality  
17 Standards." Rule G2-302.520(4)(c). Tallahassee, Florida.

18  
19 Florida Department of Environmental Protection (FDEP). 2000. "State of Florida Wastewater  
20 Facility Permit. Permit No. FL0002208-Major." Issued to Florida Power and Light Company for  
21 St. Lucie Power Plant Units 1 and 2. January 10, 2000. Tallahassee, Florida.

22  
23 Florida Department of Environmental Protection (FDEP). 2002. Email correspondence from  
24 Terry Davis, Tallahassee, Florida, April 23, 2002.

25  
26 Florida Power and Light Company (FPL). 1995. *Assessment of the Impacts of the St. Lucie*  
27 *Nuclear Generating Plant on Sea Turtle Species Found in the Nearshore Waters*  
28 *of Florida*. L-95-309, Juno Beach, Florida.

29  
30 Florida Power and Light Company (FPL). 1996. "St. Lucie Plant Wastewater Permit  
31 Application." Jensen Beach, Florida.

32  
33 Florida Power and Light Company (FPL). 2001a. *Applicant's Environmental Report –*  
34 *Operating License Renewal Stage St. Lucie Units 1 and 2*. Docket Nos. 50-335 and 50-389,  
35 Miami, Florida.

36  
37 Florida Power and Light Company (FPL). 2001b. Letter from S.M. Foster (FPL) to L. Gregg  
38 (FFWCC), "Activities Report for Florida Fish and Wildlife Conservation Commission Scientific  
39 Collecting Permit # 01S-018." Jensen Beach, Florida. December 12, 2001.

## Environmental Impacts of Operation

1 Florida Power and Light Company (FPL). 2001c. Letter from R. S. Kundalkar (FPL) to  
2 J. Snyder-Matthews, State Historic Preservation Officer, Florida Division of Historic Resources.  
3 April 2001.

4  
5 Foster Wheeler Environmental Corporation. 2000. *Annual Operation and Maintenance Status*  
6 *Report (1999-2000) for FPL St. Lucie Power Plant Unit 1 and Unit 2 Remedial Action.* Stuart,  
7 Florida.

8  
9 National Electrical Safety Code (NESC). 1997. Institute of Electrical and Electric Engineers,  
10 New York.

11  
12 National Environmental Policy Act of 1969 (NEPA). 42 USC 4321, et. seq.

13  
14 National Historic Preservation Act (NHPA). 16 USC 470, et seq.

15  
16 National Institute of Environmental Health Sciences (NIEHS). 1999. *NIEHS Report on Health*  
17 *Effects from Exposure to Power Line Frequency and Electric and Magnetic Fields.* Publication  
18 No. 99-4493, Research Triangle Park, North Carolina.

19  
20 National Marine Fisheries Service (NMFS). 1997. "Endangered Species Act Section 7  
21 Consultation Biological Opinion." St. Petersburg, Florida. February 7, 1997.

22  
23 National Marine Fisheries Service (NMFS). 2001. Letter from J.E. Powers (NMFS) to K.N.  
24 Jabbour (NRC), "National Marine Fisheries Service Biological Opinion." May 4, 2001.  
25 St. Petersburg, Florida.

26  
27 National Marine Fisheries Service (NMFS). 2002. Letter from J. E. Powers (NMFS) to P. T.  
28 Kuo (NRC). July 3, 2002.

29  
30 St. Lucie County. 2002. Letter from J.R. David (St. Lucie County) to S. Foster (FPL). "*Rivulus*  
31 *Marmoratus.*" Division of Mosquito Control, St. Lucie County, Florida. April 10, 2002.

32  
33 State Historic Preservation Office (SHPO). 2001. Letter from J. Mathews (SHPO), Florida  
34 Department of State, Division of Historic Resources, to R. S. Kundalkar, FPL. May 22, 2001.

35  
36 U.S. Atomic Energy Commission (AEC). 1973. *Final Environmental Statement Related to the*  
37 *St. Lucie Plant Unit No. 1; Florida Power and Light Company.* Docket No. 50-335, Directorate  
38 of Licensing, Washington, D.C.

1 U.S. Atomic Energy Commission (AEC). 1974. *Final Environmental Statement Related to*  
2 *Construction of St. Lucie Plant Unit 2; Florida Power and Light Company*. Docket No. 50-389,  
3 Washington, D.C.

4  
5 U.S. Census Bureau (USCB). 1991. "1990 Census-Population and Housing; Public Law  
6 94-171 Data." Washington, D.C.

7  
8 U.S. Census Bureau (USCB). 2000. "Census 2000 Summary File 1 (SF-1) 100 Percent Data."  
9 <http://www.census.gov/main/www/cen2000.html>. Accessed July 22, 2002.

10  
11 U.S. Census Bureau (USCB). 2001. "Glossary – Definition and Explanations – decennial  
12 census terms." <http://www.census.gov/main/www/glossary.html>. Accessed April 3, 2001.

13  
14 U.S. Fish and Wildlife Service (FWS). 2002. Letter from L. Ferrell (FWS) to C. I. Grimes  
15 (NRC). March 15, 2002.

16  
17 U.S. Nuclear Regulatory Commission (NRC). 1982a. *Final Environmental Statement Related*  
18 *to the Operation of St. Lucie Plant, Unit No. 2; Florida Power and Light Company, Orlando*  
19 *Utilities Commission of the City of Orlando, Florida*. Docket No. 50-389. NUREG-0842,  
20 Washington, D.C.

21  
22 U.S. Nuclear Regulatory Commission (NRC). 1982b. *Assessment of the Impacts of the St.*  
23 *Lucie Nuclear Plant on Threatened and Endangered Species*. Docket No. 50-398,  
24 Washington, D.C.

25  
26 U.S. Nuclear Regulatory Commission (NRC). 1996. *Generic Environmental Impact Statement*  
27 *for License Renewal of Nuclear Plants*. NUREG-1437, Volumes 1 and 2, Washington, D.C.

28  
29 U.S. Nuclear Regulatory Commission (NRC). 1999. *Generic Environmental Impact Statement*  
30 *for License Renewal of Nuclear Plants, Main Report*, "Section 6.3 – Transportation, Table 9.1  
31 Summary of Findings on NEPA issues for license renewal of nuclear power plants, Final  
32 Report." NUREG-1437, Volume 1, Addendum 1, Washington, D.C.

33  
34 U.S. Nuclear Regulatory Commission (NRC). 2001. "Procedural Guidance for Preparing  
35 Environmental Assessments and Considering Environmental Issues," Appendix D to NRC  
36 Office of Nuclear Reactor Regulation Instruction, LIC-203, June 21, 2001, Washington, D.C.

37  
38 U.S. Nuclear Regulatory Commission (NRC). 2002a. Letter from C. I. Grimes (NRC) to  
39 J. Slack (FWS). February 27, 2002.

## Environmental Impacts of Operation

- 1 U.S. Nuclear Regulatory Commission (NRC). 2002b. Letter from P. T. Kuo (NRC) to J. Slack
- 2 (FWS). July 24, 2002.
- 3
- 4 U.S. Nuclear Regulatory Commission (NRC). 2002c. Letter from P. T. Kuo (NRC) to
- 5 J. F. Powers (NMFS). June 3, 2002.
- 6
- 7

## 5.0 Environmental Impacts of Postulated Accidents

Environmental issues associated with postulated accidents are discussed in the *Generic Environmental Impact Statement for License Renewal of Nuclear Plants* (GEIS), NUREG-1437, Volumes 1 and 2 (NRC 1996, 1999).<sup>(a)</sup> The GEIS includes a determination of whether the analysis of the environmental issue could be applied to all plants and whether additional mitigation measures would be warranted. Issues are then assigned a Category 1 or a Category 2 designation. As set forth in the GEIS, Category 1 issues are those that meet all of the following criteria:

- (1) The environmental impacts associated with the issue have been determined to apply either to all plants or, for some issues, to plants having a specific type of cooling system or other specified plant or site characteristic.
- (2) Single significance level (i.e., SMALL, MODERATE, or LARGE) has been assigned to the impacts (except for collective offsite radiological impacts from the fuel cycle and from high-level waste and spent fuel disposal).
- (3) Mitigation of adverse impacts associated with the issue has been considered in the analysis, and it has been determined that additional plant-specific mitigation measures are likely not to be sufficiently beneficial to warrant implementation.

For issues that meet the three Category 1 criteria, no additional plant-specific analysis is required unless new and significant information is identified.

Category 2 issues are those that do not meet one or more of the criteria for Category 1, and therefore, additional plant-specific review of these issues is required.

This chapter describes the environmental impacts from postulated accidents that might occur during the license renewal term.

### 5.1 Postulated Plant Accidents

Two classes of accidents are evaluated in the GEIS. These are design-basis accidents (DBAs) and severe accidents, as discussed below.

---

(a) The GEIS was originally issued in 1996. Addendum 1 to the GEIS was issued in 1999. Hereafter, all references to the "GEIS" include the GEIS and Addendum 1.

1 **5.1.1 Design-Basis Accidents**

2  
3 To receive U.S. Nuclear Regulatory Commission (NRC) approval to operate a nuclear power  
4 facility, an applicant for an initial operating license must submit a safety analysis report (SAR)  
5 as part of its application. The SAR presents the design criteria and design information for the  
6 proposed reactor and comprehensive data on the proposed site. The SAR also discusses  
7 various hypothetical accident situations and the safety features that are provided to prevent and  
8 mitigate accidents. The NRC staff reviews the application to determine whether the plant  
9 design meets the Commission's regulations and requirements and includes, in part, the nuclear  
10 plant design and its anticipated response to an accident.

11  
12 DBAs are those accidents that both the licensee and the NRC staff evaluate to ensure that the  
13 plant can withstand normal and abnormal transients and a broad spectrum of postulated  
14 accidents without undue hazard to the health and safety of the public. A number of these  
15 postulated accidents are not expected to occur during the life of the plant, but are evaluated to  
16 establish the design basis for the preventive and mitigative safety systems of the facility. The  
17 acceptance criteria for DBAs are described in 10 CFR Part 50 and 10 CFR Part 100.

18  
19 The environmental impacts of DBAs are evaluated during the initial license process, and the  
20 ability of the plant to withstand these accidents is demonstrated to be acceptable before  
21 issuance of the operating license (OL). The results of these evaluations are found in license  
22 documentation such as the applicant's Final Safety Analysis Report (FSAR), the staff's Safety  
23 Evaluation Report (SER), and the Final Environmental Statement (FES). A licensee is required  
24 to maintain the acceptable design and performance criteria throughout the life of the plant  
25 including any extended-life operation. The consequences for these events are evaluated for  
26 the hypothetical maximum exposed individual; as such, changes in the plant environment will  
27 not affect these evaluations. Because of the requirements that continuous acceptability of the  
28 consequences and aging management programs be in effect for license renewal, the  
29 environmental impacts as calculated for DBAs should not differ significantly from initial licensing  
30 assessments over the life of the plant, including the license renewal period. Accordingly, the  
31 design of the plant relative to DBAs during the extended period is considered to remain  
32 acceptable and the environmental impacts of those accidents were not examined further in the  
33 GEIS.

34  
35 The Commission has determined that the environmental impacts of DBAs are of SMALL  
36 significance for all plants because the plants were designed to successfully withstand these  
37 accidents. Therefore, for the purposes of license renewal, design-basis events are designated  
38 as a Category 1 issue in 10 CFR Part 51, Subpart A, Appendix B, Table B-1. This issue,

1 applicable to St. Lucie Units 1 and 2, is listed in Table 5-1. The early resolution of the DBAs  
 2 makes them a part of the current licensing basis of the plant; the current licensing basis of the  
 3 plant is to be maintained by the licensee under its current license and, therefore, under the  
 4 provisions of 10 CFR 54.30, is not subject to review under license renewal.

5  
 6 **Table 5-1. Category 1 Issue Applicable to Postulated Accidents During the Renewal Term**

7

ISSUE—10 CFR Part 51, Subpart A, Appendix B, Table B-1	GEIS Section
POSTULATED ACCIDENTS	
Design-basis accidents (DBAs)	5.3.2; 5.5.1

8  
 9  
 10  
 11  
 12  
 13 Based on information in the GEIS, the Commission found that

14  
 15 The NRC staff has concluded that the environmental impacts of design basis accidents  
 16 are of small significance for all plants.

17  
 18 Florida Power and Light (FPL) stated in its Environmental Report (ER; FPL 2001) that it is not  
 19 aware of any new and significant information associated with the renewal of the St. Lucie  
 20 Units 1 and 2 OLS. The staff has not identified any significant new information during its  
 21 independent review of the ER (FPL 2001), the staff's site visit, the scoping process, or its  
 22 evaluation of other available information. Therefore, the staff concludes that there are no  
 23 impacts related to design basis accidents beyond those discussed in the GEIS.

24  
 25 **5.1.2 Severe Accidents**

26  
 27 Severe nuclear accidents are those that are more severe than DBAs because they could result  
 28 in substantial damage to the reactor core, whether or not there are serious offsite conse-  
 29 quences. In the GEIS, the staff assessed the impacts of severe accidents during the license  
 30 renewal period, using the results of existing analyses and site-specific information to  
 31 conservatively predict the environmental impacts of severe accidents for each plant during the  
 32 renewal period.

33  
 34 Severe accidents initiated by external phenomena such as tornadoes, floods, earthquakes,  
 35 fires, and sabotage have not traditionally been discussed in quantitative terms in FESs and  
 36 were not specifically considered for the St. Lucie site in the GEIS (NRC 1996). However, in the  
 37 GEIS, the staff did evaluate existing impact assessments performed by NRC and by the  
 38 industry at 44 nuclear plants in the United States and concluded that the risk from sabotage  
 39 and beyond design basis earthquakes at existing nuclear power plants is SMALL. Additionally,  
 40 the staff concluded that the risks from other external events are adequately addressed by a  
 41 generic consideration of internally initiated severe accidents.

## Postulated Accidents

1 Based on information in the GEIS, the Commission found that

2  
3 The probability weighted consequences of atmospheric releases, fallout onto open  
4 bodies of water, releases to groundwater, and societal and economic impacts from  
5 severe accidents are small for all plants. However, alternatives to mitigate severe  
6 accidents must be considered for all plants that have not considered such alternatives.

7  
8 Therefore, the Commission has designated mitigation of severe accidents as a Category 2  
9 issue in 10 CFR Part 51, Subpart A, Appendix B, Table B-1. This issue, applicable to St Lucie  
10 Units 1 and 2, is listed in Table 5-2.

11  
12 **Table 5-2. Category 2 Issue Applicable to Postulated Accidents During the Renewal Term**

13

ISSUE—10 CFR Part 51, Subpart A, Appendix B, Table B-1	GEIS Sections	10 CFR 51.53(c)(3)(ii) Subparagraph	SEIS Section
<b>POSTULATED ACCIDENTS</b>			
Severe Accidents	5.3.3; 5.3.3.2; 5.3.3.3; 5.3.3.4; 5.3.3.5; 5.4; 5.5.2	L	5.2

14  
15  
16  
17

18  
19 The staff has not identified any significant new information with regard to the consequences  
20 from severe accidents during its independent review of the ER (FPL 2001), the staff's site visit,  
21 the scoping process, or its evaluation of other available information. Therefore, the staff  
22 concludes that there are no impacts of severe accidents beyond those discussed in the GEIS.  
23 However, in accordance with 10 CFR 51.53(c)(3)(ii)(L), the staff has reviewed severe accident  
24 mitigation alternatives (SAMAs) for St. Lucie Units 1 and 2. The results of its review are  
25 discussed in Section 5.2.

## 26 27 **5.2 Severe Accident Mitigation Alternatives**

28  
29 10 CFR 51.53(c)(3)(ii)(L) requires that license renewal applicants consider alternatives to  
30 mitigate severe accidents if the staff has not previously evaluated SAMAs for the applicant's  
31 plant in an environmental impact statement (EIS) or related supplement or in an environmental  
32 assessment. The purpose of this consideration is to ensure that plant changes (i.e., hardware,  
33 procedures, and training) with the potential for improving severe accident safety performance  
34 are identified and evaluated. SAMAs have not been previously considered for St. Lucie Units 1  
35 and 2; therefore, the remainder of Chapter 5 addresses those alternatives.

## 5.2.1 Introduction

Florida Power and Light Company (FPL) submitted an assessment of SAMAs for St. Lucie as part of the ER (FPL 2001). This assessment was based on the current St. Lucie Probabilistic Safety Analysis (PSA), a plant-specific offsite consequence analysis performed using the MELCOR Accident Consequence Code System (MACCS), and insights from the St. Lucie Individual Plant Examination of External Events (IPEEE) (FPL 1994). In identifying and evaluating potential SAMAs, FPL considered several SAMA analyses for other plants and advanced light water reactor designs, including Watts Bar, Calvert Cliffs, Oconee, Turkey Point, and CE System 80+, and other documents that discuss potential plant improvements, such as NUREG-1560 (NRC 1997a). FPL identified and evaluated 169 potential SAMA candidates. This list was reduced to 50 unique SAMA candidates by eliminating SAMAs that either were not applicable to St. Lucie or were already implemented at the plant. FPL assessed the costs and benefits associated with each of the potential SAMAs and concluded that none of the candidate SAMAs evaluated would be cost-beneficial for St. Lucie.

Based on a review of the SAMA assessment, the NRC issued a request for additional information (RAI) to FPL by letter dated May 7, 2002 (NRC 2002a). Key questions concerned: differences between the PSA used for the SAMA analysis and earlier risk assessments for St. Lucie, the potential impact of uncertainties and external event initiators on the study results, detailed information on several candidate SAMAs, and the applicability of some SAMAs proposed at another Combustion Engineering plant. FPL submitted additional information on June 25, 2002, in response to the RAIs (FPL 2002a). In these responses, FPL included supplemental tables showing the impacts of uncertainties, risk reduction worth importance measures, results of sensitivity analysis, and additional information on specific SAMAs. FPL provided further information during a teleconference on July 15, 2002, clarifying remaining issues (NRC 2002b). In these responses, FPL provided additional information on its use of importance analysis and cut set information, on regional population projections, and on use of the MAAP code in its consequence assessment. FPL's responses addressed the staff's concerns and reaffirmed that none of the SAMAs would be cost-beneficial.

An assessment of SAMAs for St. Lucie is presented below.

## 5.2.2 Estimate of Risk for St. Lucie Units 1 and 2

FPL's estimates of offsite risk at St. Lucie are summarized in Section 5.2.2.1. The summary is followed by the staff's review of FPL's risk estimates in Section 5.2.2.2.

## Postulated Accidents

### 5.2.2.1 FPL's Risk Estimates

Two distinct analyses are combined to form the basis for the risk estimates used in the SAMA analysis: (1) the St. Lucie Level 1 and 2 PSA model, which is an updated version of the St. Lucie Individual Plant Examination (IPE) (FPL 1993), and (2) a supplemental analysis of offsite consequences and economic impacts (essentially a Level 3 PSA model) developed specifically for the SAMA analysis. The St. Lucie PSA, dated April 2001, is indicated in the ER (FPL 2001) to be more advanced than the St. Lucie IPE submittal of 1993 (FPL 1993) and is considered a "living" plant risk model that reflects periodic updates to incorporate (1) additional data on equipment performance, (2) changes in plant configuration, and (3) PSA model refinements.

The baseline core damage frequencies (CDFs) for the purpose of the SAMA evaluation are approximately  $3.0 \times 10^{-5}$  per reactor-year (ry) and  $2.4 \times 10^{-5}$ /ry for St. Lucie Units 1 and 2, respectively. These CDFs are based on the risk assessment for internally initiated events, including internal floods. These values represent only small changes from the original individual plant evaluation (IPE) CDF values of  $2.3 \times 10^{-5}$ /ry and  $2.6 \times 10^{-5}$ /ry for St. Lucie Units 1 and 2, respectively. Although FPL did not include the contribution of risk from external events within the St. Lucie risk estimates, it did account for the potential risk reduction benefits associated with external events by applying a factor of 2 margin in the SAMA screening process. It is FPL's position that this approach is conservative since the external events contributions to core damage are small relative to the internal events contributions (FPL 2001). This is discussed further in Section 5.2.2.2.

The breakdown of CDFs is provided in Table 5-3. It is noted that the total CDFs in Table 5-3 are slightly different than the total CDFs given above. This is because the values are based on the use of a top event model, which was also used for the purpose of screening SAMAs. The top event model accounts for 95 percent of the CDF for Unit 1 and 99 percent of the CDF for Unit 2. As shown in Table 5-3, containment bypass events (i.e., interfacing system loss-of-coolant accident [ISLOCA] and steam generator tube rupture [SGTR]) contribute about 13 percent and 24 percent to the total internal events CDF for Units 1 and 2, respectively. Transients (including loss-of-offsite power [LOOP] and anticipated transient without scram [ATWS]) contribute about 35 percent and 20 percent, respectively. The contribution of loss-of-coolant accidents (LOCAs) to the total CDFs is large at both plants (29 percent and 32 percent, respectively). The station blackout (SBO) contribution to the transients was not explicitly provided in the submittal; however, in response to a request for additional information (RAI), FPL stated that the LOOP sequences are predominantly SBO sequences (FPL 2002a). The CDFs that were used in the SAMA analysis and that are cited here are best-estimate values.

The uncertainty analysis for the updated PSA indicates 95 percent confidence level (upper) CDF values of  $6.15 \times 10^{-5}/\text{ry}$  and  $6.11 \times 10^{-5}/\text{ry}$  for Units 1 and 2, respectively. The impact of this uncertainty on the SAMA analysis is discussed in Section 5.2.6.2.

**Table 5-3. St. Lucie Core Damage Frequency<sup>(a)</sup>**

Initiating Event	Frequency (per reactor-year)		% Contribution to CDF	
	Unit 1	Unit 2	Unit 1	Unit 2
Loss of Offsite Power (LOOP)/Station Blackout (SBO)	$4.63 \times 10^{-6}$	$2.67 \times 10^{-6}$	16	11
Transients	$4.55 \times 10^{-6}$	$1.84 \times 10^{-6}$	16	8
Anticipated Transient Without Scram (ATWS)	$8.23 \times 10^{-7}$	$3.31 \times 10^{-7}$	3	1
Loss-of-Coolant Accident (LOCA)	$8.22 \times 10^{-6}$	$7.82 \times 10^{-6}$ <sup>(b)</sup>	29	32 <sup>(b)</sup>
Interfacing Systems LOCA (ISLOCA)	$2.89 \times 10^{-6}$	$5.64 \times 10^{-6}$	10	23
Steam Generator Tube Rupture (SGTR)	$9.58 \times 10^{-7}$	$2.78 \times 10^{-7}$	3	1
Internal floods	$5.00 \times 10^{-7}$	$5.00 \times 10^{-7}$	2	2
Others	$6.03 \times 10^{-6}$	$5.22 \times 10^{-6}$ <sup>(b)</sup>	21	22 <sup>(b)</sup>
<b>Total CDFs (from internal events)</b>	<b><math>2.86 \times 10^{-5}</math></b>	<b><math>2.43 \times 10^{-5}</math></b>	<b>100</b>	<b>100</b>

(a) CDF calculated using a single top event model that included all plant damage states and containment bypass sequences.

(b) The LOCA values, originally provided in the FPL RAI responses (FPL 2002a), were in error and subsequently corrected in a communication with NRC (FPL 2002b).

The major difference in the CDFs for St. Lucie Units 1 and 2 is attributed to the following:

- Unit 2 has larger PORVs, thus only one PORV is required for once-through cooling. This is the main reason why Unit 1 has a larger SGTR CDF than Unit 2.
- Unit 2 has a larger capacity Condensate Storage Tank than Unit 1. Thus, Unit 1 has a slightly higher contribution from long-term decay heat removal related scenarios such as transients.
- The Unit 2 shutdown cooling line has one more configuration of an ISLOCA path due to crosstie capability. This increases the ISLOCA frequency for Unit 2.

The CDF results were obtained using two cases for 4.16-kV AB-bus alignment. Case 1 is when the AB-bus is aligned to the A-bus, and Case 2 is when the AB-bus is aligned to the B-bus. FPL states that the SAMA evaluation uses the most conservative cases for the baseline risk model which are Case 2 for Unit 1 and Case 1 for Unit 2 (FPL 2001).

## Postulated Accidents

1 The Level 2 PSA model is based on the containment event tree and source terms from the IPE  
2 (FPL 1993). The conditional probabilities associated with each release category are provided in  
3 Table E.1-1 of the ER (FPL 2001). The fission product release fractions and characteristics for  
4 each release category are provided in Table E.2-1 of the ER.

5  
6 The offsite consequences and economic impact analyses use the MELCOR Accident  
7 Consequence Code System 2 (MACCS2) code, Version 1.12, to determine the offsite risk  
8 impacts on the surrounding environment and public. Inputs for this analysis include plant-  
9 specific and site-specific input values for core radionuclide inventory, source term and release  
10 fractions, meteorological data, projected population distribution, emergency response  
11 evacuation modeling, and economic data.

12  
13 FPL estimated the dose to the population within 80 km (50 mi) of the St. Lucie site to be  
14 approximately 0.15 person-sievert (15 person-rem) per year for Unit 1 and 0.14 person-sievert  
15 (14 person-rem) per year for Unit 2. The breakdown of the total population dose by  
16 containment release mode is summarized in Table 5-4. ISLOCAs dominate the population  
17 dose risk at St. Lucie. The ISLOCAs are followed in contribution by late containment failure.

18  
19 **Table 5-4. Breakdown of Population Dose by Containment Release Mode**

20

Containment Release Mode	Population Dose (Person-Rem <sup>(a)</sup> Per Year)	
	Unit 1	Unit 2
21 SGTR (Late and Early)	0.9	0.1
22 Interfacing Systems LOCAs	8.7	11.3
23 Early containment failure	-0.0	-0.0
24 Late containment failure	5.7	2.6
25 No containment failure	0.0	0.0
26 Total	15.3	14.0

27  
28  
29 (a) One person-Sv = 100 person-rem

### 30 31 5.2.2.2 Review of FPL's Risk Estimates

32  
33 FPL's determination of offsite risk at St. Lucie is based on the following three major elements of  
34 analysis:

- 35
- 36 • the Level 1 and 2 risk models that form the bases for the 1993 IPE and 1994 IPEEE  
37 submittals (FPL 1993,1994).
  - 38 • the major modifications to the IPE model that have been incorporated in the St. Lucie  
39 PSA  
40
- 41

- the MACCS2 analyses performed to translate fission product release frequencies from the Level 2 PSA model into offsite consequence measures.

Each of these analyses was reviewed to determine the acceptability of FPL's risk estimates for the SAMA analysis, as summarized below.

The staff's review of the St. Lucie IPE is described in an NRC report dated July 21, 1997 (NRC 1997b). In that review, the staff evaluated the methodology, models, data, and assumptions used to estimate the CDF and characterize containment performance and fission product releases. The staff concluded that FPL's analysis met the intent of Generic Letter 88-20 (NRC 1988); that is, the IPE was of adequate quality to be used to look for design or operational vulnerabilities. The staff's review primarily focused on the licensee's ability to examine St. Lucie Units 1 and 2 for severe accident vulnerabilities and not specifically on the detailed findings or quantification estimates. Overall, the staff concluded that the St. Lucie IPE was of adequate quality to be used as a tool in searching for areas with high potential for risk reduction and to assess such risk reductions, especially when the risk models are used in conjunction with insights, such as those from risk importance, sensitivity, and uncertainty analyses.

A comparison of risk profiles between the original IPE, which was reviewed by the NRC staff, and the PSA used in the SAMA analysis indicates a small increase in the St. Lucie Unit 1 CDF and small decrease in the St. Lucie Unit 2 CDF. The specific changes to the St. Lucie PSA include (FPL 2001):

- Changed to a "one-top" model rather than solving individual sequences.
- Updated software to allow use of a recovery rule file that allows automatic application of recovery rules consistently to every appropriate cut set.
- Refined common-cause failure modeling by the use of a basic event for common causes only. The original model normally used an "A" train event with the common-cause factor. This practice overemphasized the importance of the "A" train components, because all common-cause failures were tied to "A" (and none to "B" train components).
- Added test and maintenance basic events for various components as further improvements to the model.
- Improved treatment of reactor coolant pump (RCP) seal failures depending on operator action or failure to act per the latest Combustion Engineering Owners Group (CEOG) information.

## Postulated Accidents

- 1 • Updated LOCA and Main Steam Line Break initiating event frequencies per the latest  
2 CEOG methodologies.
- 3
- 4 • Updated the Unit 2 ISLOCA analysis to reflect a Unit 2 design change. This change  
5 increased the calculated probability of ISLOCA while reducing the probability of pressure  
6 locking of the shutdown cooling isolation valves (which would prevent the use of  
7 shutdown cooling).
- 8

9 The changes from the IPE version to the current April 2001 version appear to be reasonable  
10 and have a relatively small effect on PSA results.

11

12 In an RAI, the staff questioned whether the current St. Lucie PSA has been subjected to peer  
13 review (NRC 2002a). In response to the RAI, FPL noted that the PSA conforms to the FPL  
14 Quality Assurance Program procedures and the FPL Reliability and Risk Assessment Group  
15 standards. Further, the Level 1 model was compared to the CEOG plants via the CEOG PSA  
16 subcommittee cross comparison project (FPL 2002a). While these activities do not constitute a  
17 thorough external peer review, they do enhance the quality of a PSA.

18

19 The IPE and updated CDF values for the two FPL units are lower than most of the original IPE  
20 values estimated for other pressurized water reactors (PWRs) with a large dry containment.  
21 Figure 11.6 of NUREG-1560 shows that the IPE-based total internal events CDF for CE plants  
22 ranges from  $1 \times 10^{-5}$  to  $3 \times 10^{-4}/\text{ry}$  (NRC 1997a). While it is recognized that other plants have  
23 reduced the values for CDF subsequent to the IPE submittals, due to modeling and hardware  
24 changes, the CDF results for St. Lucie confirm that the overall risks from these units are lower  
25 than or comparable to other plants of similar vintage and characteristics.

26

27 FPL submitted an IPEEE by letter dated December 15, 1994 (FPL 1994), in response to  
28 Supplement 4 of Generic Letter 88-20 (NRC 1999). FPL did not identify any fundamental  
29 weaknesses or vulnerabilities to severe accident risk in regard to the external events related to  
30 seismic, fire, or other external events. The St. Lucie hurricane, tornado, and high winds  
31 analyses show that the plant is adequately designed or procedures exist to cope against the  
32 effects of these natural events. Additionally, the St. Lucie IPEEE demonstrated that  
33 transportation and nearby facility accidents were not considered to be significant vulnerabilities  
34 at the plant. However, a number of areas were identified for improvement in both the seismic  
35 and fire areas. In a letter dated January 25, 1999 (NRC 1999), the staff concluded that the  
36 submittal met the intent of Supplement 4 to Generic Letter 88-20, and that the licensee's IPEEE  
37 process is capable of identifying the most likely severe accidents and severe accident  
38 vulnerabilities.

39

40 The ER (FPL 2001) acknowledges that the methods used for the St. Lucie IPEEE do not  
41 provide the means to determine the numerical estimates of the CDF contributions from seismic

1 initiators (i.e., the seismic IPEEE uses a reduced scope margins method emphasizing plant  
2 walkdown) and fire initiators (i.e., the fire IPEEE uses the Fire Vulnerability Evaluation method).  
3 However, the risk associated with external events at St. Lucie is very low. The IPEEE fire CDF  
4 estimates are considered by FPL to be extremely conservative and overestimate the fire risk for  
5 screening purposes (FPL 2001). FPL states in the ER that recent preparatory work in support  
6 of OL amendments to extend the Allowed Outage Time (AOT) for Emergency Diesel  
7 Generators (EDGs) has refined and revised the fire risk estimates for the cable spreading  
8 rooms and the control rooms, and the current estimates are now about two orders of magnitude  
9 lower than reported in the original St. Lucie IPEEE (FPL 1994). Furthermore, as part of the OL  
10 amendment, FPL committed to perform several actions that would ensure low risk due to  
11 external and internal fire events for each unit if an EDG is to be removed from service for  
12 maintenance for an extended AOT (i.e., more than 72 hours) during Modes 1, 2, and 3. In  
13 addition, the submittal states that improvements continue to be made in St. Lucie Units 1 and 2  
14 fire protection features as a result of ongoing (10 CFR 50) Appendix R evaluations.  
15 Accordingly, the staff finds that the FPL fire assessment is adequate for the purpose of the  
16 SAMA review and that the fire vulnerabilities at St. Lucie are not major contributors to plant risk.  
17

18 Because of the small expected contribution of external events to the overall risk profile for  
19 St. Lucie, the risk reduction estimates for the SAMAs were evaluated based on consideration of  
20 the internal events risk profile. However, in the SAMA screening process described in  
21 Section 5.2.3.1, FPL screened out SAMAs from further consideration only if their  
22 implementation cost would be much greater than twice the estimated benefit (based on internal  
23 events). This provides a factor of two margin in the analysis. The contribution of external  
24 events to total risk would be bounded by this factor of two if (1) the total contribution from  
25 external events is a small fraction of the contribution from internal events, and (2) there are no  
26 external event vulnerabilities that can be eliminated or mitigated by cost-effective SAMAs. FPL  
27 presents an adequate case that the external risk contribution is relatively small. FPL also states  
28 that a search for SAMAs yielded no SAMA that would provide redundancy to plant safe  
29 shutdown capabilities in order to reduce the external event contribution. Accordingly, the staff  
30 concludes that FPL's consideration of external events within the SAMA analysis is acceptable.  
31

32 The staff reviewed the process used by FPL to extend the containment performance (Level 2)  
33 portion of the PSA to an assessment of offsite consequences (essentially a Level 3 PSA). This  
34 included consideration of the source terms used to characterize fission product releases for  
35 each containment release category and the major input assumptions used in the offsite  
36 consequence analyses. The MACCS2 code was used to estimate offsite consequences.  
37 Plant-specific input to the code includes the St. Lucie reactor core radionuclide inventory,  
38 emergency evacuation modeling, release category source terms from the St. Lucie IPE, site-  
39 specific meteorological data, and projected population distribution within a 80-km (50-mi) radius  
40 for the year 2025. This information is provided in Appendix E.2 of the ER (FPL 2001).  
41

## Postulated Accidents

1 The applicant used source term release fractions for 48 different release modes defined for the St.  
2 Lucie site. Forty-five of the release modes were previously identified in the St. Lucie IPE. Three  
3 additional containment bypass release modes were added – two SGTR cases and one ISLOCA  
4 case. The staff reviewed FPL's source term estimates for the major release categories and, with  
5 the exception of SGTR noted below, found the release fractions to be consistent with those of like  
6 plants and of expected magnitudes when considering early versus late containment failures and  
7 rupture versus leak-type failures. The staff questioned FPL regarding the release fractions for  
8 SGTR events, which were relatively low and did not include tellurium releases (NRC 2002a). FPL  
9 indicated that large amounts of radionuclides (including all tellurium) are retained in the intact  
10 containment after vessel failure, thus mitigating release to the environment (FPL 2002a). The staff  
11 finds this explanation to be reasonable, and further notes that since the SGTR contribution to CDF  
12 is relatively low for St. Lucie (3 percent for Unit 1 and 1 percent for Unit 2), higher release fractions  
13 for the SGTR sequences than those estimated by FPL would not have a significant impact on the  
14 plant risk. The staff concludes that the assignment of source terms is acceptable for use in the  
15 SAMA analysis.

16  
17 The applicant used site-specific meteorological data processed from hourly measurements for the  
18 1999 calendar year as input to the MACCS2 code. Supplementary information derived from  
19 meteorological data obtained from the National Climatic Data Center of the National  
20 Oceanographic and Atmospheric Administration (NOAA) for Vero Beach Airport was used where  
21 data were missing in the source file. A sensitivity analysis was performed using meteorological  
22 data from 1998. The impact on population dose was a 10 percent decrease. Therefore, the staff  
23 considers use of the 1999 data in the base case to be conservative.

24  
25 The population distribution the applicant used as input to the MACCS2 analysis was initially  
26 prepared using the computer program SECPOP90 (NRC 1997c). The output from SECPOP90 is a  
27 file based on a reference database for the specified site. The applicant extrapolated population  
28 projections from the years 1990 and 2015 to year 2025 using the U.S. Census Bureau (USCB)  
29 data. The MACCS2 calculations were based on the population in year 2025 because 2025 was the  
30 latest data produced by the USCB and because 2025 is the midterm year for the Unit 1 license  
31 renewal period. It is noted that the midterm year for the license renewal period for Unit 2 would be  
32 2033. If a year later than 2025 were used, it is expected that the population dose would increase  
33 proportionately with the projected increase in population. Based on information provided in Section  
34 2.5 of the ER, the population in two areas surrounding the plant is expected to increase at an  
35 average rate of 1.5 percent per year. If the year 2033 was chosen for the population projection, an  
36 increase in the population (over the base case year 2025 population dose) of approximately 13  
37 percent would be expected. The applicant, in Section E.2.4.2 of the ER (FPL 2001), presents  
38 sensitivity analyses that show a 2.5 percent and 10 percent increase in population results in  
39 approximately a 3 percent and 11 percent increase in the population dose. Thus, the population  
40 dose estimates for Unit 2 would be approximately 15 percent higher if the dose estimates were  
41 based on the population in 2033 rather than 2025. FPL pointed out that other conservative aspects

1 of the analysis more than account for this non-conservatism (NRC 2002b). This relatively small  
2 non-conservatism notwithstanding, the staff considers the methods and assumptions for estimating  
3 population reasonable and acceptable for purposes of the SAMA evaluation.  
4

5 The emergency evacuation model was modeled as a single evacuation zone extending out 16 km  
6 (10 mi) from the plant. It was assumed that 100 percent of the population would move at an  
7 average speed of approximately 1.8 m/s (6 ft/s) with a delayed start time of 7,200 seconds with no  
8 sheltering. The results of a sensitivity analysis presented in Section E.2.4.2 of the ER (FPL 2001)  
9 show that if only 95 percent of the people within the evacuation zone would participate in the  
10 evacuation, there would be only about a 1 percent increase in population dose. This assumption is  
11 conservative relative to the NUREG-1150 study (NRC 1990), which assumed evacuation of  
12 99.5 percent of the population within the emergency planning zone. Additionally, a sensitivity  
13 analysis was performed in which the evacuation speed was reduced to approximately 0.3 m/s  
14 (1 ft/s). This resulted in an increase in population dose of about 2 percent. Accordingly, the  
15 evacuation assumptions and analysis are deemed reasonable and acceptable for the purposes of  
16 the SAMA evaluation.  
17

18 Much of the site-specific economic data were provided by SECPOP90 (NRC 1997c) and used in  
19 the MACCS2 analyses. SECPOP90 contains a database extracted from USCB CD-ROMs (1990  
20 census data), the 1992 Census of Agriculture CD-ROM Series 1B, the 1994 U.S. Census County  
21 and City Data Book CD-ROM, the 1993 and 1994 Statistical Abstract of the United States, and  
22 other minor sources. These regional economic values were updated to 1999 for nine Florida  
23 counties within 80 km (50 mi) of the plant. The staff questioned whether FPL made any  
24 adjustments to the analysis to account for higher economic areas in the vicinity of the plant such as  
25 resorts (NRC 2002a). In response, FPL stated that the site file prepared for St. Lucie contained  
26 updated values (from 1999) for each county including contributions from resort areas (FPL 2002a).  
27

28 The staff concludes that the methodology used by FPL to estimate the CDF and offsite  
29 consequences for St. Lucie provides an acceptable basis from which to proceed with an  
30 assessment of risk reduction potential for candidate SAMAs. Accordingly, the staff based its  
31 assessment of offsite risk on the CDF and offsite doses reported by FPL.  
32

### 33 **5.2.3 Potential Design Improvements**

34  
35 The process for identifying potential plant improvements, an evaluation of that process, and the  
36 improvements evaluated in detail by FPL are discussed in this section.  
37

#### 38 **5.2.3.1 Process for Identifying Potential Design Improvements**

39  
40 FPL's process for identifying potential plant improvements (SAMAs) consisted of the following  
41 elements:  
42

## Postulated Accidents

- 1 • review of plant-specific improvements identified in the St. Lucie Units 1 and 2 IPE and  
2 IPEEE
- 3
- 4 • review of SAMA analyses submitted in support of original licensing and license renewal  
5 activities for other operating nuclear power plants
- 6
- 7 • review of other NRC and industry documentation discussing potential plant  
8 improvements, e.g., NUREG-1560 (NRC 1997a), and review of the top 100 cut sets of  
9 the updated Level 1 PSA.

10  
11 Based on this process, an initial list of 169 candidate SAMAs was identified, as reported in  
12 Table E.3-1 in Appendix E to the ER (FPL 2001).

13  
14 FPL performed a qualitative screening of the initial list of SAMAs. SAMAs were eliminated  
15 from further consideration at St. Lucie if the SAMA enhancement was for a boiling water  
16 reactor, the Westinghouse AP600 design, an ice condenser containment, or for a plant-specific  
17 application not applicable to St. Lucie. SAMAs were also eliminated from further consideration  
18 if the SAMA had already been implemented at St. Lucie or the plant design meets the intent of  
19 the SAMA.

20  
21 Based on the qualitative screening, 119 SAMAs were eliminated leaving 50 for further  
22 evaluation. Of the 119 SAMAs, 29 were eliminated because they were not applicable to St.  
23 Lucie, and 90 were eliminated because they already had been implemented at St. Lucie (or the  
24 design met the intent of the SAMA). The 50 remaining SAMAs are listed in Table 4.15-2 of the  
25 ER (FPL 2001) and were subjected to a final screening and evaluation process.

26  
27 The final screening process was conducted in two steps: (1) identifying and eliminating those  
28 SAMAs whose cost exceeded the maximum attainable benefit (MAB) approximated at  
29 \$1,382,000, and (2) performing a benefits analysis on the remaining SAMAs. Of the 50  
30 SAMAs, 29 were screened from further evaluation because the SAMA was estimated to have a  
31 single unit cost of implementation that exceeded the MAB of \$1,382,000. Each of the 21  
32 remaining SAMAs was further evaluated and subsequently eliminated, as described in Sections  
33 5.2.4 and 5.2.6 below.

### 34 35 **5.2.3.2 Staff Evaluation**

36  
37 FPL's efforts to identify potential SAMAs focused primarily on areas associated with internal  
38 initiating events. The initial list of SAMAs generally addressed the accident categories that are  
39 dominant CDF contributors or issues that tend to have a large impact on a number of accident  
40 sequences at St. Lucie Units 1 and 2.

1 The preliminary review of FPL's SAMA identification process raised some concerns regarding  
2 the completeness of the set of SAMAs identified and the inclusion of plant-specific risk  
3 contributors. The staff also requested specific information about several of the final SAMA  
4 candidates. The staff requested clarification regarding the portion of risk represented by the  
5 top 100 cut sets and whether an importance analysis was used to confirm the adequacy of the  
6 SAMA identification process. A review of the importance ranking of basic events in the PSA  
7 has the potential to identify SAMAs that may not be apparent from a review of the top cut sets.  
8 In response to the RAI, FPL stated that the top 100 cut sets examined account for about  
9 55 percent of the CDF for Unit 1 and about 68 percent of the CDF for Unit 2 (FPL 2002a). In a  
10 follow-up teleconference, FPL clarified that although it did not specifically use the importance  
11 measures (risk reduction worth [RRW]) to identify potential SAMAs, it performed a  
12 supplementary review of the importance measures, which did not reveal any new SAMAs. FPL  
13 indicated that the risk significant basic events are contained in the top 100 cut sets, particularly  
14 SGTR and ISLOCA.

15  
16 The staff questioned FPL about considering lower cost alternatives to a couple of the SAMAs  
17 evaluated (NRC 2002a). In response to the RAI, FPL stated that either the design and  
18 modification costs for "lower cost alternatives" were prohibitive or the reduction in risk was  
19 insufficient to warrant the implementation (FPL 2002a). The staff also questioned FPL about  
20 six SAMAs that were proposed at another Combustion Engineering plant and whether those  
21 SAMAs might be applicable to St. Lucie (NRC 2002a). In response to the RAI, FPL noted that  
22 four of the six planned SAMAs were related to SBO or LOOP. These SAMAs would provide  
23 less risk reduction benefit for St. Lucie because St. Lucie is equipped with four EDGs and has  
24 cross-tie capability. As for the other two planned SAMAs, one is already addressed by the  
25 St. Lucie emergency operating procedures network, and the other involving an improvement to  
26 refueling water tank level indication is not applicable because the recirculation actuation system  
27 at St. Lucie does not depend on instrument air.

28  
29 The staff notes that the set of SAMAs submitted is not all-inclusive, since additional, possibly  
30 even less expensive, design alternatives can always be postulated. However, the staff  
31 concludes that the benefits of any additional modifications are unlikely to exceed the benefits of  
32 the modifications evaluated and that the alternative improvements would not likely cost less  
33 than the least expensive alternatives evaluated, when the subsidiary costs associated with  
34 maintenance, procedures, and training are considered.

35  
36 The staff concludes that FPL used a systematic and comprehensive process for identifying  
37 potential plant improvements for St. Lucie Units 1 and 2. While explicit treatment of external  
38 events in the SAMA identification process was limited, it is recognized that the absence of  
39 external event vulnerabilities reasonably justifies examining primarily the internal events risk  
40 results for this purpose.

41

1           **5.2.3.3 Risk Reduction Potential of Design Improvements**

2  
3 FPL evaluated the risk-reduction potential of the 21 remaining SAMA candidates that were  
4 applicable to St. Lucie. Each SAMA evaluation was performed in a bounding fashion in that the  
5 SAMA was assumed to completely eliminate the risk associated with the proposed  
6 enhancement. Such bounding calculations overestimate the benefit and are conservative. FPL  
7 used two types of evaluations to determine the benefit of the SAMAs – model re-quantification  
8 and importance measure analysis. Some of the SAMAs were evaluated by making simple  
9 bounding changes to one or more system models and re-quantifying the full model. Some of  
10 the SAMAs were more quickly evaluated by examining importance measures such as RRW. In  
11 such cases, it was assumed that the benefit is approximately proportional to the reduction in  
12 CDF.

13  
14 For many of the SAMAs, the CDF reduction was estimated from a model (referred to as PDS  
15 TOP), which used a single top event that included all plant damage states (PDSs) and  
16 containment bypass sequences. This resulted in a manageable number of cut sets and  
17 accounted for about 95 percent of the total baseline CDF for Unit 1 and about 99 percent of the  
18 total baseline CDF for Unit 2. For specific cases such as SGTR and ISLOCA, full-risk model  
19 cases were used.

20  
21 Seven SAMA evaluation scenarios were developed to accomplish this effort (Cases 1 through 4  
22 plus three cases addressing elimination of ISLOCA, SGTR, and high-pressure safety injection  
23 failures). Each of the 21 SAMAs were binned into one of the seven scenarios. (Note that  
24 although Case 2 was defined and quantified, all of the SAMAs applicable to this case were  
25 screened out prior to the final evaluation. Thus, none of the 21 SAMAs were assigned to this  
26 case). Table 5-5 lists the evaluation scenario performed to estimate the risk reduction for each  
27 of the 21 SAMAs, the estimated risk reduction in terms of percent-reduction in CDF and person  
28 dose, and the estimated total benefit (present value) of the averted risk. The determination of  
29 the benefits for the various SAMAs is discussed in Section 5.2.6.

30  
31 In response to an RAI, FPL considered the uncertainties associated with the calculated CDF,  
32 and it was found that if the 95<sup>th</sup> percentile value of the CDF were to be used in the cost-benefit  
33 analysis, instead of the best-estimate CDF value, the benefits would be about a factor of  
34 2 greater. This matter is considered further in Section 5.2.6.2.

35  
36 The staff has reviewed FPL's bases for calculating the risk reduction for the various plant  
37 improvements and concludes that the rationale and assumptions for estimating risk reduction  
38 are reasonable and generally conservative (i.e., the estimated risk reduction is higher than what  
39 would actually be realized). Accordingly, the staff based its estimates of averted risk for the  
40 various SAMAs on FPL's risk-reduction estimates.

1  
2  
3  
4  
5  
6  
7  
8  
9  
10  
11  
12  
13  
14  
15  
16  
17  
18  
19  
20  
21  
22  
23  
24  
25  
26  
27

October 2002

5-17

NUREG-1437, Supplement 11

**Table 5-5. SAMA Cost/Benefit Screening Analysis**

Evaluation Scenario and Applicable SAMAs	Assumptions	% Risk Reduction (Unit 1/Unit2)		Total Benefit (Unit 1/Unit2)	Cost (2001 dollars)
		CDF	Population Dose		
<b>Case 1</b> 48-Install a passive containment spray system (CSS)	The containment spray system will be perfectly reliable, thus eliminating those PDSs representing loss of sprays. The logic for CSS injection and recirculation is removed from the fault tree.	0.2 / 0.2	22 / 13	200,400 / 112,200	\$20M
<b>Case 2</b> None	The reactor coolant pump (RCP) seal LOCA does not occur, and the operator does not fail to secure the RCPs. A few logic changes are imposed on the baseline model.	14 / 19	6 / 8	129,700 / 145,700	
<b>Case 3</b> 123-Upgrade chemical and volume control system (CVCS) to mitigate small-small loss-of-coolant accident (LOCA)	Small-small LOCA does not occur. A few logic changes are imposed on the baseline model.	23 / 27	11 / 12	225,300 / 216,600	>>2 x Benefit
<b>Case 4</b> 8-Eliminate RCP thermal barrier dependence on component cooling water (CCW) such that a loss of CCW does not result directly in core damage 10-Create an Independent RCP seal injection system, with dedicated diesel 11-Create an Independent RCP seal injection system without dedicated diesel 12-Use existing hydro test pump for RCP seal injection 16-Prevent charging pump flow diversion from the relief valves	The RCP seal LOCA does not occur. A few logic changes are imposed on the baseline model.	5 / 6	2 / 3	44,300 / 50,100	8 - >>2 x Benefit  10 - >>2 x Benefit 11 - >>2 x Benefit 12 - >>2 x Benefit 16 - >>2 x Benefit

Postulated Accidents

Evaluation Scenario and Applicable SAMAs	Assumptions	% Risk Reduction (Unit 1/Unit 2)		Total Benefit (Unit 1/Unit2)	Cost (2001 dollars)
		CDF	Population Dose		
<b>No ISLOCA</b> 89-Install additional instrumentation for interfacing systems LOCA (ISLOCA) sequences 90-Increase frequency of valve leak testing 95-Ensure all ISLOCA releases are scrubbed 96-Add redundant and diverse limit switch to each containment isolation valve 159-Provide auxiliary building (AB) vent/seal structure 160-Add charcoal filters on the AB exhaust	ISLOCA will be eliminated. PDSs that represent ISLOCA are set to zero to represent the impact of eliminating the event	10 / 23	26 / 55	251,500 / 487,400	89 - \$2.3M 90 - >>2 x Benefit 95 - >>2 x Benefit 96 - >>2 x Benefit 159 - >>2 x Benefit 160 - >>2 x Benefit
<b>No SGTR</b> 80-Improve instrumentation to detect SGTR, or add systems to scrub fission product releases 81-Add other SGTR coping features 82-Increase secondary-side pressure capacity such that an SGTR would not cause the relief valves to lift 83-Replace steam generators (SGs) with new design 85-Establish a maintenance practice that inspects 100% of the tubes in an SG	All SGTRs will be eliminated. PDSs that represent SGTR (i.e , SGTR1 and SGTR2) are set to zero.	4 / 1	14 / 2	111,300 / 12,600	80 - \$9.5M 81 - >>2 x Benefit 82 - >>2 x Benefit 83 - \$100M 85 - \$500K - \$750K per inspection
<b>HPSI</b> 13-Replace emergency core cooling system pump motors with air-cooled motors 117-Provide an additional high-pressure safety injection (HPSI) pump with independent diesel 118-Install an independent alternating current (AC) HPSI system	Eliminate HPSI failures	18 / 20	18 / 20	249,100 / 242,400	13 - >>2 x Benefit 117 - >>2 x Benefit 118 - >>2 x Benefit

October 2002

5-18

NUREG-1437, Supplement 11

1  
2  
3  
4  
5  
6  
7  
8  
9  
10  
11  
12  
13  
14  
15  
16  
17  
18  
19  
20  
21  
22  
23  
24  
25  
26  
27  
28  
29  
30  
31  
32  
33  
34  
35  
36  
37

#### 1           **5.2.3.4 Cost Impacts of Candidate Design Improvements**

2  
3 FPL estimated the costs of implementing the 50 SAMAs, which were not initially screened out,  
4 through the application of engineering judgment, estimates from other licensees' submittals, and  
5 site-specific cost estimates. The cost estimates conservatively did not include the cost of  
6 replacement power during extended outages required to implement the modifications, nor did  
7 they include contingency costs associated with unforeseen implementation obstacles.  
8 Estimates based on modifications implemented or estimated in the past were presented in terms  
9 of dollar values at the time of implementation and were not adjusted to present-day dollars. The  
10 depth of analysis performed varied depending on the magnitude of the expected benefit. For  
11 most of the SAMAs considered, the cost estimates were sufficiently greater than the benefits  
12 calculated such that no detailed evaluation was required. Detailed cost estimating was only  
13 applied in those situations in which the benefit is significant and application of judgment would  
14 be questioned. The minimum cost of making a procedural change (including training) was  
15 estimated at \$30,000. The minimum hardware modification package was assumed to be  
16 \$70,000.  
17

18 The staff reviewed the bases for the applicant's cost estimates. For certain improvements, the  
19 staff also compared the cost estimates (presented in Table 4.15-2 of the ER) to estimates  
20 developed elsewhere for similar improvements, including estimates developed as part of other  
21 licensees' analyses of SAMAs for operating reactors and advanced light-water reactors. A  
22 majority of the SAMAs were screened from further consideration on the basis that the expected  
23 implementation cost would be much greater than twice the estimated risk-reduction benefit.  
24 This is reasonable for the SAMAs considered given the relatively small estimated benefit for the  
25 SAMAs (a maximum benefit of about \$250,000), and the large implementation costs typically  
26 associated with major hardware changes and hardware changes that impact safety-related  
27 systems. In previous SAMA evaluations the implementation costs for such hardware changes  
28 were generally estimated to be \$1 million or more. Where specific cost estimates were provided  
29 in the ER (FPL 2001), these were typically obtained from previous licensees' ERs or from other  
30 industry submittals, most of which have been previously reviewed by the NRC. Accordingly, the  
31 cost estimates were found to be consistent with previous estimates. The staff concludes that  
32 the cost estimates are sufficient and appropriate for use in the SAMA evaluation.  
33

#### 34           **5.2.4 Cost-Benefit Comparison**

35  
36 FPL's cost-benefit analysis and the staff's review are described in the following sections.

## Postulated Accidents

### • FPL Evaluation

The methodology used by FPL was based primarily on NRC's guidance for performing cost-benefit analysis, i.e., NUREG/BR-0184, *Regulatory Analysis Technical Evaluation Handbook* (NRC 1997d). The guidance involves determining the net value for each SAMA according to the following formula:

$$\text{Net Value} = (\text{APE} + \text{AOC} + \text{AOE} + \text{AOSC}) - \text{COE}$$

where,

APE	= present value of averted public exposure (\$)
AOC	= present value of averted offsite property damage costs (\$)
AOE	= present value of averted occupational exposure costs (\$)
AOSC	= present value of averted onsite costs (\$)
COE	= cost of enhancement (\$)

If the net value of a SAMA is negative, the cost of implementing the SAMA is larger than the benefit associated with the SAMA and it is not considered cost beneficial. FPL's derivation of each of the associated costs is summarized below.

#### Averted Public Exposure (APE) Costs

The APE costs were calculated using the following formula:

$$\begin{aligned} \text{APE} = & \text{Annual reduction in public exposure } (\Delta \text{person-rem/ry}) \\ & \times \text{monetary equivalent of unit dose } (\$2,000 \text{ per person-rem}) \\ & \times \text{present value conversion factor } (10.76 \text{ based on a 20-year period with a 7-percent} \\ & \text{discount rate}). \end{aligned}$$

As stated in NUREG/BR-0184 (NRC 1997d), it is important to note that the monetary value of the public health risk after discounting does not represent the expected reduction in public health risk due to a single accident. Rather, it is the present value of a stream of potential losses extending over the remaining lifetime (in this case, the renewal period) of the facility. Thus, it reflects the expected annual loss due to a single accident, the possibility that such an accident could occur at any time over the renewal period, and the effect of discounting these potential future losses to present value. For the purposes of initial screening, FPL calculated an APE of approximately \$330,000 for the 20-year license renewal period, which assumes elimination of all severe accidents.

1 Averted Offsite Property Damage Costs (AOC)

2  
3 The AOCs were calculated using the following formula:

4  
5 
$$\text{AOC} = \text{Annual CDF reduction}$$

6 
$$\quad \times \text{offsite economic costs associated with a severe accident (on a per-event basis)}$$

7 
$$\quad \times \text{present value conversion factor.}$$

8  
9 For the purposes of initial screening which assumes all severe accidents are eliminated, FPL  
10 calculated an annual offsite economic risk of \$42,542 based on the Level 3 risk analysis. This  
11 results in a discounted value of approximately \$458,000 for the 20-year license renewal period.

12  
13 Averted Occupational Exposure (AOE) Costs

14  
15 The AOE costs were calculated using the following formula:

16  
17 
$$\text{AOE} = \text{Annual CDF reduction}$$

18 
$$\quad \times \text{occupational exposure per core damage event}$$

19 
$$\quad \times \text{monetary equivalent of unit dose}$$

20 
$$\quad \times \text{present value conversion factor.}$$

21  
22 FPL derived the values for averted occupational exposure from information provided in  
23 Section 5.7.3 of the regulatory analysis handbook (NRC 1997a). Best estimate values provided  
24 for immediate occupational dose (3300 person-rem) and long-term occupational dose  
25 (20,000 person-rem over a 10-year cleanup period) were used. The present value of these  
26 doses was calculated using the equations provided in the handbook in conjunction with a  
27 monetary equivalent of unit dose of \$2,000 per person-rem, a real discount rate of 7 percent,  
28 and a time period of 20 years to represent the license renewal period. For the purposes of initial  
29 screening, which assumes all severe accidents are eliminated, FPL calculated an AOE of  
30 approximately \$11,400 for the 20-year license renewal period.

31  
32 Averted Onsite Costs (AOSC)

33  
34 Averted onsite costs (AOSC) include averted cleanup and decontamination costs and averted  
35 power replacement costs. Repair and refurbishment costs are considered for recoverable  
36 accidents only and not for severe accidents. FPL derived the values for AOSC based on  
37 information provided in Section 5.7.6 of the regulatory analysis handbook (NRC 1997a).

38  
39 FPL divided this cost element into two parts – the onsite cleanup and decontamination costs,  
40 also commonly referred to as averted cleanup and decontamination costs, and the replacement  
41 power cost.

## Postulated Accidents

1 Averted cleanup and decontamination costs (ACCs) were calculated using the following formula:  
2

$$\begin{aligned} 3 \quad \text{ACC} &= \text{Annual CDF reduction} \\ 4 \quad &\quad \times \text{present value of cleanup costs per core damage event} \\ 5 \quad &\quad \times \text{present value conversion factor.} \end{aligned}$$

6

7 The total cost of cleanup and decontamination subsequent to a severe accident is estimated in  
8 the regulatory analysis handbook to be \$1.5 billion (undiscounted). This value was converted to  
9 present costs over a 10-year cleanup period and integrated over the term of the proposed  
10 license extension. For the purposes of initial screening, which assumes all severe accidents are  
11 eliminated, FPL calculated an ACC of approximately \$347,000 for the 20-year license renewal  
12 period.  
13

14 Long-term replacement power costs (RPCs) were calculated using the following formula:  
15

$$\begin{aligned} 16 \quad \text{RPC} &= \text{Annual CDF reduction} \\ 17 \quad &\quad \times \text{present value of replacement power for a single event} \\ 18 \quad &\quad \times \text{factor to account for remaining service years for which replacement power is} \\ 19 \quad &\quad \text{required} \\ 20 \quad &\quad \times \text{reactor power scaling factor.} \end{aligned}$$

21

22 For conservatism, FPL based its calculations on the 910-MWe reference plant in NUREG/BR-  
23 0184, and did not scale down for the 800-MWe output of St. Lucie. For the purposes of initial  
24 screening, which assumes all severe accidents are eliminated, FPL calculated an RPC of  
25 approximately \$236,000 for the 20-year license renewal period.  
26

27 Using the above equations, FPL estimated the total present dollar value equivalent associated  
28 with completely eliminating severe accidents at St. Lucie to be about \$1,382,000 for each unit.  
29

### 30 FPL's Results

31

32 If the single unit implementation costs were greater than the MAB of \$1.38 million, then the  
33 SAMA was screened from further consideration. Twenty-nine SAMAs were screened from  
34 further consideration in this way. A more refined look at the costs and benefits was performed  
35 for the remaining 21 SAMAs. If the expected cost for one of the 21 SAMAs exceeded twice the  
36 calculated benefit, the SAMA was considered not to be cost-beneficial. The cost-benefit results  
37 for the individual analysis of the 21 SAMA candidates are presented in Table 5-5. As a result,  
38 all 50 SAMAs that were evaluated were eliminated because the cost was expected to exceed  
39 the estimated benefit.  
40

1 FPL performed sensitivity analyses to evaluate the impact of parameter choices on the analysis  
 2 results (FPL 2001, 2002a). The sensitivity analyses included the calculation of candidate SAMA  
 3 benefits using a 3-percent discount rate as recommended in NUREG/BR-0184 (NRC 1997b).  
 4 This sensitivity case resulted in less than a factor of 1.4 increase in the benefit calculation.  
 5 Thus, the FPL conclusion that none of the candidate SAMAs would be cost-beneficial remains  
 6 unchanged.

7  
 8 • **Staff Evaluation**

9  
 10 The cost-benefit analysis performed by FPL was based primarily on NUREG/BR-0184  
 11 (NRC 1997a) and was executed appropriately.

12  
 13 In response to an RAI, FPL considered the uncertainties associated with the calculated CDF  
 14 (see Table 5-6 below). The uncertainty values provided are for "parameter value" uncertainties.  
 15 The calculated CDF used for the uncertainty analysis is based on the PDS TOP model whereby  
 16 approximately 95 percent (99 percent for Unit 2) of the baseline CDF is captured. The best-  
 17 estimate CDFs calculated using the PDS TOP model are  $2.86 \times 10^{-5}/\text{ry}$  and  $2.43 \times 10^{-5}/\text{ry}$  for  
 18 Units 1 and 2, respectively. If the 95<sup>th</sup> percentile values of the CDF were used in the cost-  
 19 benefit analysis instead of the best-estimate CDF values cited above, the estimated benefits of  
 20 the SAMAs would increase by about a factor of two. However, a more detailed examination by  
 21 FPL found that the initial conclusion (that none of the candidate SAMAs evaluated would be cost  
 22 beneficial for St. Lucie) would still be valid (FPL 2002a).

23  
 24  
 25 **Table 5.6. Uncertainty in the Calculated CDF for St. Lucie Units 1 and 2**

CDF (per reactor-year)		
Percentile	Unit 1	Unit 2
5th	$8.21 \times 10^{-6}$	$9.64 \times 10^{-6}$
50th	$1.52 \times 10^{-5}$	$1.73 \times 10^{-5}$
95th	$6.15 \times 10^{-5}$	$6.11 \times 10^{-5}$

26  
 27  
 28  
 29  
 30  
 31  
 32 In addition, FPL performed sensitivity analyses to address assumptions made in other parts of  
 33 the cost-benefit analysis, including variations in discount rate, weather, percent of population  
 34 evacuating, evacuation speed, population, and source terms. None of these parametric  
 35 variations were found to have a significant impact on results.

36  
 37 The staff concludes that the costs of the 50 candidate SAMAs assessed would be higher than  
 38 the associated benefits. This conclusion is upheld despite a number of uncertainties and non-  
 39 quantifiable factors in the calculations summarized as follows:  
 40

## Postulated Accidents

- 1 • Uncertainty in the internal events CDF was not explicitly included in the calculations,  
2 which employed best-estimate values to determine the benefits. The 95-percent  
3 confidence level for internal events CDF is approximately 2 times the best-estimate CDF.  
4 However, the results of the cost-benefit analysis show that all of the SAMAs evaluated  
5 would cost much more than twice the associated benefit. Therefore, consideration of  
6 CDF uncertainty is not expected to alter the conclusions of the analysis.  
7
- 8 • External events were similarly not included in the St. Lucie risk profile. However, given  
9 that the expected external events contribution to CDF is small, and the observation that  
10 there are no particular vulnerabilities in the external event risk profile at St. Lucie, any  
11 additional benefits that might accrue due to external events would fall within the factor of  
12 2 margin used in the screening analysis.  
13
- 14 • Risk reduction and cost estimates were generally found to be conservative. As such,  
15 uncertainty in the costs of any of the contemplated SAMAs would not likely have the  
16 effect of making them cost beneficial.  
17
- 18 • A number of sensitivity calculations were performed with respect to the discount rate (as  
19 low as 3 percent) and various MACCS2 parameters, including evacuation percentage  
20 and speed, meteorological data, population distribution, and source terms. The results  
21 of these calculations showed that none of the risk benefits were increased by more than  
22 a factor of 1.2. Since this is less than the margin between cost and benefit for the  
23 SAMAs considered, the uncertainties in these parameters would not alter the  
24 conclusions.  
25

### 5.2.5 Conclusions

26  
27  
28 FPL compiled a list of 169 SAMA candidates using the SAMA analyses as submitted in support  
29 of licensing activities for other nuclear power plants, NRC and industry documents discussing  
30 potential plant improvements, and the plant-specific insights from the FPL IPE, IPEEE, and  
31 current PSA model. A qualitative screening removed SAMA candidates that (1) did not apply to  
32 St. Lucie Units 1 and 2 due to design differences, or (2) the SAMA had already been  
33 implemented at St. Lucie (or the design meets the intent of the SAMA, as determined by plant  
34 review of each SAMA). A total of 119 SAMA candidates were eliminated based on the above  
35 criteria, leaving 50 SAMA candidates for further evaluation.  
36

37 Using guidance in NUREG/BR-0184 (NRC 1997b), the current PSA model, and a Level 3  
38 analysis developed specifically for SAMA evaluation, a maximum attainable benefit of about  
39 \$1,382,000 was calculated, representing the total present dollar value equivalent associated  
40 with completely eliminating severe accidents at St. Lucie. Twenty-nine of the 50 SAMAs were  
41 screened from further evaluation because their single unit implementation costs were greater

1 than this maximum attainable benefit. Each of the remaining 21 SAMAs was eliminated on the  
2 basis that their implementation cost exceeded twice the estimated benefit for that specific  
3 SAMA. The factor of two was used to account for uncertainties in the analysis and the potential  
4 impact of external events on the results of the SAMA evaluations. The end result was that no  
5 SAMA candidates were found to be cost-beneficial.

6  
7 The staff reviewed the FPL analysis and has preliminarily concluded that the methods used and  
8 the implementation of those methods were sound. The treatment of SAMA benefits and costs,  
9 the generally large negative net benefits, and the inherently small baseline risks support the  
10 general conclusion that the SAMA evaluations performed by FPL are reasonable and sufficient  
11 for the license renewal submittal. The unavailability of a seismic and fire PSA model precluded  
12 a quantitative evaluation of the SAMAs specifically aimed at reducing risk of these initiators;  
13 however, significant improvements have been realized as a result of the IPEEE process at St.  
14 Lucie that would minimize the likelihood of identifying cost-beneficial enhancements in this area.

15  
16 Based on its review of the FPL SAMA analyses, the staff preliminarily concurs that none of the  
17 candidate SAMAs are cost-beneficial. This is based on conservative treatment of costs and  
18 benefits. This preliminary conclusion is consistent with the low residual level of risk indicated in  
19 the St. Lucie PSA and the fact that St. Lucie has already implemented many plant  
20 improvements identified from the IPE and IPEEE process.  
21

### 5.3 References

10 CFR 50. Code of Federal Regulations, Title 10, *Energy*, Part 50, "Domestic Licensing of Production and Utilization Facilities."

10 CFR 51. Code of Federal Regulations, Title 10, *Energy*, Part 51, "Environmental Protection Regulations for Domestic Licensing and Related Regulatory Functions."

10 CFR 54. Code of Federal Regulations, Title 10, *Energy*, Part 54, "Requirements for Renewal of Operating Licenses for Nuclear Power Plants."

Florida Power and Light Company (FPL). 1993. Letter from D. A. Sager (FPL) to Document Control Desk (NRC). Subject: St. Lucie Units 1 and 2 Summary Report of Individual Plant Examination for Severe Accident Vulnerabilities – Generic Letter 88-20, December 9, 1993.

Florida Power and Light Company (FPL). 1994. Letter from D. A. Sager (FPL) to Document Control Desk (NRC). Subject: St. Lucie Units 1 and 2 – NRC Generic Letter 88-20, Supplement 4, Individual Plant Examination of External Events for Severe Accident Vulnerabilities Report, December 15, 1994.

## Postulated Accidents

Florida Power and Light Company (FPL). 2001. *Applicant's Environmental Report--Operating License Renewal Stage, St. Lucie Units 1 and 2*. Docket Nos. 50-335 and 50-389, Miami, Florida.

Florida Power and Light Company (FPL). 2002a. Letter from D. E. Jernigan (FPL) to Document Control Desk (NRC). Subject: Response to Request for Additional Information Related to the Staff's Review of Severe Accident Mitigation Alternatives for St. Lucie Units 1 and 2, June 25, 2002.

Florida Power and Light Company (FPL). 2002b. Letter from D. E. Jernigan (FPL) to Document Control Desk (NRC). Subject: Supplemental Response to NRC Request for Additional Information Related to the Staff's Review of Severe Accident Mitigation Alternatives for St. Lucie Units 1 and 2. August 26, 2002. ML022410053.

U.S. Nuclear Regulatory Commission (NRC). 1997a. *Individual Plant Examination Program: Perspectives on Reactor Safety and Plant Performance*. NUREG-1560, Washington, D.C.

U.S. Nuclear Regulatory Commission (NRC). 1997b. Letter from L. A. Wiens (NRC) to T. P. Plunkett (Florida Power and Light Company). Subject: Staff Evaluation Report of St. Lucie, Units 1 and 2, Individual Plant Examination (IPE) Submittal, July 21, 1997.

U.S. Nuclear Regulatory Commission (NRC). 1997c. *SECPOP90: Sector Population, Land Fraction, and Economic Estimation Program*. NUREG/CR-6525, Washington, D.C.

U.S. Nuclear Regulatory Commission (NRC). 1997d. *Regulatory Analysis Technical Evaluation Handbook*. NUREG/BR-0184, Washington, D.C.

U.S. Nuclear Regulatory Commission (NRC). 1999. Letter from W. C. Gleves (NRC) to T. F. Plunkett (Florida Power and Light Company). Subject: Generic Letter 88-20, Supplement 4, Individual Plant Examination for External Events for Severe Accident Vulnerabilities - St. Lucie Plant, Unit Nos. 1 and 2, January 25, 1999.

U.S. Nuclear Regulatory Commission (NRC). 2002a. Letter from M. T. Masnik (NRC) to J. A. Stall (FPL). Subject: Request for Additional Information Related to the Staff's Review of Severe Accident Mitigation Alternatives for St. Lucie Units 1 and 2, May 7, 2002.

U.S. Nuclear Regulatory Commission (NRC). 2002b. Memo to file from M. T. Masnik (NRC). Subject: Telecommunication with Florida Power and Light Company to Discuss Information Provided to the NRC Staff in FPL Response to NRC Request for Additional Information dated June 25, 2002, July 29, 2002.

## 6.0 Environmental Impacts of the Uranium Fuel Cycle and Solid Waste Management

Environmental issues associated with the uranium fuel cycle and solid waste management are discussed in the *Generic Environmental Impact Statement for License Renewal of Nuclear Plants* (GEIS), NUREG-1437, Volumes 1 and 2 (NRC 1996, 1999.)<sup>(a)</sup> The GEIS includes a determination of whether the analysis of the environmental issue could be applied to all plants and whether additional mitigation measures would be warranted. Issues are then assigned a Category 1 or a Category 2 designation. As set forth in the GEIS, Category 1 issues are those that meet all of the following criteria:

- (1) The environmental impacts associated with the issue have been determined to apply either to all plants or, for some issues, to plants having a specific type of cooling system or other specified plant or site characteristic.
- (2) A single significance level (i.e., SMALL, MODERATE, or LARGE) has been assigned to the impacts (except for collective offsite radiological impacts from the fuel cycle and from high-level waste [HLW] and spent fuel disposal).
- (3) Mitigation of adverse impacts associated with the issue has been considered in the analysis, and it has been determined that additional plant-specific mitigation measures are likely not to be sufficiently beneficial to warrant implementation.

For issues that meet the three Category 1 criteria, no additional plant-specific analysis is required unless new and significant information is identified.

Category 2 issues are those that do not meet one or more of the criteria for Category 1, and therefore, additional plant-specific review of these issues is required.

This chapter addresses the issues that are related to the uranium fuel cycle and solid waste management during the license renewal term that are listed in Table B-1 of 10 CFR Part 51, Subpart A, Appendix B, and are applicable to St. Lucie Units 1 and 2. The generic potential impacts of the radiological and nonradiological environmental impacts of the uranium fuel cycle and transportation of nuclear fuel and wastes are described in detail in the GEIS based, in part, on the generic impacts provided in 10 CFR 51.51(b), Table S-3, "Table of Uranium Fuel Cycle

---

(a) The GEIS was originally issued in 1996. Addendum 1 to the GEIS was issued in 1999. Hereafter, all references to the "GEIS" include the GEIS and its Addendum 1.

## Fuel Cycle

1 Environmental Data,” and in 10 CFR 51.52(c), Table S-4, “Environmental Impact of  
2 Transportation of Fuel and Waste to and from One Light-Water-Cooled Nuclear Power  
3 Reactor.” The staff also addresses the impacts from radon-222 and technetium-99 in the  
4 GEIS. There are no Category 2 issues for the uranium fuel cycle and solid waste management.  
5

### 6.1 The Uranium Fuel Cycle

6  
7  
8 Category 1 issues in 10 CFR Part 51, Subpart A, Appendix B, Table B-1, that are applicable to  
9 St. Lucie Units 1 and 2 from the uranium fuel cycle and solid waste management are listed in  
10 Table 6-1.  
11

12 **Table 6-1. Category 1 Issues Applicable to the Uranium Fuel Cycle and Solid Waste**  
13 **Management During the Renewal Term**  
14

ISSUE—10 CFR Part 51, Subpart A, Appendix B, Table B-1	GEIS Section
<b>URANIUM FUEL CYCLE AND WASTE MANAGEMENT</b>	
17 Offsite radiological impacts (individual effects from other than the 18 disposal of spent fuel and HLW)	6.1; 6.2.1; 6.2.2.1; 6.2.2.3; 6.2.3; 6.2.4; 6.6
19 Offsite radiological impacts (collective effects)	6.1; 6.2.2.1; 6.2.3; 6.2.4; 6.6
20 Offsite radiological impacts (spent fuel and HLW)	6.1; 6.2.2.1; 6.2.3; 6.2.4; 6.6
21 Nonradiological impacts of the uranium fuel cycle	6.1; 6.2.2.6; 6.2.2.7; 6.2.2.8; 6.2.2.9; 6.2.3; 6.2.4; 6.6
22 Low-level waste storage and disposal	6.1; 6.2.2.2; 6.4.2; 6.4.3; 6.4.3.1; 6.4.3.2; 6.4.3.3; 6.4.4; 6.4.4.1; 6.4.4.2; 6.4.4.3; 6.4.4.4; 6.4.4.5; 6.4.4.5.1; 6.4.4.5.2; 6.4.4.5.3; 6.4.4.5.4; 6.4.4.6; 6.6
23 Mixed waste storage and disposal	6.4.5.1; 6.4.5.2; 6.4.5.3; 6.4.5.4; 6.4.5.5; 6.4.5.6; 6.4.5.6.1; 6.4.5.6.2; 6.4.5.6.3; 6.4.5.6.4; 6.6
24 Onsite spent fuel	6.1; 6.4.6; 6.4.6.1; 6.4.6.2; 6.4.6.3; 6.4.6.4; 6.4.6.5; 6.4.6.6; 6.4.6.7; 6.6
25 Nonradiological waste	6.1; 6.5; 6.5.1; 6.5.2; 6.5.3; 6.6
26 Transportation	6.1; 6.3.1; 6.3.2.3; 6.3.3; 6.3.4; 6.6, Addendum 1

1 Florida Power and Light Company (FPL) stated in its Environmental Report (ER; FPL 2001) that  
2 it is not aware of any new and significant information associated with the renewal of the  
3 St. Lucie Units 1 and 2 operating licenses. The staff has not identified any significant new  
4 information during its independent review of the ER (FPL 2001), the staff's site visit, the scoping  
5 process, or its evaluation of other available information. Therefore, the staff concludes that  
6 there are no impacts related to these issues beyond those discussed in the GEIS. For these  
7 issues, the staff concluded in the GEIS that the impacts are SMALL except for the collective  
8 offsite radiological impacts from the fuel cycle and from HLW and spent fuel disposal, as  
9 discussed below, and that additional plant-specific mitigation measures are not likely to be  
10 sufficiently beneficial to be warranted.

11  
12 A brief description of the staff review and the GEIS conclusions, as codified in Table B-1 of  
13 10 CFR 51, for each of these issues follows:

- 14 • Offsite radiological impacts (individual effects from other than the disposal of spent  
15 fuel and high level waste. Based on information in the GEIS, the Commission  
16 found that  
17

18  
19 Off-site impacts of the uranium fuel cycle have been considered by the  
20 Commission in Table S-3 of this part [10 CFR 51.51(b)]. Based on  
21 information in the GEIS, impacts on individuals from radioactive gaseous  
22 and liquid releases including radon-222 and technetium-99 are small.  
23

24 The staff has not identified any new and significant information during its independent  
25 review of the ER (FPL 2001), the staff's site visit, the scoping process, or its evaluation of  
26 other available information. Therefore, the staff concludes that there are no offsite  
27 radiological impacts of the uranium fuel cycle during the renewal term beyond those  
28 discussed in the GEIS.  
29

- 30 • Offsite radiological impacts (collective effects). Based on information in the GEIS,  
31 the Commission found that  
32

33 The 100 year environmental dose commitment to the U.S. population from  
34 the fuel cycle, high level waste and spent fuel disposal excepted, is  
35 calculated to be about 14,800 person rem [148 person Sv], or 12 cancer  
36 fatalities, for each additional 20-year power reactor operating term. Much  
37 of this, especially the contribution of radon releases from mines and tailing  
38 piles, consists of tiny doses summed over large populations. This same  
39 dose calculation can theoretically be extended to include many tiny doses  
40 over additional thousands of years as well as doses outside the U. S. The  
41 result of such a calculation would be thousands of cancer fatalities from  
42 the fuel cycle, but this result assumes that even tiny doses have some

## Fuel Cycle

1 statistical adverse health effect which will not ever be mitigated (for  
2 example no cancer cure in the next thousand years), and that these doses  
3 projected over thousands of years are meaningful. However, these  
4 assumptions are questionable. In particular, science cannot rule out the  
5 possibility that there will be no cancer fatalities from these tiny doses. For  
6 perspective, the doses are very small fractions of regulatory limits and  
7 even smaller fractions of natural background exposure to the same  
8 populations.

9  
10 Nevertheless, despite all the uncertainty, some judgement as to the  
11 regulatory NEPA [National Environmental Policy Act] implications of these  
12 matters should be made and it makes no sense to repeat the same  
13 judgement in every case. Even taking the uncertainties into account, the  
14 Commission concludes that these impacts are acceptable in that these  
15 impacts would not be sufficiently large to require the NEPA conclusion, for  
16 any plant, that the option of extended operation under 10 CFR Part 54  
17 should be eliminated. Accordingly, while the Commission has not  
18 assigned a single level of significance for the collective effects of the fuel  
19 cycle, this issue is considered Category 1.

20  
21 The staff has not identified any new and significant information during its independent  
22 review of the ER (FPL 2001), the staff's site visit, the scoping process, or its evaluation of  
23 other available information. Therefore, the staff concludes that there are no offsite  
24 radiological impacts (collective effects) from the uranium fuel cycle during the renewal  
25 term beyond those discussed in the GEIS.

- 26  
27 • Offsite radiological impacts (spent fuel and HLW disposal). Based on information  
28 in the GEIS, the Commission found that

29  
30 For the high level waste and spent fuel disposal component of the fuel  
31 cycle, there are no current regulatory limits for offsite releases of  
32 radionuclides for the current candidate repository site. However, if we  
33 assume that limits are developed along the lines of the 1995 National  
34 Academy of Sciences (NAS) report, "Technical Bases for Yucca Mountain  
35 Standards," and that in accordance with the Commission's Waste  
36 Confidence Decision, 10 CFR 51.23, a repository can and likely will be  
37 developed at some site which will comply with such limits, peak doses to  
38 virtually all individuals will be 100 millirem [1 mSv] per year or less.  
39 However, while the Commission has reasonable confidence that these  
40 assumptions will prove correct, there is considerable uncertainty since the

1 limits are yet to be developed, no repository application has been  
2 completed or reviewed, and uncertainty is inherent in the models used to  
3 evaluate possible pathways to the human environment. The NAS report  
4 indicated that 100 millirem [1 mSv] per year should be considered as a  
5 starting point for limits for individual doses, but notes that some measure  
6 of consensus exists among national and international bodies that the limits  
7 should be a fraction of the 100 millirem [1 mSv] per year. The lifetime  
8 individual risk from 100 millirem [1 mSv] annual dose limit is about  $3 \times 10^{-3}$ .

9  
10 Estimating cumulative doses to populations over thousands of years is  
11 more problematic. The likelihood and consequences of events that could  
12 seriously compromise the integrity of a deep geologic repository were  
13 evaluated by the Department of Energy in the "Final Environmental Impact  
14 Statement: Management of Commercially Generated Radioactive Waste,"  
15 October 1980 [DOE 1980]. The evaluation estimated the 70-year whole-  
16 body dose commitment to the maximum individual and to the regional  
17 population resulting from several modes of breaching a reference  
18 repository in the year of closure, after 1,000 years, after 100,000 years,  
19 and after 100,000,000 years. Subsequently, the NRC and other federal  
20 agencies have expended considerable effort to develop models for the  
21 design and for the licensing of a high level waste repository, especially for  
22 the candidate repository at Yucca Mountain. More meaningful estimates  
23 of doses to population may be possible in the future as more is  
24 understood about the performance of the proposed Yucca Mountain  
25 repository. Such estimates would involve very great uncertainty,  
26 especially with respect to cumulative population doses over thousands of  
27 years. The standard proposed by the NAS is a limit on maximum  
28 individual dose. The relationship of potential new regulatory requirements,  
29 based on the NAS report, and cumulative population impacts has not been  
30 determined, although the report articulates the view that protection of  
31 individuals will adequately protect the population for a repository at Yucca  
32 Mountain. However, EPA's generic repository standards in 40 CFR  
33 part 191 generally provide an indication of the order of magnitude of  
34 cumulative risk to population that could result from the licensing of a  
35 Yucca Mountain repository, assuming the ultimate standards will be within  
36 the range of standards now under consideration. The standards in  
37 40 CFR part 191 protect the population by imposing "containment  
38 requirements" that limit the cumulative amount of radioactive material  
39 released over 10,000 years. Reporting performance standards that will be  
40 required by EPA are expected to result in releases and associated health

## Fuel Cycle

1 consequences in the range between 10 and 100 premature cancer deaths  
2 with an upper limit of 1,000 premature cancer deaths world-wide for a  
3 100,000 metric tonne (MTHM) repository.  
4

5 Nevertheless, despite all the uncertainty, some judgement as to the  
6 regulatory NEPA implications of these matters should be made and it  
7 makes no sense to repeat the same judgement in every case. Even  
8 taking the uncertainties into account, the Commission concludes that  
9 these impacts are acceptable in that these impacts would not be  
10 sufficiently large to require the NEPA conclusion, for any plant, that the  
11 option of extended operation under 10 CFR part 54 should be eliminated.  
12 Accordingly, while the Commission has not assigned a single level of  
13 significance for the impacts of spent fuel and high level waste disposal,  
14 this issue is considered Category 1.  
15

16 Since the GEIS was issued in 1996, the U. S. Environmental Protection Agency (EPA)  
17 has published radiation protection standards for Yucca Mountain, Nevada, at 40 CFR  
18 Part 197, "Public Health and Environmental Radiation Protection Standards for Yucca  
19 Mountain, Nevada," on June 13, 2001 (66 FR 32132). The Energy Policy Act of 1992  
20 (42 USC 10101 et seq.) directs that the NRC adopt these standards into its regulations  
21 for reviewing and licensing the repository. The NRC published its regulations at 10 CFR  
22 Part 63, on November 2, 2001 (66 FR 55792). These standards include the following:  
23 (1) a 0.15-mSv/yr (15-mrem/yr) dose limit for members of the public during the storage  
24 period prior to repository closure, (2) a 0.15-mSv/yr (15-mrem/yr) dose limit for the  
25 reasonably maximally exposed individual for 10,000 years following disposal, (3) a  
26 0.15-mSv/yr (15-mrem/yr) dose limit for the reasonably maximally exposed individual as  
27 a result of a human intrusion at or before 10,000 years after disposal, and (4) a  
28 groundwater protection standard that states for 10,000 years of undisturbed performance  
29 after disposal, radioactivity in a representative volume of groundwater will not exceed  
30 (a) 0.19 Bq/L (5 pCi/L) (radium-226 and radium-228), (b) 0.56 Bq/L (15 pCi/L) (gross  
31 alpha activity), and (c) 0.04 mSv/yr (4 mrem/yr) to the whole body or any organ (from  
32 combined beta and photon emitting radionuclides).  
33

34 On February 15, 2002, subsequent to receipt of a recommendation by Secretary  
35 Abraham, U.S. Department of Energy, the President recommended the Yucca Mountain  
36 site for the development of a repository for the geologic disposal of spent nuclear fuel  
37 and high-level nuclear waste. This change in regulatory status does not cause the staff  
38 to change its position with respect to the impact of spent fuel and HLW disposal. The  
39 staff still considers the Category 1 classification in the GEIS appropriate.

1 The staff has not identified any new and significant information during its independent  
2 review of the ER (FPL 2001), the staff's site visit, the scoping process, or its evaluation of  
3 other available information. Therefore, the staff concludes that there are no offsite  
4 radiological impacts related to spent fuel and HLW disposal during the renewal term  
5 beyond those discussed in the GEIS.

- 6  
7 • Nonradiological impacts of the uranium fuel cycle. Based on information in the  
8 GEIS, the Commission found that

9  
10 The nonradiological impacts of the uranium fuel cycle resulting from the  
11 renewal of an operating license for any plant are found to be small.

12  
13 The staff has not identified any new and significant information during its independent  
14 review of the ER (FPL 2001), the staff's site visit, the scoping process, or its evaluation of  
15 other available information. Therefore, the staff concludes that there are no  
16 nonradiological impacts of the uranium fuel cycle during the renewal term beyond those  
17 discussed in the GEIS.

- 18  
19 • Low-level waste storage and disposal. Based on information in the GEIS, the  
20 Commission found that

21  
22 The comprehensive regulatory controls that are in place and the low public  
23 doses being achieved at reactors ensure that the radiological impacts to  
24 the environment will remain small during the term of a renewed license.  
25 The maximum additional on-site land that may be required for low-level  
26 waste storage during the term of a renewed license and associated  
27 impacts will be small. Nonradiological impacts on air and water will be  
28 negligible. The radiological and nonradiological environmental impacts of  
29 long-term disposal of low-level waste from any individual plant at licensed  
30 sites are small. In addition, the Commission concludes that there is  
31 reasonable assurance that sufficient low-level waste disposal capacity will  
32 be made available when needed for facilities to be decommissioned  
33 consistent with NRC decommissioning requirements.

34  
35 The staff has not identified any new and significant information during its independent  
36 review of the ER (FPL 2001), the staff's site visit, the scoping process, or its evaluation of  
37 other available information. Therefore, the staff concludes that there are no impacts of  
38 low-level waste storage and disposal associated with the renewal term beyond those  
39 discussed in the GEIS.  
40

## Fuel Cycle

- 1 • Mixed waste storage and disposal. Based on information in the GEIS, the  
2 Commission found that

3  
4 The comprehensive regulatory controls and the facilities and procedures  
5 that are in place ensure proper handling and storage, as well as negligible  
6 doses and exposure to toxic materials for the public and the environment  
7 at all plants. License renewal will not increase the small, continuing risk to  
8 human health and the environment posed by mixed waste at all plants.  
9 The radiological and nonradiological environmental impacts of long-term  
10 disposal of mixed waste from any individual plant at licensed sites are  
11 small. In addition, the Commission concludes that there is reasonable  
12 assurance that sufficient mixed waste disposal capacity will be made  
13 available when needed for facilities to be decommissioned consistent with  
14 NRC decommissioning requirements.

15  
16 The staff has not identified any new and significant information during its independent  
17 review of the ER (FPL 2001), the staff's site visit, the scoping process, or its evaluation of  
18 other available information. Therefore, the staff concludes that there are no impacts of  
19 mixed waste storage and disposal associated with the renewal term beyond those  
20 discussed in the GEIS.

- 21  
22 • Onsite spent fuel. Based on information in the GEIS, the Commission found that

23  
24 The expected increase in the volume of spent fuel from an additional  
25 20 years of operation can be safely accommodated on site with small  
26 environmental effects through dry or pool storage at all plants if a  
27 permanent repository or monitored retrievable storage is not available.

28  
29 The staff has not identified any new and significant information during its independent  
30 review of the ER (FPL 2001), the staff's site visit, the scoping process, or its evaluation of  
31 other available information. Therefore, the staff concludes that there are no impacts of  
32 onsite spent fuel associated with license renewal beyond those discussed in the GEIS.

- 33  
34 • Nonradiological waste. Based on information in the GEIS, the Commission found  
35 that

36  
37 No changes to generating systems are anticipated for license renewal.  
38 Facilities and procedures are in place to ensure continued proper handling  
39 and disposal at all plants.  
40

1 The staff has not identified any new and significant information during its independent  
 2 review of the ER (FPL 2001), the staff's site visit, the scoping process, or its evaluation of  
 3 other available information. Therefore, the staff concludes that there are no  
 4 nonradiological waste impacts during the renewal term beyond those discussed in the  
 5 GEIS.

- 6
- 7 • Transportation. Based on information contained in the GEIS, the Commission  
 8 found that

9

10 The impacts of transporting spent fuel enriched up to 5 percent uranium-  
 11 235 with average burnup for the peak rod to current levels approved by  
 12 NRC up to 62,000 MWd/MTU and the cumulative impacts of transporting  
 13 high-level waste to a single repository, such as Yucca Mountain, Nevada  
 14 are found to be consistent with the impact values contained in 10 CFR  
 15 51.52(c), Summary Table S-4—Environmental Impact of Transportation of  
 16 Fuel and Waste to and from One Light-Water-Cooled Nuclear Power  
 17 Reactor. If fuel enrichment or burnup conditions are not met, the  
 18 applicant must submit an assessment of the implications for the  
 19 environmental impact values reported in §. 51.52.  
 20

21 St. Lucie Units 1 and 2 meet the fuel-enrichment and burnup conditions set forth in  
 22 Addendum 1 to the GEIS. The staff has not identified any new and significant  
 23 information during its independent review of the ER (FPL 2001), the staff's site visit, the  
 24 scoping process, or its evaluation of other available information. Therefore, the staff  
 25 concludes that there are no impacts of transportation associated with license renewal  
 26 beyond those discussed in the GEIS.  
 27

## 28 6.2 References

29

30 10 CFR 51. Code of Federal Regulations, Title 10, *Energy*, Part 51, "Environmental Protection  
 31 Regulations for Domestic Licensing and Related Regulatory Functions."

32

33 10 CFR 54. Code of Federal Regulations, Title 10, *Energy*, Part 54, "Requirements for  
 34 Renewal of Operating Licenses for Nuclear Power Plants."

35

36 10 CFR 63. Code of Federal Regulations, Title 10, *Energy*, Part 63, "Disposal of High-Level  
 37 Radioactive Wastes in a Geologic Repository at Yucca Mountain, Nevada."

38

39 40 CFR 191. Code of Federal Regulations, Title 40, *Protection of Environment*, Part 191,  
 40 "Environmental Radiation Protection Standards for Management and Disposal of Spent Nuclear  
 41 Fuel, High-Level and Transuranic Radioactive Wastes."

## Fuel Cycle

- 1 40 CFR 197. Code of Federal Regulations, Title 40, *Protection of Environment*, Part 197,  
2 "Public Health and Environmental Radiation Protection Standards for Yucca Mountain,  
3 Nevada."  
4
- 5 Energy Policy Act of 1992. 42 USC 10101, et seq.  
6
- 7 Florida Power and Light Company (FPL). 2001. *Applicant's Environmental Report – Operating*  
8 *License Renewal Stage St. Lucie Units 1 and 2*. Docket Nos. 50-335 and 50-389, Miami,  
9 Florida.  
10
- 11 National Academy of Sciences (NAS). 1995. *Technical Bases for Yucca Mountain Standards*.  
12 Washington, D.C.  
13
- 14 National Environmental Policy Act of 1969 (NEPA). 42 USC 4321, et seq.  
15
- 16 U.S. Department of Energy (DOE). 1980. *Final Environmental Impact Statement:*  
17 *Management of Commercially Generated Radioactive Waste*. DOE/EIS-0046F,  
18 Washington, D.C.  
19
- 20 U.S. Nuclear Regulatory Commission (NRC). 1996. *Generic Environmental Impact Statement*  
21 *for License Renewal of Nuclear Plants*. NUREG-1437, Volumes 1 and 2, Washington, D.C.  
22
- 23 U.S. Nuclear Regulatory Commission (NRC). 1999. *Generic Environmental Impact Statement*  
24 *for License Renewal of Nuclear Plants, Main Report*, "Section 6.3 – Transportation, Table 9.1,  
25 Summary of findings on NEPA issues for license renewal of nuclear power plants, Final  
26 Report." NUREG-1437, Volume 1, Addendum 1, Washington, D.C.

## 7.0 Environmental Impacts of Decommissioning

Environmental issues associated with decommissioning, which result from continued plant operation during the renewal term are discussed in the *Generic Environmental Impact Statement for License Renewal of Nuclear Plants (GEIS)*, NUREG-1437, Volumes 1 and 2 (NRC 1996, 1999).<sup>(a)</sup> The GEIS includes a determination of whether the analysis of the environmental issue could be applied to all plants and whether additional mitigation measures would be warranted. Issues are then assigned a Category 1 or a Category 2 designation. As set forth in the GEIS, Category 1 issues are those that meet all of the following criteria:

- (1) The environmental impacts associated with the issue have been determined to apply either to all plants or, for some issues, to plants having a specific type of cooling system or other specified plant or site characteristic.
- (2) A single significance level (i.e., SMALL, MODERATE, or LARGE) has been assigned to the impacts (except for collective offsite radiological impacts from the fuel cycle and from high level waste and spent fuel disposal).
- (3) Mitigation of adverse impacts associated with the issue has been considered in the analysis, and it has been determined that additional plant-specific mitigation measures are likely not to be sufficiently beneficial to warrant implementation.

For issues that meet the three Category 1 criteria, no additional plant-specific analysis is required unless new and significant information is identified.

Category 2 issues are those that do not meet one or more of the criteria for Category 1, and therefore, additional plant-specific review of these issues is required. There are no Category 2 issues related to decommissioning.

Category 1 issues in Table B-1 of 10 CFR Part 51, Subpart A, Appendix B, that are applicable to St. Lucie Units 1 and 2 decommissioning following the renewal term are listed in Table 7-1. Florida Power and Light Company (FPL) stated in its Environmental Report (ER; FPL 2001) that it is aware of no new and significant information regarding the environmental impacts of St. Lucie Units 1 and 2 license renewal. The staff has not identified any significant new information during its independent review of the ER (FPL 2001), the staff's site visit, the scoping process, or its evaluation of other available information. Therefore, the staff concludes that

---

(a) The GEIS was originally issued in 1996. Addendum 1 to the GEIS was issued in 1999. Hereafter, all references to the "GEIS" include the GEIS and its Addendum 1.

## Environmental Impacts of Decommissioning

1 there are no impacts related to these issues beyond those discussed in the GEIS. For all of  
2 these issues, the staff concluded in the GEIS that the impacts are SMALL, and additional plant-  
3 specific mitigation measures are not likely to be sufficiently beneficial to be warranted.  
4

5 **Table 7-1. Category 1 Issues Applicable to the Decommissioning of St. Lucie Units 1 and 2**  
6 **Following the Renewal Term**  
7

ISSUE—10 CFR Part 51, Subpart A, Appendix B, Table B-1	GEIS Section
DECOMMISSIONING	
Radiation Doses	7.3.1; 7.4
Waste Management	7.3.2; 7.4
Air Quality	7.3.3; 7.4
Water Quality	7.3.4; 7.4
Ecological Resources	7.3.5; 7.4
Socioeconomic Impacts	7.3.7; 7.4

17  
18 A brief description of the staff's review and the GEIS conclusions, as codified in Table B-1, for  
19 each of the issues follows:  
20

- 21 • Radiation doses. Based on information in the GEIS, the Commission found that

22  
23 Doses to the public will be well below applicable regulatory standards regardless  
24 of which decommissioning method is used. Occupational doses would increase  
25 no more than 1 man-rem [0.01 person-Sv] caused by buildup of long-lived  
26 radionuclides during the license renewal term.  
27

28 The staff has not identified any new and significant information during its independent  
29 review of the ER (FPL 2001), the staff's site visit, the scoping process, or its evaluation of  
30 other available information. Therefore, the staff concludes that there are no radiation doses  
31 associated with decommissioning following license renewal beyond those discussed in the  
32 GEIS.  
33

- 34 • Waste management. Based on information in the GEIS, the Commission found that

35  
36 Decommissioning at the end of a 20-year license renewal period would generate  
37 no more solid wastes than at the end of the current license term. No increase in  
38 the quantities of Class C or greater than Class C wastes would be expected.  
39

40 The staff has not identified any new and significant information during its independent  
41 review of the ER (FPL 2001), the staff's site visit, the scoping process, or its evaluation of

1 other available information. Therefore, the staff concludes that there are no impacts of solid  
2 waste associated with decommissioning following the license renewal term beyond those  
3 discussed in the GEIS.

- 4  
5 • Air quality. Based on information in the GEIS, the Commission found that

6  
7 Air quality impacts of decommissioning are expected to be negligible either at  
8 the end of the current operating term or, at the end of the license renewal term.

9  
10 The staff has not identified any new and significant information during its independent  
11 review of the ER (FPL 2001), the staff's site visit, the scoping process, or its evaluation of  
12 other available information. Therefore, the staff concludes that there are no impacts of  
13 license renewal on air quality during decommissioning beyond those discussed in the GEIS.

- 14  
15 • Water quality. Based on information in the GEIS, the Commission found that

16  
17 The potential for significant water quality impacts from erosion or spills is no  
18 greater whether decommissioning occurs after a 20-year license renewal period  
19 or after the original 40-year operation period, and measures are readily available  
20 to avoid such impacts.

21  
22 The staff has not identified any new and significant information during its independent  
23 review of the ER (FPL 2001), the staff's site visit, the scoping process, or its evaluation of  
24 other available information. Therefore, the staff concludes that there are no impacts of the  
25 license renewal term on water quality during decommissioning beyond those discussed in  
26 the GEIS.

- 27  
28 • Ecological resources. Based on information in the GEIS, the Commission found that

29  
30 Decommissioning after either the initial operating period or after a 20-year  
31 license renewal period is not expected to have any direct ecological impacts.

32  
33 The staff has not identified any new and significant information during its independent  
34 review of the ER (FPL 2001), the staff's site visit, the scoping process, or its evaluation of  
35 other available information. Therefore, the staff concludes that there are no impacts of the  
36 license renewal term on ecological resources during decommissioning beyond those  
37 discussed in the GEIS.

## Environmental Impacts of Decommissioning

- 1 • Socioeconomic impacts. Based on information in the GEIS, the Commission found that

2  
3 Decommissioning would have some short-term socioeconomic impacts. The  
4 impacts would not be increased by delaying decommissioning until the end of a  
5 20-year relicense period, but they might be decreased by population and  
6 economic growth.

7  
8 The staff has not identified any new and significant information during its independent  
9 review of the ER (FPL 2001), the staff's site visit, the scoping process, or its evaluation of  
10 other available information. Therefore, the staff concludes that there are no impacts of  
11 license renewal on the socioeconomic impacts of decommissioning beyond those discussed  
12 in the GEIS.

### 13 14 **7.1 References**

15  
16 10 CFR 51. Code of Federal Regulations, Title 10, *Energy*, Part 51, "Environmental Protection  
17 Regulations for Domestic Licensing and Related Regulatory Functions."

18  
19 Florida Power and Light Company (FPL). 2001. *Applicant's Environmental Report – Operating*  
20 *License Renewal Stage, St. Lucie Units 1 and 2.* Docket Nos. 50-335 and 50-389, Miami,  
21 Florida.

22  
23 U.S. Nuclear Regulatory Commission (NRC). 1996. *Generic Environmental Impact Statement*  
24 *for License Renewal of Nuclear Plants.* NUREG-1437, Volumes 1 and 2, Washington, D.C.

25  
26 U.S. Nuclear Regulatory Commission (NRC). 1999. *Generic Environmental Impact Statement*  
27 *for License Renewal of Nuclear Plants, Main Report,* "Section 6.3 – Transportation, Table 9.1,  
28 Summary of findings on NEPA issues for license renewal of nuclear power plants, Final  
29 Report." NUREG-1437, Volume 1, Addendum 1, Washington, D.C.